

## Case summary

Incident ID: 23-06352  
Patient ID: 2023030322321100-LP1547542357  
Patient Name: Hyman

Patient ID:	<u>2023030322321100-LP1547542357</u>	Birth Date:	
Incident ID:	<u>23-06352</u>	Device ID:	<u>LP152357</u>
Age at Incident:	<u>40 Years</u>	Case Start Date:	<u>3/3/2023</u>
Sex:	<u>Female</u>	Case Start Time:	<u>10:32:10 PM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

### Case Summary:

Total Analyses: 0  
Total Shocks: 2  
Total 12-Leads: 0  
Total Time Paced: 00:00:00

### Notes:

\*\*\*

Completed interval stats.

compressions added, at least 4 missed V-Fibs. extended times between pulse checks.

Updated at 3/21/2023 12:42:25 AM by rdarden (Rick Darden).

Updated at 3/26/2023 10:03:40 PM by zphillips (Zach Phillips).

### Comments:

# Table of Contents

CPR reports (by CPR period) .....3

    CPR report (by CPR period) .....3

# CPR report




Device Type: LIFEPAK® 15  
 Power On: 3/3/2023 10:32:10 PM  
 CPR Annotations Edited: Yes  
 Device Configuration: 2L355RRB0200UR

Duration: 00:29:19  
 Incident ID: 23-06352  
 Statistical Parameters: 1000-0300-3000-05


\*Times have been adjusted by the system.

Compression ratio  
 (/total time)




17:23 / 19:43 = 88 %

Compression rate




139/minute

Ventilations/minute




10/minute

Initial Rhythm

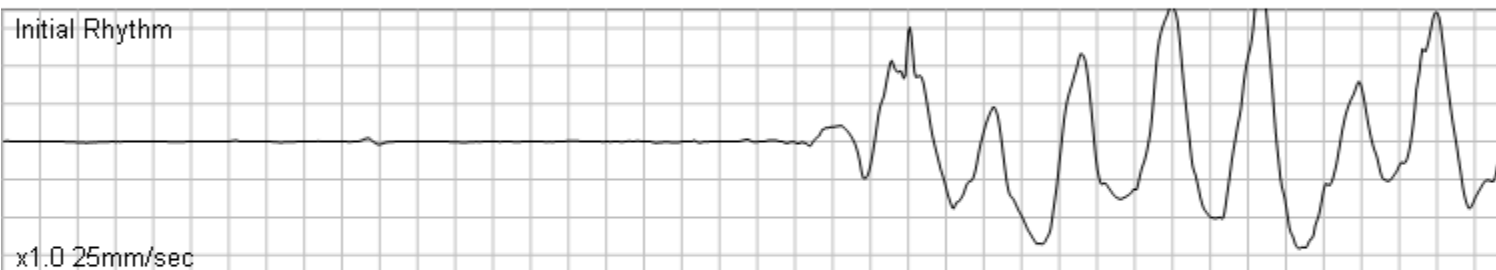

CO2 (mmHg)

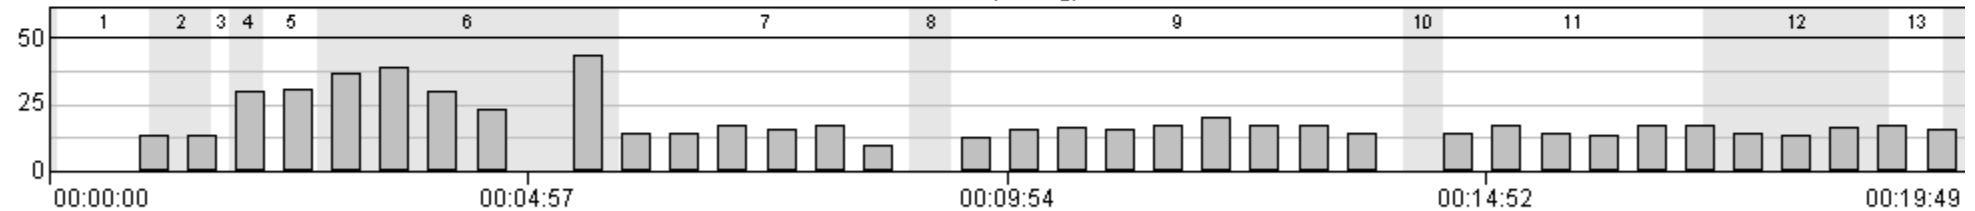

## CPR report



Device Type: LIFEPAK® 15  
 Power On: 3/3/2023 10:32:10 PM  
 CPR Annotations Edited: Yes  
 Device Configuration: 2L355RRB0200UR

Duration: 00:29:19  
 Incident ID: 23-06352  
 Statistical Parameters: 1000-0300-3000-05

\*Times have been adjusted by the system.

### Summary

CPR needed	= 19:43	CPR done	= 17:22
CPR not done	= 2:21	Compression count	= 2341
Longest compression pause	= 0:47	Pauses over 10 sec	= 4

Comment

### Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:04	00:00:59	00:00:55	00:00:02	Pulse/rhythm check	Try to minimize interruptions.	100	125	--
2		00:01:01	00:01:37	00:00:36	00:00:02	Pulse/rhythm check	Try to minimize interruptions.	94	137	8
3		00:01:39	00:01:47	00:00:08	00:00:04	Pulse/rhythm check	Try to minimize interruptions.	66	144	--
4		00:01:52	00:02:07	00:00:15	00:00:05	Pulse/rhythm check	Try to minimize interruptions.	75	137	--
5		00:02:12	00:02:43	00:00:31	00:00:04	Pulse/rhythm check	Try to minimize interruptions.	90	137	14
6		00:02:46	00:05:43	00:02:57	00:00:10	Pulse/rhythm check	Try to have pulse checks every 2 minutes. Shockable rhythm that was not defibrillated.	95	139	9
7		00:05:53	00:08:06	00:02:13	00:00:47	Pulse/rhythm check	Long pause. Shockable rhythm throughout.	74	139	10
8		00:08:53	00:09:03	00:00:10	00:00:17	Defibrillation	Long pre-shock pause even though it was pre-charged.	42	156	--
9		00:09:20	00:13:54	00:04:34	00:00:06	Pulse/rhythm check	Long time between pulse checks. Shockable rhythm. Try to pre-charge monitor.	98	142	10
10		00:14:00	00:14:04	00:00:03	00:00:22	Defibrillation	Try to pre-charge monitor. Compressions during charging. Post shock pause could be shorter.	13	146	--
11		00:14:26	00:17:02	00:02:36	00:00:04	Pulse/rhythm check	Extra 30 seconds between pulse check. Shockable rhythm that was not shocked.	97	139	10
12		00:17:06	00:18:57	00:01:51	00:00:05	Pulse/rhythm check	Shockable rhythm, not shocked.	95	134	11
13		00:19:02	00:19:22	00:00:21	00:00:13	Pulse/rhythm check	Shockable rhythm, not shocked.	60	124	12

# CPR report




Device Type: LIFEPAK® 15  
 Power On: 3/3/2023 10:32:10 PM  
 CPR Annotations Edited: Yes  
 Device Configuration: 2L355RRB0200UR

Duration: 00:29:19  
 Incident ID: 23-06352  
 Statistical Parameters: 1000-0300-3000-05


\*Times have been adjusted by the system.

## Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
14		00:19:36	00:19:48	00:00:12	00:00:00	Termination/Transfer of Care		96	134	--



## CPR QUIK-VIEW

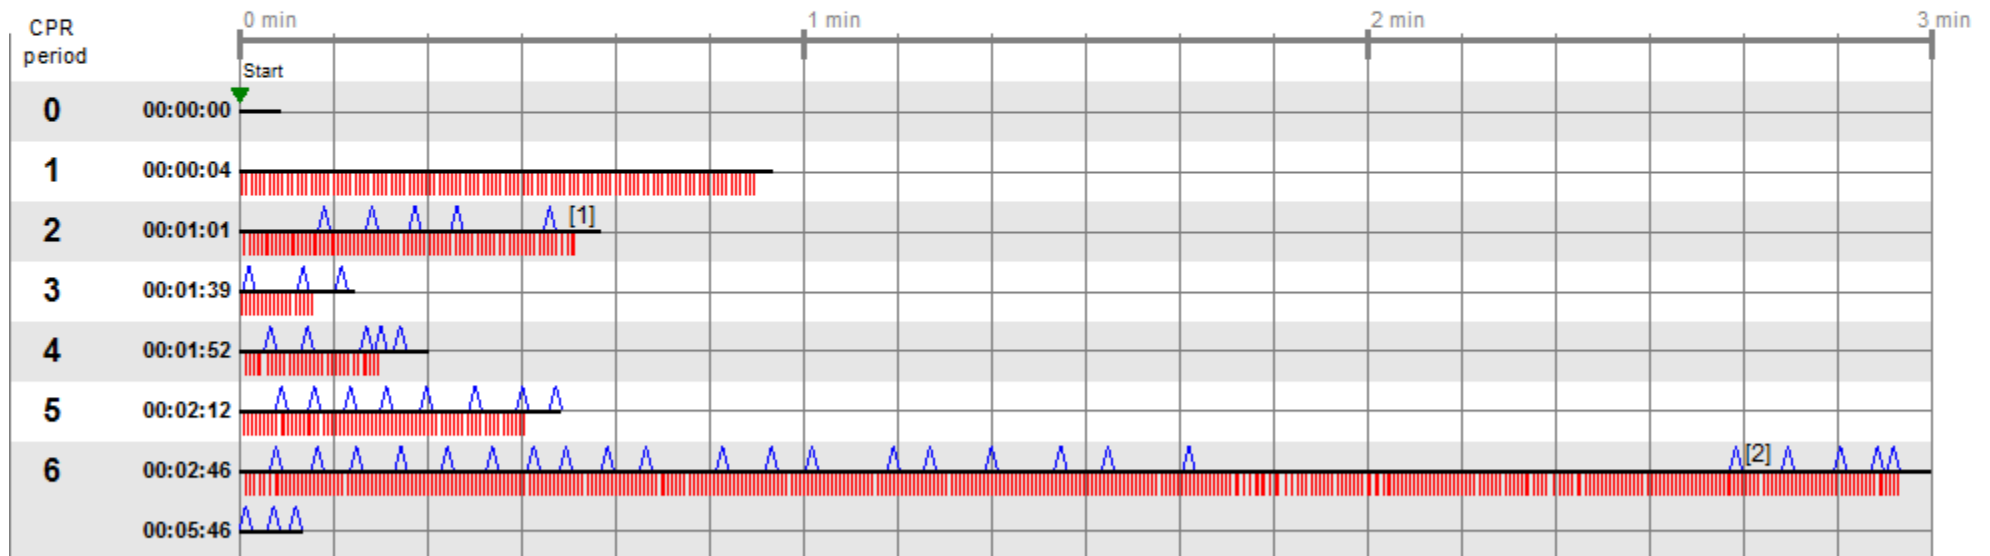

# CPR report




Device Type: LIFEPAK® 15  
 Power On: 3/3/2023 10:32:10 PM  
 CPR Annotations Edited: Yes  
 Device Configuration: 2L355RRB0200UR

Duration: 00:29:19  
 Incident ID: 23-06352  
 Statistical Parameters: 1000-0300-3000-05

\*Times have been adjusted by the system.

## CPR QUIK-VIEW

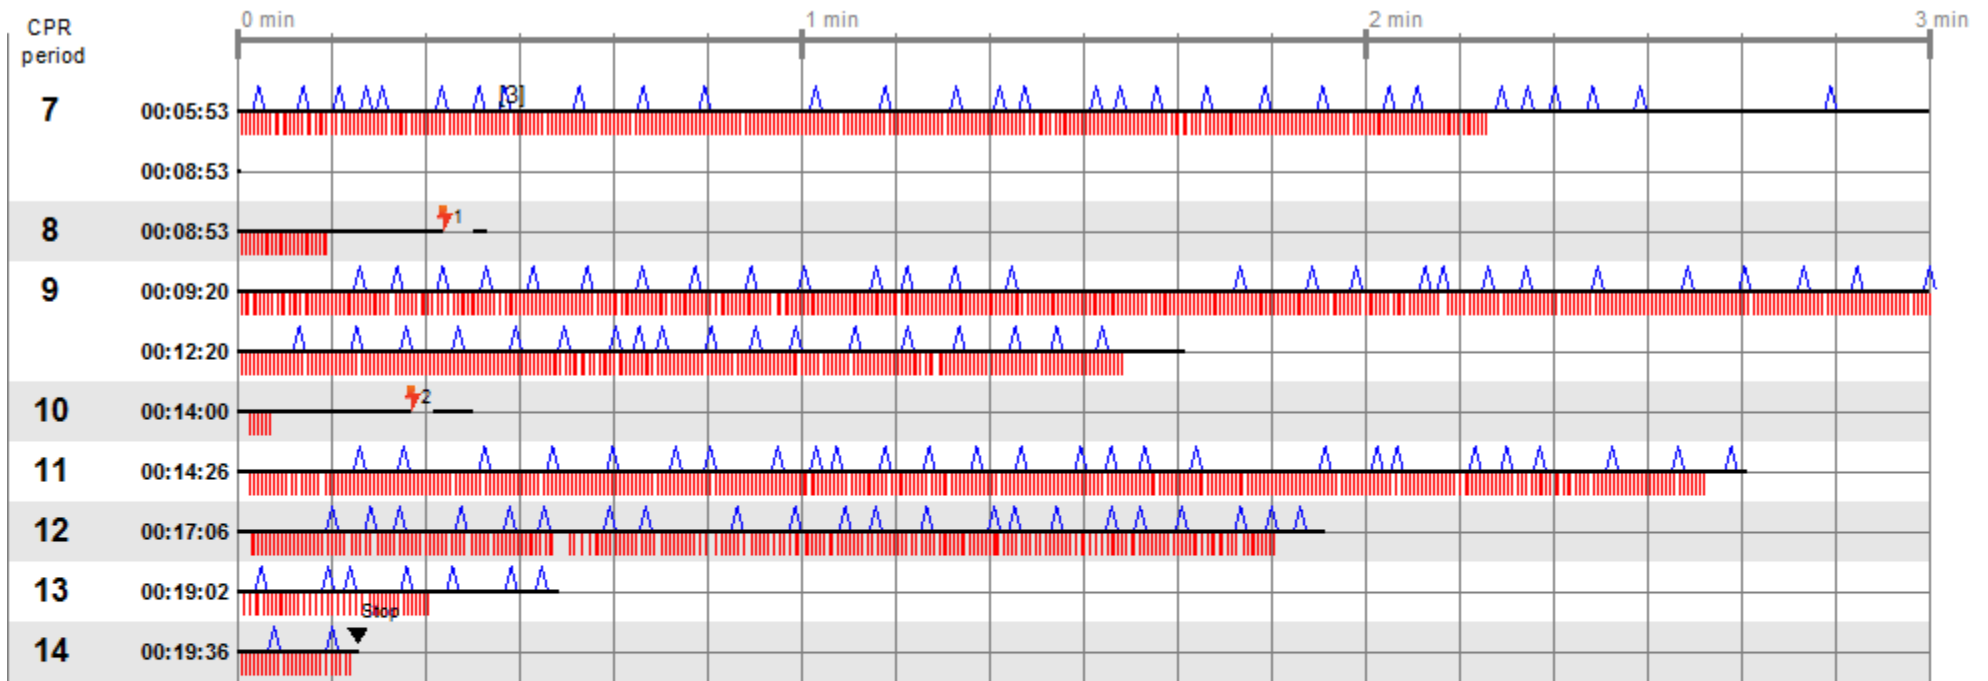

[1] Generic, [2] Generic, [3] Epinephrine

Shock	Time	Energy	Pre-shock CPR pause	Post-shock CPR pause
⚡1	9:15	360 J	0:12	0:05
⚡2	14:19	360 J	0:15	0:07