

Case summary

Incident ID: 23-05139
Patient ID: 2023022006395800-LP1547545197
Patient Name: Alfieri

Patient ID:	<u>2023022006395800-LP1547545197</u>	Birth Date:	
Incident ID:	<u>23-05139</u>	Device ID:	<u>MICU 66</u>
Age at Incident:	<u>69 Years</u>	Case Start Date:	<u>2/20/2023</u>
Sex:	<u>Male</u>	Case Start Time:	<u>6:40:00 AM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

Notes:

Summary complete

Demos only

Updated at 3/13/2023 1:38:04 AM by zphillips (Zach Phillips).

Updated at 3/27/2023 2:03:19 AM by zphillips (Zach Phillips).

Comments:

Table of Contents

CPR reports (by CPR period)	3
CPR report (by CPR period)	3

CPR report




Device Type: LIFEPAK® 15
Power On: 2/20/2023 6:40:00 AM
CPR Annotations Edited: Yes
Device Configuration: 2L355R040200UR

Duration: 00:29:34
Incident ID: 23-05139
Statistical Parameters: 1000-0300-3000-05


*Times have been adjusted by the system.

Compression ratio
(/total time)




14:38 / 15:50 = 92 %

Compression rate




129/minute

Ventilations/minute



--

Initial Rhythm

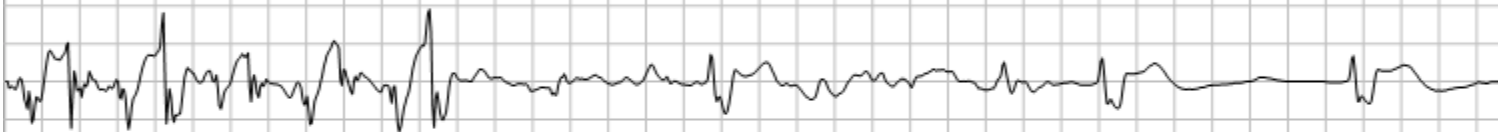

x1.0 25mm/sec

Summary

CPR needed	= 15:50	CPR done	= 14:36
CPR not done	= 1:14	Compression count	= 1836
Longest compression pause	= 0:17	Pauses over 10 sec	= 3

Comment

CPR report



Device Type: LIFEPAK® 15
Power On: 2/20/2023 6:40:00 AM
CPR Annotations Edited: Yes
Device Configuration: 2L355RO40200UR

Duration: 00:29:34
Incident ID: 23-05139
Statistical Parameters: 1000-0300-3000-05


*Times have been adjusted by the system.

Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:00	00:00:03	00:00:03	00:00:15	Pulse/rhythm check		16	124	--
2		00:00:18	00:03:08	00:02:50	00:00:30	Unknown	Leads off, but due for pulse check in there.	99	115	--
3		00:03:38	00:04:18	00:00:40	00:00:06	Pulse/rhythm check		87	118	--
4		00:04:25	00:06:16	00:01:51	00:00:05	Pulse/rhythm check		96	139	--
5		00:06:21	00:09:15	00:02:54	00:00:14	Pulse/rhythm check	2:54 between pulse checks	93	121	--
6		00:09:29	00:10:19	00:00:50	00:00:06	Pulse/rhythm check	:50 between pulse checks.	89	145	--
7		00:10:25	00:12:20	00:01:55	00:00:09	Pulse/rhythm check		93	144	--
8		00:12:29	00:13:56	00:01:27	00:00:17	Pulse/rhythm check	Long pause	84	133	--
9		00:14:13	00:16:19	00:02:05	00:00:00	Termination/Transfer of Care		100	127	--

Ventilation
 Chest compression
 AED Analysis
 AED-prompted CPR period
 Shock
 ROSC (user annotated)

CPR QUIK-VIEW

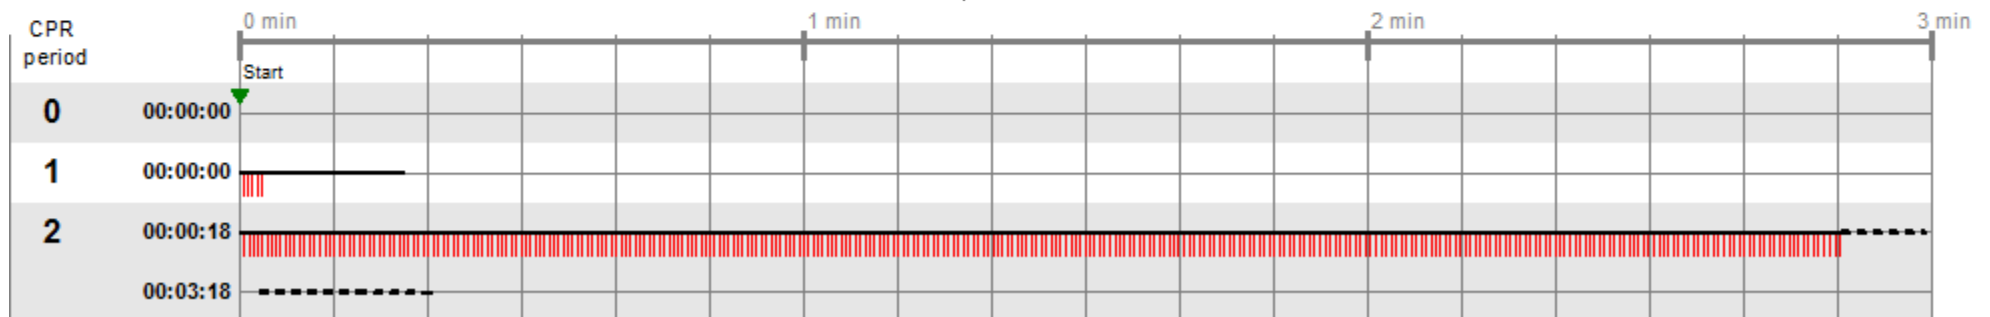

CPR report




Device Type: LIFEPAK® 15
 Power On: 2/20/2023 6:40:00 AM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355R040200UR

Duration: 00:29:34
 Incident ID: 23-05139
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

CPR QUIK-VIEW

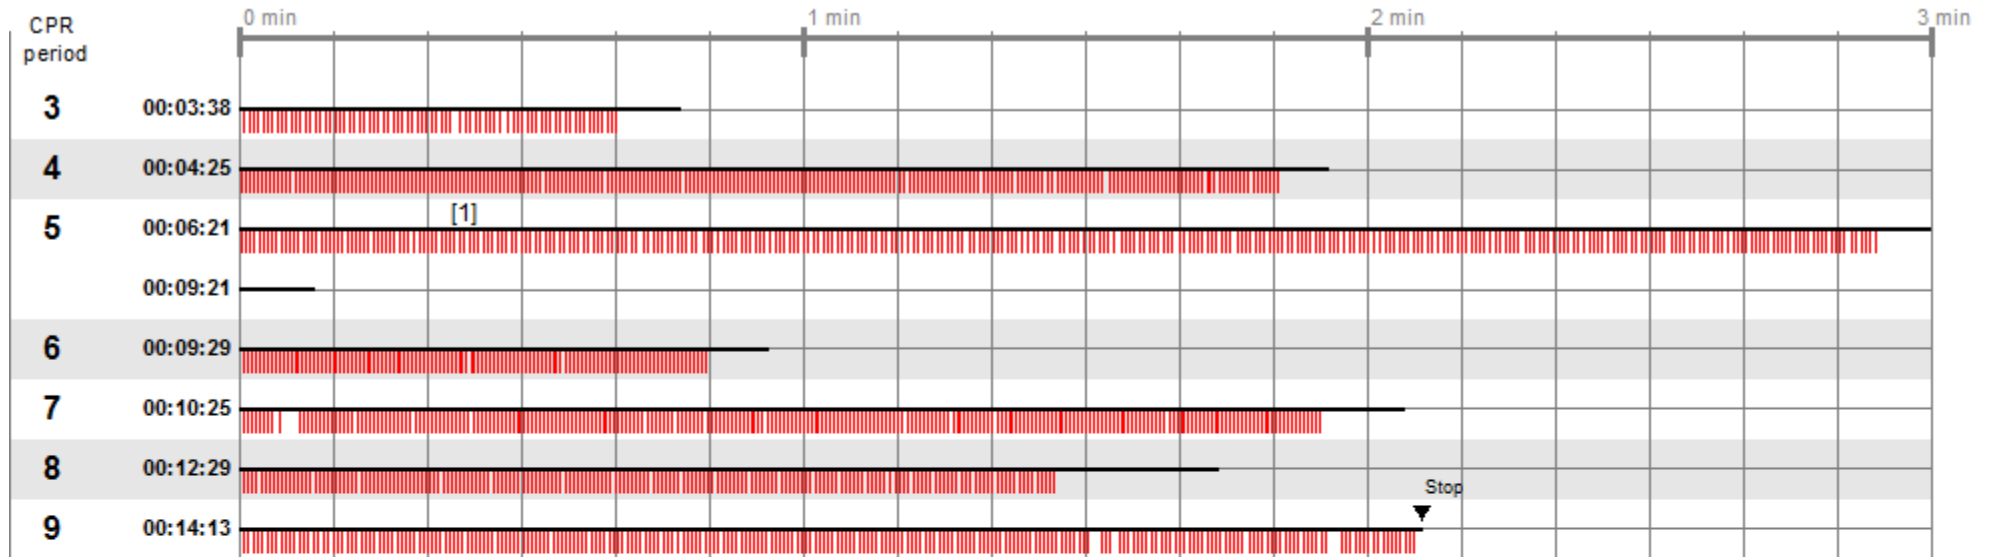

[1] EPINEPHRINE 10