

Case summary

Incident ID: 23-03782
Patient ID: 2023020706233500-LP1547542357
Patient Name: Pedrick

Patient ID:	<u>2023020706233500-LP1547542357</u>	Birth Date:	
Incident ID:	<u>23-03782</u>	Device ID:	<u>LP152357</u>
Age at Incident:	<u>36 Years</u>	Case Start Date:	<u>2/7/2023</u>
Sex:	<u>Male</u>	Case Start Time:	<u>6:23:36 AM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

Notes:

Long times between pulse checks
Updated at 3/12/2023 7:44:05 PM by zphillips (Zach Phillips).
Updated demos
Updated at 3/12/2023 7:45:30 PM by zphillips (Zach Phillips).

Comments:

Table of Contents

CPR reports (by CPR period)3

 CPR report (by CPR period)3

CPR report




Device Type: LIFEPAK® 15
Power On: 2/7/2023 6:23:36 AM
CPR Annotations Edited: Yes
Device Configuration: 2L355RRB0200UR

Duration: 00:40:44
Incident ID: 23-03782
Statistical Parameters: 1000-0300-3000-05


*Times have been adjusted by the system.

Compression ratio
(/total time)




15:40 / 16:57 = 92 %

Compression rate





126/minute

Ventilations/minute



9/minute

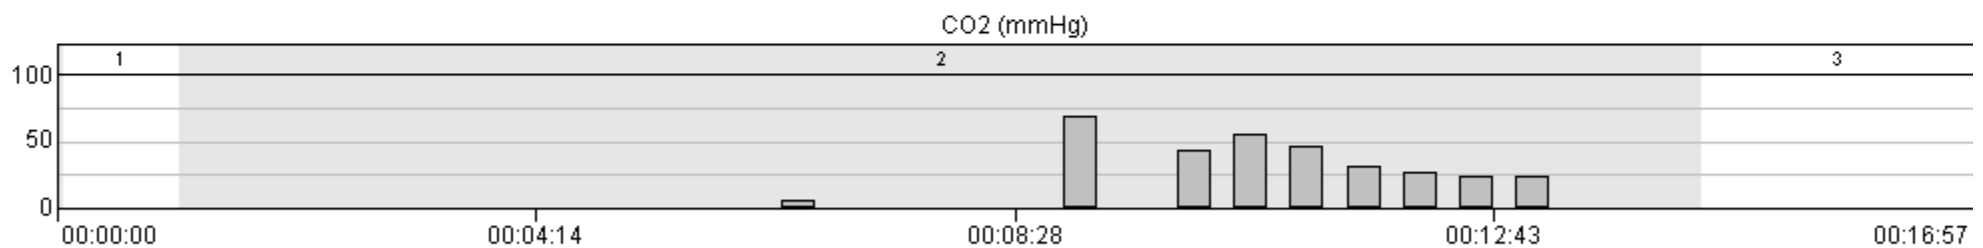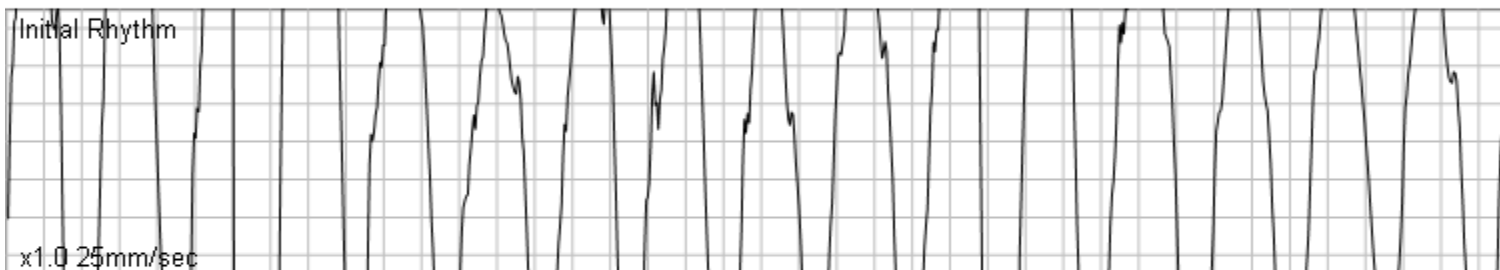

CPR report



Device Type: LIFEPAK® 15
 Power On: 2/7/2023 6:23:36 AM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355RRB0200UR

Duration: 00:40:44
 Incident ID: 23-03782
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

Summary

CPR needed	= 16:57	CPR done	= 16:23
CPR not done	= 0:33	Compression count	= 1924
Longest compression pause	= 0:21	Pauses over 10 sec	= 2

Comment

Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:00	00:00:52	00:00:52	00:00:12			74	121	--
2		00:01:04	00:14:12	00:13:08	00:00:21			93	127	3
3		00:14:33	00:16:56	00:02:23	00:00:00			95	122	--



Ventilation

— AED-prompted CPR period



Shock



Chest compression




AED Analysis



ROSC (user annotated)

CPR QUIK-VIEW

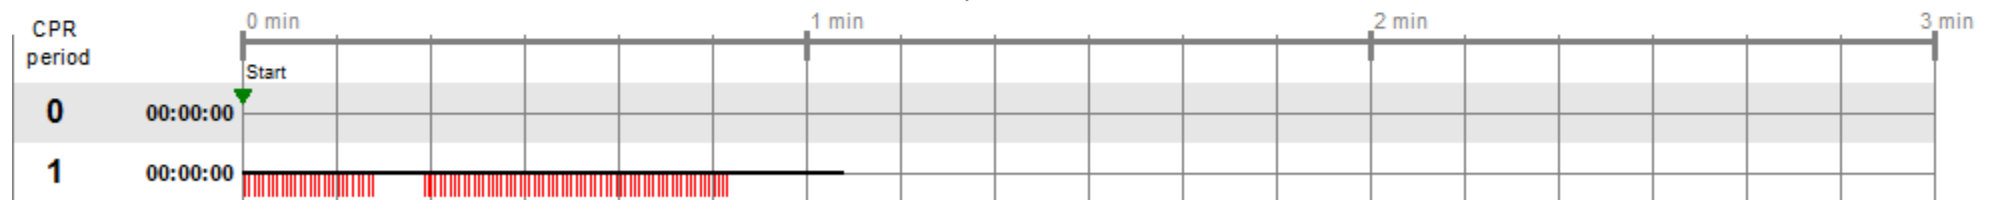

CPR report




Device Type: LIFEPAK® 15
Power On: 2/7/2023 6:23:36 AM
CPR Annotations Edited: Yes
Device Configuration: 2L355RRB0200UR

Duration: 00:40:44
Incident ID: 23-03782
Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

CPR QUIK-VIEW

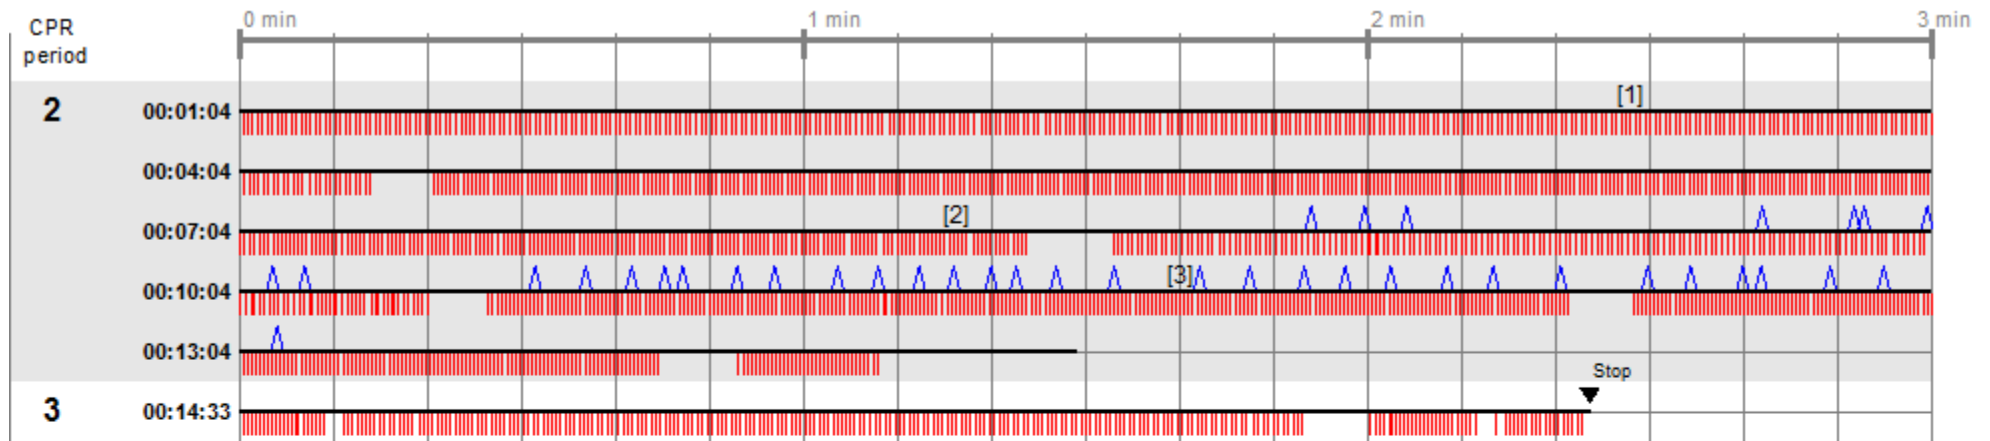

[1] Epinephrine, [2] Epinephrine, [3] Epinephrine