SITE DEVELOPMENT PLANS

INDIAN QUEEN EAST — LOT 53 & LOT 54 & LOT 55 & LOT 56

9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd
Prince George's County, Maryland

INDEX OF DRAWINGS

N

VICINITY MAP



SUBJECT PROPERTY SHOWN IN RED. NOT TO SCALE.

STATUS OF THIS SET

PRELIMINARY. NOT FOR CONSTRUCTION. NOT RELEASED FOR PERMIT. No sheet in this set bears a professional seal. Each discipline certifies only the subjects and objects within its own scope; see the divided responsibility block on each sheet.

Issued 2026-09-11

SOILS TABLE USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

DRAINAGE SWALE SCHEDULE Rational method, NOAA Atlas 14 · Manning n = 0.041, 2' bottom, 3:1 sides

REACH	LENGTH	GRADE	D.A. (AC)	Q10 (CFS)	Q100 (CFS)	DEPTH	V100 (FPS)	INV IN	INV OUT	CUT
ST-1 — ST-2	110'	3.01%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'
ST-4 — ST-3	157'	4.98%	0.3143	0.65	0.86	0.16'	2.12	60.30	52.50	1.0'
ST-3 — ST-2	177'	3.17%	0.9051	1.87	2.47	0.33'	2.51	52.50	46.90	1.0'

GRADE CONTROL SCHEDULE

POINT	LOT	DESCRIPTION	GROUND	SWALE INV
ST-1	LOT 53	Swale grade break / invert control	51.20	50.20
ST-2	LOT 54	Swale grade break / invert control	47.90	46.90
ST-3	LOT 55	Swale grade break / invert control	53.50	52.50
ST-4	LOT 56	Swale grade break / invert control	61.30	60.30
OUT	—	Swale grade break / invert control	48.90	—

SYSTEM AT THE LOW POINT: 1.7260 AC, Q10 3.57 CFS, Q100 4.71 CFS.
MAX VELOCITY 2.51 FPS AT Q100 — WITHIN THE 5 FPS PERMISSIBLE FOR ESTABLISHED GRASS. 0.5 FT FREEBOARD THROUGHOUT.
THE SWALE DISCHARGES TO THE RECORDED 54/55 STORM DRAIN EASEMENT, ALONGSIDE THE 48" RCP CL IV EXTENDING THE FORT FOOTE ROAD CULVERT INLET.
THAT MAIN IS BURIED: OD 4.67 FT, 1.5 FT MIN COVER OVER THE CROWN — FINISHED GRADE OVER IT SHALL BE NO LOWER THAN INVERT + 6.17 FT. FILL WHERE EXISTING GROUND IS LOWER.
SWALE GRADES AND INVERTS TO BE SET FROM THE FIELD-RUN TOPOGRAPHIC SURVEY. ESTABLISH SOD BEFORE THE CONTRIBUTING AREA IS STABILISED.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

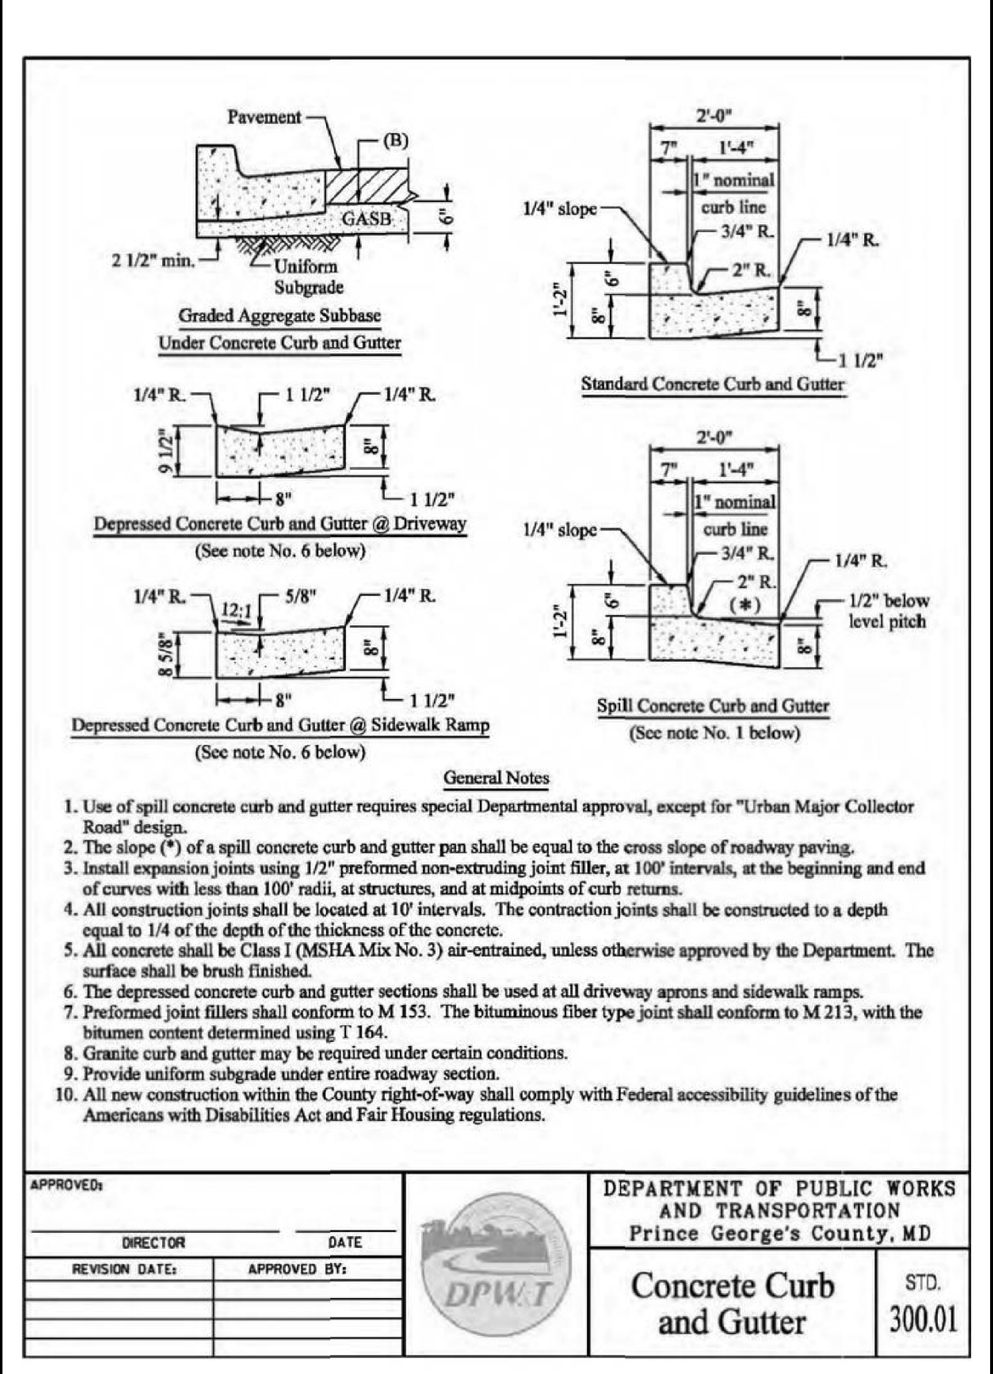

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

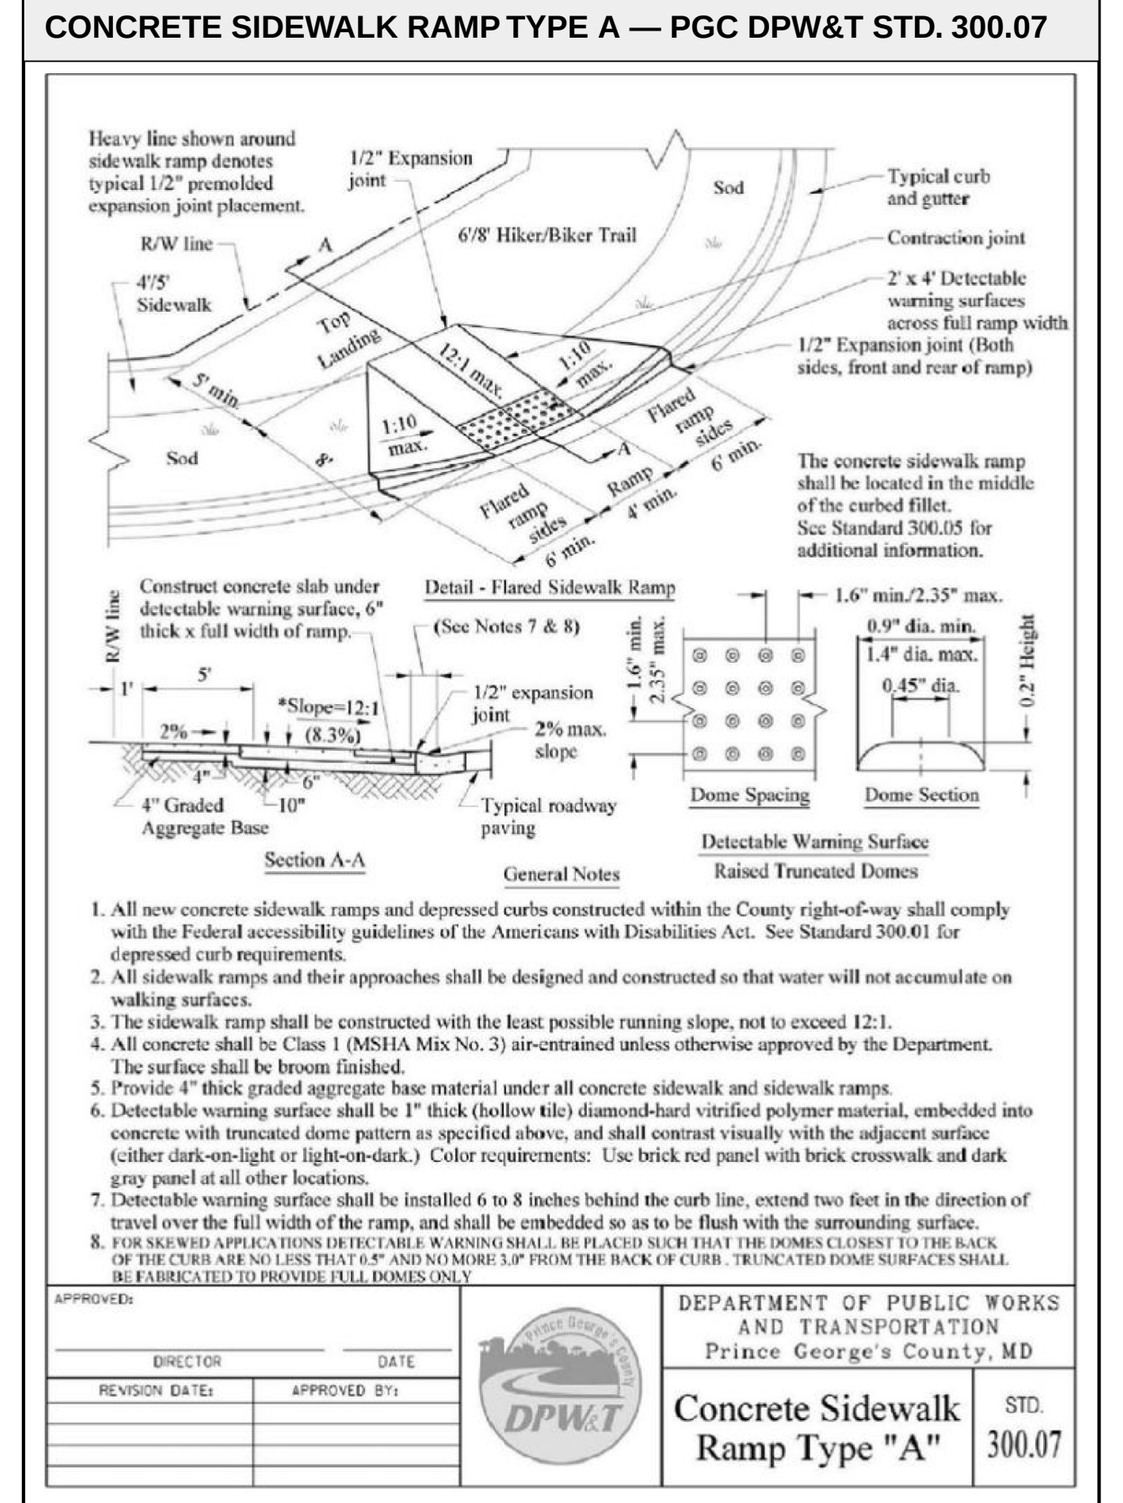

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

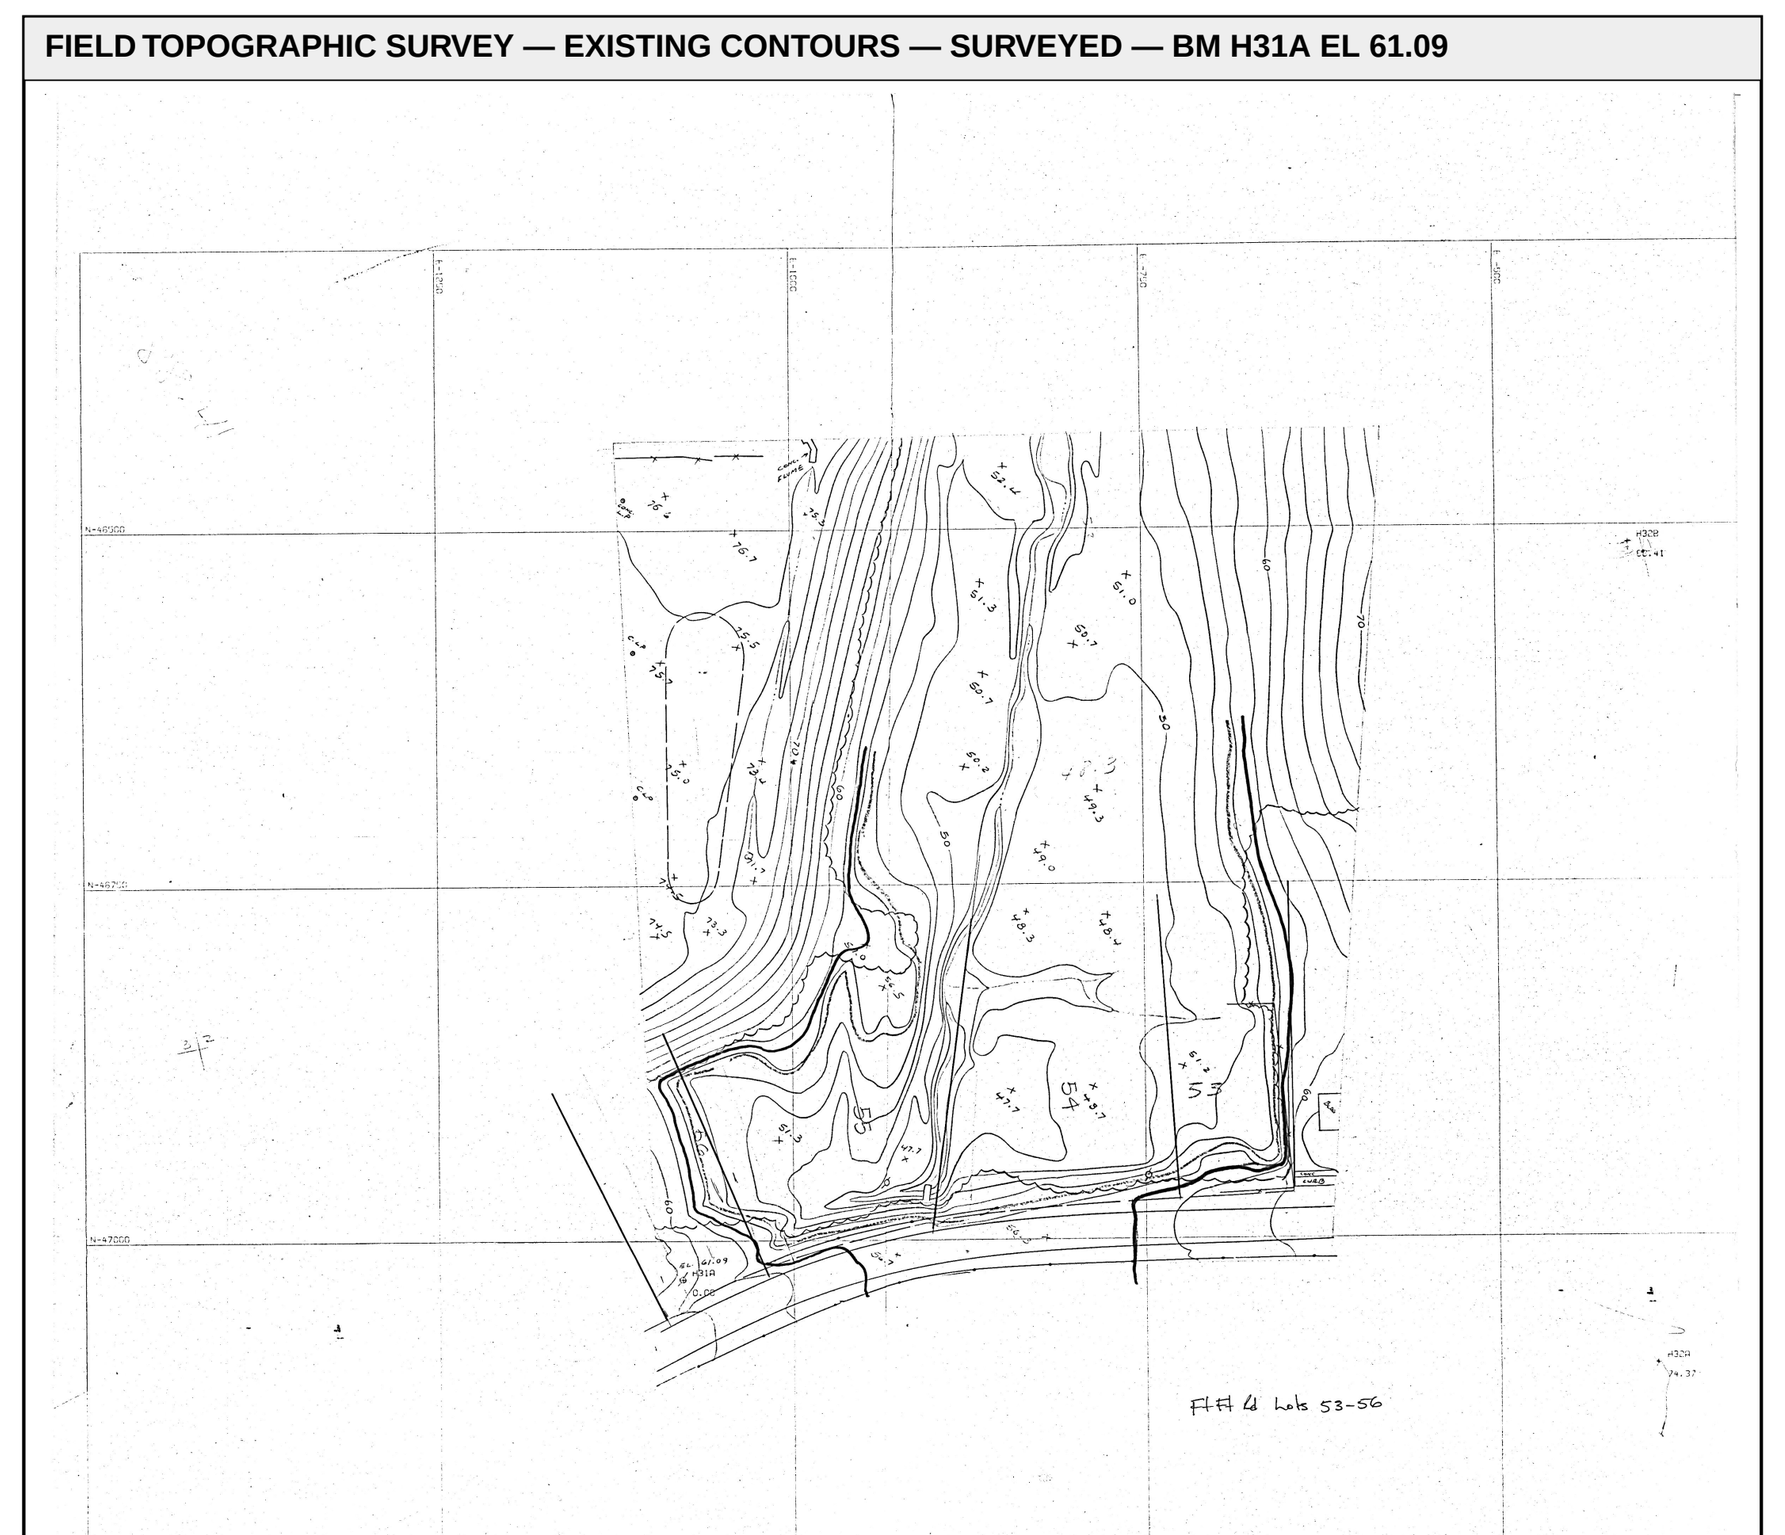

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

KEALEE

design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
C-000 — Cover Sheet, Approvals and General Notes

SCALE
1" = 30'

STATUS
PRELIMINARY

SHEET NO.
1 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION

PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-000 — Cover Sheet, Approvals and General Notes
DISCIPLINE	Kealee (coordination)
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

1 C-000 Cover Sheet, Approvals and General Notes
2 C-100 Existing Conditions and Boundary Plan
3 C-200 Overall Site and Zoning Plan
4 C-300 Demolition Plan
5 C-400 Grading and Drainage Plan
6 C-500 Utility Plan
7 C-600 Stormwater Management Plan
8 C-700 Sediment and Erosion Control Plan
9 C-800 Road, Driveway and Paving Plan
10 C-900 Civil Details
11 L-100 Landscape and Tree Canopy Plan
12 TCP-NRI Tree Conservation Plan / Natural Resource Inventory Coordination
13 FP-100 Floodplain Concept Study — Existing Conditions, Impact and Mitigation

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area — 75,178 SF
2. Area of dwelling — 4,784 SF
3. Wooded area — NOT ESTABLISHED
4. Floodplain area — NOT ESTABLISHED
5. Net lot area — 75,184 SF
6. TOTAL AREA DISTURBED — 41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3) — YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	192
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	**75,184**	**10.8%**	**2.96**	**3.84**	**0.88**	**924**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting — **1 DAY**
2. Obtain necessary permits — **2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation — **1 DAY**
4. Install stabilized construction entrance and perimeter sediment control — **2 DAYS**
5. Rough grade the lot — **5 DAYS**
6. Construct dwelling — **6 MONTHS**
7. Install water, sewer and storm services and the driveway — **10 DAYS**
8. Fine grade and stabilize all disturbed areas — **5 DAYS**
9. Remove sediment control once the inspector gives written permission — **1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F. PLAT BOOK WWW 65, P. 60 (MSA_S1289_51253). 12TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND. TAX MAP 113, BLOCK F, GRID E4. PLAT DATED 6 JUNE 1967; APPROVED 26 JUNE 1967 BY THE MARYLAND-NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD. M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR: W. L. MEEKINS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20.9811 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE ______ DATE ______
SEAL LICENSE NO. ______ EXPIRATION DATE ______

REVISIONS
— none —

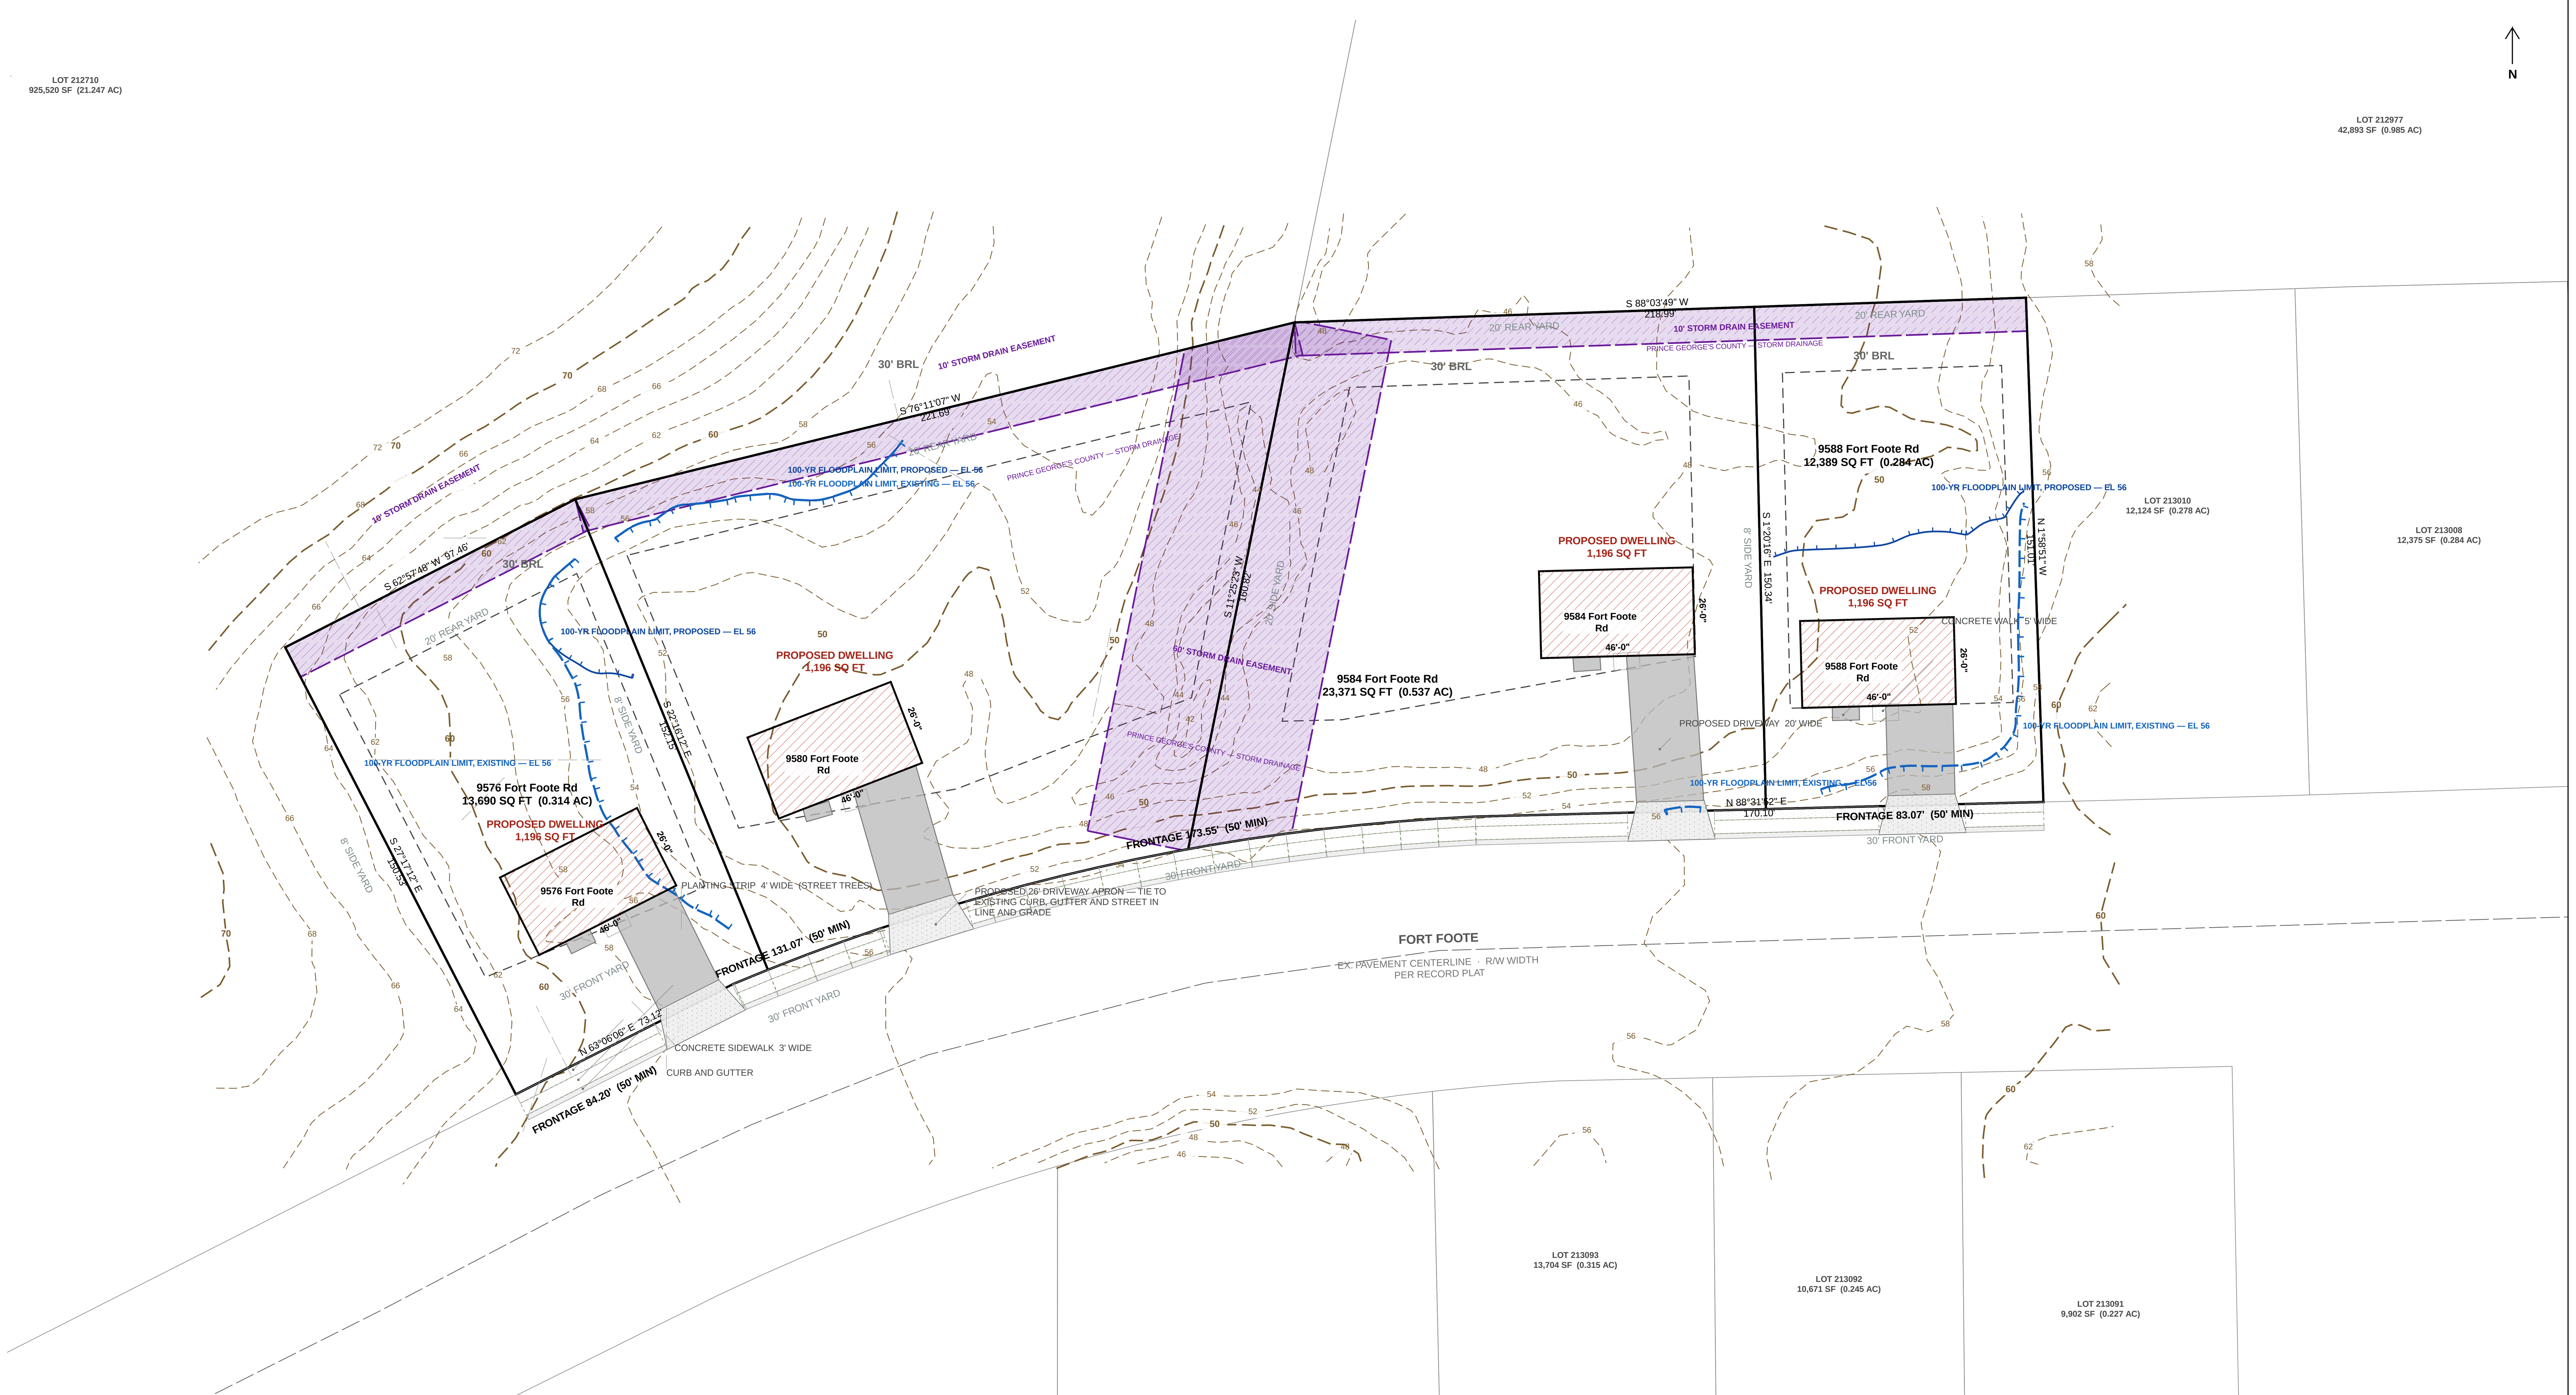

KEALEE

design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
C-100 — Existing Conditions and Boundary Plan

SCALE
1" = 30'

STATUS
PRELIMINARY

SHEET NO.
2 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION	
PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-100 — Existing Conditions and Boundary Plan
DISCIPLINE	Maryland Licensed Surveyor
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	75,178 SF
2. Area of dwelling	4,784 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	75,184 SF
6. TOTAL AREA DISTURBED	41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	192
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	**75,184**	**10.8%**	**2.96**	**3.84**	**0.88**	**924**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F. PLAT BOOK WWW 65, P. 60 (MSA_S1289_51253). 12TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND. TAX MAP 113, BLOCK F, GRID E4. PLAT DATED 6 JUNE 1967; APPROVED 26 JUNE 1967 BY THE MARYLAND-NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD. M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR: W. L. MEEKINS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20.9811 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE DATE

LICENSE NO. EXPIRATION DATE

SEAL

REVISIONS
— none —

SOILS TABLE USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

DRAINAGE SWALE SCHEDULE Rational method, NOAA Atlas 14 · Manning n = 0.041, 2' bottom, 3:1 sides

REACH	LENGTH	GRADE	D.A. (AC)	Q10 (CFS)	Q100 (CFS)	DEPTH	V100 (FPS)	INV IN	INV OUT	CUT
ST-1 — ST-2	110'	3.01%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'
ST-4 — ST-3	157'	4.98%	0.3143	0.65	0.86	0.16'	2.12	60.30	52.50	1.0'
ST-3 — ST-2	177'	3.17%	0.9051	1.87	2.47	0.33'	2.51	52.50	46.90	1.0'

GRADE CONTROL SCHEDULE

POINT	LOT	DESCRIPTION	GROUND	SWALE INV
ST-1	LOT 53	Swale grade break / invert control	51.20	50.20
ST-2	LOT 54	Swale grade break / invert control	47.90	46.90
ST-3	LOT 55	Swale grade break / invert control	53.50	52.50
ST-4	LOT 56	Swale grade break / invert control	61.30	60.30
OUT	—	Swale grade break / invert control	48.90	—

SYSTEM AT THE LOW POINT: 1.7260 AC, Q10 3.57 CFS, Q100 4.71 CFS.
MAX VELOCITY 2.51 FPS AT Q100 — WITHIN THE 5 FPS PERMISSIBLE FOR ESTABLISHED GRASS. 0.5 FT FREEBOARD THROUGHOUT.
THE SWALE DISCHARGES TO THE RECORDED 54/55 STORM DRAIN EASEMENT, ALONGSIDE THE 48" RCP CL IV EXTENDING THE FORT FOOTE ROAD CULVERT INLET.
THAT MAIN IS BURIED: OD 4.67 FT, 1.5 FT MIN COVER OVER THE CROWN — FINISHED GRADE OVER IT SHALL BE NO LOWER THAN INVERT + 6.17 FT. FILL WHERE EXISTING GROUND IS LOWER.
SWALE GRADES AND INVERTS TO BE SET FROM THE FIELD-RUN TOPOGRAPHIC SURVEY. ESTABLISH SOD BEFORE THE CONTRIBUTING AREA IS STABILISED.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

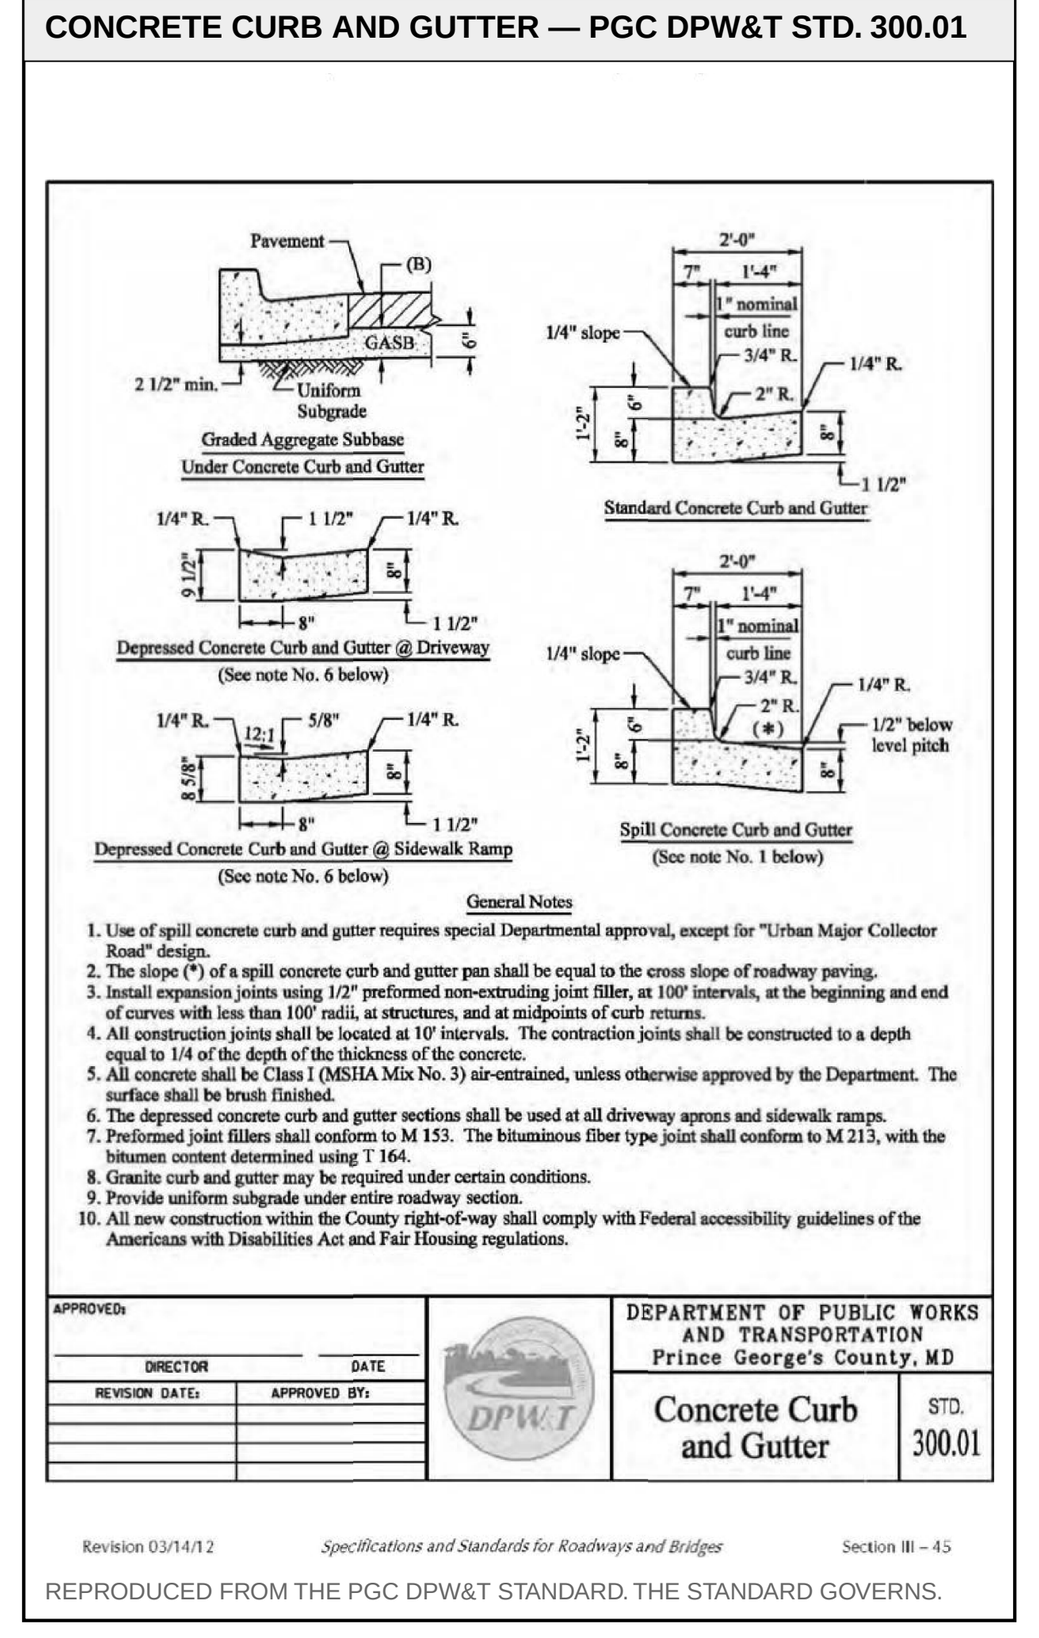

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

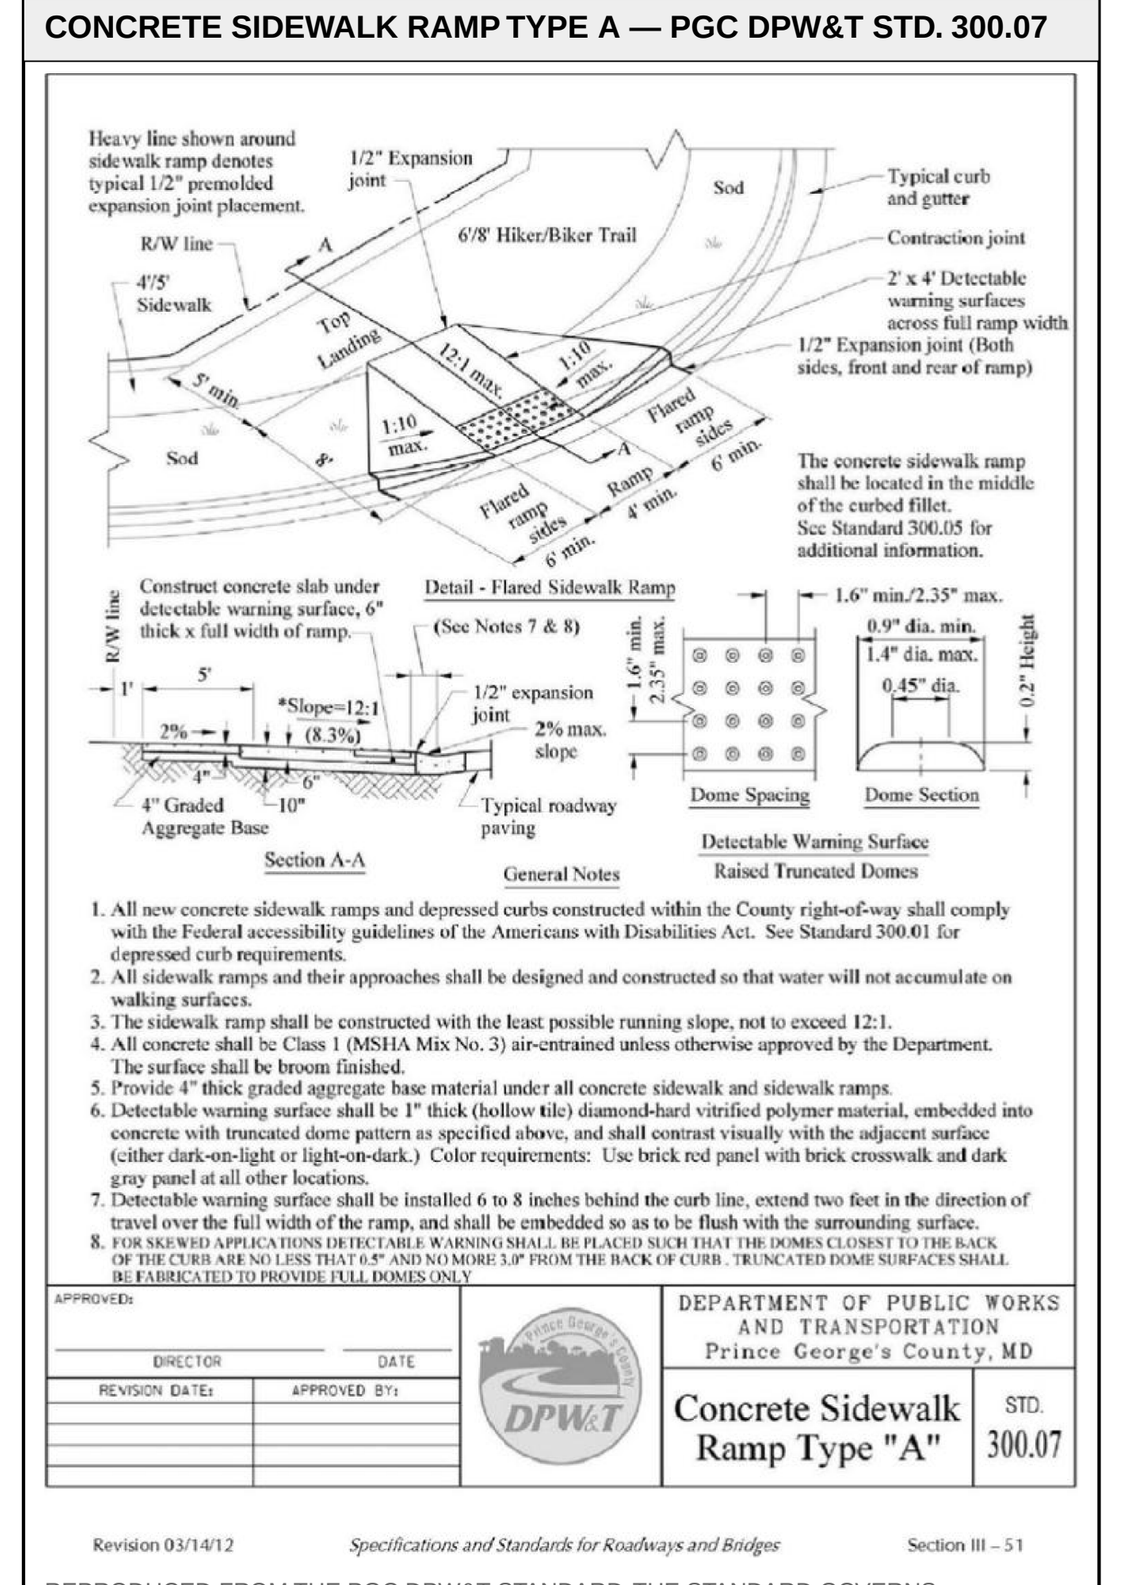

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

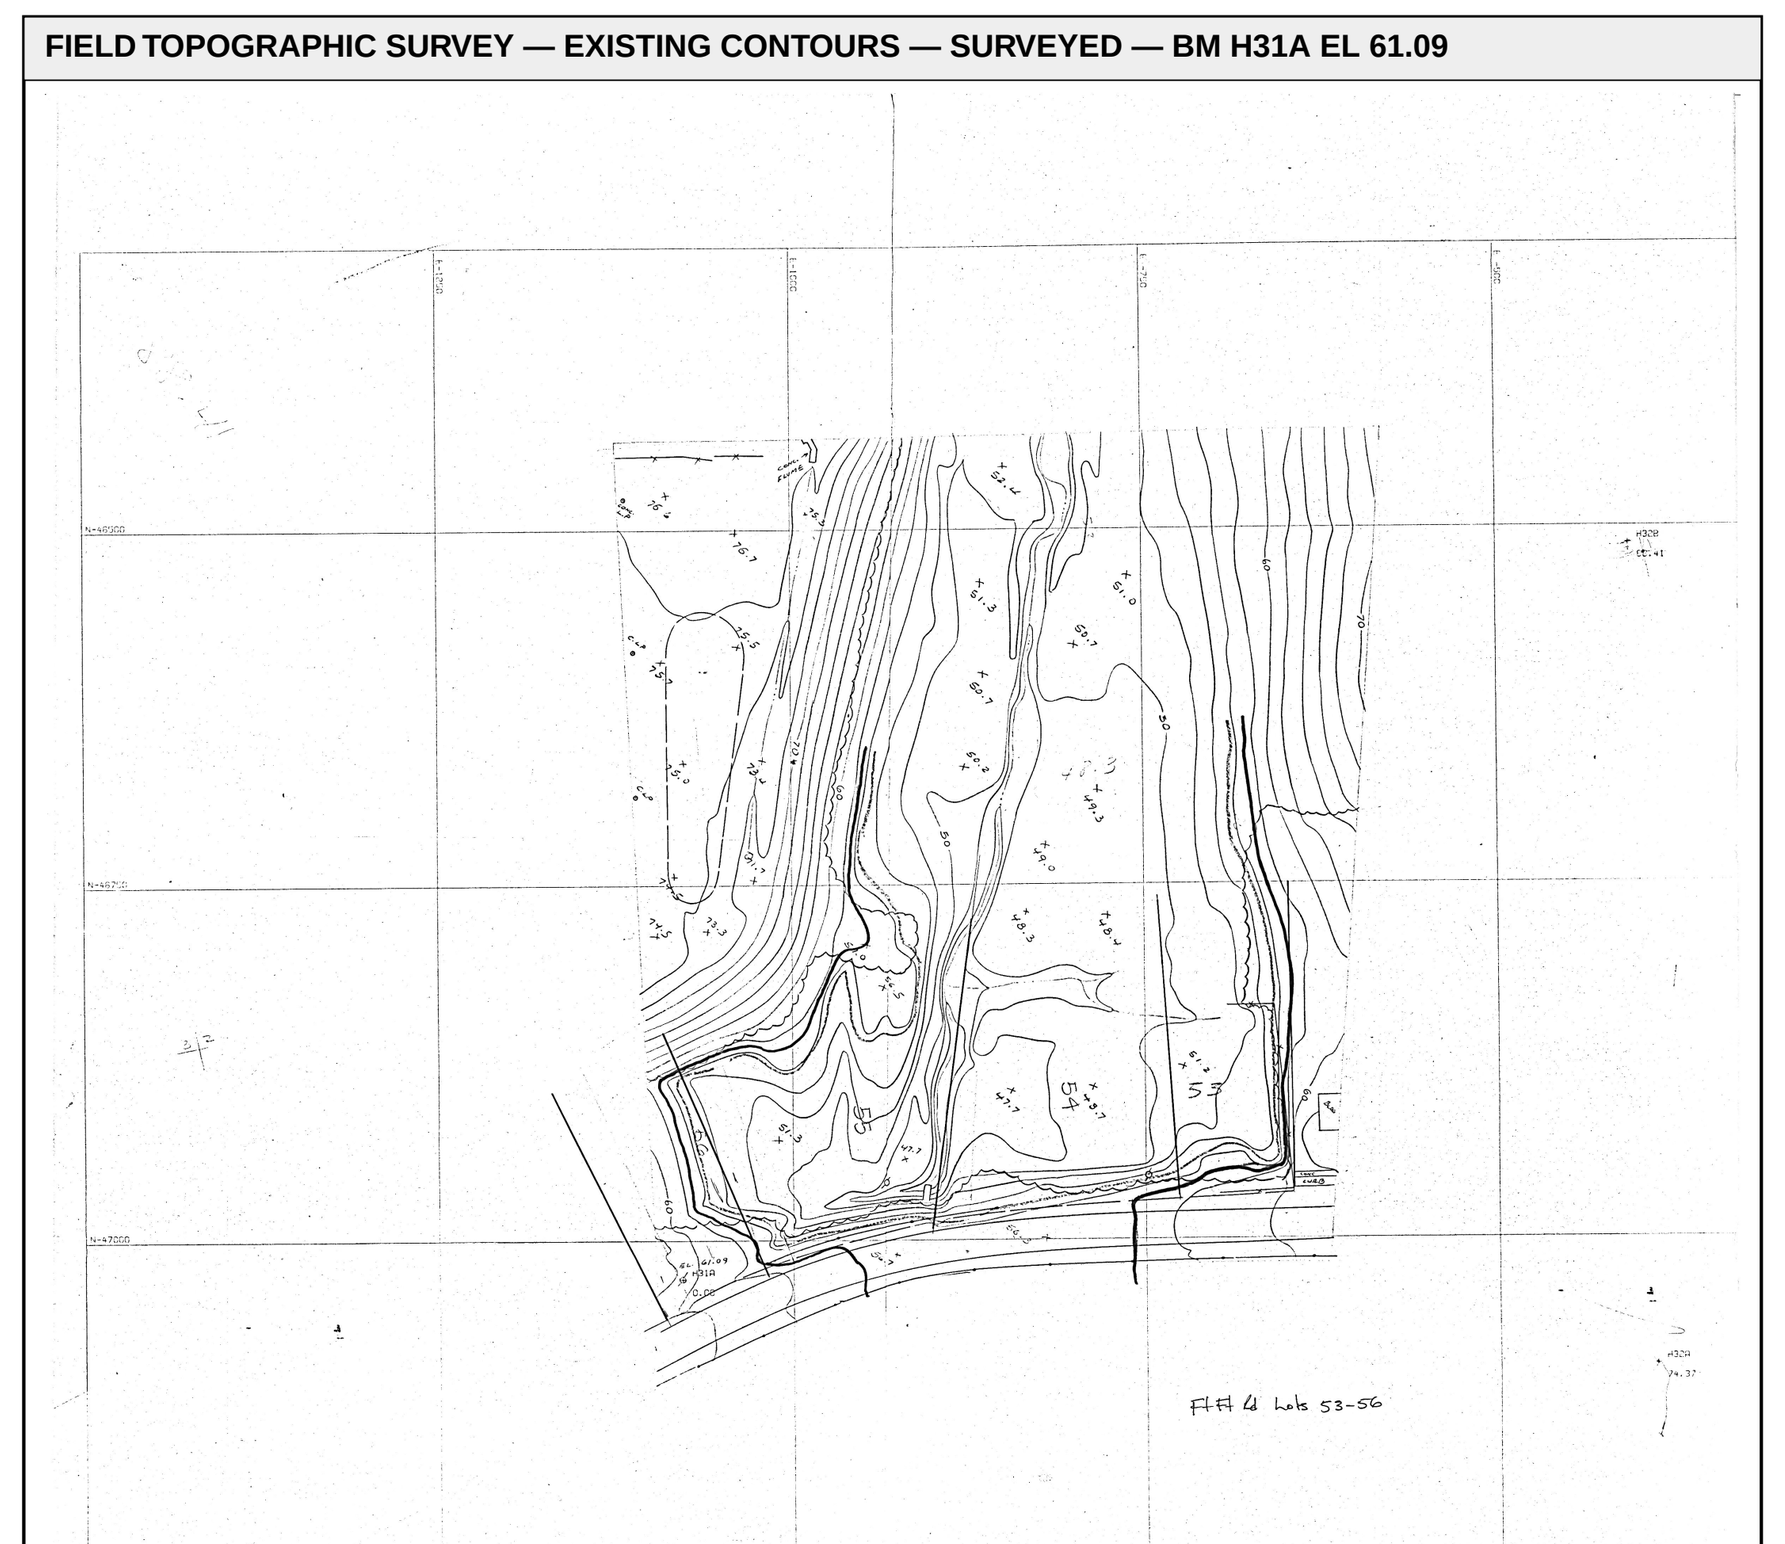

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

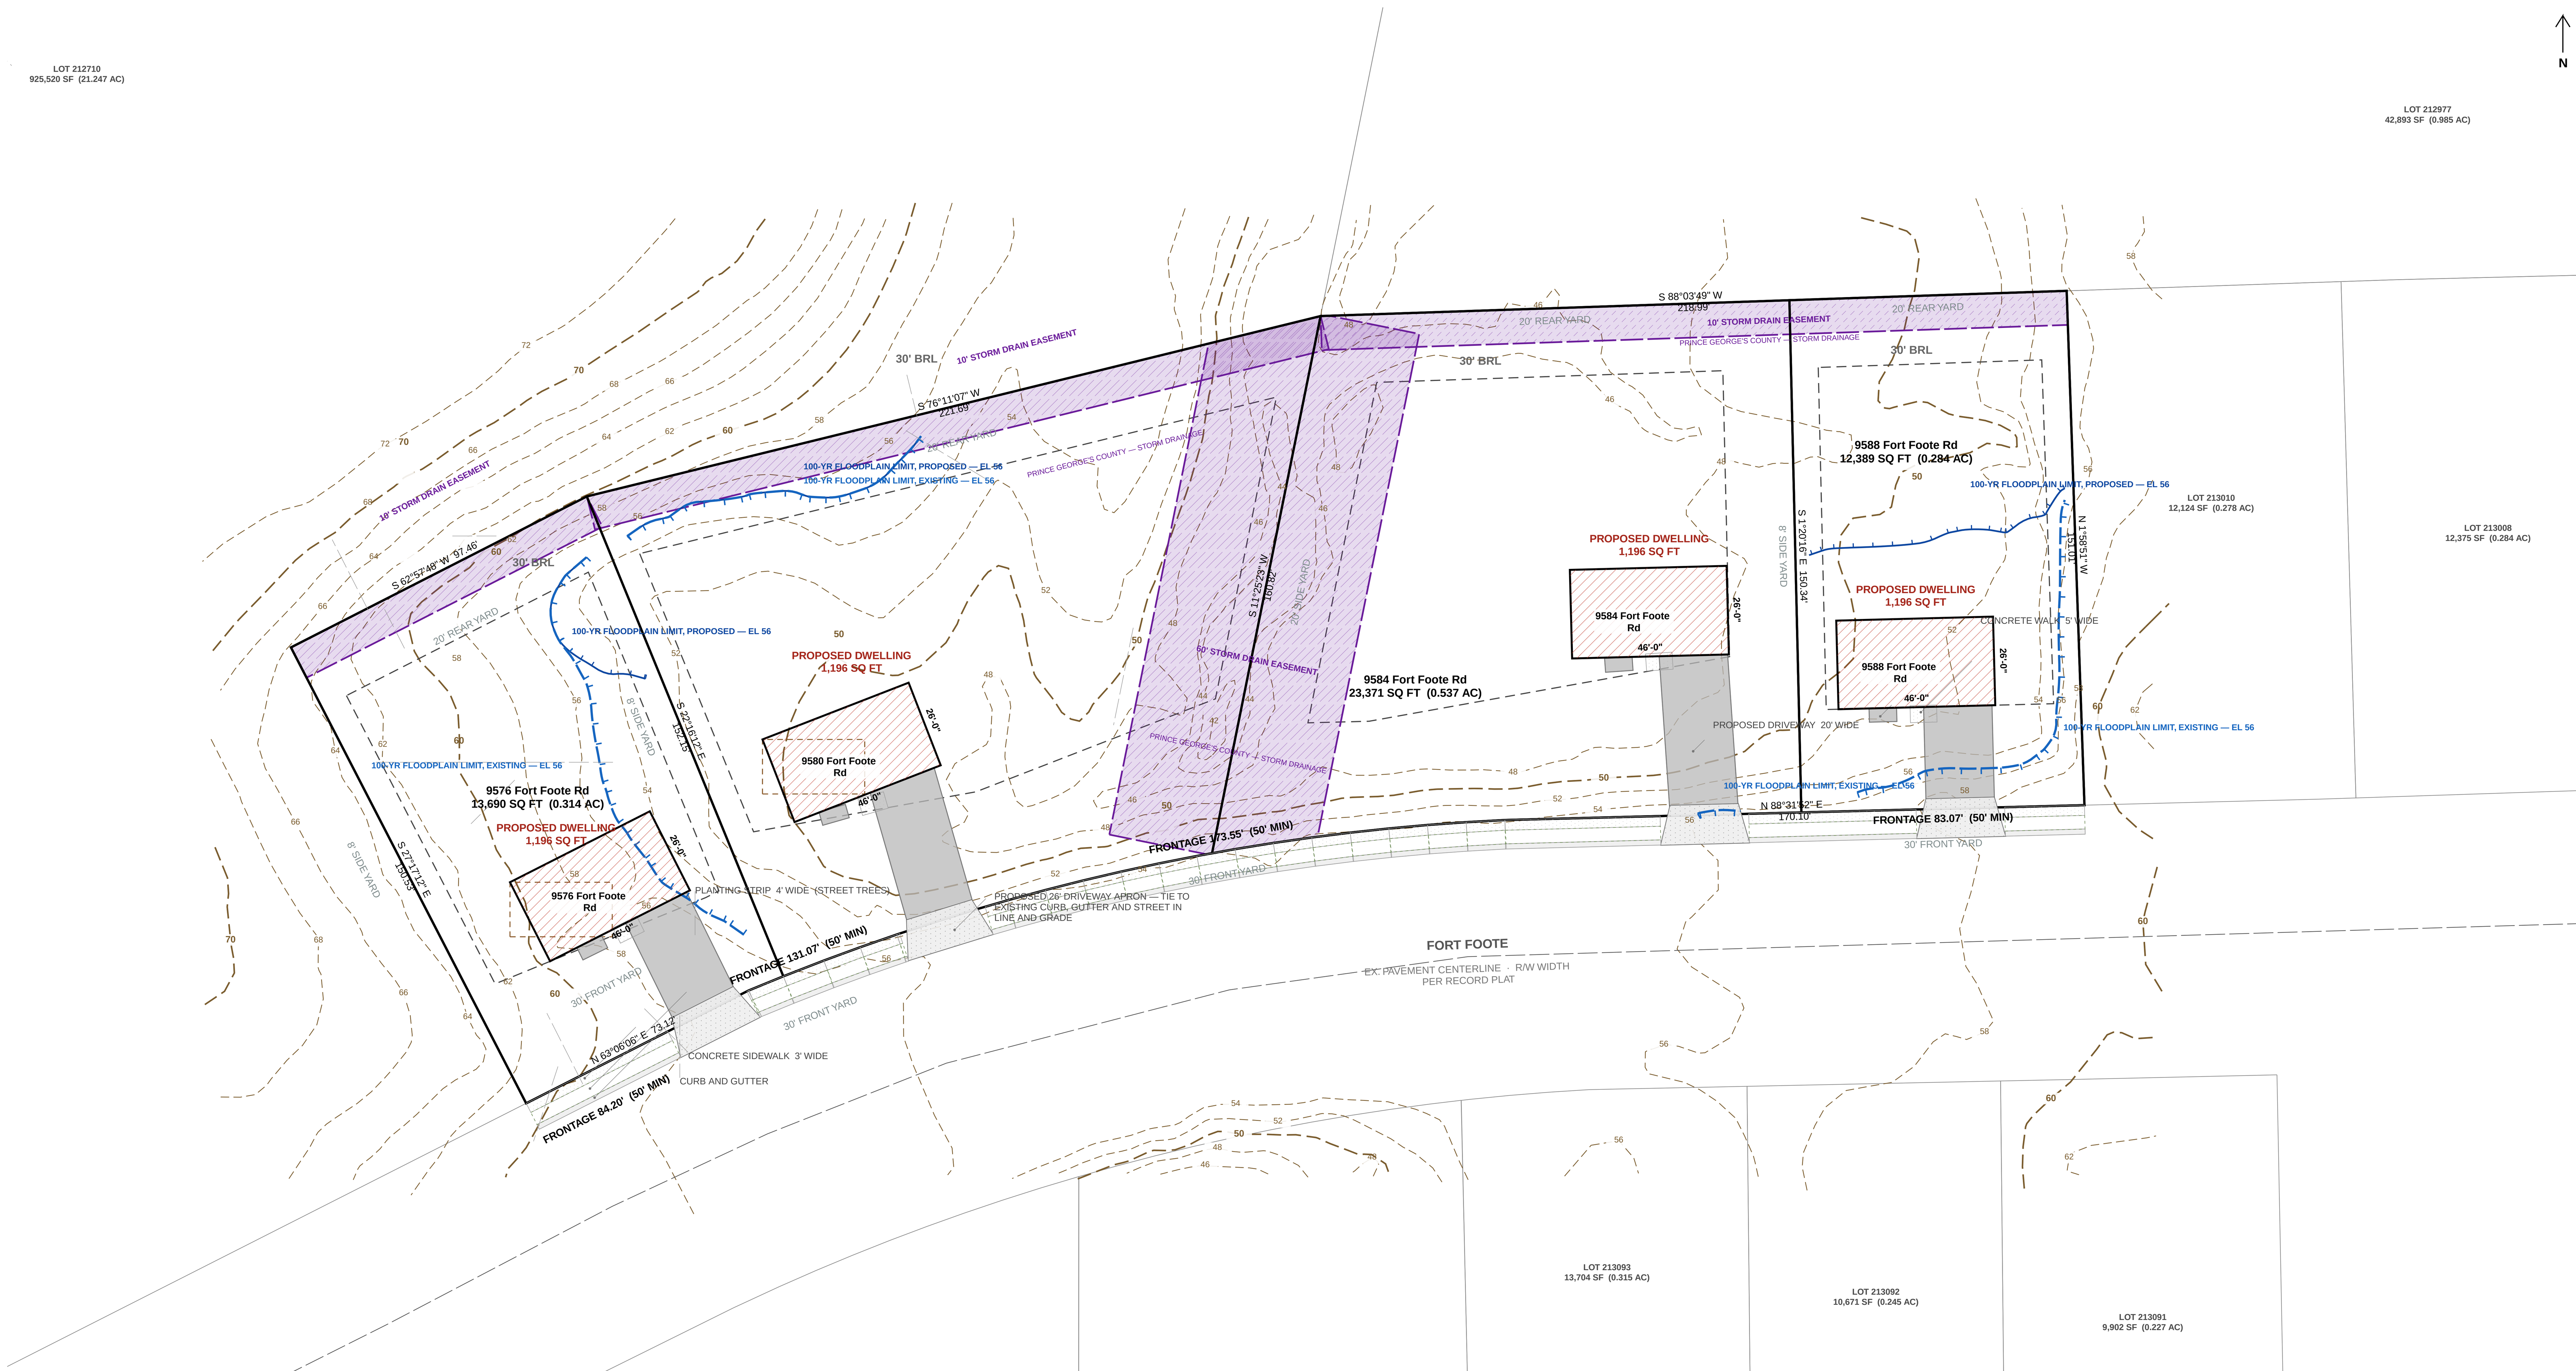

KEALEE

design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
C-200 — Overall Site and Zoning Plan

SCALE
1" = 30'

STATUS
PRELIMINARY

SHEET NO.
3 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION	
PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-200 — Overall Site and Zoning Plan
DISCIPLINE	Maryland Professional Engineer
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	75,178 SF
2. Area of dwelling	4,784 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	75,184 SF
6. TOTAL AREA DISTURBED	41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	192
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	**75,184**	**10.8%**	**2.96**	**3.84**	**0.88**	**924**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F. PLAT BOOK WWW 65, P. 60 (MSA_S1289_51253). 12TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND. TAX MAP 113, BLOCK F, GRID E4. PLAT DATED 6 JUNE 1967; APPROVED 26 JUNE 1967 BY THE MARYLAND-NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD. M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR: W. L. MEEKINS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20.9811 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE DATE
LICENSE NO. EXPIRATION DATE
SEAL

REVISIONS
— none —

SOILS TABLE USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

DRAINAGE SWALE SCHEDULE Rational method, NOAA Atlas 14 · Manning n = 0.041, 2' bottom, 3:1 sides

LOT 213101
29,852 SF (0.685 AC)

LOT 239698
287,905 SF (6.609 AC)

REACH	LENGTH	GRADE	D.A. (AC)	Q10 (CFS)	Q100 (CFS)	DEPTH	V100 (FPS)	INV IN	INV OUT	CUT
ST-1 — ST-2	110'	3.01%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'
ST-4 — ST-3	157'	4.98%	0.3143	0.65	0.86	0.16'	2.12	60.30	52.50	1.0'
ST-3 — ST-2	177'	3.17%	0.9051	1.87	2.47	0.33'	2.51	52.50	46.90	1.0'

GRADE CONTROL SCHEDULE

POINT	LOT	DESCRIPTION	GROUND	SWALE INV
ST-1	LOT 53	Swale grade break / invert control	51.20	50.20
ST-2	LOT 54	Swale grade break / invert control	47.90	46.90
ST-3	LOT 55	Swale grade break / invert control	53.50	52.50
ST-4	LOT 56	Swale grade break / invert control	61.30	60.30
OUT	—	Swale grade break / invert control	48.90	—

SYSTEM AT THE LOW POINT: 1.7260 AC, Q10 3.57 CFS, Q100 4.71 CFS.
MAX VELOCITY 2.51 FPS AT Q100 — WITHIN THE 5 FPS PERMISSIBLE FOR ESTABLISHED GRASS. 0.5 FT FREEBOARD THROUGHOUT.
THE SWALE DISCHARGES TO THE RECORDED 54/55 STORM DRAIN EASEMENT, ALONGSIDE THE 48" RCP CL IV EXTENDING THE FORT FOOTE ROAD CULVERT INLET.
THAT MAIN IS BURIED: OD 4.67 FT, 1.5 FT MIN COVER OVER THE CROWN — FINISHED GRADE OVER IT SHALL BE NO LOWER THAN INVERT + 6.17 FT. FILL WHERE EXISTING GROUND IS LOWER.
SWALE GRADES AND INVERTS TO BE SET FROM THE FIELD-RUN TOPOGRAPHIC SURVEY. ESTABLISH SOD BEFORE THE CONTRIBUTING AREA IS STABILISED.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

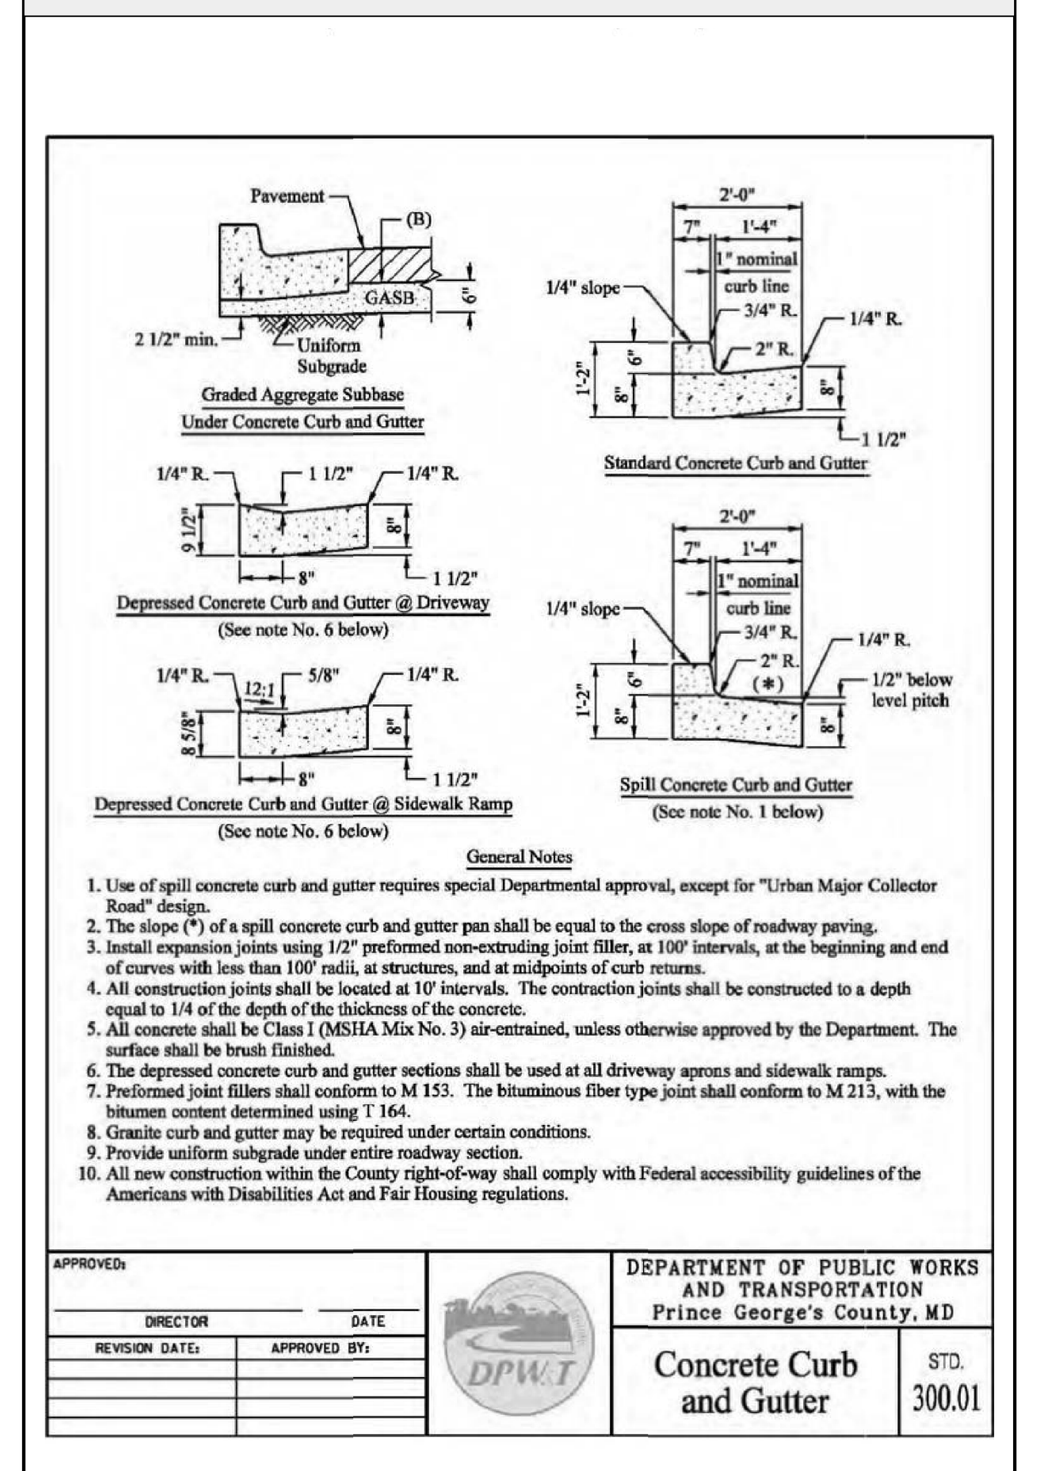

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

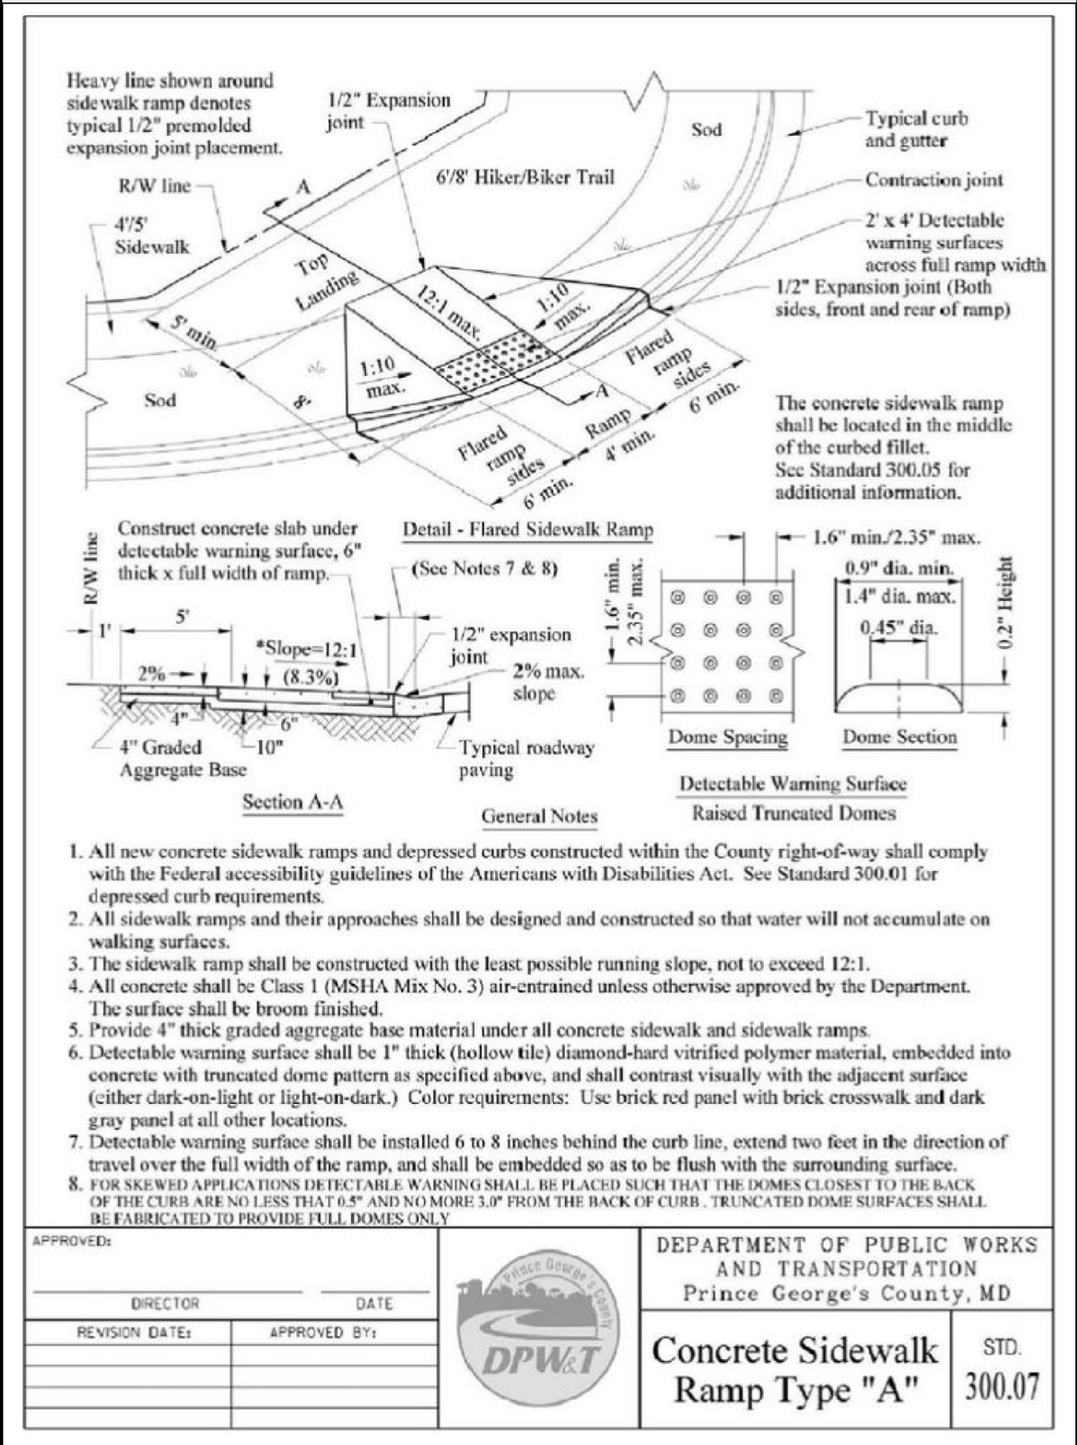

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

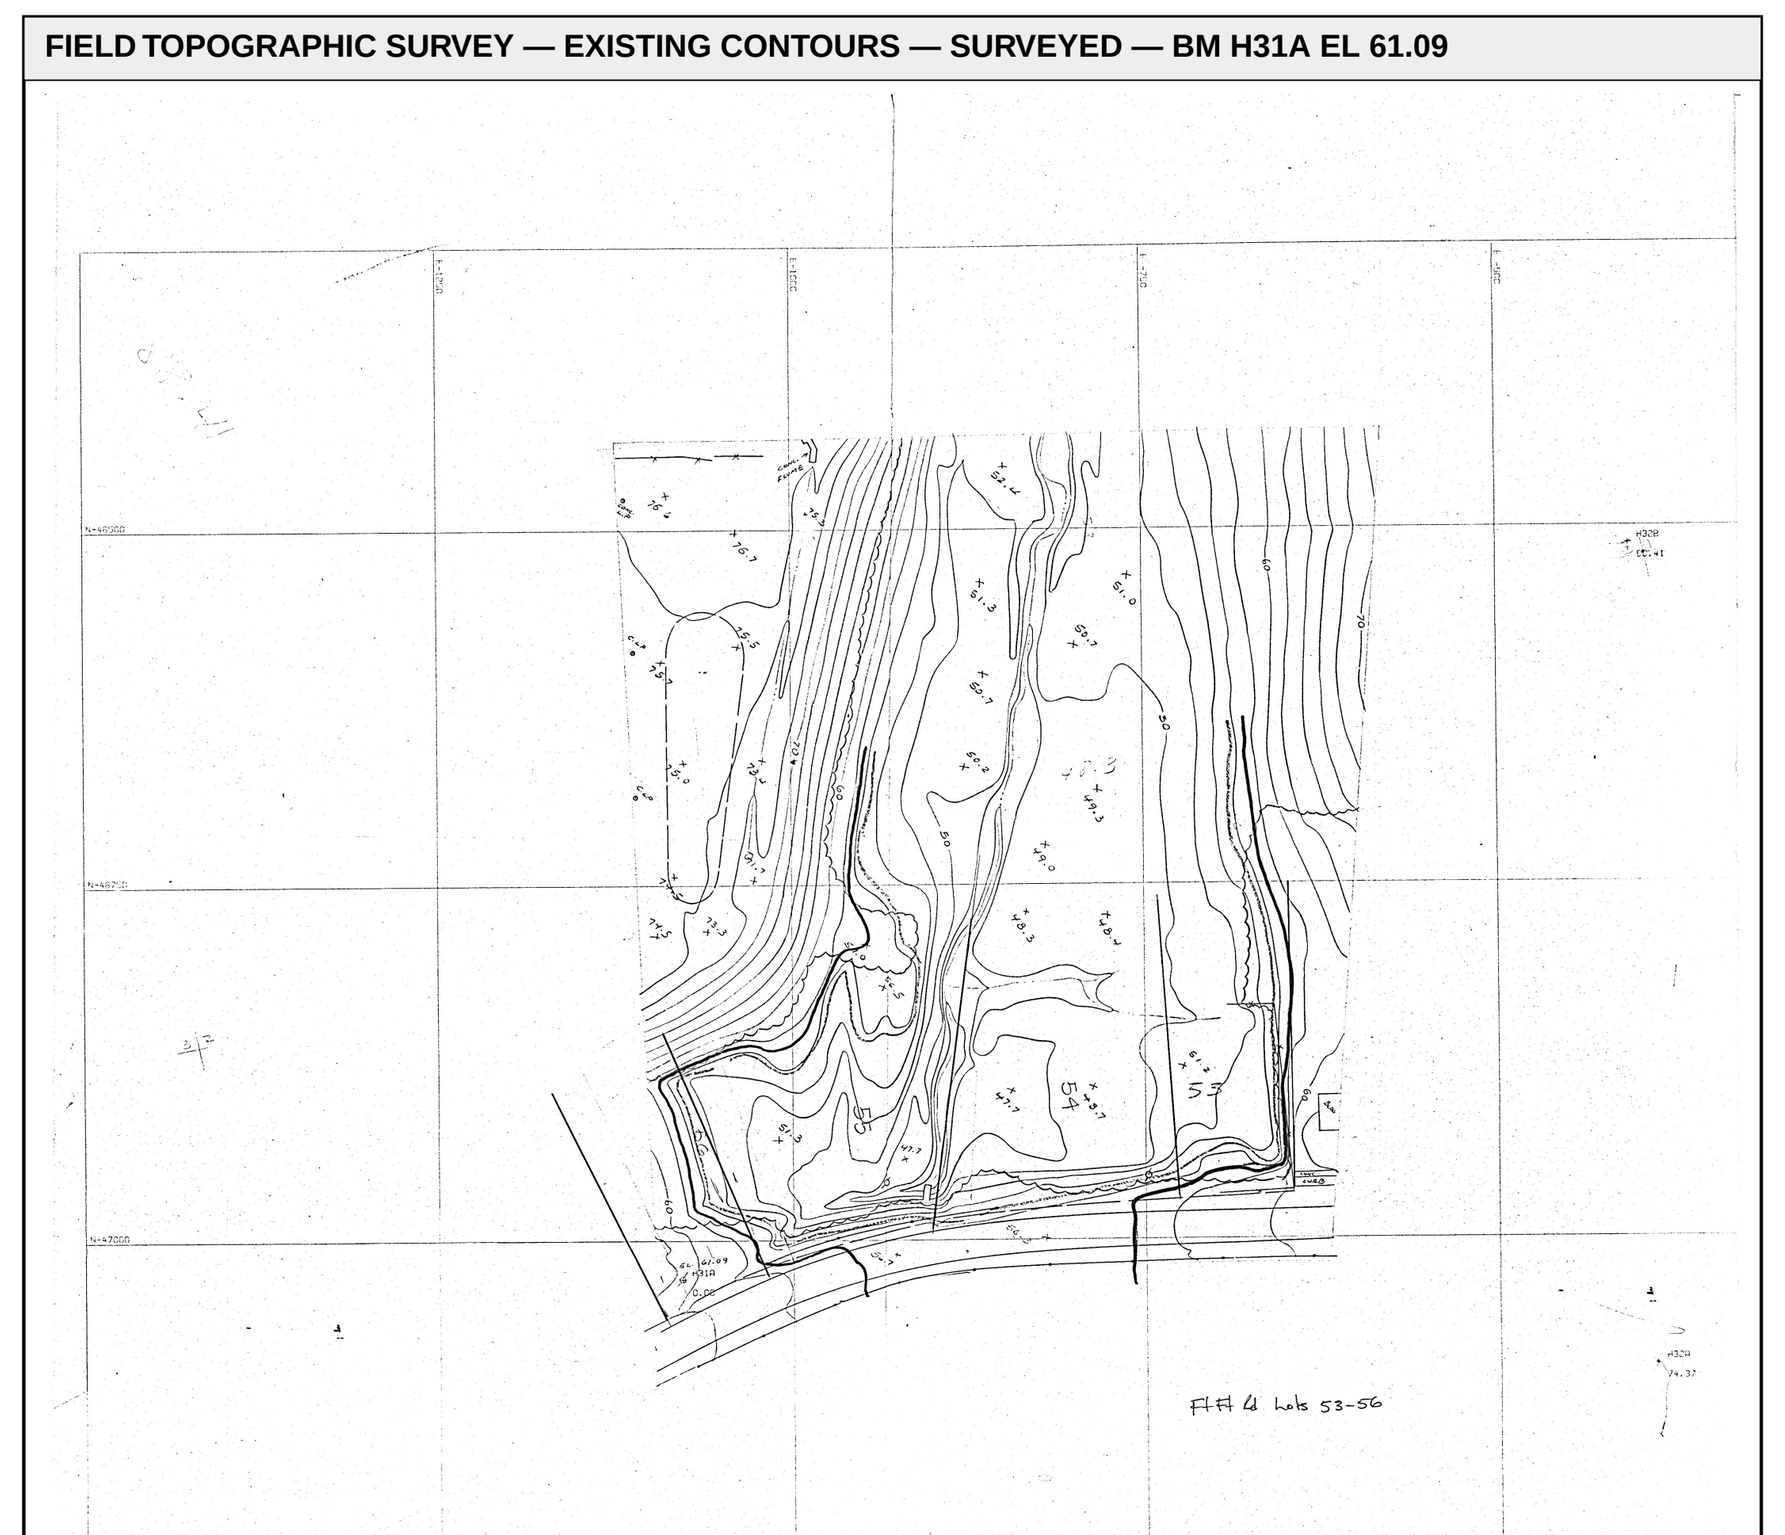

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

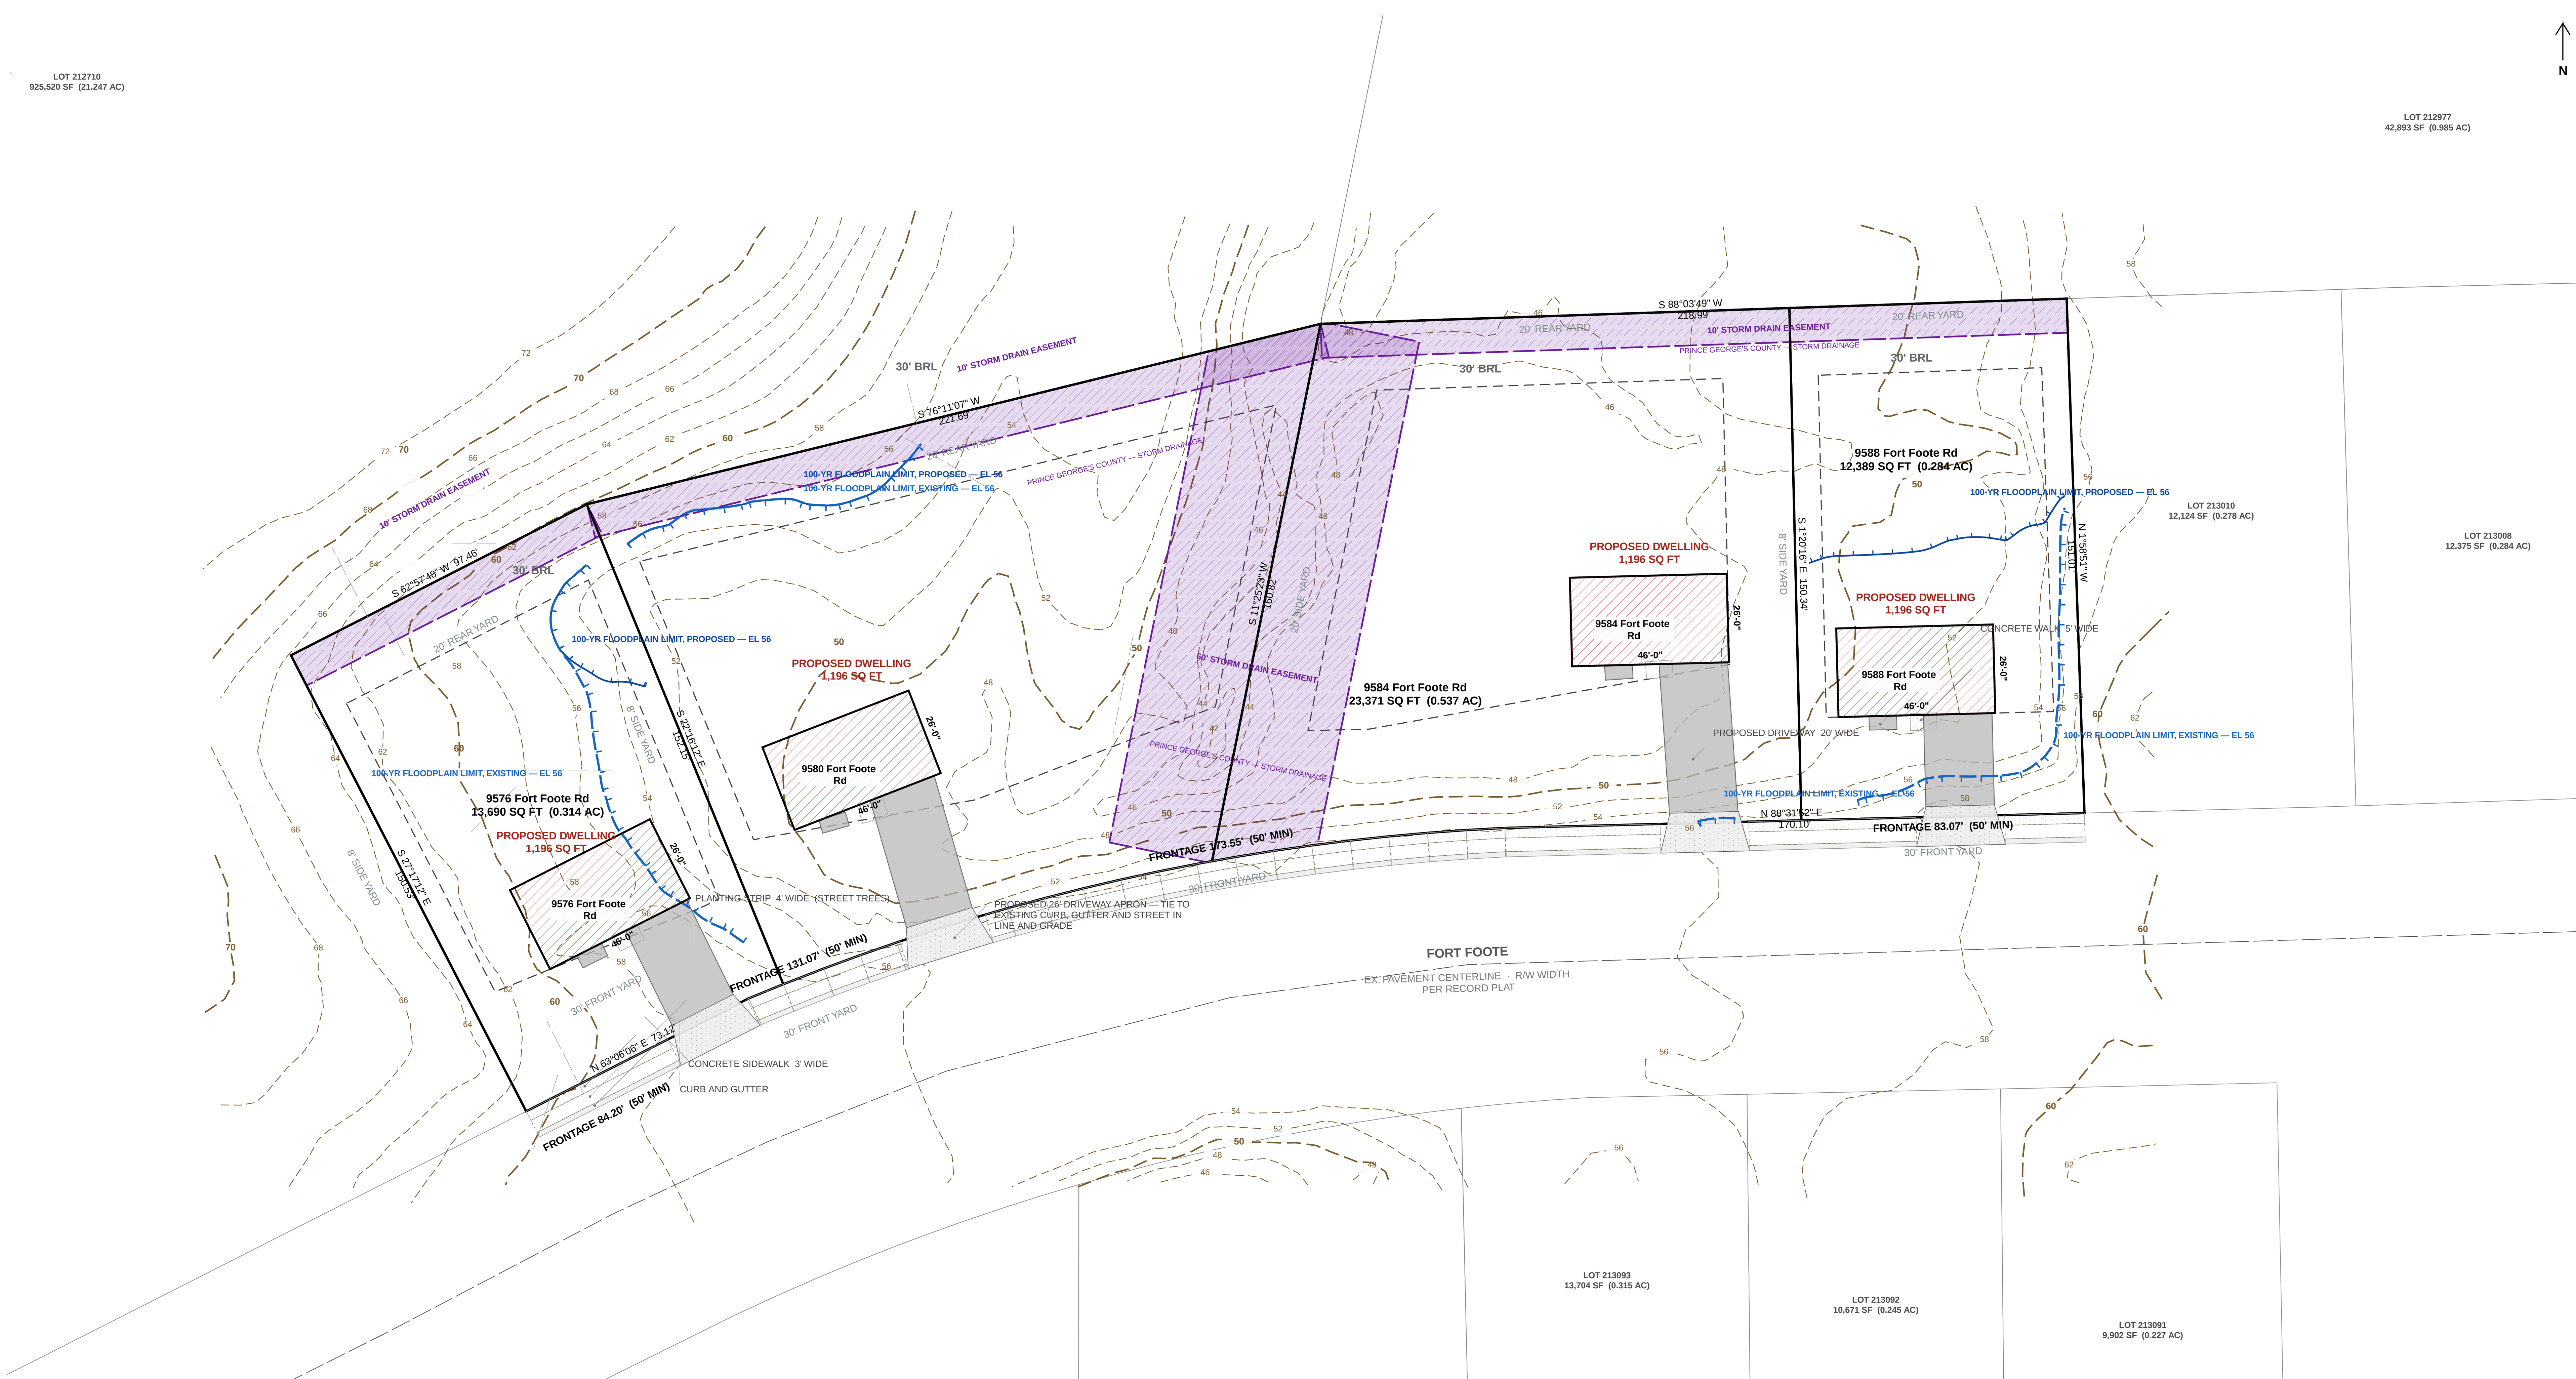

KEALEE

design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
C-300 — Demolition Plan

SCALE
1" = 30'

STATUS
PRELIMINARY

SHEET NO.
4 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION	
PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-300 — Demolition Plan
DISCIPLINE	Maryland Professional Engineer
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	75,178 SF
2. Area of dwelling	4,784 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	75,184 SF
6. TOTAL AREA DISTURBED	41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	192
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	**75,184**	**10.8%**	**2.96**	**3.84**	**0.88**	**924**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F. PLAT BOOK WWW 65, P. 60 (MSA_S1289_51253). 12TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND. TAX MAP 113, BLOCK F, GRID E4. PLAT DATED 6 JUNE 1967; APPROVED 26 JUNE 1967 BY THE MARYLAND-NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD. M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR: W. L. MEEKINS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20.9811 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE ______ DATE ______

LICENSE NO. ______ EXPIRATION DATE ______

SEAL

REVISIONS
— none —

SOILS TABLE USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

DRAINAGE SWALE SCHEDULE Rational method, NOAA Atlas 14 · Manning n = 0.041, 2' bottom, 3:1 sides

LOT 213101
29,852 SF (0.685 AC)

LOT 239698
287,905 SF (6.609 AC)

REACH	LENGTH	GRADE	D.A. (AC)	Q10 (CFS)	Q100 (CFS)	DEPTH	V100 (FPS)	INV IN	INV OUT	CUT
ST-1 — ST-2	110'	3.01%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'
ST-4 — ST-3	157'	4.98%	0.3143	0.65	0.86	0.16'	2.12	60.30	52.50	1.0'
ST-3 — ST-2	177'	3.17%	0.9051	1.87	2.47	0.33'	2.51	52.50	46.90	1.0'

GRADE CONTROL SCHEDULE

POINT	LOT	DESCRIPTION	GROUND	SWALE INV
ST-1	LOT 53	Swale grade break / invert control	51.20	50.20
ST-2	LOT 54	Swale grade break / invert control	47.90	46.90
ST-3	LOT 55	Swale grade break / invert control	53.50	52.50
ST-4	LOT 56	Swale grade break / invert control	61.30	60.30
OUT	—	Swale grade break / invert control	48.90	—

SYSTEM AT THE LOW POINT: 1.7260 AC, Q10 3.57 CFS, Q100 4.71 CFS.
MAX VELOCITY 2.51 FPS AT Q100 — WITHIN THE 5 FPS PERMISSIBLE FOR ESTABLISHED GRASS. 0.5 FT FREEBOARD THROUGHOUT.
THE SWALE DISCHARGES TO THE RECORDED 54/55 STORM DRAIN EASEMENT, ALONGSIDE THE 48" RCP CL IV EXTENDING THE FORT FOOTE ROAD CULVERT INLET.
THAT MAIN IS BURIED: OD 4.67 FT, 1.5 FT MIN COVER OVER THE CROWN — FINISHED GRADE OVER IT SHALL BE NO LOWER THAN INVERT + 6.17 FT. FILL WHERE EXISTING GROUND IS LOWER.
SWALE GRADES AND INVERTS TO BE SET FROM THE FIELD-RUN TOPOGRAPHIC SURVEY. ESTABLISH SOD BEFORE THE CONTRIBUTING AREA IS STABILISED.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

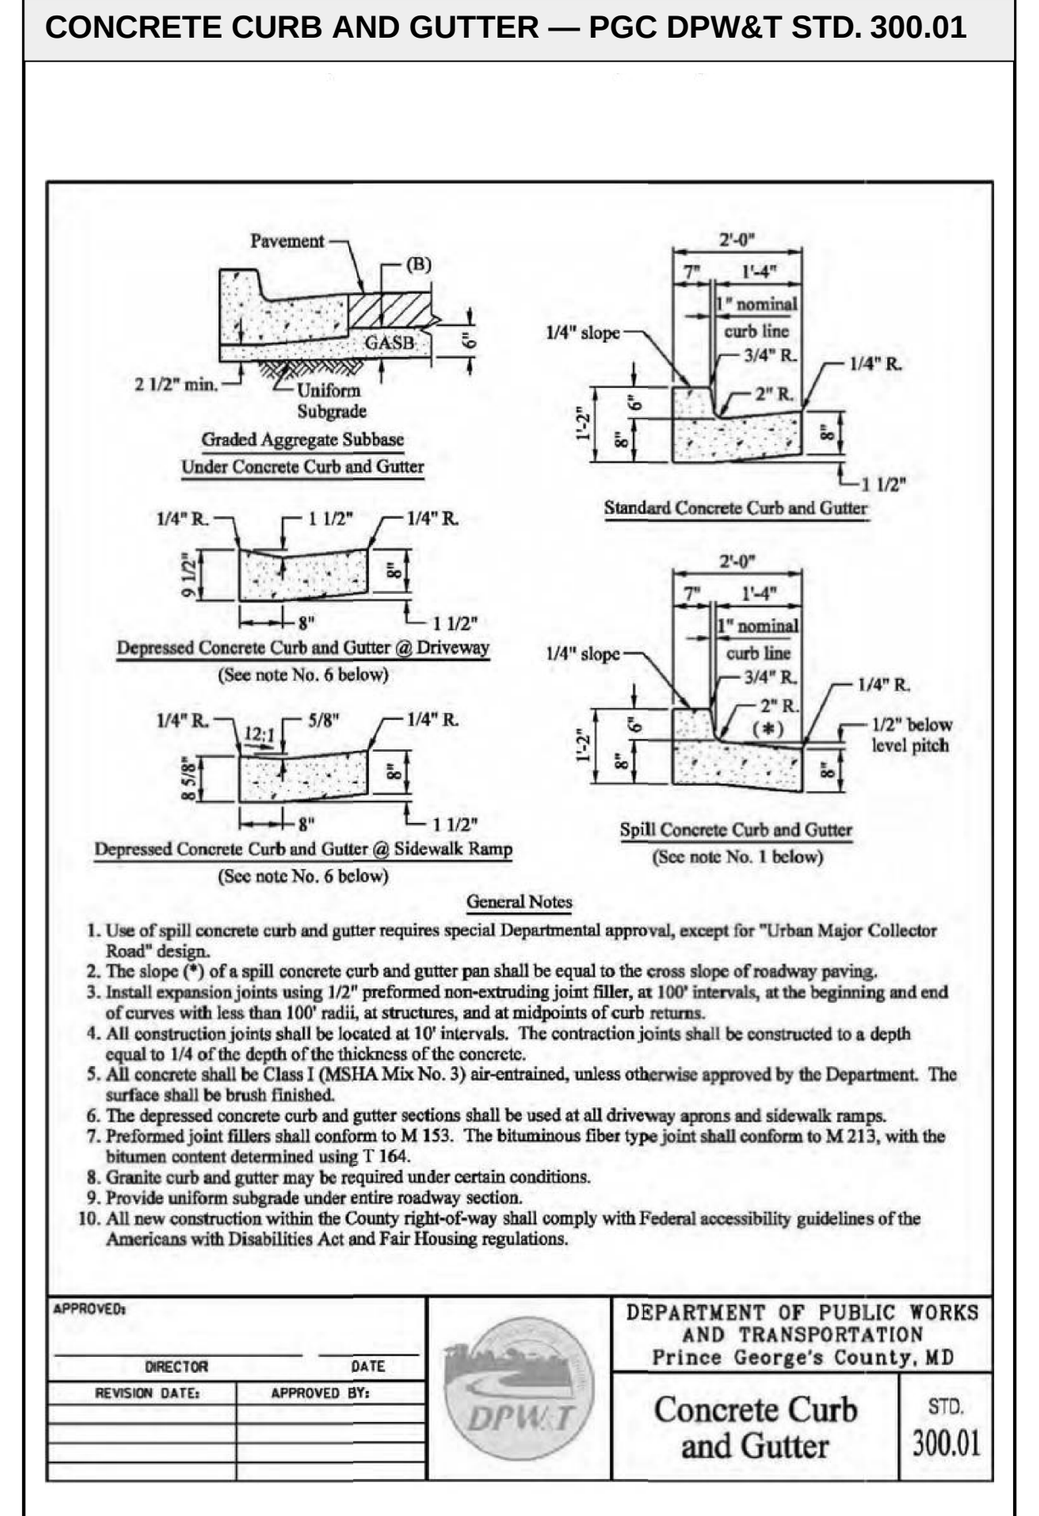

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

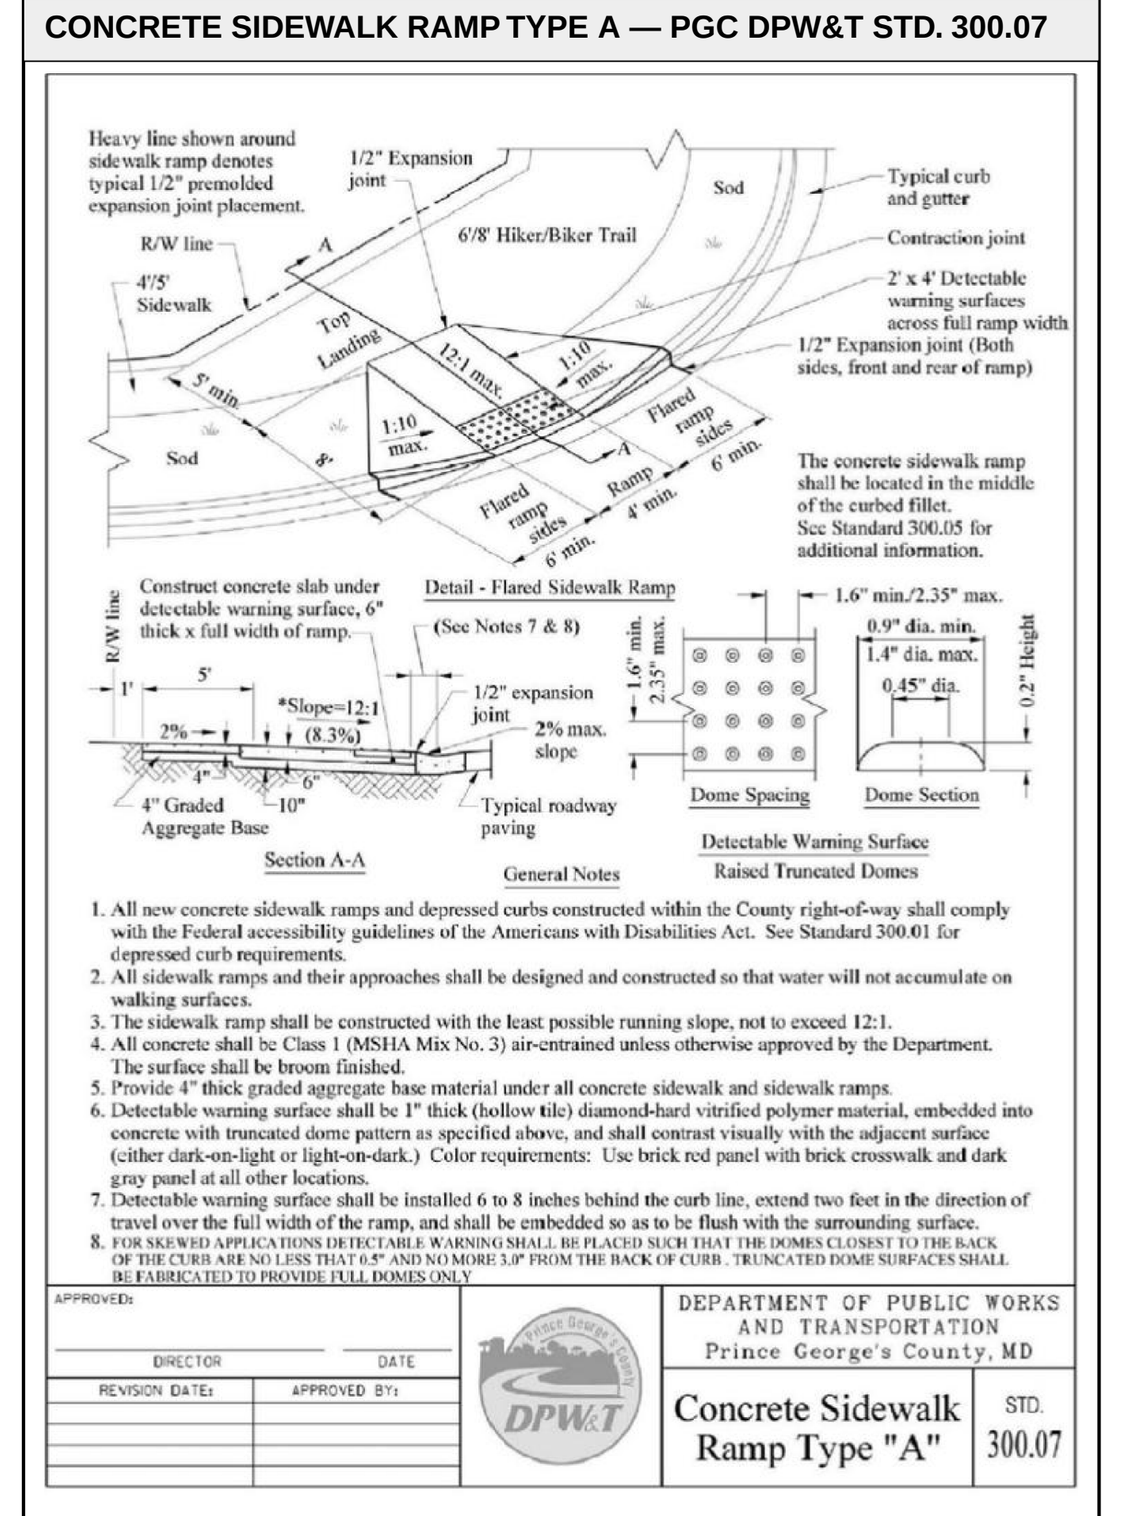

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

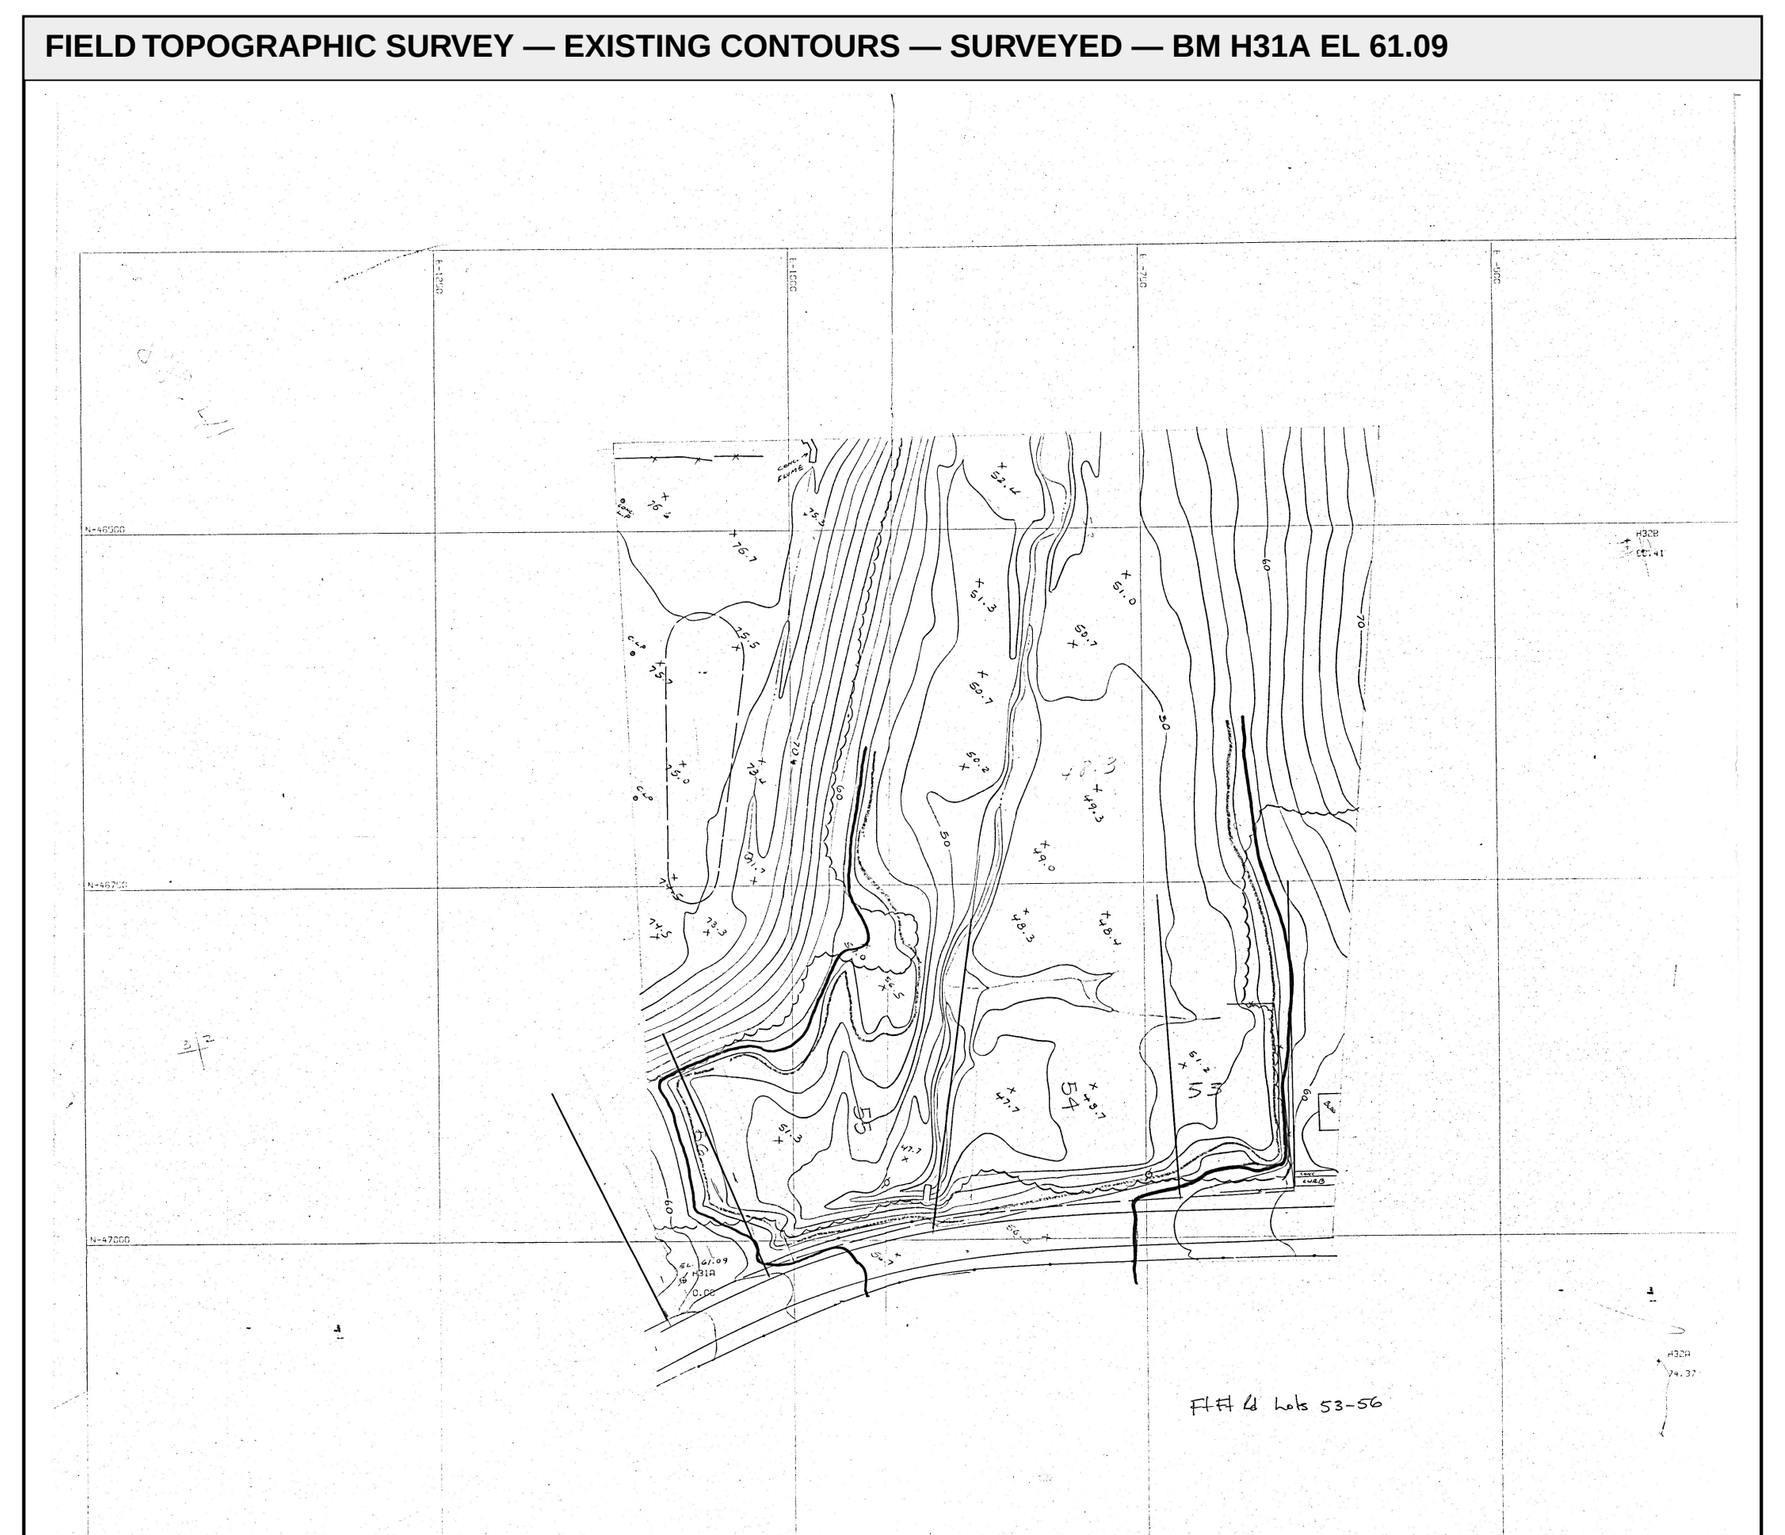

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

SOILS TABLE	USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)				
MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

DRAINAGE SWALE SCHEDULE Rational method, NOAA Atlas 14 · Manning n = 0.041, 2' bottom, 3:1 sides

REACH	LENGTH	GRADE	D.A. (AC)	Q10 (CFS)	Q100 (CFS)	DEPTH	V100 (FPS)	INV IN	INV OUT	CUT
ST-1 — ST-2	110'	3.01%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'
ST-4 — ST-3	157'	4.98%	0.3143	0.65	0.86	0.16'	2.12	60.30	52.50	1.0'
ST-3 — ST-2	177'	3.17%	0.9051	1.87	2.47	0.33'	2.51	52.50	46.90	1.0'

GRADE CONTROL SCHEDULE

POINT	LOT	DESCRIPTION	GROUND	SWALE INV
ST-1	LOT 53	Swale grade break / invert control	51.20	50.20
ST-2	LOT 54	Swale grade break / invert control	47.90	46.90
ST-3	LOT 55	Swale grade break / invert control	53.50	52.50
ST-4	LOT 56	Swale grade break / invert control	61.30	60.30
OUT	—	Swale grade break / invert control	48.90	—

SYSTEM AT THE LOW POINT: 1.7260 AC, Q10 3.57 CFS, Q100 4.71 CFS.
MAX VELOCITY 2.51 FPS AT Q100 — WITHIN THE 5 FPS PERMISSIBLE FOR ESTABLISHED GRASS. 0.5 FT FREEBOARD THROUGHOUT.
THE SWALE DISCHARGES TO THE RECORDED 54/55 STORM DRAIN EASEMENT, ALONGSIDE THE 48" RCP CL IV EXTENDING THE FORT FOOTE ROAD CULVERT INLET.
THAT MAIN IS BURIED: OD 4.67 FT, 1.5 FT MIN COVER OVER THE CROWN — FINISHED GRADE OVER IT SHALL BE NO LOWER THAN INVERT + 6.17 FT. FILL WHERE EXISTING GROUND IS LOWER.
SWALE GRADES AND INVERTS TO BE SET FROM THE FIELD-RUN TOPOGRAPHIC SURVEY. ESTABLISH SOD BEFORE THE CONTRIBUTING AREA IS STABILISED.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

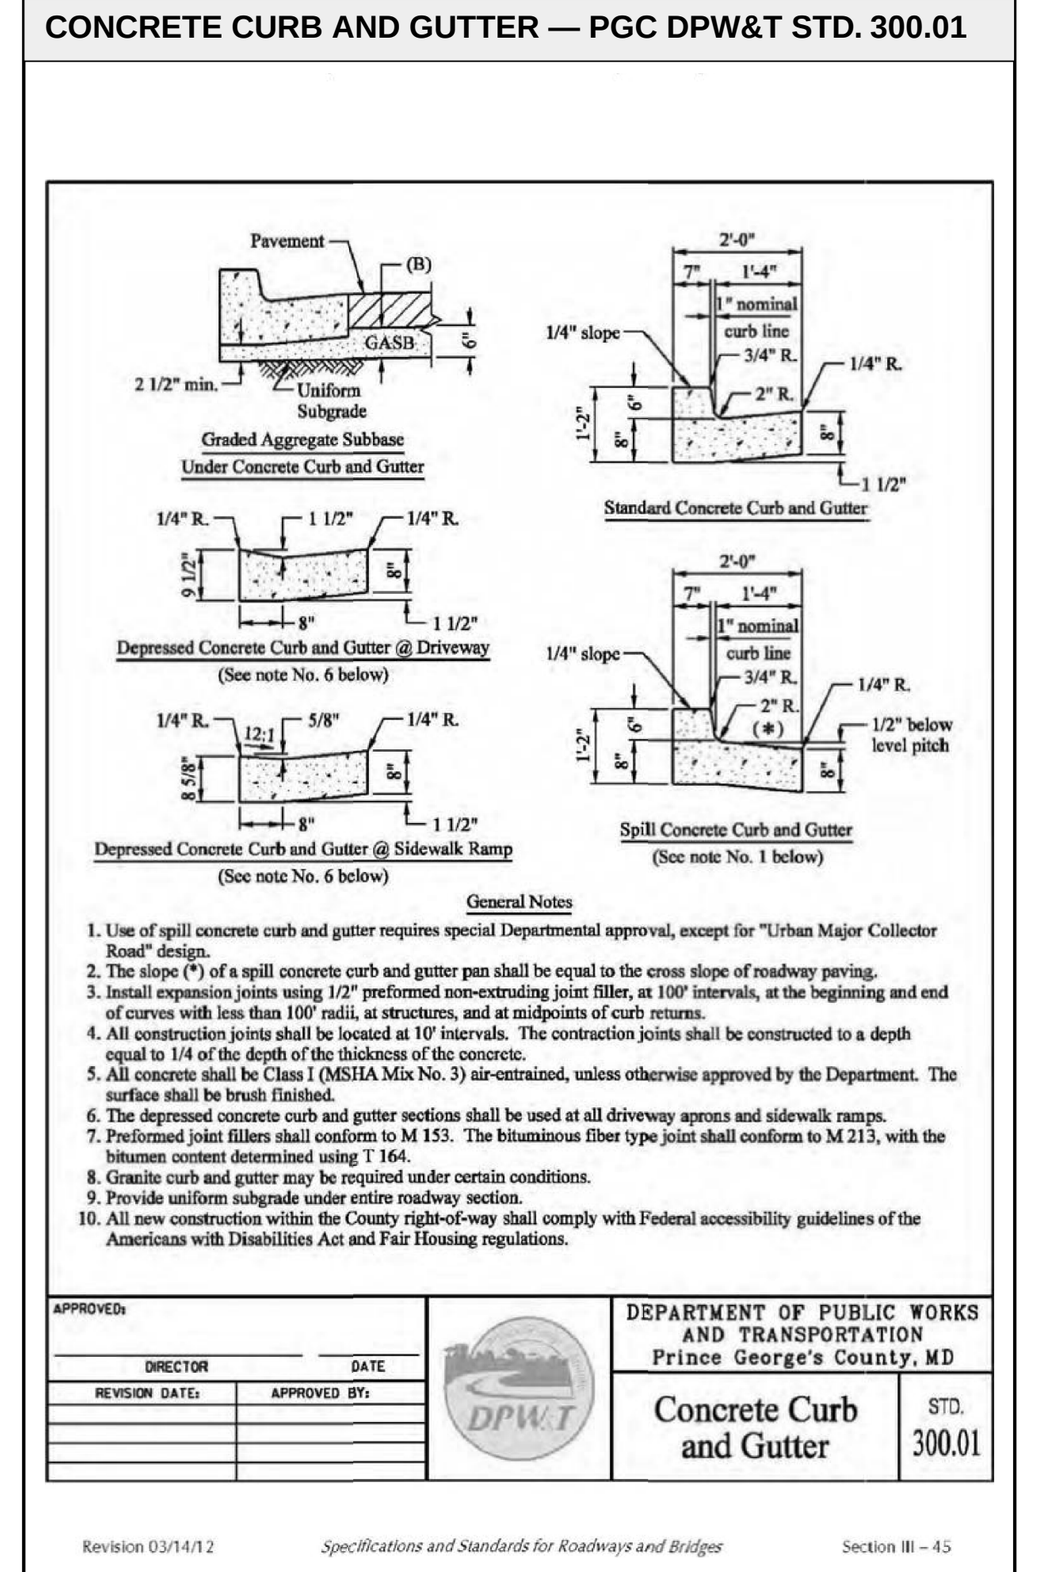

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

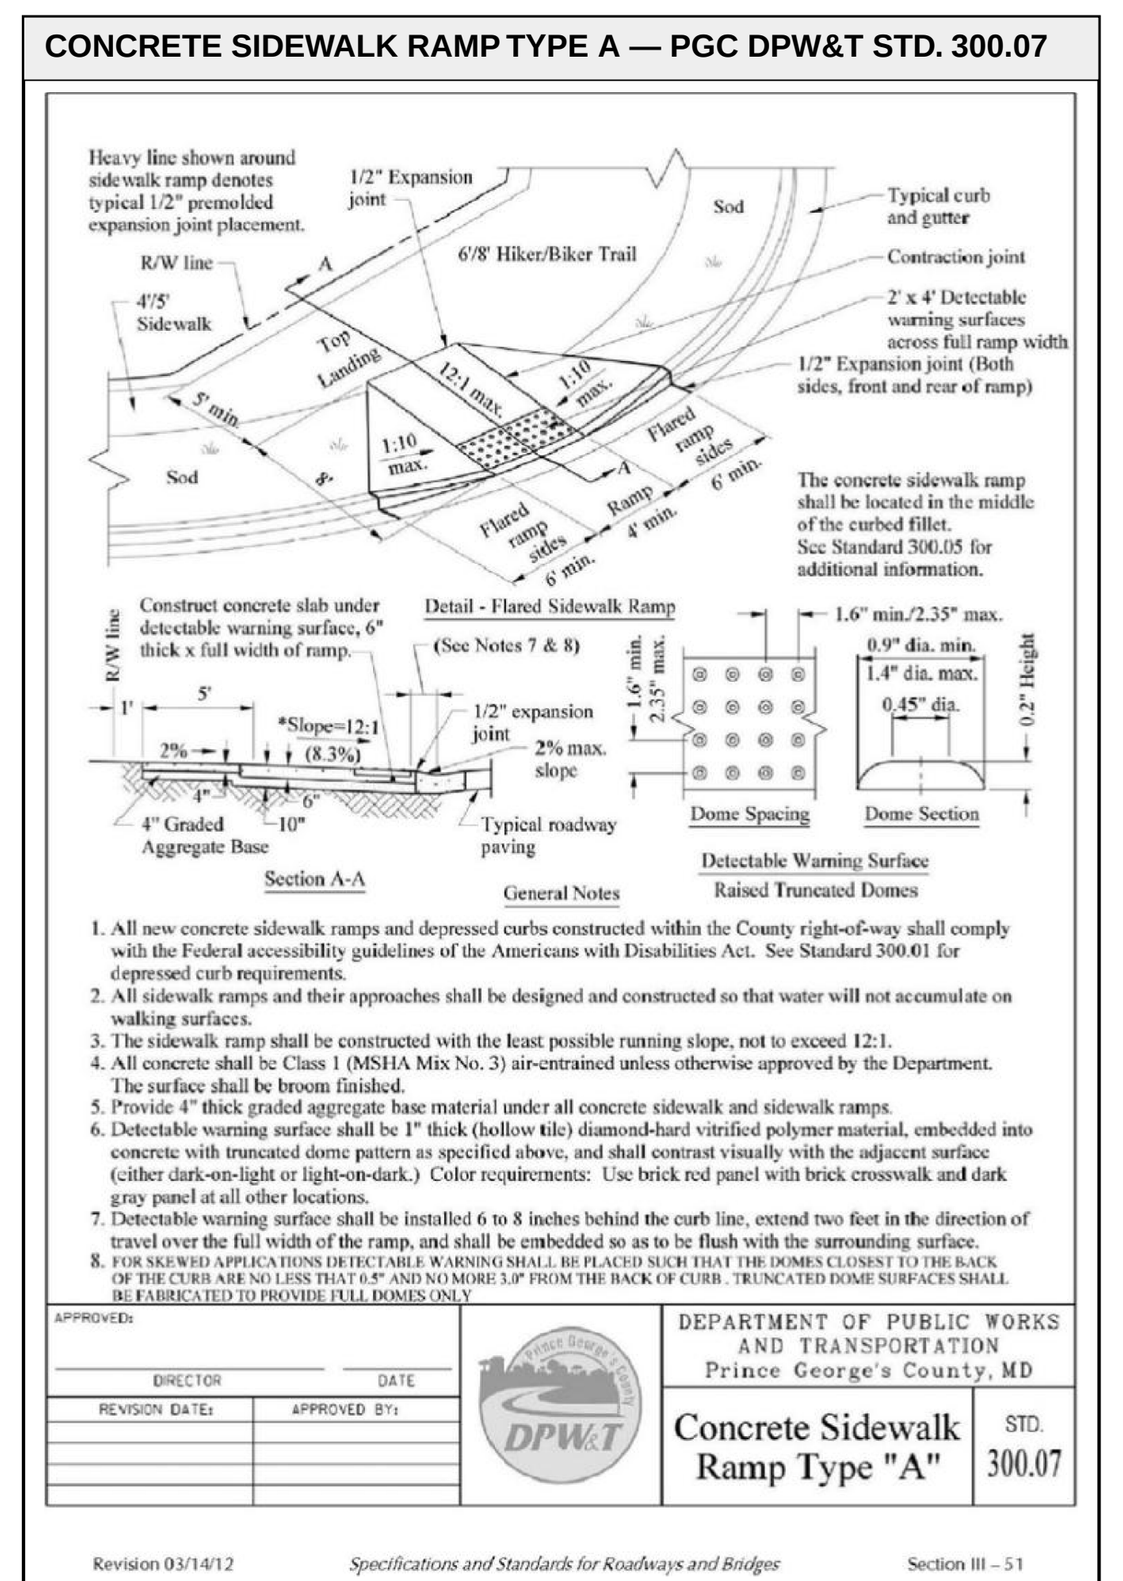

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

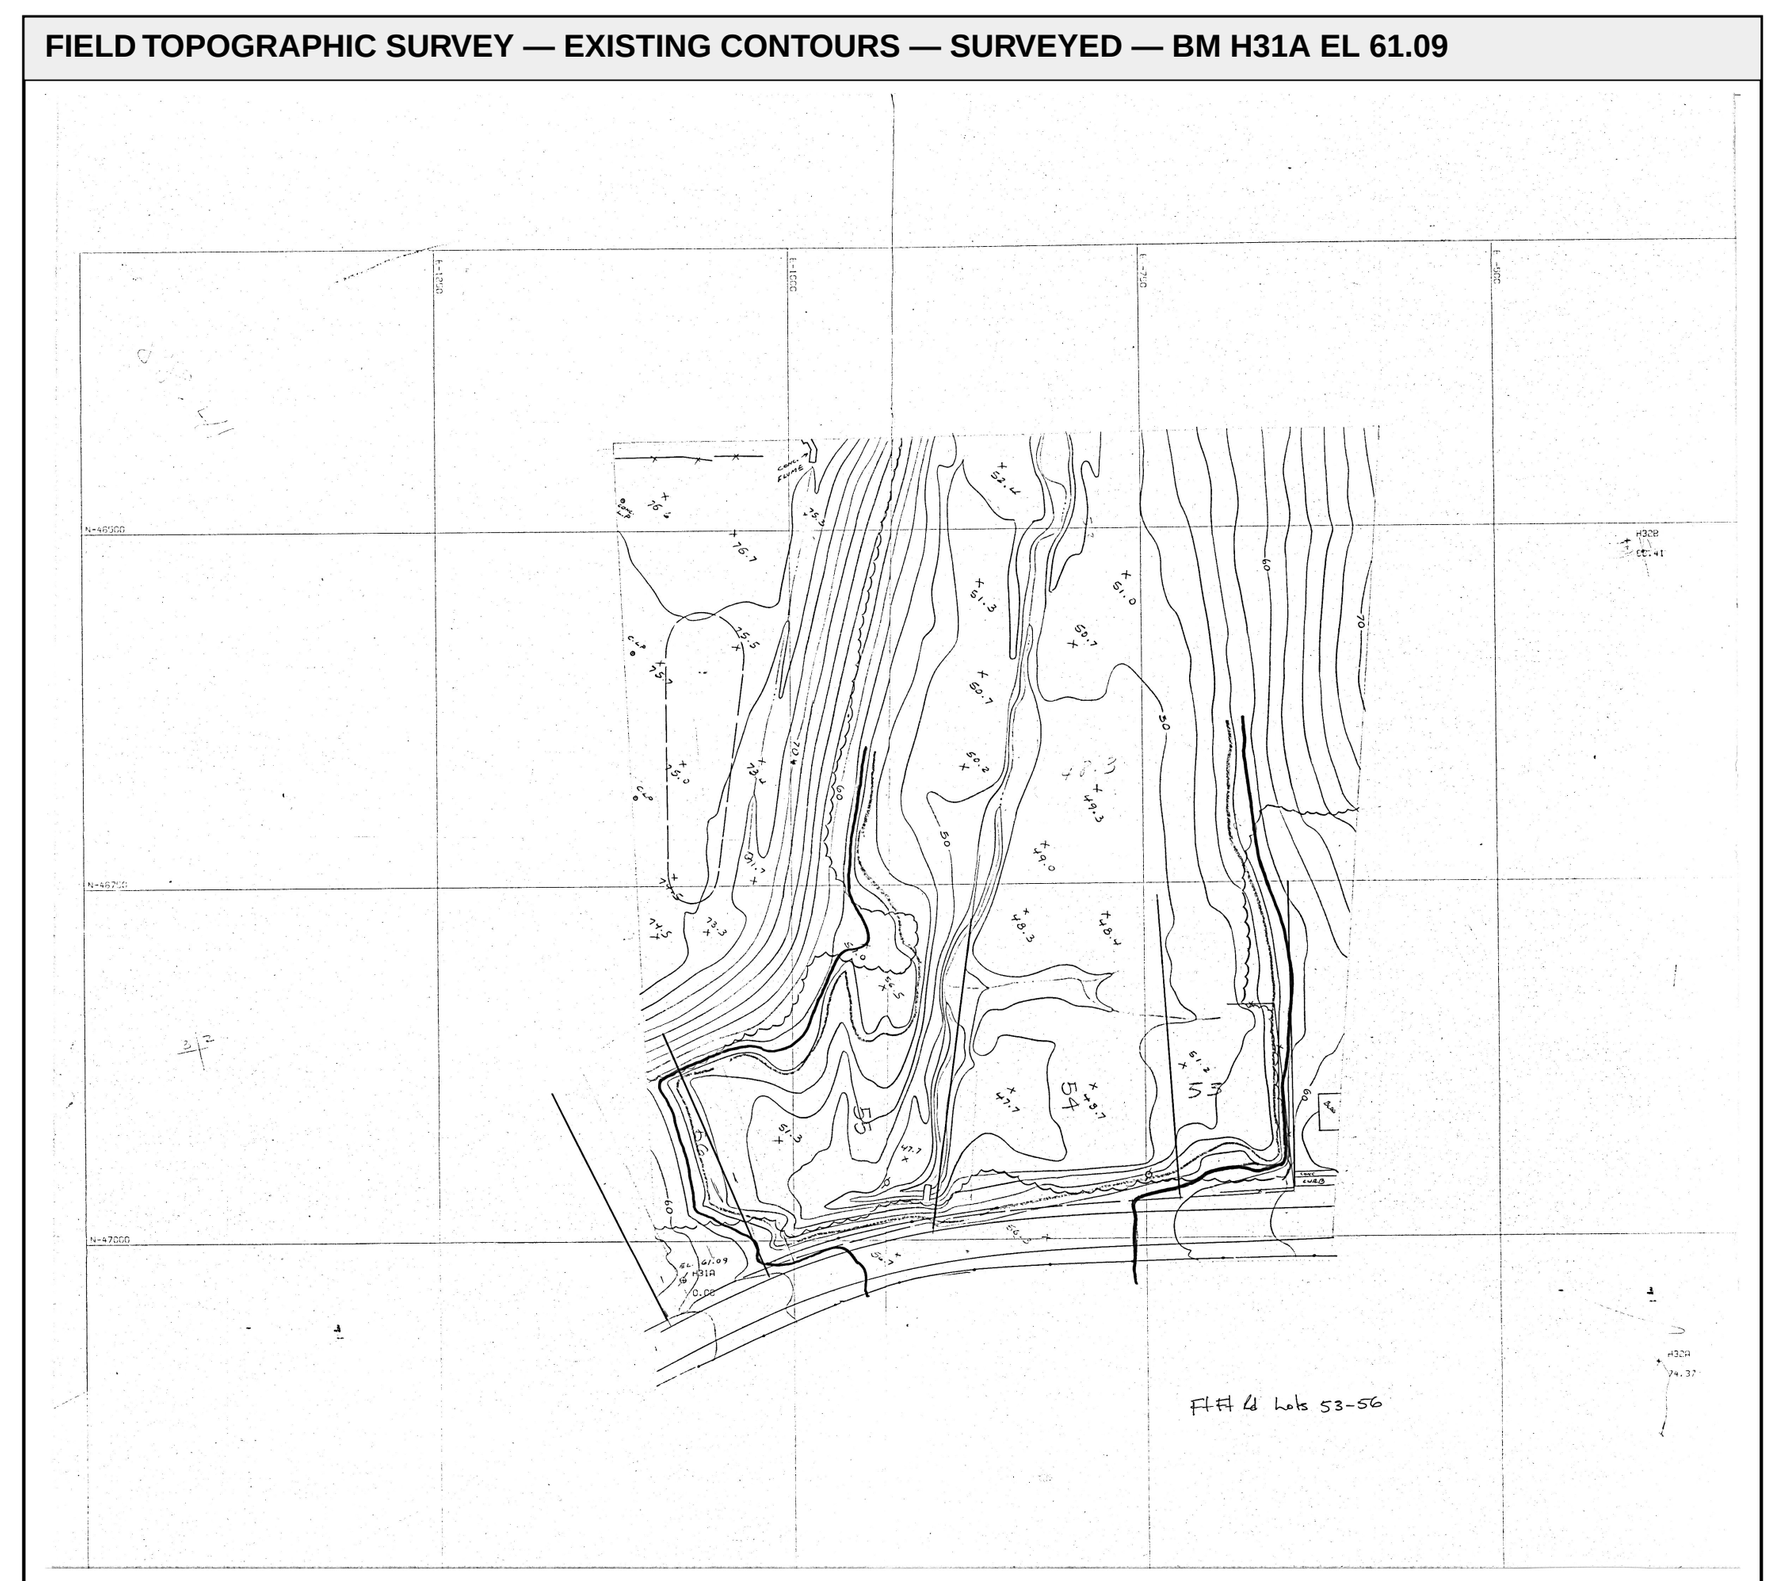

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

KEALEE

design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
C-400 — Grading and Drainage Plan

SCALE
1" = 30'

STATUS
PRELIMINARY

SHEET NO.
5 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION	
PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-400 — Grading and Drainage Plan
DISCIPLINE	Maryland Professional Engineer
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area — 75,178 SF
2. Area of dwelling — 4,784 SF
3. Wooded area — NOT ESTABLISHED
4. Floodplain area — NOT ESTABLISHED
5. Net lot area — 75,184 SF
6. TOTAL AREA DISTURBED — 41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3) — YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	192
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	**75,184**	**10.8%**	**2.96**	**3.84**	**0.88**	**924**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting — **1 DAY**
2. Obtain necessary permits — **2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation — **1 DAY**
4. Install stabilized construction entrance and perimeter sediment control — **2 DAYS**
5. Rough grade the lot — **5 DAYS**
6. Construct dwelling — **6 MONTHS**
7. Install water, sewer and storm services and the driveway — **10 DAYS**
8. Fine grade and stabilize all disturbed areas — **5 DAYS**
9. Remove sediment control once the inspector gives written permission — **1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F. PLAT BOOK WWW 65, P. 60 (MSA_S1289_51253). 12TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND. TAX MAP 113, BLOCK F, GRID E4. PLAT DATED 6 JUNE 1967; APPROVED 26 JUNE 1967 BY THE MARYLAND-NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD. M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR: W. L. MEEKINS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20.9811 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE ____________ DATE ____________

LICENSE NO. ____________ EXPIRATION DATE ____________

SEAL

REVISIONS
— none

3 REQUIRED NOTE(S) — GRADING CERTIFICATE; STABILIZATION COMPLIANCE PREAMBLE; STANDARD STABILIZATION NOTE — ARE CARRIED IN FULL ON SHEET C-000.

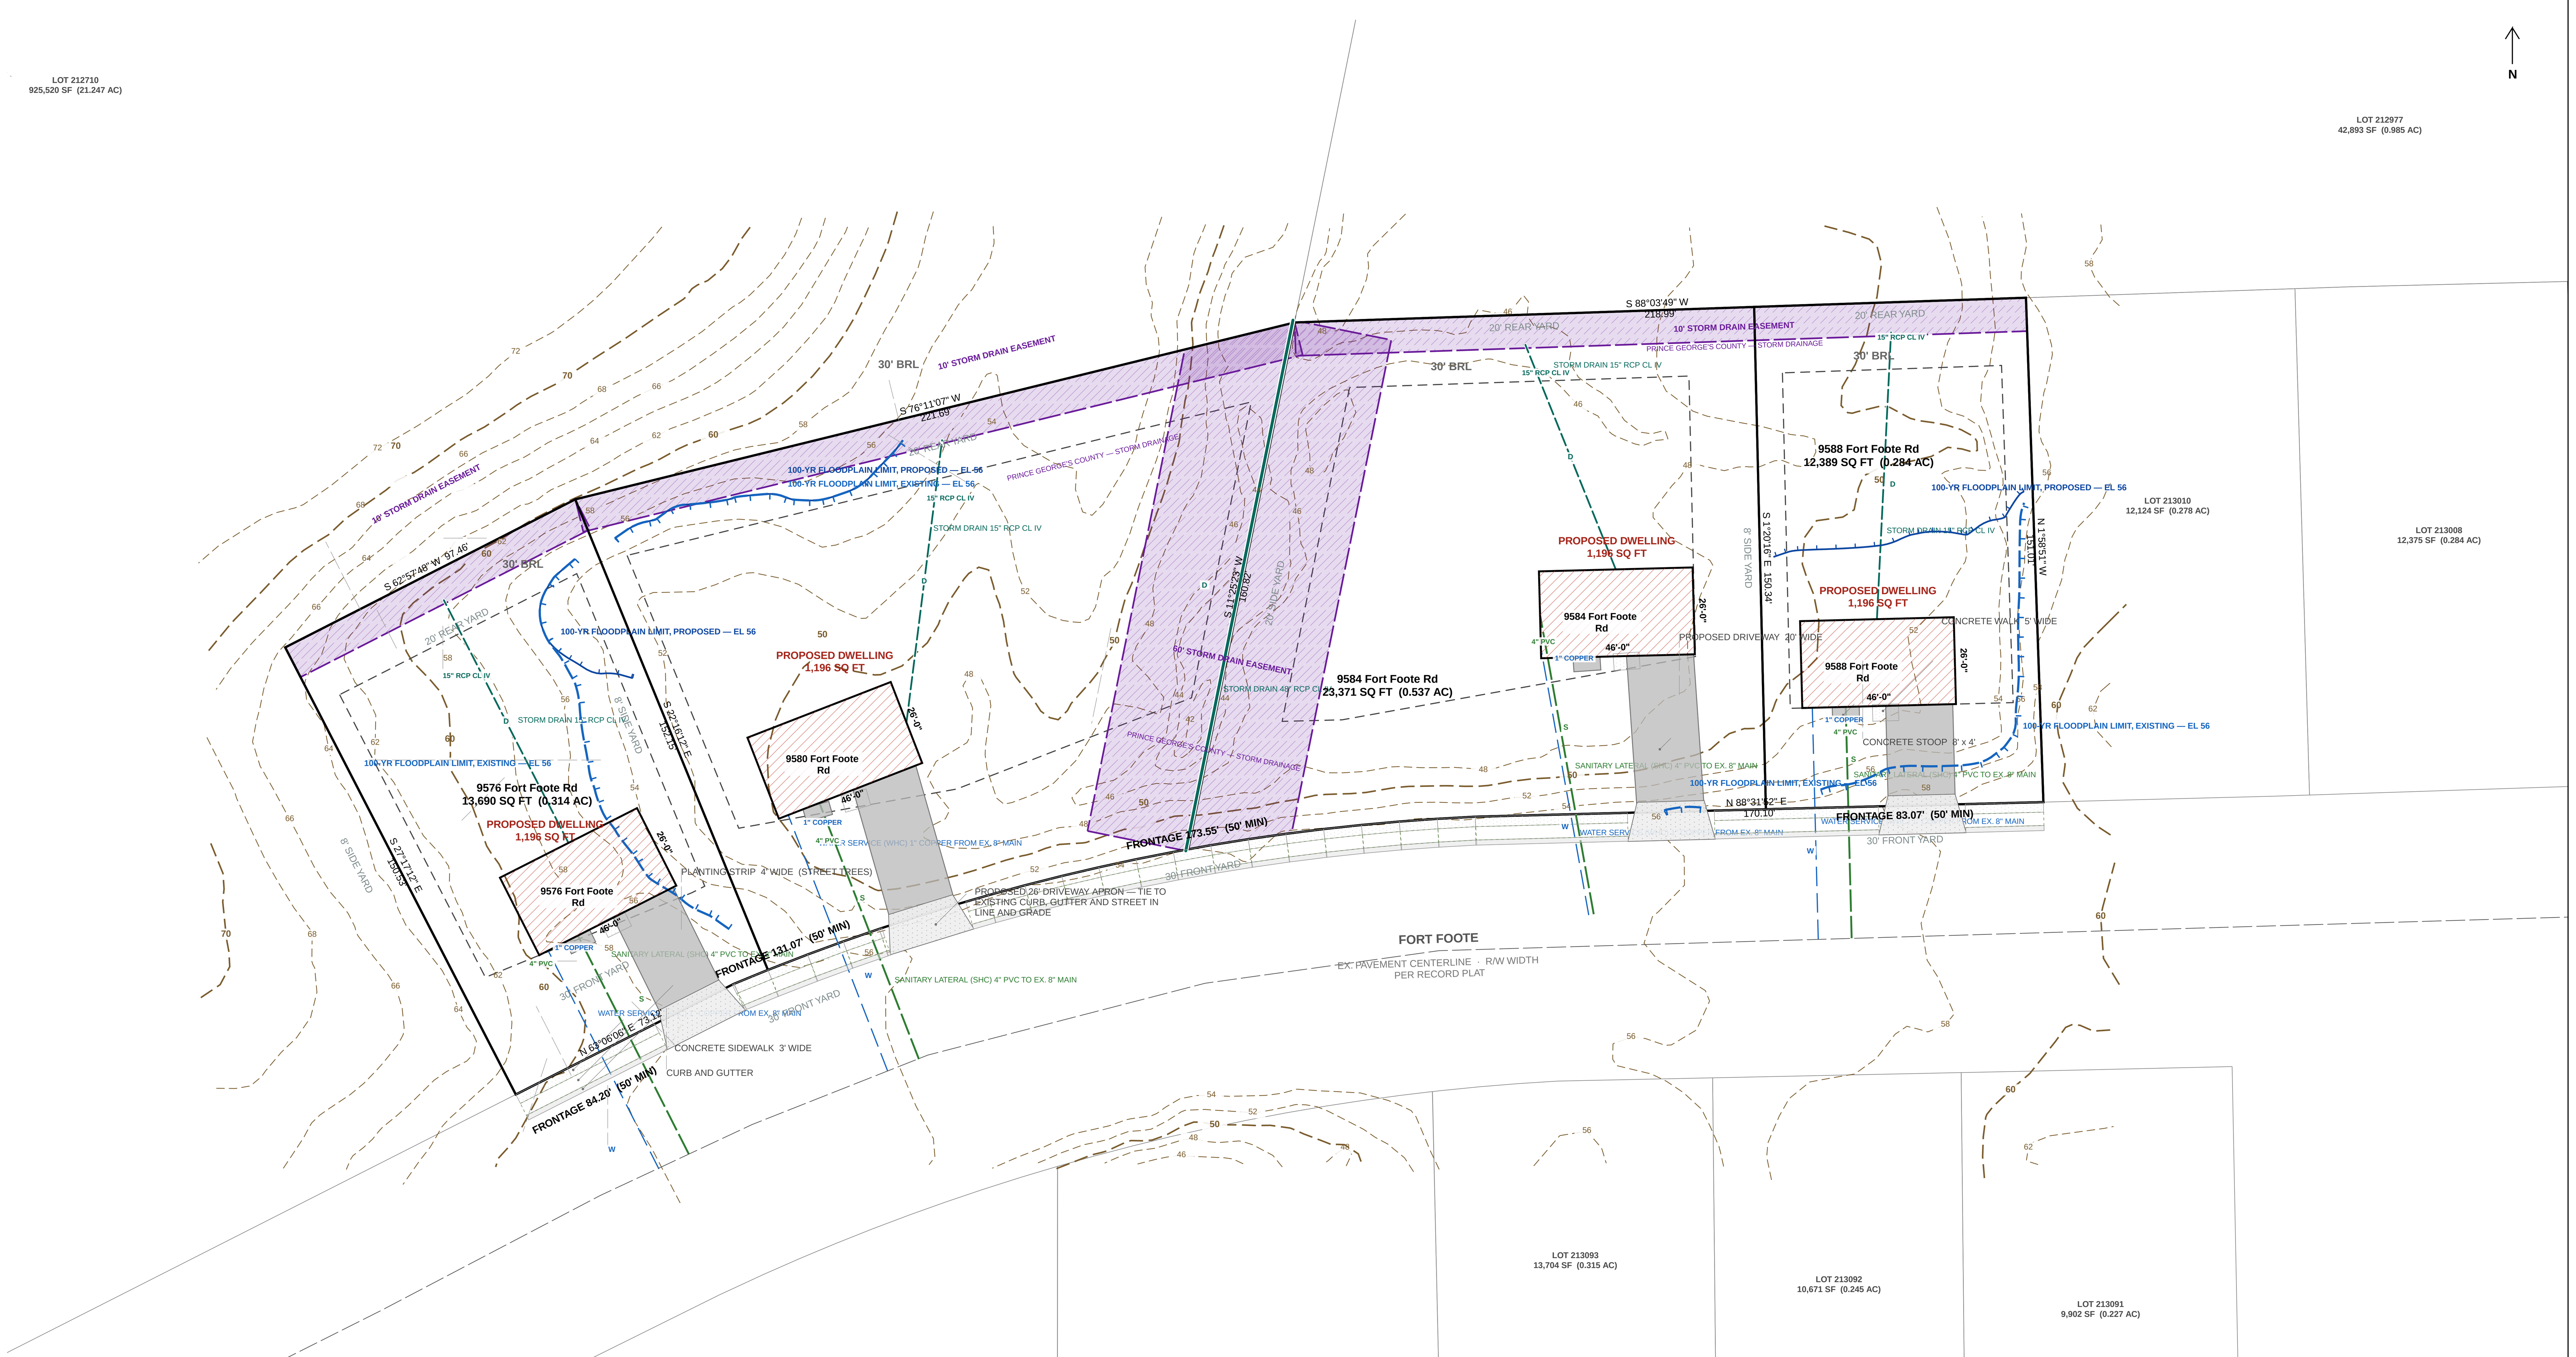

SOILS TABLE
USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

DRAINAGE SWALE SCHEDULE
Rational method, NOAA Atlas 14 · Manning n = 0.041, 2' bottom, 3:1 sides

REACH	LENGTH	GRADE	D.A. (AC)	Q10 (CFS)	Q100 (CFS)	DEPTH	V100 (FPS)	INV IN	INV OUT	CUT
ST-1 — ST-2	110'	3.01%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'
ST-4 — ST-3	157'	4.98%	0.3143	0.65	0.86	0.16'	2.12	60.30	52.50	1.0'
ST-3 — ST-2	177'	3.17%	0.9051	1.87	2.47	0.33'	2.51	52.50	46.90	1.0'

GRADE CONTROL SCHEDULE

POINT	LOT	DESCRIPTION	GROUND	SWALE INV
ST-1	LOT 53	Swale grade break / invert control	51.20	50.20
ST-2	LOT 54	Swale grade break / invert control	47.90	46.90
ST-3	LOT 55	Swale grade break / invert control	53.50	52.50
ST-4	LOT 56	Swale grade break / invert control	61.30	60.30
OUT	—	Swale grade break / invert control	48.90	—

SYSTEM AT THE LOW POINT: 1.7260 AC, Q10 3.57 CFS, Q100 4.71 CFS.
MAX VELOCITY 2.51 FPS AT Q100 — WITHIN THE 5 FPS PERMISSIBLE FOR ESTABLISHED GRASS. 0.5 FT FREEBOARD THROUGHOUT.
THE SWALE DISCHARGES TO THE RECORDED 54/55 STORM DRAIN EASEMENT, ALONGSIDE THE 48" RCP CL IV EXTENDING THE FORT FOOTE ROAD CULVERT INLET.
THAT MAIN IS BURIED: OD 4.67 FT, 1.5 FT MIN COVER OVER THE CROWN — FINISHED GRADE OVER IT SHALL BE NO LOWER THAN INVERT + 6.17 FT. FILL WHERE EXISTING GROUND IS LOWER.
SWALE GRADES AND INVERTS TO BE SET FROM THE FIELD-RUN TOPOGRAPHIC SURVEY. ESTABLISH SOD BEFORE THE CONTRIBUTING AREA IS STABILISED.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

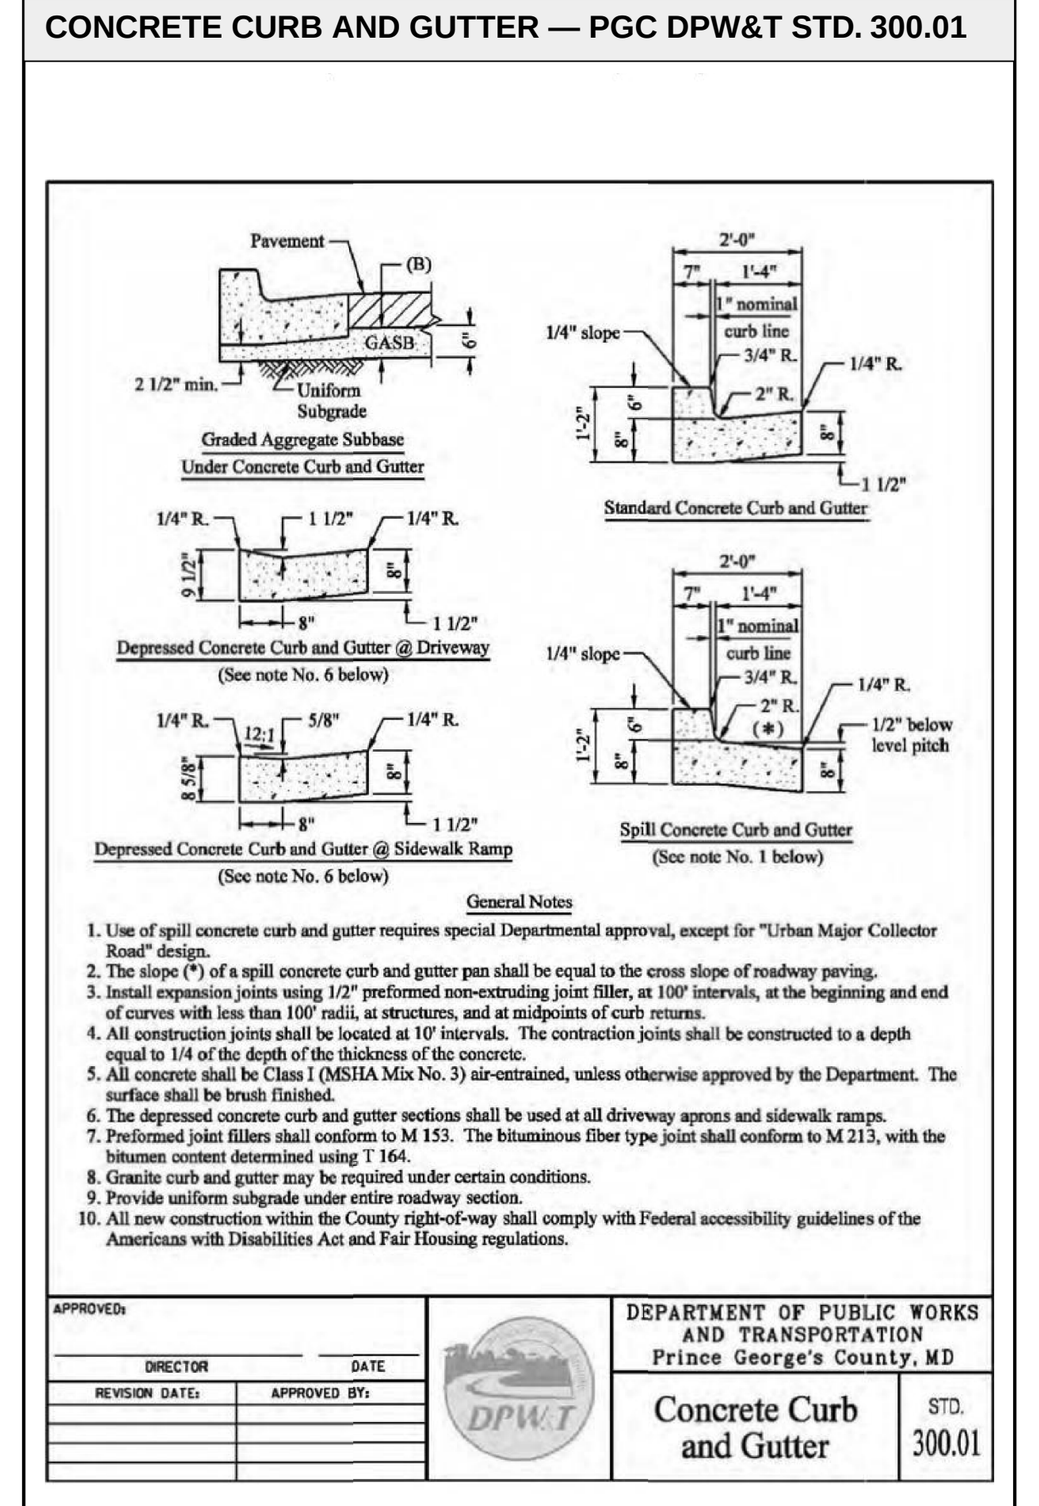

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

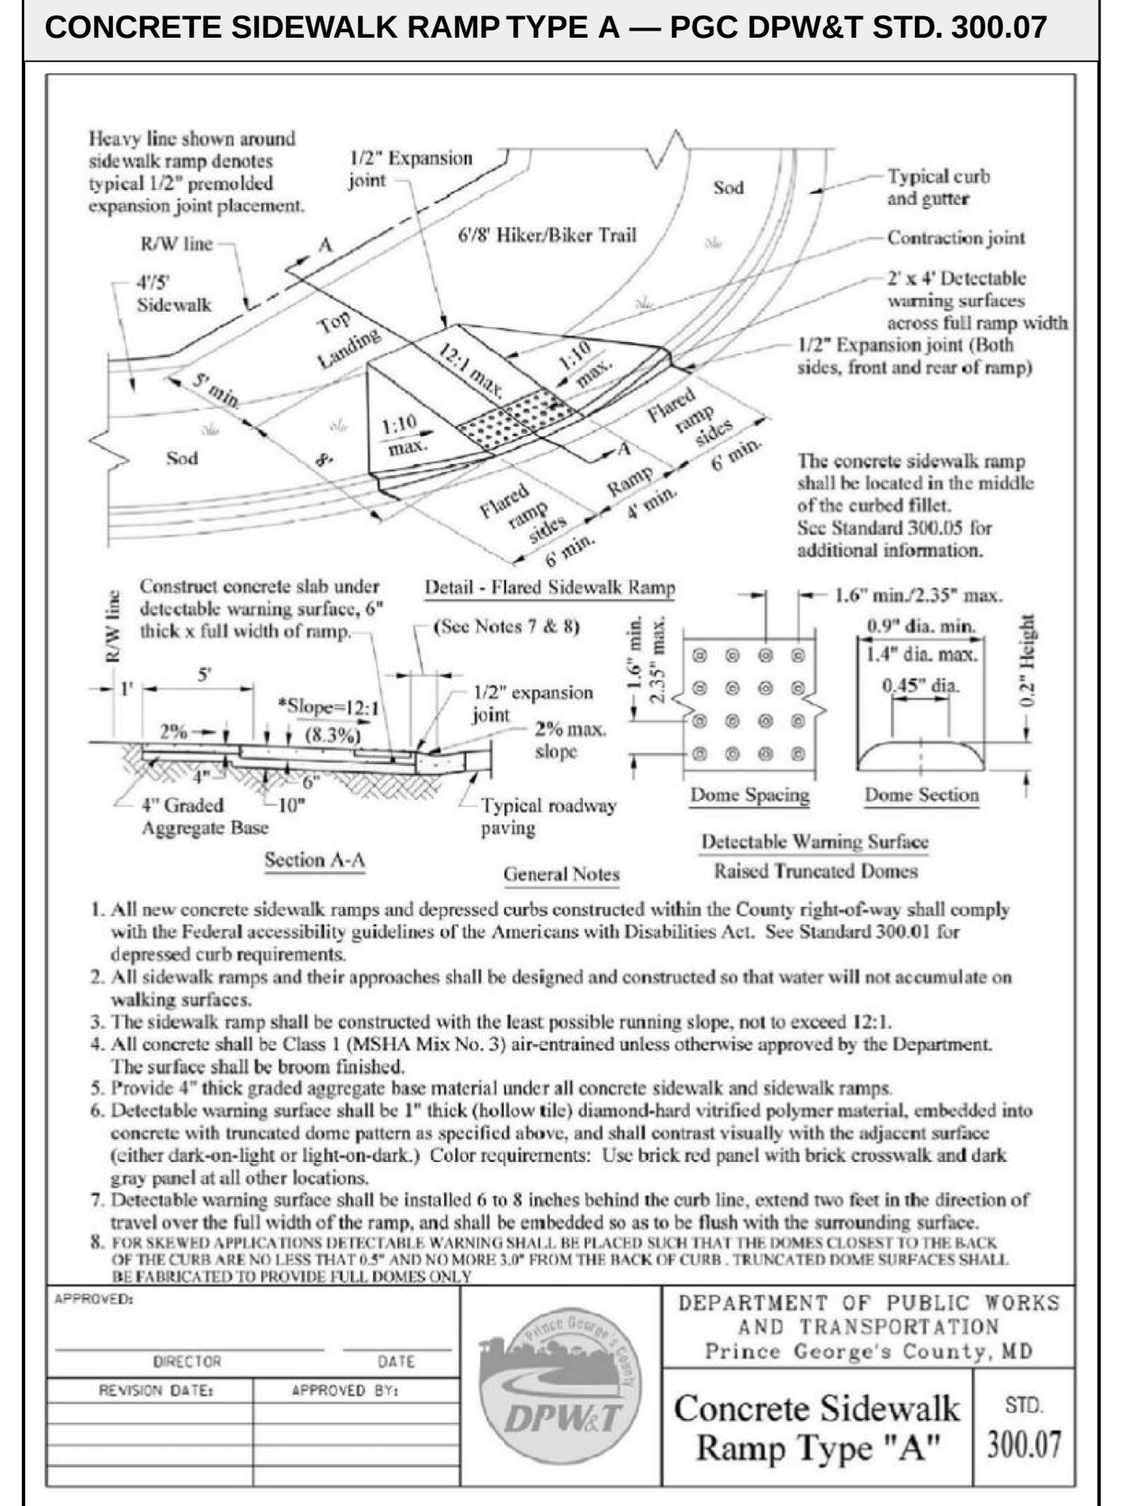

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

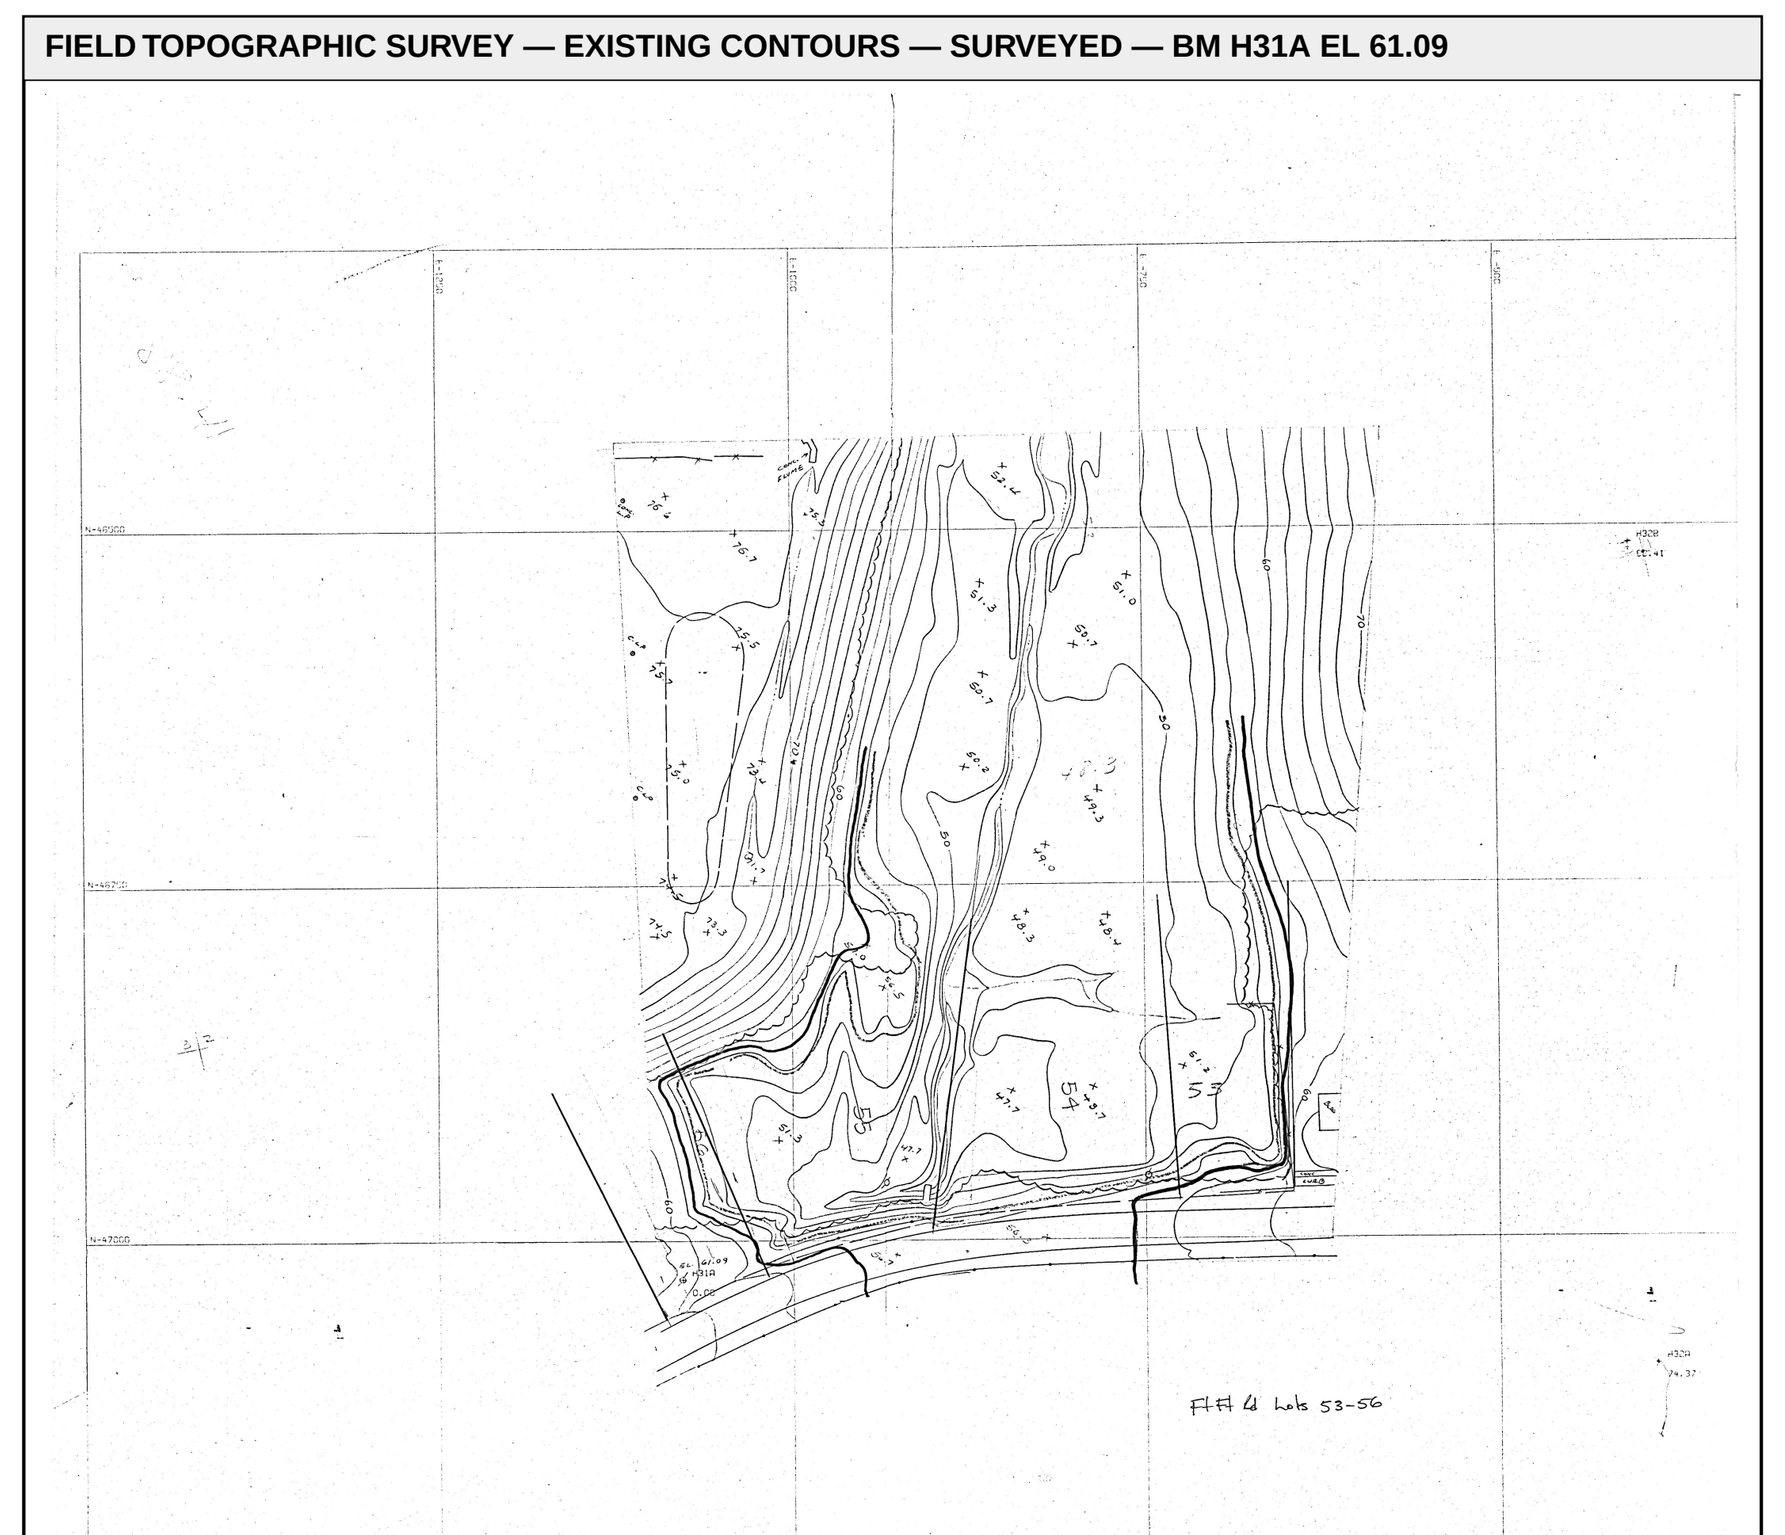

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

KEALEE
design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
C-500 — Utility Plan

SCALE
1" = 30'

STATUS
PRELIMINARY

SHEET NO.
6 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION

PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-500 — Utility Plan
DISCIPLINE	Maryland Professional Engineer
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	75,178 SF
2. Area of dwelling	4,784 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	75,184 SF
6. TOTAL AREA DISTURBED	41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	192
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	**75,184**	**10.8%**	**2.96**	**3.84**	**0.88**	**924**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES
1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F. PLAT BOOK WWW 65, P. 60 (MSA_S1289_51253). 12TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND. TAX MAP 113, BLOCK F, GRID E4. PLAT DATED 6 JUNE 1967; APPROVED 26 JUNE 1967 BY THE MARYLAND-NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD. M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR: W. L. MEEKINS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20.9811 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION
I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE | DATE
LICENSE NO. | EXPIRATION DATE
SEAL

REVISIONS
— none —

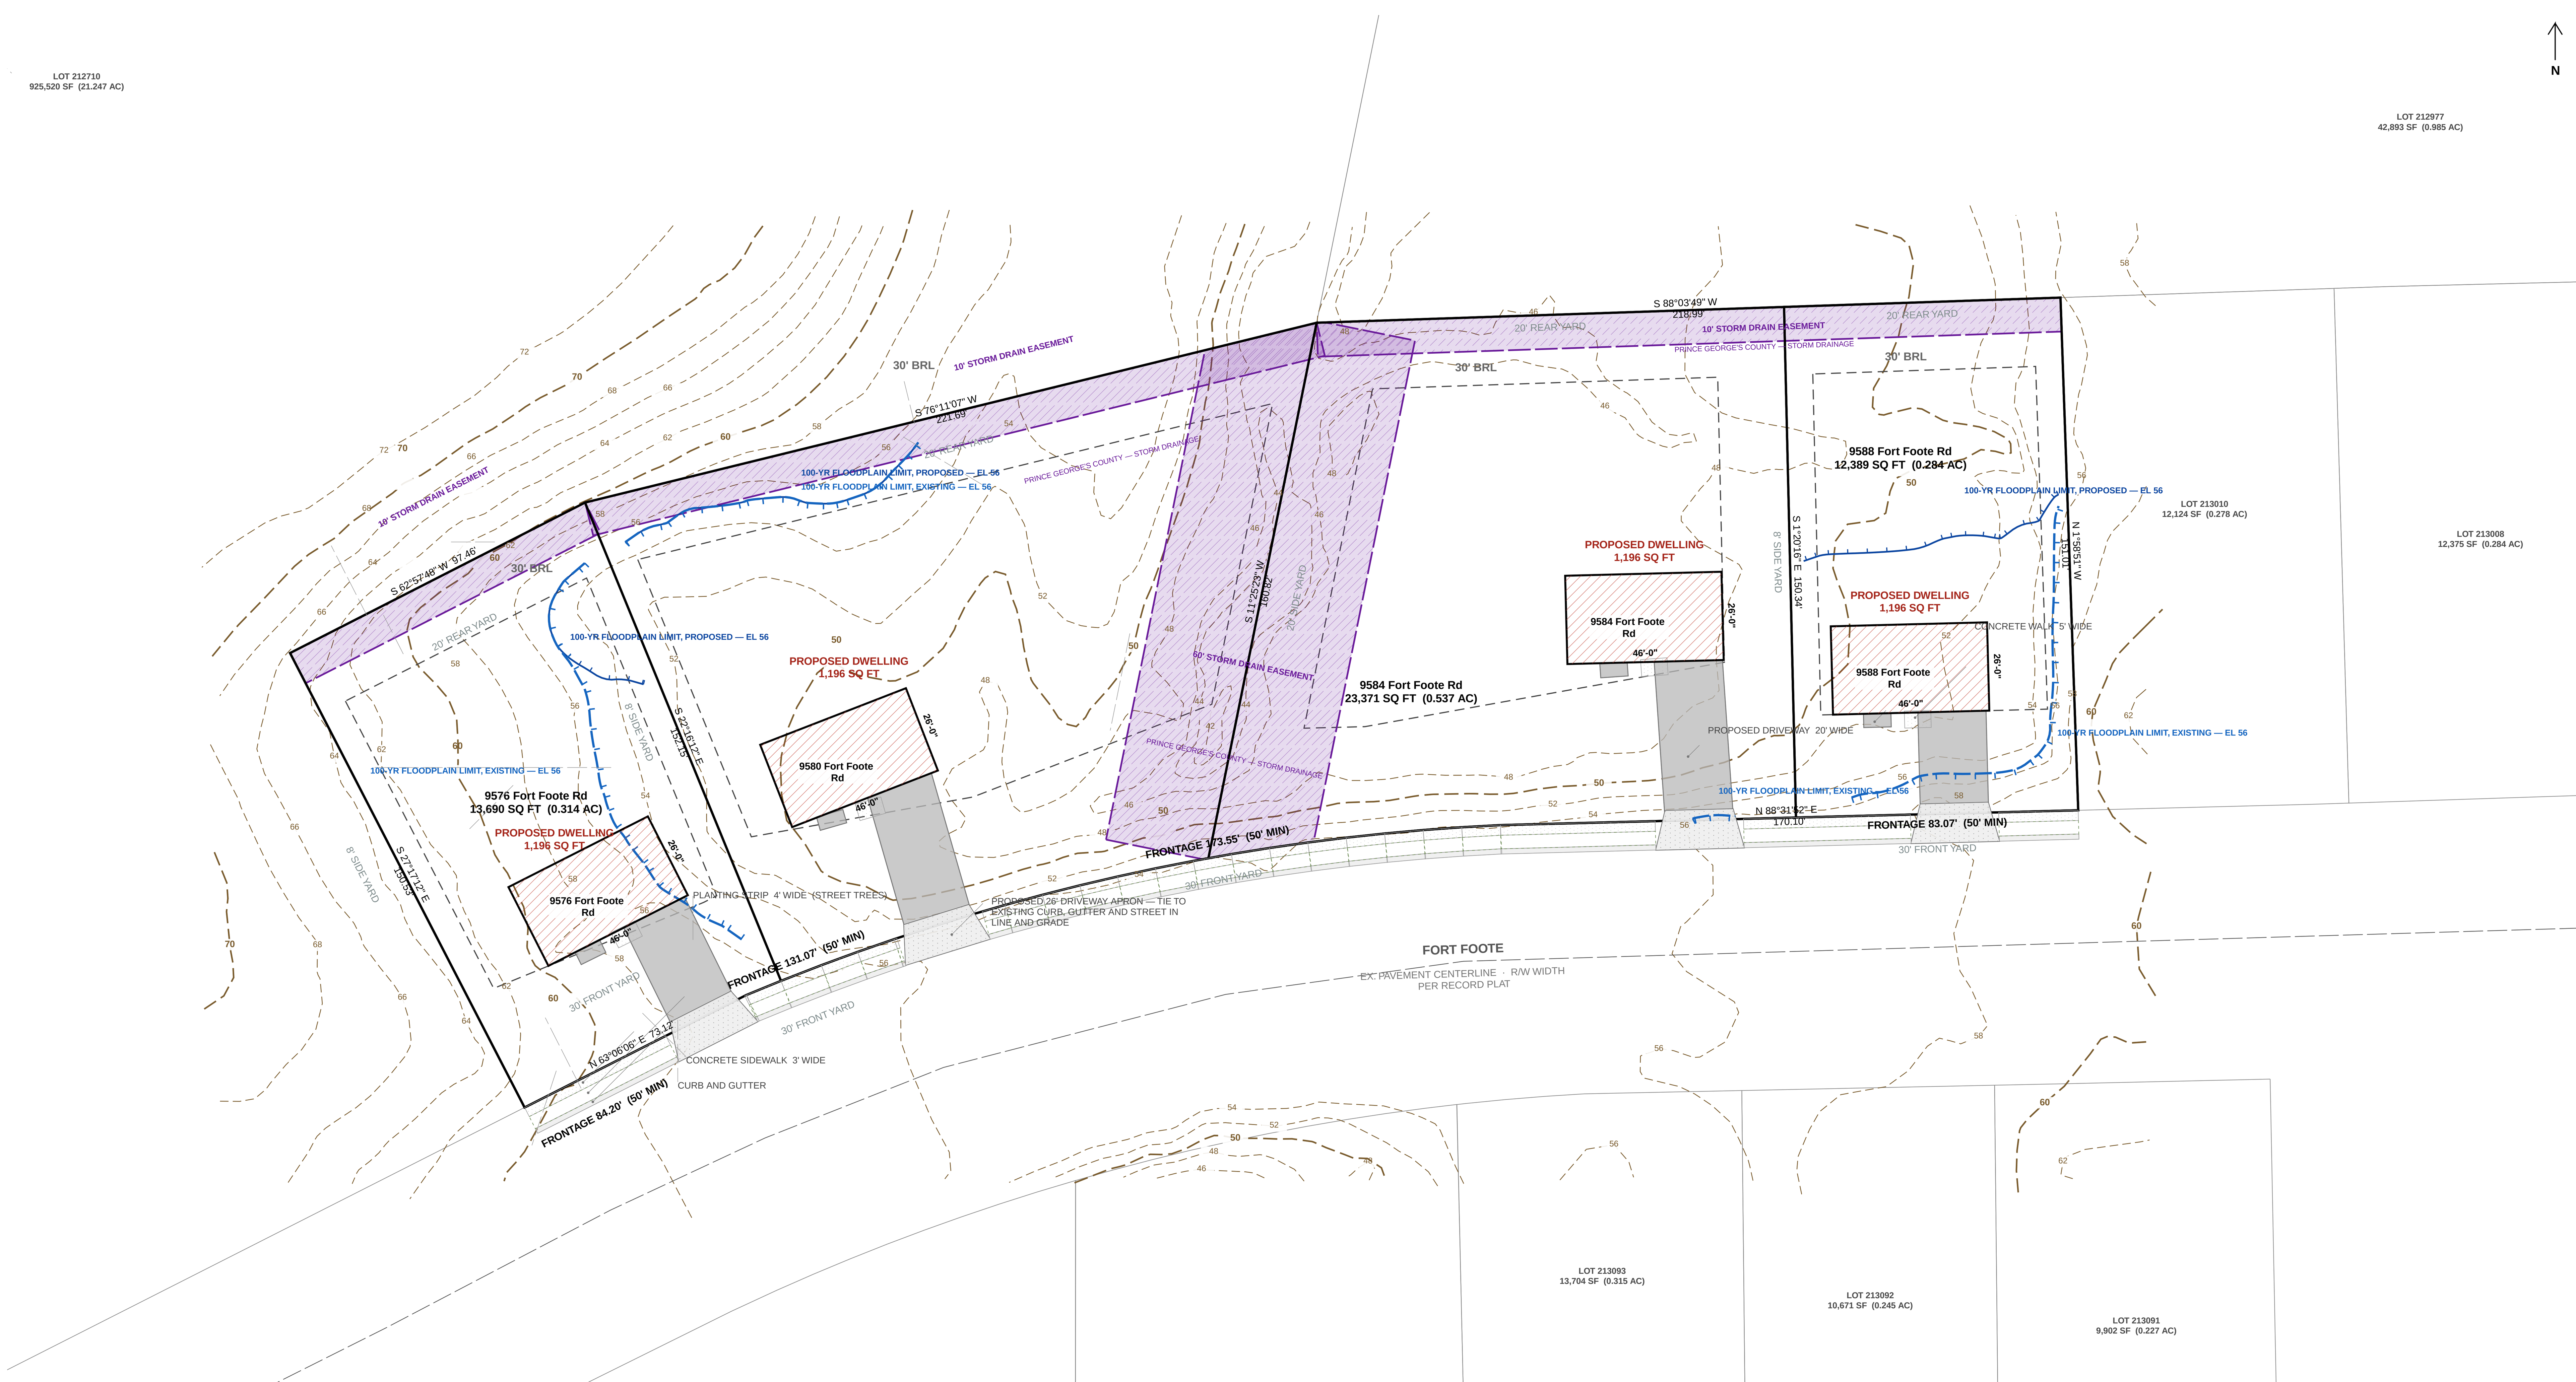

SOILS TABLE

USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

DRAINAGE SWALE SCHEDULE

Rational method, NOAA Atlas 14 · Manning n = 0.041, 2' bottom, 3:1 sides

LOT 213101
29,852 SF (0.685 AC)

LOT 239698
287,905 SF (6.609 AC)

REACH	LENGTH	GRADE	D.A. (AC)	Q10 (CFS)	Q100 (CFS)	DEPTH	V100 (FPS)	INV IN	INV OUT	CUT
ST-1 — ST-2	110'	3.01%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'
ST-4 — ST-3	157'	4.98%	0.3143	0.65	0.86	0.16'	2.12	60.30	52.50	1.0'
ST-3 — ST-2	177'	3.17%	0.9051	1.87	2.47	0.33'	2.51	52.50	46.90	1.0'

GRADE CONTROL SCHEDULE

POINT	LOT	DESCRIPTION	GROUND	SWALE INV
ST-1	LOT 53	Swale grade break / invert control	51.20	50.20
ST-2	LOT 54	Swale grade break / invert control	47.90	46.90
ST-3	LOT 55	Swale grade break / invert control	53.50	52.50
ST-4	LOT 56	Swale grade break / invert control	61.30	60.30
OUT	—	Swale grade break / invert control	48.90	—

SYSTEM AT THE LOW POINT: 1.7260 AC, Q10 3.57 CFS, Q100 4.71 CFS.
MAX VELOCITY 2.51 FPS AT Q100 — WITHIN THE 5 FPS PERMISSIBLE FOR ESTABLISHED GRASS. 0.5 FT FREEBOARD THROUGHOUT.
THE SWALE DISCHARGES TO THE RECORDED 54/55 STORM DRAIN EASEMENT, ALONGSIDE THE 48" RCP CL IV EXTENDING THE FORT FOOTE ROAD CULVERT INLET.
THAT MAIN IS BURIED: OD 4.67 FT, 1.5 FT MIN COVER OVER THE CROWN — FINISHED GRADE OVER IT SHALL BE NO LOWER THAN INVERT + 6.17 FT. FILL WHERE EXISTING GROUND IS LOWER.
SWALE GRADES AND INVERTS TO BE SET FROM THE FIELD-RUN TOPOGRAPHIC SURVEY. ESTABLISH SOD BEFORE THE CONTRIBUTING AREA IS STABILISED.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

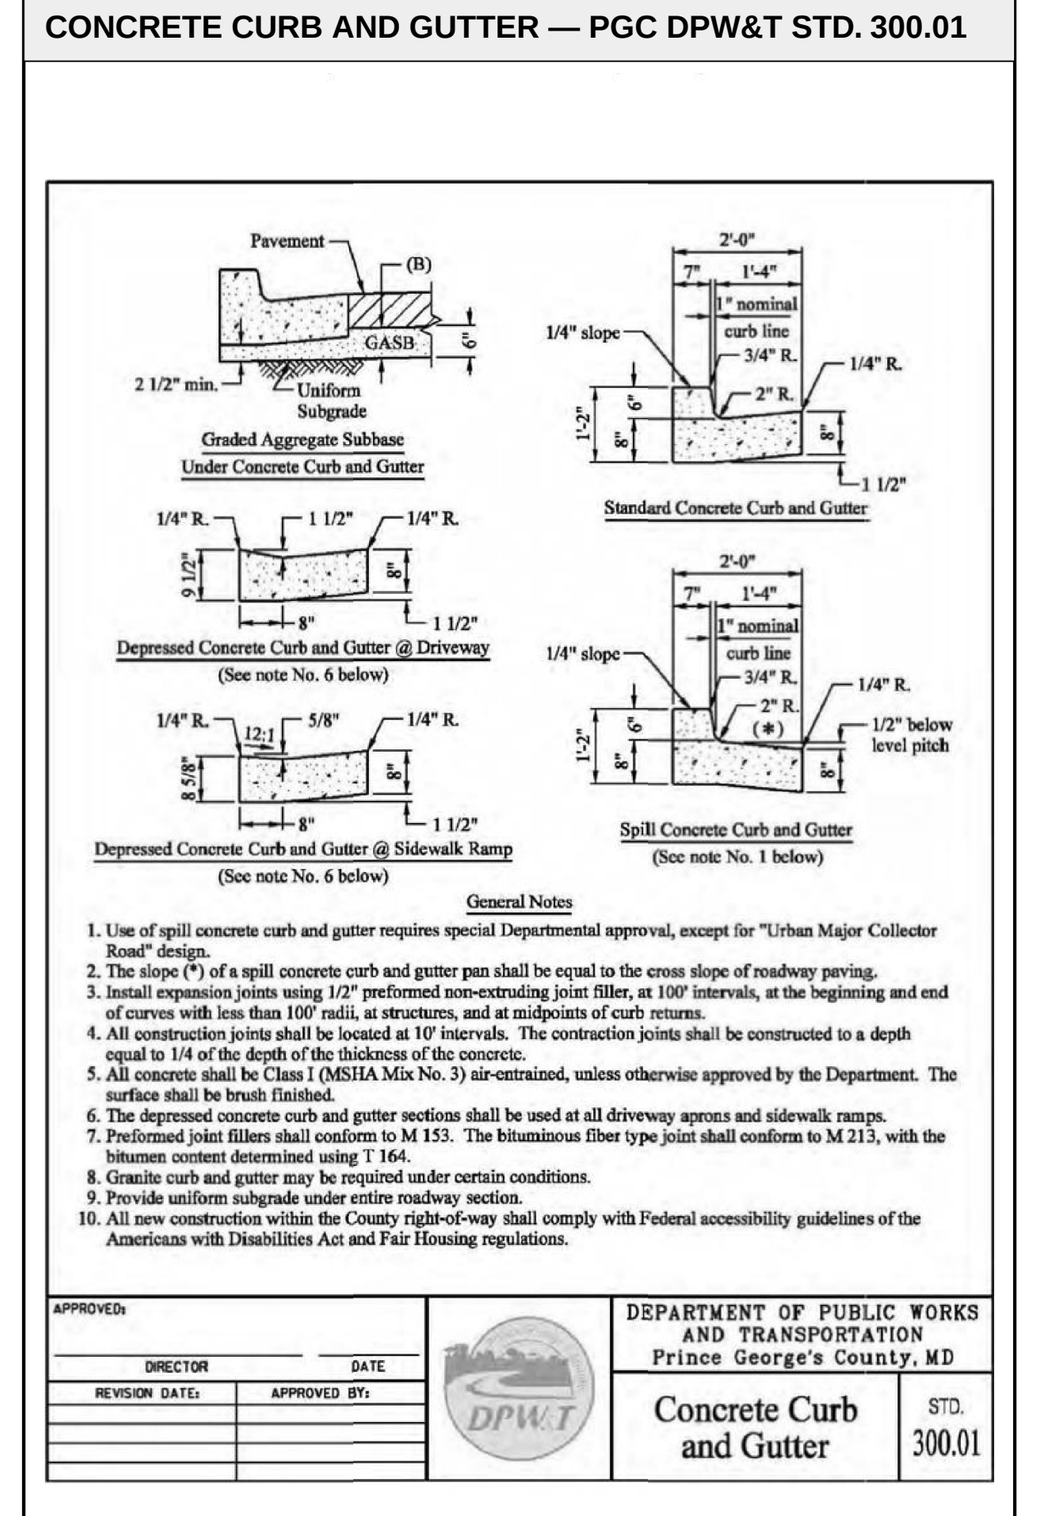

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

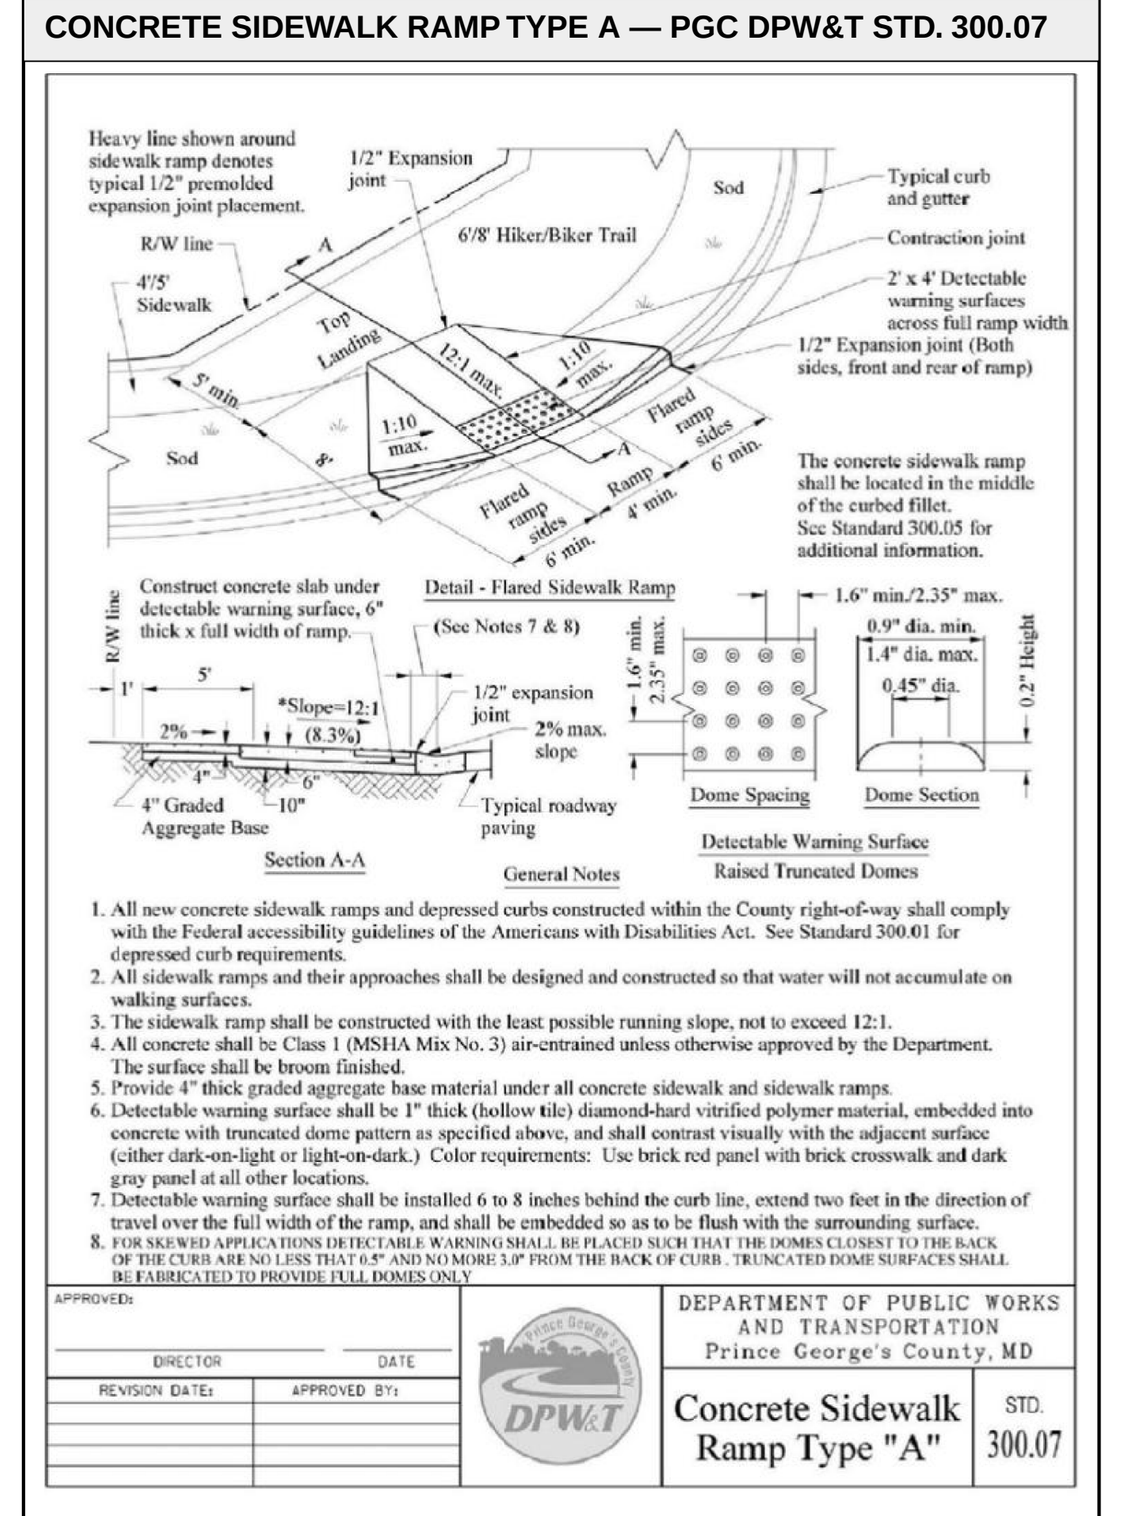

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

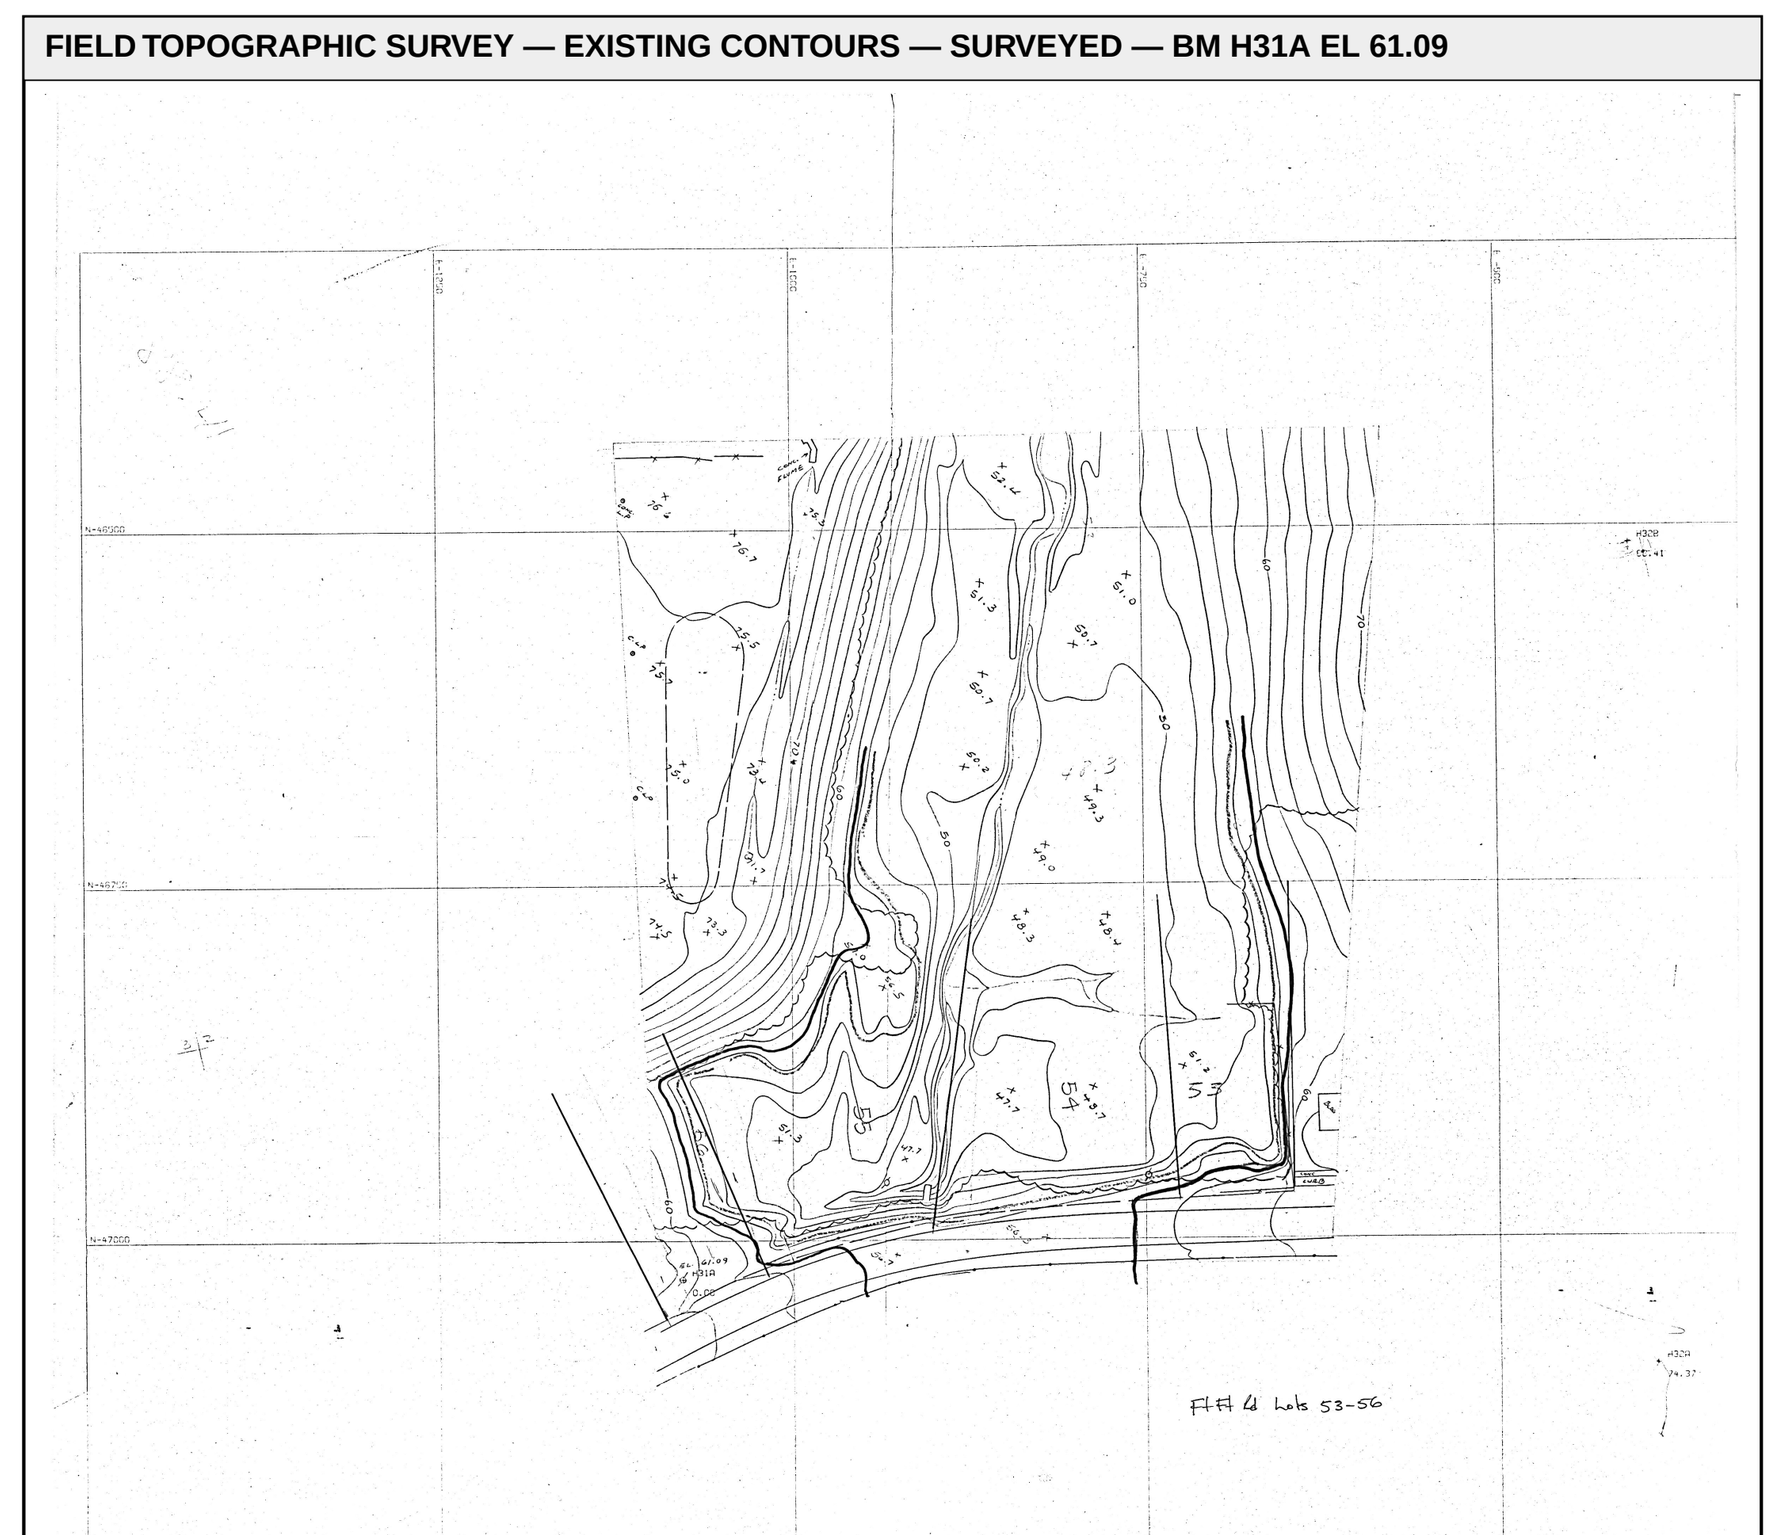

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

KEALEE

design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
C-600 — Stormwater Management Plan

SCALE
1" = 30'

STATUS
PRELIMINARY

SHEET NO.
7 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION

PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-600 — Stormwater Management Plan
DISCIPLINE	Maryland Professional Engineer
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	75,178 SF
2. Area of dwelling	4,784 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	75,184 SF
6. TOTAL AREA DISTURBED	41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	192
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	**75,184**	**10.8%**	**2.96**	**3.84**	**0.88**	**924**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F. PLAT BOOK WWW 65, P. 60 (MSA_S1289_51253). 12TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND. TAX MAP 113, BLOCK F, GRID E4. PLAT DATED 6 JUNE 1967; APPROVED 26 JUNE 1967 BY THE MARYLAND-NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD. M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR: W. L. MEEKINS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20.9811 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE
DATE
LICENSE NO.
EXPIRATION DATE
SEAL

REVISIONS
— none —

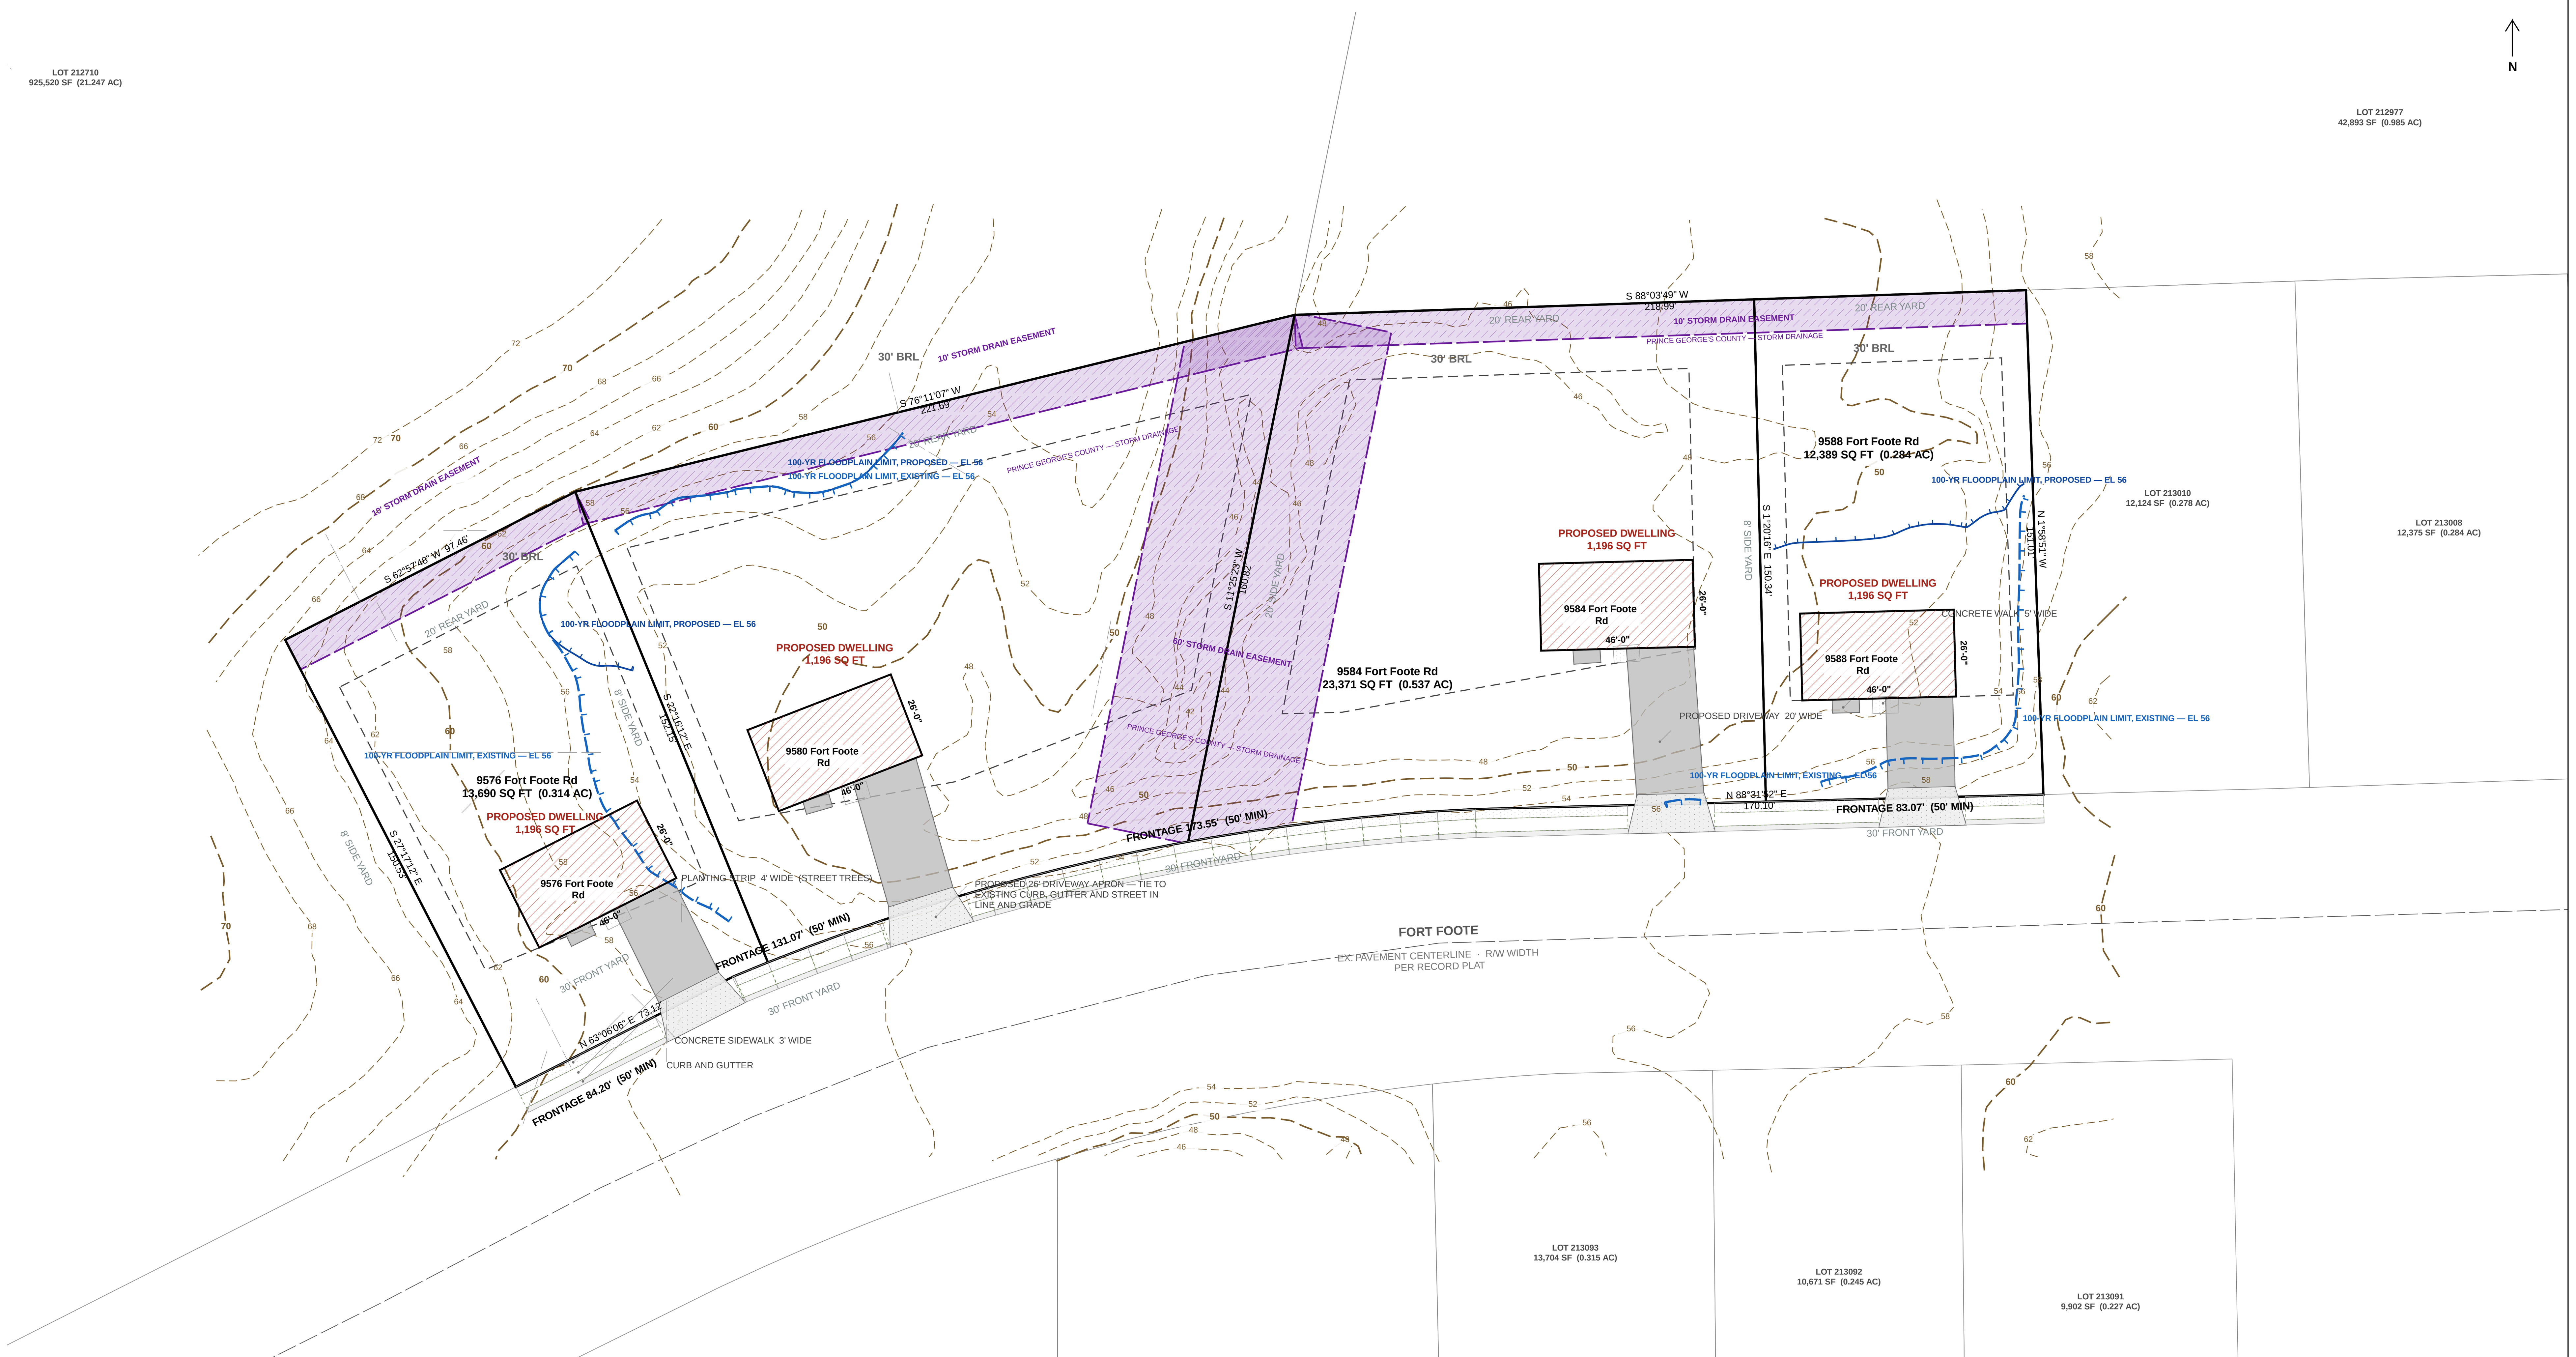

SOILS TABLE USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

DRAINAGE SWALE SCHEDULE Rational method, NOAA Atlas 14 · Manning n = 0.041, 2' bottom, 3:1 sides

REACH	LENGTH	GRADE	D.A. (AC)	Q10 (CFS)	Q100 (CFS)	DEPTH	V100 (FPS)	INV IN	INV OUT	CUT
ST-1 — ST-2	110'	3.01%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'
ST-4 — ST-3	157'	4.98%	0.3143	0.65	0.86	0.16'	2.12	60.30	52.50	1.0'
ST-3 — ST-2	177'	3.17%	0.9051	1.87	2.47	0.33'	2.51	52.50	46.90	1.0'

GRADE CONTROL SCHEDULE

POINT	LOT	DESCRIPTION	GROUND	SWALE INV
ST-1	LOT 53	Swale grade break / invert control	51.20	50.20
ST-2	LOT 54	Swale grade break / invert control	47.90	46.90
ST-3	LOT 55	Swale grade break / invert control	53.50	52.50
ST-4	LOT 56	Swale grade break / invert control	61.30	60.30
OUT	—	Swale grade break / invert control	48.90	—

SYSTEM AT THE LOW POINT: 1.7260 AC, Q10 3.57 CFS, Q100 4.71 CFS.
MAX VELOCITY 2.51 FPS AT Q100 — WITHIN THE 5 FPS PERMISSIBLE FOR ESTABLISHED GRASS. 0.5 FT FREEBOARD THROUGHOUT.
THE SWALE DISCHARGES TO THE RECORDED 54/55 STORM DRAIN EASEMENT, ALONGSIDE THE 48" RCP CL IV EXTENDING THE FORT FOOTE ROAD CULVERT INLET.
THAT MAIN IS BURIED: OD 4.67 FT, 1.5 FT MIN COVER OVER THE CROWN — FINISHED GRADE OVER IT SHALL BE NO LOWER THAN INVERT + 6.17 FT. FILL WHERE EXISTING GROUND IS LOWER.
SWALE GRADES AND INVERTS TO BE SET FROM THE FIELD-RUN TOPOGRAPHIC SURVEY. ESTABLISH SOD BEFORE THE CONTRIBUTING AREA IS STABILISED.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

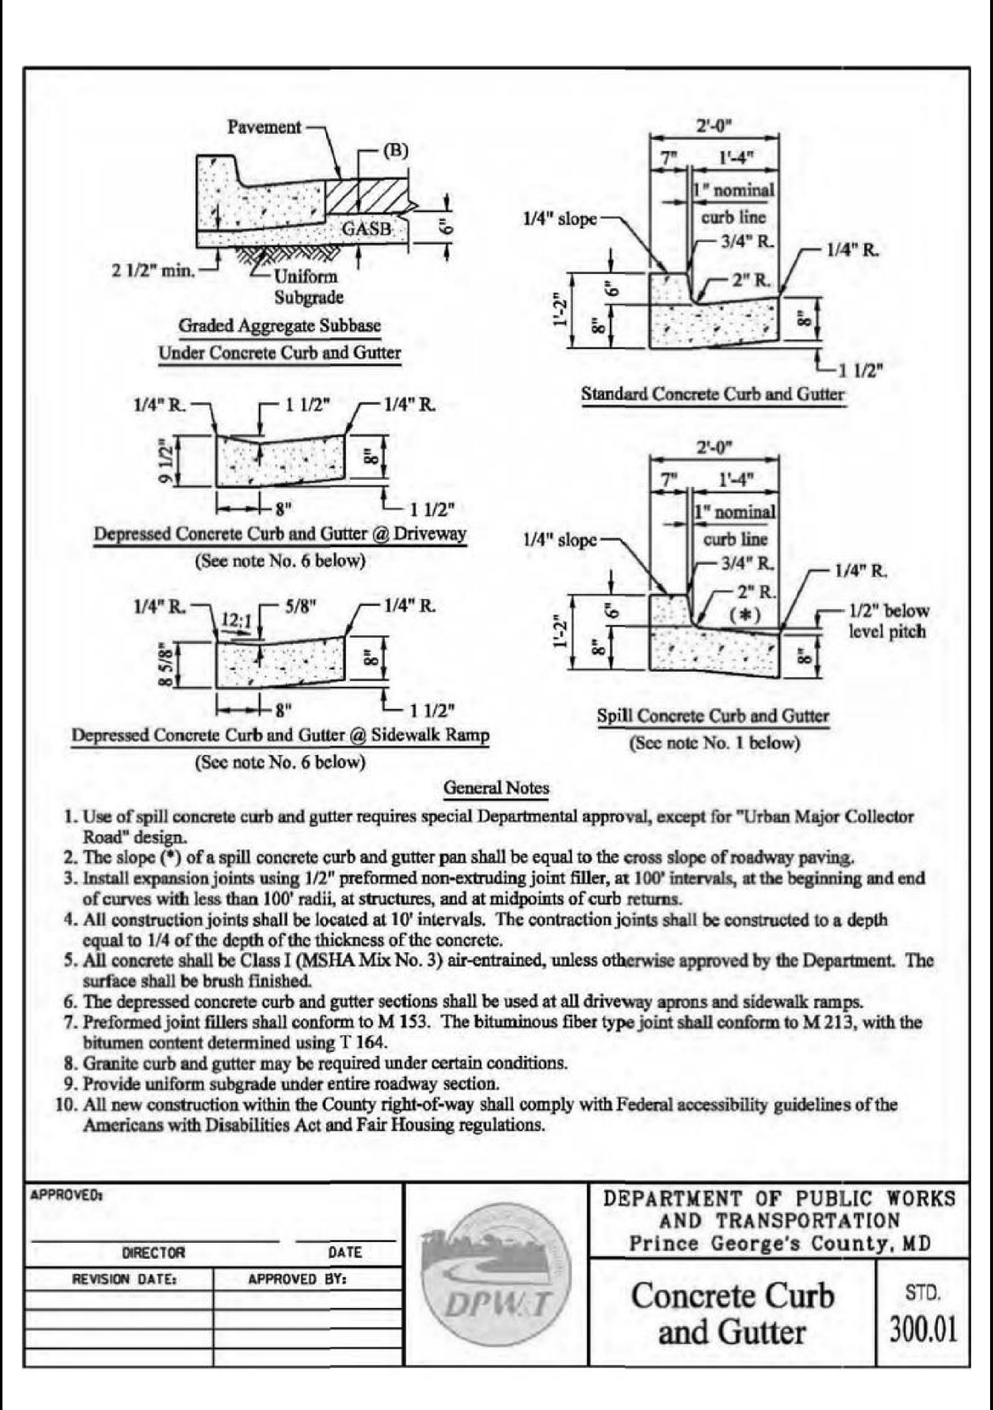

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

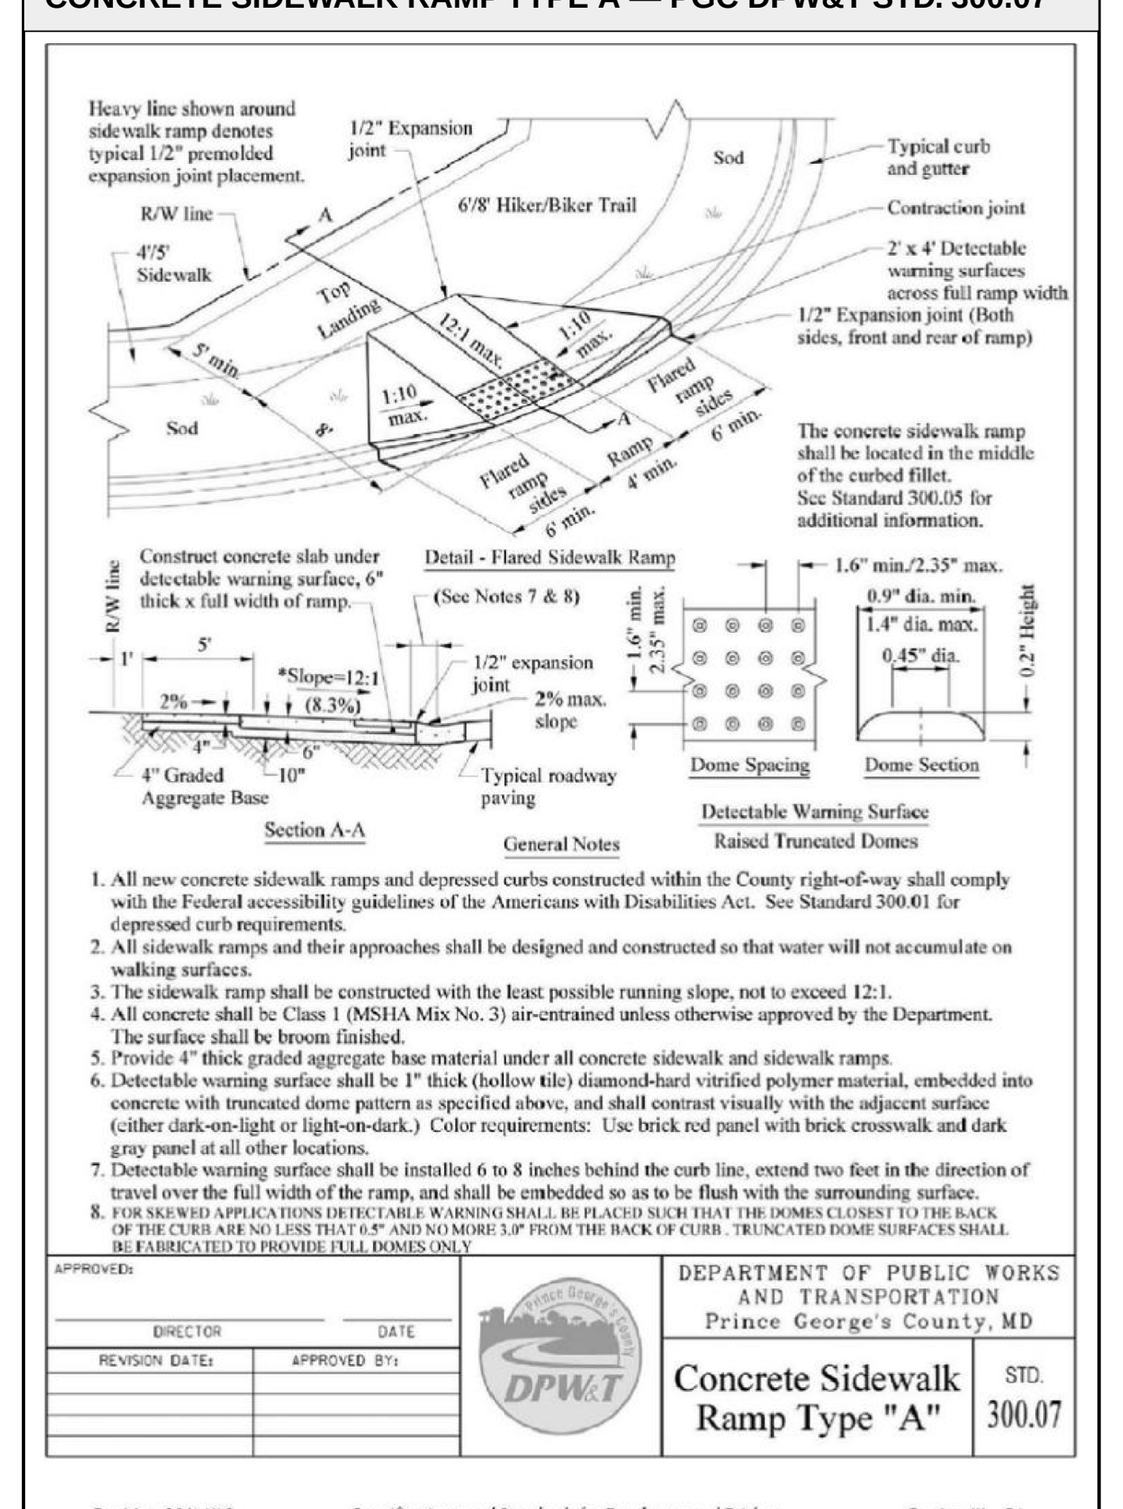

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

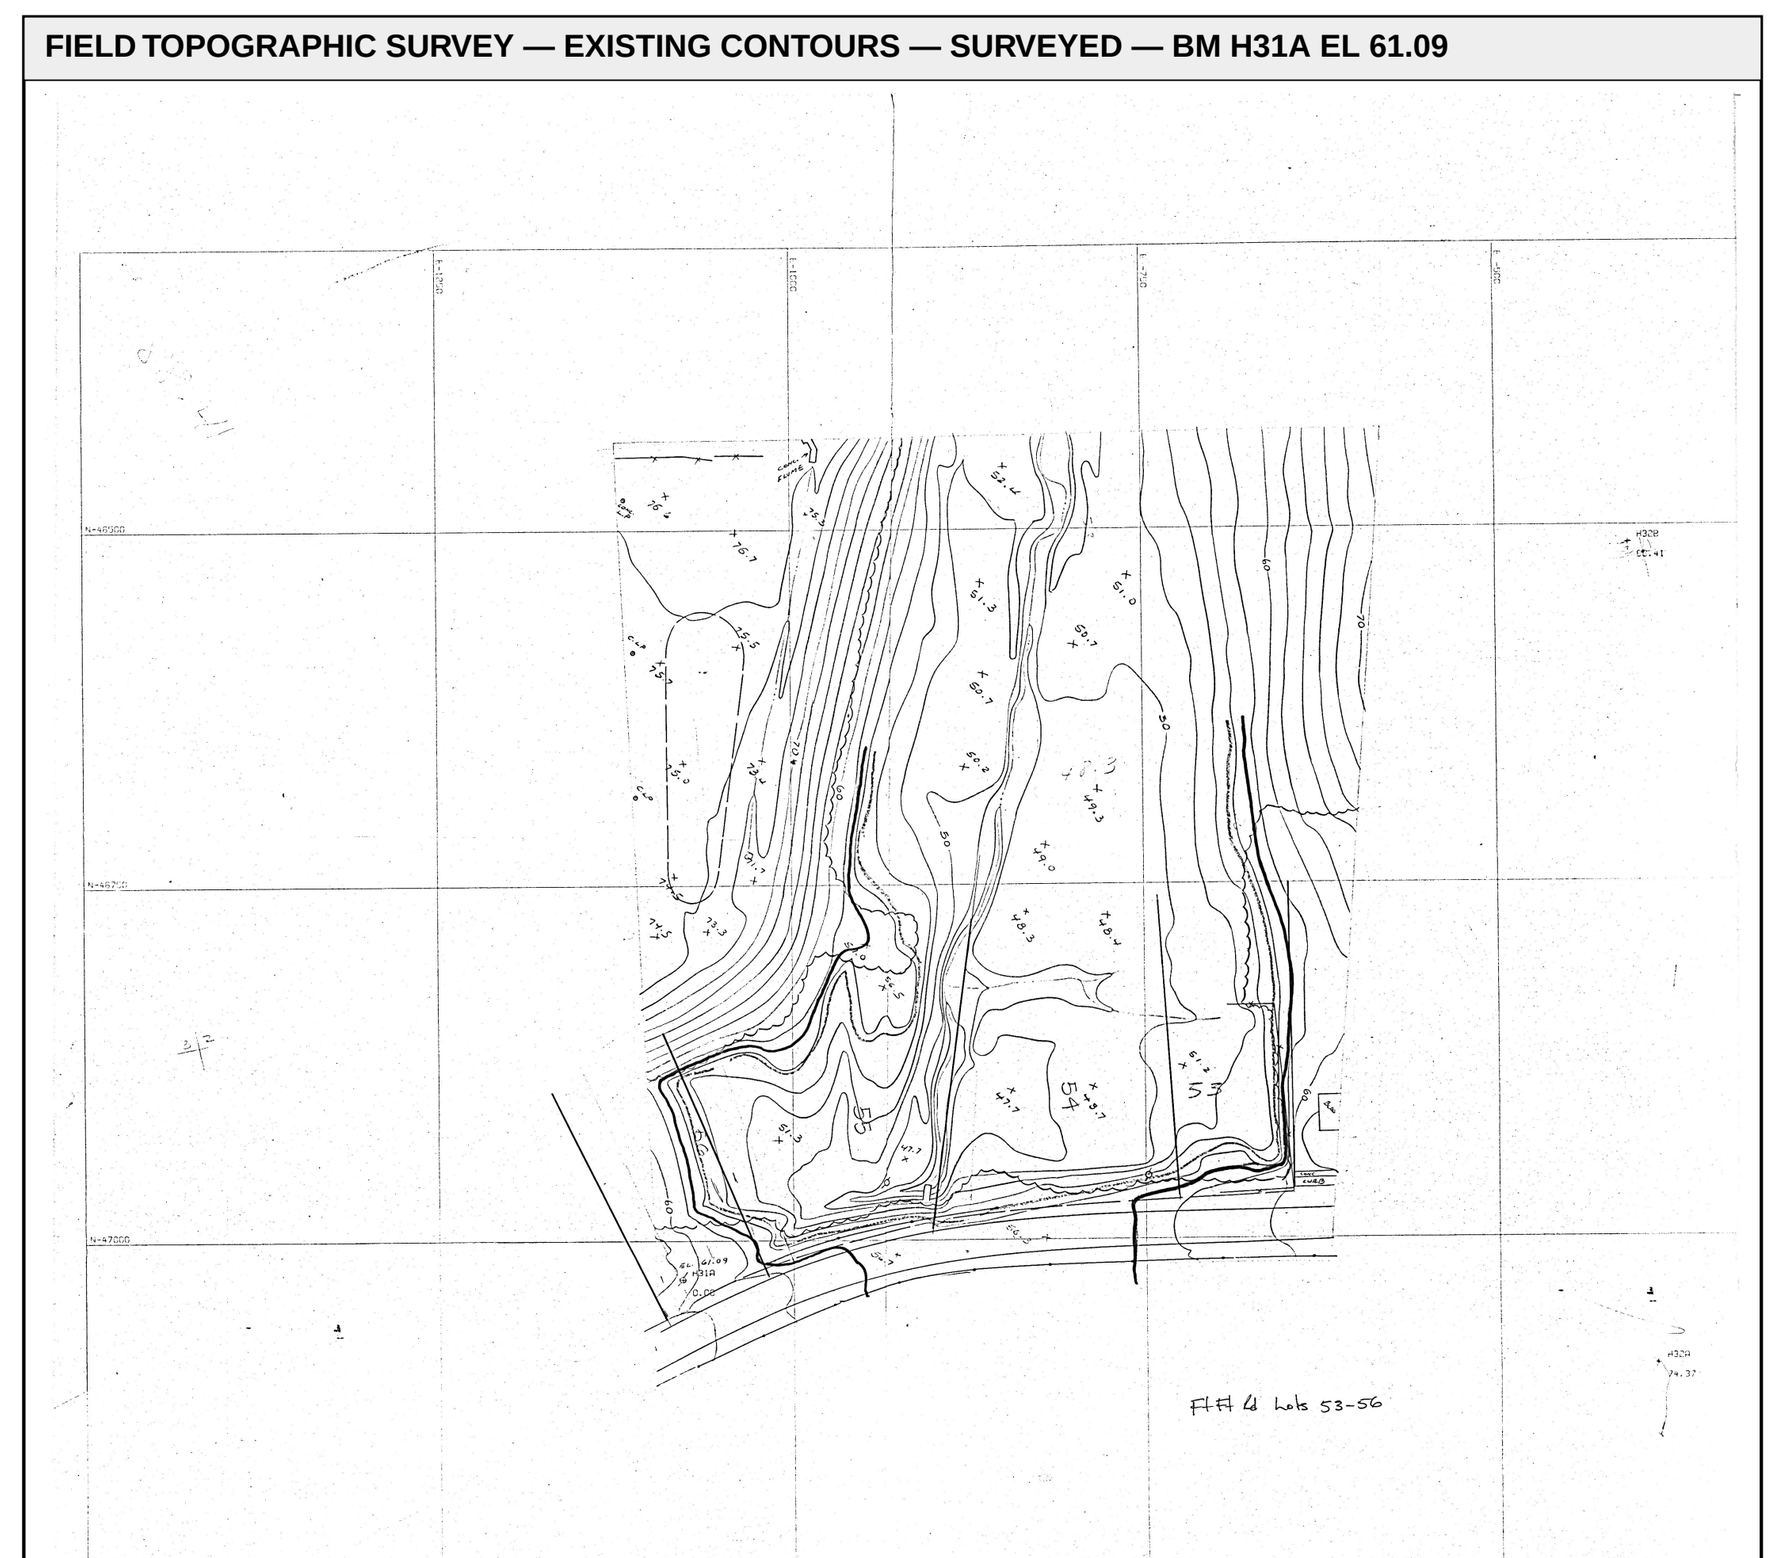

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

KEALEE

design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
C-700 — Sediment and Erosion Control Plan

SCALE
1" = 30'

STATUS
PRELIMINARY

SHEET NO.
8 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION	
PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-700 — Sediment and Erosion Control Plan
DISCIPLINE	Maryland Professional Engineer
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	75,178 SF
2. Area of dwelling	4,784 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	75,184 SF
6. TOTAL AREA DISTURBED	41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	192
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	**75,184**	**10.8%**	**2.96**	**3.84**	**0.88**	**924**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F. PLAT BOOK WWW 65, P. 60 (MSA_S1289_51253). 12TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND. TAX MAP 113, BLOCK F, GRID E4. PLAT DATED 6 JUNE 1967; APPROVED 26 JUNE 1967 BY THE MARYLAND-NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD. M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR: W. L. MEEKINS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20.9811 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE

DATE

LICENSE NO.

EXPIRATION DATE

SEAL

REVISIONS
— none —

2 REQUIRED NOTE(S) — STABILIZATION COMPLIANCE PREAMBLE; STANDARD STABILIZATION NOTE — ARE CARRIED IN FULL ON SHEET C-000.

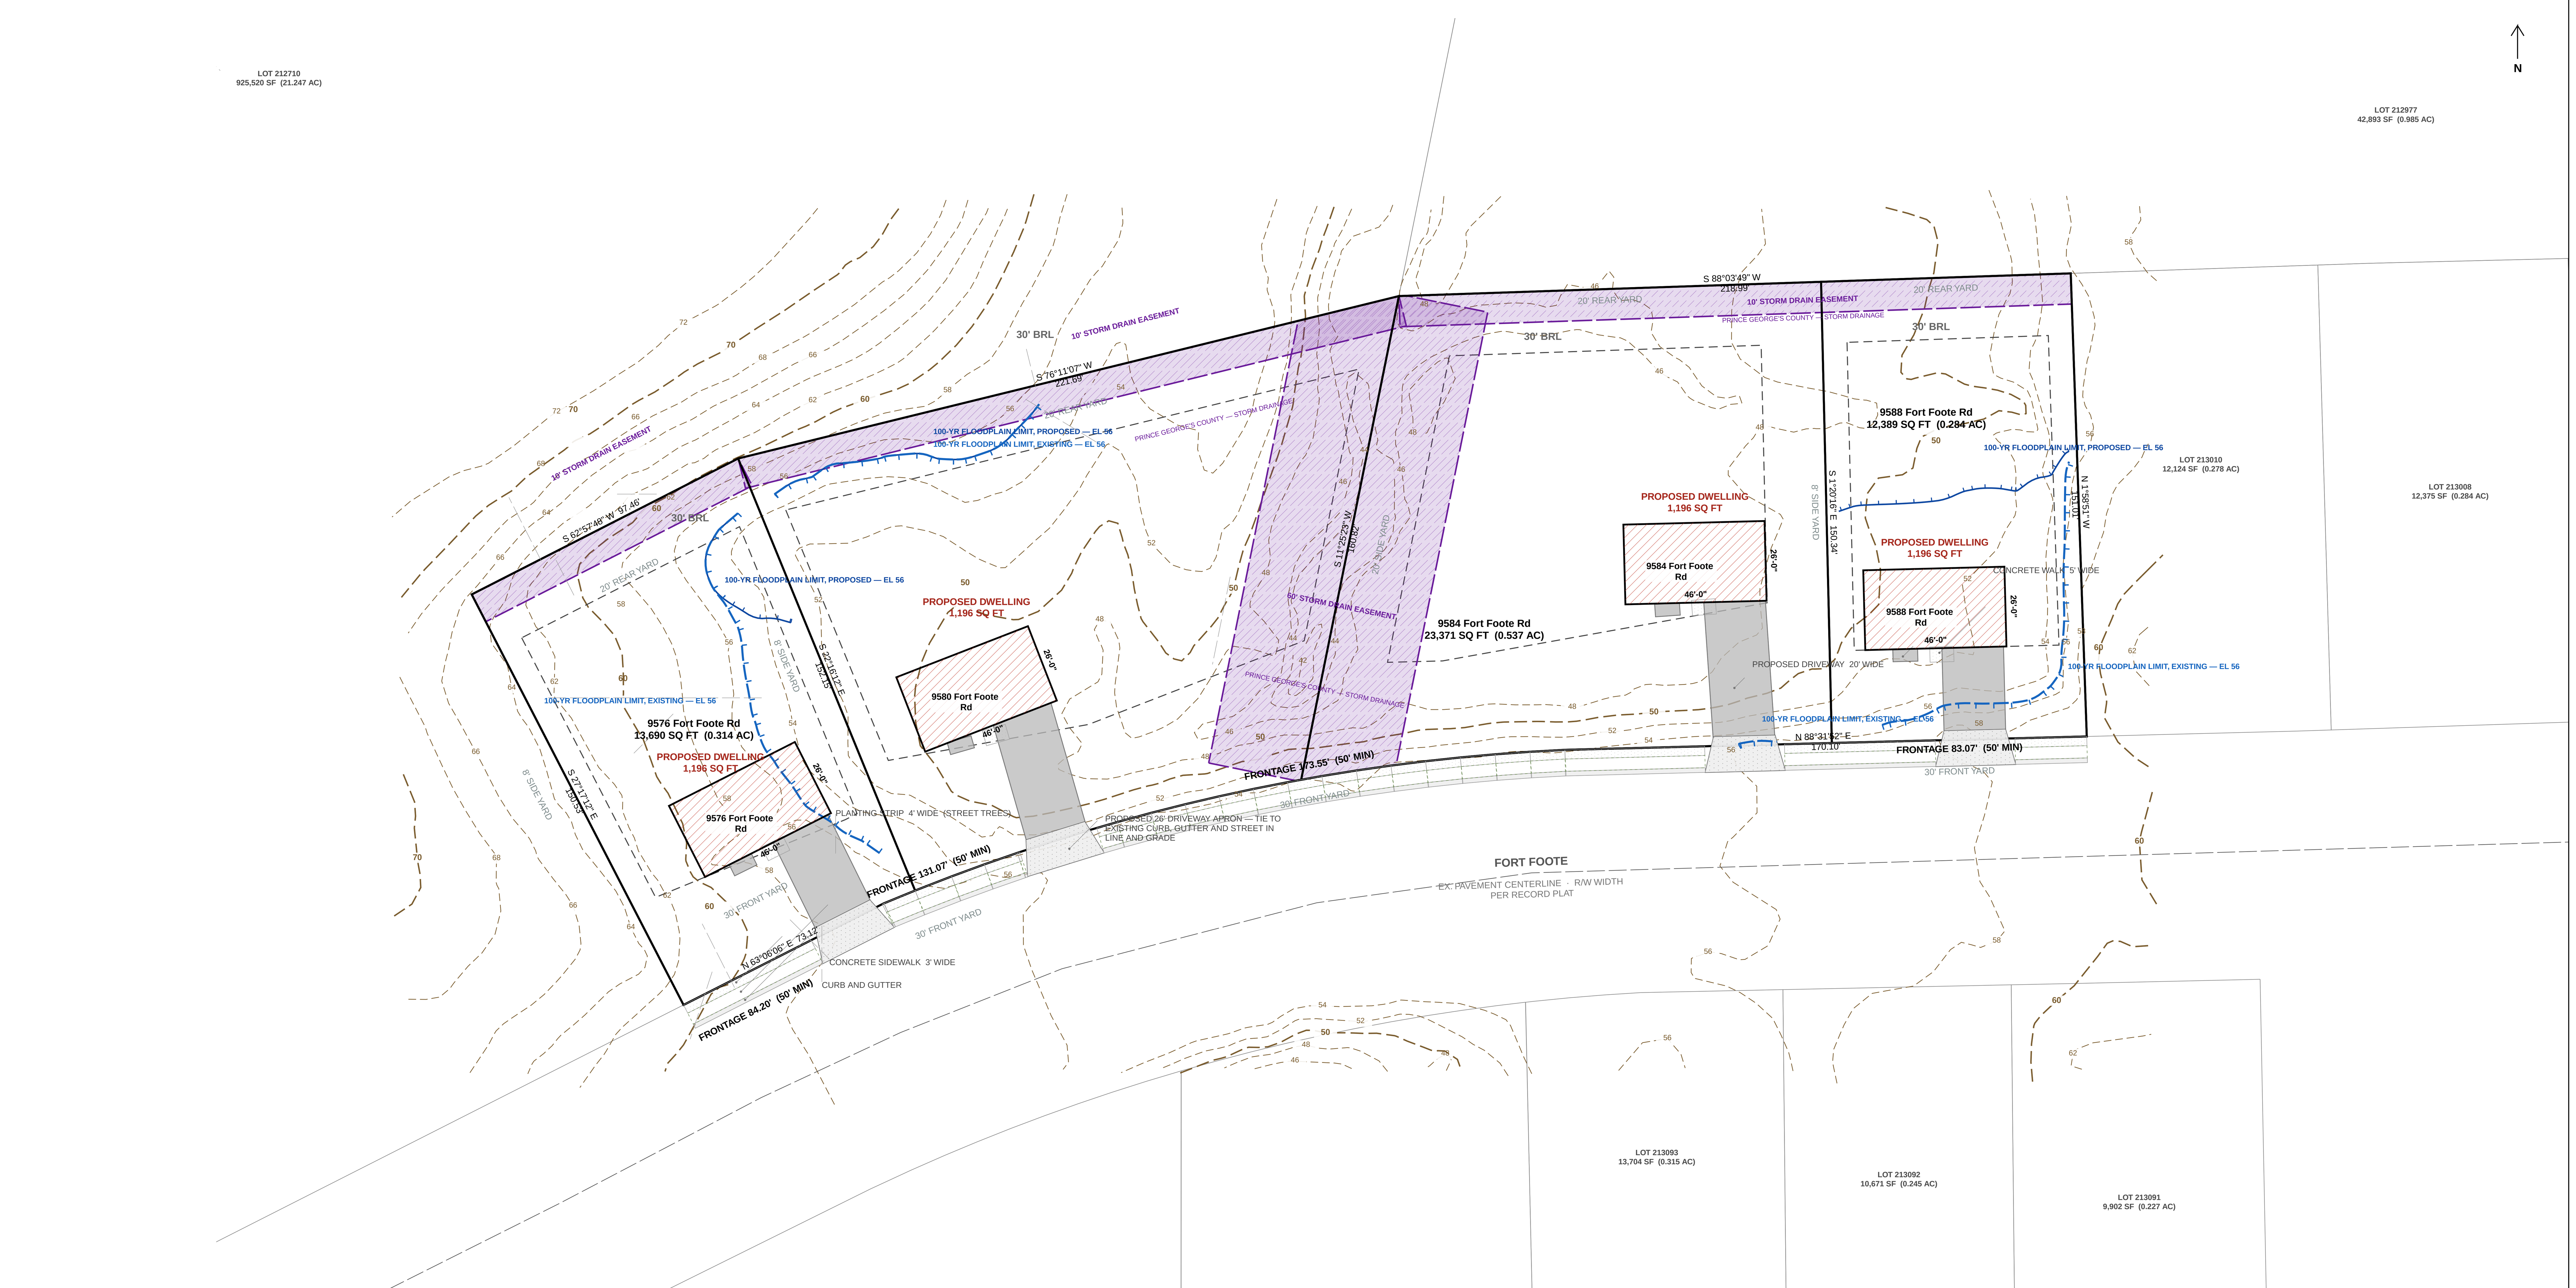

SOILS TABLE
USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

DRAINAGE SWALE SCHEDULE
Rational method, NOAA Atlas 14 · Manning n = 0.041, 2' bottom, 3:1 sides

REACH	LENGTH	GRADE	D.A. (AC)	Q10 (CFS)	Q100 (CFS)	DEPTH	V100 (FPS)	INV IN	INV OUT	CUT
ST-1 — ST-2	110'	3.01%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'
ST-4 — ST-3	157'	4.98%	0.3143	0.65	0.86	0.16'	2.12	60.30	52.50	1.0'
ST-3 — ST-2	177'	3.17%	0.9051	1.87	2.47	0.33'	2.51	52.50	46.90	1.0'

GRADE CONTROL SCHEDULE

POINT	LOT	DESCRIPTION	GROUND	SWALE INV
ST-1	LOT 53	Swale grade break / invert control	51.20	50.20
ST-2	LOT 54	Swale grade break / invert control	47.90	46.90
ST-3	LOT 55	Swale grade break / invert control	53.50	52.50
ST-4	LOT 56	Swale grade break / invert control	61.30	60.30
OUT	—	Swale grade break / invert control	48.90	—

SYSTEM AT THE LOW POINT: 1.7260 AC, Q10 3.57 CFS, Q100 4.71 CFS.
MAX VELOCITY 2.51 FPS AT Q100 — WITHIN THE 5 FPS PERMISSIBLE FOR ESTABLISHED GRASS. 0.5 FT FREEBOARD THROUGHOUT.
THE SWALE DISCHARGES TO THE RECORDED 54/55 STORM DRAIN EASEMENT, ALONGSIDE THE 48" RCP CL IV EXTENDING THE FORT FOOTE ROAD CULVERT INLET.
THAT MAIN IS BURIED: OD 4.67 FT, 1.5 FT MIN COVER OVER THE CROWN — FINISHED GRADE OVER IT SHALL BE NO LOWER THAN INVERT + 6.17 FT. FILL WHERE EXISTING GROUND IS LOWER.
SWALE GRADES AND INVERTS TO BE SET FROM THE FIELD-RUN TOPOGRAPHIC SURVEY. ESTABLISH SOD BEFORE THE CONTRIBUTING AREA IS STABILISED.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

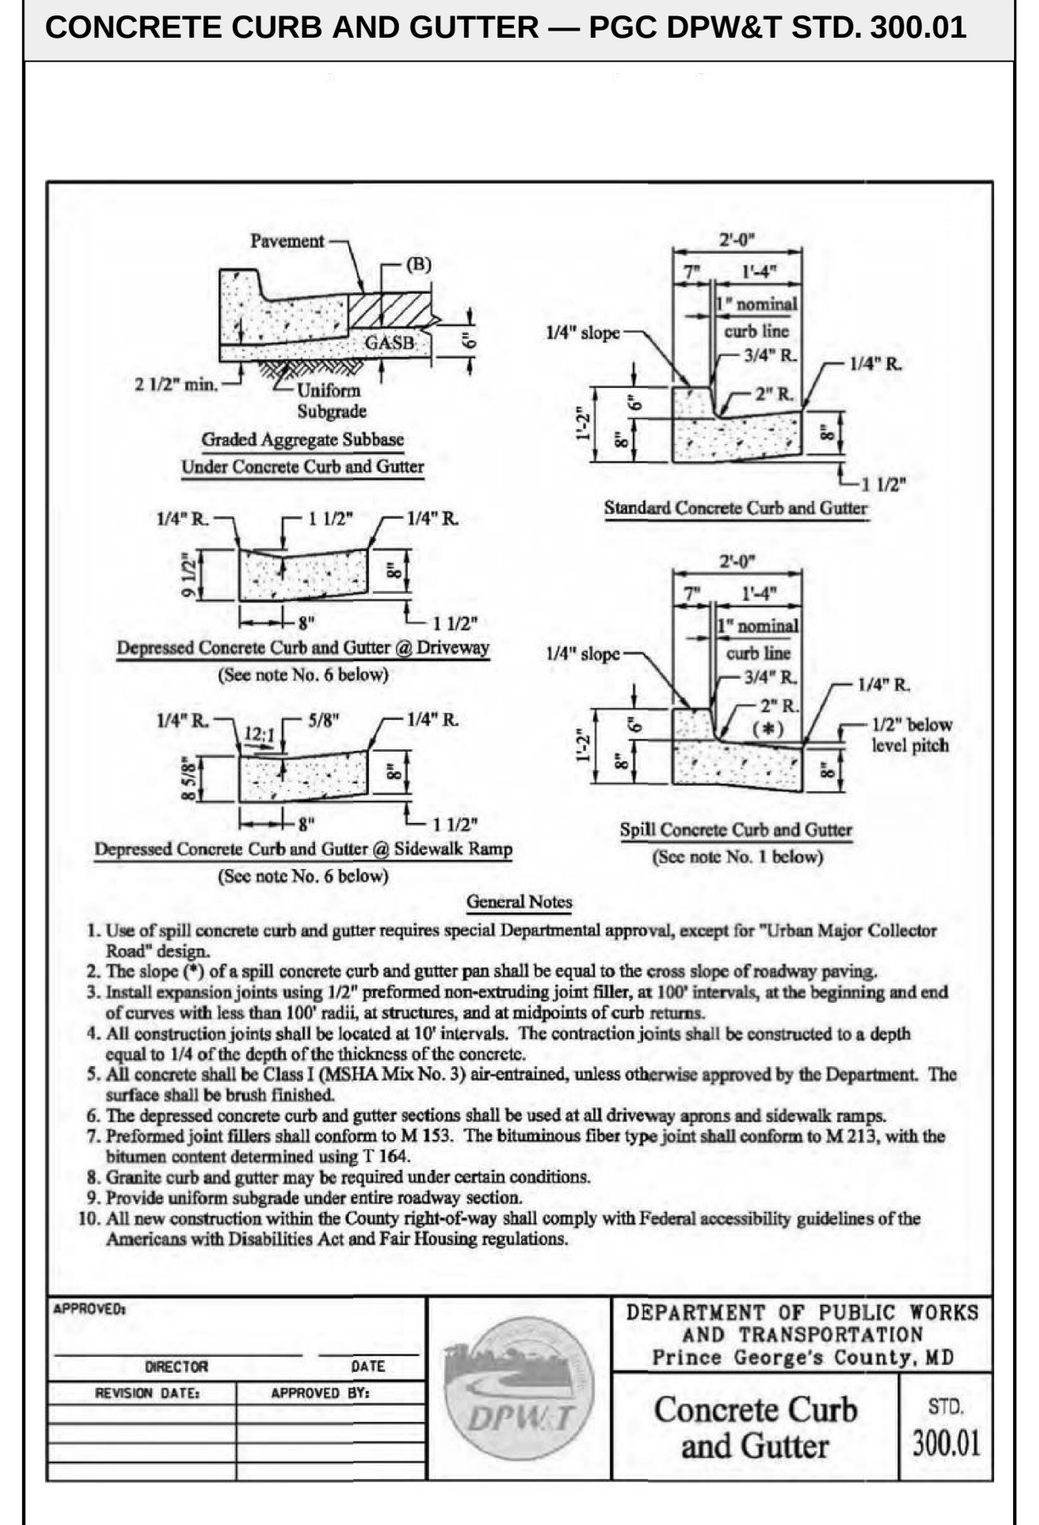

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

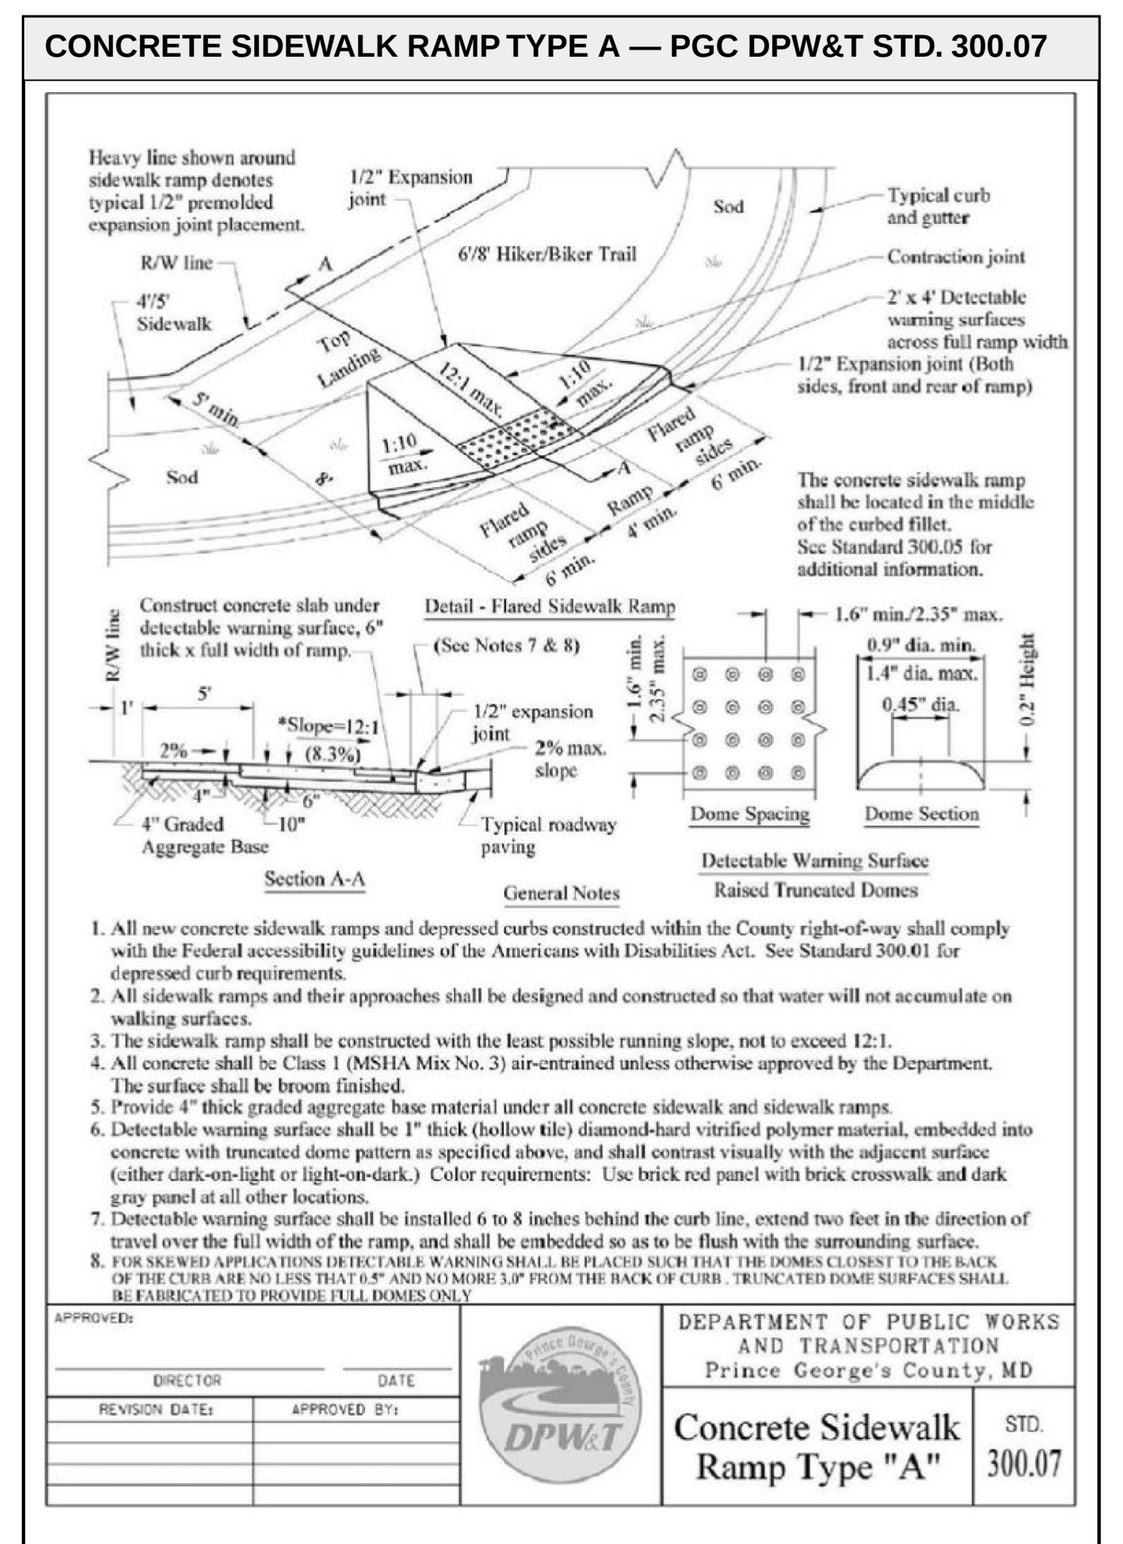

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

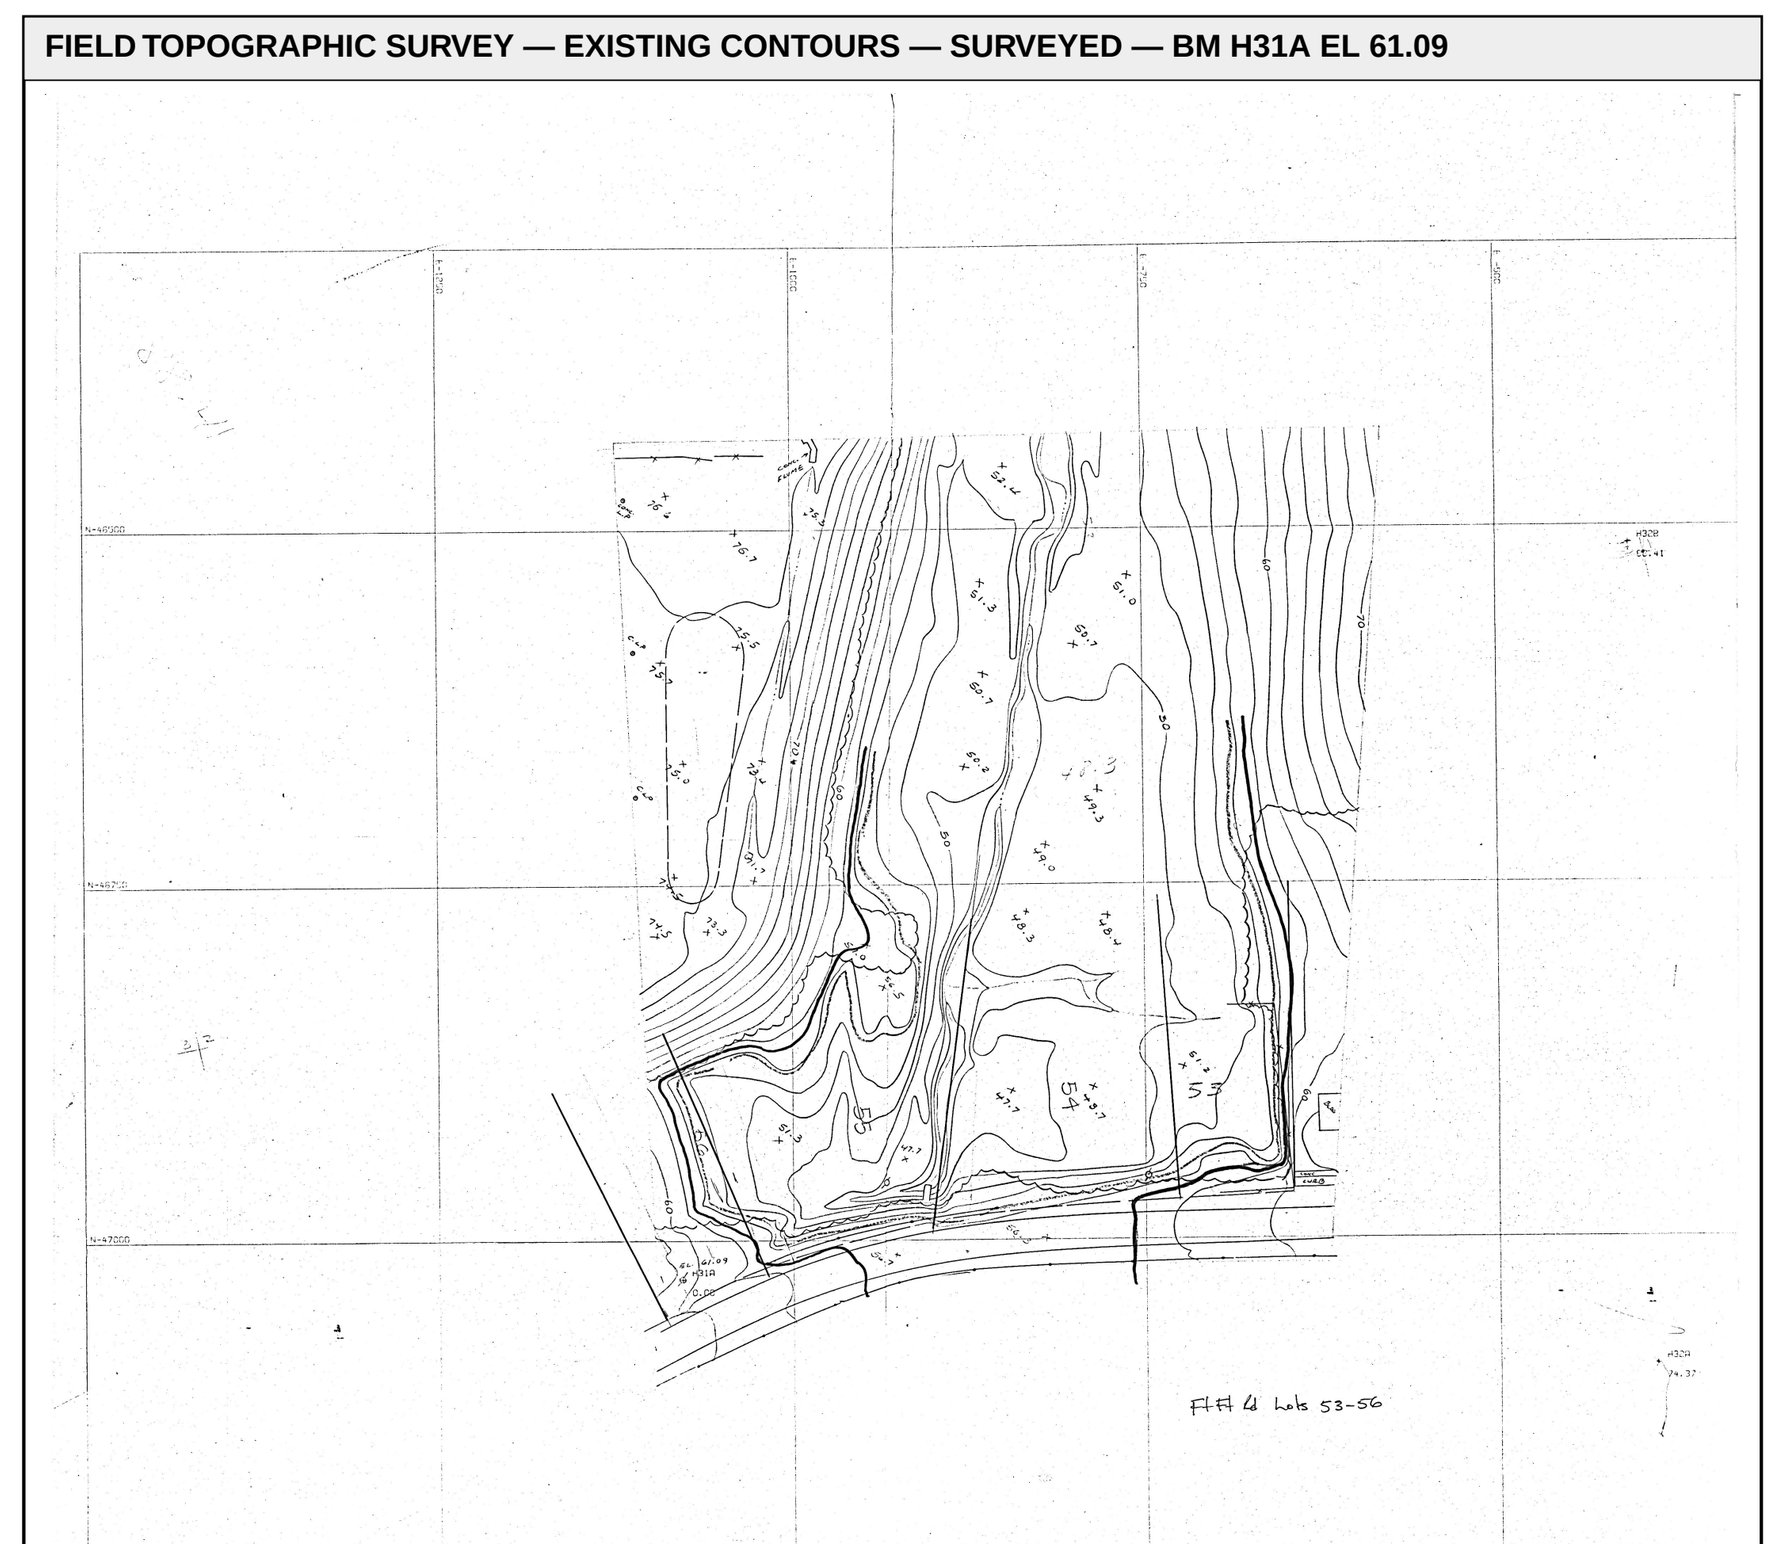

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

KEALEE
design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
C-800 — Road, Driveway and Paving Plan

SCALE
1" = 30'

STATUS
PRELIMINARY

SHEET NO.
9 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION	
PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-800 — Road, Driveway and Paving Plan
DISCIPLINE	Maryland Professional Engineer
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	75,178 SF
2. Area of dwelling	4,784 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	75,184 SF
6. TOTAL AREA DISTURBED	41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	192
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	**75,184**	**10.8%**	**2.96**	**3.84**	**0.88**	**924**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F. PLAT BOOK WWW 65, P. 60 (MSA_S1289_51253). 12TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND. TAX MAP 113, BLOCK F, GRID E4. PLAT DATED 6 JUNE 1967; APPROVED 26 JUNE 1967 BY THE MARYLAND-NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD. M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR: W. L. MEEKINS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20.9811 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE
DATE
LICENSE NO.
EXPIRATION DATE
SEAL

REVISIONS
— none —

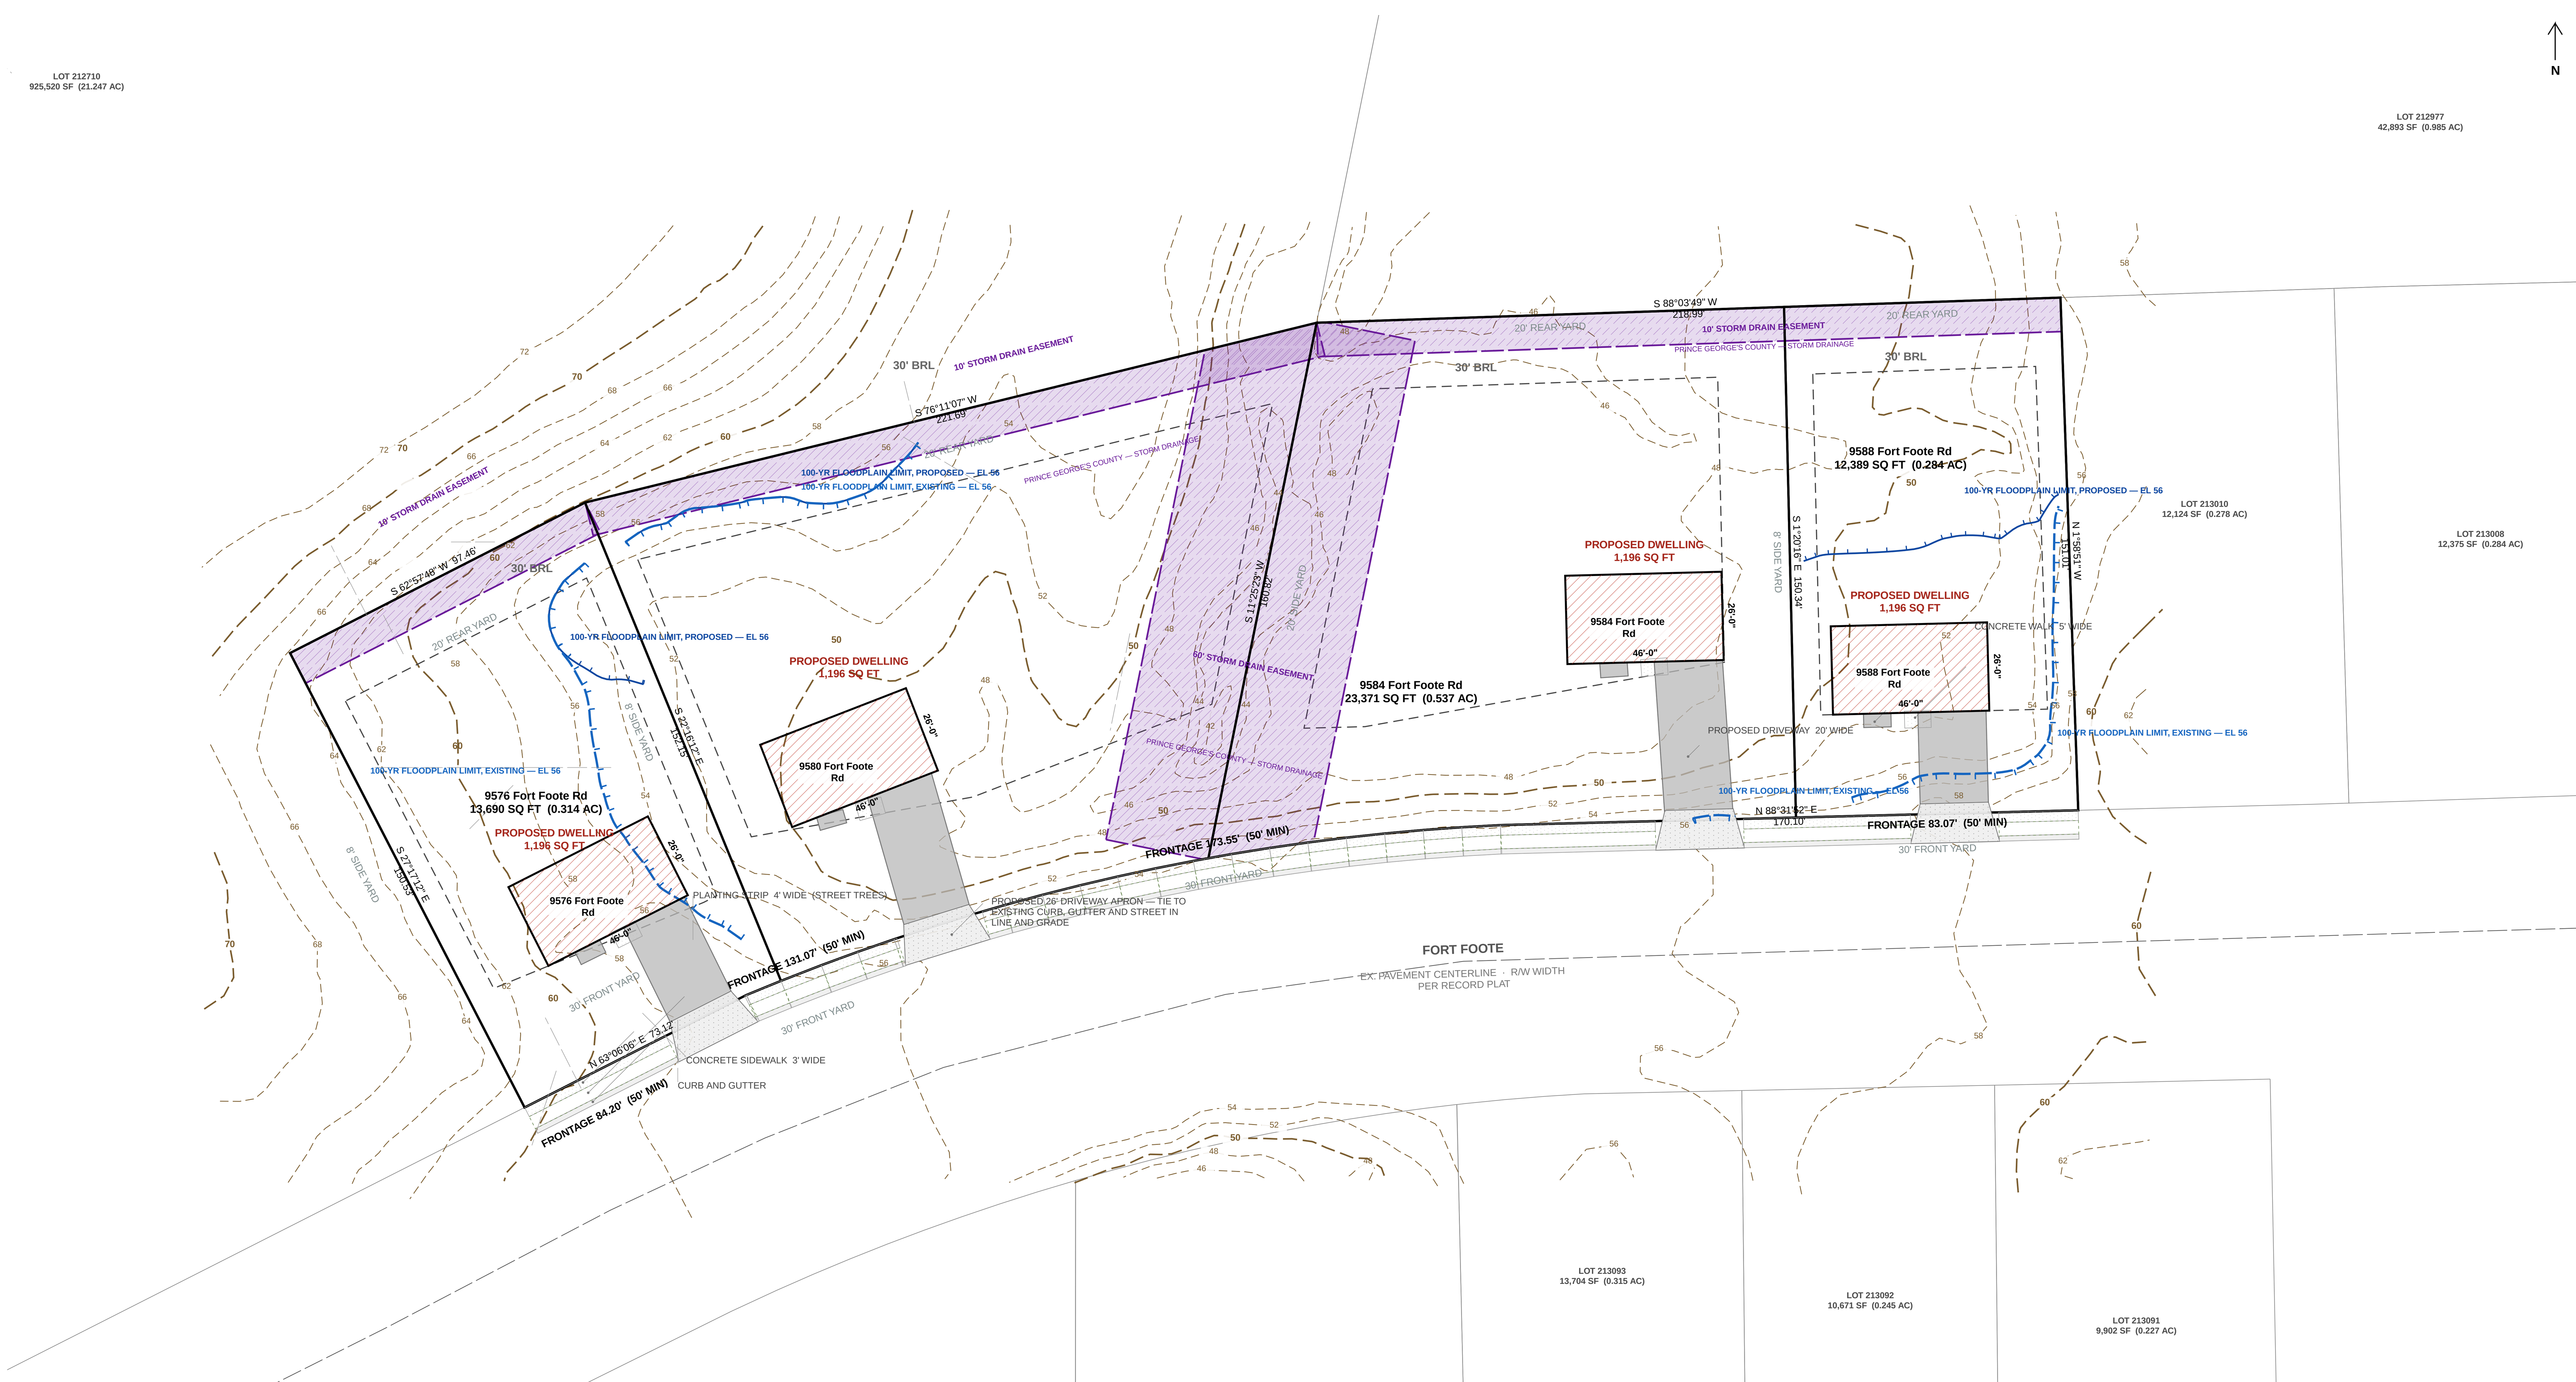

SOILS TABLE

USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

DRAINAGE SWALE SCHEDULE

Rational method, NOAA Atlas 14 · Manning n = 0.041, 2' bottom, 3:1 sides

LOT 213101
29,852 SF (0.685 AC)

LOT 239698
287,905 SF (6.609 AC)

REACH	LENGTH	GRADE	D.A. (AC)	Q10 (CFS)	Q100 (CFS)	DEPTH	V100 (FPS)	INV IN	INV OUT	CUT
ST-1 — ST-2	110'	3.01%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'
ST-4 — ST-3	157'	4.98%	0.3143	0.65	0.86	0.16'	2.12	60.30	52.50	1.0'
ST-3 — ST-2	177'	3.17%	0.9051	1.87	2.47	0.33'	2.51	52.50	46.90	1.0'

GRADE CONTROL SCHEDULE

POINT	LOT	DESCRIPTION	GROUND	SWALE INV
ST-1	LOT 53	Swale grade break / invert control	51.20	50.20
ST-2	LOT 54	Swale grade break / invert control	47.90	46.90
ST-3	LOT 55	Swale grade break / invert control	53.50	52.50
ST-4	LOT 56	Swale grade break / invert control	61.30	60.30
OUT	—	Swale grade break / invert control	48.90	—

SYSTEM AT THE LOW POINT: 1.7260 AC, Q10 3.57 CFS, Q100 4.71 CFS.
MAX VELOCITY 2.51 FPS AT Q100 — WITHIN THE 5 FPS PERMISSIBLE FOR ESTABLISHED GRASS. 0.5 FT FREEBOARD THROUGHOUT.
THE SWALE DISCHARGES TO THE RECORDED 54/55 STORM DRAIN EASEMENT, ALONGSIDE THE 48" RCP CL IV EXTENDING THE FORT FOOTE ROAD CULVERT INLET.
THAT MAIN IS BURIED: OD 4.67 FT, 1.5 FT MIN COVER OVER THE CROWN — FINISHED GRADE OVER IT SHALL BE NO LOWER THAN INVERT + 6.17 FT. FILL WHERE EXISTING GROUND IS LOWER.
SWALE GRADES AND INVERTS TO BE SET FROM THE FIELD-RUN TOPOGRAPHIC SURVEY. ESTABLISH SOD BEFORE THE CONTRIBUTING AREA IS STABILISED.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

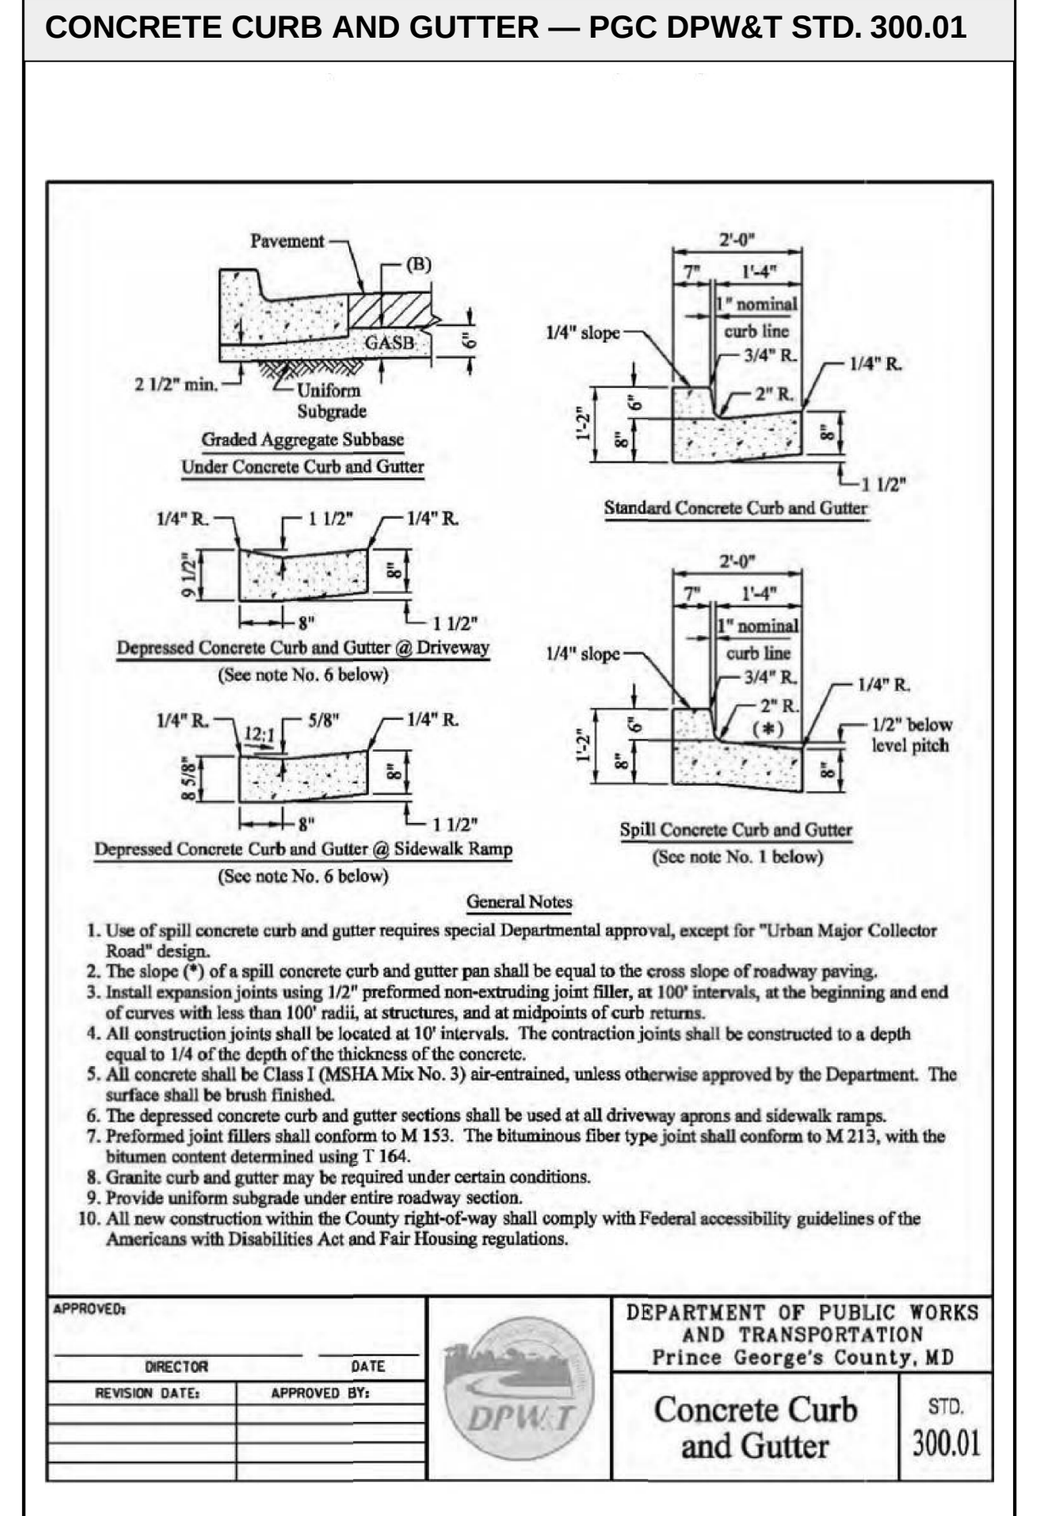

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

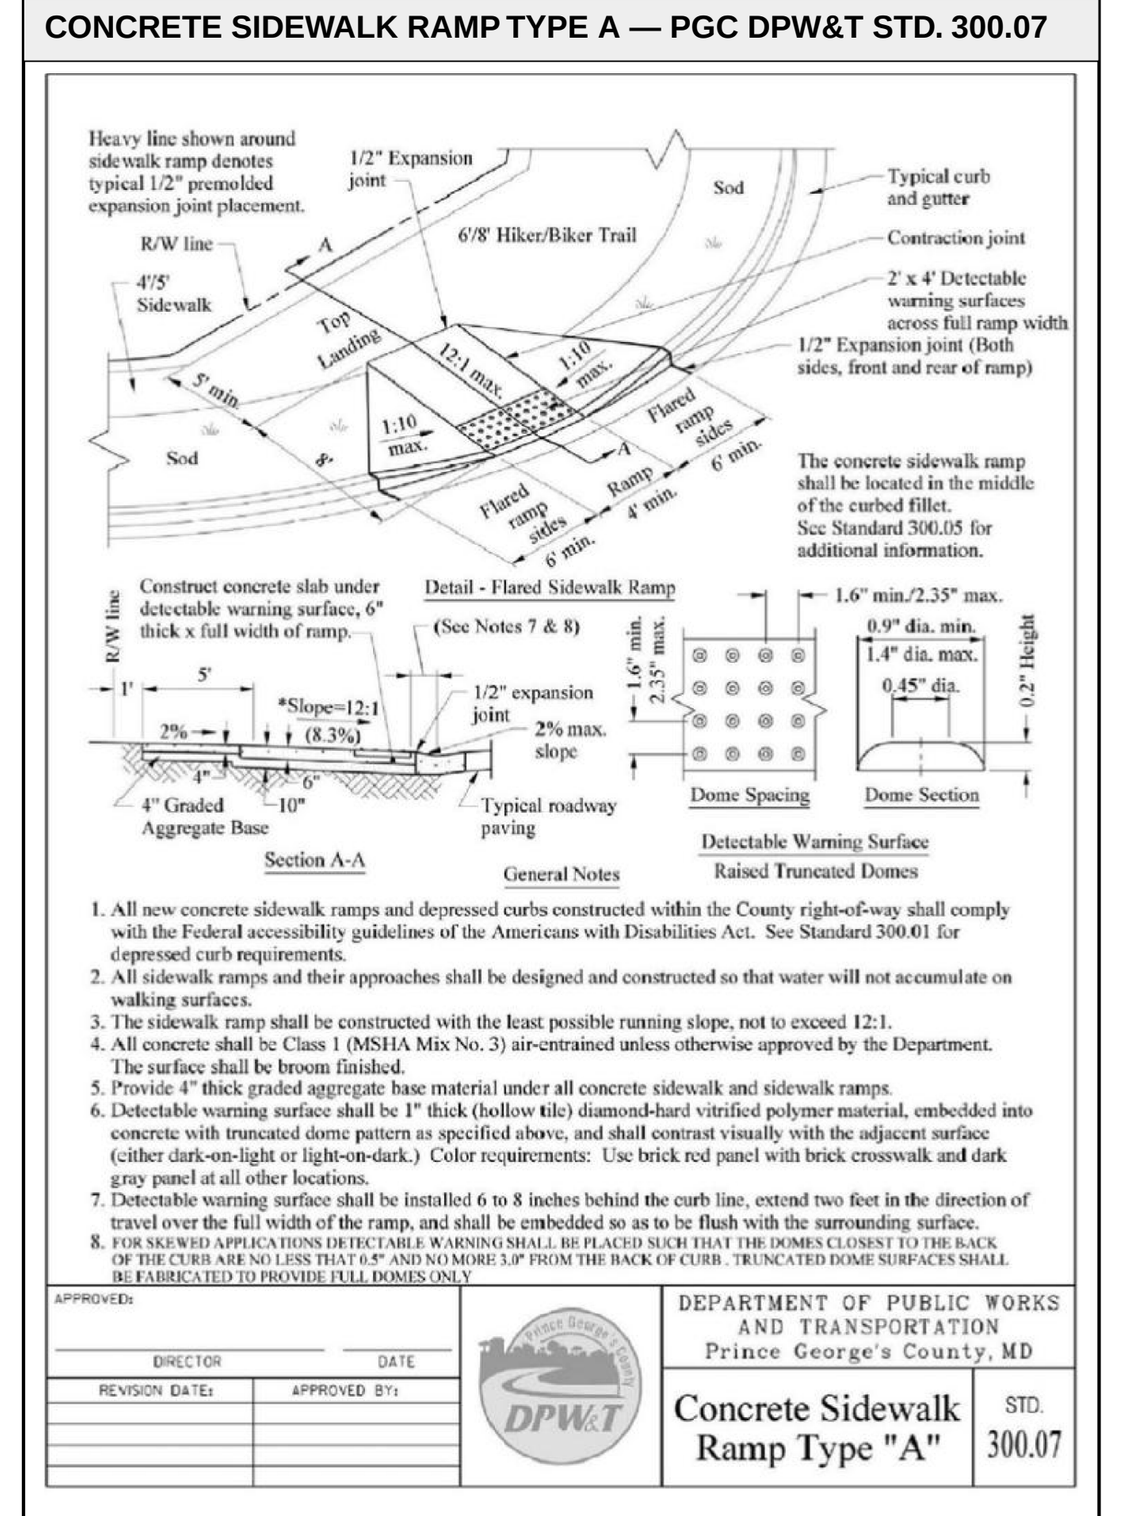

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

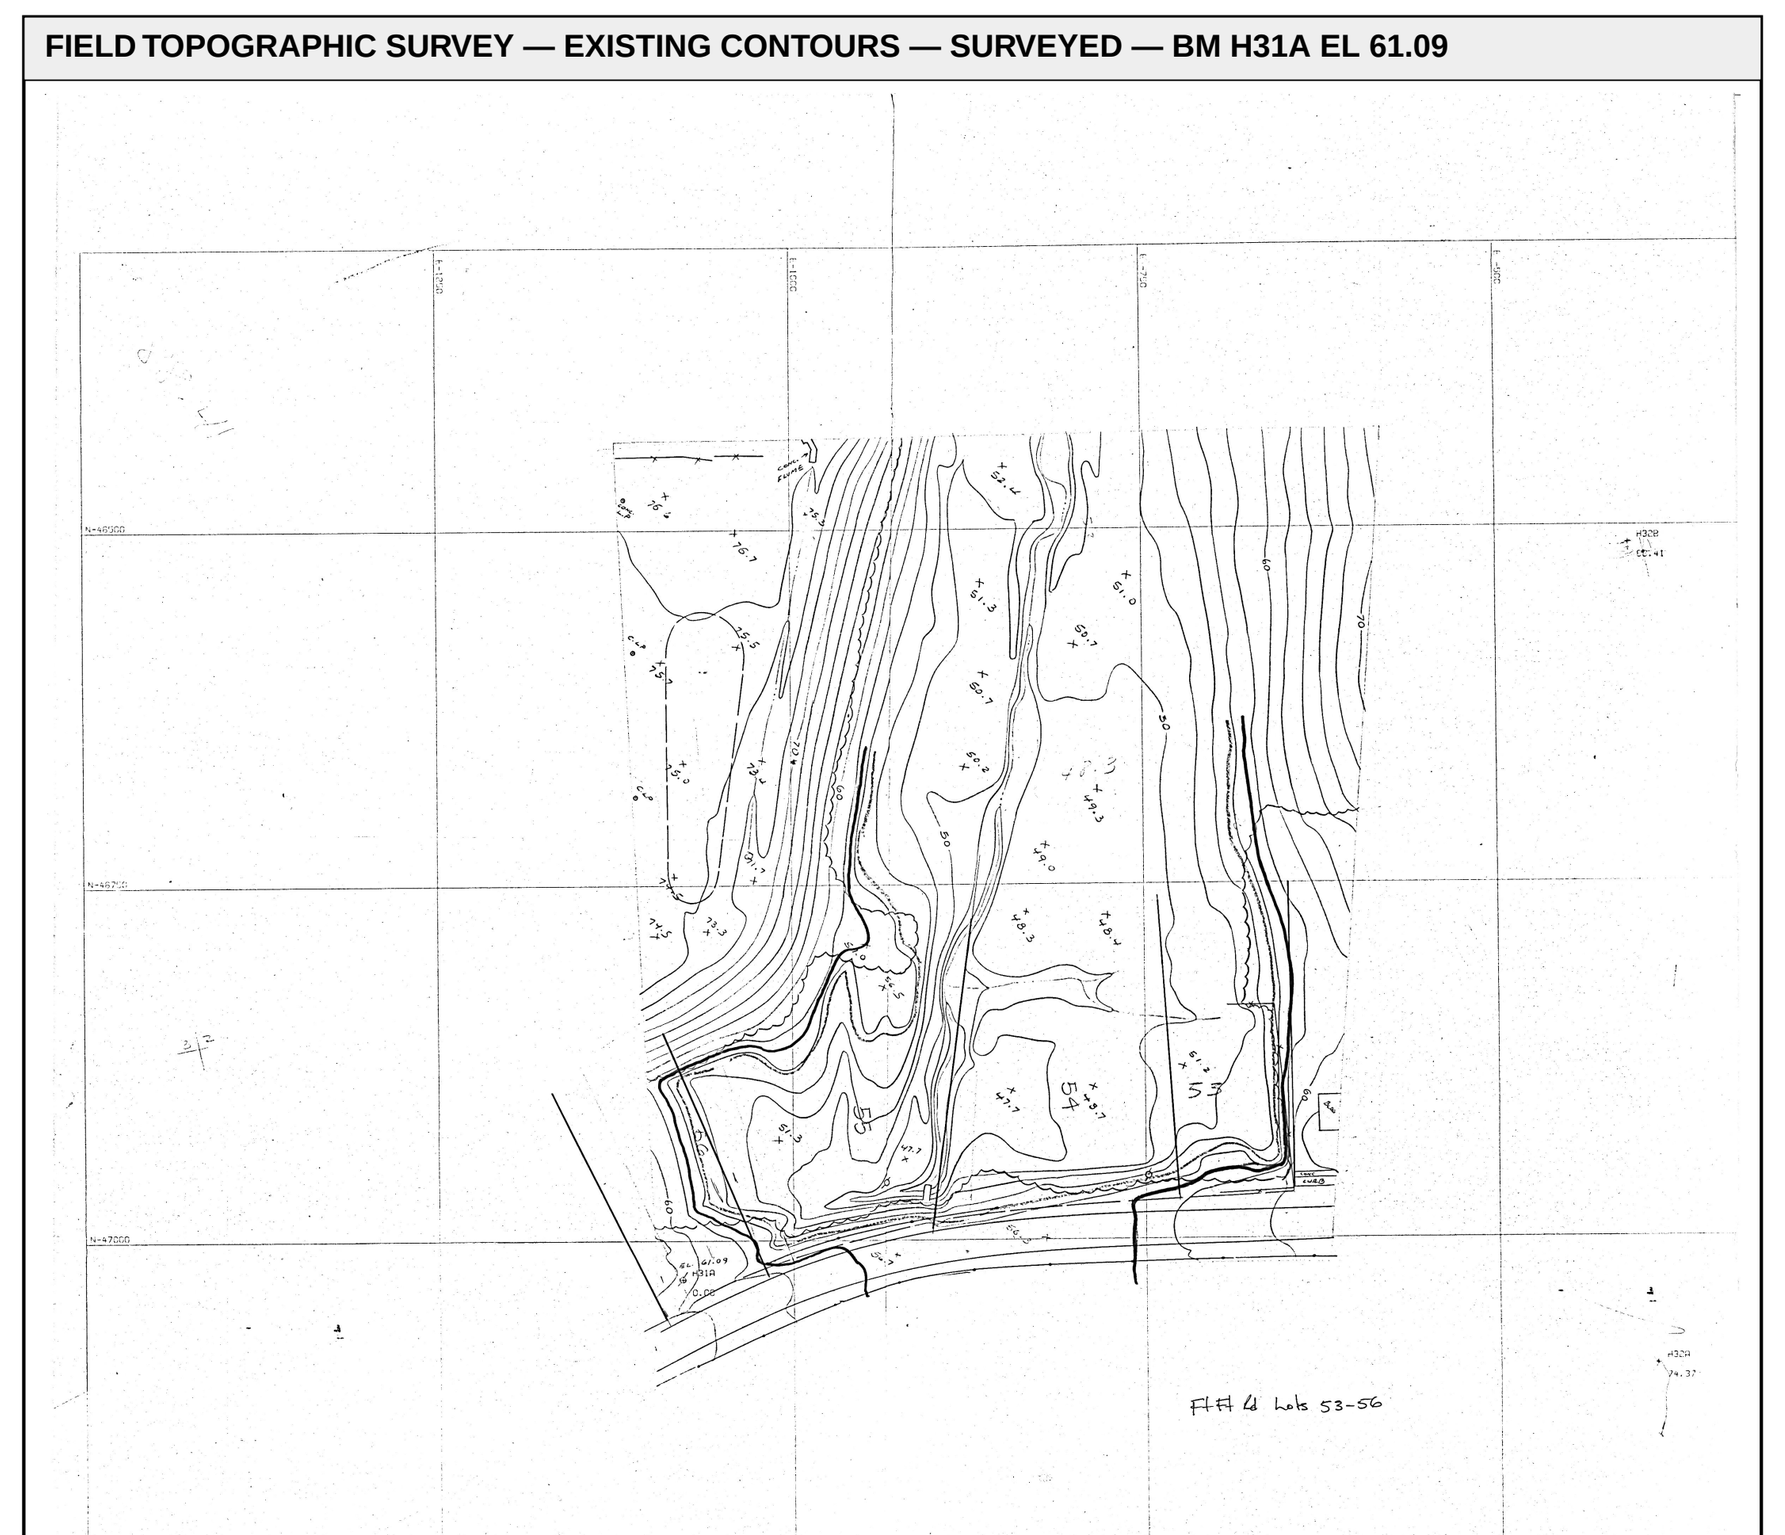

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

KEALEE

design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
C-900 — Civil Details

SCALE
1" = 30'

STATUS
PRELIMINARY

SHEET NO.
10 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION	
PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-900 — Civil Details
DISCIPLINE	Maryland Professional Engineer
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	75,178 SF
2. Area of dwelling	4,784 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	75,184 SF
6. TOTAL AREA DISTURBED	41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	192
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	**75,184**	**10.8%**	**2.96**	**3.84**	**0.88**	**924**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F. PLAT BOOK WWW 65, P. 60 (MSA_S1289_51253). 12TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND. TAX MAP 113, BLOCK F, GRID E4. PLAT DATED 6 JUNE 1967; APPROVED 26 JUNE 1967 BY THE MARYLAND-NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD. M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR: W. L. MEEKINS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20.9811 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

	SIGNATURE	DATE
SEAL	LICENSE NO.	EXPIRATION DATE

REVISIONS
— none —

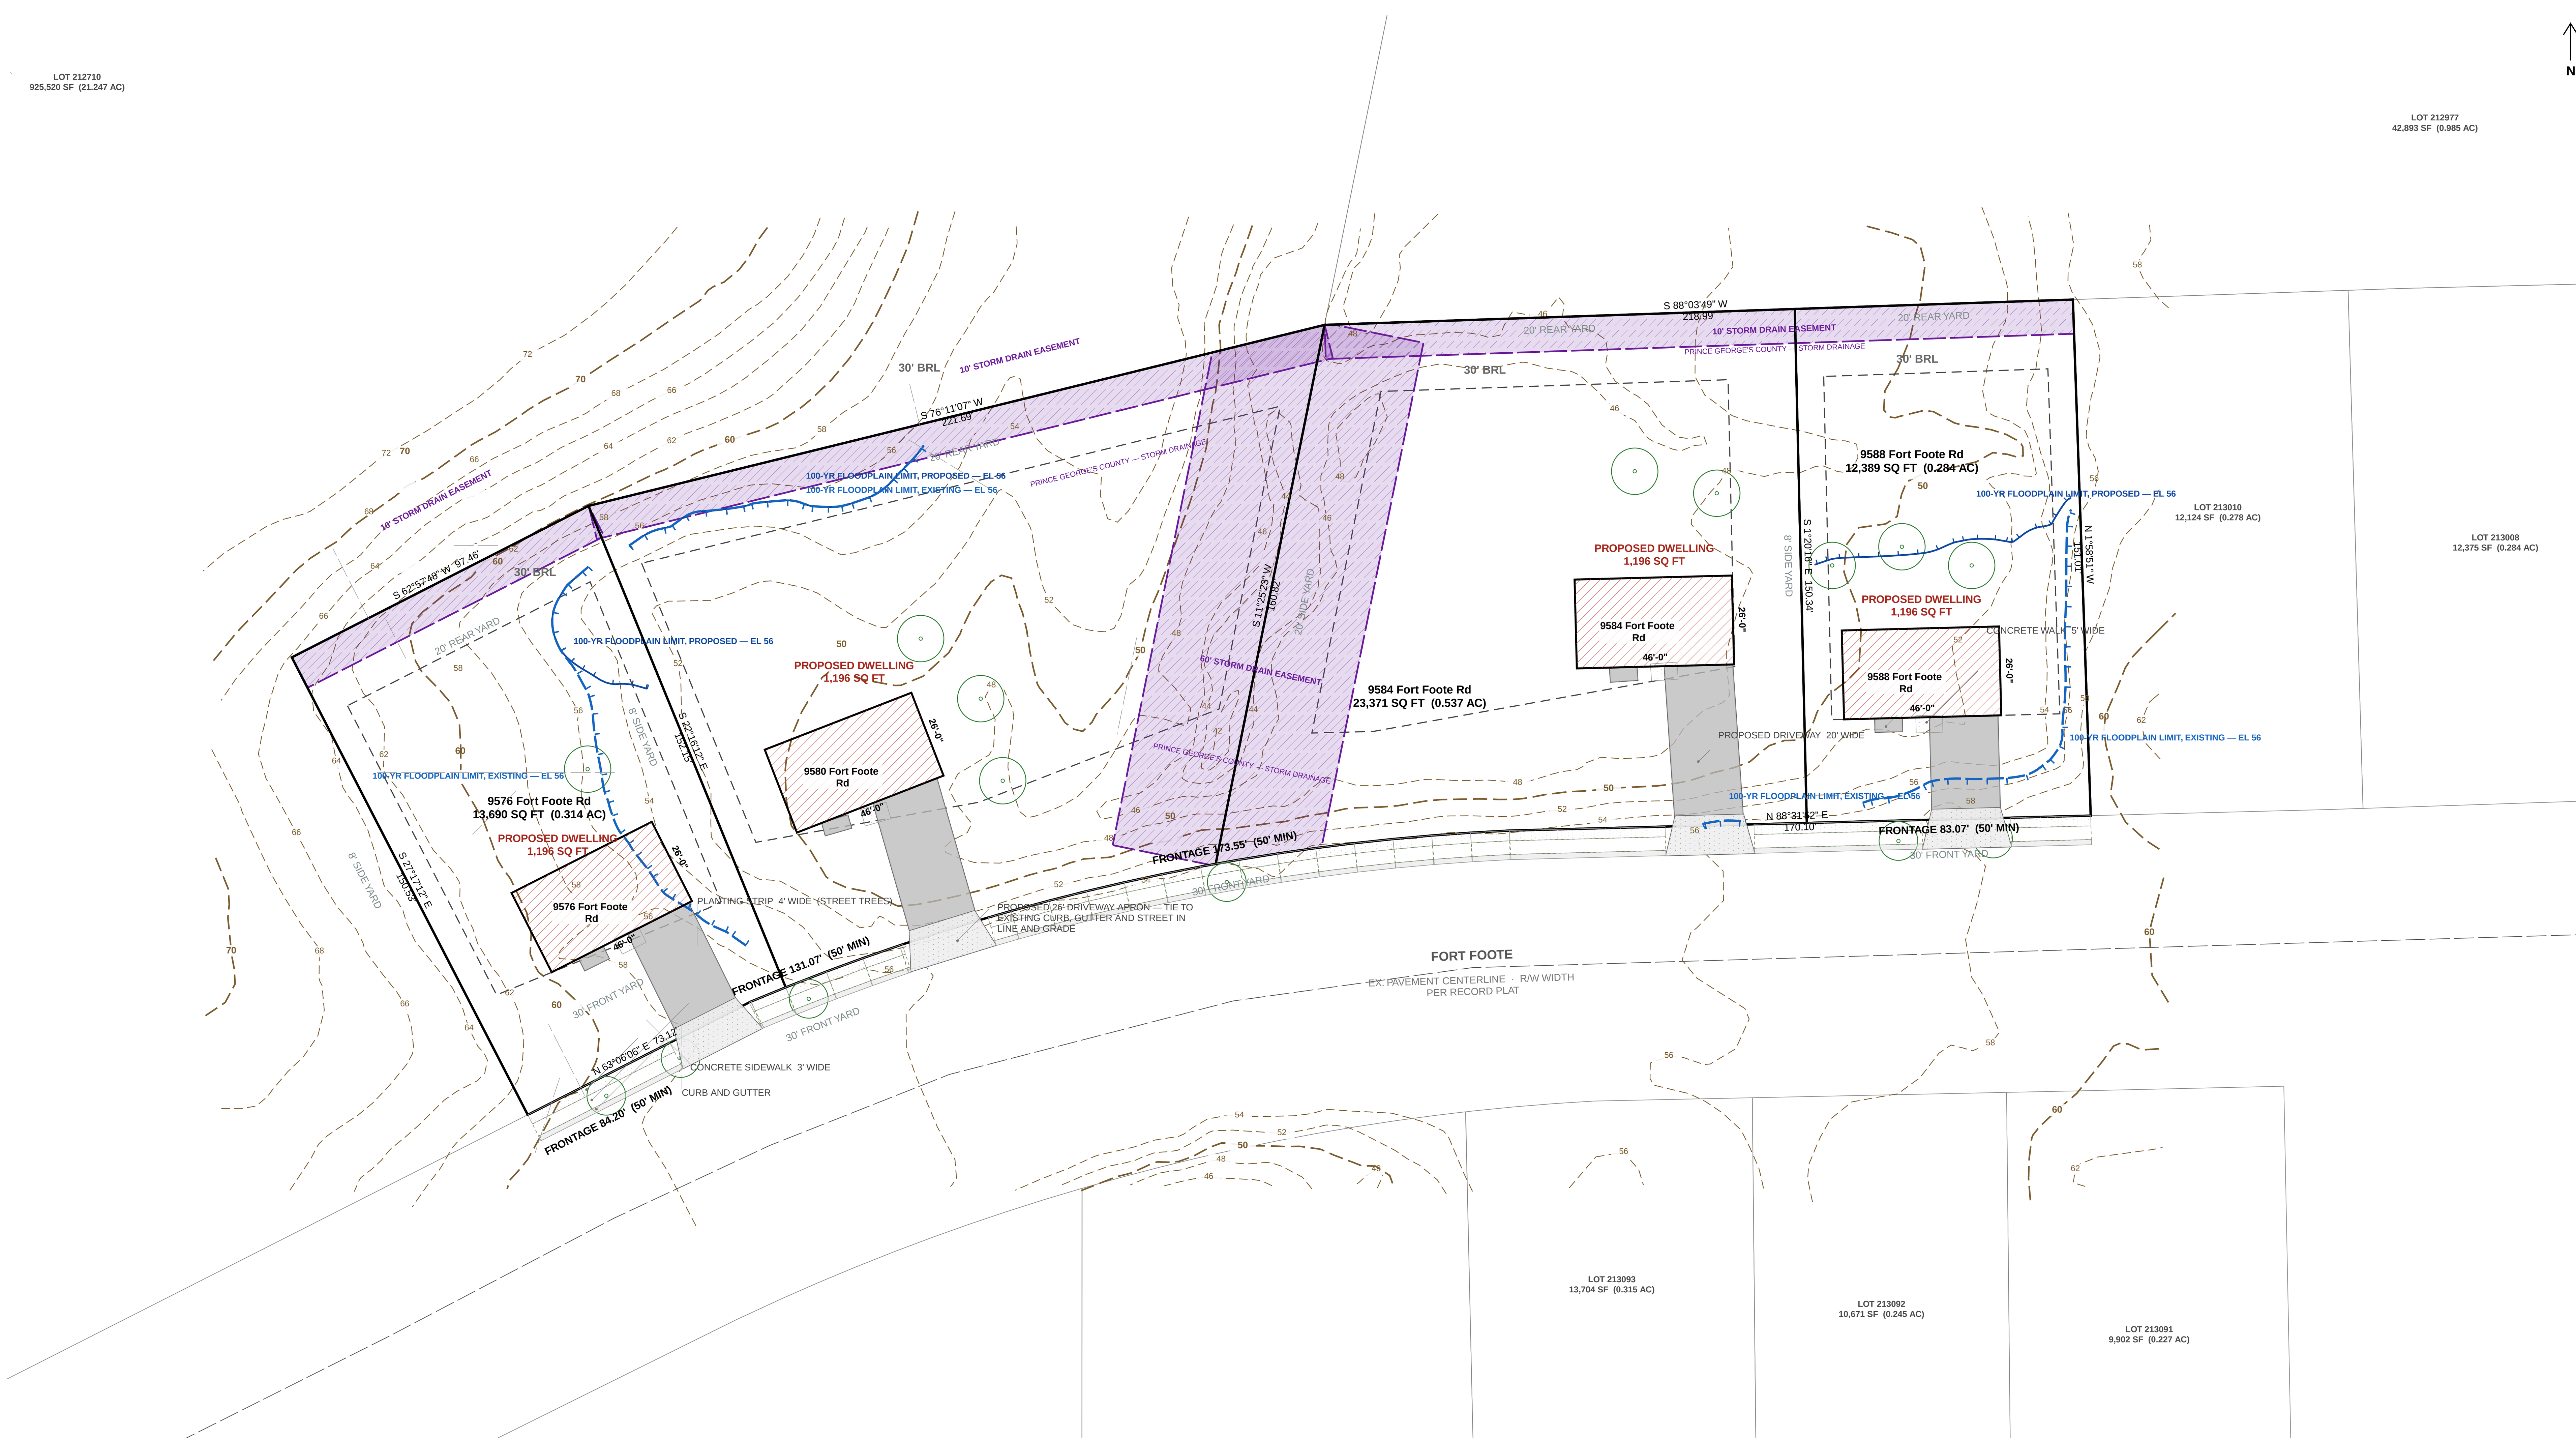

KEALEE

design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
L-100 — Landscape and Tree Canopy Plan

SCALE
1" = 30'

STATUS
PRELIMINARY

SHEET NO.
11 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION	
PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	L-100 — Landscape and Tree Canopy Plan
DISCIPLINE	Landscape Architect / Qualified Professional
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area — 75,178 SF
2. Area of dwelling — 4,784 SF
3. Wooded area — NOT ESTABLISHED
4. Floodplain area — NOT ESTABLISHED
5. Net lot area — 75,184 SF
6. TOTAL AREA DISTURBED — 41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3) — YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	192
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	**75,184**	**10.8%**	**2.96**	**3.84**	**0.88**	**924**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F. PLAT BOOK WWW 65, P. 60 (MSA_S1289_51253). 12TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND. TAX MAP 113, BLOCK F, GRID E4. PLAT DATED 6 JUNE 1967; APPROVED 26 JUNE 1967 BY THE MARYLAND-NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD. M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR: W. L. MEEKINS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20.9811 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE _______________ DATE _______________

LICENSE NO. _______________ EXPIRATION DATE _______________

SEAL

REVISIONS
— none —

TREE CANOPY SCHEDULE

Sec. 25-128 Table 1 as amended by CB-021-2024 — 20% of NET tract area on RSF-95, met within it. Per-lot planting per Landscape Manual Sec. 4.1(c)(1). Street trees in the right-of-way count toward canopy under Sec. 25-129.

LOT	NET AREA SF	CANOPY REQ 20% SF	SHADE PROV / REQ	ORN-EVGN PROV / REQ	STREET TREES	10-YR CANOPY PROVIDED
LOT 53	12,389	2,478	3 / 3	0 / 2 SHORT	2	NOT ESTABLISHED
LOT 54	23,371	4,674	2 / 4 SHORT	0 / 3 SHORT	1	NOT ESTABLISHED
LOT 55	25,733	5,147	3 / 4 SHORT	0 / 3 SHORT	1	NOT ESTABLISHED
LOT 56	13,690	2,738	1 / 3 SHORT	0 / 2 SHORT	2	NOT ESTABLISHED
TOTAL	75,184	15,037	9 / 14	0 / 10	6	—

TEN-YEAR CANOPY IS CREDITED PER SPECIES FROM THE PRINCE GEORGE'S COUNTY LANDSCAPE MANUAL. NO SPECIES HAS BEEN SELECTED ON THIS SET, SO THE CANOPY PROVIDED IS NOT ESTABLISHED AND THE SCHEDULE IS NOT YET BALANCED. EXISTING TREES PRESERVED ALSO COUNT.
NO TREE IS PLANTED WITHIN A STORM DRAIN EASEMENT. THE 60 FT 54/55 EASEMENT CARRIES THE 48 IN RCP MAIN AND THE 10 FT REAR EASEMENT CARRIES THE DRAINAGE SWALE; BOTH ARE SHOWN ON THIS SHEET AND BOTH ARE EXCLUDED FROM PLANTABLE AREA.
A WAIVER OF THE CANOPY REQUIREMENT IS AVAILABLE UNDER SEC. 25-130.
PER-LOT PLANTING IS SHORT ON EVERY LOT AS DRAWN. LANDSCAPE MANUAL SEC. 4.1(c)(1) REQUIRES 4 MAJOR SHADE AND 3 ORNAMENTAL OR EVERGREEN TREES ON A LOT OF 20,000 SF OR MORE, AND 3 AND 2 ON A LOT OF 9,500 TO 19,999 SF. NO ORNAMENTAL OR EVERGREEN TREES ARE DRAWN. AT LEAST ONE SHADE TREE MUST STAND ON THE SOUTH OR WEST SIDE WITHIN 30 FT OF THE DWELLING, AND AT LEAST ONE REQUIRED TREE IN THE FRONT YARD. SPECIES AND FINAL LOCATIONS BY THE LANDSCAPE ARCHITECT.
THE CANOPY REQUIREMENT MUST BE MET ON-SITE UNLESS A VARIANCE IS APPROVED, AND WHERE A GRADING PERMIT IS THE ONLY APPLICATION THE CANOPY NOTES BELONG ON THE GRADING PLAN — ENVIRONMENTAL TECHNICAL MANUAL PART D, SEC. 3.0.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

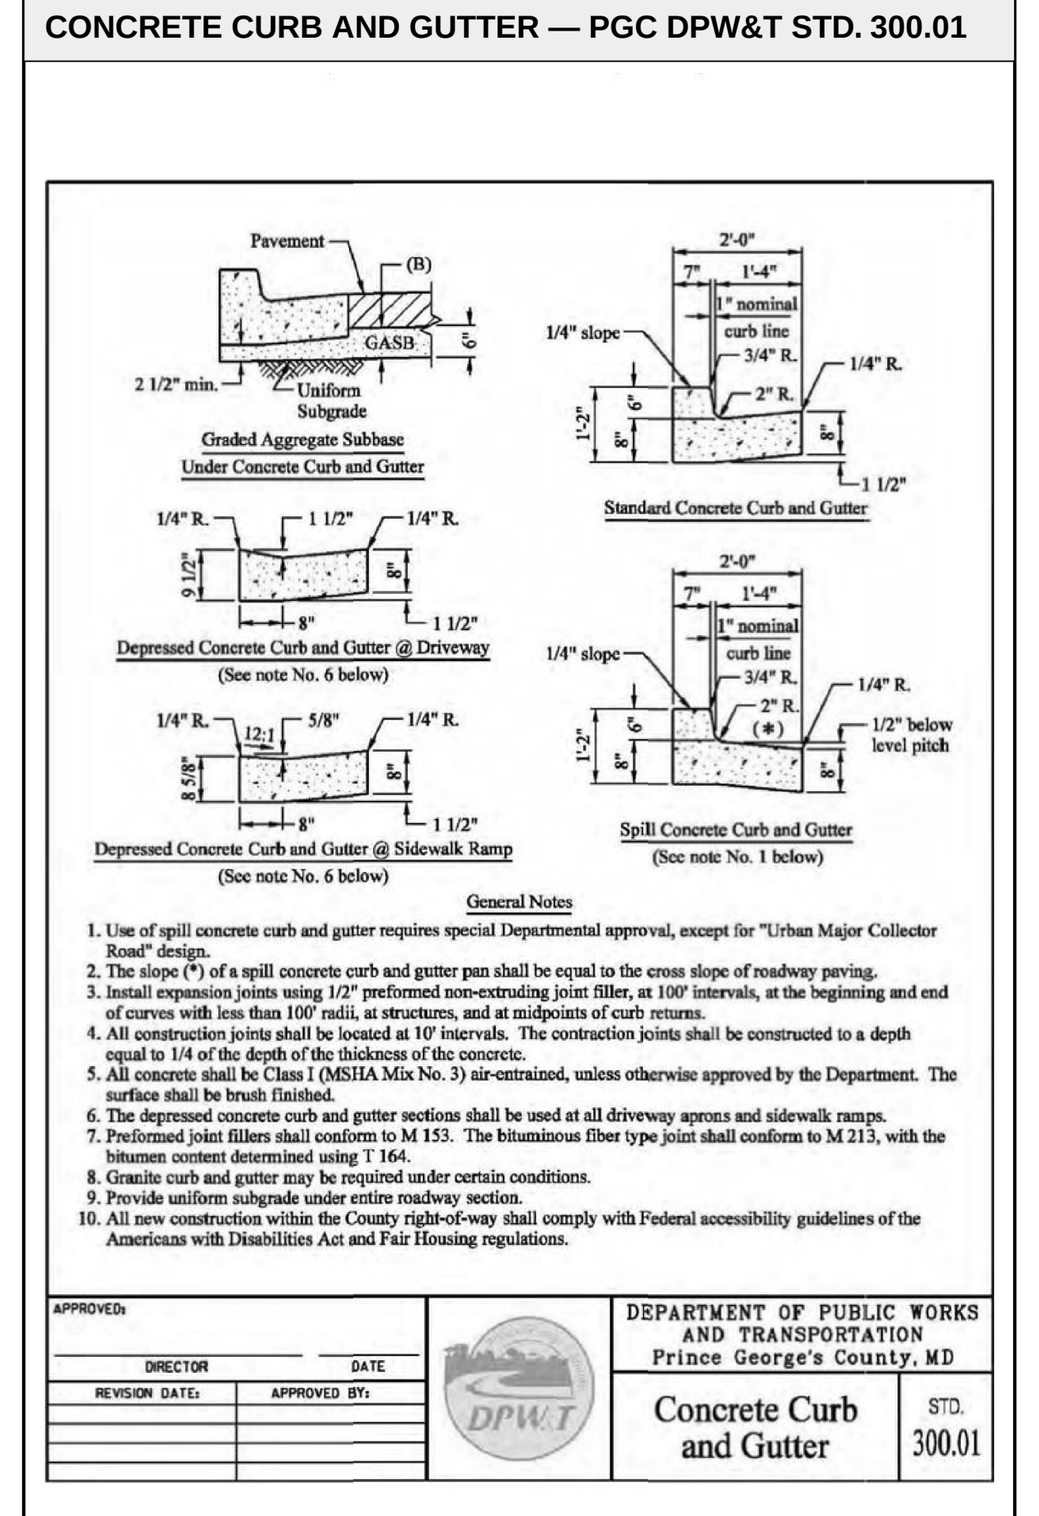

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

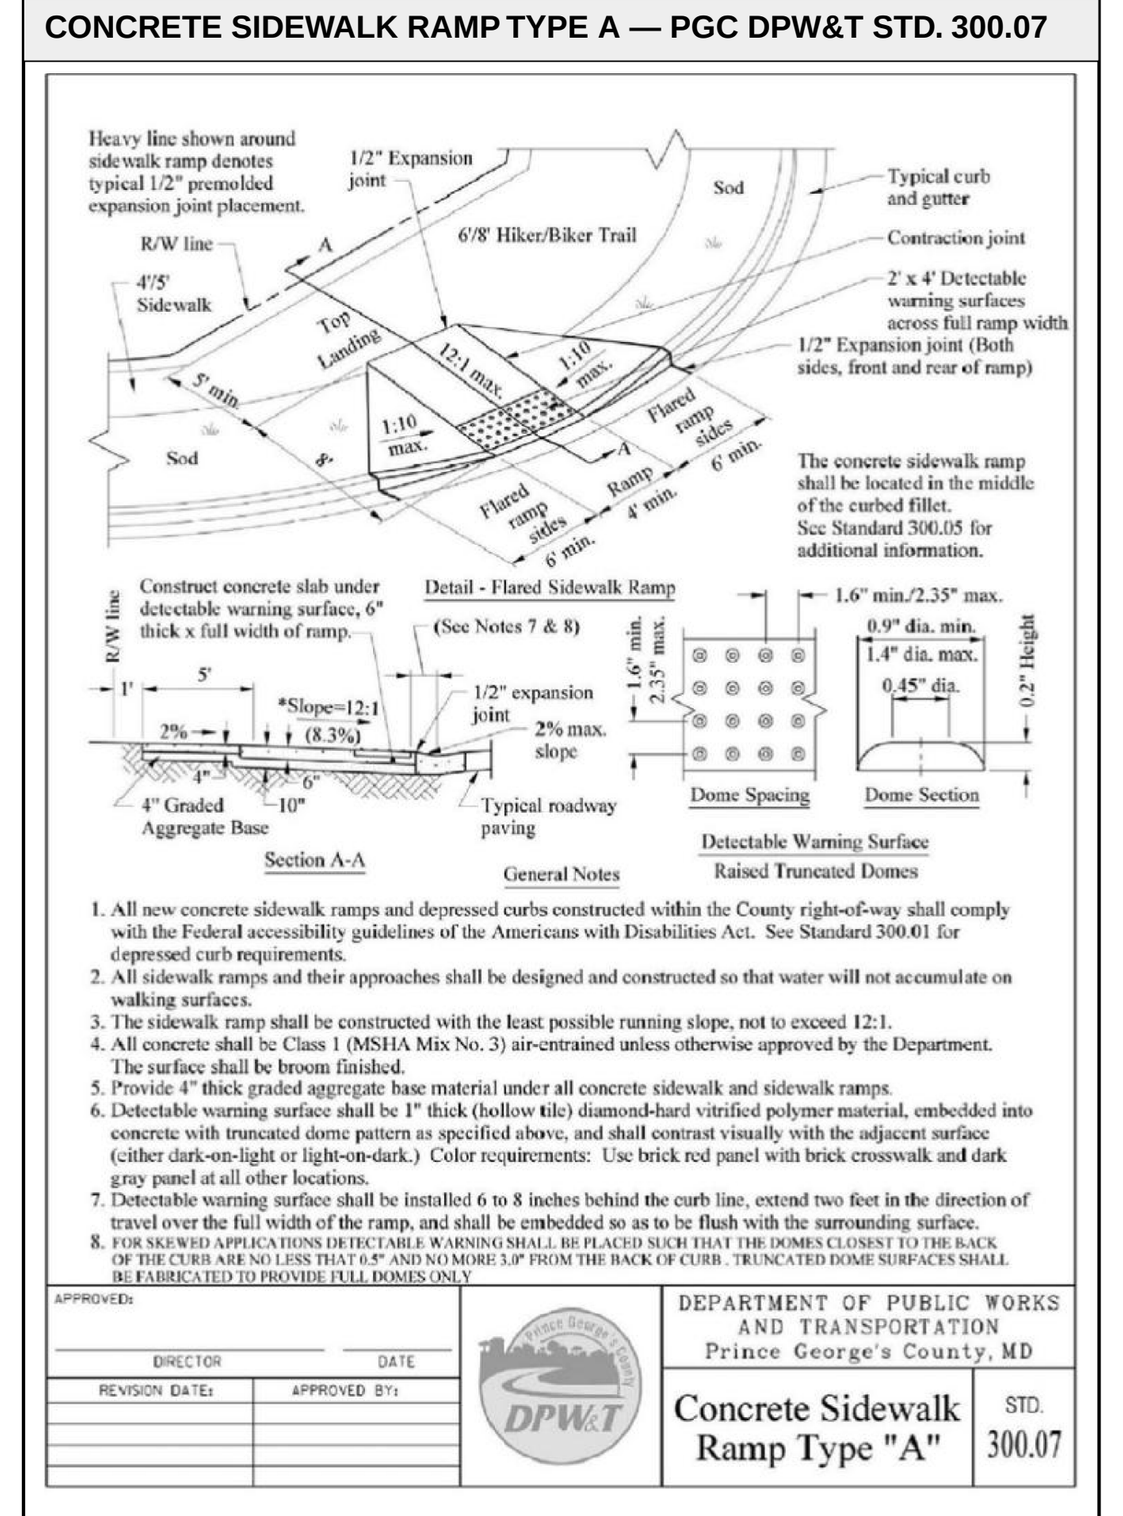

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

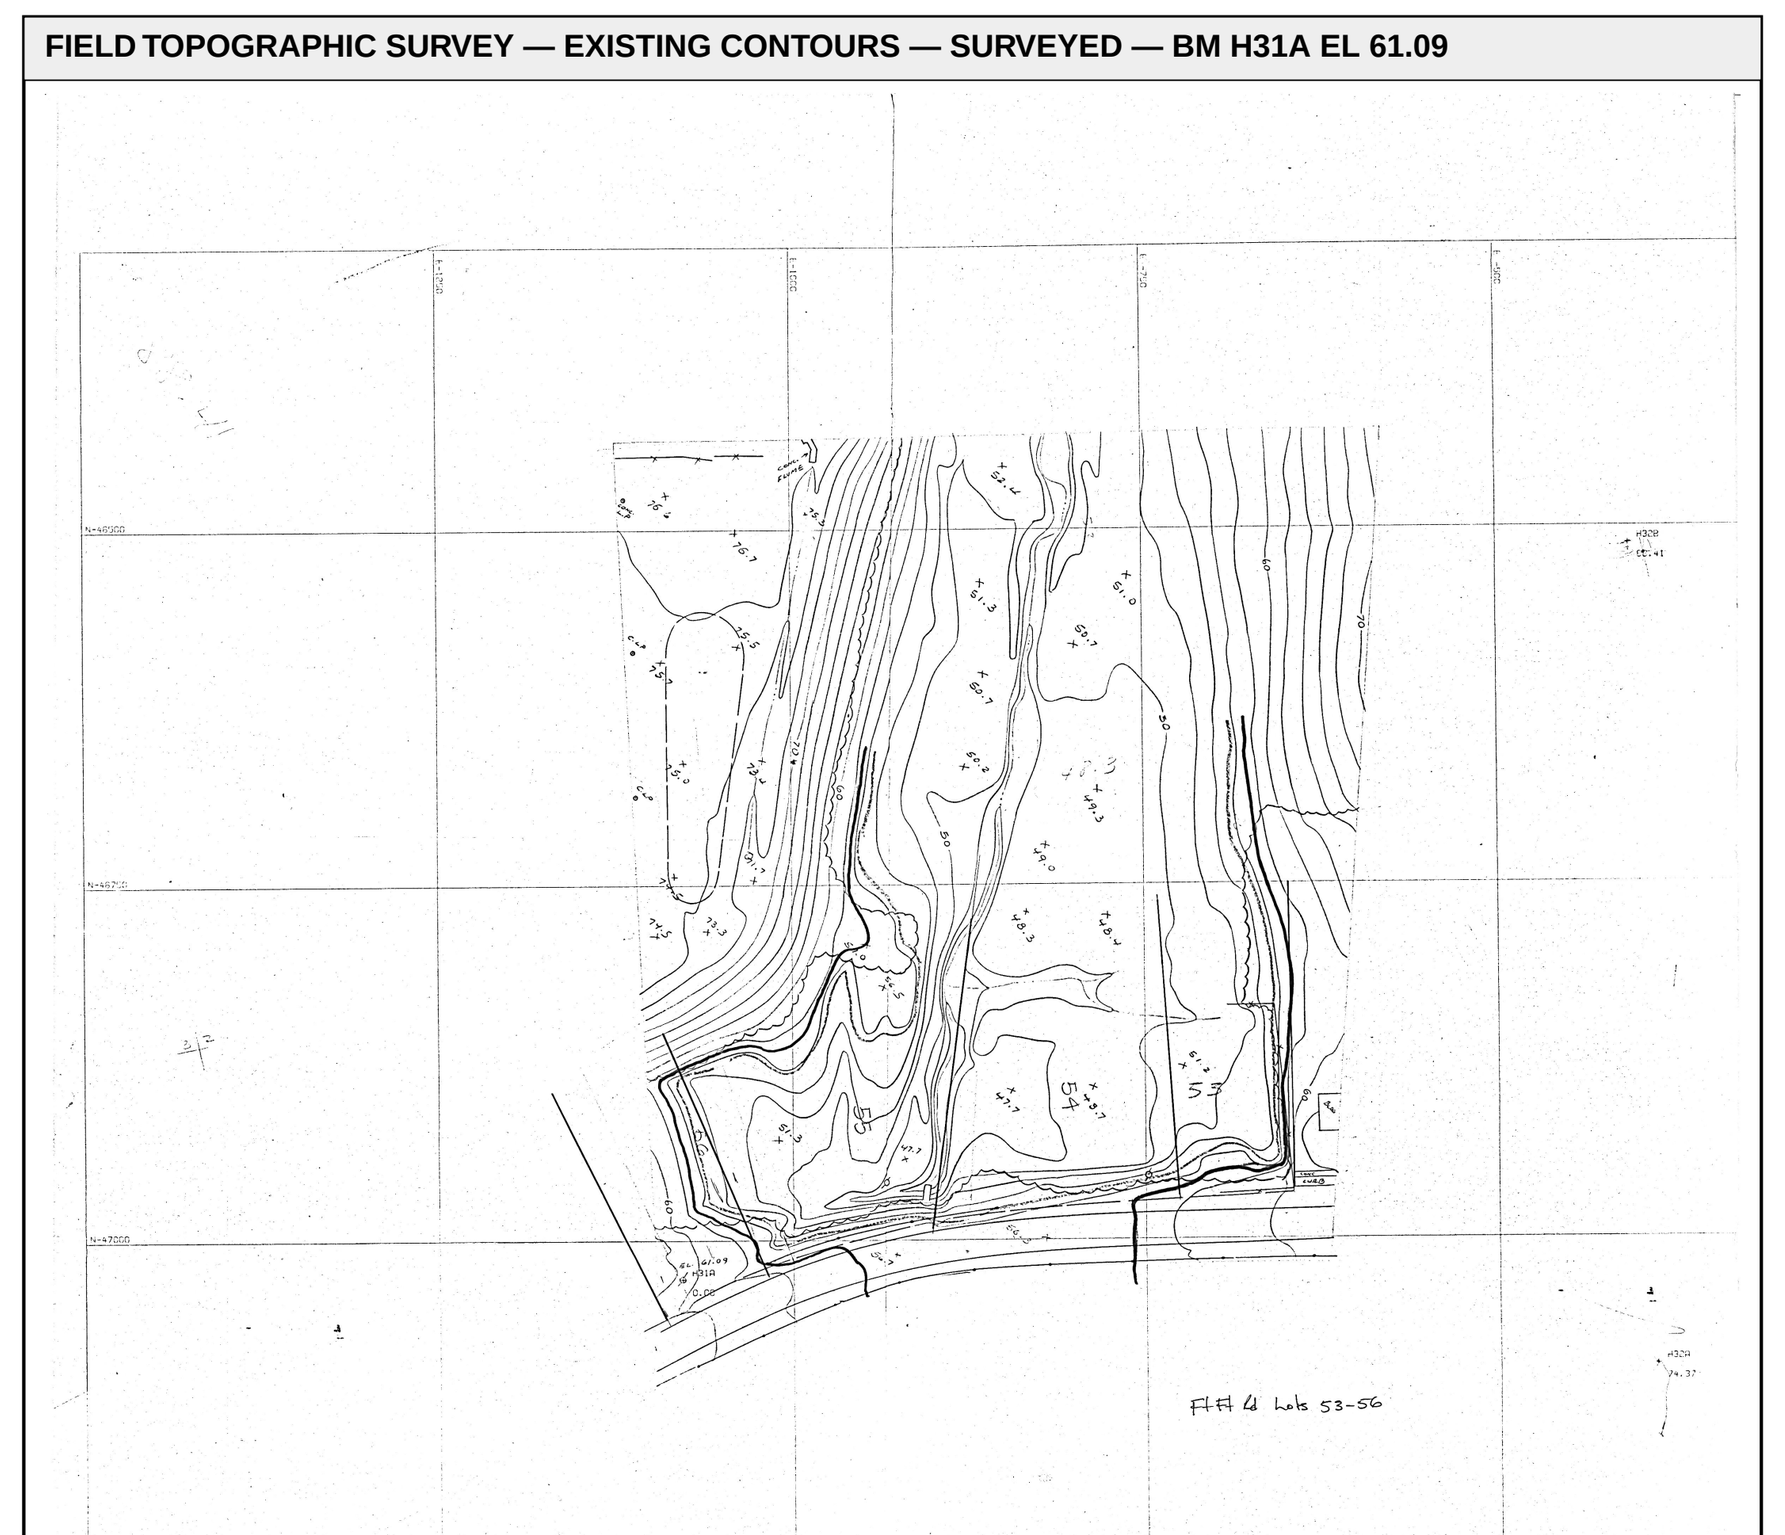

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

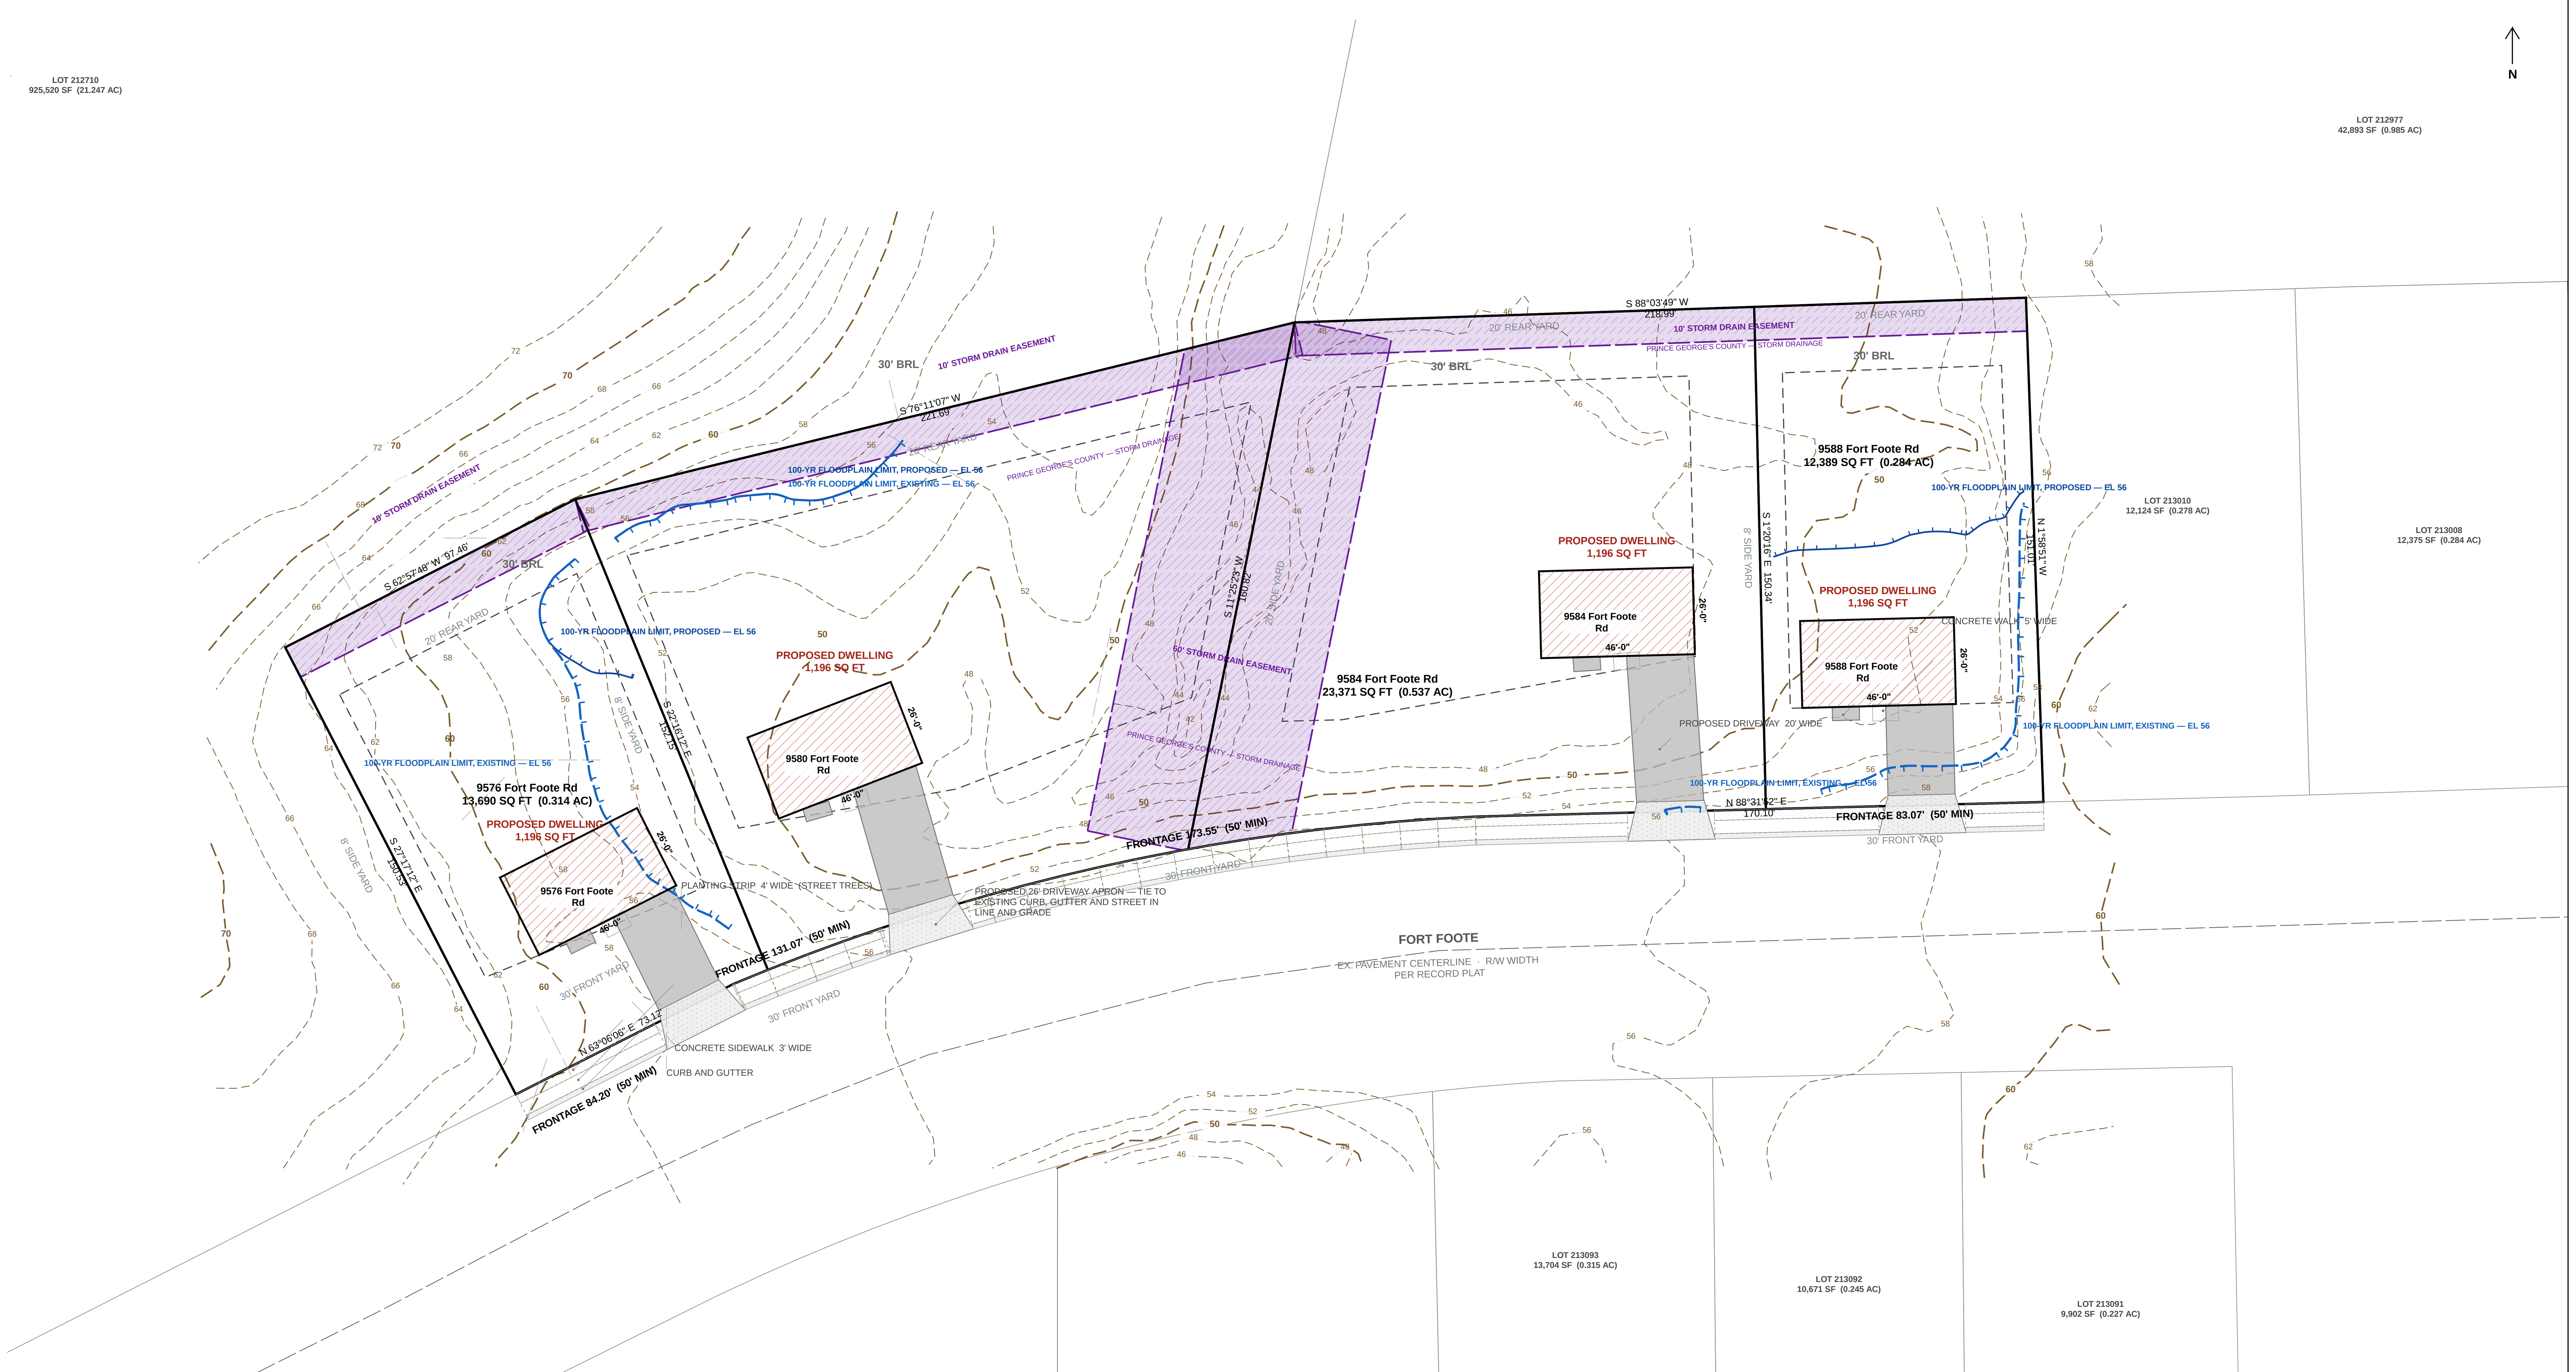

KEALEE

design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
TCP-NRI — Tree Conservation Plan / Natural Resource Inventory Coordination

SCALE
1" = 30'

STATUS
PRELIMINARY

SHEET NO.
12 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION	
PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	TCP-NRI — Tree Conservation Plan / Natural Resource Inventory Coordination
DISCIPLINE	Qualified Environmental Professional
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	75,178 SF
2. Area of dwelling	4,784 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	75,184 SF
6. TOTAL AREA DISTURBED	41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	192
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	**75,184**	**10.8%**	**2.96**	**3.84**	**0.88**	**924**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F. PLAT BOOK WWW 65, P. 60 (MSA_S1289_51253). 12TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND. TAX MAP 113, BLOCK F, GRID E4. PLAT DATED 6 JUNE 1967; APPROVED 26 JUNE 1967 BY THE MARYLAND-NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD. M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR: W. L. MEEKINS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20.9811 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

	SIGNATURE	DATE
SEAL	LICENSE NO.	EXPIRATION DATE

REVISIONS
— none —

SOILS TABLE USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

DRAINAGE SWALE SCHEDULE Rational method, NOAA Atlas 14 · Manning n = 0.041, 2' bottom, 3:1 sides

REACH	LENGTH	GRADE	D.A. (AC)	Q10 (CFS)	Q100 (CFS)	DEPTH	V100 (FPS)	INV IN	INV OUT	CUT
ST-1 — ST-2	110'	3.01%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'
ST-4 — ST-3	157'	4.98%	0.3143	0.65	0.86	0.16'	2.12	60.30	52.50	1.0'
ST-3 — ST-2	177'	3.17%	0.9051	1.87	2.47	0.33'	2.51	52.50	46.90	1.0'

GRADE CONTROL SCHEDULE

POINT	LOT	DESCRIPTION	GROUND	SWALE INV
ST-1	LOT 53	Swale grade break / invert control	51.20	50.20
ST-2	LOT 54	Swale grade break / invert control	47.90	46.90
ST-3	LOT 55	Swale grade break / invert control	53.50	52.50
ST-4	LOT 56	Swale grade break / invert control	61.30	60.30
OUT	—	Swale grade break / invert control	48.90	—

SYSTEM AT THE LOW POINT: 1.7260 AC, Q10 3.57 CFS, Q100 4.71 CFS.
MAX VELOCITY 2.51 FPS AT Q100 — WITHIN THE 5 FPS PERMISSIBLE FOR ESTABLISHED GRASS. 0.5 FT FREEBOARD THROUGHOUT.
THE SWALE DISCHARGES TO THE RECORDED 54/55 STORM DRAIN EASEMENT, ALONGSIDE THE 48" RCP CL IV EXTENDING THE FORT FOOTE ROAD CULVERT INLET.
THAT MAIN IS BURIED: OD 4.67 FT, 1.5 FT MIN COVER OVER THE CROWN — FINISHED GRADE OVER IT SHALL BE NO LOWER THAN INVERT + 6.17 FT. FILL WHERE EXISTING GROUND IS LOWER.
SWALE GRADES AND INVERTS TO BE SET FROM THE FIELD-RUN TOPOGRAPHIC SURVEY. ESTABLISH SOD BEFORE THE CONTRIBUTING AREA IS STABILISED.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

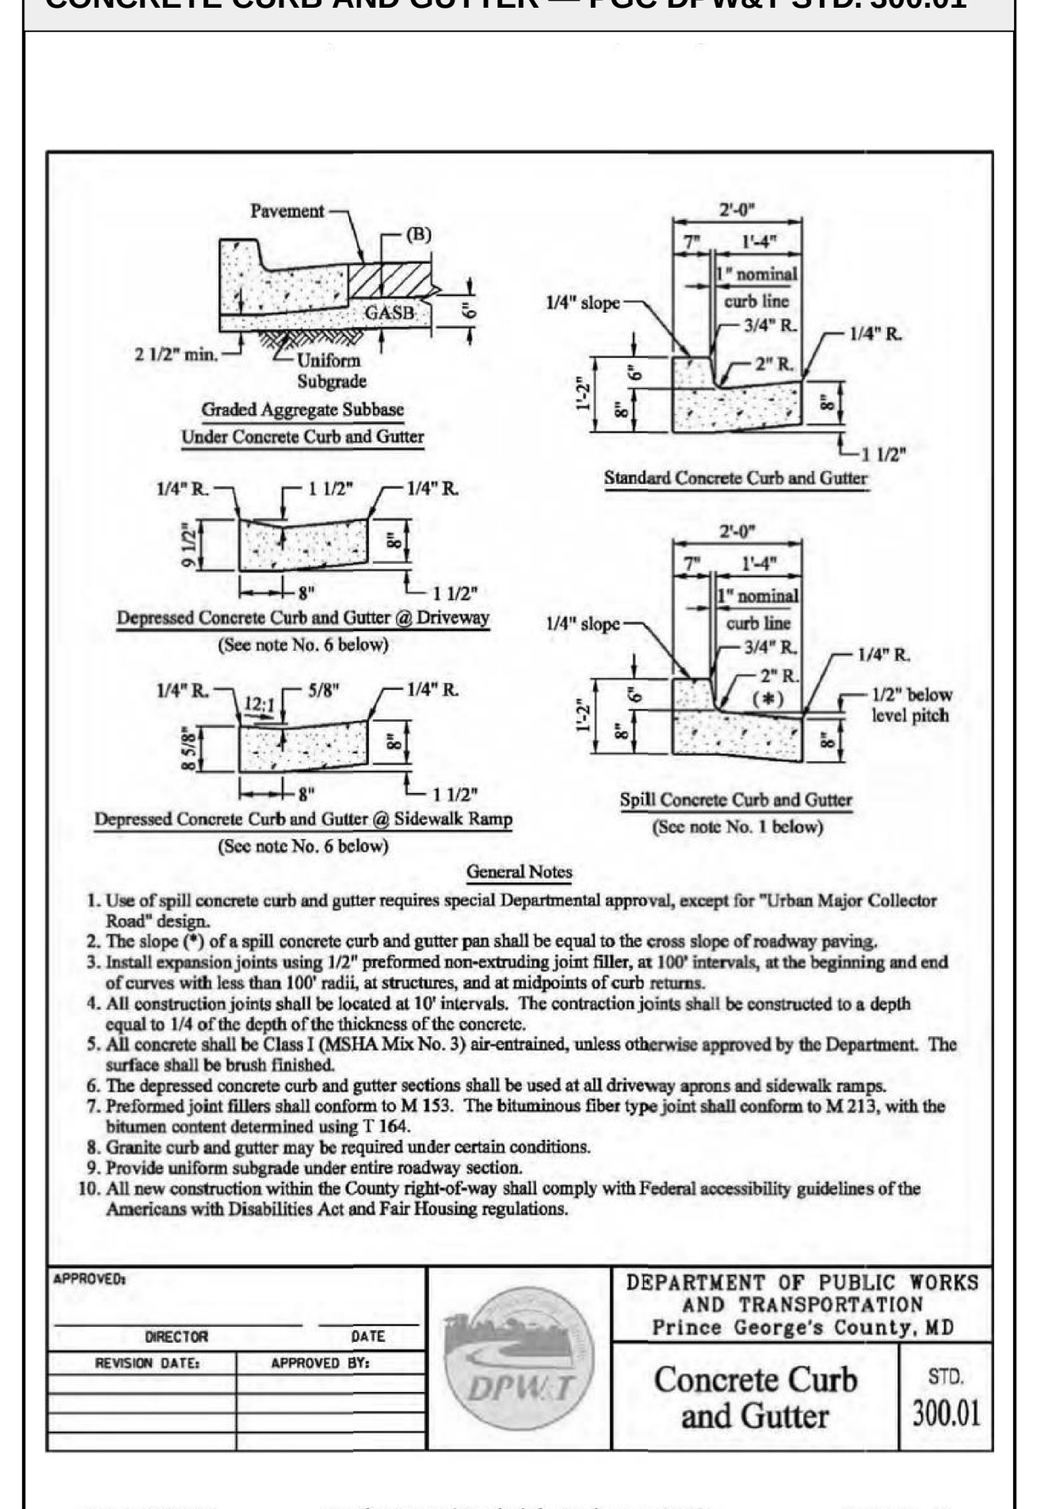

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

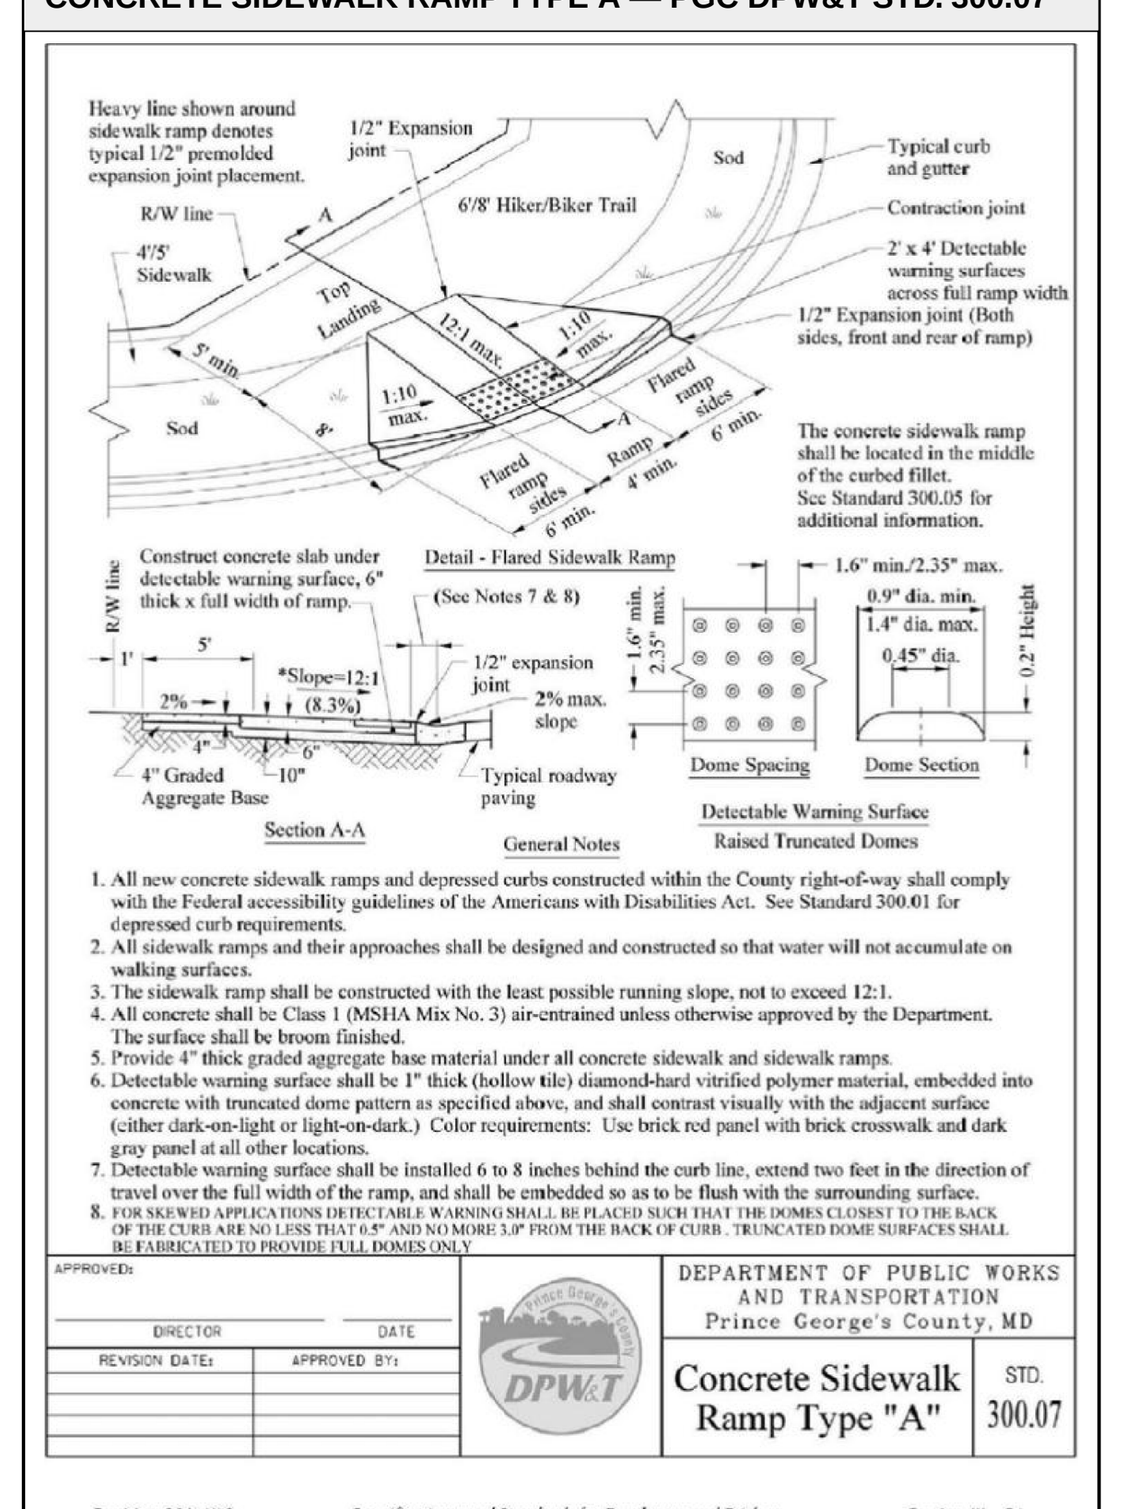

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

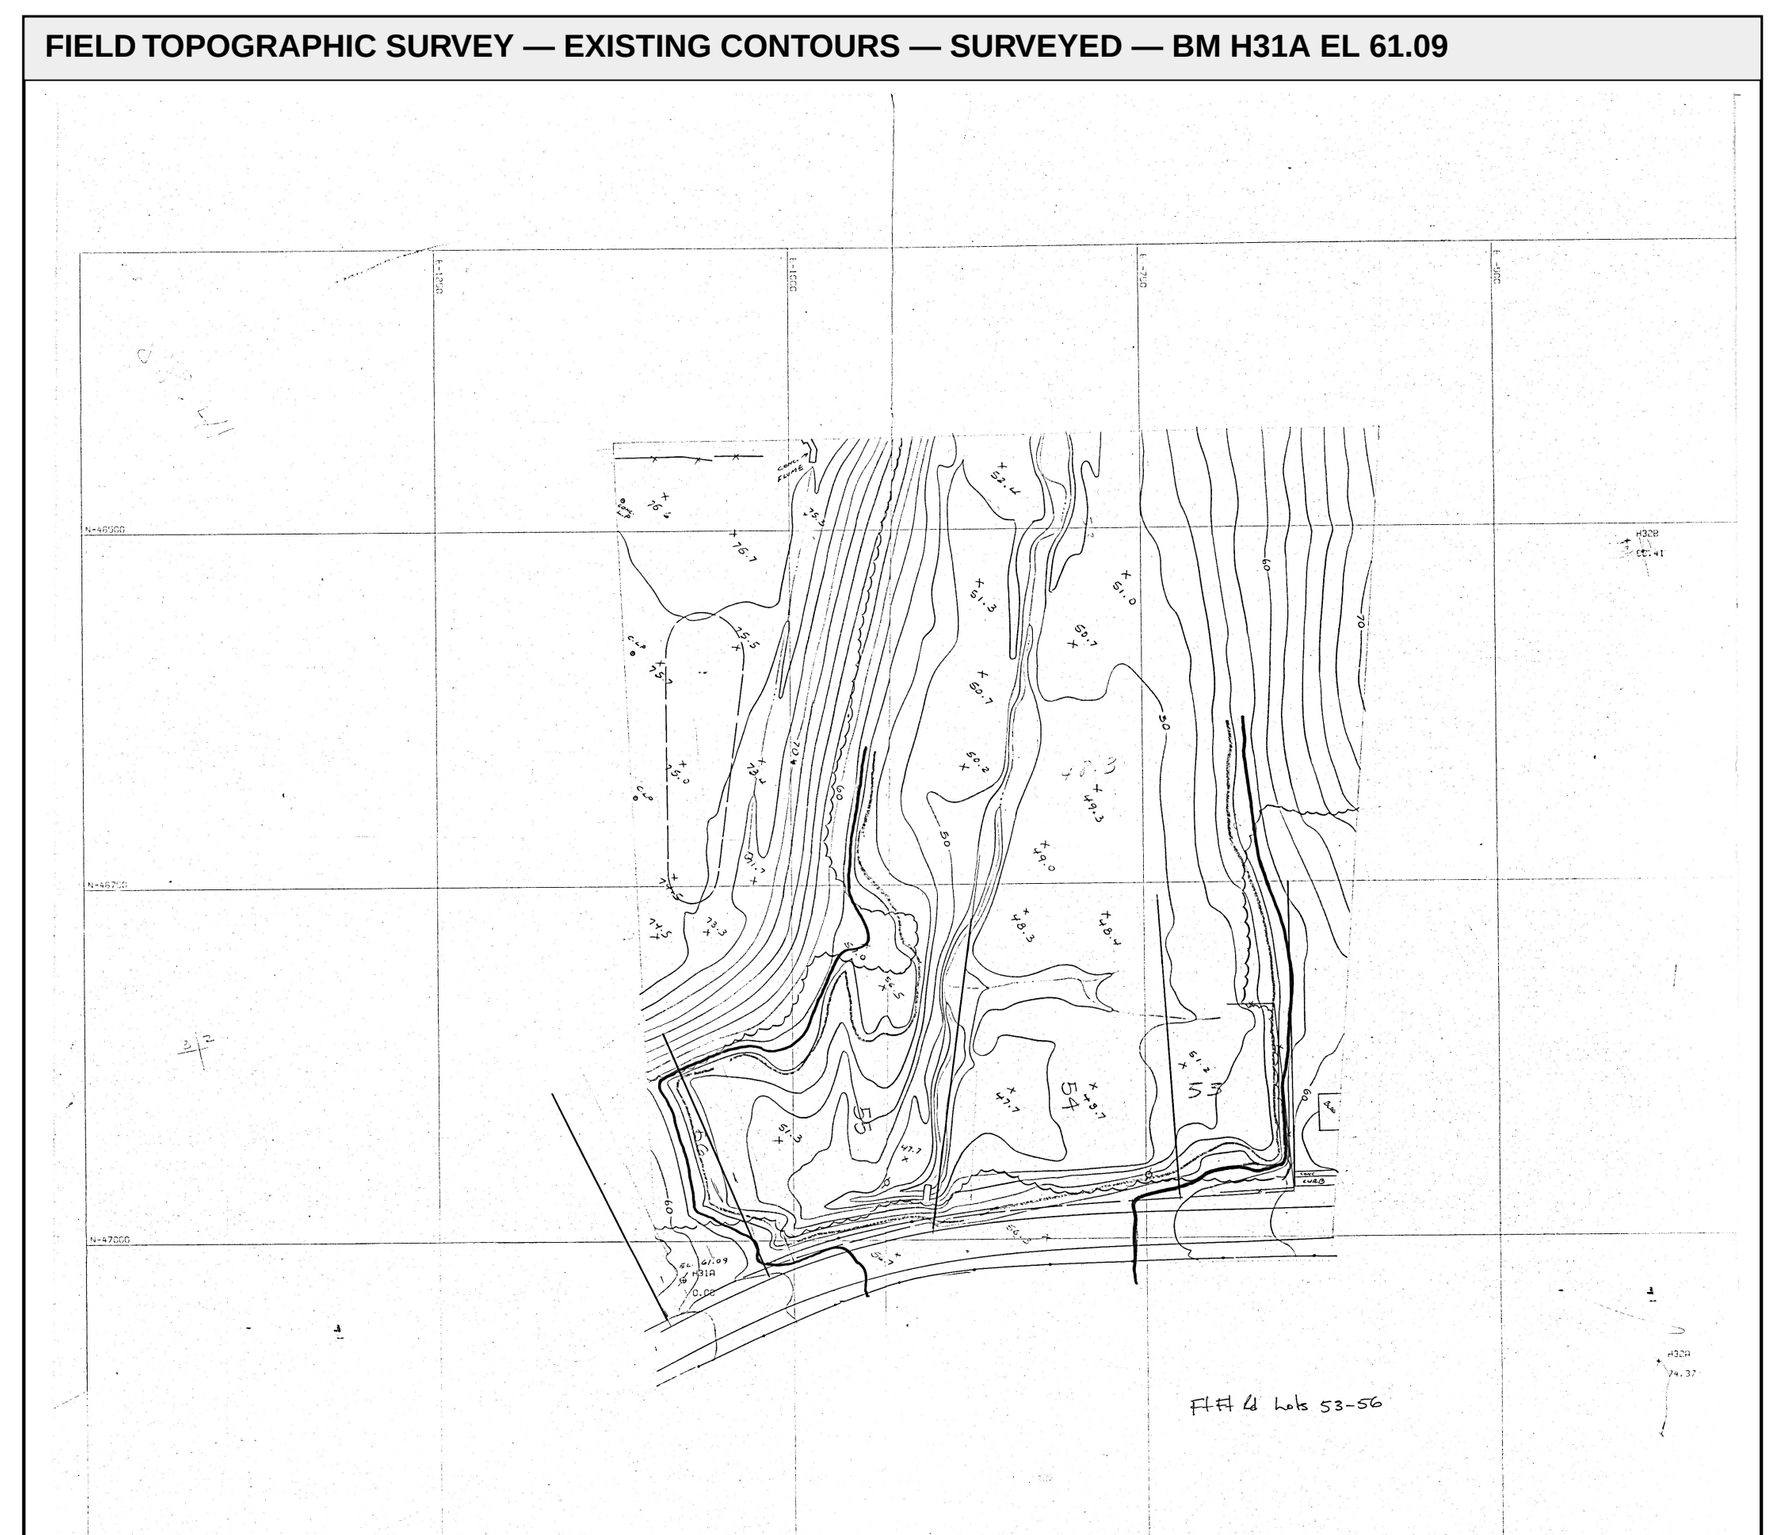

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

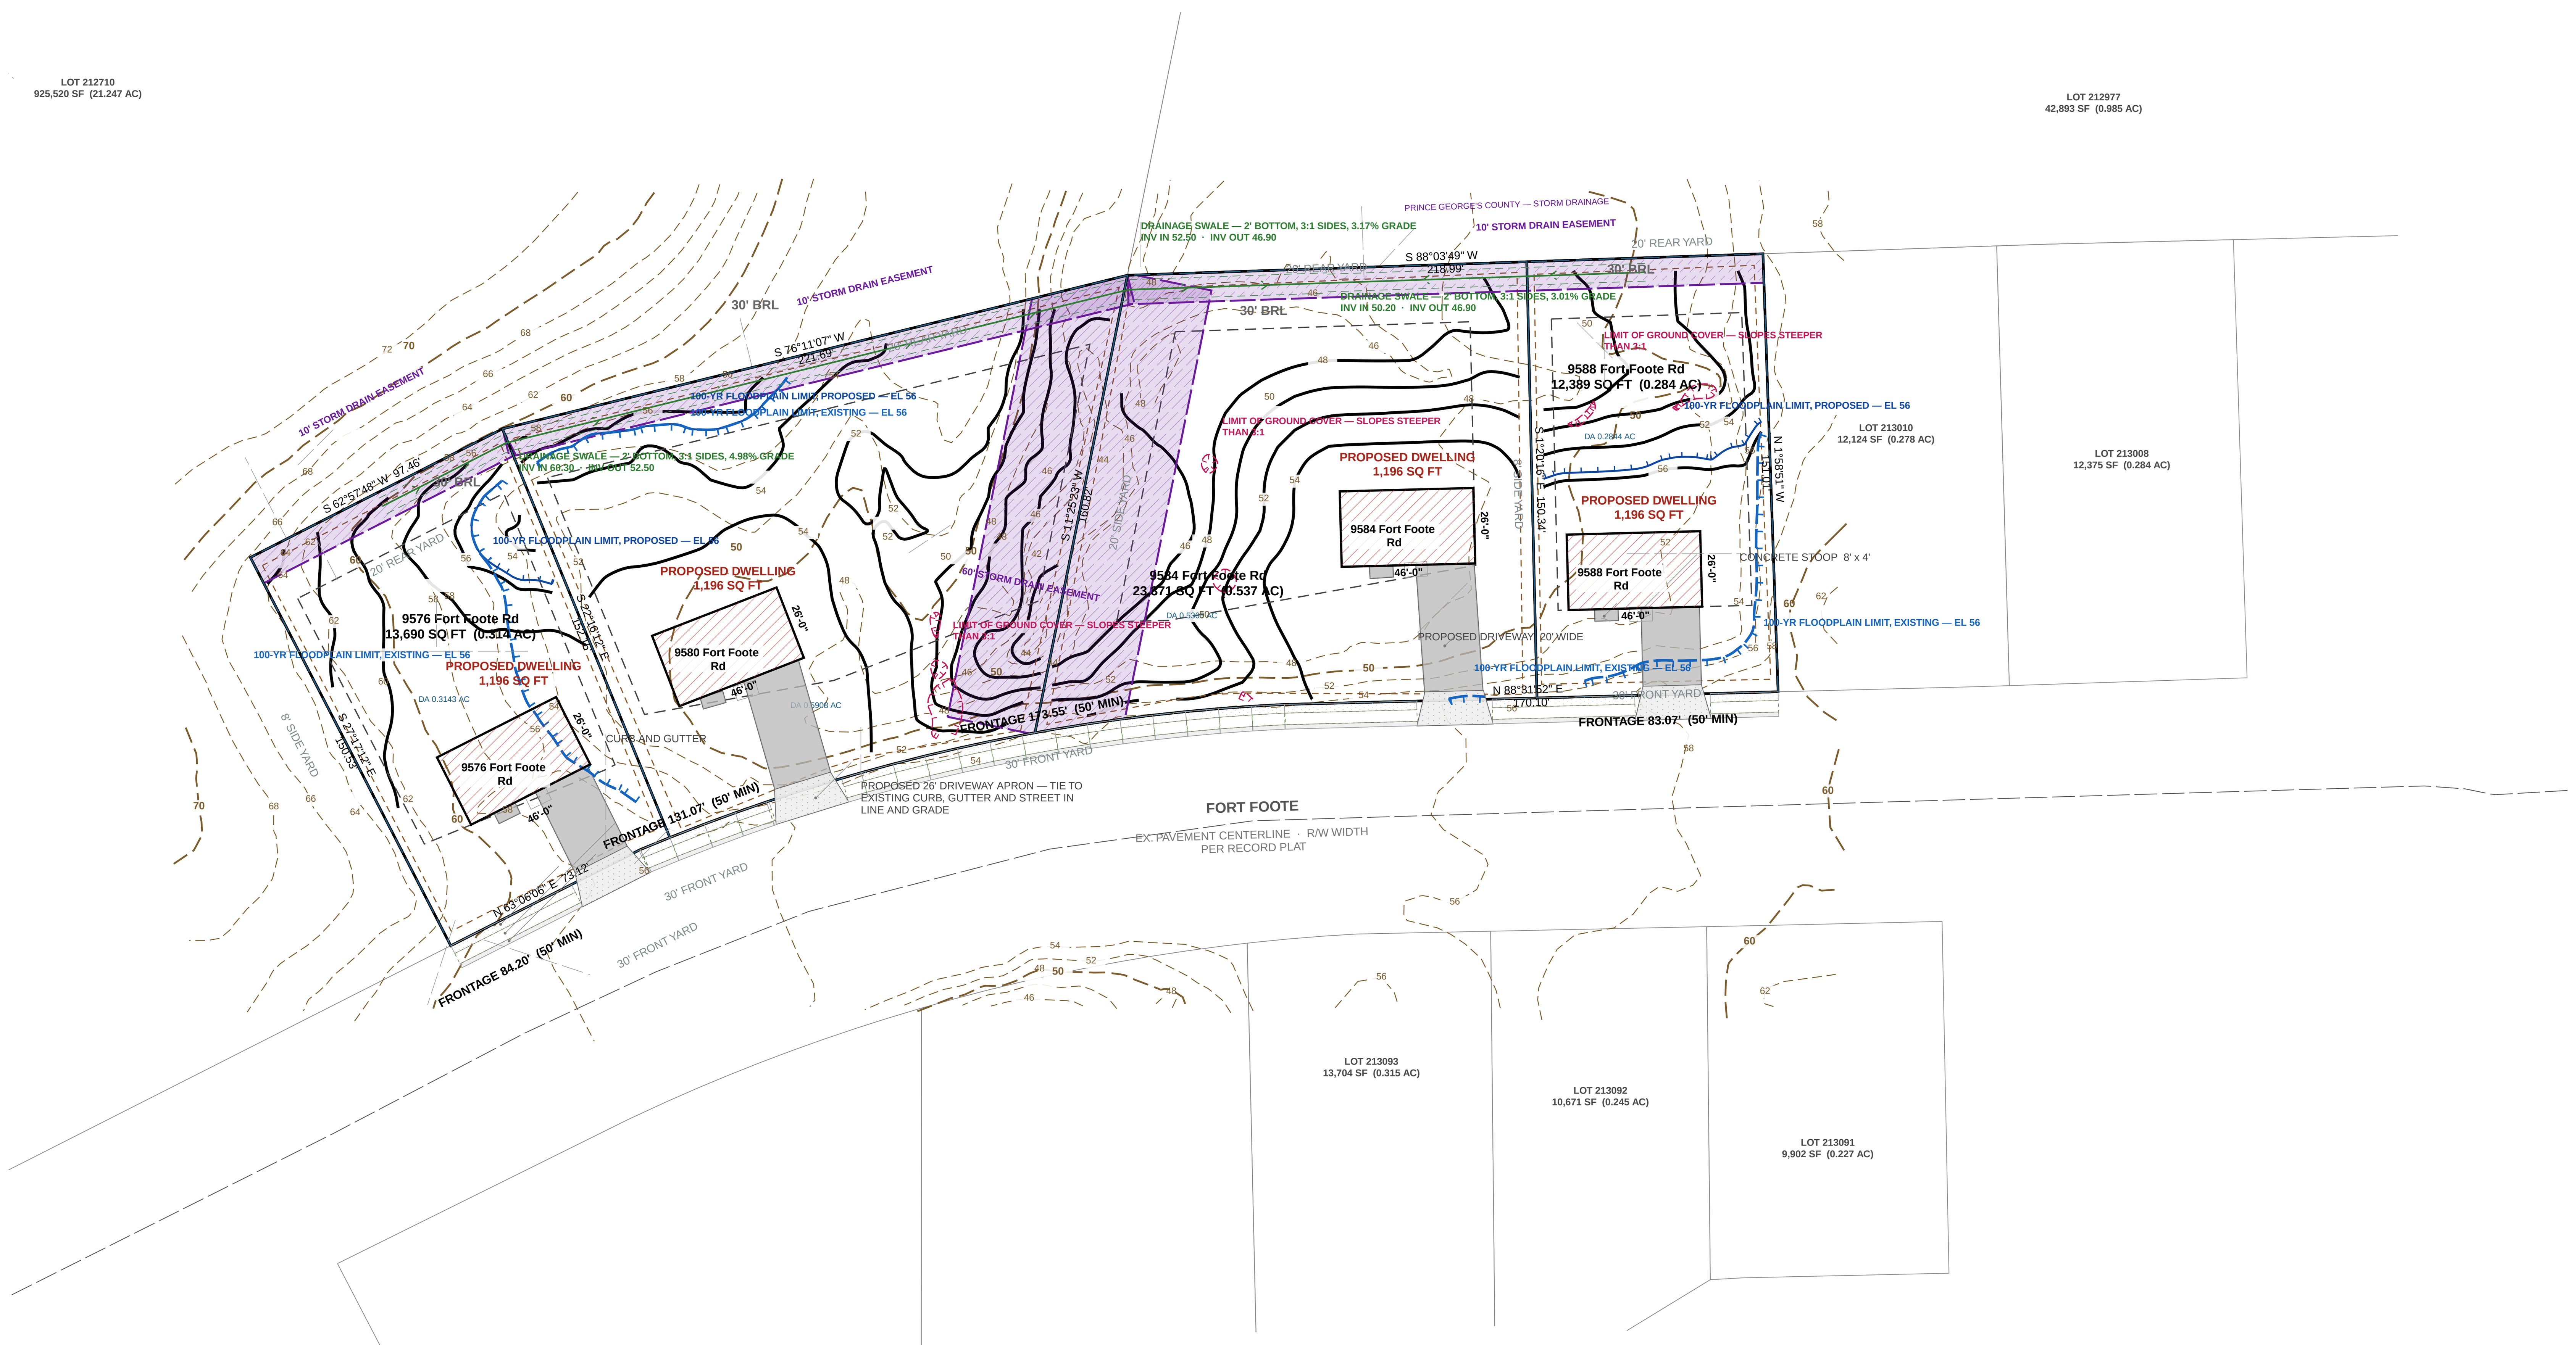

CROSS SECTIONS — FRONT LOT LINE TO REAR, PERPENDICULAR TO THE OVERFLOW

Existing ground SOLID from county 2 ft contour mapping, NAVD88 — not a field-run survey. Proposed ground DASHED. The flood elevation is the FPS-770017 figure in the WSSC datum, plotted at its numeric value pending the tie.

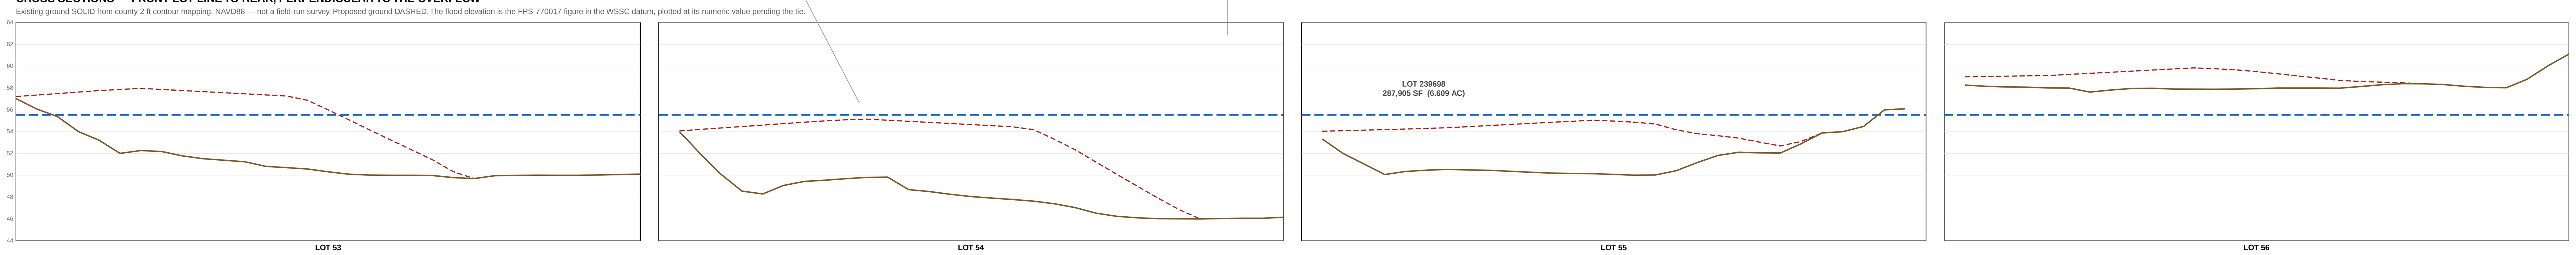

Horizontal 1" = 22' · vertical 1" = 9' · vertical exaggeration 2.6x. Stations at 5 ft from the front lot line.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

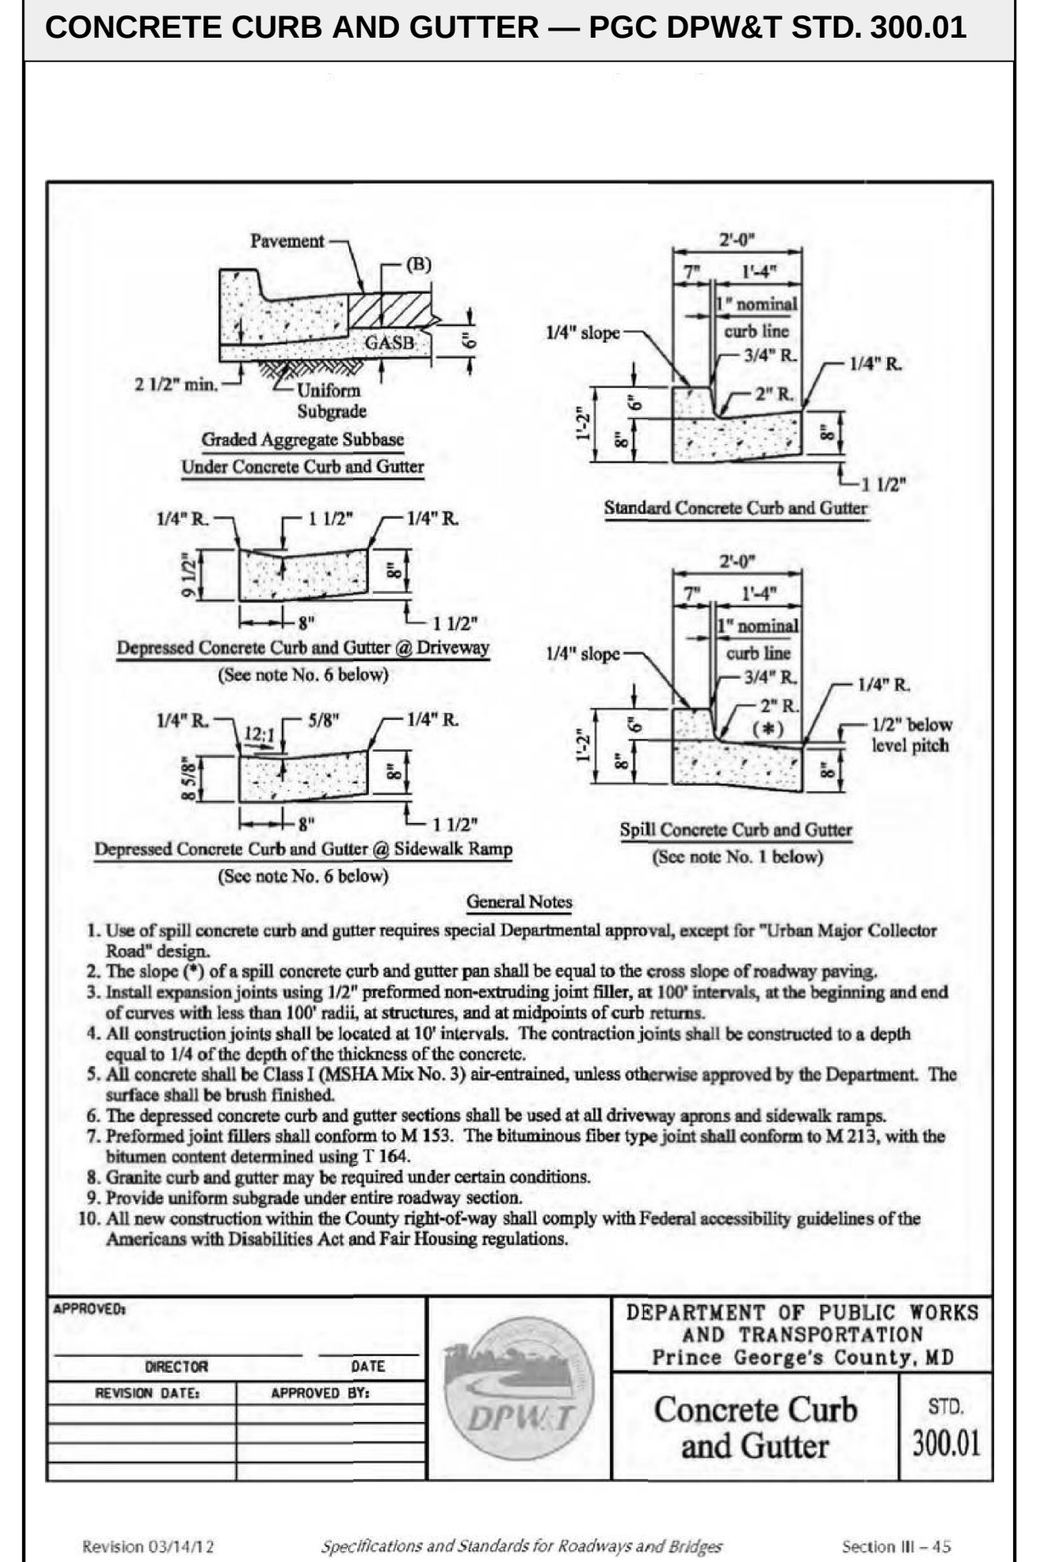

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

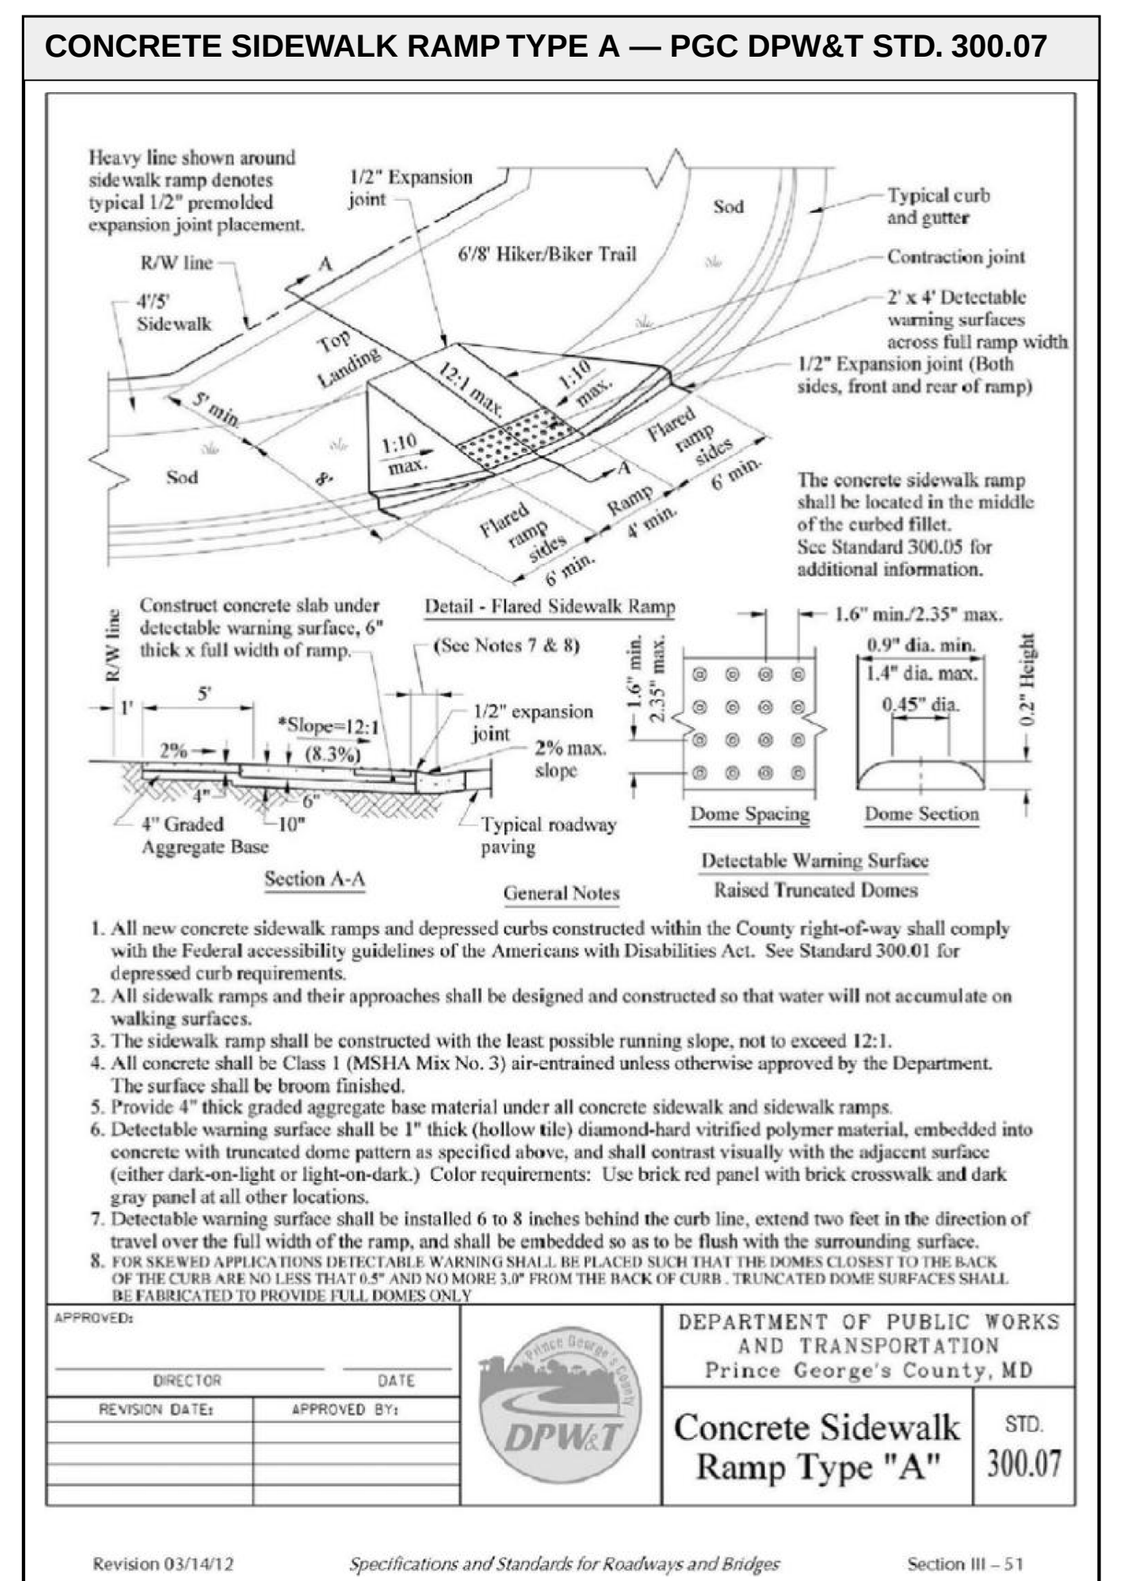

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL 61.09

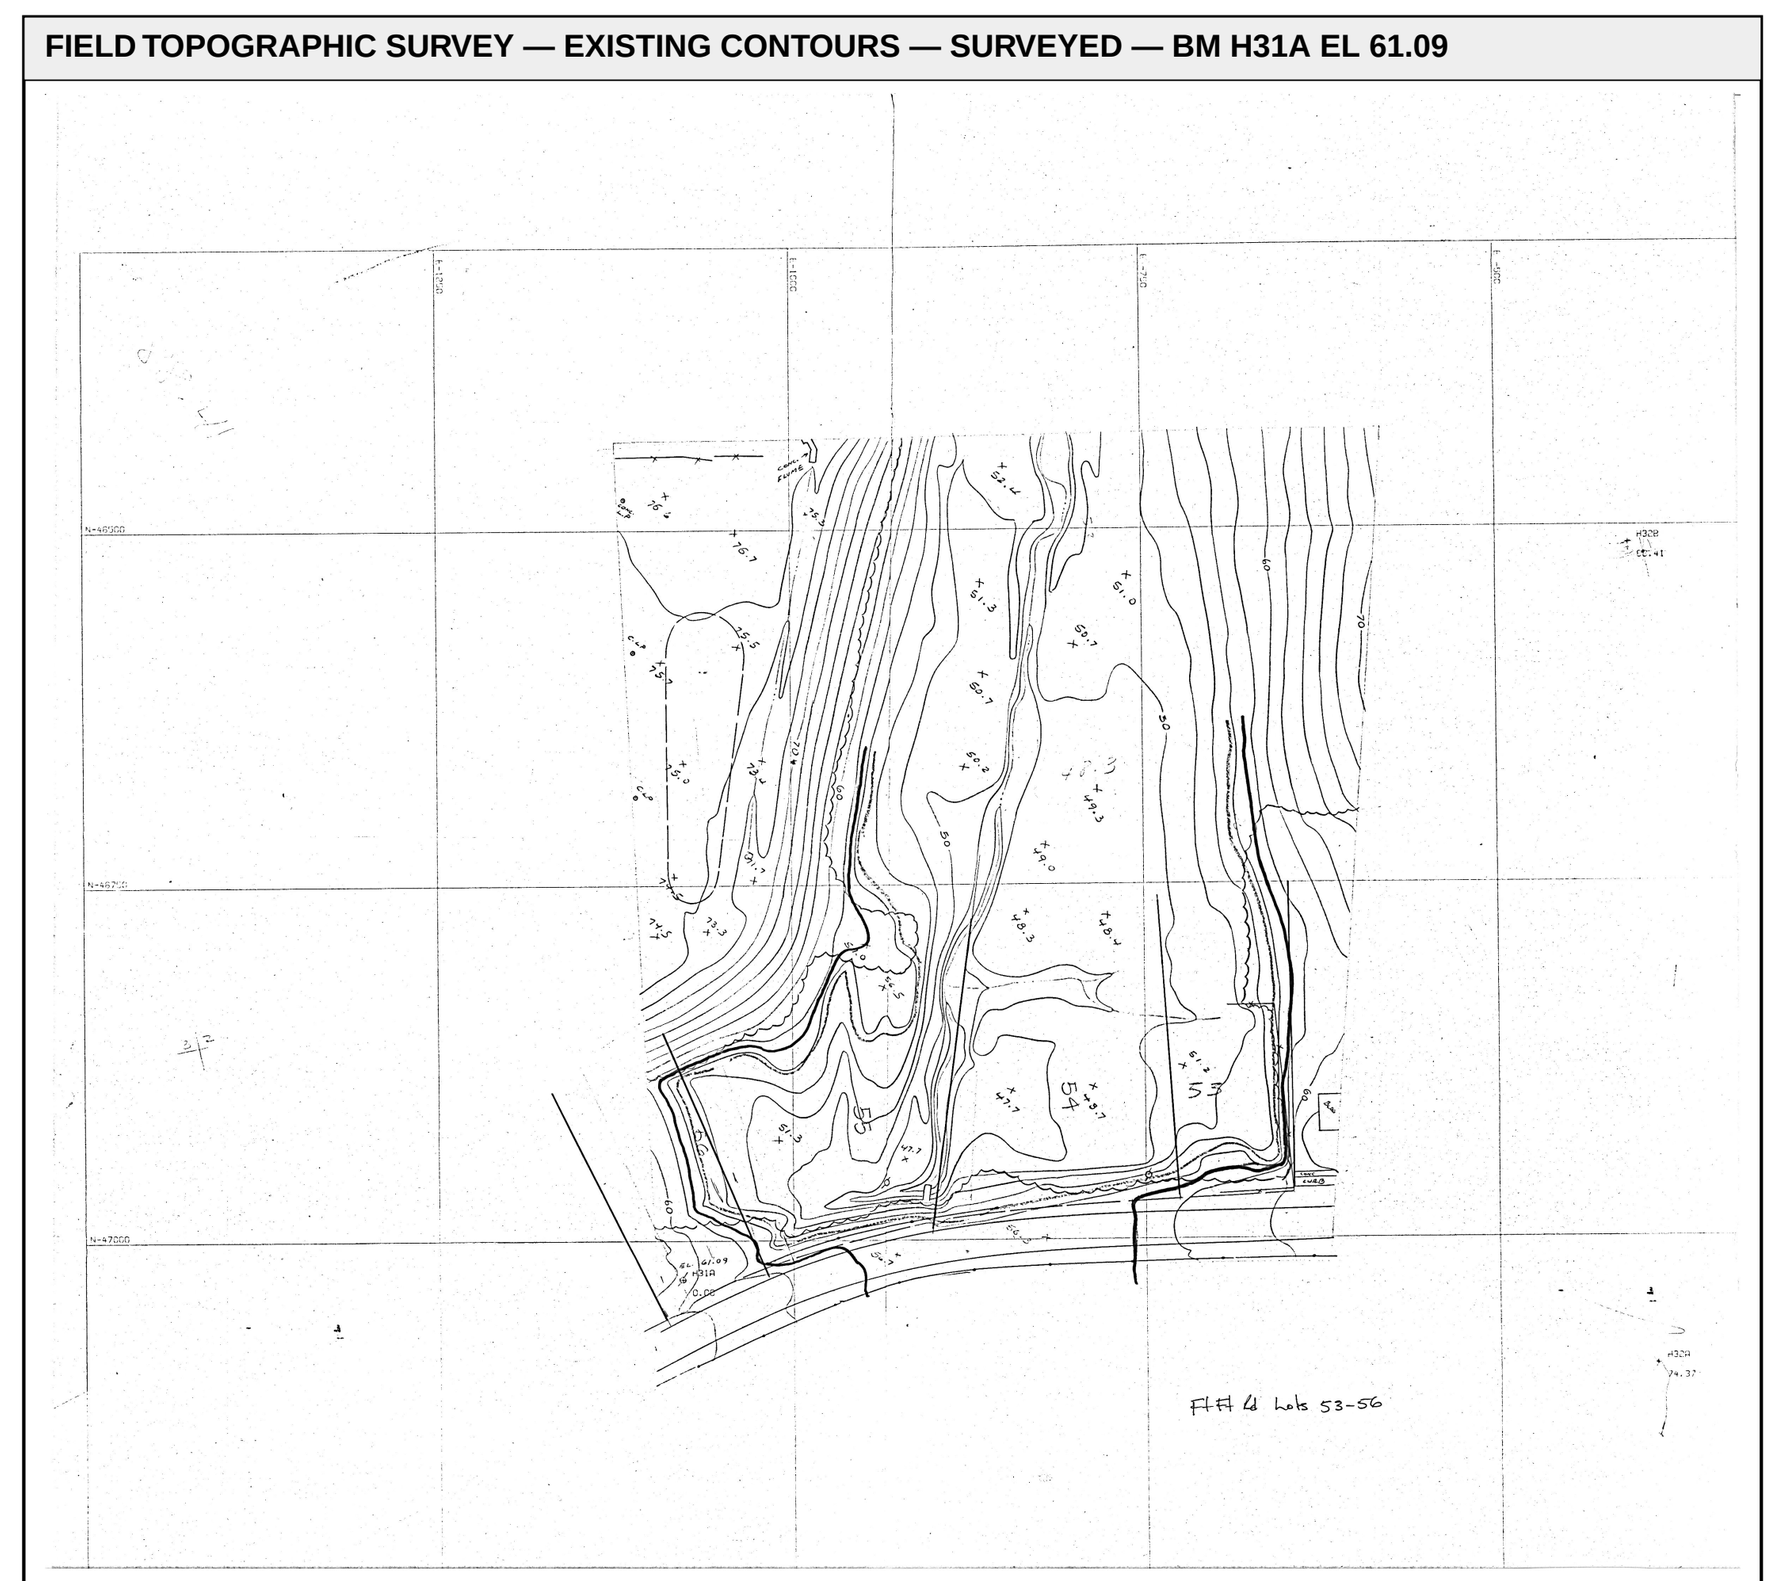

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY. THE SURVEY GOVERNS.

GRAPHIC SCALE — 1" = 40'

0 40 80 120 160 FEET

KEALEE

design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56

ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
FP-100 — Floodplain Concept Study — Existing Conditions, Impact and Mitigation

SCALE
1" = 40'

STATUS
PRELIMINARY

SHEET NO.
13 OF 13

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION	
PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	FP-100 — Floodplain Concept Study — Existing Conditions, Impact and Mitigation
DISCIPLINE	Maryland Professional Engineer
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

FLOODPLAIN CONCEPT — FINDINGS AND LIMITS

HOW TO READ THE TWO LIMIT LINES

THE DASH-DOT LINE IS THE STATED FLOOD ELEVATION CUT THROUGH EXISTING GROUND. THE FINER SOLID LINE IS THE SAME ELEVATION CUT THROUGH THE PROPOSED REGRADED SURFACE. TICKS ON THE WET SIDE OF BOTH. THE ELEVATION DOES NOT MOVE BETWEEN THEM — ONLY THE GROUND DOES, AND THE DIFFERENCE IS THE FLOODPLAIN IMPACT OF THE GRADING. A LOT LYING WHOLLY BELOW THE ELEVATION IN A GIVEN CONDITION CARRIES NO LINE FOR IT, BECAUSE THERE IS NO CROSSING TO DRAW — LOT 54 IS 100% BELOW EXISTING AND HAS NONE. READ THE TABLE, NOT THE ABSENCE OF A LINE.

NEITHER LINE IS A DELINEATION

BOTH ARE A STATED ELEVATION CUT THROUGH A SURFACE BUILT FROM COUNTY 2 FT LIDAR CONTOUR MAPPING. A DELINEATION UNDER DPIE SUBMITTAL ITEMS 18 AND 19 REQUIRES HYDRAULIC MODELLING ON FIELD-RUN CROSS SECTIONS, TIED TO A DATUM, SEALED BY A LICENSED PROFESSIONAL ENGINEER AND APPROVED BY THE COUNTY. THESE ARE THE EXHIBITS THAT SCOPE THAT WORK, NOT A SUBSTITUTE FOR IT.

MITIGATION CONCEPT — RECOMMENDED

1. TIE BENCHMARKS H31A (61.09), H32A (74.37), H32B (66.41) TO NAVD88 AND ESTABLISH THE WSSC OFFSET. EVERY VOLUME BELOW IS SIZED OFF IT. 2. EXTEND THE EXISTING FORT FOOTE ROAD CULVERT WITH 48 IN RCP CL IV, 162 FT, WITHIN THE RECORDED 60 FT STORM DRAIN EASEMENT ON THE LOT 54 / LOT 55 PARTY LINE, AND ENLARGE OR REPLACE THE INLET. THE EXISTING 36 IN RUNS AT 104% OF CAPACITY AT Q10 ON 39.1 AC; THE 48 IN CARRIES 149.3 CFS AGAINST A 100-YEAR DEMAND OF 94.9 CFS, AND AT 48 IN CONTROL PASSES FROM THE INLET TO THE OUTLET — THE POINT AT WHICH THE BARREL IS ACTUALLY BEING USED. THIS IS THE ONLY MEASURE THAT CAN LOWER THE WATER SURFACE RATHER THAN DISPLACE IT. 3. RAISE THE LOT 54 AND LOT 55 PADS 3.0 FT — APPROXIMATELY 1,000 CY. 4. SLAB-ON-GRADE OR VENTED CRAWLSPACE ON LOTS 54 AND 55; NO HABITABLE SPACE BELOW THE FLOOD ELEVATION. 5. COMPENSATORY STORAGE CUT FROM THE REAR OF LOTS 54 AND 55. 6. LEAVE THE REAR OVERFLOW CORRIDOR AT EXISTING GRADE. 7. RESOLVE THE FLOODPLAIN EASEMENT ON LOTS 53 AND 54.

BLANKET FILL WAS CONSIDERED AND IS NOT RECOMMENDED

FILLING THE TRACT TO EL 58 IS 19,212 CY AND TO EL 60 IS 24,062 CY — FOUR TO FIVE TIMES THE ENTIRE PROJECT EARTHWORK. IT WOULD FILL THE OVERFLOW SWALE THAT FPS-770017 RECORDS RUNNING WITH THE STORM DRAIN EASEMENT ACROSS THE REAR OF LOTS 50 TO 53, WHICH IS CONVEYANCE AND NOT MERELY STORAGE, AND WOULD REQUIRE COMPENSATORY STORAGE THERE IS NO ROOM FOR ON A 1.7 AC TRACT. GRADING DOES NOT LOWER A FLOOD ELEVATION; IT RAISES THE GROUND AND MOVES THE WATER.

FEMA STATUS

ALL FOUR LOTS ARE ZONE X, AREA OF MINIMAL FLOOD HAZARD, OUTSIDE THE SFHA, WITH NO PUBLISHED BASE FLOOD ELEVATION — FEMA NFHL QUERIED 2026-09-10 AT EACH ADDRESS POINT AND OVER THE WHOLE TRACT. FIRM PANEL 24033C0220E, EFFECTIVE 2016-09-16. THE EXPOSURE ON THIS SITE IS THE COUNTY'S OWN FLOODPLAIN OF RECORD, NOT FEMA'S.

LIMITS OF THIS ANALYSIS — READ BEFORE RELYING ON THIS SHEET

THIS IS A CONCEPT STUDY. IT IS NOT A FLOODPLAIN DELINEATION, NOT A NO-RISE CERTIFICATION AND NOT A DETERMINATION. EXISTING GRADE IS COUNTY 2 FT LIDAR CONTOUR MAPPING, NOT A FIELD-RUN SURVEY. THE EL LINE IS DRAWN AT THE NUMERIC VALUE OF A WSSC-DATUM ELEVATION ON AN NAVD88 SURFACE AND ITS TRUE POSITION DEPENDS ON A TIE NOT YET MADE — NOTE THAT FORT FOOTE ROAD ITSELF READS EL 54.0 NAVD88 AT LOTS 54 AND 55, BELOW THE STATED ELEVATION, WHICH INDICATES THE OFFSET IS MATERIAL. FPS-770017 CARRIES NO CROSS SECTIONS AND ITS CONTROLLING REVISION FPS 960004 IS NOT IN THE RECORD. HYDRAULICS SHOWN ARE RATIONAL METHOD AND MANNING FOR CONVEYANCE SIZING — NO BACKWATER, NO WATER-SURFACE PROFILE, NO HEC-RAS. EXCLUDED UNLESS SEPARATELY AUTHORISED: NEW TOPOGRAPHIC OR BOUNDARY SURVEY, FEMA CLOMR OR LOMR, FULL FLOODPLAIN STUDY, DETAILED HEC-RAS MODELING, GEOTECHNICAL OR INFILTRATION TESTING, WETLAND DELINEATION, FINAL SWM DESIGN, FINAL SEDIMENT AND EROSION CONTROL, CONSTRUCTION DOCUMENTS, UTILITY RELOCATION, CONSTRUCTION COST, AGENCY FEES, MORE THAN ONE REVISION CYCLE, AND ANY GUARANTEE THAT THE LOTS WILL BE REMOVED FROM THE FLOODPLAIN.

CONCLUSION

FEASIBLE WITH MODIFICATIONS, SUBJECT TO TWO VERIFICATION GATES — (1) THE DATUM TIE, AND (2) A NO-RISE DEMONSTRATION FOR THE CULVERT UPGRADE AND THE PAD FILL. IF GATE 2 CANNOT BE MET, THE FALLBACK IS TO RAISE THE FLOORS AND PLACE NO FILL BELOW THE FLOOD ELEVATION. THE FLOODPLAIN EASEMENT QUESTION ON LOTS 53 AND 54 IS INDEPENDENT OF THE HYDRAULICS AND MAY GOVERN REGARDLESS.

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	75,178 SF	1.726 AC
LOT 53 AREA	12,389 SF	0.284 AC
LOT 54 AREA	23,371 SF	0.537 AC
LOT 55 AREA	25,733 SF	0.591 AC
LOT 56 AREA	13,690 SF	0.314 AC
NET LOT AREA	75,184 SF	1.726 AC
LOT 53 FRONTAGE	50' MIN	83.07'
LOT 54 FRONTAGE	50' MIN	173.55'
LOT 55 FRONTAGE	50' MIN	131.07'
LOT 56 FRONTAGE	50' MIN	84.20'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	30'	30'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	6.4%
BUILDING FOOTPRINT	—	4,784 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	75,178 SF
2. Area of dwelling	4,784 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	75,184 SF
6. TOTAL AREA DISTURBED	41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

LEGEND

- PROPERTY BOUNDARY
- BRL — BUILDING RESTRICTION LINE
- PROPOSED STRUCTURE
- EXISTING CONTOUR — 2 FT INTERVAL, NAVD88
- PROPOSED CONTOUR — 2 FT INTERVAL
- STREET CENTRELINE
- PROPOSED PAVEMENT — DRIVEWAY / WALK
- EASEMENT
- SANITARY LATERAL (SHC) — HEAVIEST
- WATER SERVICE (WHC)
- STORM DRAIN — TRUNK, RCP
- STORM — HOUSE CONNECTION TO TRUNK
- DRAINAGE SWALE — INVERT AND GRADED SECTION
- RETAINING WALL — TICKS ON THE RETAINED SIDE
- LIMIT OF GROUND COVER — TICKS ON THE STEEP SIDE
- 100-YR FLOODPLAIN LIMIT, EXISTING GROUND — FPS-770017, WSSC DATUM, UNTIED
- 100-YR FLOODPLAIN LIMIT, PROPOSED GROUND — SAME ELEVATION, REGRADED SURFACE
- ESD — STORMWATER PRACTICE

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE DATE

LICENSE NO. EXPIRATION DATE

SEAL

REVISIONS
— none —

FLOODPLAIN DELINEATION — EXISTING AND PROPOSED, 100-YEAR

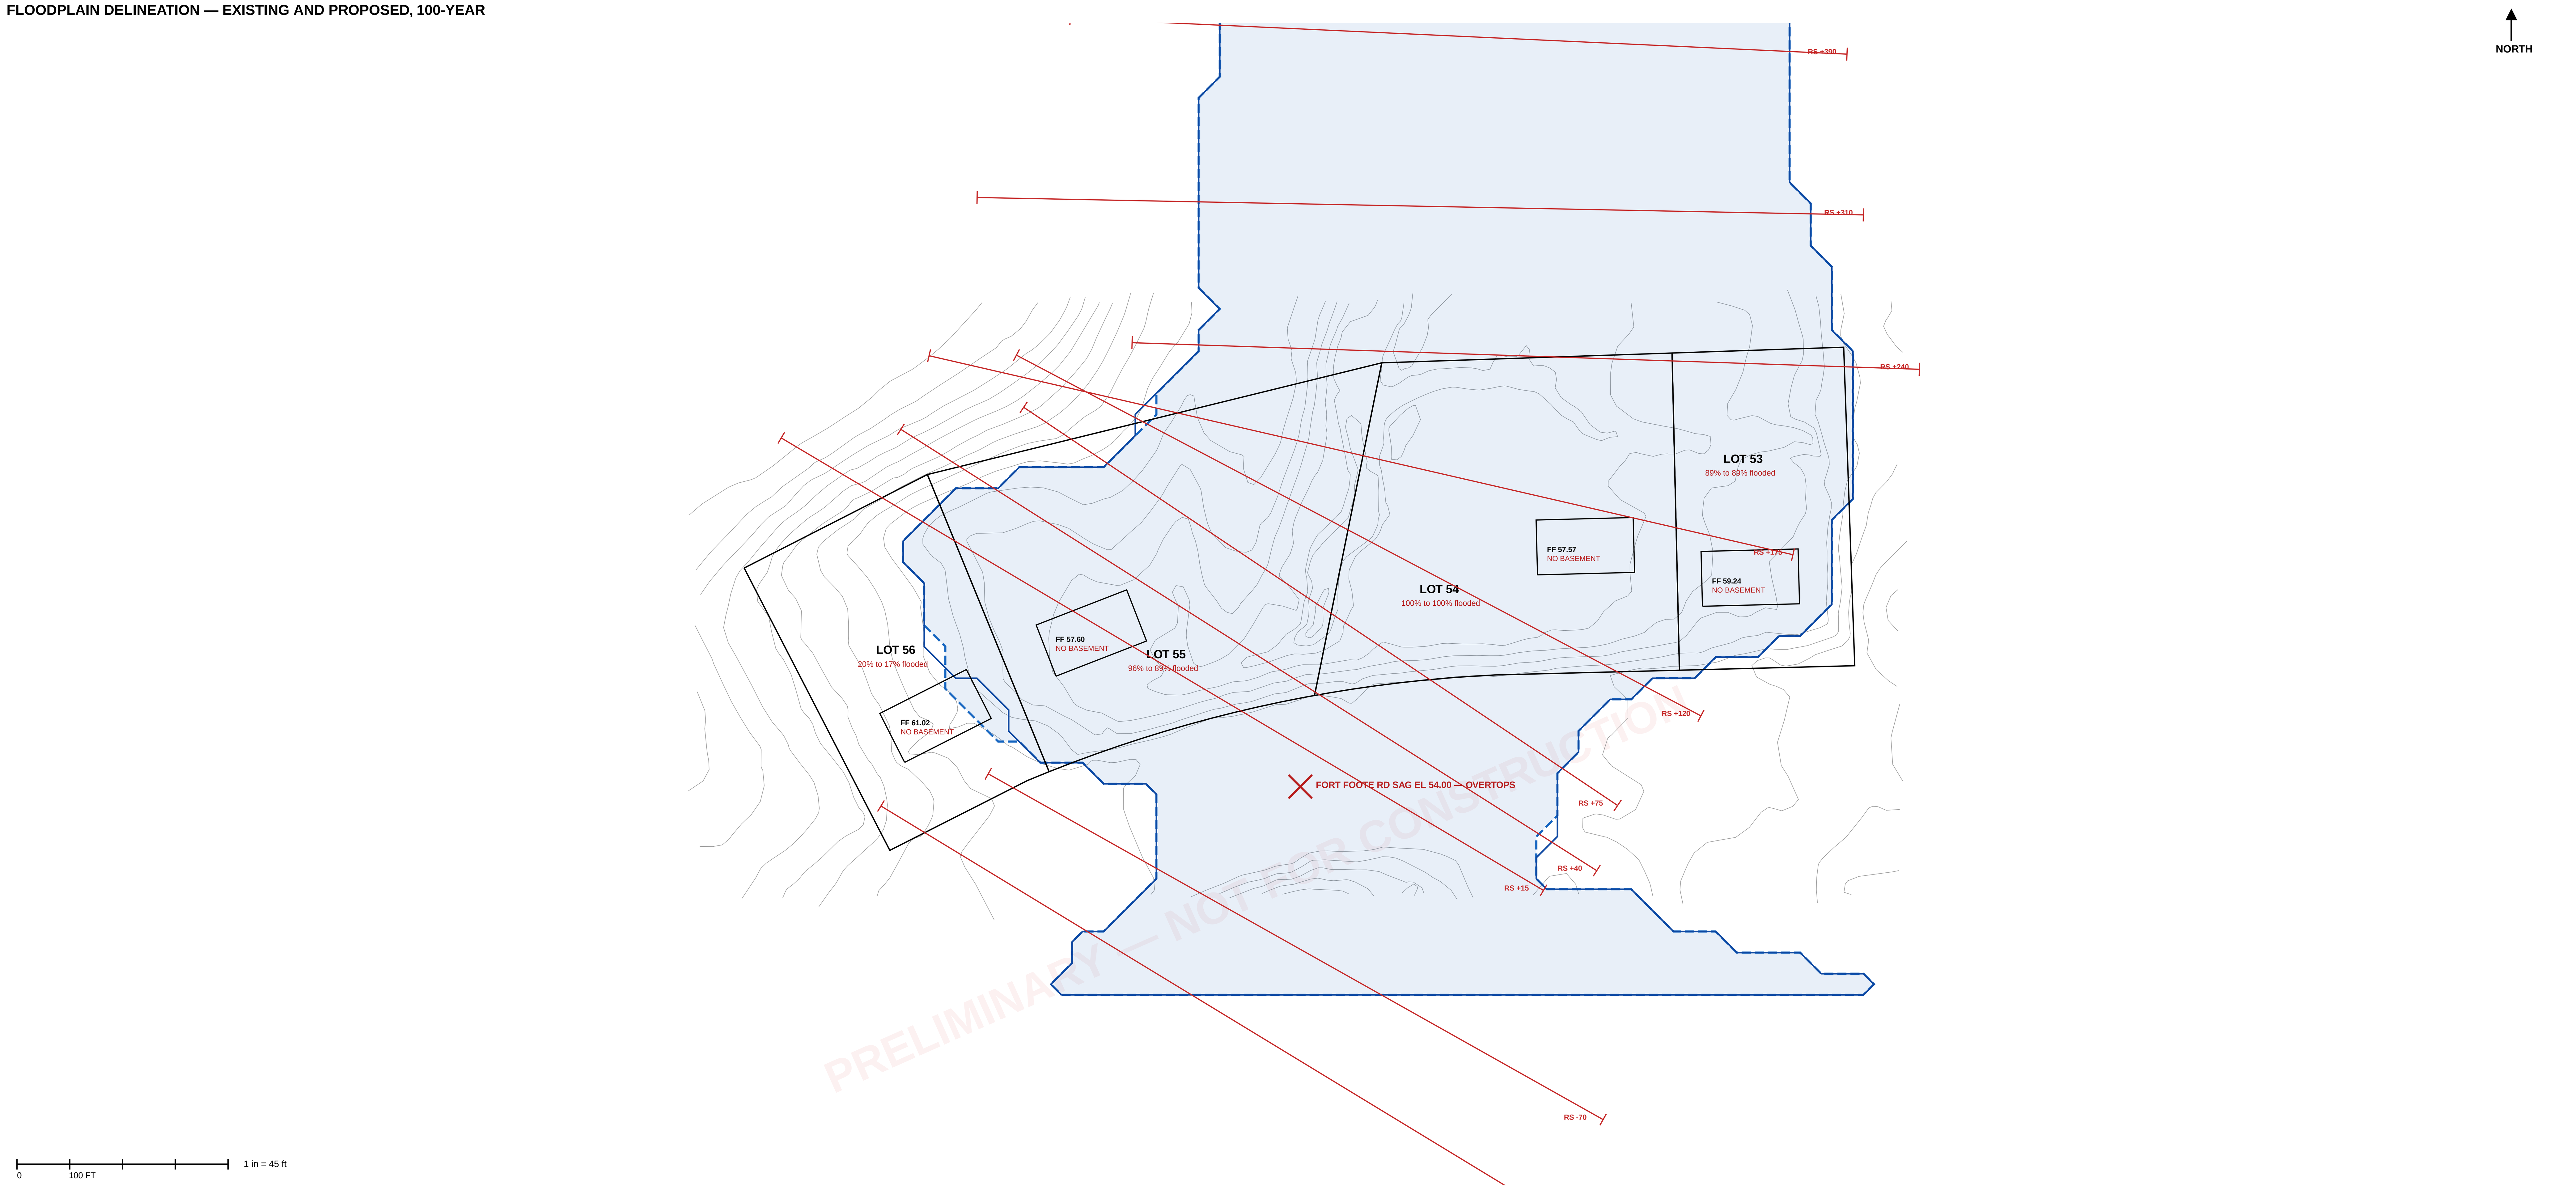

WATER-SURFACE PROFILE ALONG NORTH BRANCH BROAD CREEK

Station in feet from the Fort Foote Road sag; + is upstream

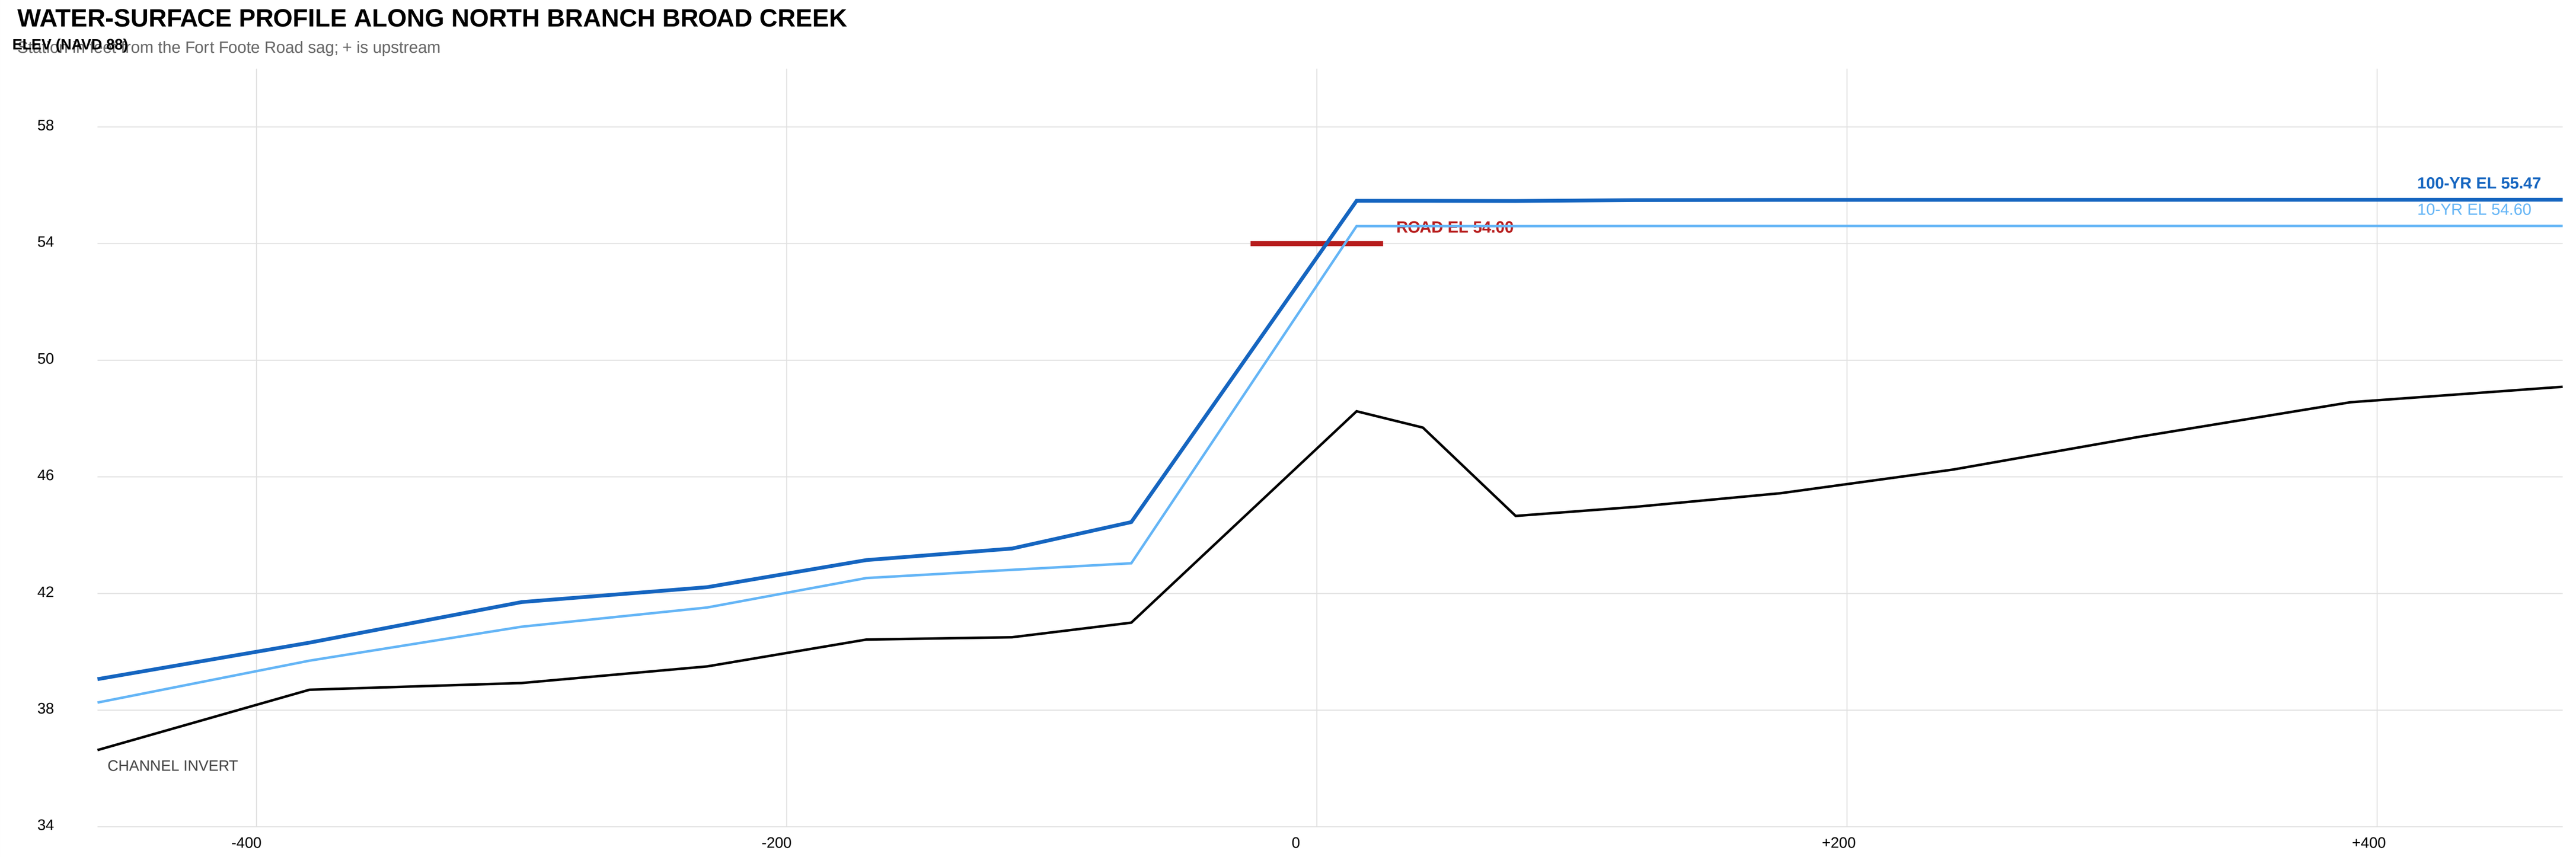

MODELLED CROSS SECTIONS — EXISTING AND PROPOSED

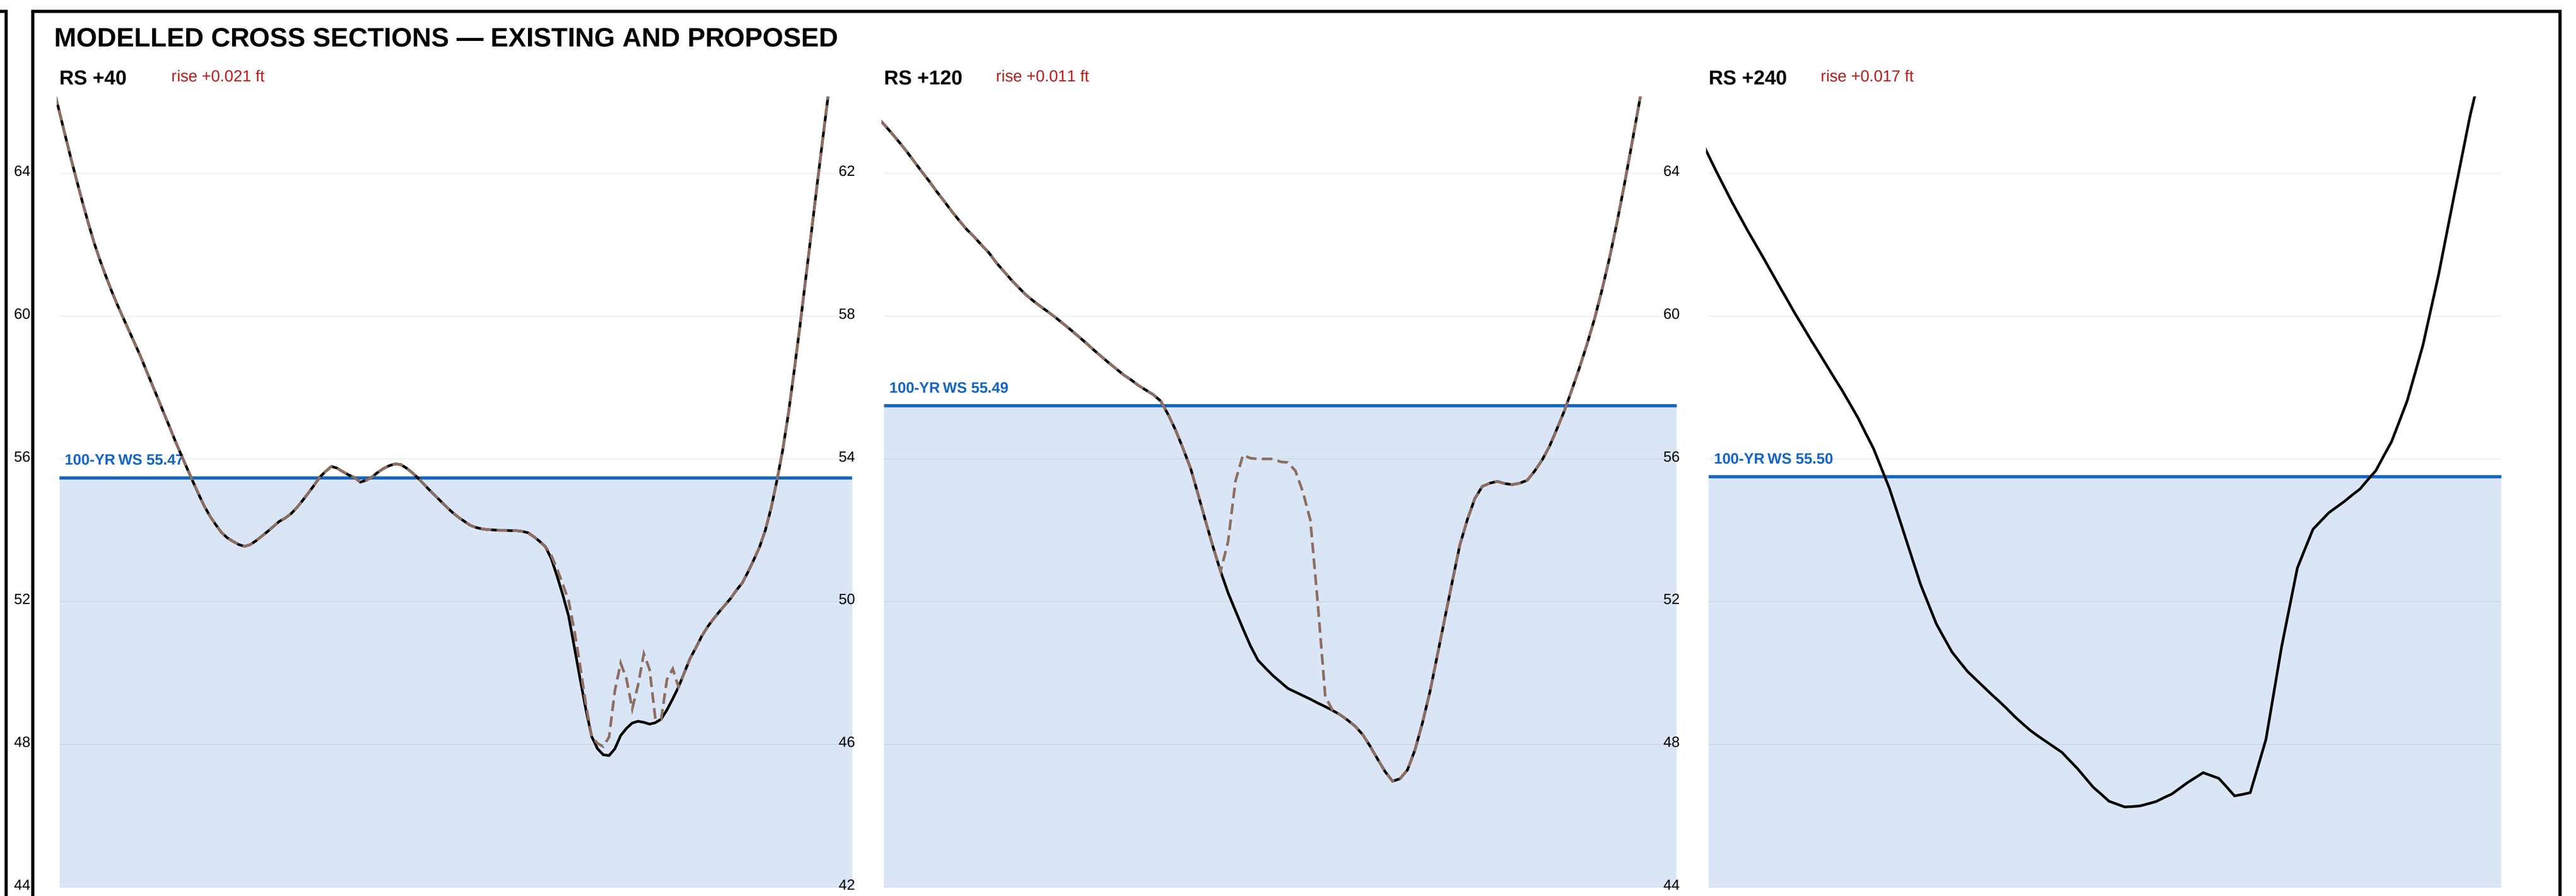

Solid = existing ground. Dashed brown = proposed grading. Shaded = 100-year water. Vertical exaggeration applies; stations in feet from the thalweg.

DESIGN DISCHARGES — NRCS TR-55, TYPE II

STORM	P24 (IN)	Q (IN)	qu	PEAK (CFS)
10-year	4.81	1.75	324	351
25-year	6.01	2.63	350	571
50-year	7.08	3.47	367	792
100-year	8.29	4.48	382	1,061
Area	397 ac	CN	68.0	Tc 0.86 hr
CULVERT AT Q100				
36 in	inlet	HW 55.45	HW/D 3.6	939 over rd
48 in	inlet	HW 55.36	HW/D 2.7	855 over rd
60 in	inlet	HW 55.26	HW/D 2.1	757 over rd
72 in	inlet	HW 55.13	HW/D 1.7	650 over rd
84 in	inlet	HW 55.00	HW/D 1.5	541 over rd
96 in	inlet	HW 54.87	HW/D 1.3	439 over rd

EXISTING vs PROPOSED WATER SURFACE — 100-YEAR

SECTION	EXISTING	PROPOSED	RISE (FT)	
RS +15	55.47	55.47	+0.000	
RS +40	55.47	55.49	+0.021	RISE
RS +75	55.46	55.49	+0.030	RISE
RS +120	55.49	55.50	+0.011	RISE
RS +175	55.50	55.51	+0.016	RISE
RS +240	55.50	55.52	+0.017	RISE
RS +310	55.50	55.52	+0.018	RISE
RS +390	55.50	55.52	+0.017	RISE
RS +470	55.51	55.52	+0.017	RISE
MAXIMUM			+0.030	NOT NO-RISE
Storage removed below the 100-yr surface			2,108 cy	
Total fill in the modelled reach			2,243 cy	
Compensatory storage			REQUIRED	

FLOODPLAIN ON THE LOTS, AND FREEBOARD — 100-YEAR

LOT	AREA (SF)	FLOODED EXIST	FLOODED PROP	FILL < FLOOD
LOT 53	12,500	11,100 (89%)	11,100 (89%)	18 cy
LOT 54	23,500	23,500 (100%)	23,500 (100%)	1,142 cy
LOT 55	25,600	24,500 (96%)	22,700 (89%)	932 cy
LOT 56	13,900	2,800 (20%)	2,400 (17%)	12 cy
LOWEST FLOOR CHECK AGAINST WS EL 55.52				
LOT	FIN FLOOR	FREEBOARD	BASEMENT	FOUNDATION
LOT 53	59.24	+3.72	none	slab
LOT 54	57.57	+2.05	none	slab
LOT 55	57.60	+2.08	none	slab
LOT 56	61.02	+5.50	none	slab

BASIS, METHOD AND LIMITATIONS

HYDROLOGY NRCS TR-55 graphical peak discharge, Type II distribution. Drainage area delineated by D8 routing on the USGS 3DEP bare-earth DEM. Curve number composited from the county 2023 impervious-surface and tree-canopy layers and the NRCS soil survey. Rainfall from NOAA Atlas 14 Vol. 2 Ver. 3, partial duration series, at 38.7611 N 77.0115 W.

HYDRAULICS One-dimensional steady gradually-varied flow, standard step, conveyance subdivided at the bank stations, average-conveyance friction slope. Crossing analysed to FHWA HDS-5 with both controls computed and the roadway treated as a broad-crested weir.

TERRAIN PGAtlas Contour 2 Ft (2023), NAVD 88, interpolated to a 10 ft grid. THIS IS NOT A FIELD SURVEY.

DATUM NAVD 88 = NGVD 29 - 0.66 ft here, from NGS marks HV4762, HV4763 and HV4728. On that basis the 57 ft WSSC of FPS-770017 is about EL 56.3 NAVD 88, against EL 55.47 computed. To be confirmed by levelling to benchmarks H31A, H32A and H32B on the field topographic survey.

NOT DONE No field survey. The existing culvert has never been measured and its size, inverts and entrance are assumed. HEC-RAS was not run and no HEC-RAS files exist. FPS 200546, the controlling study of record, has not been obtained. Upstream stormwater facilities were not inventoried. No floodway was delineated and none exists on current mapping. No unsteady or storage routing.

FLOODPLAIN OF RECORD FEMA FIRM panel 24033C0220E eff. 2016-09-16 maps these lots Zone X, outside the special flood hazard area, with no BFE and no floodway. That is a statement about FEMA mapping, not about flood risk. The county regulates this floodplain through the FPS series regardless.

EASEMENT The only platted floodplain easement in Indian Queen East (Plat 118-083, recorded 17 January 1984, 5.32 ac) lies entirely south of Fort Foote Road and covers none of Lots 53-56.

KEALEE

design, build, deliver

PROJECT
Indian Queen East — Lots 53, 54, 55 and 56

ADDRESS
9588 · 9584 · 9580 · 9576 Fort Foote Road

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

PLAT OF RECORD
Plat Book WWW 65, folio 60

SHEET
FP-101 — FLOODPLAIN STUDY AND DELINEATION, EXISTING AND PROPOSED

DISCIPLINE
Maryland Professional Engineer

HORIZONTAL DATUM
NAD 83, Maryland State Plane, US survey feet (EPSG:2248)

VERTICAL DATUM
NAVD 88

DATE
2026-09-11

STATUS
PRELIMINARY FEASIBILITY. NOT A SEALED FLOODPLAIN STUDY. No field survey. Culvert never measured. HEC-RAS not run. FPS 200546, the controlling study of record, not obtained. No professional engineer has reviewed or sealed this sheet.

PROFESSIONAL CERTIFICATION

Maryland P.E. No. ________ Date __________

KEY FINDINGS

Contributing drainage area	**397 ac (0.620 sq mi)**
Composite curve number	**68.0**
Time of concentration	**0.86 hr**
Q100 at the crossing	**1,061 cfs**
Fort Foote Road sag	**EL 54.00**
100-yr water surface, existing	**EL 55.47**
100-yr water surface, proposed	**EL 55.52**
Max rise, proposed vs existing	**+0.03 ft — NOT no-rise**
Flood storage removed by fill	**2,108 cy**
Road overtops at Q100	**956 cfs over the pavement**

LEGEND

- 100-yr floodplain limit, EXISTING
- 100-yr floodplain limit, PROPOSED
- Modelled cross section
- Lot boundary of record
- Existing contour (2 ft, county LiDAR)

COMPENSATORY STORAGE DESIGN — PLAN

Cells CS-53 to CS-56 excavated to EL 50.50; cell CS-E within the recorded 60 ft storm drain easement

NORTH

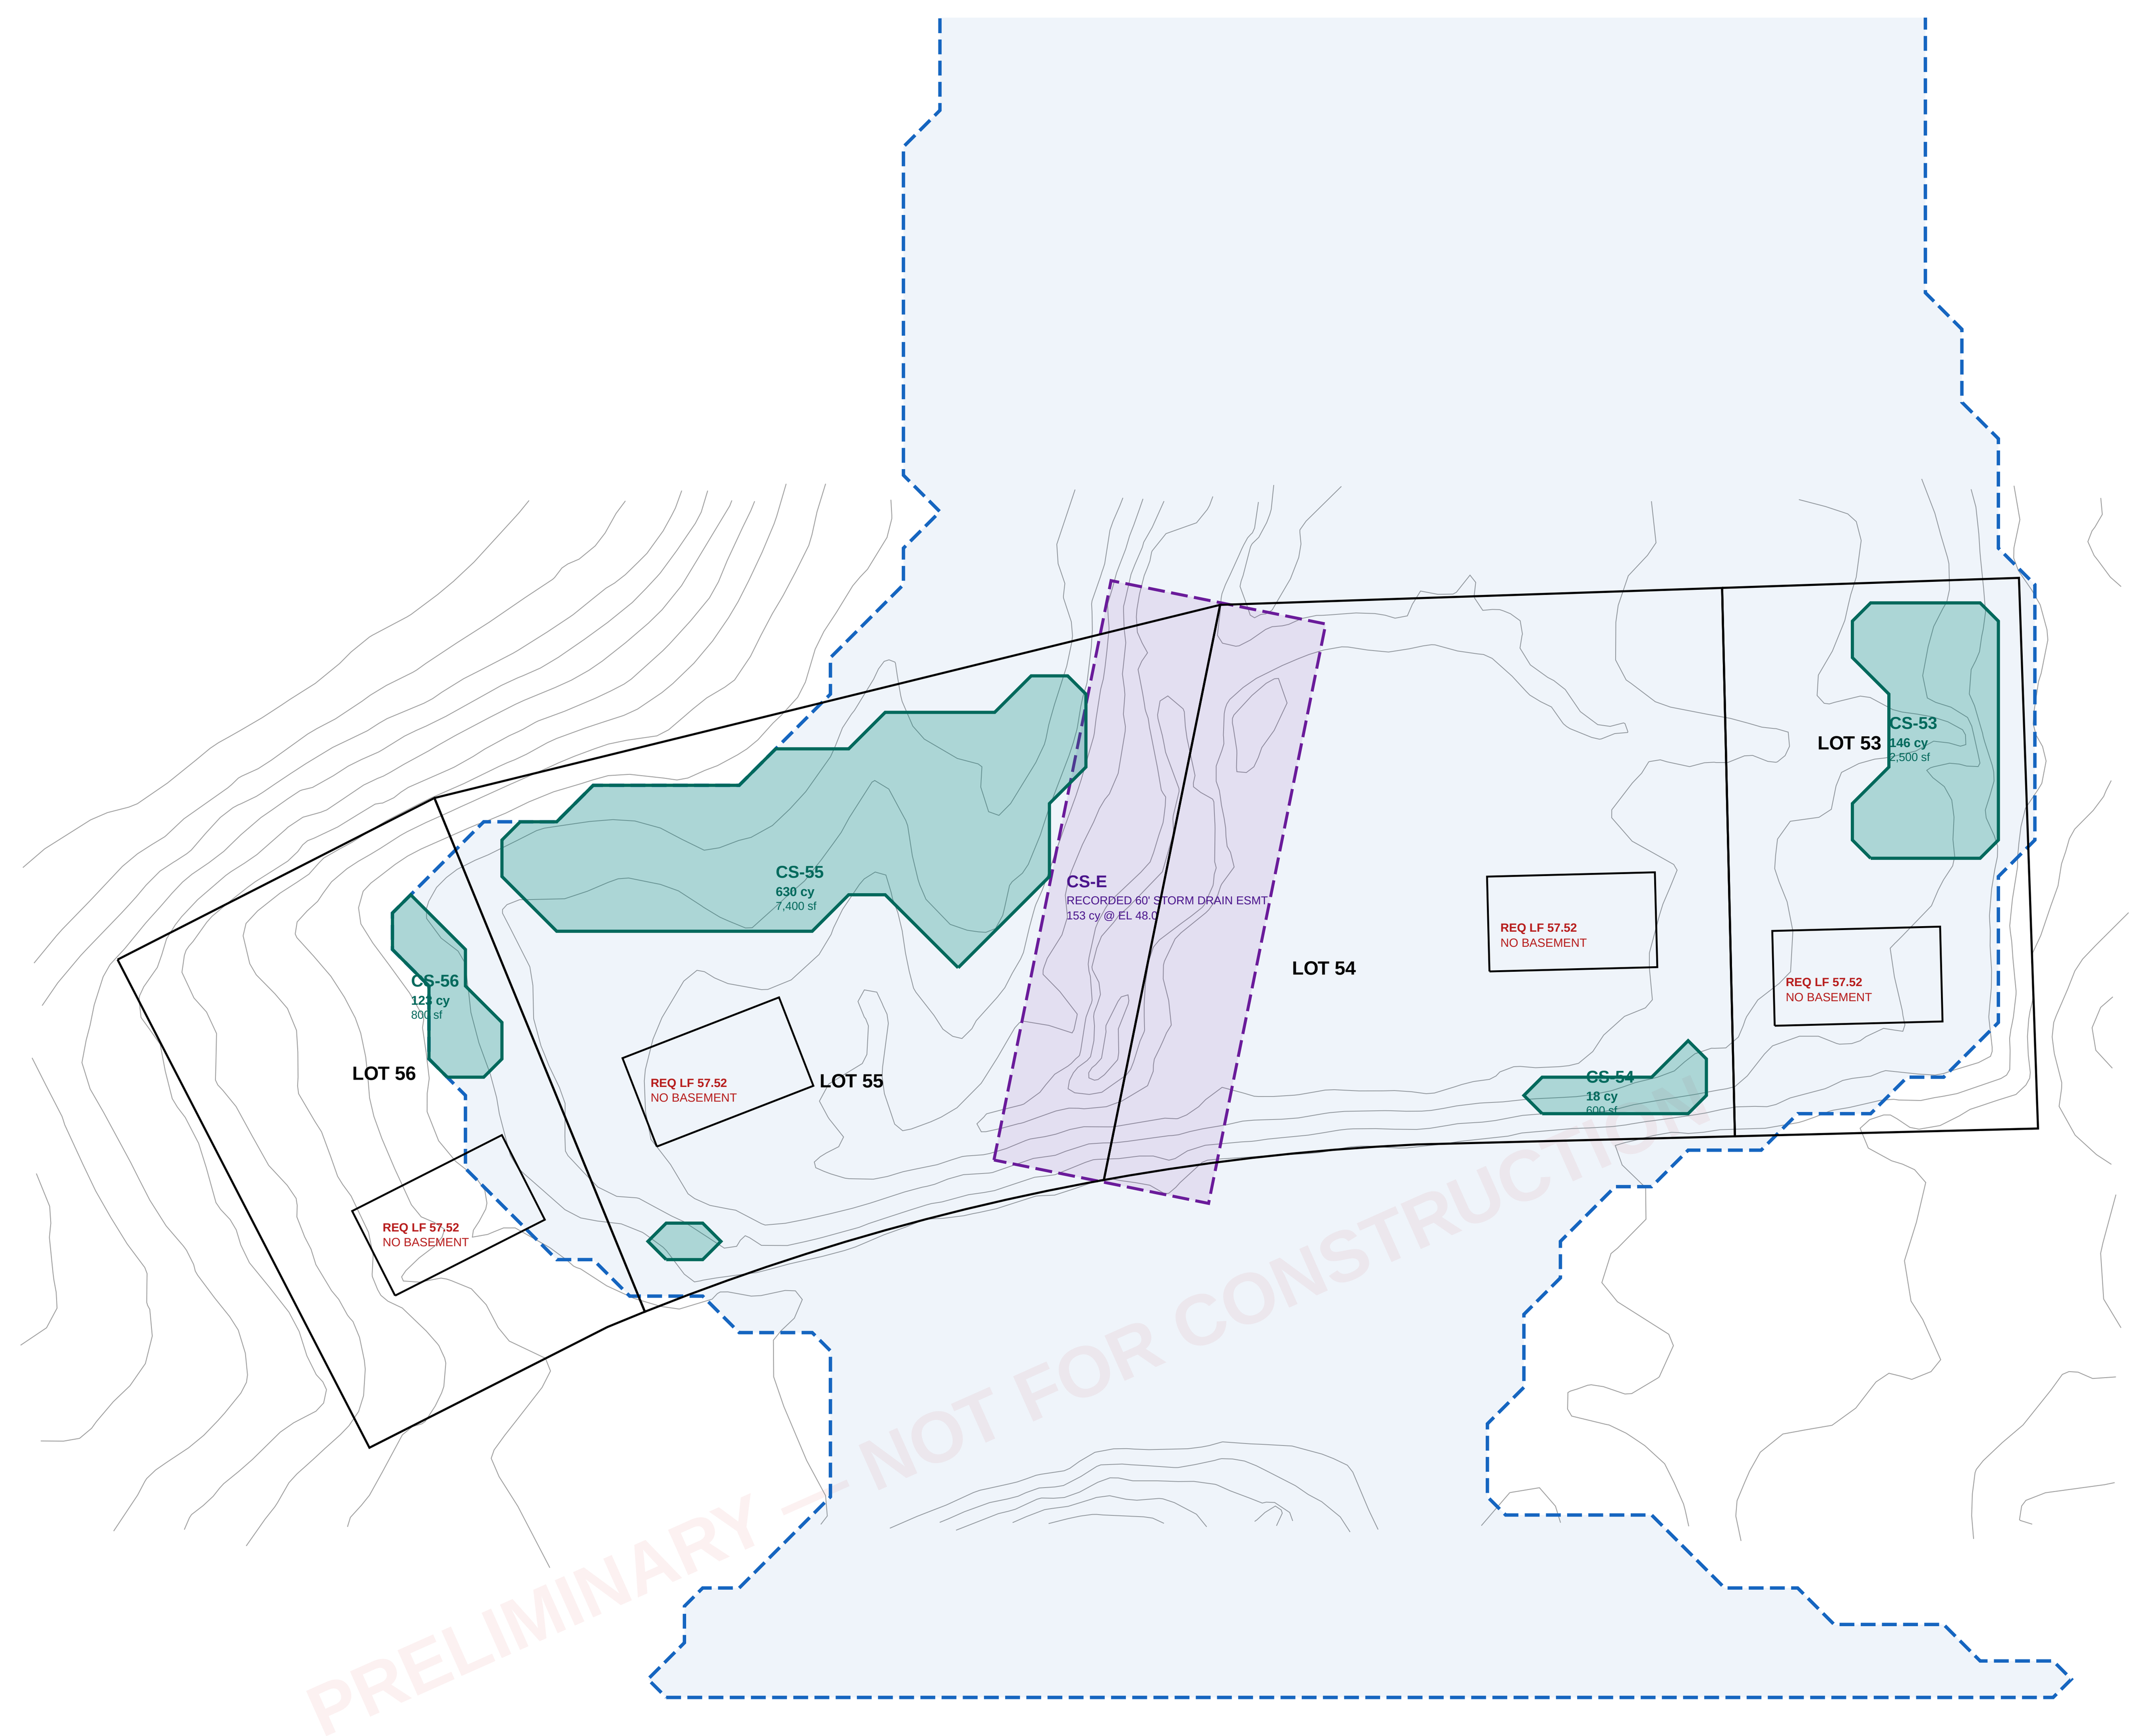

0 100 FT 1 in = 42 ft

RESERVOIR ROUTING — EXISTING CROSSING

STORM	INFLOW	OUTFLOW	ATTENUATED	PEAK STAGE
10-year	388 cfs	215 cfs	44.6%	EL 54.31
25-year	606 cfs	512 cfs	15.5%	EL 54.82
50-year	814 cfs	758 cfs	6.8%	EL 55.13
100-year	1,058 cfs	1,032 cfs	2.4%	EL 55.43

CROSSING ALTERNATIVES — DOWNSTREAM TRANSFER

OPTION	10-YR OUT	CHANGE	100-YR OUT	CHANGE
existing 36 in	215	+0	1,032	+0
48 in RCP	179	-36	1,023	-9
72 in RCP	275	+60	981	-52
twin 72 in RCP	333	+118	870	-162
8 x 6 ft box	307	+91	953	-80
10 x 8 ft box	347	+132	869	-163
twin 10 x 8 ft box	388	+173	974	-58
20 x 8 ft box (bridge-class)	388	+173	974	-58
twin 20 x 8 ft box	388	+173	1,058	+26

COMPENSATORY STORAGE SCHEDULE

CELL	LOT	AREA (SF)	MEAN DEPTH	VOLUME
CS-53	53	2,500	1.57 ft	146 cy
CS-54	54	600	0.79 ft	18 cy
CS-55	55	7,400	2.30 ft	630 cy
CS-56	56	800	4.16 ft	123 cy
CS-E	54/55	9,721	to EL 48.0	153 cy

PROVIDED	1,070 cy
REQUIRED by proposed grading	2,108 cy
DEFICIT	1,038 cy

FILL BELOW EL 55.53 — DISTRIBUTION

beneath dwelling footprints	835 cy
within 10 ft of a dwelling	759 cy
driveways, aprons, tie-out	1,324 cy

RESOLUTION: reduce fill. Vented stem-wall or pier foundations and driveways at existing grade bring the balance within the volume provided.

FLOODPLAIN REMOVAL AND FOUNDATION DETERMINATION

LOT	LOWEST GROUND	WS MUST FALL BELOW	REQUIRED DROP	ACHIEVABLE
LOT 53	EL 48.78	EL 48.78	6.69 ft	partial
LOT 54	EL 44.97	EL 44.97	10.50 ft	partial
LOT 55	EL 44.66	EL 44.66	10.81 ft	partial
LOT 56	EL 53.34	EL 53.34	2.13 ft	partial

Controlling tailwater lower bound: EL 44.45
The upstream water surface cannot be lowered below the downstream water surface.

LOWEST FLOOR DETERMINATION

LOT	PROPOSED FF	BASEMENT	REQ LOWEST FLOOR	STATUS
LOT 53	59.24	none	57.52	COMPLIES
LOT 54	57.57	none	57.52	COMPLIES
LOT 55	57.60	none	57.52	COMPLIES
LOT 56	61.02	none	57.52	COMPLIES

Basements are not permissible on any lot.
Vented stem-wall or pier foundations required on Lots 54 and 55 per ASCE 24 and 44 CFR 60.3.

KEALEE

design, build, deliver

PROJECT
Indian Queen East — Lots 53, 54, 55 and 56

ADDRESS
9588 · 9584 · 9580 · 9576 Fort Foote Road

JURISDICTION
Prince George's County, Maryland

SHEET
FP-102 — MITIGATION ANALYSIS AND COMPENSATORY STORAGE DESIGN

DISCIPLINE
Maryland Professional Engineer

VERTICAL DATUM
NAVD 88

DATE
2026-09-11

STATUS
PRELIMINARY FEASIBILITY. NOT A SEALED FLOODPLAIN STUDY. Quantities are for concept evaluation and are not construction quantities. No professional engineer has reviewed or sealed this sheet.

PROFESSIONAL CERTIFICATION

Maryland P.E. No. ________ Date __________

DETERMINATIONS

Removal of all lots from floodplain	**NOT ACHIEVABLE**
Controlling tailwater, lower bound	**EL 44.45**
Lowest ground, Lot 55	**EL 44.66**
Basements	**NOT PERMISSIBLE, ALL LOTS**
Required lowest floor	**EL 57.52**
Compensation required	**2,108 cy**
Compensation available on site	**1,070 cy**
Crossing enlargement	**NOT RECOMMENDED**

DESIGN CRITERIA — COMPENSATORY STORAGE

1 Excavation floor EL 50.50, above the invert of the receiving channel, so each cell drains by gravity.
2 Cells located within the existing-condition 100-year floodplain limit, being the area to be placed under floodplain easement.
3 Side slopes no steeper than 3:1, stabilised and mowable, no retaining structure.
4 Minimum 10 ft from every property line and 20 ft from every structure.
5 Positive hydraulic connection to the recorded storm drain easement corridor at the cell invert.
6 Volume provided at the same elevation increments from which it is taken; stage-by-stage comparison required at final design.