



KEALEE

Design, build, deliver

PROJECT
18405 EMORY ST
ADDRESS
18405 EMORY ST
JURISDICTION
Montgomery County, Maryland
ZONE
R-90
SHEET
C-100 — Existing Conditions and Boundary Plan
SCALE
1" = 30'
STATUS
PRELIMINARY
SHEET NO.
1 OF 3
COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PROFESSIONAL RESPONSIBILITY
Maryland Licensed Surveyor
certifies: boundary_determination, topographic_survey

SEAL AND SIGNATURE

All content on this sheet falls within one professional scope.

PLAN TYPE AND PREPARATION

PLANTYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-100 — Existing Conditions and Boundary Plan
DISCIPLINE	Maryland Licensed Surveyor
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

SITE DATA		
ZONE	R-90	
TAX / PARCEL ID	00005638	
GROSS TRACT AREA	9,589 SF	0.220 AC
LOT FRONTAGE	—	79.24'
SETBACKS	REQUIRED	PROVIDED
FRONT YARD	97.7'	97.7'
SIDE YARD	12.5'	12.5'
REAR YARD	25'	25'
COVERAGE	MAX	PROPOSED
LOT COVERAGE	30%	—
BUILDING FOOTPRINT	—	—
DATUM	EPSG:2248 NAD83	
HORIZONTAL	EPSG:2248	
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

- | | |
|-------------------------|------------------------------------|
| 1. Gross tract area | 9,589 SF |
| 2. Area of dwelling | NOT ESTABLISHED |
| 3. Wooded area | NOT ESTABLISHED |
| 4. Floodplain area | NOT ESTABLISHED |
| 5. Net lot area | 9,589 SF |
| 6. TOTAL AREA DISTURBED | 50 SF (AT LEAST) |
| 7. SWM REVIEW | CONFIRM WITH MONTGOMERY COUNTY DPS |

DRAINAGE AREA COMPUTATIONS

CATCHMENT	SF	ACRES	C
Total — 0.0% impervious	9,589	0.220	C
PRE-DEVELOPMENT	SF		C
Pervious — lawn / meadow	9,589		0.25
Composite C			0.250
POST-DEVELOPMENT	SF		C
Pervious — lawn	9,589		0.25
Composite C			0.250
Flow path			199 ft
Flow path slope			2.0 %
Time of concentration (Kirpich)			5.0 min
Rainfall intensity, 10-yr			6.55 in/hr
Peak discharge PRE, Q = CIA			0.36 cfs
Peak discharge POST, Q = CIA			0.36 cfs
INCREASE TO BE MANAGED			0.00 cfs
Rv = 0.05 + 0.0091			0.0500
Water quality volume WQv			40 cf

Time of concentration by Kirpich over a 199 ft flow path at 2.0%, taken from the 2 ft contours across the catchment. A 5-minute floor applies.
Rainfall intensity 6.55 in/hr for the 10-year storm at a 5.0 minute duration, NOAA Atlas 14 Vol. 2, ver. 3, PFD5 point estimate, 39.1562 N 77.1584 W.
Water quality volume on a 1.0 in rainfall, Maryland Stormwater Design Manual, Vol. 1 & 2 — WQv on a 1.0 in rainfall.
Runoff coefficients: roof and pavement 0.95, average lawn 0.25. Confirm the lawn coefficient against the soil hydrologic group before relying on the composite.
Sidewalk, curb and gutter and the driveway apron lie in the public right-of-way and drain to the street. They are excluded from the lot catchment and included in the disturbed area.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting
2. Obtain necessary permits
3. Notify Miss Utility at \$11 at least 48 hours prior to any excavation
4. Install stabilized construction entrance and perimeter sediment control
5. Rough grade the lot
6. Construct dwelling
7. Install water, sewer and storm services and the driveway
8. Fine grade and stabilize all disturbed areas
9. Remove sediment control once the inspector gives written permission

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT \$11 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION, FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. EXISTING UTILITIES ARE SHOWN FROM PUBLIC RECORD AND ARE APPROXIMATE. LOCATION AND DEPTH SHALL BE FIELD-VERIFIED BY TEST PIT BEFORE CONSTRUCTION.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS COMPILED JURISDICTION GIS, NOT A BOUNDARY SURVEY.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION. GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER MCDOT STANDARD. ON-LOT DRAINAGE IS COLLECTED BY THE REAR YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

MONTGOMERY COUNTY DPS — ZONING AND SITE PLAN REVIEW

SIGNATURE DATE

MONTGOMERY COUNTY DPS — SEDIMENT CONTROL / STORMWATER

SIGNATURE DATE

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE	DATE
SEAL	EXPIRATION DATE
LICENSE NO.	

REVISIONS

— NONE —

SOILS TABLE

USDA NRCS SSURGO — survey area MD031, Montgomery County

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
100	Dumps, refuse	—	No	—	—
109D	Hyattstown channery silt loam, 15 to 25 percent slopes, very	.49	No	D	Well drained
109E	Hyattstown channery silt loam, 25 to 45 percent slopes, very	.49	No	D	Well drained
116C	Blocktown channery silt loam, 8 to 15 percent slopes, very	.49	No	D	Well drained
116D	Blocktown channery silt loam, 15 to 25 percent slopes, very	.49	No	D	Well drained
116E	Blocktown channery silt loam, 25 to 45 percent slopes, very	.49	No	D	Well drained
168	Blocktown channery silt loams, 3 to 8 percent slopes	.43	No	C	Well drained

SOURCE AND ACCURACY
Parcel boundary — Jurisdiction gis — M-NCPPC Montgomery Planning — parcels (SDAT) — Lot P2, Block 13, ...
Existing contours — M-NCPPC Montgomery Planning — backgrounds/Contours_28/MapServer/1 — Contours (...)

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET



KEALEE

Design, build, deliver

PROJECT
18405 EMORY ST
ADDRESS
18405 EMORY ST
JURISDICTION
Montgomery County, Maryland
ZONE
R-90
SHEET
C-400 — Grading and Drainage Plan
SCALE
1" = 30'
STATUS
PRELIMINARY
SHEET NO.
2 OF 3
COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)
PROFESSIONAL RESPONSIBILITY
Maryland Professional Engineer
certifies: grading_design, stormwater_design

SEAL AND SIGNATURE

All content on this sheet falls within one professional scope.

PLAN TYPE AND PREPARATION

PLANTYPE SITE DEVELOPMENT / FINE GRADING
SHEET C-400 — Grading and Drainage Plan
DISCIPLINE Maryland Professional Engineer
DRAWN BY KEALEE SITE-PLAN ENGINE
DESIGNED BY
CHECKED BY

REVISIONS

NO.	DATE	DESCRIPTION

SITE DATA

ZONE	R-90	
TAX / PARCEL ID	00005638	
GROSS TRACT AREA	9,589 SF	0.220 AC
LOT FRONTAGE	—	79.24'
SETBACKS	REQUIRED	PROVIDED
FRONT YARD	97.7'	97.7'
SIDE YARD	12.5'	12.5'
REAR YARD	25'	25'
COVERAGE	MAX	PROPOSED
LOT COVERAGE	30%	—
BUILDING FOOTPRINT	—	—
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	9,589 SF
2. Area of dwelling	NOT ESTABLISHED
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	9,589 SF
6. TOTAL AREA DISTURBED	50 SF (AT LEAST)
7. SWM REVIEW	CONFIRM WITH MONTGOMERY COUNTY DPS

DRAINAGE AREA COMPUTATIONS

CATCHMENT	SF	ACRES	C
Total — 0.0% impervious	9,589	0.220	C
PRE-DEVELOPMENT	SF		C
Pervious — lawn / meadow	9,589		0.25
Composite C			0.250
POST-DEVELOPMENT	SF		C
Pervious — lawn	9,589		0.25
Composite C			0.250
Flow path			199 ft
Flow path slope			2.0 %
Time of concentration (Kirpich)			5.0 min
Rainfall intensity, 10-yr			6.55 in/hr
Peak discharge PRE, Q = CIA			0.36 cfs
Peak discharge POST, Q = CIA			0.36 cfs
INCREASE TO BE MANAGED			0.00 cfs
Rv = 0.05 + 0.0091			0.0500
Water quality volume Wqv			40 cf

Time of concentration by Kirpich over a 199 ft flow path at 2.0%, taken from the 2 ft contours across the catchment. A 5-minute floor applies.
Rainfall intensity 6.55 in/hr for the 10-year storm at a 5.0 minute duration, NOAA Atlas 14 Vol. 2, ver. 3, PPDS point estimate, 39.1562 N 77.1584 W.
Water quality volume on a 1.0 in rainfall, Maryland Stormwater Design Manual, Vol. 1 & 2 — WQv on a 1.0 in rainfall.
Runoff coefficients: roof and pavement 0.95, average lawn 0.25. Confirm the lawn coefficient against the soil hydrologic group before relying on the composite.
Sidewalk, curb and gutter and the driveway apron lie in the public right-of-way and drain to the street. They are excluded from the lot catchment and included in the disturbed area.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	1 DAY
2. Obtain necessary permits	2 DAYS
3. Notify Miss Utility at \$11 at least 48 hours prior to any excavation	1 DAY
4. Install stabilized construction entrance and perimeter sediment control	2 DAYS
5. Rough grade the lot	5 DAYS
6. Construct dwelling	6 MONTHS
7. Install water, sewer and storm services and the driveway	10 DAYS
8. Fine grade and stabilize all disturbed areas	5 DAYS
9. Remove sediment control once the inspector gives written permission	1 DAY

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

- CONTRACTOR SHALL CONTACT MISS UTILITY AT \$11 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION, FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
- EXISTING UTILITIES ARE SHOWN FROM PUBLIC RECORD AND ARE APPROXIMATE. LOCATION AND DEPTH SHALL BE FIELD-VERIFIED BY TEST PIT BEFORE CONSTRUCTION.
- PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
- ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
- BOUNDARY SHOWN IS COMPILED JURISDICTION GIS, NOT A BOUNDARY SURVEY.
- CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
- NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION. GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER MCDOT STANDARD. ON-LOT DRAINAGE IS COLLECTED BY THE REAR YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

MONTGOMERY COUNTY DPS — ZONING AND SITE PLAN REVIEW

SIGNATURE	DATE

MONTGOMERY COUNTY DPS — SEDIMENT CONTROL / STORMWATER

SIGNATURE	DATE

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE	DATE
SEAL	LICENSE NO.
REVISIONS	EXPIRATION DATE
— NONE —	


SOILS TABLE

USDA NRCS SSURGO — survey area MD031, Montgomery County

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
100	Dumps, refuse	—	No	—	—
109D	Hyattstown channery silt loam, 15 to 25 percent slopes, very	.49	No	D	Well drained
109E	Hyattstown channery silt loam, 25 to 45 percent slopes, very	.49	No	D	Well drained
116C	Blocktown channery silt loam, 8 to 15 percent slopes, very	.49	No	D	Well drained
116D	Blocktown channery silt loam, 15 to 25 percent slopes, very	.49	No	D	Well drained
116E	Blocktown channery silt loam, 25 to 45 percent slopes, very	.49	No	D	Well drained
168	Blocktown channery silt loams, 3 to 8 percent slopes	.43	No	C	Well drained

SOURCE AND ACCURACY
Parcel boundary — Jurisdiction gis — M-NCPPC Montgomery Planning — parcels (SDAT) — Lot P2, Block 13, ...
Existing contours — M-NCPPC Montgomery Planning — backgrounds/Contours_28/MapServer/1 — Contours (...)

GRAPHIC SCALE — 1" = 30'





KEALEE

Design, build, deliver

PROJECT
18405 EMORY ST
ADDRESS
18405 EMORY ST
JURISDICTION
Montgomery County, Maryland
ZONE
R-90
SHEET
L-100 — Landscape and Tree Canopy Plan
SCALE
1" = 30'
STATUS
PRELIMINARY
SHEET NO.
3 OF 3
COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PROFESSIONAL RESPONSIBILITY
Qualified Environmental Professional
certifies: tree_conservation

SEAL AND SIGNATURE

All content on this sheet falls within one professional scope.

PLAN TYPE AND PREPARATION

PLANT TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	L-100 — Landscape and Tree Canopy Plan
DISCIPLINE	Landscape Architect / Qualified Professional
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

SITE DATA

ZONE	R-90	
TAX / PARCEL ID	00005638	
GROSS TRACT AREA	9,589 SF	0.220 AC
LOT FRONTAGE	—	79.24'
SETBACKS	REQUIRED	PROVIDED
FRONT YARD	97.7'	97.7'
SIDE YARD	12.5'	12.5'
REAR YARD	25'	25'
COVERAGE	MAX	PROPOSED
LOT COVERAGE	30%	—
BUILDING FOOTPRINT	—	—
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	9,589 SF
2. Area of dwelling	NOT ESTABLISHED
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	9,589 SF
6. TOTAL AREA DISTURBED	50 SF (AT LEAST)
7. SWM REVIEW	CONFIRM WITH MONTGOMERY COUNTY DPS

DRAINAGE AREA COMPUTATIONS

CATCHMENT	SF	ACRES	C
Total — 0.0% impervious	9,589	0.220	
PRE-DEVELOPMENT	SF		C
Pervious — lawn / meadow	9,589		0.25
Composite C			0.250
POST-DEVELOPMENT	SF		C
Pervious — lawn	9,589		0.25
Composite C			0.250
Flow path			199 ft
Flow path slope			2.0 %
Time of concentration (Kirpich)			5.0 min
Rainfall intensity, 30-yr			6.55 in/hr
Peak discharge PRE, Q = CIA			0.36 cfs
Peak discharge POST, Q = CIA			0.36 cfs
INCREASE TO BE MANAGED			0.00 cfs
Rv = 0.05 + 0.0091			0.0500
Water quality volume WQv			40 cf

Time of concentration by Kirpich over a 199 ft flow path at 2.0%, taken from the 2 ft contours across the catchment. A 5-minute floor applies.
Rainfall intensity 6.55 in/hr for the 30-year storm at a 5.0 minute duration, NOAA Atlas 14 Vol. 2, ver. 3, PPDS point estimate, 39.1562 N 77.1584 W.
Water quality volume on a 1.0 in rainfall, Maryland Stormwater Design Manual, Vol. 1 & 2 — WQv on a 1.0 in rainfall.
Runoff coefficients: roof and pavement 0.95, average lawn 0.25. Confirm the lawn coefficient against the soil hydrologic group before relying on the composite.
Sidewalk, curb and gutter and the driveway apron lie in the public right-of-way and drain to the street. They are excluded from the lot catchment and included in the disturbed area.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	1 DAY
2. Obtain necessary permits	2 DAYS
3. Notify Miss Utility at S11 at least 48 hours prior to any excavation	1 DAY
4. Install stabilized construction entrance and perimeter sediment control	2 DAYS
5. Rough grade the lot	5 DAYS
6. Construct dwelling	6 MONTHS
7. Install water, sewer and storm services and the driveway	10 DAYS
8. Fine grade and stabilize all disturbed areas	5 DAYS
9. Remove sediment control once the inspector gives written permission	1 DAY
TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS	

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT S11 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION, FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. EXISTING UTILITIES ARE SHOWN FROM PUBLIC RECORD AND ARE APPROXIMATE. LOCATION AND DEPTH SHALL BE FIELD-VERIFIED BY TEST PIT BEFORE CONSTRUCTION.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS COMPILED JURISDICTION GIS, NOT A BOUNDARY SURVEY.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION. GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER MCDOT STANDARD. ON-LOT DRAINAGE IS COLLECTED BY THE REAR YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

MONTGOMERY COUNTY DPS — ZONING AND SITE PLAN REVIEW

SIGNATURE	DATE

MONTGOMERY COUNTY DPS — SEDIMENT CONTROL / STORMWATER

SIGNATURE	DATE


PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE	DATE
SEAL	EXPIRATION DATE
LICENSE NO.	

REVISIONS

— NONE —

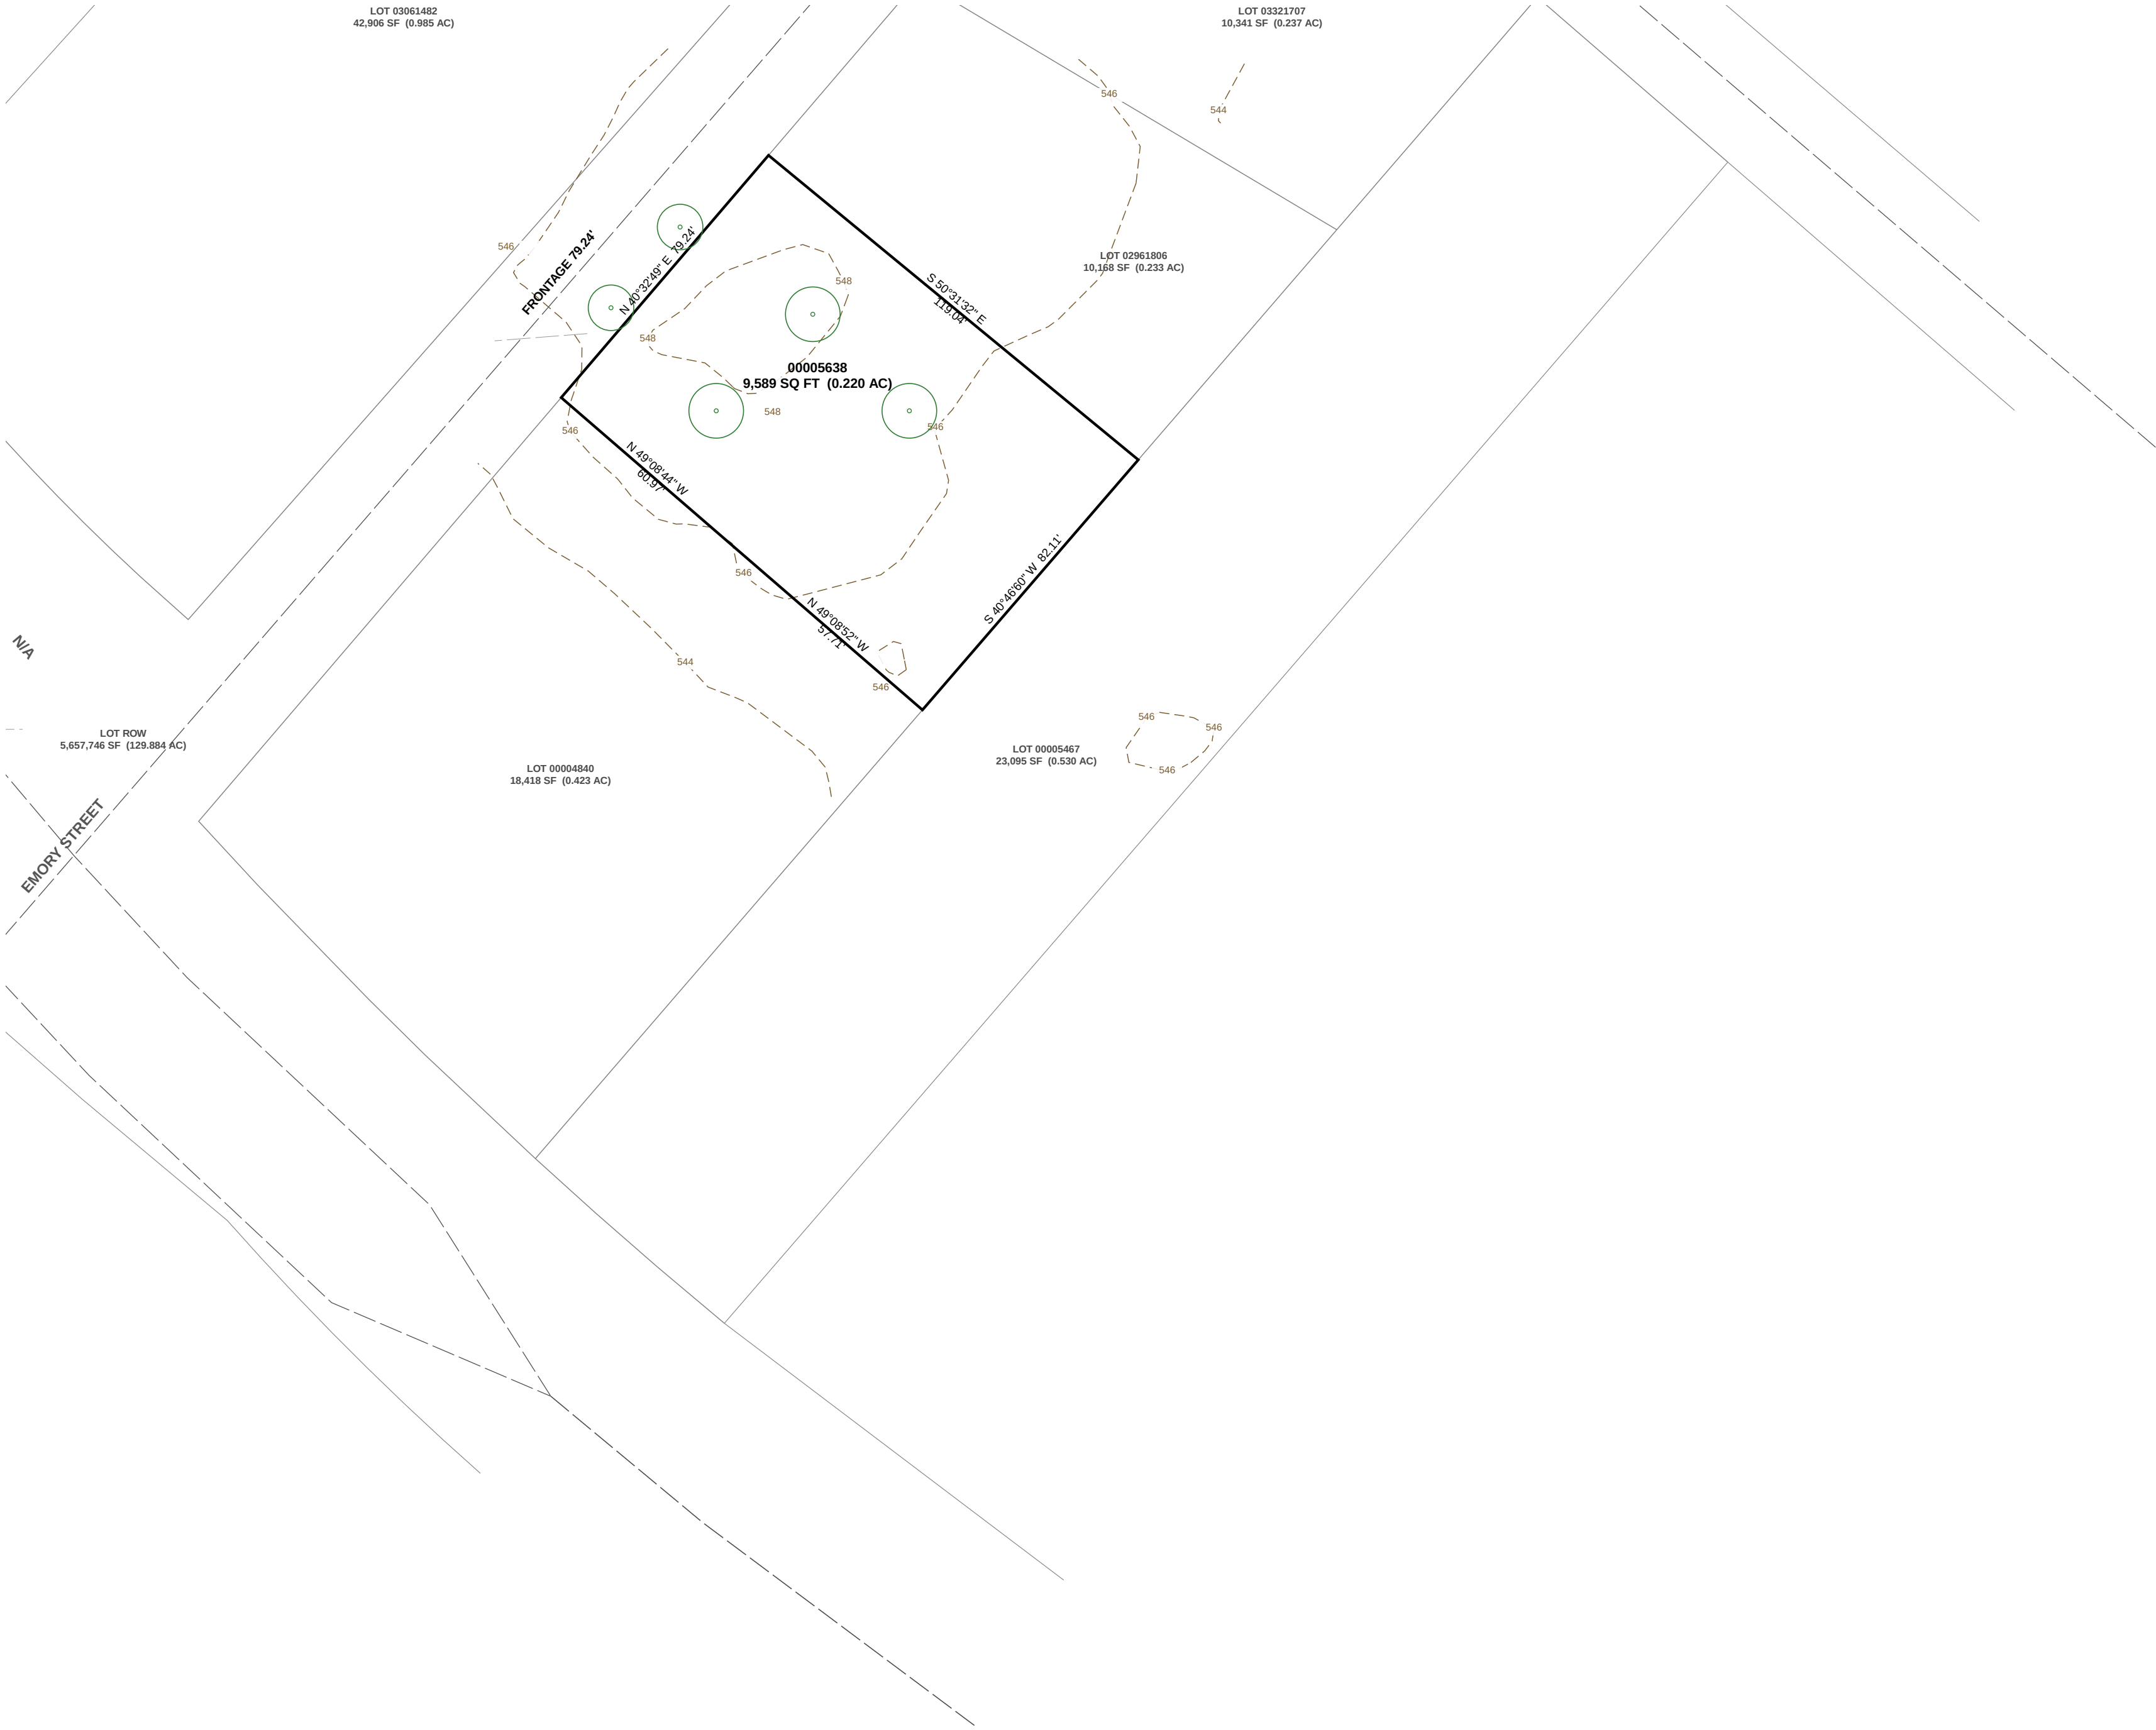

SOURCE AND ACCURACY
Parcel boundary — Jurisdiction gis — M-NCPPC Montgomery Planning — parcels (SDAT) — Lot P2, Block 13...
Existing contours — M-NCPPC Montgomery Planning — backgrounds/Contours_28/MapServer/1 — Contours (...)

GRAPHIC SCALE — 1" = 30'

