

SITE DEVELOPMENT CONCEPT PLAN

ESTATES AT INDIAN HEAD — LOTS 1-6 AND ESTATES COURT

Plat Book PM 228 Plat 83 · 200-205 Estates Court, Accokeek, MD 20607 · Tax Map 151 Grid F-3 · Zone RR · Piscataway Election District 5 · Prince George's County, Maryland

Stormwater management by Environmental Site Design to the Maximum Extent Practicable (MDE Design Manual Ch. 5: PGC Subtitle 32, Div. 3). Follows the approved 2009 layout (Street Tree & Lighting Plan, DPW&T permit 9399-2009-00).

PRINCE GEORGE'S COUNTY BMP SUMMARY TABLE (ESD broken out by Point of Investigation — checklist A-15, C-9)

BMP	PRACTICE (HSG)	LOCATION / OWNERSHIP	POI	DA (SF)	BMP (SF)	% I	P E (IN)	Rv	ESDv REQ (CF)	ESDv PRDV (CF)	Rvw REQ (CF)	SURFACE (SF)	N (NAD83)	E (NAD83)
ESD-1	Micro bio-retention (M-4)	Lot 1 (200 Estates Ct), private	POI-1	19,899	3,362	16.8	1.0	0.201	336	420	44	525	367,419	1,311,149
ESD-2	Micro bio-retention (M-4)	Lot 2 (202 Estates Ct), private	POI-1	20,015	3,315	16.6	1.0	0.199	332	332	43	330	367,398	1,311,251
ESD-3	Micro bio-retention (M-4)	Lot 3 (204 Estates Ct), private	POI-1	20,051	3,537	17.6	1.0	0.209	349	349	45	388	367,381	1,311,390
ESD-4	Micro bio-retention (M-4)	Lot 4 (205 Estates Ct), private	POI-1	20,021	2,558	12.8	1.0	0.165	275	275	36	298	367,219	1,311,301
ESD-5	Micro bio-retention (M-4)	Lot 5 (203 Estates Ct), private	POI-1	20,235	3,441	17.0	1.0	0.203	342	342	45	340	367,175	1,311,173
ESD-6	Micro bio-retention (M-4)	Lot 6 (201 Estates Ct), private	POI-1	29,536	3,257	11.0	1.0	0.149	367	367	48	376	367,084	1,310,952
ESD-S1	Dry swale (M-8) w/ check dams — street	Estates Ct RW, north roadside (public, DPE)	POI-1	18,020	9,180	50.9	1.8	0.508	1,374	1,374	99	4,601	367,401	1,311,069
ESD-S2	Dry swale (M-8) w/ check dams — street	Estates Ct RW, south roadside (public, DPE)	POI-1	18,020	9,180	50.9	1.8	0.508	1,374	1,374	99	8,017	367,334	1,311,116
SUBTOTAL POI-1			POI-1	165,898	37,831				4,750	4,835	459			
TOTAL 8 ESD practices			ESDv provided as required at every POI			165,898	37,831	22.8		4,750	4,835	459	14,876	

P, E from MDE Design Manual Table 5.3, HSG C (governing on site). Rv = 0.05 + (0.0091). ESDv = P, E-Rv-A12. Rev = 5-Rv-A12, 5 = 0.13 in (HSG C); Rev is met within ESDv (percent-volume method). Micro bio-retention: 12 in max. ponding, 2.5 ft filter media (n = 0.40), underdrain to stable outfall; infiltration credit only where the Sec. 32-131 soil borings show ≥ 0.52 in/hr.

SITE DATA (DPEI Concept Application, rev. 07/28/2021)

APPLICATION DATA	
Project name	Estates at Indian Head, Lots 1-6
Geographic location	S. side of MD 210 (Indian Head Hwy), ±3,000 ft NE of MD 210 / MD 373 (Livingston Rd)
Street address	200, 201, 202, 203, 204, 205 Estates Court, Accokeek, MD 20607
Companion cases	NR1-015-06, TCPI-018-06, TCP2-016-09 (current); final plat S-08238 (PM 228 @ 83); DPW&T 9399-2009-00 street tree & lighting
Lots / area	6 lots + public RW: 165,902 sf (3,809 ac) computed, 165,013 sf of record (plat 171,505 sf less Outlet A)
Tax accounts	3987666, 3987674, 3987682, 3987690, 3987708, 3987716
Tax map / WSSC 200'	151 F-3 / 220501
Master plan	2013 Approved Subregion 5 Master Plan & SMA (CR 8081-2013); Planning Area 84, Piscataway & Vicinity
Master plan road	MD 210 Indian Head Highway (Frontage, SHA) — access by Estates Court only
Council / election district	District 9 / District 5 (Piscataway)
Municipality	None (unincorporated) — PGAtlas Administrative/30
Historic site / scenic road	None / None; Mount Vernon Viewshed Area of Primary Concern covers the site
Zone (current / proposed)	RR / RR (no change) — Sec. 27-4202: 20,000 sf min., 25' front, 8' side, 20' rear, 25% max. coverage
MD 12-digit watershed	021402030798 — Piscataway Creek (MD 8-digit 02140203); County watershed: Piscataway Creek
Impaired / TMDL	Chesapeake Bay TMDL (N, P, sediment) applies; Piscataway Creek listings to be confirmed on MDE TMDL data center at submission
Tier II / hotspot	No (no MDE Tier II catchment intersect) / No (single-family residential)
Ex. site imp. area	0 sf (vacant, wooded; DEVELOPED = N on all six accounts)
New site imp. area	37,831 sf (22.8% of tract) — roofs, driveways, walks, Estates Court pavement, curb and sidewalk
Est. disturbed area	70,787 sf (1.63 ac), incl. 4,054 sf off-site in the WSSC easement (Outlet A, Lot 20)
Marlboro clay / public project	No (PGAtlas Environmental/7; none within 100 ft) / No
Road section	Open section (rural), as approved 2009: Estates Court 60' RW, 24' pavement, 4' shoulders, roadside swales, cul-de-sac
Water / sewer	W-3 / S-3 community systems (WSSC), Piscataway Creek sewer basin; mains from Henrietta Dr via 30' WSSC esmt L-51799 F-399

INDEX OF SHEETS

SHEET	TITLE
SDC-1	Site Development Concept Plan — Cover, BMP Summary Table, ESD Computations, Notes
SDC-2	Site Development Concept Plan — Plan View, Drainage Area Map and Environmental Features, 1" = 40'
C-000 - L-100	Site Development Plan set (11 sheets, companion): existing conditions, site/zoning, grading, utility, SWM, ESC, road, details, landscape

GENERAL NOTES

- Boundary: recorded plat PM 228 @ 83 (final plat S-08238). Lot lines are the county parcel geometry, which reproduces the plat bearings to the second and distances to 0.02 ft; closure of every lot ± 0.02 ft. A Maryland licensed surveyor shall confirm the boundary and set the Indian Head Hwy ROW before technical plans.
- Topography: M-NCPPC 2-ft contours (NWAD 88), extended ±100 ft beyond the property (A-13). The 2009 approved sheet (2005 Landside field survey, WSSC datum) is georeferenced and shown faint on SDC-2 for reference. V-1: DPEI prefers NGVD 29; the field-run update shall state the datum and conversion.
- Outlet A (6,486 sf) was conveyed to M. & K. Doyal (L-51565 F455) and is not part of this site. Water and sewer reach Estates Court through the recorded 30-ft WSSC easement across Outlet A and Lot 20. Treeview Estates (L-51799 F-399, Rev. 2023) and a 30-ft WSSC easement to be granted across Lot 4.
- Easement record discrepancies to resolve with WSSC before technical plans: Schedule A describes N 03°24'09" W where the plat and Exhibit A show N 03°27'26" W; the curve is written "N 04°07'06" W"; the recited deed dates are inconsistent.
- Estates Court (60-ft RW, 35,173 sf of record) is dedicated to public use on the plat and is not built. The entrance is on MD 210 (SHA): an SMA access permit and a sight-distance analysis (checklist item A.10) are required. The 30-ft RW for use in common (L-10142 F-723) adjoins to the south-west and is not used.
- R-1: Estates Court keeps the 2009 rural open section (DPW&T Std. 500.10 / 600.02 / 600.04): 24-ft pavement, 4-ft shoulders and roadside dry swales (M-8). Driveways cross the swale on 15-in. culverts or as swale driveways per DPW&T; aprons are 12 ft at the RW with 5-ft flares at the edge of pavement. Confirm the section with DPEI/DPW&T for a rural residential cul-de-sac.
- All six lots are vacant (no existing impervious area, no structures to remove). No wells or septic systems are proposed; the existing well on Parcel 199 (15608 Indian Head Hwy) is ≥100 ft from the proposed mains.
- Stormwater management to ESD to the MDP: each lot drains to one micro-bio-retention cell (M-6) sized for its own roof and paving. Estates Court sheet-flows off the shoulders into roadside dry swales (M-8) with check dams, north and south, draining west to the entrance. Rooftop and non-rooftop disconnection (N-1, N-2) are to be credited at technical design and will reduce the cells.
- Quantity: the site is <1 ac of new impervious area on HSG C soils. The 10-yr and 100-yr (Op10/Qf) analyses at each POI accompany this plan in the concept narrative. ESD storage is subtracted per MDE Ch. 5. Outfalls as tabulated; each discharge as sheet flow through a level spreader.
- Approval of record (current): NR1-015-06, TCPI-018-06, TCP2-016-09. Still to be submitted: geotechnical report with Sec. 32-131 infiltrations (E-1, E-2), soil borings, affidavit of the adjacent-owner notification (Sec. 32-182)(g), mailed within 7 days of submittal, and the application fee (\$500 + 5% technology fee).
- Contact Miss Utility (811) at least 48 hours before any excavation.

ENVIRONMENTAL FEATURES


ENVIRONMENTAL FEATURE (CHECKLIST B)	FINDING AND SOURCE
B-1B-2 Streams & buffers	None on site (verified on PGAtlas; approved NR1-015-06).
B-3 Wetlands	None mapped on or within 100 ft (DNR wetlands, WSSC). Confirm by NR1 field delineation.
B-4 100-yr floodplain	None. FEMA Zone X (area of minimal flood hazard); no DPEI or consultant floodplain within 100 ft.
B-5 Steep slopes	15–25%: 2,757 sf; >25%: 520 sf on site (PGAtlas Slope 2023) — isolated.
B-6 PMA	None on site (approved NR1-015-06).
B-7 Woodland	Per approved NR1-015-06 and TCP2-016-09 (current); the 2009 layout is followed, so the approved TCP2 woodland conservation governs. 2023 canopy 132,705 sf shown for reference.
B-9 Soils	C&E: Croom-Marr complex, 15 to 25 percent slopes (HSG C, K-15) 2%; UdaF udorthents, highway, 0 to 65 percent slopes (HSG None, K None) 2%; Ball Beltsville silt loam, 2 to 5 percent slopes (HSG C, K-37) 9.
B-10 TMDL / Tier II	Chesapeake Bay TMDL watershed; not within a Tier II catchment; DNR Stronghold watershed (021402030798).
B-11 Highly erodible	Slopes ≥15% with K ≥ 0.35 are highly erodible: the 15–25% patches on Ball (K-37) qualify — stabilize within 3 days.
B-12B-13 Springs, bedrock, Marlboro clay	None observed (2005 field survey) or mapped. Geotechnical report to confirm (E-1, E-2).
B-14 Chesapeake Bay Critical Area	Not in the CBCA overlay (PGAtlas Zoning/3).
Other	FIDS habitat (DNR) overlaps 1.9 ac; Green Infrastructure Evaluation Area; Priority Woodlands for Retention; ESA 2 (Plan 2035).

POINTS OF INVESTIGATION (C-9) — from D8 flow routing on M-NCPPC 2-ft topography

POI	LOCATION (NAD83)	SHARE OF SITE	ESD PRACTICES
POI-1	N 367,259 E 1,311,041	89%	ESD-1, ESD-2, ESD-3, ESD-4, ESD-5, ESD-6, ESD-S1, ESD-S2
POI-2	N 367,499 E 1,311,246	10%	—

Off-site drainage onto the tract: 116,500 sf (2.67 ac), from the Treeview Estates rear yards to the north and east (C-11). It is passed through by sheet flow around the ESD cells; no off-site area is routed into a practice.

VICINITY MAP SCALE: 1" = 2,000'

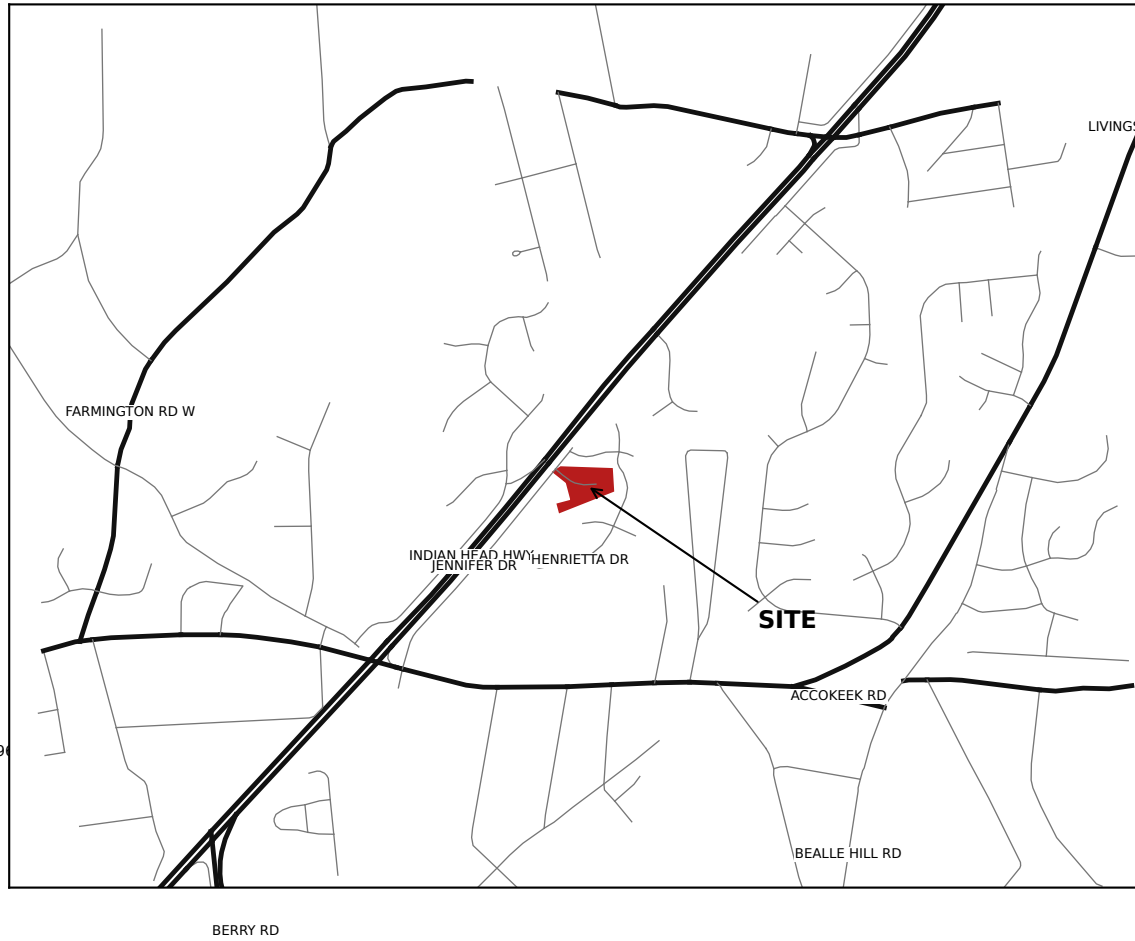

PLAN TYPE SITE DEVELOPMENT CONCEPT PLAN

PROJECT ESTATES AT INDIAN HEAD LOTS 1-6 AND ESTATES COURT

LOCATION:
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT PM 228 @ 83 · TAX MAP 151 F-3
WSSC 220501 · ELECTION DIST. 5
COUNCIL DIST. 9 · ZONE RR

OWNER / APPLICANT:
GERALD WALDMAN REVOCABLE TRUST
400 N. FLAGLER DR., WEST PALM BEACH, FL 33401
(L-32062 F043)

ENGINEER:
W.L. MEEKINS, INC. — BILL MEEKINS, JR.
3101 RITCHIE ROAD, FORESTVILLE, MD 20747
301-736-0115 — info@meekins.net

PREPARED WITH:
KEALEE SITE-PLAN ENGINE (DRAFT FOR PE REVIEW)

SHEET TITLE COVER SHEET, BMP SUMMARY TABLE, ESD COMPUTATIONS AND NOTES

SCALE:
AS NOTED

DATUM:
HORIZ: MD STATE PLANE NAD 83 (EPSG 2248), US FT
VERT: NAVD 88 (M-NCPPC 2-ft TOPOGRAPHY)
DPEI PREFERENCES NGVD 29 — SEE NOTE V-3

DATE:
2026-09-30 · CONCEPT SUBMISSION 1

REVISIONS

PROFESSIONAL CERTIFICATION

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. ____ Expiration ____

(SEAL)

NOT SEALED — DRAFT FOR PE REVIEW

SHEET

SDC-1

RESERVED FOR PRINCE GEORGE'S COUNTY
DPEI APPROVAL BLOCK — KEEP CLEAR

SITE DEVELOPMENT CONCEPT PLAN — PLAN VIEW / DRAINAGE AREA MAP



- LEGEND**
- Site boundary (plat PM 228 @ 83)
 - Lot line / R/W line
 - Proposed pavement, walk, driveway
 - Proposed dwelling (1,900 sf tp.)
 - ESD practice — micro-bioretenion (M-6)
 - ESD practice — roadside dry swale (M-8)
 - Drainage area divide (to device)
 - Off-site drainage area onto site
 - 100-yr overflow path
 - Point of investigation
 - Limit of disturbance
 - Slopes 15-25%
 - Slopes > 25%
 - Existing tree canopy (2023)
 - Soil boundary (NRCS)
 - WSSC easement (recorded / proposed)
 - Prop. 8" water main
 - Prop. 8" sewer main
 - Ex. contour, 2 ft (NAVD 88)
 - 2009 approved sheet (reference)

- PLAN NOTES**
- Plan scale 1" = 40' (± 1" = 50'; A-11); the whole property is on this sheet. Three grid ticks (A-8) are State Plane NAD 83.
 - Drainage areas are the engineer's per-lot catchments; POI and the 100-yr overflow path are from DB flow routing on the WACPC 2-R surface. Rest from the field-run survey.
 - Every lot drains to one M-6 catchment; Estates Court drains to roadside dry swales ESD-S152 (M-8), which discharge at the entrance-low point (EL) 220.4 to the MD 210 roadside ditch (SHA review).
 - No disturbance in floodplain, wetlands or slopes > 25% (approved NR-015-06).
 - The faint underlay is the 2009 approved Street Tree & Lighting sheet (2005 field topography, WSSC datum), grandfathered to the plat (median residual 0.44 ft). Its houses, mains and street lights are superseded.
 - Easements: 30' WSSC L51799 F399 (Outlet A 906 sf; Lot 20 1.154 acf recorded; 30' WSSC across Lot 4 proposed. Private SWM easements over ESD-S152 to be recorded with a maintenance agreement.

PLAN TYPE
**SITE DEVELOPMENT
CONCEPT PLAN**

PROJECT
**ESTATES AT INDIAN HEAD
LOTS 1-6 AND ESTATES COURT**

LOCATION
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT PM 228 @ 83 - TAX MAP 151 F-3
WSSC 220801 - ELECTION DIST. 5
COUNCIL DIST. 9 - ZONE RR

OWNER / APPLICANT
GERALD WALDMAN REVOCABLE TRUST
400 N. FLAGLER DR., WEST PALM BEACH, FL 33401
(L-32062 F043)

ENGINEER
W.L. MEEKINS, INC. — BILL MEEKINS, JR.
3101 RITCHIE ROAD, FORESTVILLE, MD 20747
301.736-7115 - info@meekins.net

PREPARED WITH
KEALEE SITE-PLAN ENGINE (DRAFT FOR PE REVIEW)

SHEET TITLE
**PLAN VIEW, DRAINAGE AREA
MAP AND ENVIRONMENTAL
FEATURES**

SCALE
1" = 40'

DATUM
HORIZ: MD STATE PLANE NAD 83 (EPSG 2248), US FT
VERT: NAVD 88 (M-NCPC 2-FT TOPOGRAPHY)
DPIE PREFERENCES — SEE NOTE V-3

DATE
2026-09-30 - CONCEPT SUBMISSION 1

REVISIONS

PROFESSIONAL CERTIFICATION
I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Expiration _____

(SEAL)

NOT SEALED — DRAFT FOR PE REVIEW

SHEET

SDC-2

RESERVED FOR PRINCE GEORGE'S COUNTY
DPIE APPROVAL BLOCK — KEEP CLEAR