

SITE DEVELOPMENT CONCEPT PLAN

ESTATES AT INDIAN HEAD — LOTS 1-6 AND ESTATES COURT

Plat Book PM 228 Plat 83 · 200-205 Estates Court, Accokeek, MD 20607 · Tax Map 151 Grid F-3 · Zone RR · Piscataway Election District 5 · Prince George's County, Maryland

Stormwater management by Environmental Site Design to the Maximum Extent Practicable (MDE Design Manual Ch. 5: PGC Subtitle 32, Div. 3). New submittal; base layout from the prior 2009 Street Tree & Lighting Plan (DPW&T permit 9399-2009-00).

PRINCE GEORGE'S COUNTY BMP SUMMARY TABLE (ESD broken out by Point of Investigation — checklist A-15, C-9)

BMP	PRACTICE (HSG)	LOCATION / OWNERSHIP	POI	DA (SF)	% I	P % (IN)	Rv	ESDv REQ (CF)	ESDv PRDV (CF)	Rvw REQ (CF)	SURFACE (SF)	N (NAD83)	E (NAD83)
ESD-1	Micro bio-retention (M-6)	Lot 1 (200 Estates Ct), private	POI-1	19,899	3.362	16.8	1.0	0.201	336	420	44	325	367,419
ESD-2	Micro bio-retention (M-6)	Lot 2 (202 Estates Ct), private	POI-1	20,015	3.315	16.6	1.0	0.199	332	332	43	330	367,398
ESD-3	Micro bio-retention (M-6)	Lot 3 (204 Estates Ct), private	POI-1	20,051	3.459	17.3	1.0	0.205	343	343	45	386	367,381
ESD-4	Micro bio-retention (M-6)	Lot 4 (205 Estates Ct), private	POI-1	20,021	2.558	12.8	1.0	0.165	275	275	36	298	367,219
ESD-5	Micro bio-retention (M-6)	Lot 5 (203 Estates Ct), private	POI-1	20,235	3.441	17.0	1.0	0.203	342	342	45	340	367,175
ESD-6	Micro bio-retention (M-6)	Lot 6 (201 Estates Ct), private	POI-1	29,536	3.370	11.4	1.0	0.153	376	376	49	389	367,084
ESD-51	Dry swale (M-8) w/ check dams — street	Estates Ct R/W, north roadside (public, DPE)	POI-1	18,020	9.187	51.0	1.8	0.509	1,375	99	4,340	367,401	1,311,069
ESD-52	Dry swale (M-8) w/ check dams — street	Estates Ct R/W, south roadside (public, DPE)	POI-1	18,020	9.187	51.0	1.8	0.509	1,375	99	8,266	367,327	1,311,175
SUBTOTAL POI-1			POI-1	165,898	37,881				4,755	459			
TOTAL			8 ESD practices						4,755	4,839	459	14,874	

P, E from MDE Design Manual Table 5.3, HSG C (governing on site); Rv = 0.05 ± 0.009(0); ESDv = P, E Rv-A/12; Rev = 5-Rv-A/12; S = 0.13 in (HSG C); Rev is met within ESDv (percent-volume method); Micro bio-retention: 12 in max. ponding; 2.5 ft filter media (n = 0.40); underdrain to stable outfall; infiltration credit only where the Sec. 32-131 soil borings show ≥ 0.52 in/hr.

SITE DATA (DPE Concept Application, rev. 07/28/2021)

APPLICATION DATA	
Project name	Estates at Indian Head, Lots 1-6
Geographic location	S. side of MD 210 (Indian Head Hwy.), ±3,000 ft. NE of MD 210 / MD 373 (Livingston Rd)
Street address	200, 201, 202, 203, 204, 205 Estates Court, Accokeek, MD 20607
Companion cases	Prior (base work, not carrying this submittal): NRI-015-06, TCP1-018-06, TCP2-016-09, DPW&T 9399-2009-00 street tree & lighting. Of record: final plat S-08238 (PM 228 @ 83)
Lots / area	6 lots ± public R/W: 165,902 sf (3,809 ac) computed; 165,019 sf of record (plat 171,505 sf less Outlet A)
Tax accounts	3987666, 3987674, 3987682, 3987690, 3987708, 3987716
Tax map / WSSC 200'	151 F-3 / 2205E(1)
Master plan	2013 Approved Subregion 5 Master Plan & SMA (CR 808B1-2013); Planning Area 84, Piscataway & Vicinity
Master plan road	MD 210 Indian Head Highway (frontage, SHA) — access by Estates Court only
Council / election district	District 9 / District 5 (Piscataway)
Municipality	None (unincorporated) — PGAtlas Administrative/30
Historic site / scenic road	None / None; Mount Vernon Viewshed Area of Primary Concern covers the site
Zone (current / proposed)	RR / RR (no change) — Sec. 27-4202: 20,000 sf min., 25' front, 8' side, 20' rear, 25% max. coverage
MD 12-digit watershed	021402030798 — Piscataway Creek (MD 8-digit 02140203); County watershed: Piscataway Creek
Impaired / TMDL	Chesapeake Bay TMDL (N, P, sediment) applies; Piscataway Creek listings to be confirmed on MDE TMDL data center at submission
Tier I / Indapet	No (no MDE Tier II catchment intersect) / No (single-family residential)
Ex. site imp. area	0 sf (vacant, wooded; DEVELOPED = N on all six accounts)
New site imp. area	37,881 sf (22.8% of tract) — roofs, driveways, walks, Estates Court pavement, curb and sidewalk
Est. disturbed area	71,636 sf (1.64 ac), incl. 4,054 sf off-site in the WSSC easement (Outlet A, Lot 20)
Marlboro clay / public project	No (PGAtlas Environmental/7; none within 100 ft) / No
Road section	Open section (rural), per the 2009 base plan: Estates Court 60' R/W, 24' pavement, 4' shoulders, roadside swales, cul-de-sac
Water / sewer	W-3 / S-3 community systems (WSSC), Piscataway Creek sewer basin; mains from Henrietta Dr via 30' WSSC esent L 51799 F 399

INDEX OF SHEETS

SHEET	TITLE
SDC-1	Site Development Concept Plan — Cover, BMP Summary Table, ESD Computations, Notes
SDC-2	Site Development Concept Plan — Plan View, Drainage Area Map and Environmental Features, 1" = 40'
C-000 - L-100	Site Development Plan set (11 sheets, companion): existing conditions, site/zoning, grading, utility, SWM, ESC, road, details, landscape

GENERAL NOTES

- Boundary: recorded plat PM 228 @ 83 (final plat S-08238). Lot lines are the county parcel geometry, which reproduces the plat bearings to the second and distances to 0.00 ft; closure of every lot ± 0.04 ft.
- Topography: M-NCPPC 2-ft contours (NAVD 88), extended ±100 ft beyond the property (A-13). The 2009 approved sheet (2005 Landesign field survey, WSSC datum) is georeferenced and shown faint on SDC-2 for reference; V-1 DPE prefers NGVD 29.
- Outlet A (6,486 sf) was conveyed to M, & L, Doug (L-11505 F451) and is not part of this site. Water and sewer reach Estates Court through the recorded 30-ft WSSC easement across Outlet A and Lot 20. Treeview Estates (L-51799 F399, Nov. 2025) and a 30-ft WSSC easement to be granted across Lot 4.
- Easement record discrepancies to resolve with WSSC before technical plans: Schedule A describes N 03°24'09" W where the plat and Exhibit A show N 03°27'20" W; the curve is written "N 04°07'00" W"; the rectified deed dates are inconsistent.
- Estates Court (660-ft R/W, 35,173 sf of record) is dedicated to public use on the plat and is not built. The entrance is on MD 210 (SHA); an SHA access permit and a sight-distance analysis (checklist item A.10) are required. The 30-ft R/W for use in common (L-10142 F725) adjoins to the south-west and is not used.
- R-1: Estates Court keeps the 2009 rural open section (DPW&T Sld. 500.10 / 600.02 / 600.04): 24-ft pavement, 4-ft shoulders and roadside dry swales (M-8). Driveways cross the swale on 15-ft culverts or at swale driveways per DPW&T; aprons are 12 ft at the R/W with 5-ft flares at the edge of pavement. Confirm the section with DPE/DPW&T for a rural residential cul-de-sac.
- All six lots are vacant (no existing impervious area, no structures to remove). No wells or septic systems are proposed; the existing well on Parcel 199 (15668 Indian Head Hwy) is ±100 ft from the proposed mains.
- Stormwater management is ESD to the MEP; each lot drains to one micro bio-retention cell (M-6) sized for its own roof and paving. Estates Court sheet-flow off the shoulders into roadside dry swales (M-8) with check dams, north and south, draining west to the entrance. Rooftop and non-rooftop disconnection (N-1, N-2) are to be credited at technical design and will reduce the cells.
- Quantity: the site is < 1 ac of new impervious area on HSG C soils. The 10-yr and 100-yr (Op10/Q0) analyses at each POI accompany this plan in the concept narrative; ESD storage is subtracted per MDE Ch. 5. Outfalls as tabulated; each discharge as sheet flow through a level grate.
- NEW SUBMITTAL (2026). Prior approvals NRI-015-06, TCP1-018-06, TCP2-016-09 and DPW&T 9399-2009-00 are used as base work only and do not carry this submittal. Additional work: an updated revised NRI (draft with this submission, approved copy before concept approval, Sec. 32-182(1)), a TCP2-016-09 revision or new TCP / letter of exemption as M-NCPPC Environmental Planning determines; street tree and lighting plan re-reviewed to current DPW&T/DPE standards; SHM by ESD to the MEP under current Subtitle 32. Also still to be submitted: geotechnical report with Sec. 32-131 infiltration tests (E-1, E-2), soil borings, affidavit of the adjacent-owner notification (Sec. 32-182(2)), mailed within 7 days of submittal, and the application fee (\$500 + 5% technology fee).
- Contact Miss Utility (811) at least 48 hours before any excavation.

ENVIRONMENTAL FEATURES


ENVIRONMENTAL FEATURE (CHECKLIST B)	FINDING AND SOURCE
B-1B-2 Streams & buffers	None on site (verified on PGAtlas; prior NRI-015-06). Updated NRI required (new submittal).
B-3 Wetlands	None mapped on or within 100 ft (DNR wetlands, WSSC). Confirm by NRI field delineation.
B-4 100-yr floodplain	None. FEMA Zone X (area of minimal flood hazard); no DPE or consultant floodplain within 100 ft.
B-5 Steep slopes	15–25%: 2,757 sf, >25%: 520 sf on site (PGAtlas Slope 2023) — isolated.
B-6 PMA	None on site (prior NRI-015-06). Updated NRI required (new submittal).
B-7 Woodland	Per updated NRI (prior NRI-015-06/TCP2-016-09 = base work): TCP2 revision or new TCP per M-NCPPC.
B-9 Soils	C&E Croom-Marr complex, 15 to 25 percent slopes (HSG C, K-15) 2%; UdaF Udorthents, highway, 0 to 65 percent slopes (HSG None, K-None) 2%; BaB Beltsville silt loam, 2 to 5 percent slopes (HSG C, K-37) 94.
B-10 TMDL / Tier II	Chesapeake Bay TMDL watershed; not within a Tier II catchment; DNR Stronghold watershed (021402030798).
B-11 Highly erodible	Slopes ≥15% with K ≥ 0.35 are highly erodible: the 15–25% patches on BaB (K-37) qualify — stabilize within 3 days.
B-12B-13 Springs, bedrock, Marlboro clay	None observed (2005 field survey) or mapped. Geotechnical report to confirm (E-1, E-2).
B-14 Chesapeake Bay Critical Area	Not in the C&E overlay (PGAtlas Zoning/3).
Other	FIDS habitat (DNR) overlaps 1.9 ac; Green Infrastructure Evaluation Area; Priority Woodlands for Retention; ESA 2 (Plan 2035).

POINTS OF INVESTIGATION (C-9) — from D8 flow routing on M-NCPPC 2-ft topography

POI	LOCATION (NAD83)	SHARE OF SITE	ESD PRACTICES
POI-1	N 367,259 E 1,311,041	89%	ESD-1, ESD-2, ESD-3, ESD-4, ESD-5, ESD-6, ESD-51, ESD-52
POI-2	N 367,499 E 1,311,246	10%	—

Off-site drainage onto the tract: 116,500 sf (2.67 ac), from the Treeview Estates rear yards to the north and east (C-11). It is passed through by sheet flow around the ESD cells; no off-site area is routed into a practice.

VICINITY MAP SCALE: 1" = 2,000'

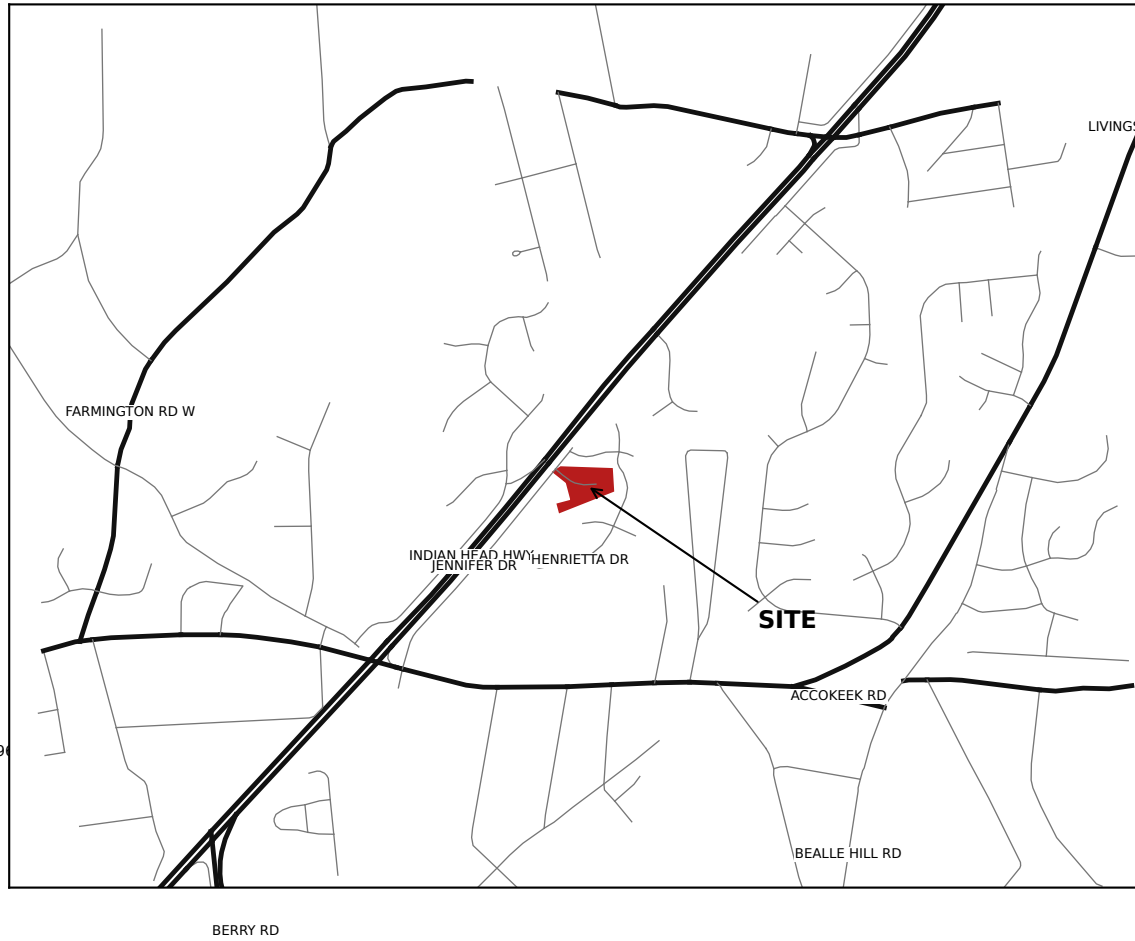

PLAN TYPE SITE DEVELOPMENT CONCEPT PLAN

PROJECT ESTATES AT INDIAN HEAD LOTS 1-6 AND ESTATES COURT

LOCATION:
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT PM 228 @ 83 · TAX MAP 151 F-3
WSSC 2205E(1) — ELECTION DIST. 5
COUNCIL DIST. 9 · ZONE RR

OWNER / APPLICANT:
GERALD WALDMAN REVOCABLE TRUST
400 N. FLAGLER DR., WEST PALM BEACH, FL 33401
(L-32062 F043)

ENGINEER:
W.L. MEEKINS, INC. — BILL MEEKINS, JR.
3101 RITCHIE ROAD, FORESTVILLE, MD 20747
301.736.0115 — info@meekins.net

PREPARED WITH:
KEALEE SITE-PLAN ENGINE (DRAFT FOR PE REVIEW)

SHEET TITLE COVER SHEET, BMP SUMMARY TABLE, ESD COMPUTATIONS AND NOTES

SCALE

AS NOTED

DATUM

HORIZ: MD STATE PLANE NAD 83 (EPSG 2248), US FT
VERT: NAVD 83 (M-NCPPC 2-FT TOPOGRAPHY)
DPE PREFERS NGVD 29 — SEE NOTE V-3

DATE

2026-09-30 · CONCEPT SUBMISSION 1

REVISIONS

PROFESSIONAL CERTIFICATION

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Expiration _____

(SEAL)

NOT SEALED — DRAFT FOR PE REVIEW

SHEET

SDC-1

RESERVED FOR PRINCE GEORGE'S COUNTY
DPE APPROVAL BLOCK — KEEP CLEAR

SITE DEVELOPMENT CONCEPT PLAN — PLAN VIEW / DRAINAGE AREA MAP



LEGEND

- Site boundary (plat PM 228 @ 83)
- Lot line / RW line
- Proposed pavement, walk, driveway
- Proposed dwelling (1,900 sf ft.)
- ESD practice — micro-bioretenion (M-6)
- ESD practice — roadside dry swale (M-8)
- Drainage area divide (to device)
- Off-site drainage area onto site
- 100-yr overflow path
- Point of investigation
- Limit of disturbance
- Slopes 15-25%
- Slopes > 25%
- Existing tree canopy (2023)
- Soil boundary (NRCS)
- WSSC easement (recorded / proposed)
- Prop. 8" water main
- Prop. 8" sewer main
- Ex. contour, 2 ft (NAVD 88)
- 2009 approved sheet (reference)

PLAN NOTES

- Plan scale 1" = 40' (± 1" = 50'; A-11); the whole property is on this sheet. Three grid ticks (A-B) are State Plane NAD 83.
- Drainage areas are the engineer's per-lot catchments; POI and the 100-yr overflow path are from DB flow routing on the M-6PC 2-R surface.
- Every lot drains to one M-6 cell; Estates Court drains to roadside dry swales ESD-5152 (M-8), which discharge at the entrance-low point (EL) 220.4 to the MD 210 roadside ditch (SHA review).
- No disturbance in floodplain, wetlands or slopes > 25% (prior NRI-015-06, updated NRI required).
- The faint underlay is the 2009 approved Street Tree & Lighting sheet (2005 field topography, WSSC datum), georeferenced to the plat (median residual 0.44 ft). Its houses, mains and street lights are superseded.
- Easements: 30' WSSC L51799 F399 (Outlet A 906 sf; Lot 20 1.154 acf recorded; 30' WSSC across Lot 4 proposed. Private 50M easements over ESD-5152 to be recorded with a maintenance agreement.

PLAN TYPE

SITE DEVELOPMENT CONCEPT PLAN

PROJECT

ESTATES AT INDIAN HEAD LOTS 1-6 AND ESTATES COURT

LOCATION

200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT PM 228 @ 83 - TAX MAP 151 F-3
WSSC 220501 - ELECTION DIST. 5
COUNCIL DIST. 9 - ZONE RR

OWNER / APPLICANT

GERALD WALDMAN REVOCABLE TRUST
400 N. FLAGLER DR., WEST PALM BEACH, FL 33401
(L-32062 F043)

ENGINEER

W.L. MEEKINS, INC. — BILL MEEKINS, JR.
3101 RITCHIE ROAD, FORESTVILLE, MD 20747
301.736.7115 - info@meekins.net

PREPARED WITH

KEALEE SITE-PLAN ENGINE (DRAFT FOR PE REVIEW)

SHEET TITLE

PLAN VIEW, DRAINAGE AREA MAP AND ENVIRONMENTAL FEATURES

SCALE

1" = 40'

DATUM

HORIZ: MD STATE PLANE NAD 83 (EPSG 2248), US FT
VERT: NAVD 88 (M-6PC 2-FT TOPOGRAPHY)
DPIE PREFERS NGVD 29 — SEE NOTE V-3

DATE

2026-09-30 - CONCEPT SUBMISSION 1

REVISIONS

PROFESSIONAL CERTIFICATION

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Expiration _____

(SEAL)

NOT SEALED — DRAFT FOR PE REVIEW

SHEET

SDC-2

RESERVED FOR PRINCE GEORGE'S COUNTY
DPIE APPROVAL BLOCK — KEEP CLEAR



KEALEE

Design, build, deliver

PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
ADDRESS
200, 201, 202, 203, 204, 205 ESTATES COURT
JURISDICTION
Prince George's County, Maryland
ZONE
RR
SHEET
C-100 — Existing Conditions and Boundary Plan
SCALE
1" = 100'
STATUS
PRELIMINARY
SHEET NO.
1 OF 5
COORDINATES
EPSG:2248
H: NAD83
V: NAVD83 (feet)

PLAN TYPE AND PREPARATION

PLAN TYPE SITE DEVELOPMENT / FINE GRADING
SHEET C-100 — Existing Conditions and Boundary Plan
DISCIPLINE Maryland Licensed Surveyor
DRAWN BY KEALEE SITE-PLAN ENGINE
DESIGNED BY
CHECKED BY

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

- C-100 Existing Conditions and Boundary Plan
- C-400 Grading and Drainage Plan
- C-500 Utility Plan
- C-700 Sediment and Erosion Control Plan
- L-100 Landscape and Tree Canopy Plan

SITE DATA

ZONE	RR
TAX / PARCEL ID	—
GROSS TRACT AREA	165,902 SF 3.809 AC
LOT 1 AREA	19,999 SF 0.459 AC
LOT 2 AREA	20,015 SF 0.459 AC
LOT 3 AREA	20,051 SF 0.460 AC
LOT 4 AREA	20,021 SF 0.460 AC
LOT 5 AREA	20,235 SF 0.465 AC
LOT 6 AREA	29,536 SF 0.678 AC
NET LOT AREA	129,857 SF 2.981 AC
LOT 1 FRONTAGE	70' MIN 258.22'
LOT 2 FRONTAGE	70' MIN 107.40'
LOT 3 FRONTAGE	70' MIN 59.04'
LOT 4 FRONTAGE	70' MIN 89.94'
LOT 5 FRONTAGE	70' MIN 177.46'
LOT 6 FRONTAGE	70' MIN 164.74'
SETBACKS	REQUIRED PROVIDED
FRONT YARD	25' 25'
SIDE YARD	8' 8'
REAR YARD	20' 20'
COVERAGE	MAX PROPOSED
LOT COVERAGE	25% 10.5%
BUILDING FOOTPRINT	— 13,629 SF
DATUM	
HORIZONTAL	EPSG:2248 NAD83
VERTICAL	NAVD83 (feet)

SITE ANALYSIS

- Gross tract area 165,902 SF
- Area of dwelling 13,629 SF
- Wooded area NOT ESTABLISHED
- Floodplain area NOT ESTABLISHED
- Net lot area 129,857 SF
- TOTAL AREA DISTURBED 56,177 SF (AT LEAST)
- SWM REQUIRED — Sec. 32-174(a)(3) YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
LOT 1	206.14	197.47	206.47	205.47	20'	2
LOT 2	207.68	199.01	208.01	207.01	20'	2
LOT 3	206.70	200.63	210.03	209.03	20'	2
LOT 4	207.99	199.32	208.32	207.32	20'	2
LOT 5	206.67	197.00	206.00	205.00	20'	2
LOT 6	205.90	197.23	206.23	205.23	20'	2

G: garage slab - B: basement - FF: finished floor - SF: subfloor - HT: height - STY: stories. A DASH IS NOT 20' 0"; no elevation is shown for that item.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 1	19,999	16.0%	0.77	1.13	0.36	336
LOT 2	20,015	16.0%	0.77	1.13	0.36	332
LOT 3	20,051	17.3%	0.77	1.15	0.38	343
LOT 4	20,021	12.0%	0.77	1.06	0.28	275
LOT 5	20,235	17.0%	0.78	1.15	0.37	342
LOT 6	29,536	11.4%	1.14	1.50	0.36	376
PROJECT TOTAL	129,857	15.0%	5.00	7.11	2.11	2,004

Peak flows are summed for catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

- Pre-construction meeting
- Obtain necessary permits
- Notify Miss Utility at 811 at least 48 hours prior to any excavation
- Install stabilized construction entrance and perimeter sediment control
- Rough grade the lot
- Construct dwelling
- Install water, sewer and storm services and the driveway
- Fine grade and stabilize all disturbed areas
- Remove sediment control once the inspector gives written permission

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS


GENERAL NOTES

- CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
- ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
- PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
- ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
- BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — LOTS 1-6, ESTATES AT INDIAN HEAD — PLAT BOOK PM 228 PLAT 83 — ZONE RR — TAX MAP 151 GRID F-3 — WSSC 220SE01 — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
- CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
- NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION. NOT AN OPEN DITCH SECTION. GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSIONED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.


SIGNATURE	DATE
LICENSE NO.	EXPIRATION DATE
SEAL	
REVISIONS	
— NONE —	

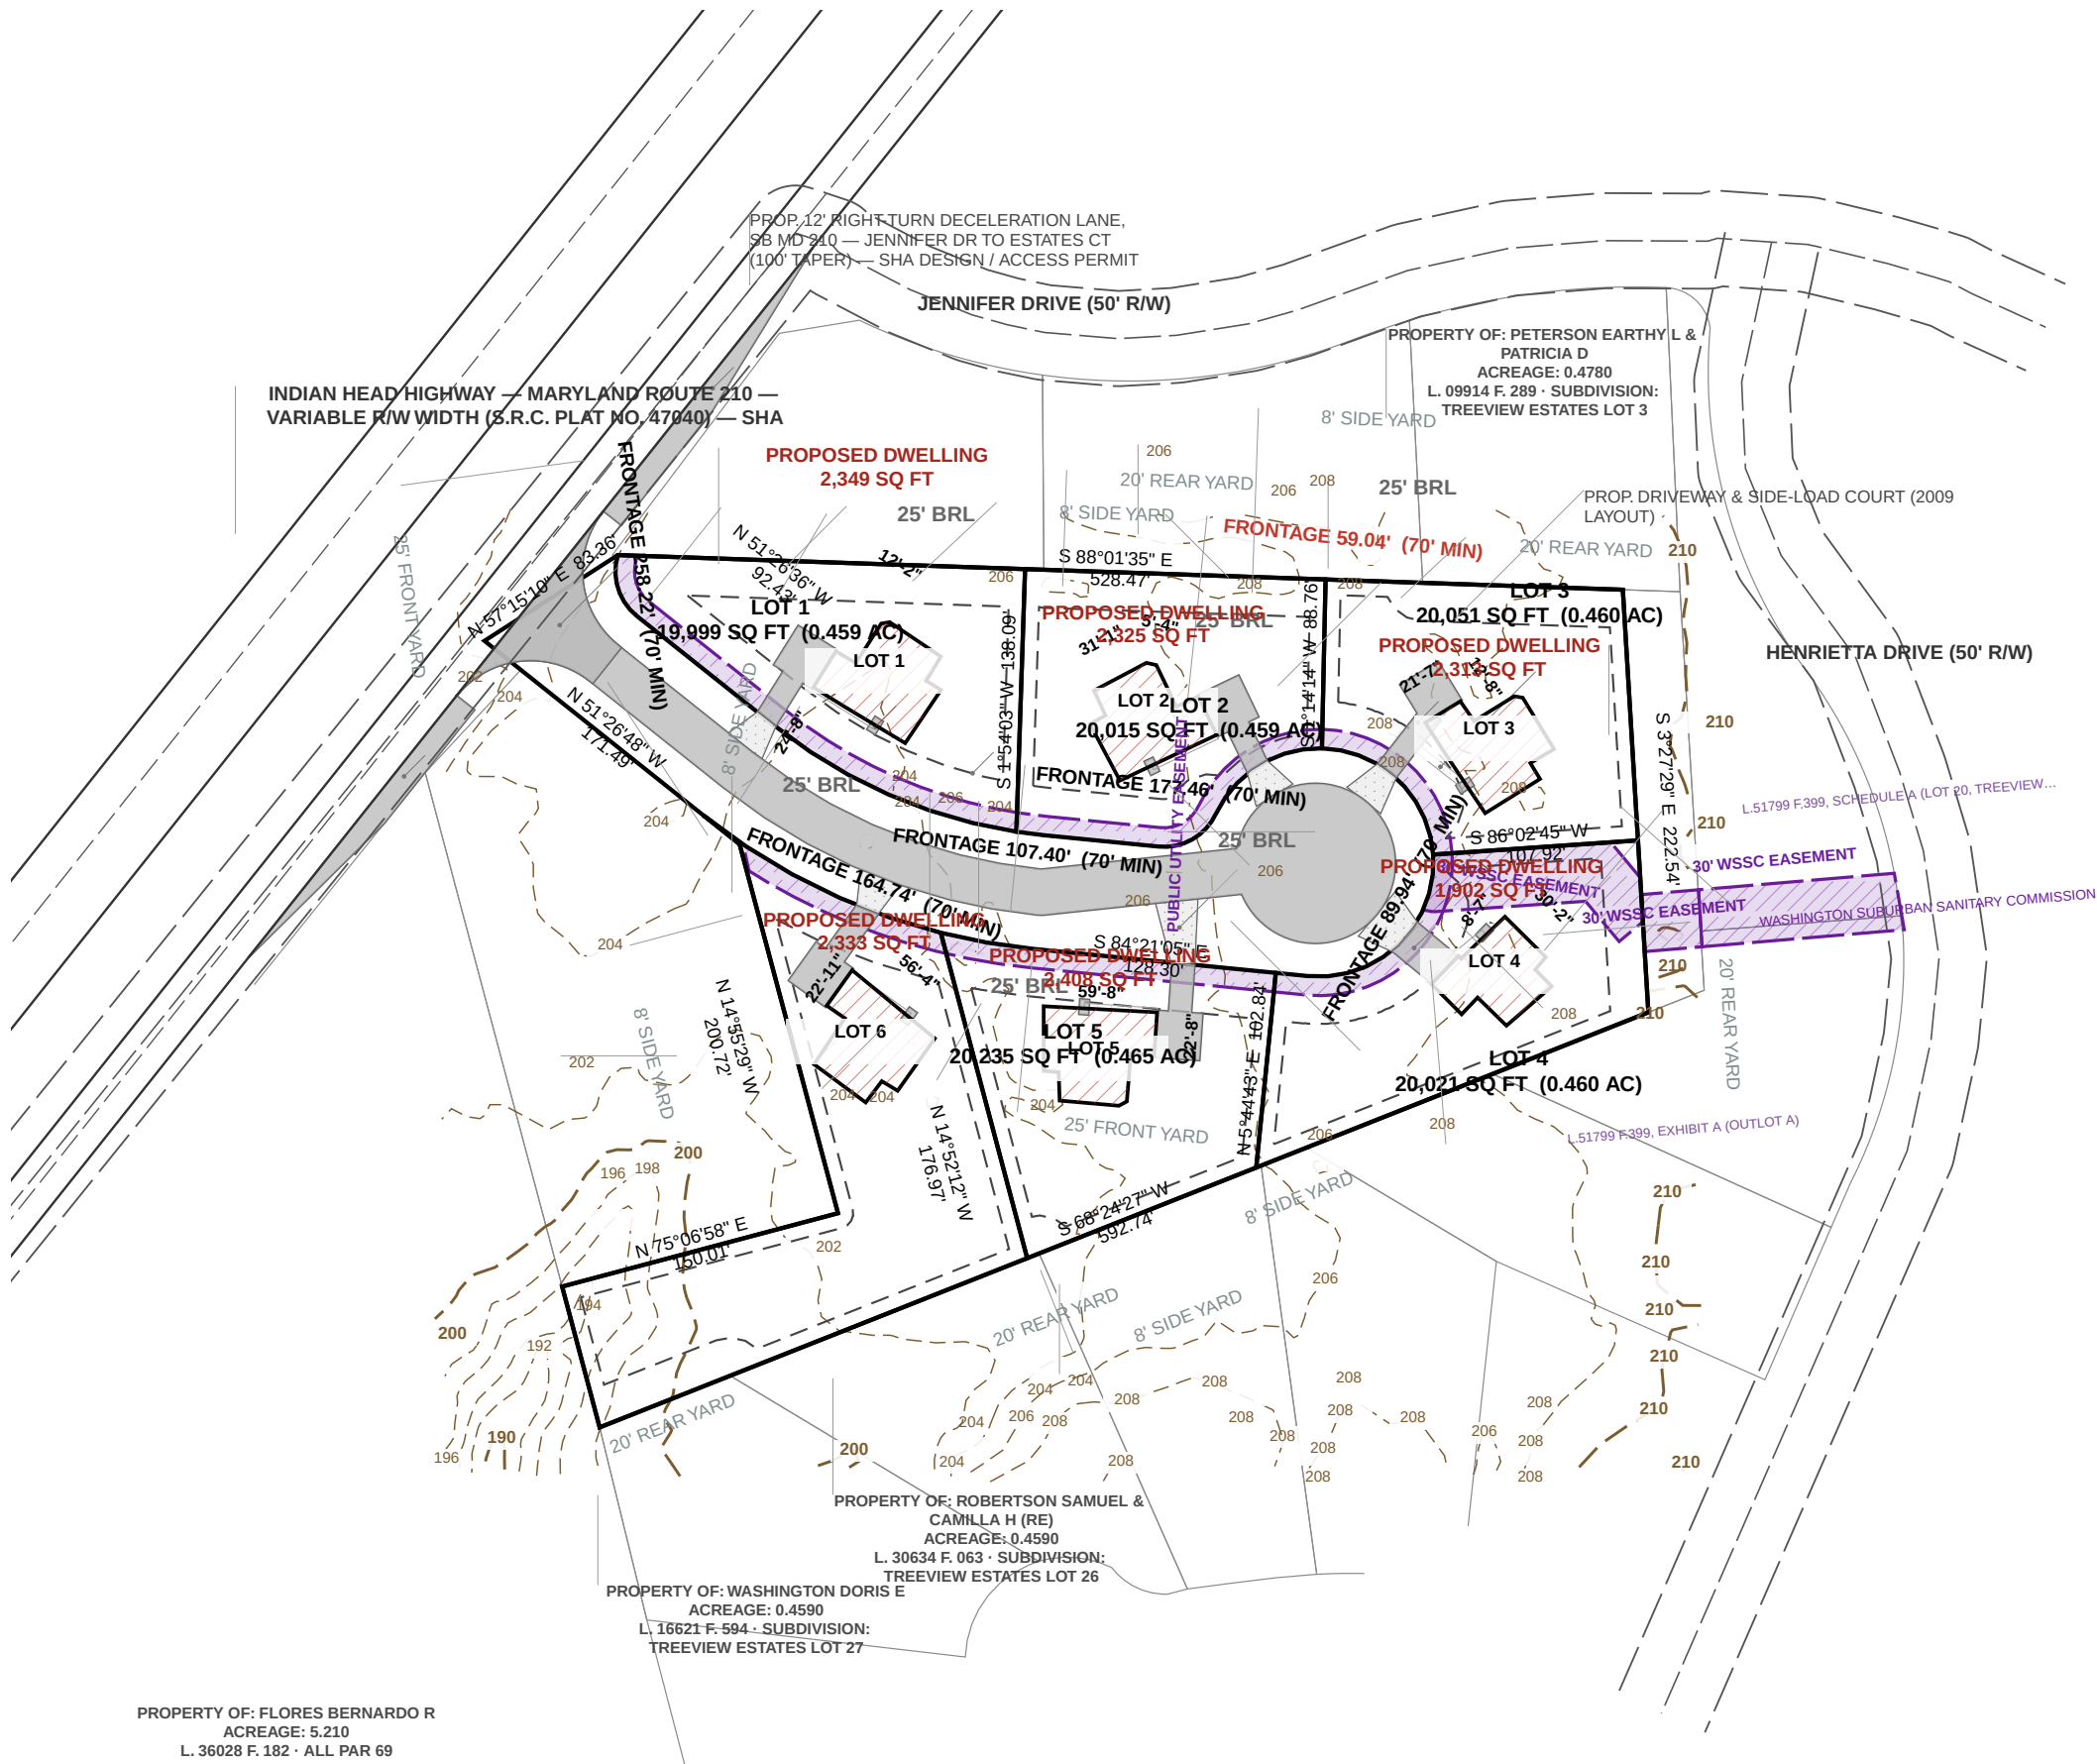


SOILS TABLE USDA NRCS SSURGO — PGC Code Sec. 32-133(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
ACA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
ADA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
ADB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
ADC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained



STREET TREE PLACEMENT IN RURAL RW — SWALE & CULVERT DRIVEWAYS — PGC DPW&T STD. 600.02

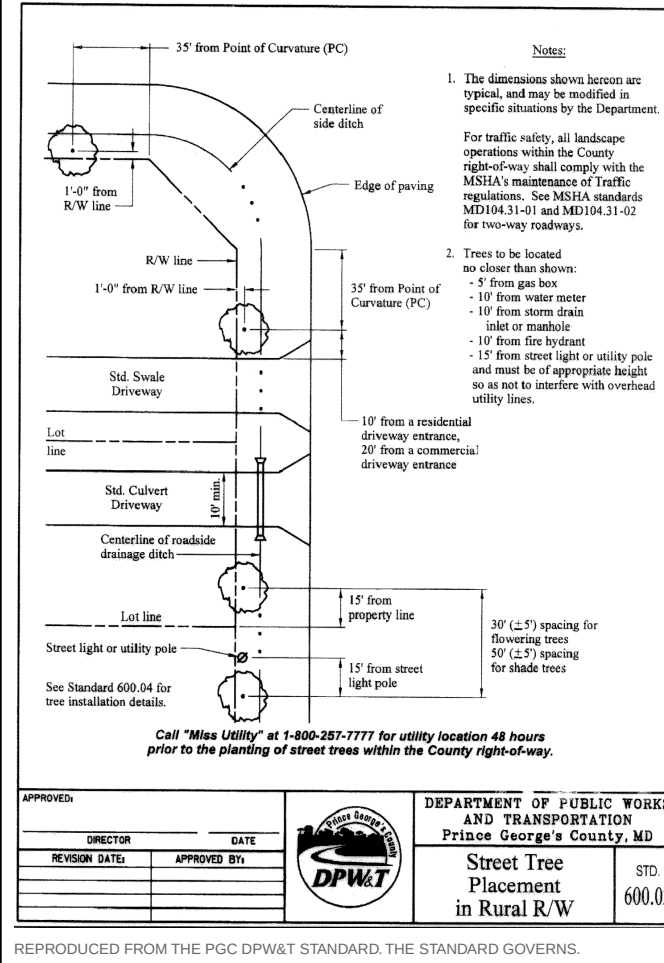

STREET LIGHT LOCATION — RURAL RESIDENTIAL — PGC DPW&T STD. 600.10

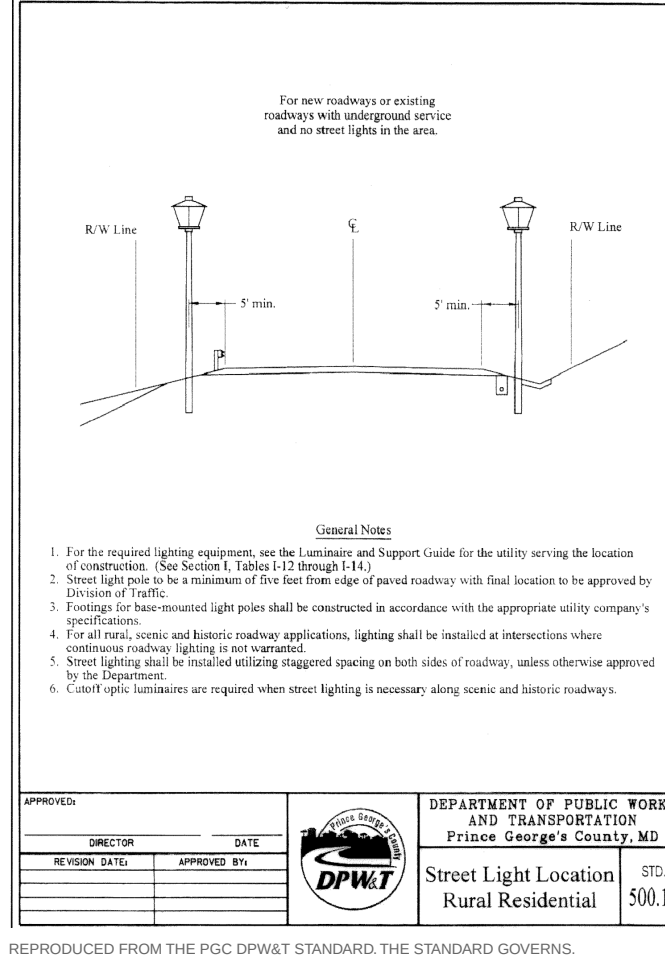

STREET TREE INSTALLATION IN RURAL RW — PGC DPW&T STD. 600.04

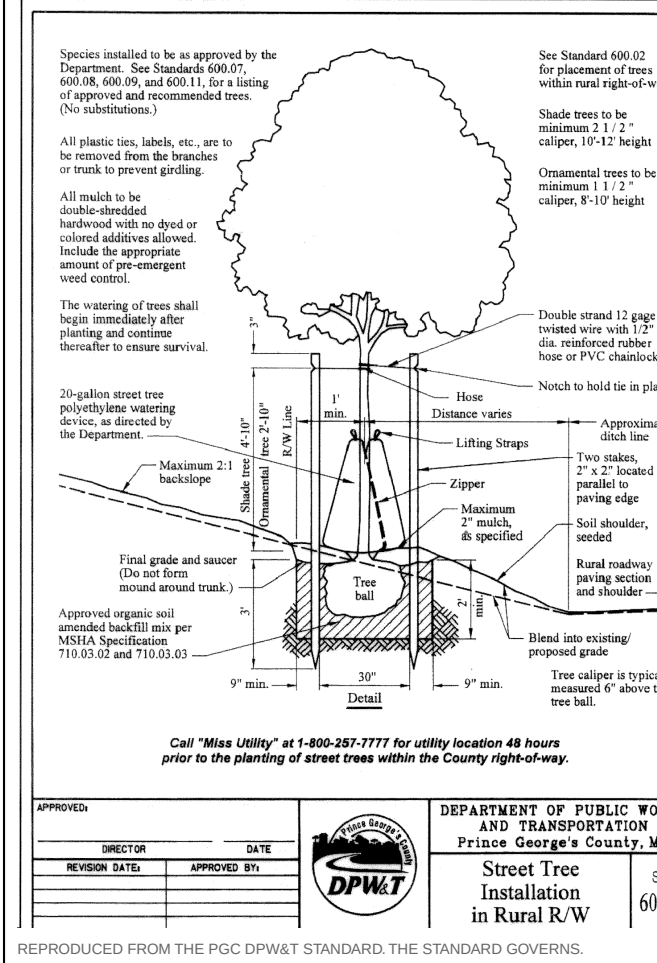



KEALEE

Design, build, deliver

PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
ADDRESS
200, 201, 202, 203, 204, 205 ESTATES COURT
JURISDICTION
Prince George's County, Maryland
ZONE
RR
SHEET
C-400 — Grading and Drainage Plan
SCALE
1" = 100'
STATUS
PRELIMINARY
SHEET NO.
2 OF 5
COORDINATES
EPSG 2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION

PLAN TYPE SITE DEVELOPMENT / FINE GRADING
SHEET C-400 — Grading and Drainage Plan
DISCIPLINE Maryland Professional Engineer
DRAWN BY KEALEE SITE-PLAN ENGINE
DESIGNED BY
CHECKED BY

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

- C-100 Existing Conditions and Boundary Plan
- C-400 Grading and Drainage Plan
- C-500 Utility Plan
- C-700 Sediment and Erosion Control Plan
- L-100 Landscape and Tree Canopy Plan

SITE DATA

ZONE	RR
TAX / PARCEL ID	—
GROSS TRACT AREA	165,902 SF 3.809 AC
LOT 1 AREA	19,999 SF 0.459 AC
LOT 2 AREA	20,015 SF 0.459 AC
LOT 3 AREA	20,051 SF 0.460 AC
LOT 4 AREA	20,021 SF 0.460 AC
LOT 5 AREA	20,235 SF 0.465 AC
LOT 6 AREA	29,536 SF 0.678 AC
NET LOT AREA	129,857 SF 2.981 AC
LOT 1 FRONTAGE	70' MIN 258.22'
LOT 2 FRONTAGE	70' MIN 107.40'
LOT 3 FRONTAGE	70' MIN 59.04'
LOT 4 FRONTAGE	70' MIN 89.94'
LOT 5 FRONTAGE	70' MIN 177.46'
LOT 6 FRONTAGE	70' MIN 164.74'
SETBACKS	REQUIRED PROVIDED
FRONT YARD	25' 25'
SIDE YARD	8' 8'
REAR YARD	20' 20'
COVERAGE	MAX PROPOSED
LOT COVERAGE	25% 10.5%
BUILDING FOOTPRINT	— 13,629 SF
DATUM	
HORIZONTAL	EPSG 2248 NAD83
VERTICAL	NAVD88 (feet)

SITE ANALYSIS

- Gross tract area 165,902 SF
- Area of dwelling 13,629 SF
- Wooded area NOT ESTABLISHED
- Floodplain area NOT ESTABLISHED
- Net lot area 129,857 SF
- TOTAL AREA DISTURBED 56,177 SF (AT LEAST)
- SWM REQUIRED — Sec. 32-17a(a)(3) YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
LOT 1	206.14	197.47	206.47	205.47	20'	2
LOT 2	207.68	199.01	208.01	207.01	20'	2
LOT 3	208.70	200.63	210.03	209.03	20'	2
LOT 4	207.99	199.32	208.32	207.32	20'	2
LOT 5	206.67	197.00	206.00	205.00	20'	2
LOT 6	205.90	197.23	206.23	205.23	20'	2

G: garage slab - B: basement - FF: finished floor - SF: subfloor - HT: height - STY: storeys. A DASH IS NOT ZERO; no elevation is shown for that item.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 1	19,999	16.0%	0.77	1.13	0.36	336
LOT 2	20,015	16.0%	0.77	1.13	0.36	332
LOT 3	20,051	17.3%	0.77	1.15	0.38	343
LOT 4	20,021	12.8%	0.77	1.06	0.28	275
LOT 5	20,235	17.0%	0.78	1.15	0.37	342
LOT 6	29,536	11.4%	1.14	1.50	0.36	376
PROJECT TOTAL	129,857	15.0%	5.00	7.11	2.11	2,004

Peak flows are summed for catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

- Pre-construction meeting
- Obtain necessary permits
- Notify Miss Utility at 811 at least 48 hours prior to any excavation
- Install stabilized construction entrance and perimeter sediment control
- Rough grade the lot
- Construct dwelling
- Install water, sewer and storm services and the driveway
- Fine grade and stabilize all disturbed areas
- Remove sediment control once the inspector gives written permission

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES


- CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
- ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
- PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
- ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
- BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — LOTS 1-6, ESTATES AT INDIAN HEAD — PLAT BOOK PM 228 PLAT 83 — ZONE RR — TAX MAP 151 GRID F-3 — WSSC ZD0501 — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
- CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
- NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION. NOT AN OPEN DITCH SECTION. GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSIONED CURB AT THE APRON PER DPW&T STD. 300.01. NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE	DATE
LICENSE NO.	EXPIRATION DATE
SEAL	


UNRECORDED NOTES) DO NOT FIT THIS SHEET; GRADING CERTIFICATE; STABILIZATION COMPLIANCE PREAMBLE; STANDARD STABILIZATION NOTE. THEY ARE REQUIRED AND ARE NOT ON ANY SHEET IN THIS SET.

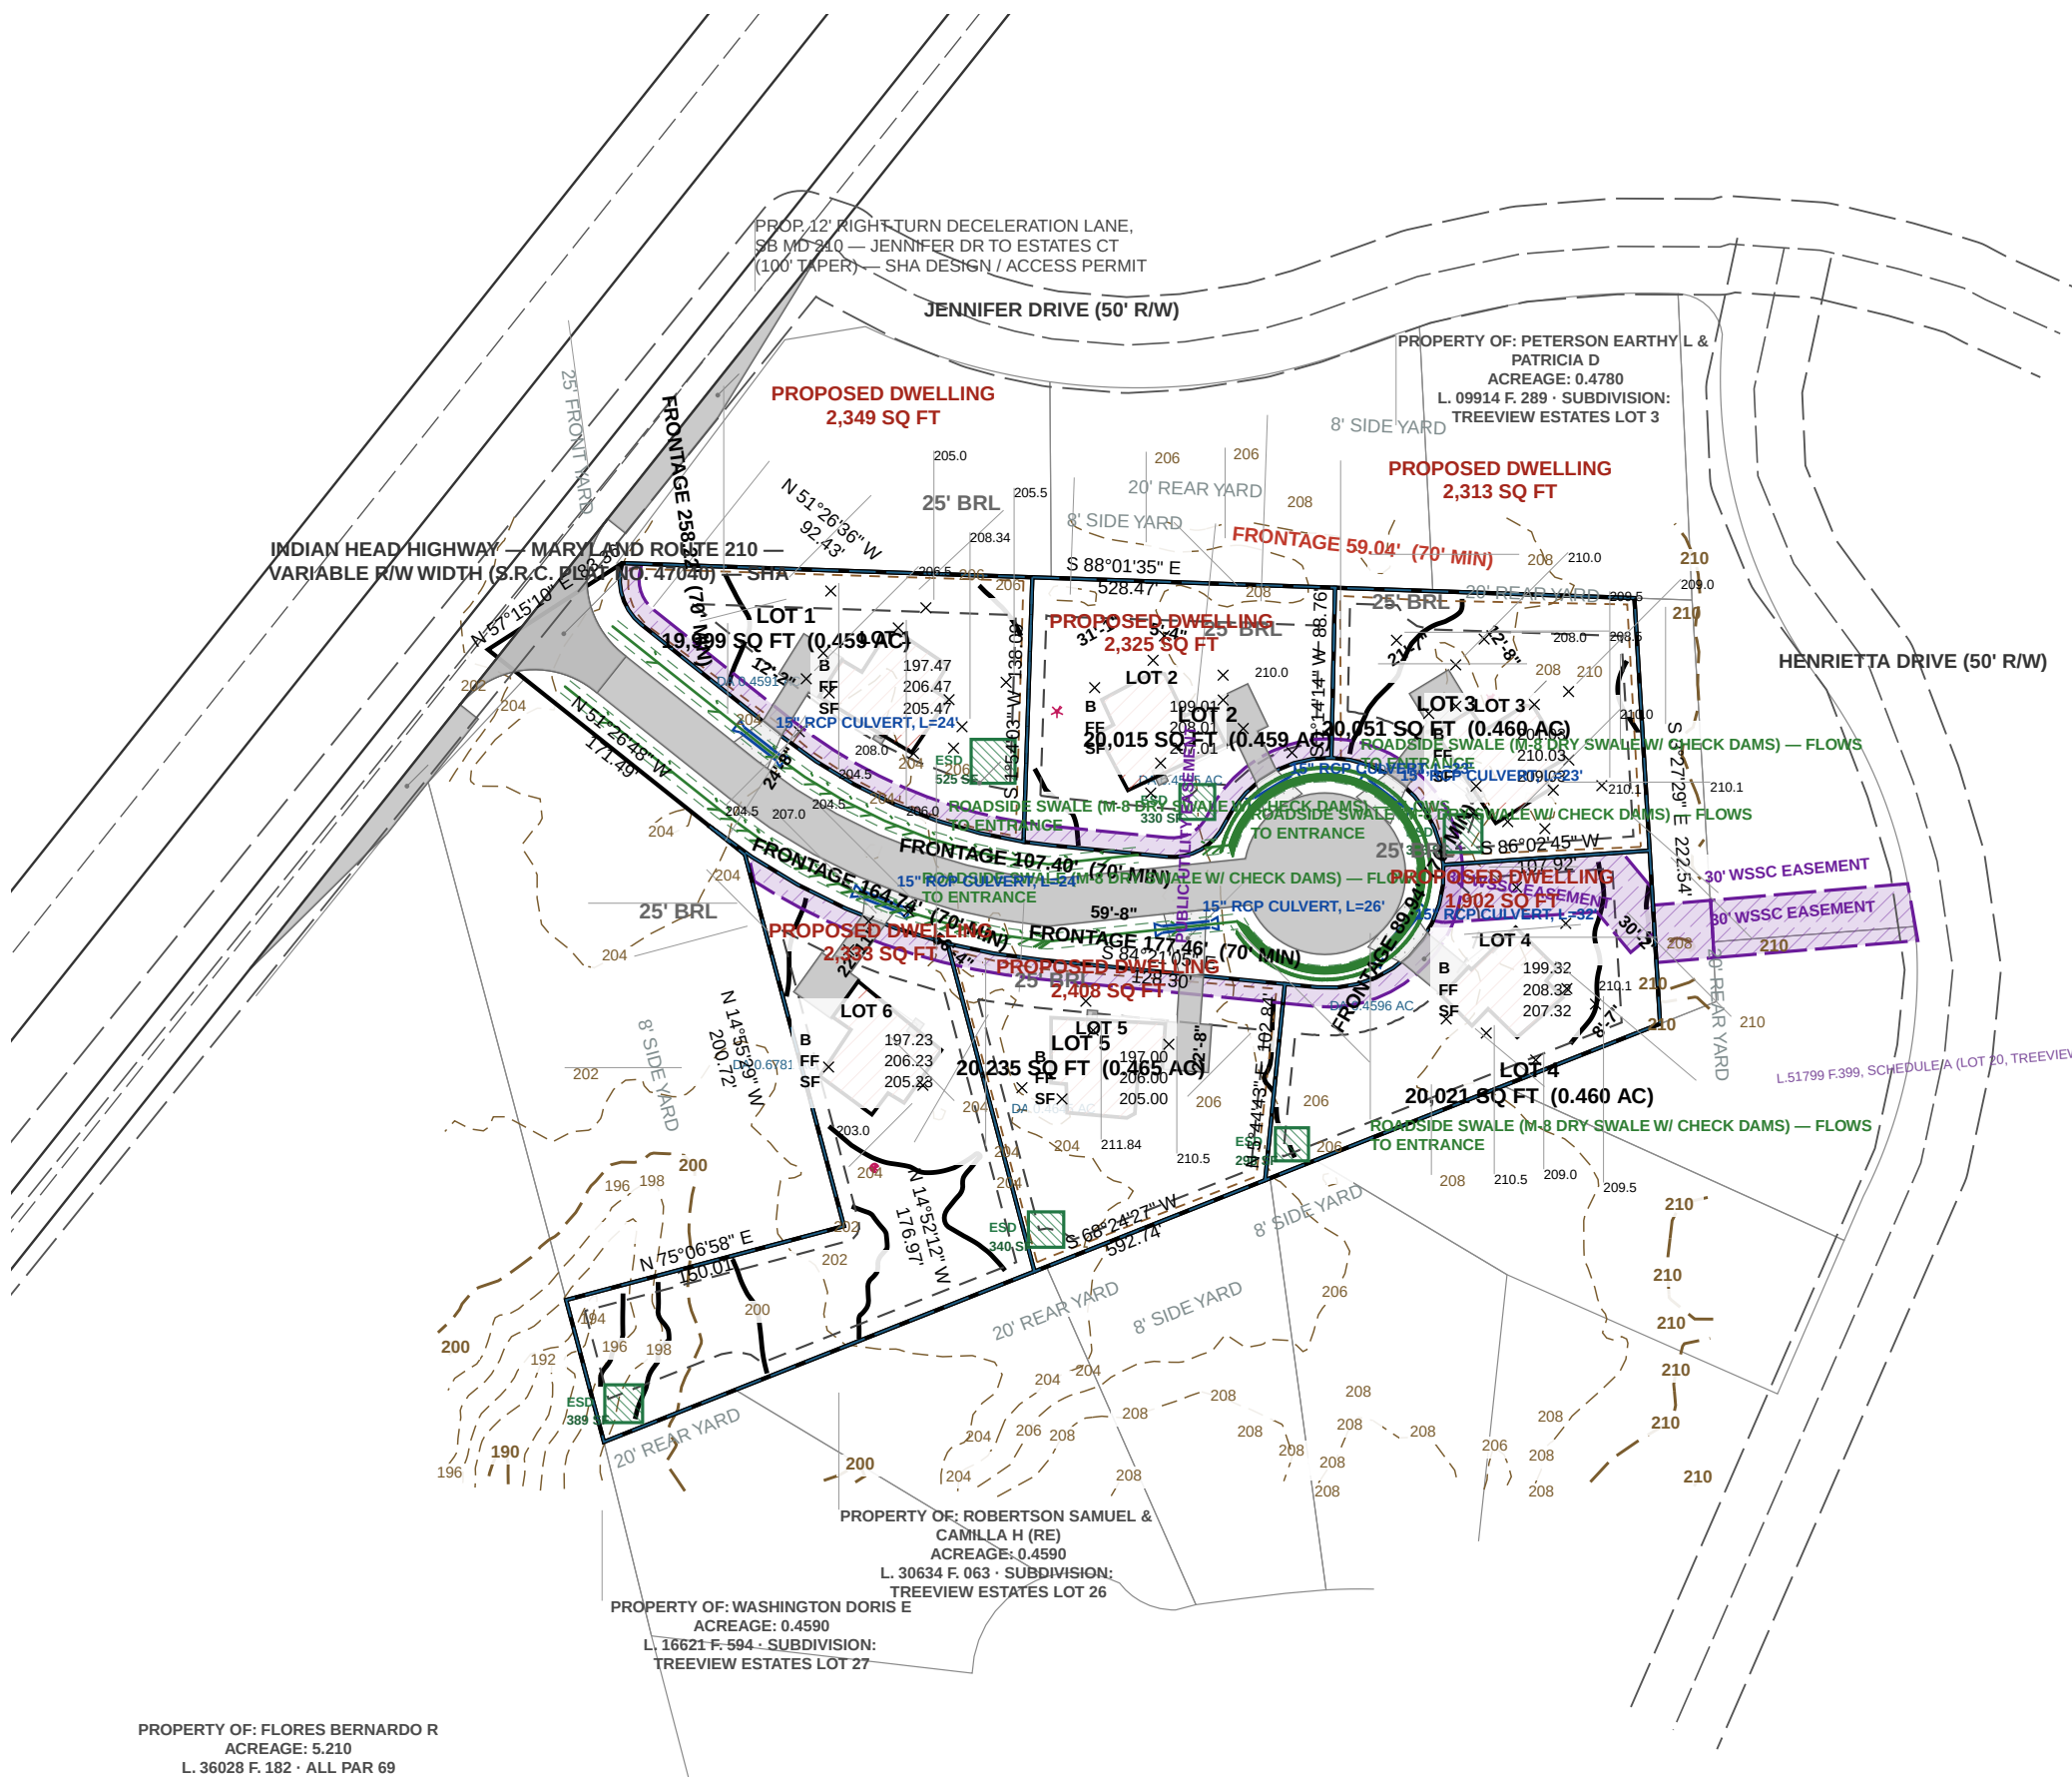


SOILS TABLE USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
ACA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
ADA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
ADB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
ADC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained



STREET TREE PLACEMENT IN RURAL RW — SWALE & CULVERT DRIVEWAYS — PGC DPW&T STD. 600.02

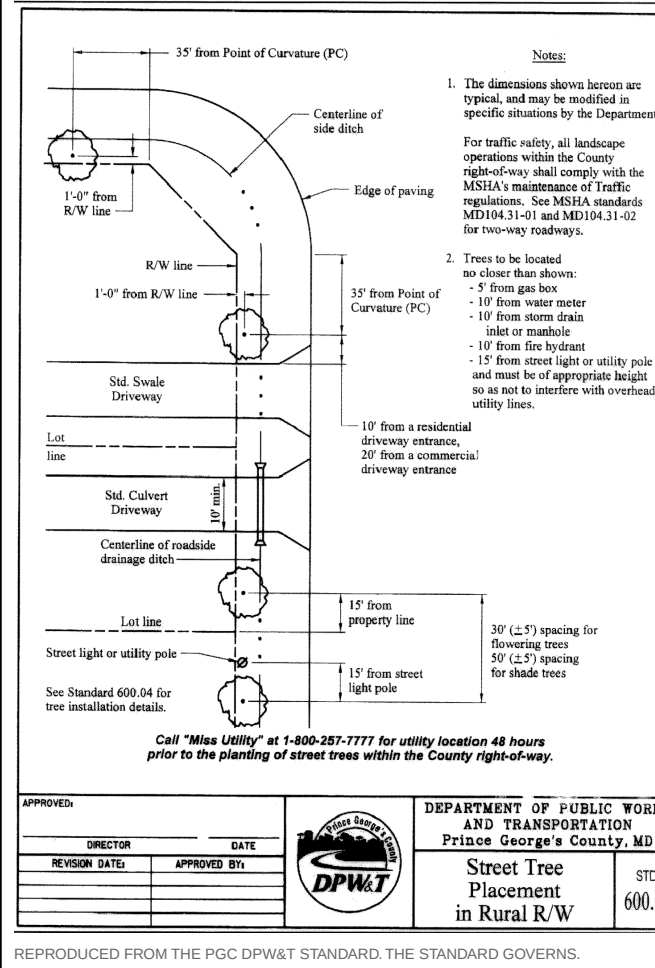

STREET LIGHT LOCATION — RURAL RESIDENTIAL — PGC DPW&T STD. 600.10

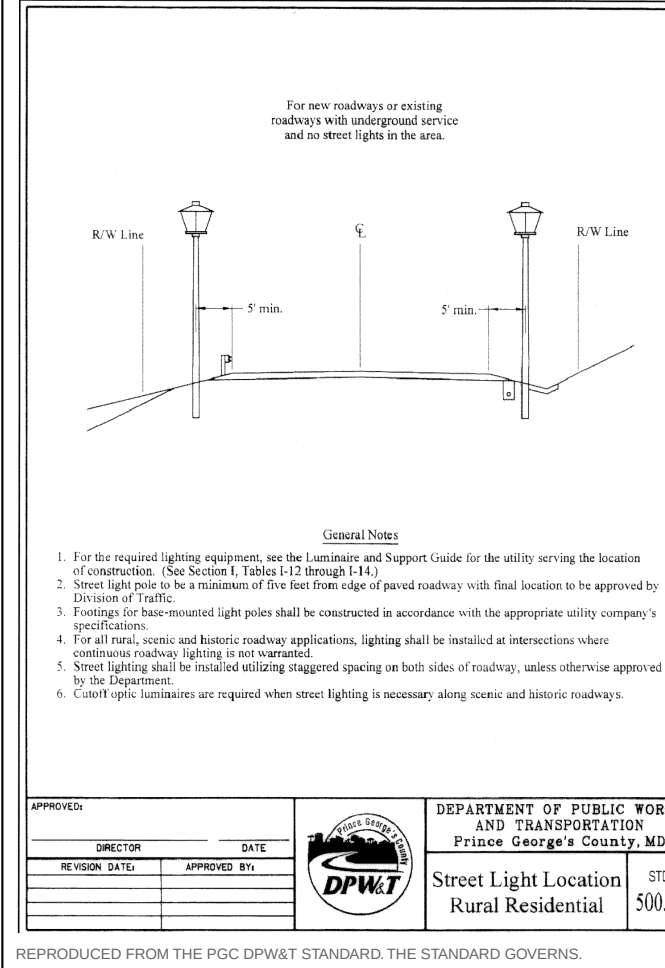

STREET TREE INSTALLATION IN RURAL RW — PGC DPW&T STD. 600.04

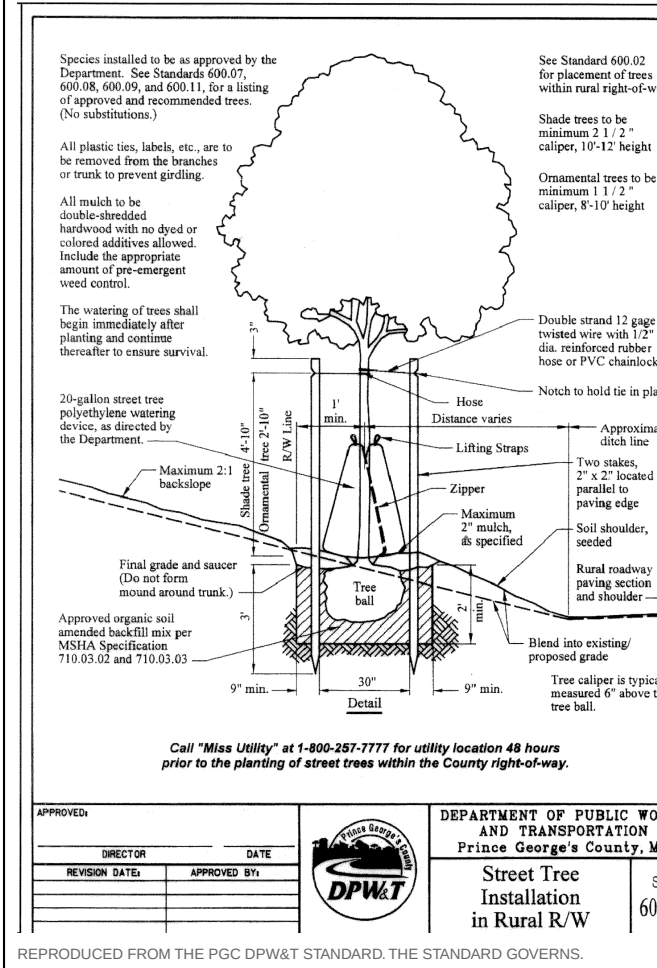



KEALEE

Design, build, deliver

PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
ADDRESS
200, 201, 202, 203, 204, 205 ESTATES COURT
JURISDICTION
Prince George's County, Maryland
ZONE
RR
SHEET
C-500 — Utility Plan
SCALE
1" = 100'
STATUS
PRELIMINARY
SHEET NO.
3 OF 5
COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION

PLAN TYPE SITE DEVELOPMENT / FINE GRADING
SHEET C-500 — Utility Plan
DISCIPLINE Maryland Professional Engineer
DRAWN BY KEALEE SITE-PLAN ENGINE
DESIGNED BY
CHECKED BY

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

- C-100 Existing Conditions and Boundary Plan
- C-400 Grading and Drainage Plan
- C-500 Utility Plan
- C-700 Sediment and Erosion Control Plan
- L-100 Landscape and Tree Canopy Plan

SITE DATA

ZONE	RR
TAX / PARCEL ID	—
GROSS TRACT AREA	165,902 SF 3.809 AC
LOT 1 AREA	19,999 SF 0.459 AC
LOT 2 AREA	20,015 SF 0.459 AC
LOT 3 AREA	20,051 SF 0.460 AC
LOT 4 AREA	20,021 SF 0.460 AC
LOT 5 AREA	20,235 SF 0.465 AC
LOT 6 AREA	29,536 SF 0.678 AC
NET LOT AREA	129,857 SF 2.981 AC
LOT 1 FRONTAGE	70' MIN 258.22'
LOT 2 FRONTAGE	70' MIN 107.40'
LOT 3 FRONTAGE	70' MIN 59.04'
LOT 4 FRONTAGE	70' MIN 89.94'
LOT 5 FRONTAGE	70' MIN 177.46'
LOT 6 FRONTAGE	70' MIN 164.74'
SETBACKS	REQUIRED PROVIDED
FRONT YARD	25' 25'
SIDE YARD	8' 8'
REAR YARD	20' 20'
COVERAGE	MAX PROPOSED
LOT COVERAGE	25% 10.5%
BUILDING FOOTPRINT	— 13,629 SF
DATUM	
HORIZONTAL	EPSG:2248 NAD83
VERTICAL	NAVD88 (feet)

SITE ANALYSIS

- Gross tract area 165,902 SF
- Area of dwelling 13,629 SF
- Wooded area NOT ESTABLISHED
- Floodplain area NOT ESTABLISHED
- Net lot area 129,857 SF
- TOTAL AREA DISTURBED 56,177 SF (AT LEAST)
- SWM REQUIRED — Sec. 32-17a(a)(3) YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
LOT 1	206.14	197.47	206.47	205.47	20'	2
LOT 2	207.68	199.01	208.01	207.01	20'	2
LOT 3	206.70	200.63	210.03	209.03	20'	2
LOT 4	207.99	199.32	208.32	207.32	20'	2
LOT 5	206.67	197.00	206.00	205.00	20'	2
LOT 6	205.90	197.23	206.23	205.23	20'	2

G: garage slab - B: basement - FF: finished floor - SF: subfloor - HT: height - STY: stories. A DASH IS NOT 2'00" - NO ELEVATION IS SHOWN FOR THIS ITEM.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 1	19,999	16.0%	0.77	1.13	0.36	336
LOT 2	20,015	16.0%	0.77	1.13	0.36	332
LOT 3	20,051	17.3%	0.77	1.15	0.38	343
LOT 4	20,021	12.0%	0.77	1.06	0.28	275
LOT 5	20,235	17.0%	0.78	1.15	0.37	342
LOT 6	29,536	11.4%	1.14	1.50	0.36	376
PROJECT TOTAL	129,857	15.0%	5.00	7.11	2.11	2,004

Peak flows are summed for catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

- Pre-construction meeting
- Obtain necessary permits
- Notify Miss Utility at 811 at least 48 hours prior to any excavation
- Install stabilized construction entrance and perimeter sediment control
- Rough grade the lot
- Construct dwelling
- Install water, sewer and storm services and the driveway
- Fine grade and stabilize all disturbed areas
- Remove sediment control once the inspector gives written permission

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS


GENERAL NOTES

- CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
- ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
- PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
- ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
- BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — LOTS 1-6, ESTATES AT INDIAN HEAD — PLAT BOOK PM 228 PLAT 83 — ZONE RR — TAX MAP 151 GRID F-3 — WSSC 220501 — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
- CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
- NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION. NOT AN OPEN DITCH SECTION. GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSIONED CURB AT THE APRON PER DPW&T STD. 300.01. NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.


SIGNATURE	DATE
LICENSE NO.	EXPIRATION DATE
SEAL	
REVISIONS	
— NONE —	

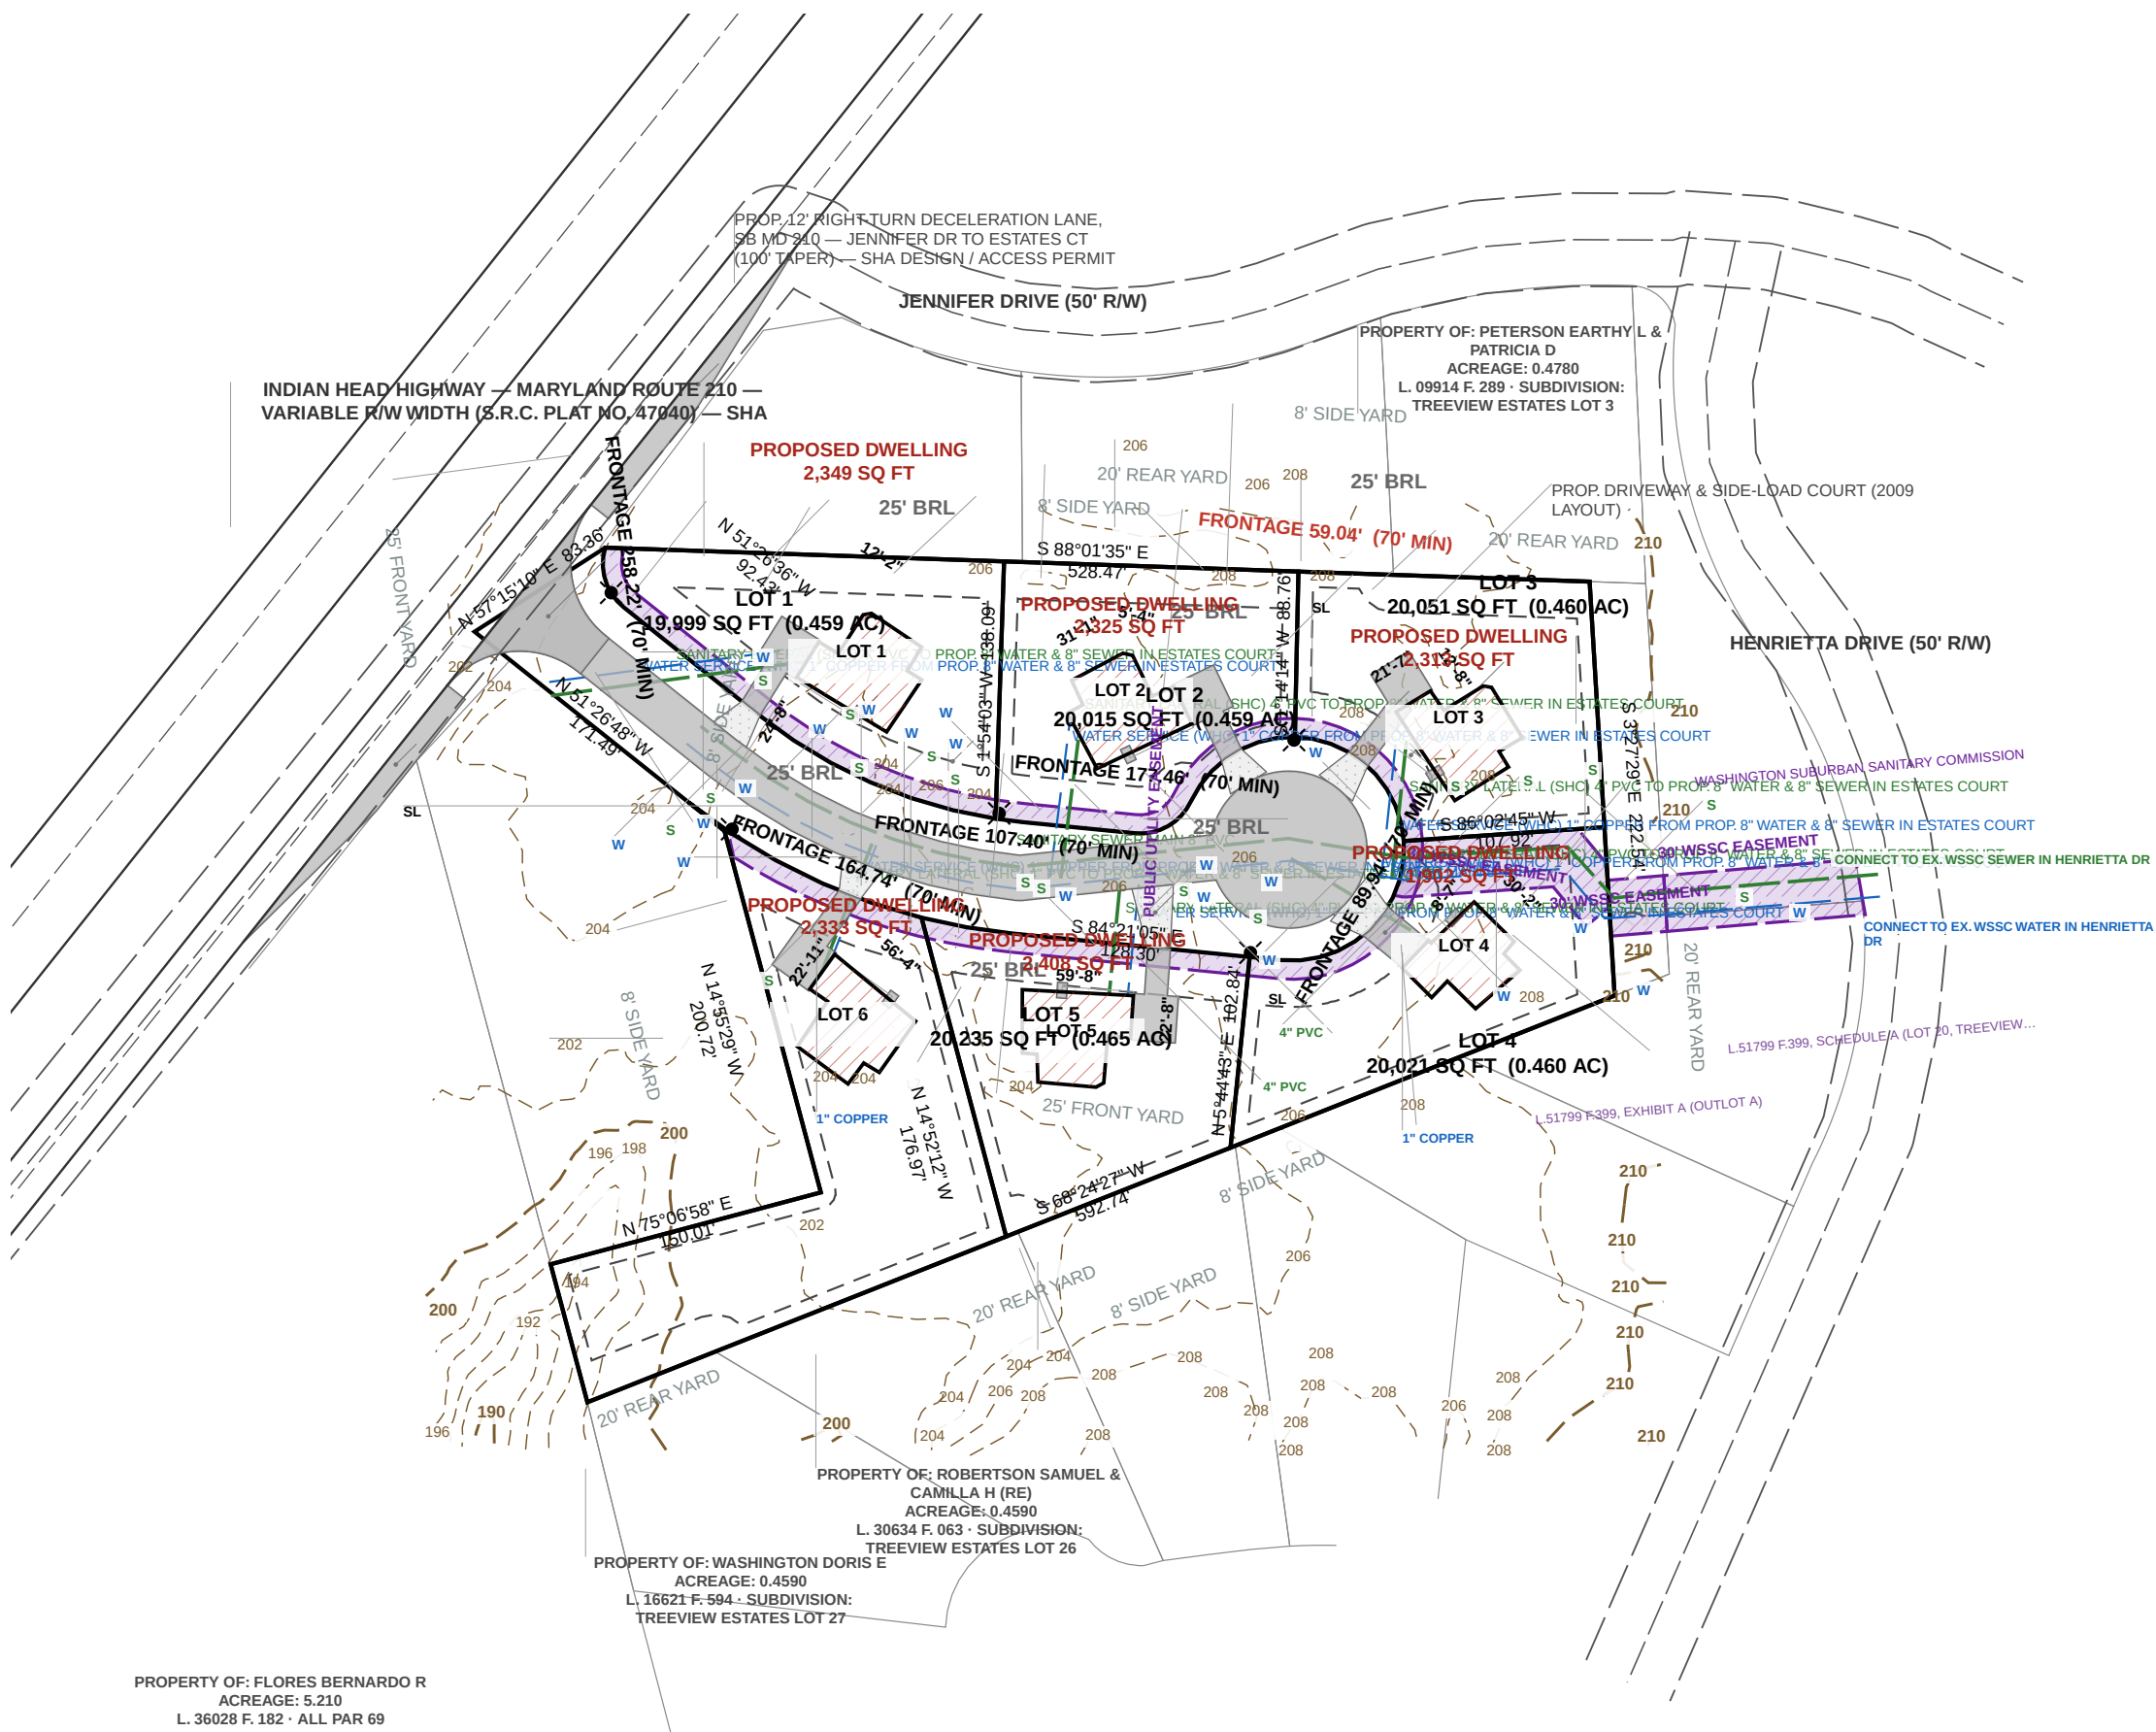


SOILS TABLE USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACTOR	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
ACA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
ADA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
ADB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
ADC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained



STREET TREE PLACEMENT IN RURAL RW — SWALE & CULVERT DRIVEWAYS — PGC DPW&T STD. 600.02

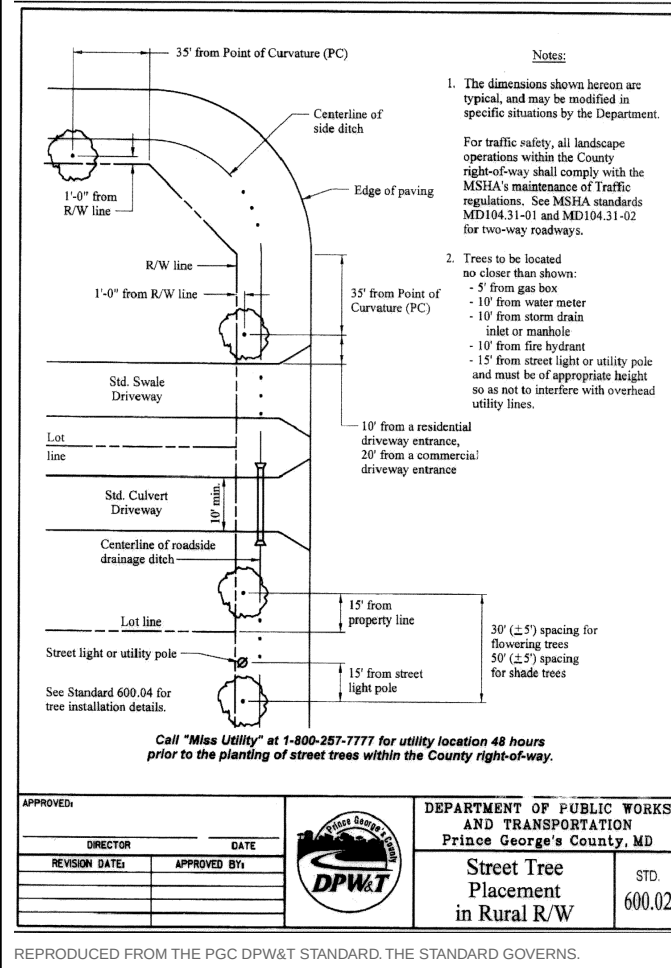

STREET LIGHT LOCATION — RURAL RESIDENTIAL — PGC DPW&T STD. 600.10

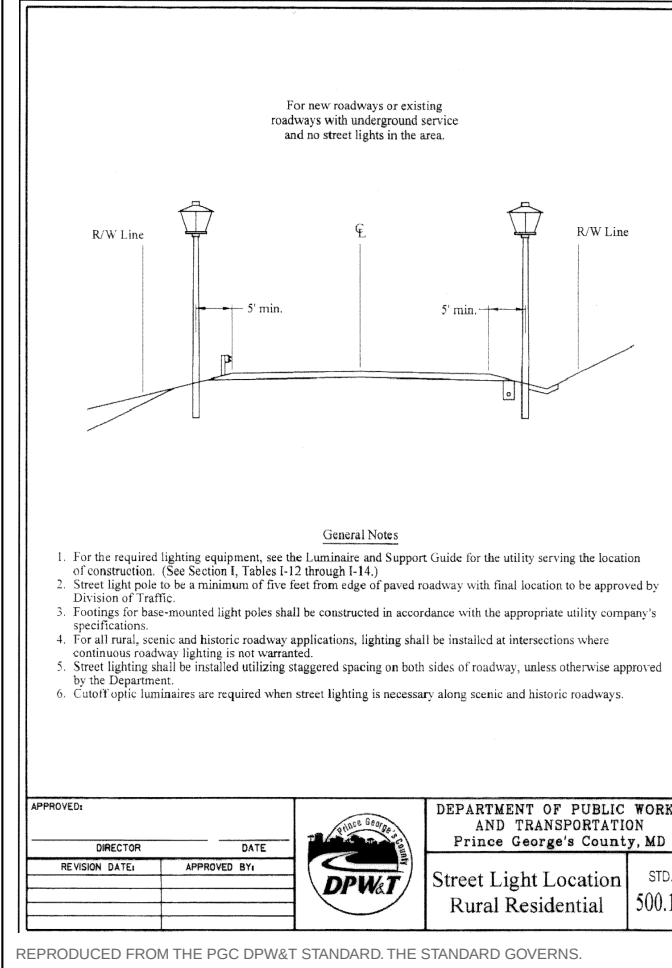

STREET TREE INSTALLATION IN RURAL RW — PGC DPW&T STD. 600.04

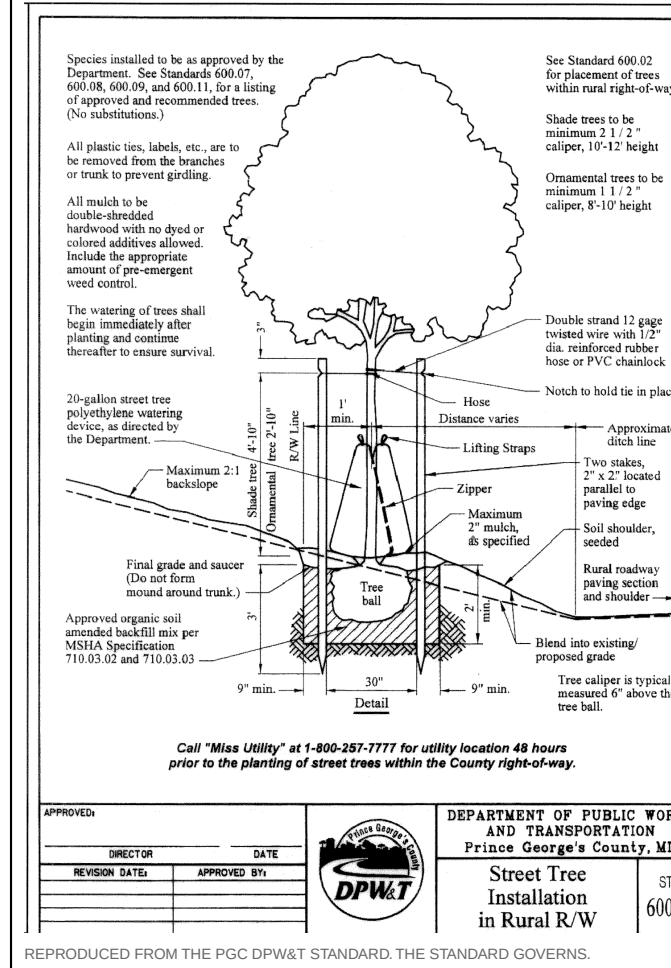



KEALEE

Design, build, deliver

PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
ADDRESS
200, 201, 202, 203, 204, 205 ESTATES COURT
JURISDICTION
Prince George's County, Maryland
ZONE
RR
SHEET
L-100 — Landscape and Tree Canopy Plan
SCALE
1" = 100'
STATUS
PRELIMINARY
SHEET NO.
5 OF 5
COORDINATES
EPSG-2248
H: NAD83
V: NAVD83 (feet)

PLAN TYPE AND PREPARATION

PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	L-100 — Landscape and Tree Canopy Plan
DISCIPLINE	Landscape Architect / Qualified Professional
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

- C-100 Existing Conditions and Boundary Plan
- C-400 Grading and Drainage Plan
- C-500 Utility Plan
- C-700 Sediment and Erosion Control Plan
- L-100 Landscape and Tree Canopy Plan

SITE DATA

ZONE	RR
TAX / PARCEL ID	—
GROSS TRACT AREA	165,902 SF 3.809 AC
LOT 1 AREA	19,999 SF 0.459 AC
LOT 2 AREA	20,015 SF 0.459 AC
LOT 3 AREA	20,051 SF 0.460 AC
LOT 4 AREA	20,021 SF 0.460 AC
LOT 5 AREA	20,235 SF 0.465 AC
LOT 6 AREA	29,536 SF 0.678 AC
NET LOT AREA	129,857 SF 2.981 AC
LOT 1 FRONTAGE	70' MIN 258.22'
LOT 2 FRONTAGE	70' MIN 107.40'
LOT 3 FRONTAGE	70' MIN 59.04'
LOT 4 FRONTAGE	70' MIN 89.94'
LOT 5 FRONTAGE	70' MIN 177.46'
LOT 6 FRONTAGE	70' MIN 164.74'
SETBACKS	REQUIRED PROVIDED
FRONT YARD	25' 25'
SIDE YARD	8' 8'
REAR YARD	20' 20'
COVERAGE	MAX PROPOSED
LOT COVERAGE	25% 10.5%
BUILDING FOOTPRINT	— 13,629 SF
DATUM	
HORIZONTAL	EPSG-2248 NAD83
VERTICAL	NAVD83 (feet)

SITE ANALYSIS

- Gross tract area 165,902 SF
- Area of dwelling 13,629 SF
- Wooded area NOT ESTABLISHED
- Floodplain area NOT ESTABLISHED
- Net lot area 129,857 SF
- TOTAL AREA DISTURBED 56,177 SF (AT LEAST)
- SWM REQUIRED — Sec. 32-174(a)(3) YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
LOT 1	206.14	197.47	206.47	205.47	20'	2
LOT 2	207.68	199.01	208.01	207.01	20'	2
LOT 3	206.70	201.63	210.03	209.03	20'	2
LOT 4	207.99	199.32	208.32	207.32	20'	2
LOT 5	206.67	197.00	206.00	205.00	20'	2
LOT 6	205.90	197.23	206.23	205.23	20'	2

G: garage slab · B: basement · FF: finished floor · SF: subfloor · HT: height · STY: stories · A DASH IS NOT 20' 0"; no elevation is shown for lot terms.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 1	19,999	16.0%	0.77	1.13	0.36	336
LOT 2	20,015	16.0%	0.77	1.13	0.36	332
LOT 3	20,051	17.3%	0.77	1.15	0.38	343
LOT 4	20,021	12.0%	0.77	1.06	0.28	275
LOT 5	20,235	17.0%	0.78	1.15	0.37	342
LOT 6	29,536	11.4%	1.14	1.50	0.36	376
PROJECT TOTAL	129,857	15.0%	5.00	7.11	2.11	2,004

Peak flows are summed for catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

- Pre-construction meeting
- Obtain necessary permits
- Notify Miss Utility at 811 at least 48 hours prior to any excavation
- Install stabilized construction entrance and perimeter sediment control
- Rough grade the lot
- Construct dwelling
- Install water, sewer and storm services and the driveway
- Fine grade and stabilize all disturbed areas
- Remove sediment control once the inspector gives written permission

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS


GENERAL NOTES

- CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
- ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
- PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
- ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
- BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — LOTS 1-6, ESTATES AT INDIAN HEAD — PLAT BOOK PM 228 PLAT 83 — ZONE RR — TAX MAP 151 GRID F-3 — WSSC 220SE01 — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
- CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
- NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION. NOT AN OPEN DITCH SECTION. GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSIONED CURB AT THE APRON PER DPW&T STD. 300.01. NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE	DATE
LICENSE NO.	EXPIRATION DATE
SEAL	
REVISIONS	
— NONE —	

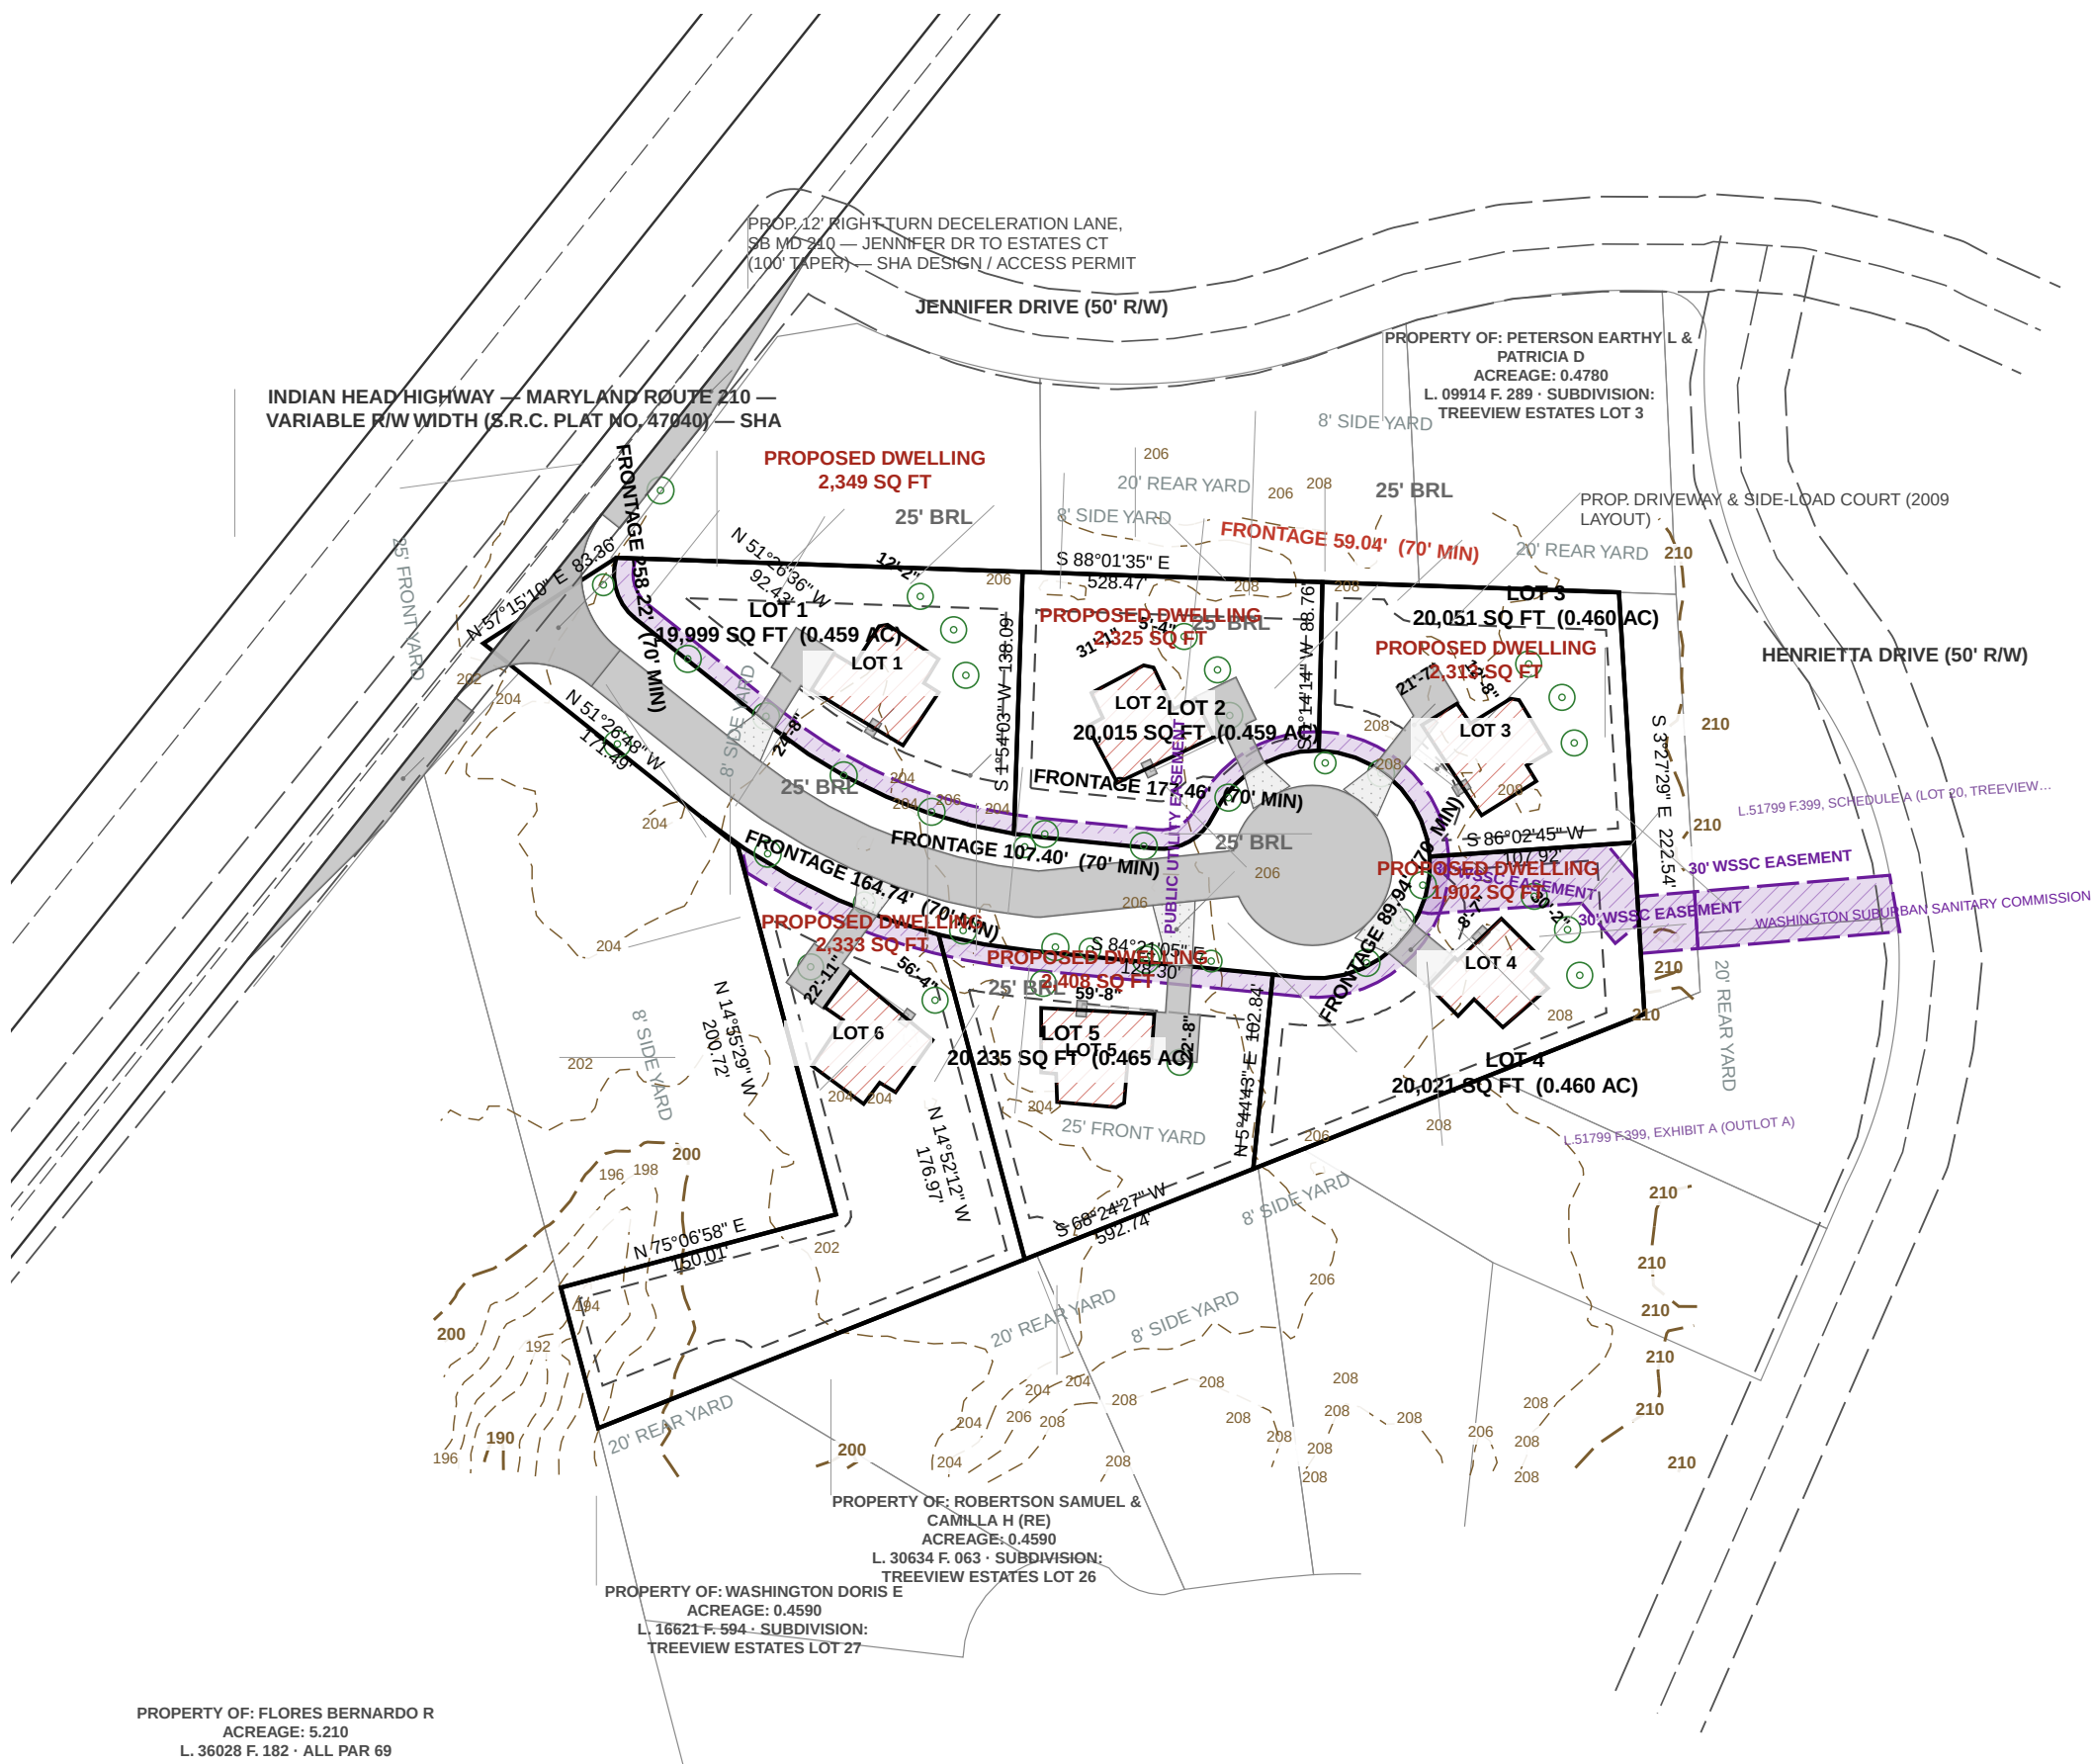

TREE CANOPY SCHEDULE

Sec. 25-128 Table 1 as amended by CB-021-2024 — 20% of NET tract area on RSP-95, met within 8'. Per lot planting per Landscape Manual Sec. 4.1(c)(1). Street trees in the right-of-way count toward canopy under Sec. 25-129.

LOT	NET AREA SF	CANOPY REQ 20% SF	SHADE PROV / REQ	ORN-EVGN PROV / REQ	STREET TREES	10-YR CANOPY PROVIDED
LOT 1	19,999	4,000	3 / 3	1	NOT ESTABLISHED	
LOT 2	20,015	4,003	3 / 4 SHORT	0 / 3 SHORT	1	NOT ESTABLISHED
LOT 3	20,051	4,010	3 / 4 SHORT	0 / 3 SHORT	1	NOT ESTABLISHED
LOT 4	20,021	4,004	3 / 4 SHORT	0 / 3 SHORT	1	NOT ESTABLISHED
LOT 5	20,235	4,047	2 / 4 SHORT	0 / 3 SHORT	3	NOT ESTABLISHED
LOT 6	29,536	5,907	2 / 4 SHORT	1	NOT ESTABLISHED	
TOTAL	129,857	25,971	16 / 23	0 / 17	24	

TEN-YEAR CANOPY IS CREDITED PER SPECIES FROM THE PRINCE GEORGE'S COUNTY LANDSCAPE MANUAL. NO SPECIES HAS BEEN SELECTED ON THIS SET, SO THE CANOPY PROVIDED IS NOT ESTABLISHED AND THE SCHEDULE IS NOT YET BALANCED. EXISTING TREES PRESERVED ALSO COUNT.


NO TREE IS PLANTED WITHIN A STORM DRAIN EASEMENT. THE 60 FT 5455 EASEMENT CARRIES THE 42 IN RCP MAN AND THE 10 FT REAR EASEMENT CARRIES THE DRAINAGE SWALE. BOTH ARE SHOWN ON THIS SHEET AND BOTH ARE EXCLUDED FROM PLANTABLE AREA.

A VARIANCE OF THE CANOPY REQUIREMENT IS AVAILABLE UNDER SEC. 25-130.


PER LOT PLANTING IS SHORT ON EVERY LOT AS DRAWN. LANDSCAPE MANUAL, SEC. 4.1(c)(3) REQUIRES 4 MAJOR SHADE AND 3 ORNAMENTAL OR EVERGREEN TREES ON A LOT OF 20,000 SF OR MORE, AND 3 AND 2 ON A LOT OF 15,000 TO 19,999 SF. NO ORNAMENTAL OR EVERGREEN TREES ARE DRAWN. AT LEAST ONE SHADE TREE MUST STAND ON THE SOUTH OR WEST SIDE WITHIN 30 FT OF THE DWELLING, AND AT LEAST ONE REQUIRED TREE IN THE FRONT YARD. SPECIES AND FINAL LOCATIONS BY THE LANDSCAPE ARCHITECT.

THE CANOPY REQUIREMENT MUST BE MET ON-SITE UNLESS A VARIANCE IS APPROVED, AND WHERE A GRADING PERMIT IS THE ONLY APPLICATION THE CANOPY NOTES BELONG ON THE GRADING PLAN — ENVIRONMENTAL TECHNICAL MANUAL PART D, SEC. 3.5.

STREET TREE PLACEMENT IN RURAL RW — SWALE & CULVERT DRIVEWAYS — PGC DPW&T STD. 600.02

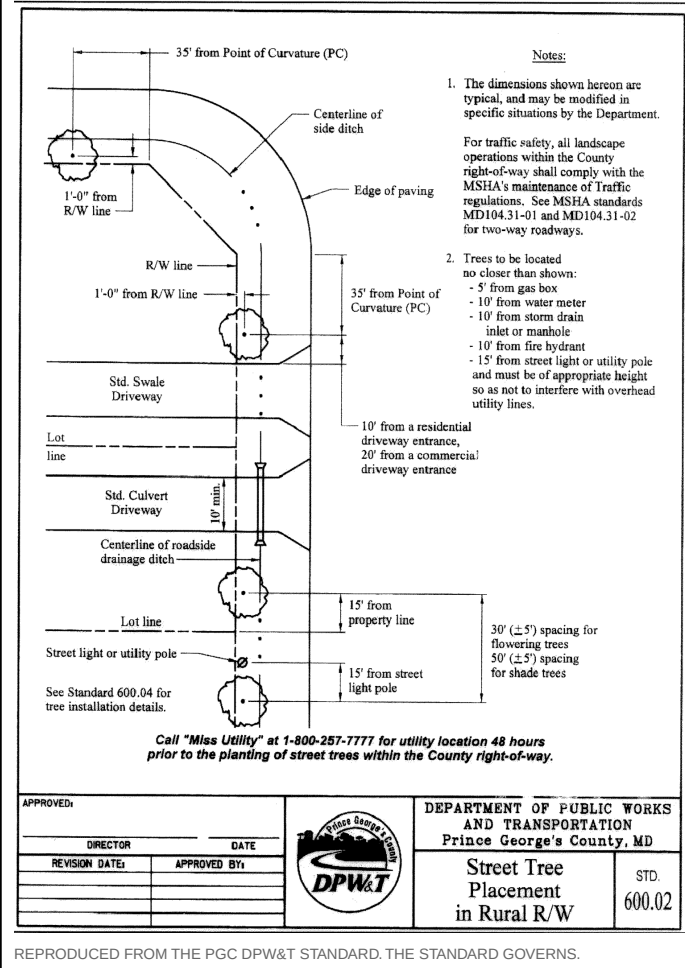

STREET LIGHT LOCATION — RURAL RESIDENTIAL — PGC DPW&T STD. 600.10

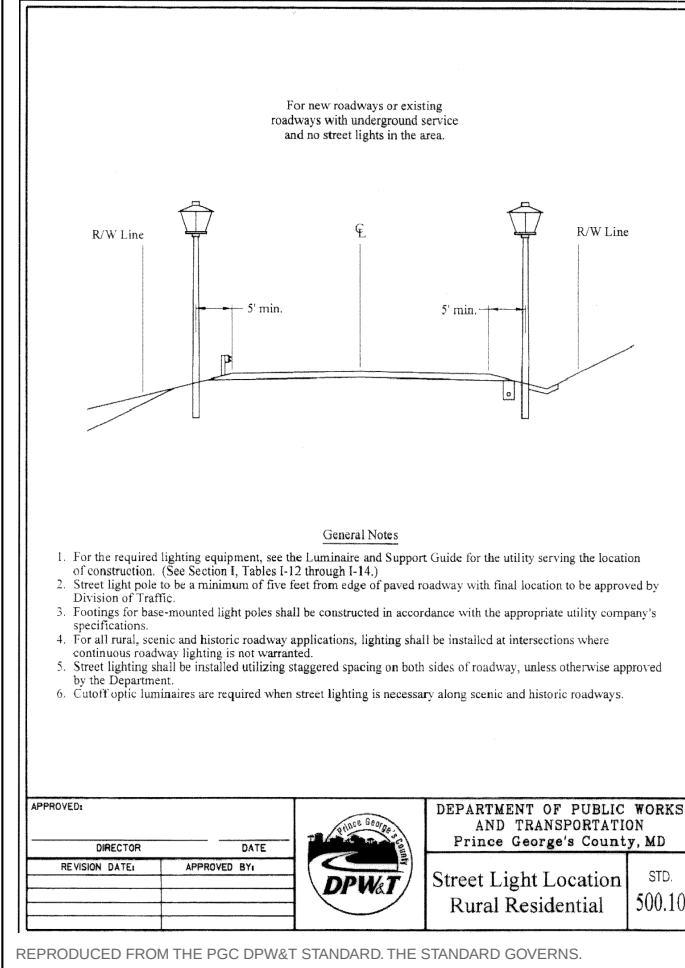

STREET TREE INSTALLATION IN RURAL RW — PGC DPW&T STD. 600.04

