

ESTATES AT INDIAN HEAD — LOTS 1-6

200-205 ESTATES COURT, ACCOKEEK, MD 20607 · PLAT BOOK PM 228 PLAT 83 · TAX MAP 151 F-3 · WSSC 220SE01 · ELECTION DIST. 5 · COUNCIL DIST. 9 · ZONE RR

Stormwater management by Environmental Site Design to the Maximum Extent Practicable (MDE Design Manual Ch. 5; PGC Subtitle 32). New submittal; base layout from the prior 2009 Street Tree & Lighting Plan, DPW&T 9399-2009-00.

PRINCE GEORGE'S COUNTY BMP SUMMARY TABLE — ESD BY POINT OF INVESTIGATION (A-15, C-9)

BMP	PRACTICE	MDE	LOCATION	OWNERSHIP / MAINT.	POI	DA SF	IMP SF	%	HSG	P,E IN	Rv	ESDv REQ CF	ESDv PROV CF	Rev REQ CF	SURFACE SF	COORDINATES (NAD 83)
ESD-1	Micro-bioretentment	M-6	Lot 1	Private — lot owner (maintenance agreement)	POI-1	19,999	4,500	22.5	C	1.2	0.253	505	505	55	525	N 367,417 E 1,311,443
ESD-2	Micro-bioretentment	M-6	Lot 2	Private — lot owner (maintenance agreement)	POI-1	20,015	2,422	12.1	C	1.0	0.159	265	265	34	330	N 367,396 E 1,311,250
ESD-3	Micro-bioretentment	M-6	Lot 3	Private — lot owner (maintenance agreement)	POI-1	20,051	3,008	15.0	C	1.0	0.185	309	309	40	386	N 367,378 E 1,311,388
ESD-4	Micro-bioretentment	M-6	Lot 4	Private — lot owner (maintenance agreement)	POI-1	20,021	2,062	10.3	C	1.0	0.143	238	238	31	298	N 367,217 E 1,311,299
ESD-5	Micro-bioretentment	M-6	Lot 5	Private — lot owner (maintenance agreement)	POI-1	20,235	2,489	12.3	C	1.0	0.161	271	272	35	340	N 367,173 E 1,311,177
ESD-6	Micro-bioretentment	M-6	Lot 6	Private — lot owner (maintenance agreement)	POI-1	29,536	2,511	8.5	C	1.0	0.127	311	311	40	389	N 367,082 E 1,310,950
ESD-5	Roadside dry swales w/ check dams (99' L)	M-8	Estates Ct RW, both sides	Public — DPPE	POI-1	36,041	21,216	58.9	C	2.0	0.580	3,483	5,992	226	3,995	N 367,342 E 1,311,097
	SUBTOTAL POI-1				POI-1							5,382	7,892			
TOTAL	7 ESD practices					165,898	38,208					5,382	7,892	461	6,263	

P_E from MDE Stormwater Design Manual (2000, Supp. 1 2009), Ch. 5, Table 5.3 — rainfall targets for ESD; HSG C governing. $R_v = 0.05 + 0.009I$; $ESD_v = P_E - R_v A/12$; $Rev = S - R_v A/12$ ($S = 0.13$ in, HSG C), met within ESD_v. M-8 provided = 6 cf per ft (4-ft bottom, 6" ponding, 2.5' media at n 0.40)

SITE DATA

ITEM	DATA
Project	Estates at Indian Head, Lots 1-6 and Estates Court
Location	S. side of MD 210, 23600 ft NE of MD 210 / MD 373; 200-205 Estates Ct., Accokeek 20761
Record	Plat Book PM 228 Plat 83 (final plat 5-08238); Tax Map 151 F-3; WSSC 200 2205051
Accounts	3987636, 3987674, 3987698, 3987699, 3987708, 3987716
Owner	General Wadsworth Reversible Trust, L32062 F 0043
Zone / use	RR (no change) – 6 single-family detached dwellings
Tract	165,019 sq. record of 3788 ac) = plat 171,505 of 565 Outlot A (6.486 sf, Coveny 156565 1.655)
Public dedication	Estates Court 60' RW, 55,173 of record – rural open section, 24' pavement, cul-de-sac
Water / sewer	W-5 (WSSC) – main from Henrietta Dr via 30' WSSC, 15,759 F 399 and prop. Lot 4 esmt
Watershed	Piscataway Creek, MD 012402303798; not Tier II; not CBFA; FEMA Zone X
Master plan	2103 Subregion 5 Master Plan & SMA; Planning Area 84; Council District 9; Election Dist. 5
Datum	NAD 83 MD State Plane (US IR); NAVD 88 (N-NCPP 2-84); 2009 spot grades on WSSC datum

APPROVALS OF RECORD

CASE	STATUS
NRI-015-06	Prior approval – base work; updated NRI required
TCP1-018-06	Prior approval – base work
TCP2-016-09	Prior approval – base work; revision or new TCP per M-NCPPC
5-08238	Final plat, PM 228 @ 83 – recorded
DPW67-9399-2009-00	Street tree & lighting plan (2009) – base layout; re-review to current standards
L51799 F.399	30' WSSC easement (Outlot A, Lot 20) – recorded 2025

GENERAL NOTES


1. Boundary per recorded plat PM 228 at 83:10 lines reproduce the plat to the second.
2. Horizontal datum: Maryland State Plane NAD 83 (US ft). Vertical datum: NAVD 88 (M-NCPPC 2' contours). 2009 spot grades are on WSSC datum (NGVD 29 = 1.6' above NAVD 88).
3. The base layout is the 2009 Street Tree & Lighting Plan (DPW67 9399-2009-00), resubmitted to review under current requirements; dwellings, side-lawn garages and courts, street trees and street lights. Lot 4 is front-lawn, (permitted for the cul-de-sac) to clear the WSSC easement.
4. A 4' x 4' x 4' rock stormwater detention (DPW67 SLD 500 1' 600/02 600/04 24' pavement, shoulders, roadside/sideways; driveways cross the swale on 15' RCP culverts with flared end sections).
5. Entrance to MD 210 (SHA) with 50' returns as the 2009; SHA access permit and sight-distance analysis reviewed. MD 210 auxiliary lanes shown on 2009 SHA plan.
6. Water and sewer: WSSC mains from Henrietta Dr through the recorded 30' WSSC easement (LS1799 399) and a 30' WSSC easement to be granted across Lot 4. Record discrepancies in the easement description to be resolved with WSSC.
7. NEW SUBMITTAL (2026). Prior approvals NAD 018-06, TCP1-018-06, and DPW67 9399-2009-00 are used as base work only and do not carry over. Additional information is added to updated/revised drawings and specifications per concept approval (Sec 4.132(a)).
8. TCP1-018-06 (revision or new) / letter of exemption as M-NCPPC Environmental Planning determinations; street tree and lighting plan re-reviewed to meet current requirements per the ESD under current Submittal 32.
9. No streams, wetlands, floodplain, PMA or Chesapeake Bay Critical Area on the property (prior NRI-015; updated NRI before).
10. Contact Miss Utility (811) at least 48 hours before any excavation.


DPIE CONCEPT PLAN DESIGN REVIEW CHECKLIST (08/25/2021) — C = SHOWN · X = N/A · O = OUTSTANDING

A-1	REQUIREMENT	REF.	C/X/O	RESPONSE / WHERE SHOWN	SHEET
A-1	Plan is labeled as Site Development Concept Plan (aka Concept Plan from MDC Sec. 1)			Everywhere is titled SITE DEVELOPMENT CONCEPT PLAN.	ALL
A-2	Print sheet size does not exceed 30" x 42" and all sheets are planned on same size paper.	5.3.2	C	All sheets 24" x 36" (ARCH D).	ALL
A-3	A 5-inch, full-height open area is provided on the right-hand side of the drawing for County approval blocks.	2.2.1.0	C	5-inch full-height strip at the right edge, kept clear for DPE.	ALL
A-4	If more than 4 plan sheets: composite plan showing match lines and sheet numbers (scale not to exceed 1"=200'); key map on each plan sheet.	2.2.1.1	C	7 sheets: the whole site is on each plan sheet at one scale, so no match lines; key map in every title block.	ALL
A-5	Match lines have a minimum length of 4 inches and identify the matching sheet number.	2.2.1.M	X	No match lines – the entire site is one viewport.	
A-6	Vertical map at a minimum scale of 1"=2,000' with north arrow and scale, upper right hand corner of cover sheet.	2.2.1.B	C	'Vicinity map at 1" = 2,000' with north arrow and bar scale, upper right.	C-000
A-7	A bar scale is provided on every sheet.		C	Graphic bar scale in every plan viewport.	C-000
A-8	Three grid ticks are provided as described in the manual.	2.2.1.E	C	Three State Plane grid ticks with N/E values on each plan.	C-200
A-9	Horizontal (MD Coordinate System, NAD 83) and vertical (NGVD 29 preferred) datum is stated on the plan.		C	Horizontal Maryland State Plane, NAD 83 (EPSG 2248), US ft, vertical NAVD 88 (M-NCPNC 2+ft), 2009 spot heights WGS84 datum as noted.	ALL
A-10	General notes about the project are provided.		C	General notes on the cover sheet.	C-000
A-11	The entire property shall be shown at a maximum plan scale of 1 inch = 50 feet (preferred) within the plan set.	5.3.2	C	Entire property at 1" = 30'.	C-000
A-12	All existing structures and site features including cultural resources, historic site features, and any visible foundations or ruins are shown.	5.3.2	C	Existing structures, adjoining houses, fences, sheds, wells, easements of record shown; no historic sites or ruins.	C-000
A-13	Topographic contours at maximum 2 foot interval, extending at least 100 feet beyond the property.	32-182	C	M-NCPNC 2-ft contours, 100' beyond the property.	C-000
A-14	All existing utilities and utility easements are shown.		C	WSSC easement, S15799 F 399 and the proposed Lot 4 WSSC easement; public utility easements along the frontage; existing mains in Henrietta DR noted (sized to verify on WSSC 2205E01).	C-300
A-15	The County BMP Summary Table is provided. Preferred location is the cover sheet.	5.3.1	C	County BMP Summary Table, 7 practices.	C-000
B-1	Banks of all regulated streams or a centerline if the banks are too close together to graphically show.	5.0.7.1	X	No streams on map. New submittal: prior NR1-015-06 (with TCP2-018-06, TCP2-016-09) is based on only. Updated/revised NRI to be provided in draft with this submission; approved copy required before concept approval (Sec. 32-182(a)).	
B-2	Location of stream and stream buffers and/or enhanced buffers per MNCPPC and SCD criteria.	MD 5.7	X	No streams, no stream buffers.	
B-3	Location of wetlands and/or wetlands of special state concern and appropriate wetland buffers.	MD 5.7	X	No wetlands on or within 100 ft (DNR, NRI).	
B-4	Delineation of the 100-year floodplain, per Techno-Grant 004-2020.	MD 5.7	X	FEMA Zone X or 100-yr floodplain on within 100 ft.	
B-5	Location of steep slopes (15% and greater) clearly shown on the plan and in the legend.	M-NCPNC	C	Slopes 15-25%: 2.757 sf; >25%: 520 sf – shown and in the legend.	
B-6	The Primary Management Area is delineated.	MD 5.7	X	No PMA on the plan.	
B-7	Existing woodland is delineated on the property.	MD 5.7	C	No woodland conservation shown on this concept. Prior NR1-015-06 / TCP2-018-06 are base work only; woodland per updated NRI, with a TCP2 revision or new TCP / letter of explanation as M-NCPNC determines.	C-100
B-8	Existing environmental features extend off the property 100 feet in all directions.	MNCPPC	C	Environmental features drawn 100 ft beyond the property.	C-100
B-9	Soils types and soil boundaries from USDA NRCS Soil Survey (Dec. 2009) or later.		C	Soil types and boundaries from USDA NRCS (PGAtlas soil layer); CwE (HS C); UdaR (HS-); baB (HS C); baB (HS C).	C-100
B-10	Plan notes identify TMDL watershed (sediment, nitrogen, phosphorus) and Tier I waters/waterbodies.		C	Chesapeake Bay TMDL (nitrogen, phosphorus, sediment) applies; MD 12 digit watershed 021402030798, Potomac River (0214020301), Tier I: no.	C-000
B-11	Highly erodible soils noted.	MD 5.7	C	Beltsville soil loam (K 0.37) is highly erodible where slopes are 15% or more; those areas are stabilized within 3 days.	C-000
B-12	Springs and seeps noted.	MD 5.7	X	None observed or mapped.	
B-13	Bedrock and Marblage Clay outcrops noted.	MD 5.7	X	No bedrock or Marblage clay mapped (PGAtlas); geotechnical report to confirm (E-2).	
B-14	Chesapeake Bay Critical Area delineated.	MD 5.7	X	Not in the Chesapeake Bay Critical Area.	


CHECKLIST (CONT.)

ITEM	REQUIREMENT	REF.	C/X/O	RESPONSE / WHERE SHOWN	SHEET
C-1	Project layout is shown, including roads, buildings, parking, sidewalk and other improvements and associated grading.	32-182	C	Estates Court, 6 dwellings, driveways and courts, entrance at WD 210, grading.	C-200
C-2	Preliminary locations of ESD and structural stormwater practices; grading for drains where slopes exceed 15%.	32-182	C	7 ESD practices (micro-bioretentation M-6 per lot; roadside dry swales M-8).	C-240
C-3	Preliminary locations of storm drain inlets and culverts; entrance and outfall structures located beyond project limits (assessments may be required).	5.2.4.4.2B / 32-162 A.6	C	Open swale – no inlets; 6 driveway culverts (15" RCP) with end sections; swales outfall at the entrance to the MD 210 roadside ditch (SHA).	C-400
C-4	Limit of Disturbance shown for all site work, incl. water, sewer, storm drain, SWM, road improvements, sediment control, stockpile.	32-182	C	LOD 22,317 sf incl. mains, easement work off site, sediment control and stockpile.	C-500
C-5	Existing easements shown and any required offsets proposed easement.		C	Recorded WSSC easement (Outlet A, Lot 20) and proposed Lot WSSC easement; private SWM easements over ESD practices.	C-300
C-6	Locations, names and widths of existing and ultimate right-of-way of adjacent streets and alleys; public vs. private note.		C	MD 210 (variable RW, SHA), Estates Ct (60' public), 30' driveway (R, smaller DR (50' public), 30' RW in common L10142 E 7,725 private)	C-200
C-7	Existing and proposed water well and septic field locations are shown.		C	No wells or septic; proposed (public water and sewer). Existing well on Parcel 199 (15608 Indian Head Hwy), off site, shown.	C-100
C-8	Proposed public dedication area including any proposed parkland is shown and labeled.		C	Estates Court public dedication 36,041 sf (plat PM 228 @ 30' show ESD Required)	C-200
C-9	Point(s) of investigation shown, ESDv computations and BMP Summary Table broken out to show ESD Required is Provided within each POI.		C	3 POI(s), ESDv required vs. provided tabulated per POI.	C-400
C-10	The ultimate 100-year stormwater overflow path is shown throughout the site using flow arrows.		C	100+ year overflow arrows from every practice to its POI	C-400
C-11	Drainage areas to each device, off-site drainage onto the site, and to site outfalls; diverted areas analysed for no increase in 100-yr discharge.		C	Drainage area to each practice; off-site area onto the site @ 6% ac; no diversion between POIs	C-400
C-12	Where grading blocks a drainage course, ponding limits before and after grading are shown.		X	No fill across a drainage course.	
D-1	Report addresses natural resource protection, natural flow patterns, impervious reduction, ESC integration, ESD planning to the MEP.	MDE 5.11	O	SWM concept narrative (ESD to the MEP, flow patterns, ESC integration) – to accompany the plans.	
D-2	If in the Chesapeake Bay Critical Area, discussion of how requirements are met; preliminary computations.		X	Not in the Chesapeake Bay Critical Area.	
D-3	Outfalls located outside the site, to existing storm drain or 100-yr floodplain; otherwise the discharge area is described.		O	Narrative: outfalls at the POIs; swales discharge to the MD 210 roadside ditch; describe receiving areas.	
D-4	Stabilization at downstream outfall and upstream inflow evaluated; measures against gully formation discussed.		O	Narrative: outfall stabilization (level spreaders / riprap) at each POI.	
D-5	Photographs of the stream at the downstream outfall and upstream property line; eroded slopes.		X	No stream at the outfalls.	
D-6	If outfall is to an existing SWM facility, its capacity for the added area and flow is documented.		X	No existing SWM facility receives the site.	
D-7	If returned to higher imperviousness, effects on downstream properties analysed.		X	No rezoning (RR remains RR).	
D-8	Floodplain ordinance discussion (drainage courses, buildings within 25 ft of floodplain, dams, downstream crossings).		X	No floodplain or drainage course on or downstream within the site; no dams.	
D-9	If a waiver of water quality or quantity is requested, the basis is provided.		X	No waiver requested.	
D-10	Computations: ESDWQv required and provided; 100-year runoff and proposed runoff; downstream storm drain analysis with 10-yr credit if inadequate.	5.3.3 / 5.2.6.1 / 5.2.4.2 / TG 002-2019	O	ESDv computations are on the cover; 100-yr runoff provided runoff at each POI and downstream analysis to follow in the report.	
E-1	A Geotechnical Report for SWM is provided to support concept development and feasibility.	5.3.3 / TG 004-2018	O	Geotechnical report for SWM (borings and Sec. 32-131 infiltration tests at each practice) – to be submitted.	
E-2	Geotechnical Report addresses Marlboro and Christina clays, sulfidic and diatomaceous soils.	5.3.3 / TG 005-2018 / PGSCD-1.8	O	Geotechnical report to address Marlboro/Christiana clays, sulfidic and diatomaceous soils.	
E-3	Affidavit of Public Informational mailing is provided with second submission.	32-182(g)	O	Affidavit of the adjacent-owner mailing (within 7 days of submission) – with second submission.	
E-4	A draft Natural Resource Inventory is provided with initial submission (approved copy required prior to approval).	32-182(a)	O	A new Natural Resource Inventory (TCF-018-06) is base work only. Updated/revised NRI to be provided in draft with this submission; approved copy required before concept approval (Sec. 32-182(a)).	

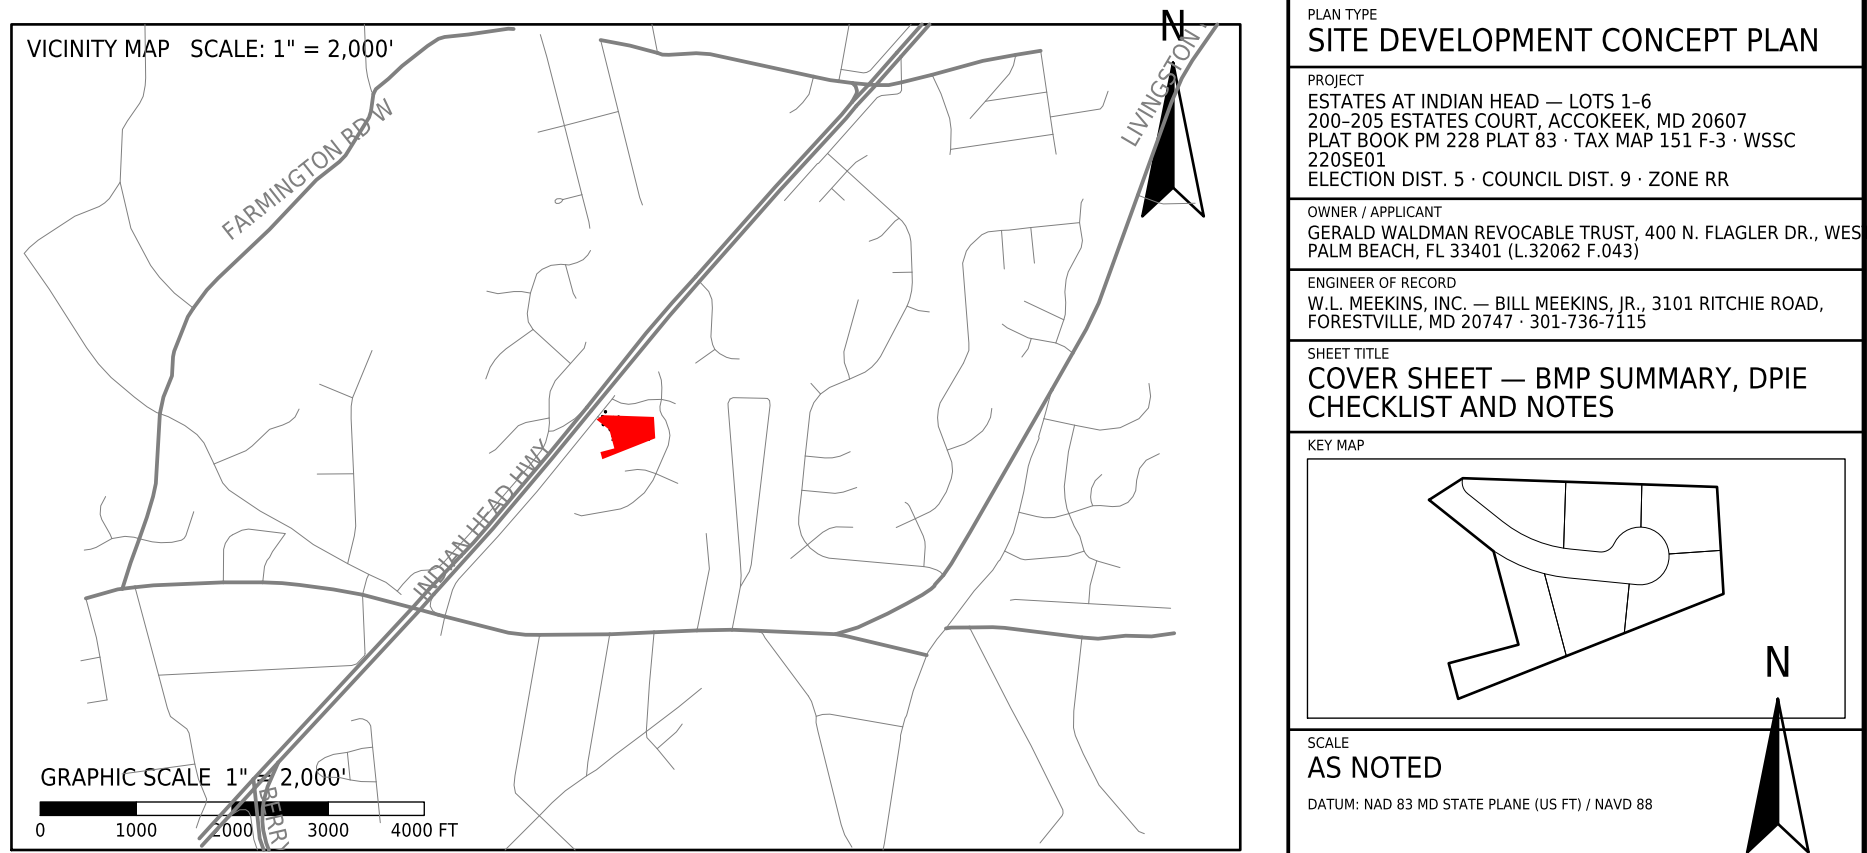

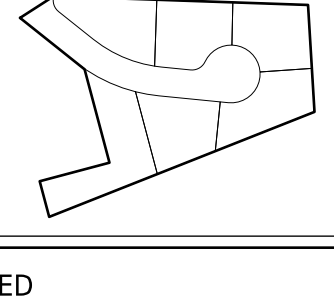PLAN TYPE SITE DEVELOPMENT CONCEPT PLAN								
PROJECT ESTATES AT INDIAN HEAD – LOTS 1-6 206-205 ESTATES COURT, ACCOKEE, MD 20607 PLAT BOOK PM 228 PLAT 63 TAX MAP 251 F-1 WSSC 2205001 ELECTION DIST. 5 COUNCIL DIST. 9 ZONE RR								
OWNER / APPLICANT GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WES PALM BEACH, FL 33401 (L:32062 P:043)								
ENGINEER OF RECORD W.L. MEERKINS, INC. – BILL MEERKINS, PR. 3101 RITCHIE ROAD, PALM BEACH, MD 20747-3601/736-7115								
SHEET TITLE COVER SHEET – BMP SUMMARY, DPEI CHECKLIST AND NOTES								
KEY MAP 								
SCALE AS NOTED DATUM: NAD 83 MD STATE PLANE (US FT.) / NAVD 88								
REVISIONS <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="width: 10%;">NO.</th> <th style="width: 30%;">DATE</th> <th style="width: 60%;">DESCRIPTION</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>2026-09-30</td> <td>CONCEPT SUBMISSION 1</td> </tr> </tbody> </table> 			NO.	DATE	DESCRIPTION	1	2026-09-30	CONCEPT SUBMISSION 1
NO.	DATE	DESCRIPTION						
1	2026-09-30	CONCEPT SUBMISSION 1						

PROFESSIONAL CERTIFICATION
I hereby certify that these documents were prepared or approved by me,
and that I am a duly licensed professional engineer under the laws of
the State of Maryland. License No. _____ Exp. _____




CONCEPT SUBMISSION 1 — NOT SEALED
DATE 2026-09-30 · JOB KEA-EIH-2026
PREPARED WITH KEALEE SPATIAL ENGINE / CAD-PLOT

SHEET INDEX


1	C-000 COVER SHEET	2	BMD SUMMARY, BMD CHECKLIST AND NOTES
---	-------------------	---	--------------------------------------

- C-000 COVER SHEET — BMP SUMMARY, DPE CHECKLIST AND NOTES
- C-100 EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES
- C-200 SITE LAYOUT, GRADING AND PAVING PLAN
- C-300 UTILITY, STREET LIGHT AND STREET TREE PLAN
- C-400 STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP
- C-500 SEDIMENT AND EROSION CONTROL PLAN
- C-600 DETAILS

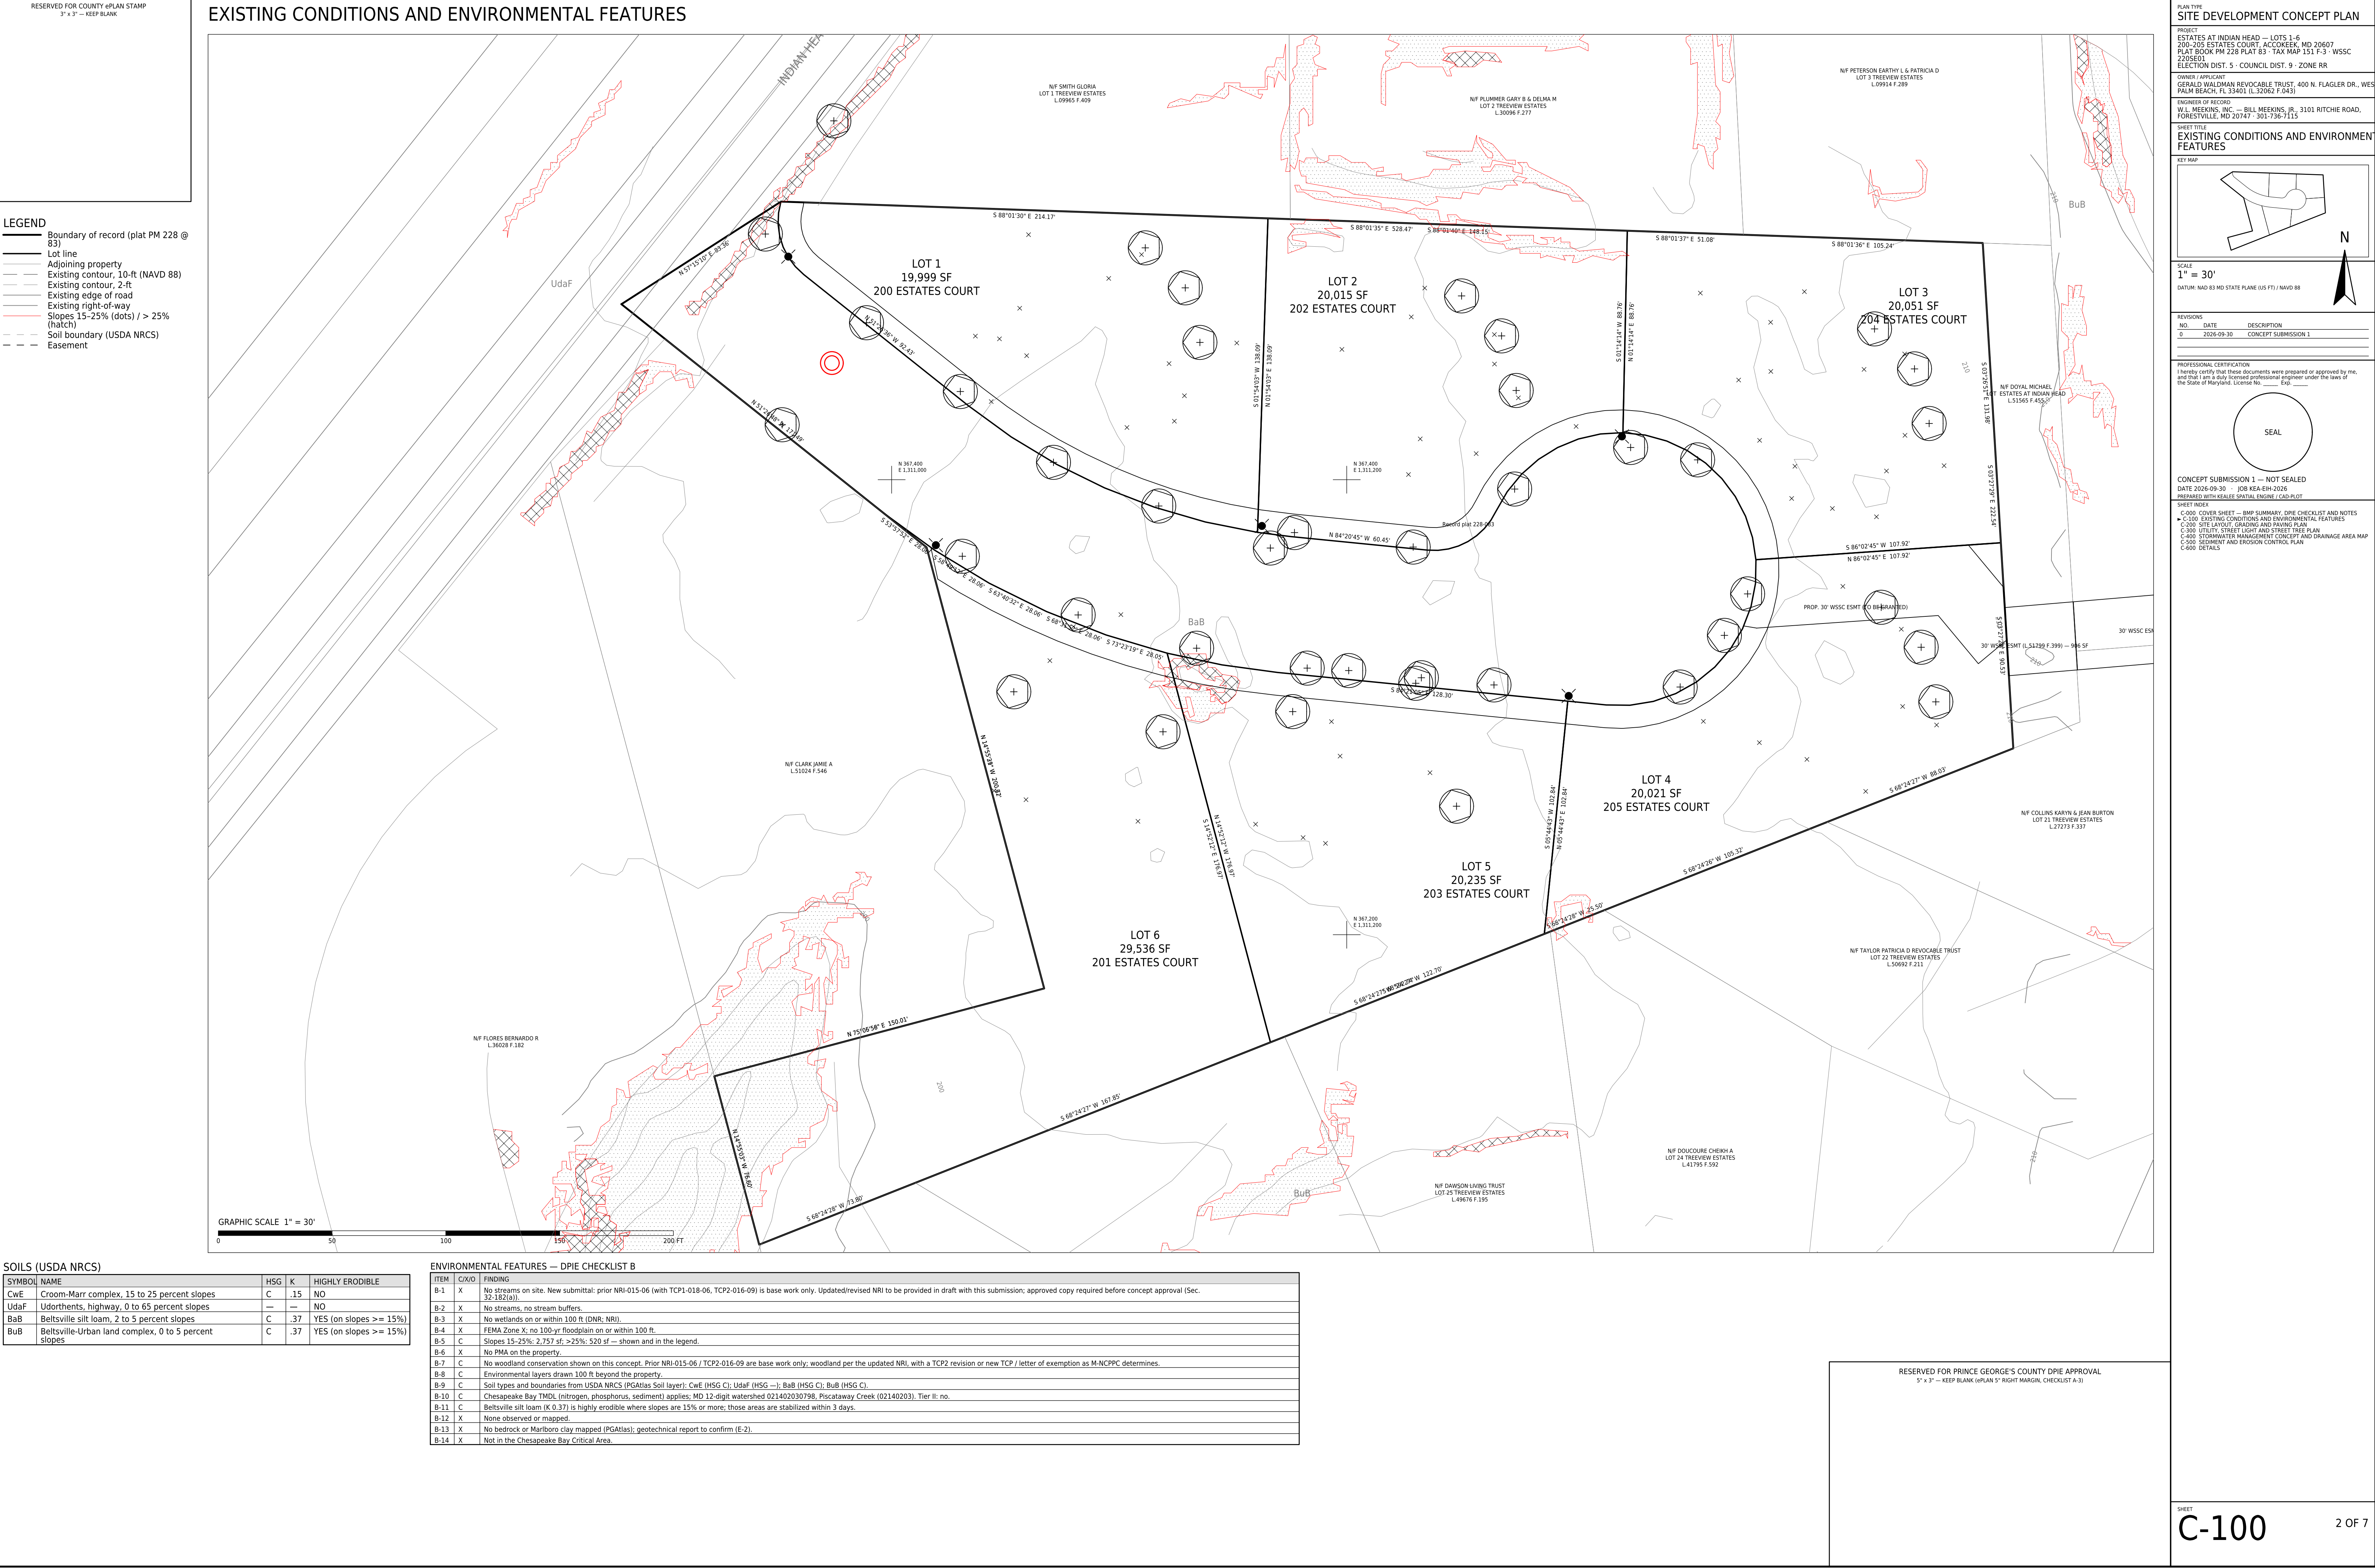

SITE LAYOUT, GRADING AND PAVING PLAN

- Boundary of record
- Estates Ct right-of-way
- Proposed pavement
- Roadside swale (flowline)
- Driveway culvert, 15" RCP w/ end sections
- Proposed dwelling
- Building restriction line
- Proposed contour
- Existing contour
- Spot elevation (2009 plan, WSSC datum)
- Limit of disturbance
- MD 210 auxiliary lane (SHA)

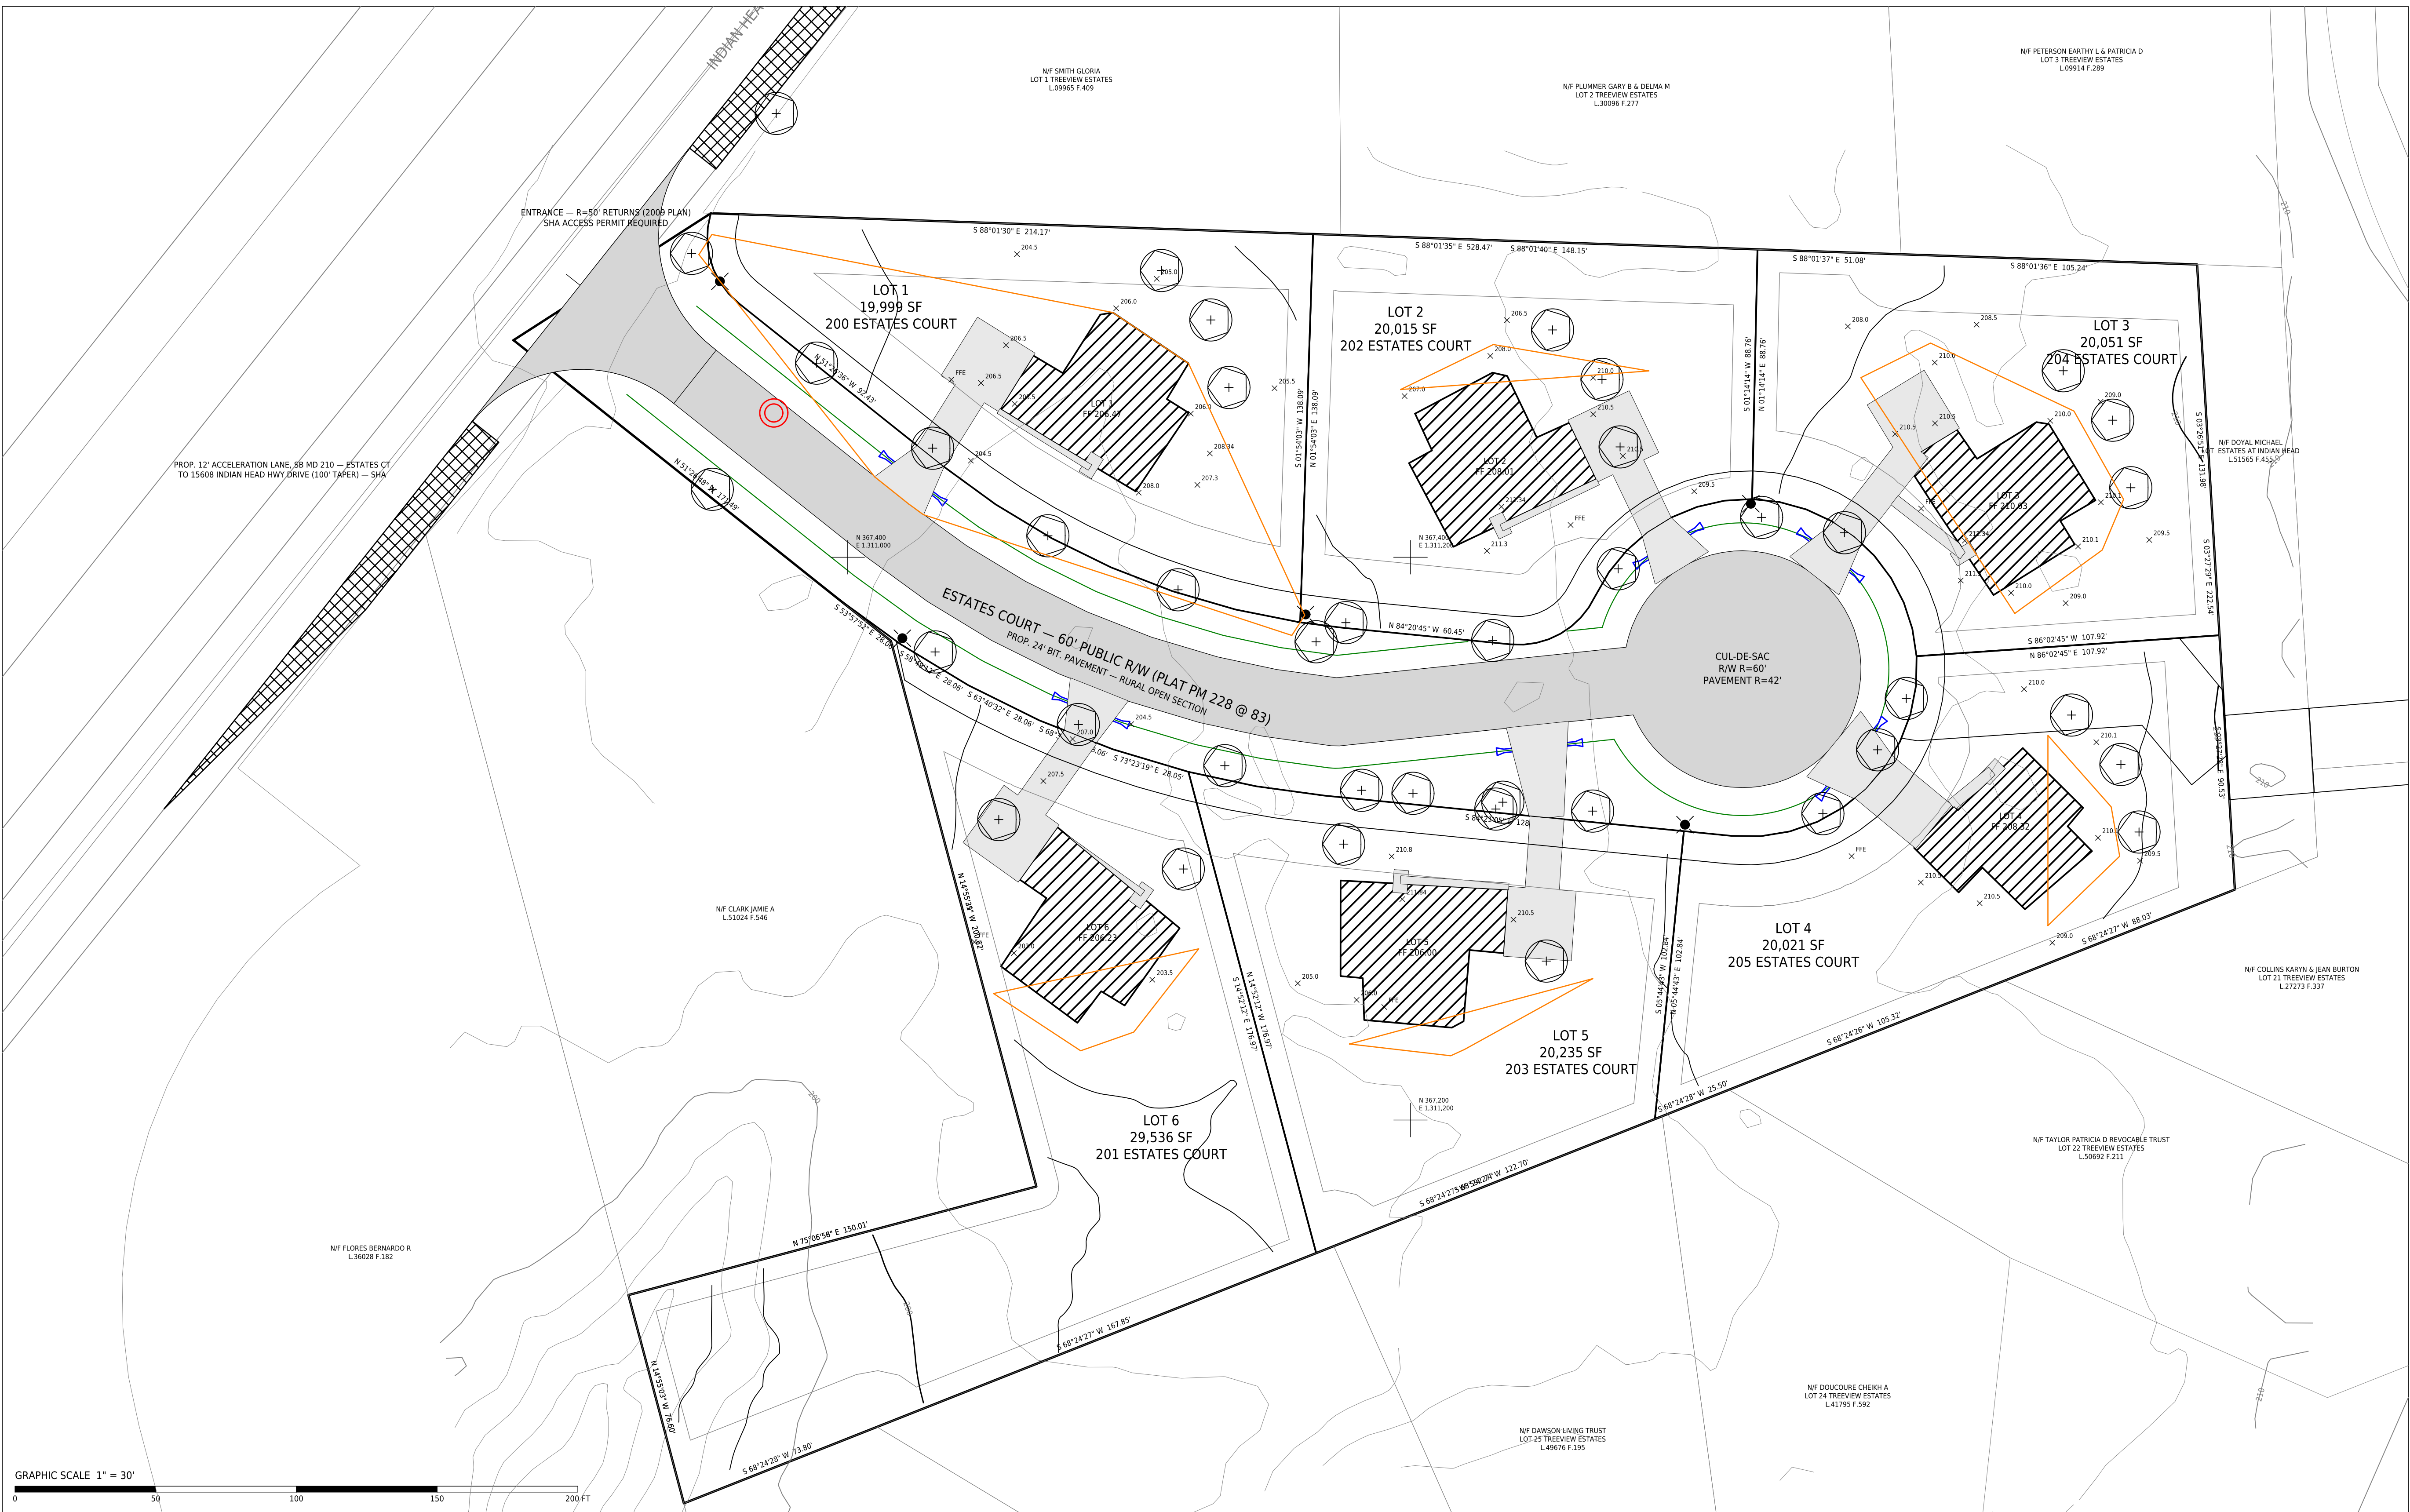

LOT	ADDRESS	FOOTPRINT SF	GARAGE FF (NAVD 88)	B (NAVD 88)
LOT 1	200 ESTATES COURT	2349	206.47	197.47
LOT 2	202 ESTATES COURT	2325	208.01	199.01
LOT 3	204 ESTATES COURT	2313	210.03	201.03
LOT 4	206 ESTATES COURT	1902	208.32	199.32
LOT 5	203 ESTATES COURT	2408	206.00	197.00
LOT 6	201 ESTATES COURT	2333	206.23	197.23

1. Boundary per recorded plat PM 228 @ 83; lot lines reproduce the plat to the second.
2. Horizontal datum: Maryland State Plane NAD 83 (US ft). Vertical datum: NAVD 88 (M-NCPPC 2-ft contours). 2009 spot grades are on WSSC datum (= NAVD 88 + 1.6 ft). DPHE prefers NGVD 29.
3. The base layout is the 2009 Street Tree & Lighting Plan (DPWGT 9399-2009-00), resubmitted for review under current requirements: dwellings, side-load garages and courts, street trees and street lights. Lot 4 is front-load (garage to the cul-de-sac) to clear the WSSC easement.
4. Estates Court is a rural open section (DPWST Std. 500.10 / 600.02 / 600.04): 24' pavement, shoulders, roadside swales; driveways cross the swale on 15" RCP culverts with flared end sections.
5. Entrance to MD 210 (SHA) with 50' returns as the 2009 plan; SHA access permit and sight-distance analysis off the MD 210 auxiliary lanes shown for SHA review; R/W dedication may be required.
6. MD 210 frontage improvements are shown for SHA review. At the entrance the MD 210 R/W line aligns about 6 ft off the edge of road (2009 sheet), so a 12-ft lane needs R/W dedication along Lots 1 and 6 or SHA agreement. Lane lengths and tapers are set by SHA's access-permit review and traffic study

SHEET INDEX

C-000	COVER SHEET — BMP SUMMARY, DPIE CHECKLIST AND NOTES
C-100	EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES
► C-200	SITE LAYOUT, GRADING AND PAVING PLAN
C-300	UTILITY, STREET LIGHT AND STREET TREE PLAN
C-400	STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP
C-500	SEDIMENT AND EROSION CONTROL PLAN
C-600	DETAILS

 Proposed 8" water main
 Proposed 8" sanitary sewer
 House connection
 WSSC easement (recorded / proposed)
 Street tree — Red Maple (2009 plan)
 Street light (2009 plan)




SYMBOL	QTY	ITEM	SIZE / TYPE	STANDARD
TREE	16	ACER RUBRUM — RED MAPLE	2 1/2"-3" CAL., B&B	DPW&T 600.02 / 600.04
LIGHT	5	STREET LIGHT (SMECO)	100 W HPS COLONIAL POST-TOSS, TYPE IV, BLACK FINGERGLASS	DPW&T 500.10

1. Water and sewer by WSSC (W-3 / 5-3). Mains from the existing WSSC mains in Henrietta Drive through the recorded 30' WSSC easement (L.51799 F.399, Outlot A and Lot 20) and a 30' WSSC easement to be granted across Lot 4 along the Lot 3/4 line.
2. Sizes and invert of the Henrietta Drive mains to be verified on WSSC 200' sheet 220S01 before technical design.
3. Street lights and street trees follow the approved 2009 Street Tree & Lighting Plan (DPW&T 9399-2009; light permit 09.09399); electric service by SMECO.
4. Keep street trees 10 ft from water meters and storm structures and 15 ft from street lights (DPW&T 600.02).
5. Contact Miss Utility (811) at least 48 hours before excavation.

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP

- LEGEND
- ESD practice — micro-bioretenction (M-6)
 - Roadside dry swale (M-8)
 - Drainage area to practice
 - Off-site area draining onto site
 - 100-yr overflow path
 - Point of investigation
 - Driveway culvert

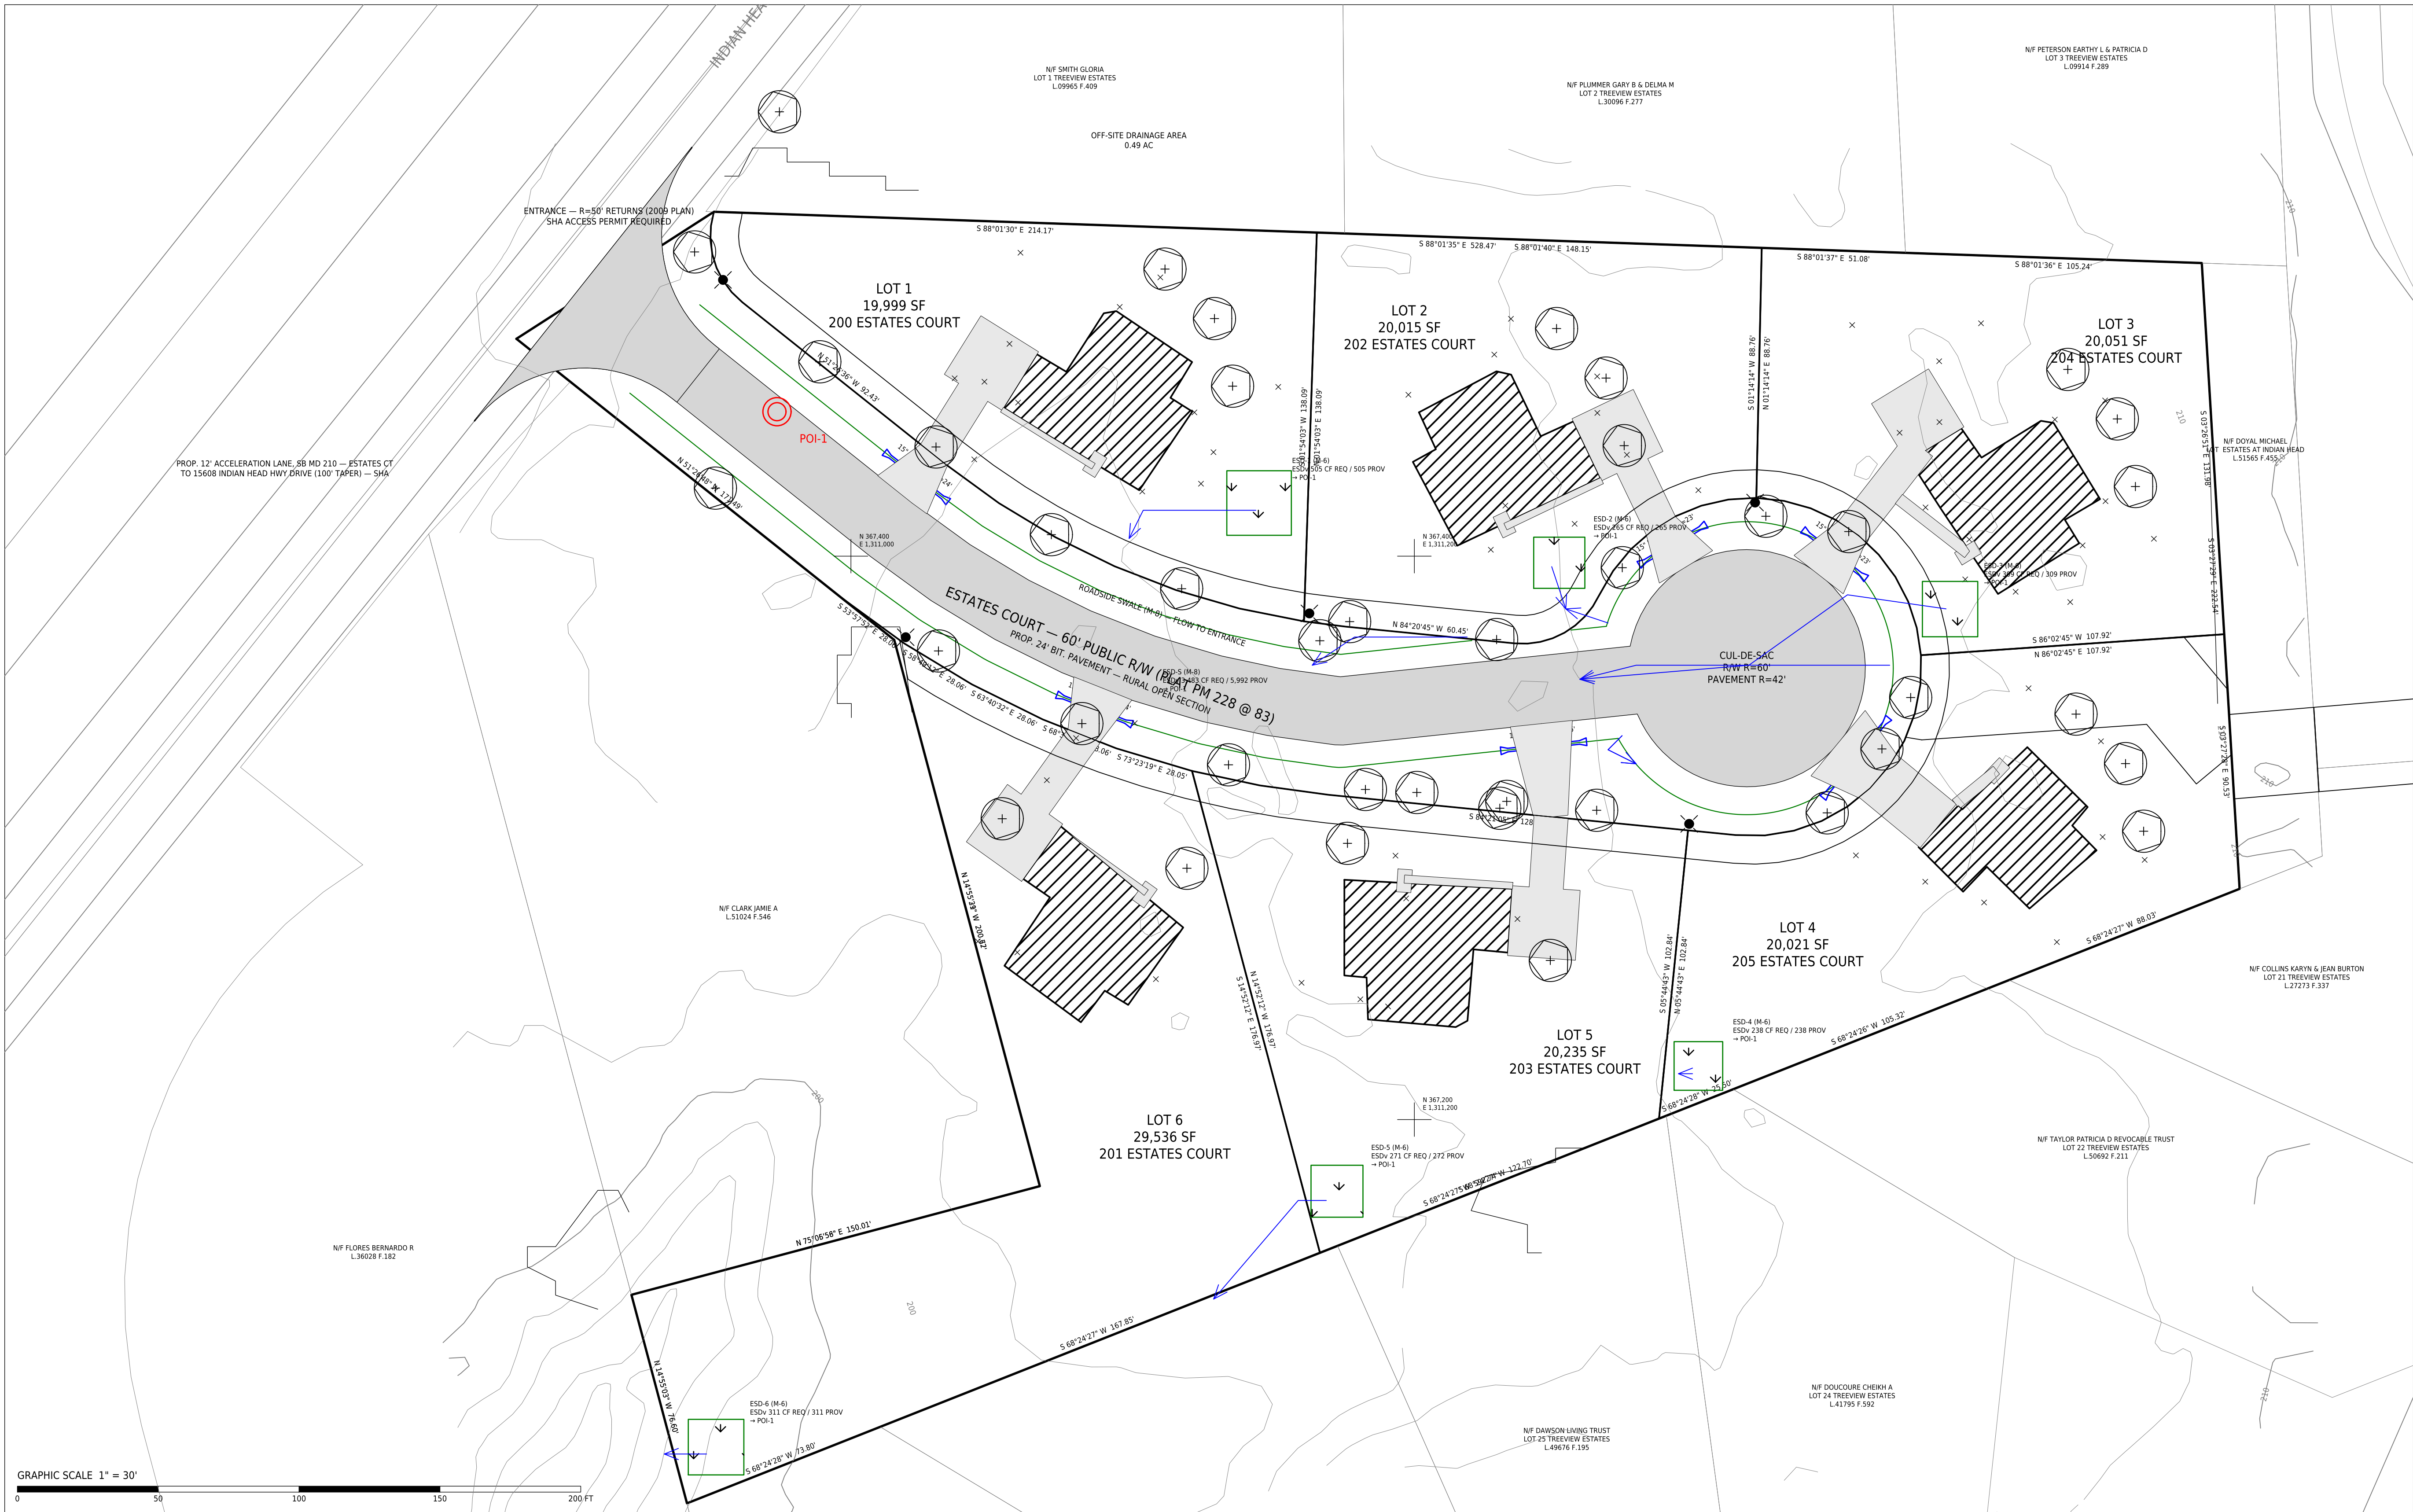

ESD PER PRACTICE (FULL TABLE ON C-000)

BMP	MDE	LOCATION	POI	DA SF	%I	P_E	ESDv REQ	ESDv PROV
ESD-1	M-6	Lot 1	POI-1	19,999	22.5	1.2	505	505
ESD-2	M-6	Lot 2	POI-1	20,015	12.1	1.0	265	265
ESD-3	M-6	Lot 3	POI-1	20,051	15.0	1.0	309	309
ESD-4	M-6	Lot 4	POI-1	20,021	10.3	1.0	238	238
ESD-5	M-6	Lot 5	POI-1	20,235	12.3	1.0	271	272
ESD-6	M-6	Lot 6	POI-1	29,536	8.5	1.0	311	311
ESD-5	M-8	Estates Ct R/W, both sides	POI-1	36,041	58.9	2.0	3,483	5,992

POINTS OF INVESTIGATION (C-9)

POI	LOCATION	SHARE	ESDv REQ	ESDv PROV
POI-1	N 367,451 E 1,310,974	100%	5,382	7,892

SWM NOTES

- SWM by Environmental Site Design to the MEP (Md. Stormwater Management Act of 2007; MDE Design Manual Ch. 5; PCG Subtitle 32). Target rainfall P_E from MDE Table 5.3 for HSG C at each drainage area's imperviousness.
- Each lot drains to one micro-bioretenction cell (M-6): 12-in max. ponding; 2.5-ft filter media; underdrain to a stable outfall. Estates Court drains to roadside dry swales (M-8) with check dams.
- Rooftop and non-rooftop disconnection (N-1, N-2) to be credited at technical design. Infiltration credit only where Sec. 32-131 borings show ≥ 0.52 in/hr.
- Private ESD practices: maintenance agreement recorded before permit; public swales in the R/W maintained by DPPE.
- D8 flow routing on a 5-ft surface interpolated from the existing 2-ft contours; exit points clustered at 120 ft; POIs carrying under 4% of the site omitted.

PLAN TYPE
SITE DEVELOPMENT CONCEPT PLAN


PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT BOOK PW 228 PLAT 83 TAX MAP 151 F-3 - WSSC
220501
ELECTION DIST. 5 COUNCIL DIST. 9 ZONE RR

OWNER / APPLICANT
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST
PALM BEACH, FL 33401 (L32062 F.043)

ENGINEER OF RECORD
W.L. MECKINS, INC. — BILL MECKINS, JR., 3101 RITCHIE ROAD,
FORESTVILLE, MD 20747 301-736-7115

SHEET TITLE
STORMWATER MANAGEMENT CONCEPT AND
DRAINAGE AREA MAP

KEY MAP

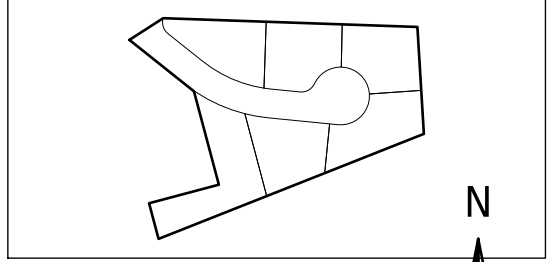


SCALE
1" = 30'

DATUM: NAD 83 MD STATE PLANE (US FT) / NAD83

REVISIONS		
NO.	DATE	DESCRIPTION
0	2026-09-30	CONCEPT SUBMISSION 1

PROFESSIONAL CERTIFICATION
I hereby certify that these documents were prepared or approved by me,
and that I am a duly licensed professional engineer under the laws of
the State of Maryland. License No. _____ EIT _____

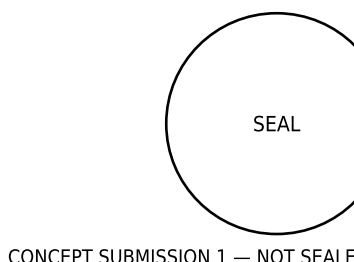

CONCEPT SUBMISSION 1 — NOT SEALED

DATE 2026-09-30 JOB KEA-EH-2026

DRAWN WITH SCALE 3/32"=1' ENGINEER / C-000-001

SHEET INDEX
C-000 COVER SHEET — BMP SUMMARY, DPE CHECKLIST AND NOTES

C-100 EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES

C-200 SITE LAYOUT, GRADING AND PAVING PLAN

C-300 UTILITY, STREET LIGHT AND STREET TREE PLAN

C-400 STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP

C-500 SEDIMENT AND EROSION CONTROL PLAN

C-600 DETAILS

RESERVED FOR PRINCE GEORGE'S COUNTY DPE APPROVAL
3" x 3" — KEEP BLANK (UPAN 5 RIGHT MARGIN, CHECKLIST A-3)

SHEET

C-400

5 OF 7

SEDIMENT AND EROSION CONTROL PLAN

— — — — — Limit of disturbance
 — — — — — Super silt fence
 — — — — — Stabilized construction entrance
 — — — — — Proposed contour
 — — — — — Existing contour



1. Sediment and erosion control per the 2011 Maryland Standards and Specifications for Soil Erosion and Sediment Control and PGSCD requirements.
2. Stabilized construction entrance at the Estates Court entrance; super silt fence along the down-gradient limit of disturbance; inlet and swale protection.
3. Stabilize disturbed areas within 3 days on slopes $\geq 3:1$ and within 7 days elsewhere.

1. Pre-construction meeting with the PGSCD / DPE inspector; Miss Utility.
2. Install stabilized construction entrance and perimeter controls; inspector approval.
3. Clear and grub within the LOD; rough grade Estates Court and swales.
4. Install water and sewer (Henrietta Dr to Estates Ct) and house connections.
5. Construct pavement, shoulders, culverts and entrance; stabilize swales.
6. Build dwellings, driveways and courts; construct ESD practices after the contributing area is stable.
7. Fine grade, permanent stabilization, street trees and lights; remove controls with inspector approval.




RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

SHEET INDEX


- C-000 COVER SHEET — BMP SUMMARY, DPE CHECKLIST AND NOTES
- C-100 EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES
- C-200 SITE LAYOUT, GRADING AND PAVING PLAN
- C-300 UTILITY, STREET LIGHT AND STREET TREE PLAN
- C-400 STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP
- C-500 SEDIMENT AND EROSION CONTROL PLAN
- C-600 DETAILS

SHEET
C-500
6 OF

DETAILS

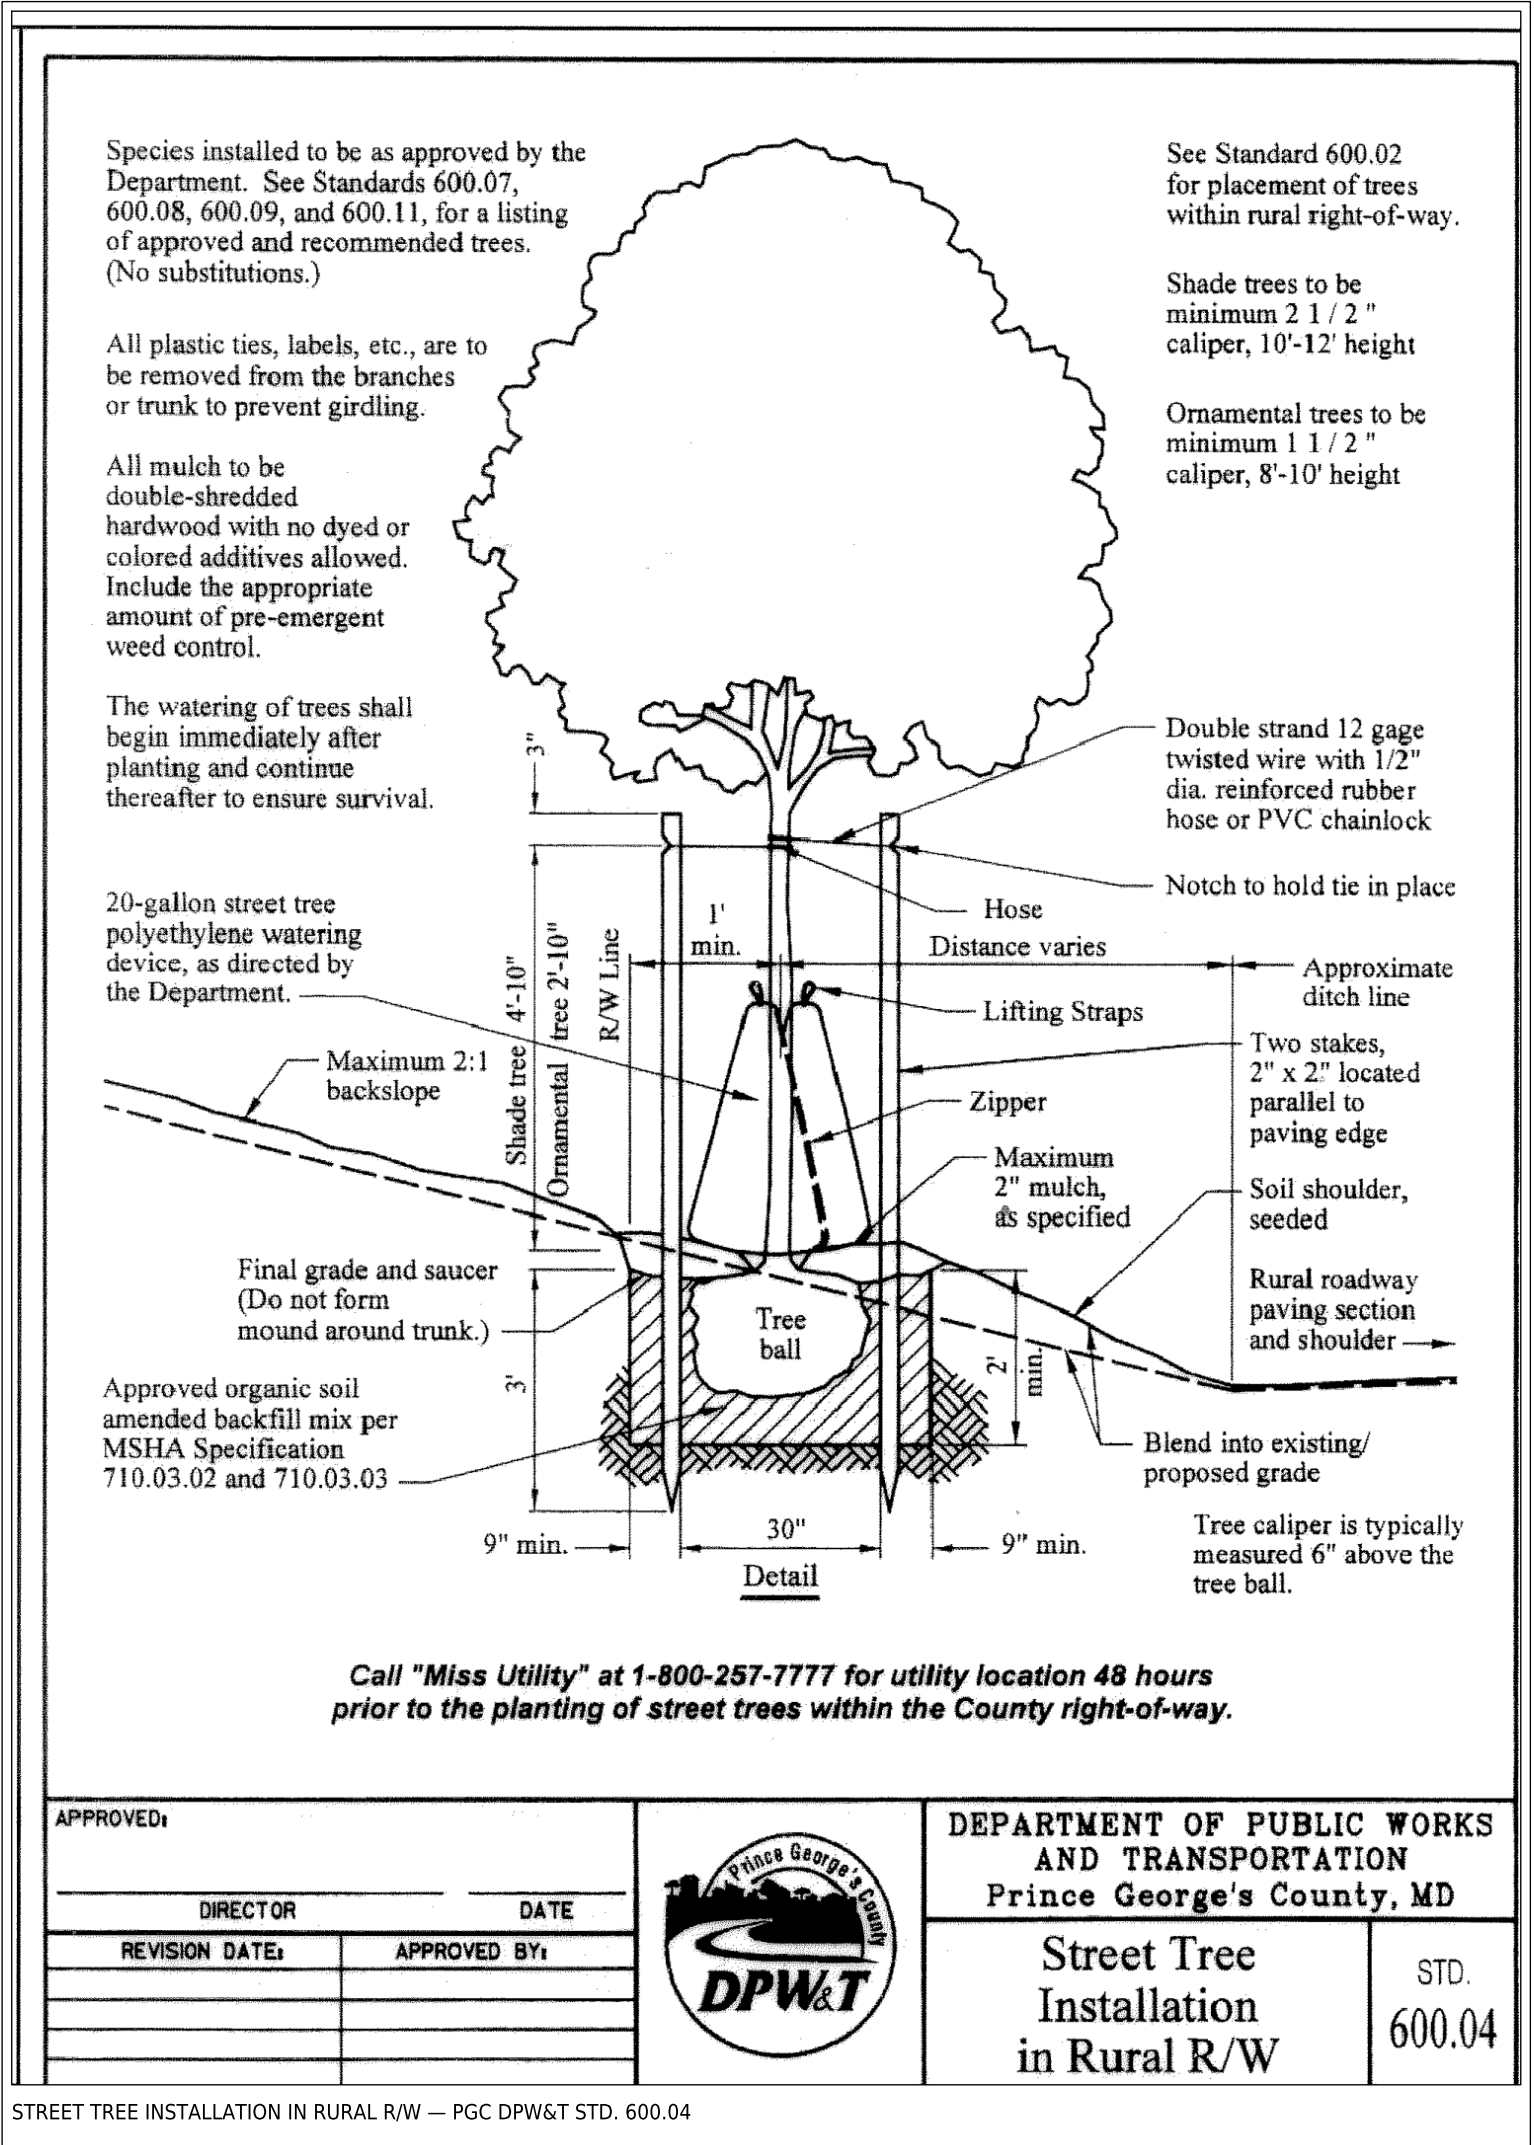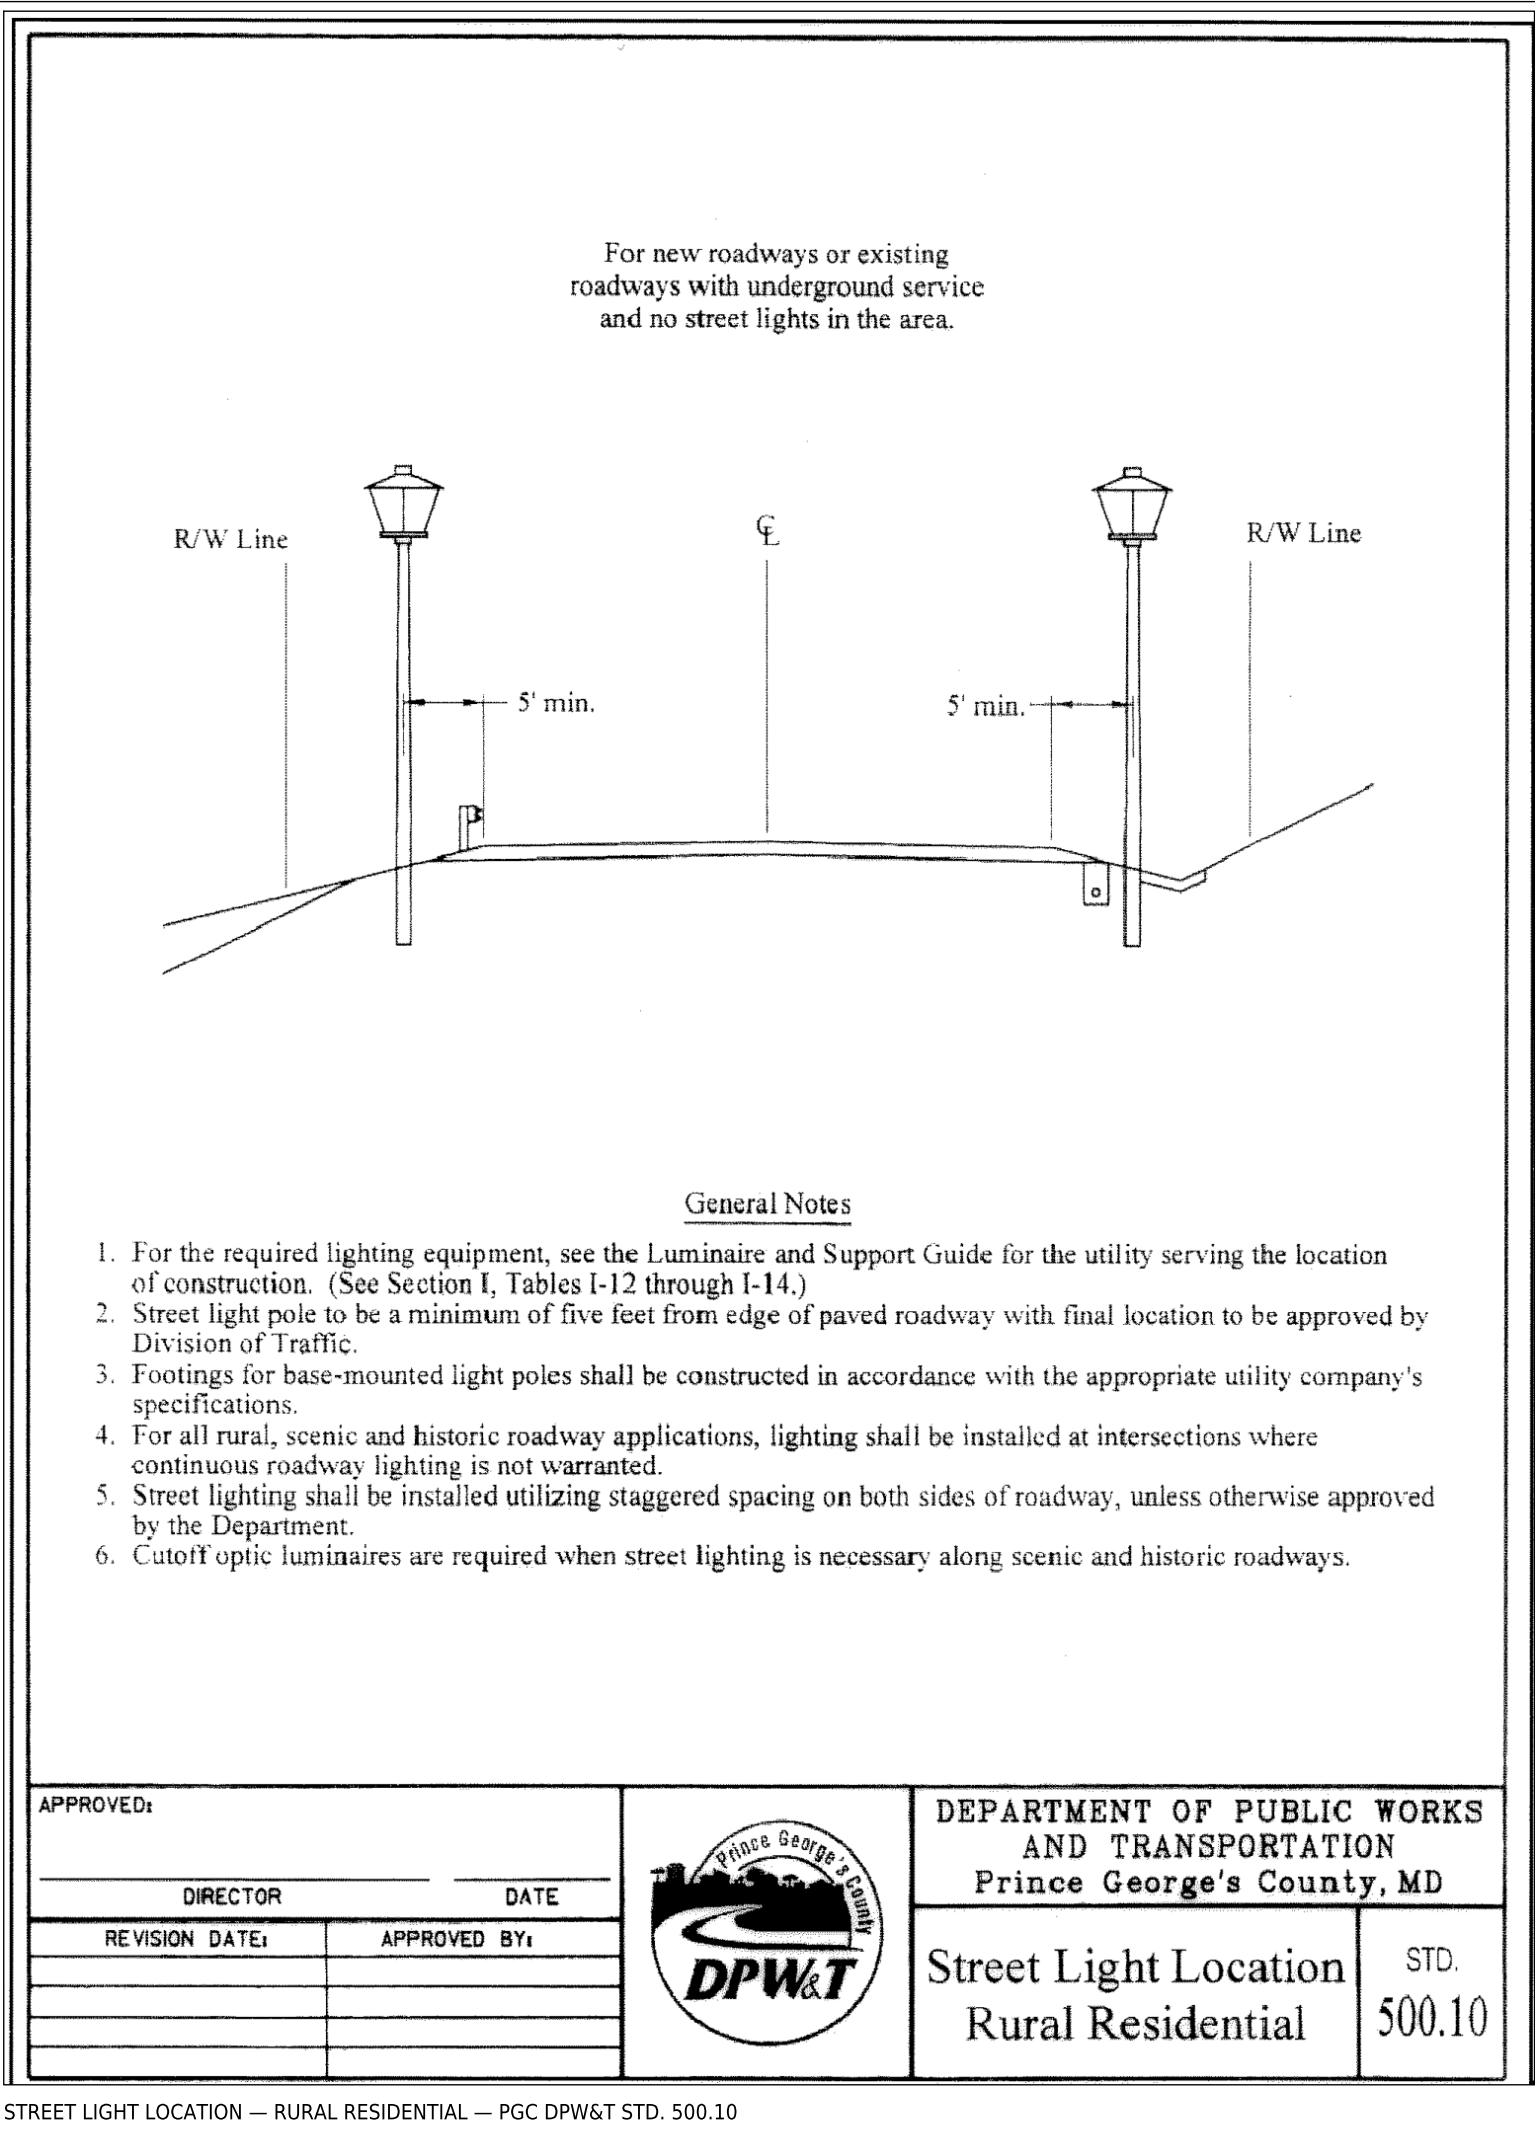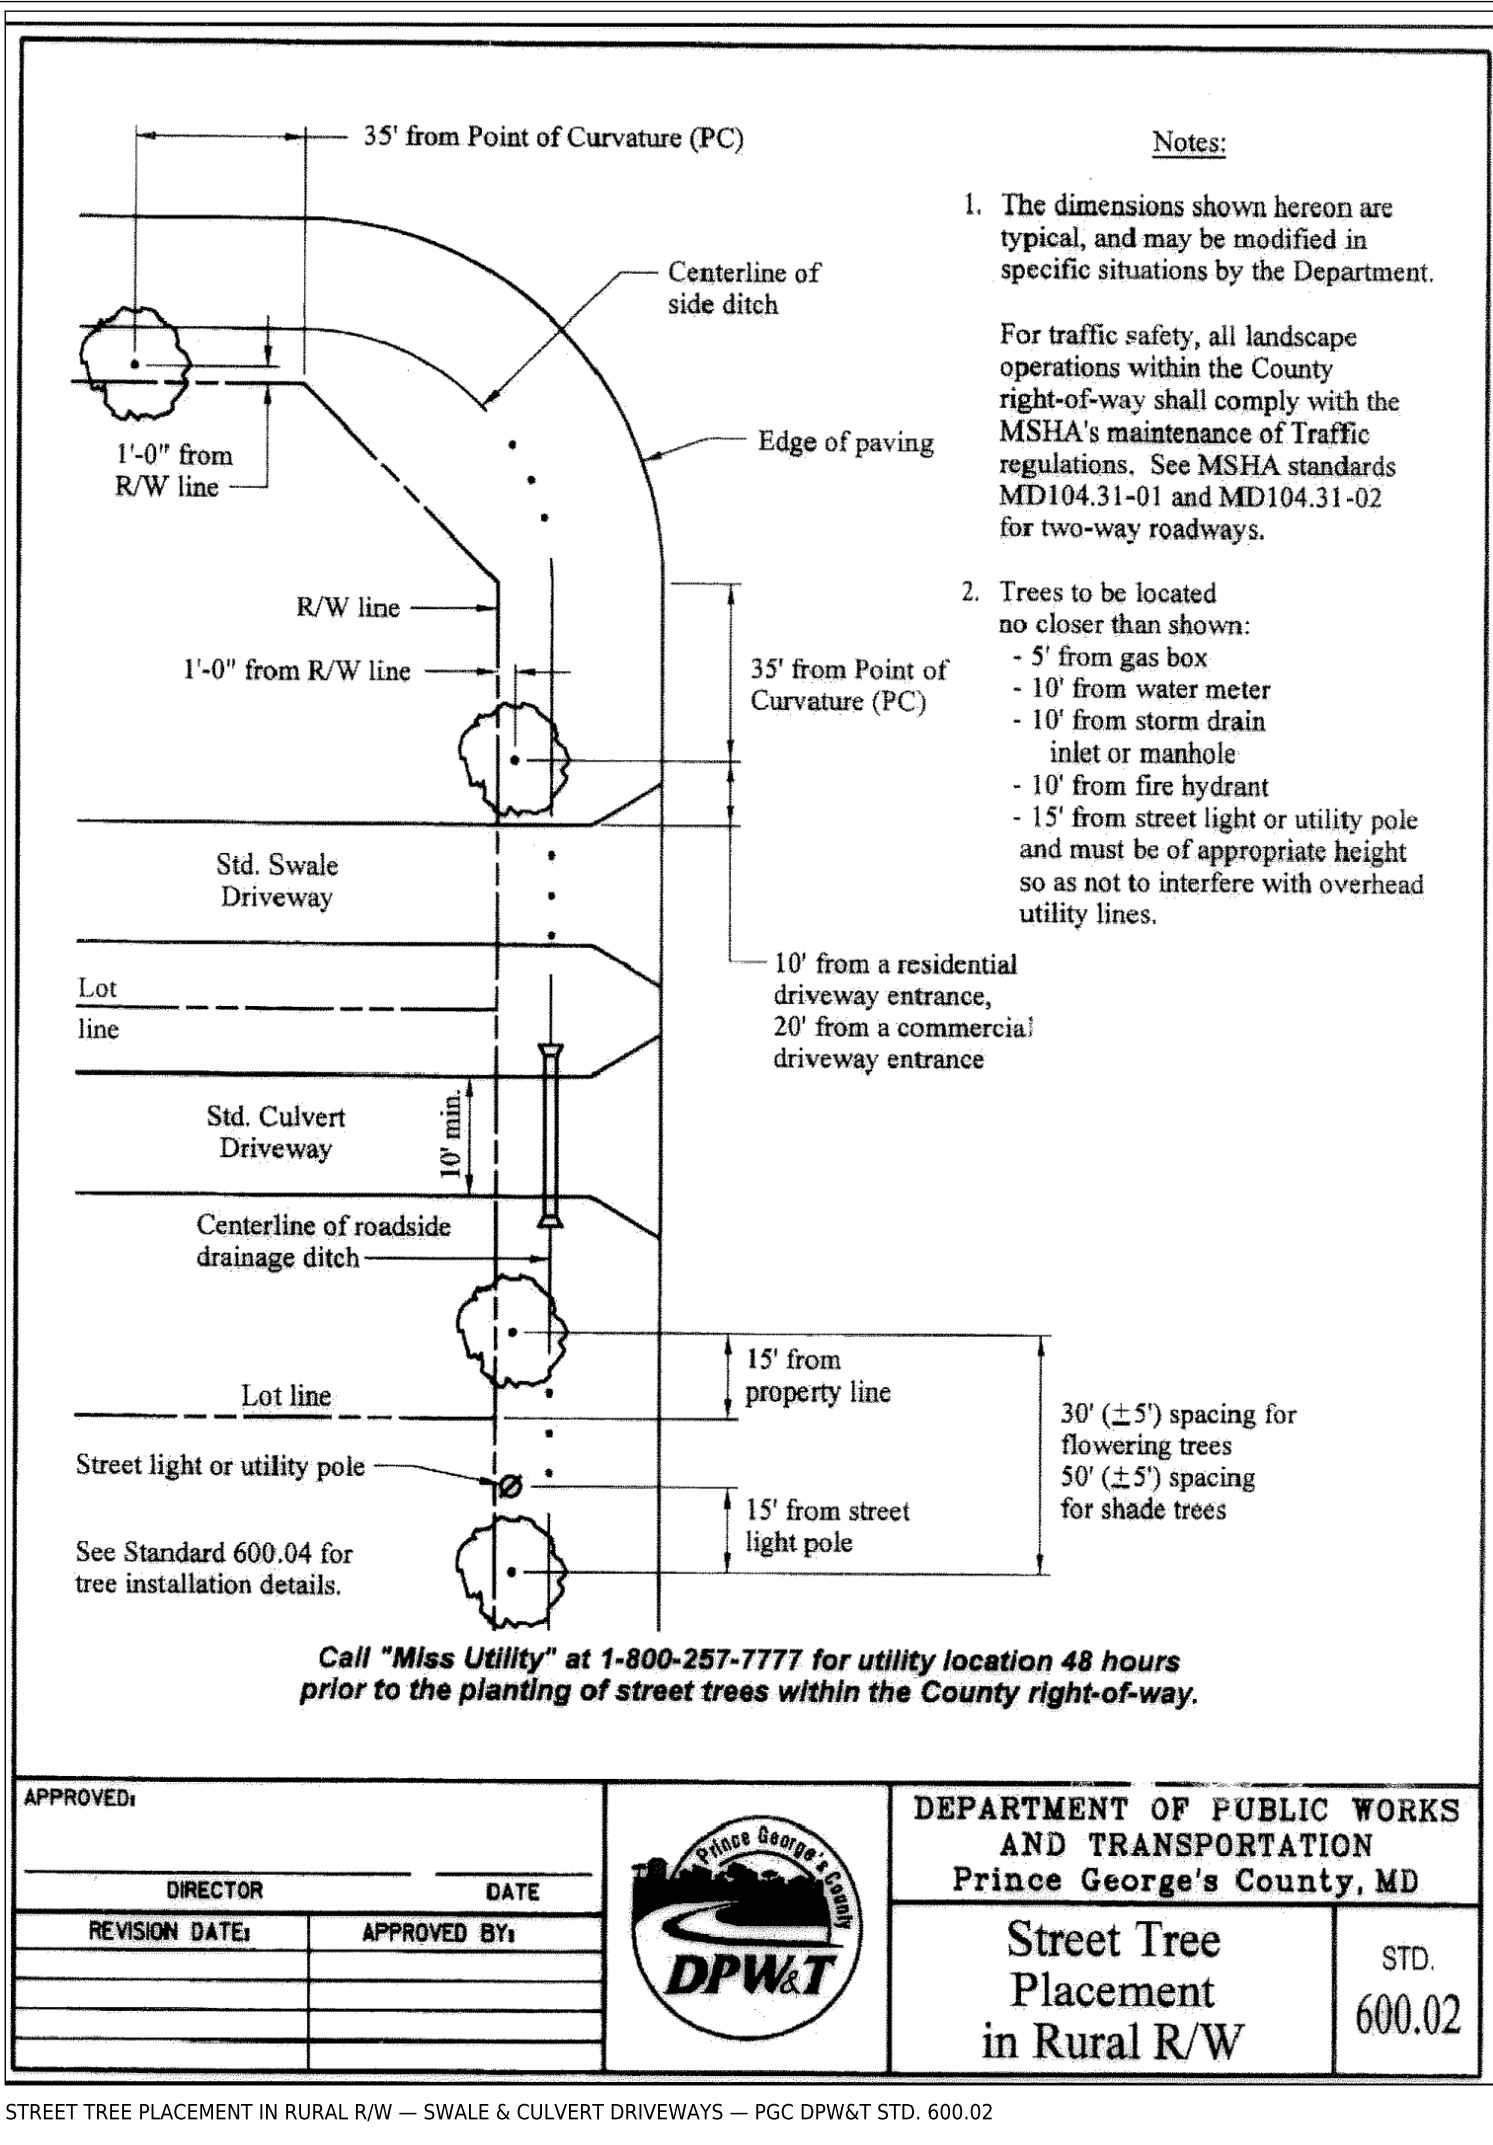


ESTATES COURT — TYPICAL SECTION (RURAL OPEN SECTION, 60' R/W)

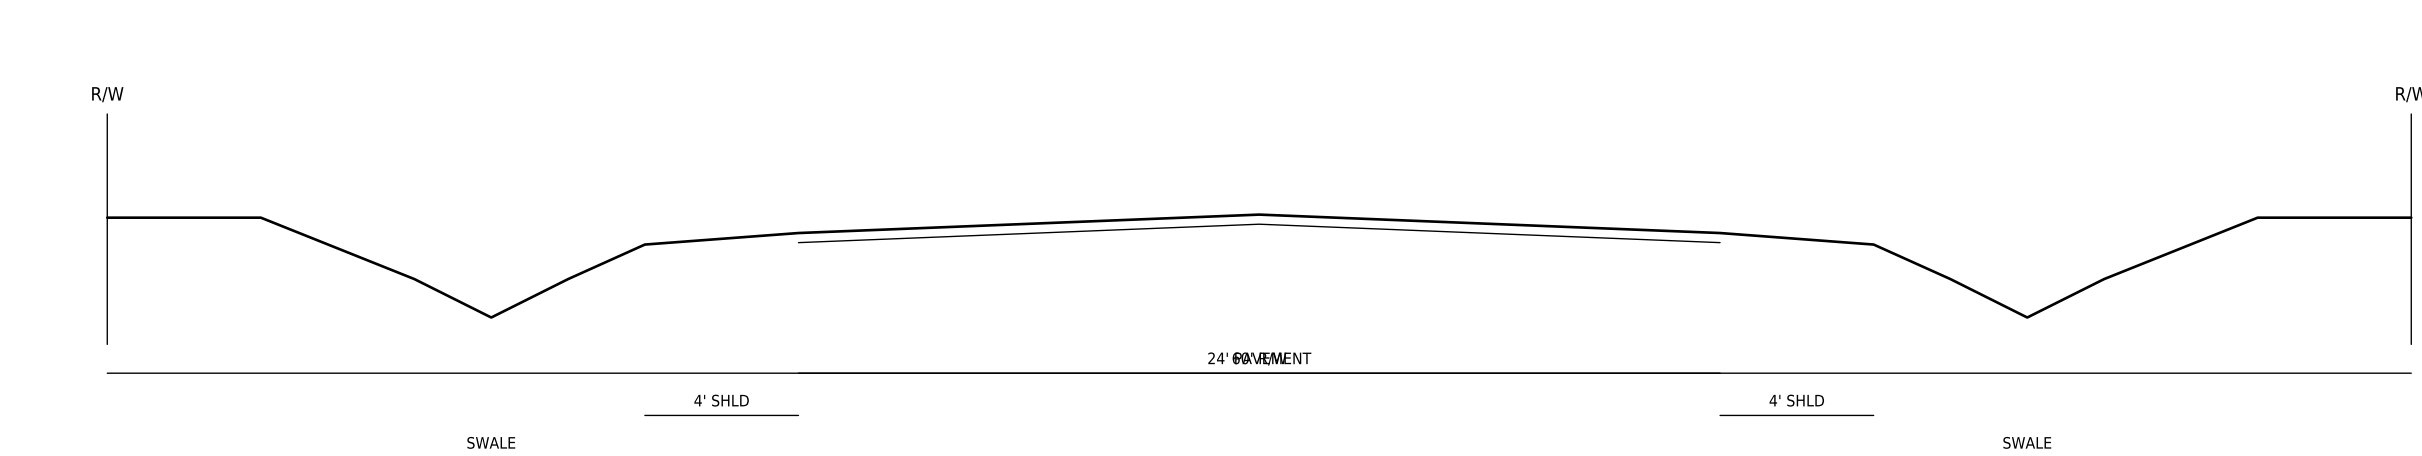


1.1/2" SURFACE + 2.1/2" BASE BIT. CONC. ON 6" GAB (DPW&T PAVEMENT SCHEDULE FOR RURAL RESIDENTIAL — CONFIRM)
CROSS SLOPE 2%; 4-FT STABILIZED SHOULDERS, SWALE FLOWLINE 20 FT OFF CENTRELINE, 3:1 SIDE SLOPES
DRIVEWAYS CROSS THE SWALE ON 15" RCP CULVERTS WITH FLARED END SECTIONS (DPW&T STD. 600.02)

MICRO-BIORETENTION (M-6) — TYPICAL SECTION

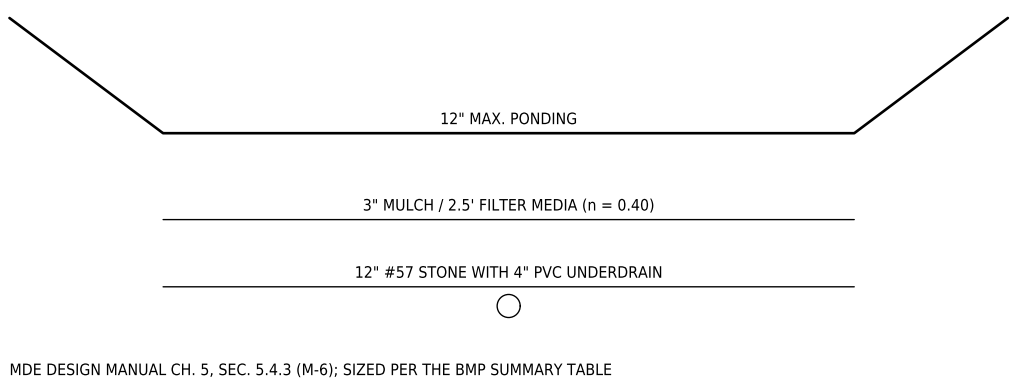

DRY SWALE (M-8) WITH CHECK DAM

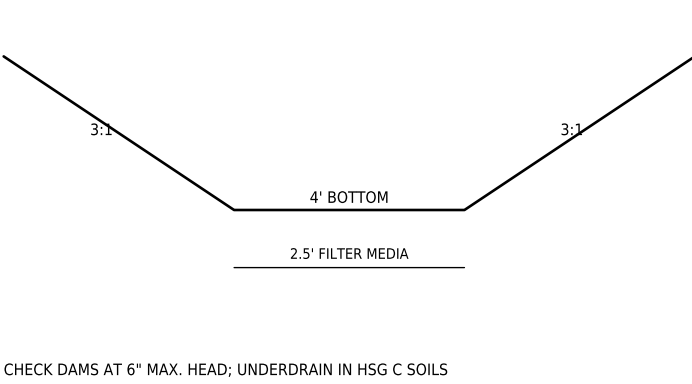

PLAN TYPE
SITE DEVELOPMENT CONCEPT PLAN

PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT BOOK PM 226 PLAT 83 TAX MAP 151 P-3 WSSC
2206E01
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE RR

OWNER / APPLICANT
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST
PALM BEACH, FL 33401 (L-32062.F-043)

ENGINEER OF RECORD
W.L. MEEKINS, INC. — BILL MEEKINS, JR., 3101 RITCHIE ROAD,
FONTSVILLE, MD 20747 - 301-736-7115

SHEET TITLE
DETAILS

KEY MAP

SCALE
AS NOTED

DATUM: NAD 83 MD STATE PLANE (US FT) / NAVD 88

REVISIONS

NO.	DATE	DESCRIPTION
0	2026-09-30	CONCEPT SUBMISSION 1

PROFESSIONAL CERTIFICATION
I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Exp. _____

SEAL

CONCEPT SUBMISSION 1 — NOT SEALED
DATE 2026-09-30 JOB KEA-EH-2026
PREPARED WITH KRAUSE SPOTIAL ENGINE / CAD-PILOT

SHEET INDEX
C-600 COVER SHEET — BMP SUMMARY, DPE CHECKLIST AND NOTES
C-200 SITE SUSTAINING CONDITIONS AND ENVIRONMENTAL FEATURES
C-300 SITE EROSION, GRADING AND PAVING PLAN
C-300 UTILITY, STREET LIGHT AND STREET TREE PLAN
C-400 STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP
C-500 SEDIMENT AND EROSION CONTROL PLAN
C-600 DETAILS