

RESERVED FOR COUNTY ePLAN STAMP  
3" x 3" — KEEP BLANK

ESTATES AT INDIAN HEAD  
LOTS 1 THRU 6  
SITE DEVELOPMENT CONCEPT PLAN  
(ESTATES COURT — 200-205 ESTATES COURT, ACCOKEEK, MD 20607)  
PLAT BOOK PM 228 PLAT 83 · TAX MAP 151 F-3 · WSSC 2205E01 · ELECTION DIST. 5 · COUNCIL DIST. 9 · ZONE RR

New submittal to the DPIE Site Development Concept checklist (rev. 08/25/2021).

VICINITY MAP SCALE: 1" = 2,000'

GRAPHIC SCALE 1" = 2,000'

0 1000 2000 3000 4000 FT

W.L. MEEKINS, INC.  
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115  
PREPARED WITH KEALEE SPATIAL ENGINE (COP-PILOT)

PRINCE GEORGE'S COUNTY BMP SUMMARY TABLE — ESD BY POINT OF INVESTIGATION (A-15, C-9)

| BMP   | PRACTICE                                   | MDE | LOCATION                   | OWNERSHIP / MAINT.                          | POI   | DA SF   | IMP SF | %I   | HSG | P_E IN | Rv    | ESDv REQ CF | ESDv PROV CF | Rv REQ CF | SURFACE SF | COORDINATES (NAD 83)  |
|-------|--------------------------------------------|-----|----------------------------|---------------------------------------------|-------|---------|--------|------|-----|--------|-------|-------------|--------------|-----------|------------|-----------------------|
| ESD-1 | Micro-bioretentation                       | M-6 | Lot 1                      | Private — lot owner (maintenance agreement) | POI-1 | 19,999  | 4,500  | 22.5 | C   | 1.2    | 0.253 | 505         | 505          | 55        | 526        | N 367,417 E 1,311,143 |
| ESD-2 | Micro-bioretentation                       | M-6 | Lot 2                      | Private — lot owner (maintenance agreement) | POI-1 | 20,015  | 2,422  | 12.1 | C   | 1.0    | 0.159 | 265         | 265          | 34        | 330        | N 367,394 E 1,311,198 |
| ESD-3 | Micro-bioretentation                       | M-6 | Lot 3                      | Private — lot owner (maintenance agreement) | POI-1 | 20,051  | 3,008  | 15.0 | C   | 1.0    | 0.185 | 309         | 309          | 40        | 386        | N 367,379 E 1,311,388 |
| ESD-4 | Micro-bioretentation                       | M-6 | Lot 4                      | Private — lot owner (maintenance agreement) | POI-1 | 20,021  | 2,062  | 10.3 | C   | 1.0    | 0.143 | 238         | 238          | 31        | 298        | N 367,217 E 1,311,299 |
| ESD-5 | Micro-bioretentation                       | M-6 | Lot 5                      | Private — lot owner (maintenance agreement) | POI-1 | 20,235  | 2,489  | 12.3 | C   | 1.0    | 0.161 | 271         | 271          | 35        | 339        | N 367,173 E 1,311,171 |
| ESD-6 | Micro-bioretentation                       | M-6 | Lot 6                      | Private — lot owner (maintenance agreement) | POI-1 | 29,536  | 2,511  | 8.5  | C   | 1.0    | 0.127 | 311         | 312          | 40        | 390        | N 367,210 E 1,311,121 |
| ESD-5 | Roadside dry swales w/ check dams (B41 LF) | M-8 | Estates Ct R/W, both sides | Public — DPIE                               | POI-1 | 36,041  | 21,137 | 58.6 | C   | 2.0    | 0.578 | 3,471       | 5,049        | 226       | 3,366      | N 367,390 E 1,311,360 |
|       | SUBTOTAL POI-1                             |     |                            |                                             | POI-1 |         |        |      |     |        |       | 5,370       | 6,949        |           |            |                       |
| TOTAL | 7 ESD practices                            |     |                            |                                             |       | 165,898 | 38,129 |      |     |        |       | 5,370       | 6,949        | 461       | 5,635      |                       |

F, E from MDE Stormwater Design Manual (2000, Supp. 1 2009), Ch. 5, Table 5.3 — rainfall targets for ESD; HSG C governing, Rv = 0.05 + 0.009(I); ESDv = P, E, Rv A-12, Rev = S Rv A-12 (S = 0.13 in, HSG C), met within ESDv, M 8 provided = 6 cf per ft (4 ft bottom, 6" ponding, 2.5' media at n 0.40).

LOT COVERAGE ANALYSIS

| LOT # | DRIVEWAY AREA (SF) | COVERED AREA (SF) | TOTAL AREA (SF) | LOT AREA (SF) | LOT COVERAGE (%) |
|-------|--------------------|-------------------|-----------------|---------------|------------------|
| LOT 1 | 1117               | 2349              | 3467            | 20041         | 17.30            |
| LOT 2 | 1081               | 2325              | 3405            | 20005         | 17.02            |
| LOT 3 | 1206               | 2313              | 3519            | 20060         | 17.54            |
| LOT 4 | 690                | 1902              | 2591            | 20024         | 12.94            |
| LOT 5 | 1118               | 2408              | 3525            | 20228         | 17.43            |
| LOT 6 | 1176               | 2333              | 3509            | 29488         | 11.90            |

LOT COVERAGE = DRIVEWAY, WALK AND STOOP + DWELLING FOOTPRINT, ON THE LOT.

ADDRESS LIST

| LOT   | STREET ADDRESS    |
|-------|-------------------|
| Lot 1 | 200 ESTATES COURT |
| Lot 2 | 202 ESTATES COURT |
| Lot 3 | 204 ESTATES COURT |
| Lot 4 | 205 ESTATES COURT |
| Lot 5 | 203 ESTATES COURT |
| Lot 6 | 201 ESTATES COURT |

LEGEND

| ITEM                   | NEW | EXISTING |
|------------------------|-----|----------|
| PROPERTY LINE          |     |          |
| LOT LINE               |     |          |
| BUILDING (EXISTING)    |     |          |
| RIGHT-OF-WAY           |     |          |
| EDGE OF PAVEMENT       |     |          |
| CENTER LINE            |     |          |
| CONTOURS               |     |          |
| EASEMENT (WSSC)        |     |          |
| BUILDING               |     |          |
| WATER MAIN             |     |          |
| SANITARY SEWER         |     |          |
| WATER HOUSE CONNECTION |     |          |
| SEWER HOUSE CONNECTION |     |          |
| ROADSIDE SWALE         |     |          |
| DRIVEWAY CULVERT       |     |          |
| ESD PRACTICE (M-6)     |     |          |
| DRAINAGE AREA          |     |          |
| LIMITS OF DISTURBANCE  |     |          |
| SILT FENCE             |     |          |
| SOIL BOUNDARY          |     |          |
| STREET TREE            |     |          |
| STREET LIGHT           |     |          |
| SPOT ELEVATION         |     |          |

INDEX OF DRAWINGS

| NO. | SHEET | TITLE                                                           |
|-----|-------|-----------------------------------------------------------------|
| 1   | C-000 | COVER SHEET                                                     |
| 2   | C-001 | GENERAL NOTES AND DPIE CHECKLIST                                |
| 3   | C-100 | EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES                  |
| 4   | C-200 | SITE LAYOUT, GRADING AND PAVING PLAN                            |
| 5   | C-210 | ESTATES COURT — PLAN AND PROFILE                                |
| 6   | C-300 | UTILITY, STREET LIGHT AND STREET TREE PLAN                      |
| 7   | C-400 | STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP             |
| 8   | C-410 | STORMWATER MANAGEMENT CONCEPT NARRATIVE AND 100-YR COMPUTATIONS |
| 9   | C-500 | SEDIMENT AND EROSION CONTROL PLAN                               |
| 10  | C-600 | DETAILS                                                         |

MISS UTILITY NOTE

Information concerning existing underground utilities was obtained from available records. The contractor must field verify the exact locations and elevations as required for applicable horizontal and vertical clearances by digging test pits by hand, well in advance of excavation. Contact "Miss Utility" at 1-800-257-7777 (311), 48 hours prior to the start of any excavation. Provide results of test pits to the design engineer and coordinate with the engineer, owner/developer and utility company before proceeding with construction to resolve any conflicts or clearances with other utilities, storm drains, grading or other improvements.

STABILIZATION NOTE

Stabilization practices on all projects must be in compliance with the requirements of COMAR 26.17.01.08 G. Following initial soil disturbance or re-disturbance, permanent or temporary stabilization must be completed within three (3) calendar days as to the surface of all perimeter dikes, swales, ditches, perimeter slopes and all slopes steeper than 3 horizontal to 1 vertical (3:1); and seven (7) calendar days as to all other disturbed or graded areas on the project site not under active grading.

OWNER / DEVELOPER

GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L 32062 F.043)

EXISTING SUBDIVISION OF RECORD — LOTS 1-6, ESTATES AT INDIAN HEAD, PLAT BOOK PM 228 @ 83 (AS IS: NO DWELLINGS OR IMPROVEMENTS)

GRAPHIC SCALE 1" = 80'

0 80 160 240 320 FT

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10

COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

DATE

2026-09-30

SCALE

AS NOTED

SHEET

1 OF 10


COVER SHEET  
C-000

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

| DATE | DESCRIPTION</ |
|------|---------------|
|------|---------------|

KEY MAP

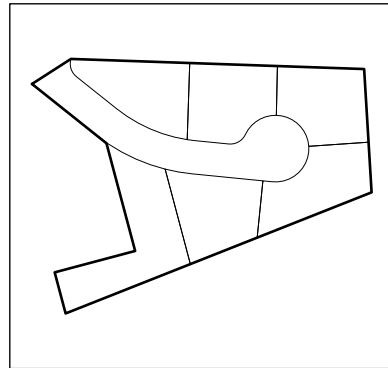

GENERAL NOTES AND DPIE CHECKLIST

SITE DATA

| ITEM              | DATA                                                                                                       |
|-------------------|------------------------------------------------------------------------------------------------------------|
| Project           | Estates at Indian Head, Lots 1-6 and Estates Court                                                         |
| Location          | Estates Ct at Jennifer Dr, south/east of separated MD 210; ±3,000 ft NE of MD 210 / MD 373; Accokeek 20607 |
| Record            | Plat Book PM 228 Plat 83 (final plat 5-08238); Tax Map 151 F-3; WSSC 200' 2205E01                          |
| Accounts          | 3987666, 3987674, 3987682, 3987690, 3987708, 3987716                                                       |
| Owner             | Gerald Waldman Revocable Trust, L 32062 F.043                                                              |
| Zone / use        | RR (no change) — 6 single-family detached dwellings                                                        |
| Tract             | 165,019 sf of record (3.788 ac) = plat 171,505 sf less Outlot A (6,486 sf, conveyed L 51565 F.455)         |
| Public dedication | Estates Court 60' R/W, 35,173 sf of record — rural open section, 24' pavement, cul-de-sac                  |
| Water / sewer     | W-3 / S-3 (WSSC) — mains from Henrietta Dr via 30' WSSC esmt L 51799 F.399 and prop. Lot 4 esmt            |
| Watershed         | Piscataway Creek, MD 021402030798; not Tier II; not CBCA; FEMA Zone X                                      |
| Master plan       | 2013 Subregion 5 Master Plan & SMA; Planning Area 84; Council Dist. 9; Election Dist. 5                    |
| Datum             | NAD 83 MD State Plane (US ft); NAVD 88 (M-NCPPC 2-ft); spot grades on WSSC datum                           |

APPROVALS OF RECORD

| CASE          | STATUS                                                      |
|---------------|-------------------------------------------------------------|
| NRI-015-06    | Prior approval — base work; updated NRI required            |
| TCP1-018-06   | Prior approval — base work                                  |
| TCP2-016-09   | Prior approval — base work; revision or new TCP per M-NCPPC |
| 5-08238       | Final plat, PM 228 @ 83 — recorded                          |
| L 51799 F.399 | 30' WSSC easement (Outlot A, Lot 20) — recorded 2025        |

GENERAL NOTES

- Boundary per recorded plat PM 228 @ 83; lot lines reproduce the plat to the second.
- Horizontal datum: Maryland State Plane NAD 83 (US ft). Vertical datum: NAVD 88 (M-NCPPC 2-ft contours). Spot grades are on WSSC datum (= NAVD 88 + 1.6 ft). DPIE prefers NGVD 29.
- Six single-family dwellings with side-load garages and courts, street trees and street lights, laid out to current requirements. Lot 4 is front-load (garage to the cul-de-sac) to clear the WSSC easement.
- Estates Court is a rural open section (DPW&T Std. 500.10 / 600.02 / 600.04): 24' pavement, shoulders, roadside swales; driveways cross the swale on 15" RCP culverts with flared end sections.
- Estates Court intersects Jennifer Drive with 50' returns. Jennifer Drive lies between the entrance and MD 210; preserve the existing physical separation/barrier. No direct MD 210 access or auxiliary lanes are proposed. Field-verify Jennifer Drive sight distance for County review.
- Water and sewer: WSSC mains from Henrietta Dr through the recorded 30' WSSC easement (L 51799 F.399) and a 30' WSSC easement to be granted across Lot 4. Record discrepancies in the easement description to be resolved with WSSC.
- NEW SUBMITTAL (2026). Prior approvals NRI-015-06, TCP1-018-06 and TCP2-016-09 are used as base work only and do not carry this submittal. Additional work: an updated/revised NRI (draft with this submission, approved copy before concept approval, Sec. 32-182(a)); a TCP2-016-09 revision or new TCP / letter of exemption as M-NCPPC Environmental Planning determines; street trees and lighting reviewed to current DPW&T/DPIE standards; SWM by ESD to the MEP under current Subtitle 32.
- Desktop screening maps 132,705 sf of woody vegetation/possible woodland on site. No mapped streams, wetlands, floodplain, PMA or Chesapeake Bay Critical Area. Updated NRI/TCP field verification governs woodland and steep-slope limits.
- GRADING HOLD POINT: proposed contours and base-plan spot grades are preliminary. Before technical approval, the civil PE shall verify positive drainage away from every dwelling (5% for the first 10 ft where practicable), driveway/garage ties, retaining or stepped grading at Lot 1, and the Lots 2-4 front-yard drainage. Do not use this concept set for construction staking.
- RR ZONING CHECK: each lot exceeds 20,000 sf; proposed lot coverage is below the 25% maximum; building restriction lines depict 25-ft front, 8-ft side and 20-ft rear minimums. Licensed surveyor/PE shall certify final setbacks and the 40-ft height maximum at permit.
- Contact Miss Utility (811) at least 48 hours before any excavation.

DPIE CONCEPT PLAN DESIGN REVIEW CHECKLIST (08/25/2021) — C = SHOWN · X = N/A · O = OUTSTANDING

| ITEM | REQUIREMENT                                                                                                                                          | REF.    | C/X/O | RESPONSE / WHERE SHOWN                                                                                                                                                                                                                    | SHEET |
|------|------------------------------------------------------------------------------------------------------------------------------------------------------|---------|-------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------|
| A-1  | Plan is labeled as Site Development Concept Plan (aka Concept Plan from MDE Step 1)                                                                  |         | C     | Every sheet is titled SITE DEVELOPMENT CONCEPT PLAN.                                                                                                                                                                                      | ALL   |
| A-2  | Plan sheet size does not exceed 30" x 42" and all sheets are printed on same size paper.                                                             | 5.3.2   | C     | All sheets 24" x 36" (ARCH D).                                                                                                                                                                                                            | ALL   |
| A-3  | A 5-inch, full-height open area is provided on the right-hand side of the drawing for County approval block.                                         | 2.2.1.A | C     | 5-inch full-height strip at the right edge, kept clear for DPIE.                                                                                                                                                                          | ALL   |
| A-4  | If more than 4 plan sheets, composite plan showing match lines and sheet numbers (scale not to exceed 1"=200'); key map on each plan sheet.          | 2.2.1.O | C     | 10 sheets; the whole site is on each plan sheet at one scale, so no match lines; key map in every title block.                                                                                                                            | ALL   |
| A-5  | Match lines have a minimum length of 4 inches and identify the matching sheet number.                                                                | 2.2.1.M | X     | No match lines — the entire site fits one viewpoint.                                                                                                                                                                                      |       |
| A-6  | Vicinity map at a minimum scale of 1"=2,000' with north arrow and scale, upper right hand corner of cover sheet.                                     | 2.2.1.B | C     | Vicinity map at 1" = 2,000' with north arrow and bar scale, upper right.                                                                                                                                                                  | C-000 |
| A-7  | A bar scale is provided on every sheet.                                                                                                              |         | C     | Graphic bar scale in every plan viewpoint.                                                                                                                                                                                                | ALL   |
| A-8  | Three grid ticks are provided as described in the manual.                                                                                            | 2.2.1.E | C     | Three State Plane grid ticks with N/E values on each plan.                                                                                                                                                                                | C-200 |
| A-9  | Horizontal (MD Coordinate System, NAD 83) and vertical (NGVD 29 preferred) datum is stated on the plan.                                              |         | C     | Horizontal Maryland State Plane, NAD 83 (EPSG 2248), US ft; vertical NAVD 88 (M-NCPPC 2-R); spot grades WSSC datum as noted.                                                                                                              | ALL   |
| A-10 | General notes about the project are provided.                                                                                                        |         | C     | General notes on C-001.                                                                                                                                                                                                                   | C-001 |
| A-11 | The entire property is shown at a maximum plan scale of 1 inch = 50 feet (preferred) within the plan set.                                            | 5.3.2   | C     | Entire property at 1" = 30'.                                                                                                                                                                                                              | C-200 |
| A-12 | All existing structures and site features including cultural features, historic sites and easements, and any visible foundations or ruins are shown. | 5.3.2   | C     | Existing structures, adjoining houses, fences, sheds, well, easements of record shown; no historic sites or ruins.                                                                                                                        | C-100 |
| A-13 | Topographic contours at maximum 2 foot interval, extending at least 100 feet beyond the property.                                                    | 32-182  | C     | M-NCPPC 2-ft contours, 100 ft beyond the property.                                                                                                                                                                                        | C-100 |
| A-14 | All existing utilities and utility easements are shown.                                                                                              |         | C     | WSSC easement L 51799 F.399 and the proposed Lot 4 WSSC easement; public utility easements along the frontage; existing mains in Henrietta Dr noted (sizes to verify on WSSC 2205E01).                                                    | C-300 |
| A-15 | The County BMP Summary Table is provided. Preferred location is on the cover sheet.                                                                  | 5.3.1   | C     | County BMP Summary Table, 7 practices.                                                                                                                                                                                                    | C-000 |
| B-1  | Banks of all regulated streams or a centerline if the banks are too close together to graphically show.                                              | MDE 5.7 | X     | No streams on site. New submittal: prior NRI-015-06 (with TCP1-018-06, TCP2-016-09) is base work only. Updated/revised NRI to be provided in draft with this submission; approved copy required before concept approval (Sec. 32-182(a)). |       |
| B-2  | Location of stream and stream buffers and/or enhanced buffers per MNCPPC and SCD criteria.                                                           | MDE 5.7 | X     | No streams, no stream buffers.                                                                                                                                                                                                            |       |
| B-3  | Location of wetlands and/or wetlands of special state concern and appropriate wetland buffers.                                                       | MDE 5.7 | X     | No wetlands on or within 100 ft (DNR; NRI).                                                                                                                                                                                               |       |
| B-4  | Delineation of the 100-year floodplain, per Techno-Gram 004-2020.                                                                                    | MDE 5.7 | X     | FEMA Zone X; no 100-yr floodplain on or within 100 ft.                                                                                                                                                                                    |       |
| B-5  | Location of steep slopes (15% and greater) clearly shown on the plan and in the legend.                                                              | M-NCPPC | X     | No steep slopes (15% and greater) on the property.                                                                                                                                                                                        |       |
| B-6  | The Primary Management Area is delineated.                                                                                                           | MDE 5.7 | X     | No PMA on the property.                                                                                                                                                                                                                   |       |
| B-7  | Existing woodland is delineated on the property.                                                                                                     | MDE 5.7 | C     | Desktop woody-vegetation screening: 132,705 sf on site (PGAtlas Layer 17; agrees with base-survey woods). Updated NRI/TCP field verification governs.                                                                                     | C-100 |
| B-8  | Existing environmental features extend off the property 100 feet in all directions.                                                                  | MNCPPC  | C     | Environmental layers drawn 100 ft beyond the property.                                                                                                                                                                                    | C-100 |
| B-9  | Soils types and soil boundaries from USDA NRCS Soil Survey (Dec. 2009 or latest).                                                                    |         | C     | Soil types and boundaries from USDA NRCS (PGAtlas Soil layer): CwE (HSG C); UdaF (HSG —); BaB (HSG C); BuB (HSG C).                                                                                                                       | C-100 |
| B-10 | Plan notes identify TMDL watershed (sediment, nitrogen, phosphorus) and Tier II waters/watershed.                                                    |         | C     | Chesapeake Bay TMDL (nitrogen, phosphorus, sediment) applies; MD 12-digit watershed 021402030798, Piscataway Creek (021402031). Tier II: no.                                                                                              | C-001 |
| B-11 | Highly erodible soils noted.                                                                                                                         | MDE 5.7 | X     | No highly erodible soils on the property.                                                                                                                                                                                                 |       |
| B-12 | Springs and seeps noted.                                                                                                                             | MDE 5.7 | X     | None observed or mapped.                                                                                                                                                                                                                  |       |
| B-13 | Bedrock and Marlboro Clay outcrops noted.                                                                                                            | MDE 5.7 | X     | No bedrock or Marlboro clay mapped (PGAtlas); geotechnical report per E-2.                                                                                                                                                                |       |
| B-14 | Chesapeake Bay Critical Areas delineated.                                                                                                            | MDE 5.7 | X     | Not in the Chesapeake Bay Critical Area.                                                                                                                                                                                                  |       |

CHECKLIST (CONT.)

| ITEM | REQUIREMENT                                                                                                                                          | REF.                                    | C/X/O | RESPONSE / WHERE SHOWN                                                                                                                                                                                                | SHEET |
|------|------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------|-------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------|
| C-1  | Project layout is shown, including roads, buildings, parking, sidewalk and other improvements and associated grading.                                | 32-182                                  | C     | Estates Court, 6 dwellings, driveways and courts, T-intersection at Jennifer Drive, and preliminary grading.                                                                                                          | C-200 |
| C-2  | Preliminary locations of ESD and structural stormwater practices; grading for devices where slopes exceed 1.5%.                                      | 32-182                                  | C     | 7 ESD practices (micro-bioretenment M-6 per lot; roadside dry swales M-8).                                                                                                                                            | C-400 |
| C-3  | Preliminary locations of storm drain inlets and culverts; entrance and outfall structures located beyond project limits (easements may be required). | 5.2.4.4.2B / 32-162.A.6                 | C     | Open section — no inlets; 6 driveway culverts (15" RCP) with end sections; swales outfall to the existing Jennifer Drive frontage-road drainage system.                                                               | C-400 |
| C-4  | Limit of Disturbance shown for all site work, incl. water, sewer, storm drain, SWM, road improvements, sediment control, stockpile.                  | 32-182                                  | C     | LOD 131,080 sf incl. mains, easement work off site, sediment control and stockpile.                                                                                                                                   | C-500 |
| C-5  | Existing easements shown and any required offsite proposed easements.                                                                                |                                         | C     | Recorded WSSC easement (Outlot A, Lot 20) and proposed Lot 4 WSSC easement; private SWM easements over ESD practices.                                                                                                 | C-300 |
| C-6  | Locations, names and widths of existing and ultimate rights-of-way of adjacent streets and alleys; public vs. private noted.                         |                                         | C     | Estates Ct (60' public) terminates at Jennifer Dr; Jennifer lies between the entrance and separated MD 210; Henrietta Dr (50' public) and the 30' R/W in common L 10142 F.725 are shown.                              | C-200 |
| C-7  | Existing and proposed water well and septic field locations are shown.                                                                               |                                         | C     | No wells or septic proposed (public water and sewer). Existing well on Parcel 199 (15608 Indian Head Hwy), off site, shown.                                                                                           | C-100 |
| C-8  | Proposed public dedication area including any proposed parkland is shown and labeled.                                                                |                                         | C     | Estates Court public dedication 36,041 sf (plat PM 228 @ 83); no parkland.                                                                                                                                            | C-200 |
| C-9  | Point(s) of investigation shown; ESDv computations and BMP Summary Table broken out to show ESD Required is Provided within each POI.                |                                         | C     | 1 POI(s); ESDv required vs. provided tabulated per POI.                                                                                                                                                               | C-400 |
| C-10 | The ultimate 100-year stormwater overflow path is shown throughout the site using flow arrows.                                                       |                                         | C     | 100-yr overflow arrows from every practice to its POI (7).                                                                                                                                                            | C-400 |
| C-11 | Drainage areas to each device, offsite drainage onto the site, and to site outfalls; diverted areas analysed for no increase in 100-yr discharge.    |                                         | C     | Drainage area to each practice; off-site area onto the site 0.49 ac; no diversion between POIs.                                                                                                                       | C-400 |
| C-12 | Where grading blocks a drainage course, ponding limits before and after grading are shown.                                                           |                                         | X     | No fill across a drainage course.                                                                                                                                                                                     |       |
| D-1  | Report addresses natural resource protection, natural flow patterns, impervious reduction, ESC integration, ESD planning to the MEP.                 | MDE 5.11                                | C     | SWM concept narrative: natural resources, natural flow patterns, impervious reduction, ESD to the MEP, ESC integration.                                                                                               | C-410 |
| D-2  | If in the Chesapeake Bay Critical Area, discussion of how requirements are met; preliminary computations.                                            |                                         | X     | Not in the Chesapeake Bay Critical Area.                                                                                                                                                                              |       |
| D-3  | Outfalls located outside the site, to existing storm drain or 100-yr floodplain; otherwise the discharge area is described.                          |                                         | C     | Outfall at each POI and the receiving area described.                                                                                                                                                                 | C-410 |
| D-4  | Stabilization at downstream outfall and upstream inflow evaluated; measures against gully formation discussed.                                       |                                         | C     | Outfall velocity checked at the 10- and 100-yr flows; rock outlet protection at each POI; upstream inflow evaluated.                                                                                                  | C-410 |
| D-5  | Photographs of the stream at the downstream outfall and upstream property line; eroded slopes.                                                       |                                         | X     | No stream at the outfalls.                                                                                                                                                                                            |       |
| D-6  | If outfall is to an existing SWM facility, its capacity for the added area and flow is documented.                                                   |                                         | X     | No existing SWM facility receives the site.                                                                                                                                                                           |       |
| D-7  | If rezoned to higher imperviousness, effects on downstream properties analysed.                                                                      |                                         | X     | No rezoning (IRR remains RRI).                                                                                                                                                                                        |       |
| D-8  | Floodplain ordinance discussion (drainage courses, buildings within 25 ft of floodplain, dams, downstream crossings).                                |                                         | X     | No floodplain or drainage course on or downstream within the site, no dams.                                                                                                                                           |       |
| D-9  | If a waiver of water quality or quantity is requested, the basis is provided.                                                                        |                                         | X     | No waiver requested.                                                                                                                                                                                                  |       |
| D-10 | Computations: ESDWQv required and provided; 100-yr existing and proposed runoff; downstream storm drain analysis with 10-yr control if inadequate.   | 5.3.3 / 5.2.6.1 / 5.2.4.2 / TG 002-2019 | O     | ESDv per POI on the cover; 100-yr existing vs. proposed runoff at each POI on C-410. Outstanding: downstream adequacy analysis at technical design.                                                                   | C-410 |
| E-1  | A Geotechnical Report for SWM is provided to support concept development and feasibility.                                                            | 5.3.3 / TG 004-2018                     | O     | Geotechnical report for SWM (berings and Sec. 32-131 infiltration tests at each practice) — to be submitted.                                                                                                          |       |
| E-2  | Geotechnical Report addresses Marlboro and Christiansa clays, sulfidic and diatomaceous soils.                                                       | 5.3.3 / TG 005-2018 / PGSCD I-8         | O     | Geotechnical report to address Marlboro/Christiana clays, sulfidic and diatomaceous soils.                                                                                                                            |       |
| E-3  | Affidavit of Public Informational mailing is provided with second submission.                                                                        | 32-182(g)                               | O     | Affidavit of the adjacent-owner mailing (within 7 days of submittal) — with second submission.                                                                                                                        |       |
| E-4  | A draft Natural Resource Inventory is provided with initial submission (approved copy required prior to approval).                                   | 32-182(a)                               | O     | New submittal: prior NRI-015-06 (with TCP1-018-06, TCP2-016-09) is base work only. Updated/revised NRI to be provided in draft with this submission; approved copy required before concept approval (Sec. 32-182(a)). |       |

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. \_\_\_\_\_ Expiration date: \_\_\_\_\_

SEAL

CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

DATE

2026-09-30

DESCRIPTION

CONCEPT SUBMISSION 1

FILE

GENERAL NOTES AND DPIE CHECKLIST

C-001

2026-09-30

AS NOTED

SHEET

2 OF 10

DRAWN: KEALE CAD-PLOT

DESIGNED:

CHECKED:

ESTATES AT INDIAN HEAD  
SITE DEVELOPMENT CONCEPT PLAN  
LOTS 1 THRU 6 & ESTATES COURT

200-205 ESTATES COURT, ACCOKEEK, MD 20607  
PLAT: PM 228 @ 83 (PLAT 5-08238) (M-NCPPC 2-FT)  
OWNER: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER CA., WEST PALM BEACH, FL 33409 (L 52062 F.483)

W.L. MEEKINS, INC.  
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115  
PREPARED WITH KEALE SPATIAL ENGINE / CAD-PLOT

EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES

- LEGEND
- Boundary of record (plat PM 228 @ 83)
  - Lot line
  - Adjoining property
  - Existing building (county 2023 footprint)
  - Existing contour, 10-ft (NAVD 88)
  - Existing contour, 2-ft
  - Existing edge of road
  - Existing right-of-way
  - Soil boundary (USDA NRCS)
  - Mapped woody vegetation (field verify)
  - Easement



SOILS (USDA NRCS)

| SYMBOL | NAME                                                 | HSG | K   | HIGHLY ERODIBLE |
|--------|------------------------------------------------------|-----|-----|-----------------|
| CwE    | Croom-Marr complex, 15 to 25 percent slopes          | C   | .15 | NO              |
| UdaF   | Udorthents, highway, 0 to 65 percent slopes          | —   | —   | NO              |
| BaB    | Beltsville silt loam, 2 to 5 percent slopes          | C   | .37 | NO              |
| BuB    | Beltsville-Urban land complex, 0 to 5 percent slopes | C   | .37 | NO              |

ENVIRONMENTAL FEATURES — DPIE CHECKLIST B

| ITEM | CX/D | FINDING                                                                                                                                                                                                                                 |
|------|------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| B-1  | X    | No streams on site. New submittal: prior NRI-015-06 (with TCP1-018-06, TCP2-016-09) is base work only. Updated/revised NRI to be provided in draft with this submission; approved copy required before concept approval (Sec. 32.182a). |
| B-2  | X    | No streams, no stream buffers.                                                                                                                                                                                                          |
| B-3  | X    | No wetlands on or within 100 ft (DNR; NRI).                                                                                                                                                                                             |
| B-4  | X    | FEMA Zone X; no 100-yr floodplain on or within 100 ft.                                                                                                                                                                                  |
| B-5  | X    | No steep slopes (15% and greater) on the property.                                                                                                                                                                                      |
| B-6  | X    | No PMA on the property.                                                                                                                                                                                                                 |
| B-7  | C    | Desktop woody-vegetation screening: 132,705 sf on site (PGAtlas layer 17; agrees with base-survey woods). Updated NRI/TCP field verification governs.                                                                                   |
| B-8  | C    | Environmental layers drawn 100 ft beyond the property.                                                                                                                                                                                  |
| B-9  | C    | Soil types and boundaries from USDA NRCS (PGAtlas Soil layer): CwE (HSG C); UdaF (HSG —); BaB (HSG C); BuB (HSG C).                                                                                                                     |
| B-10 | C    | Chesapeake Bay TMDL (nitrogen, phosphorus, sediment) applies; MD 12-digit watershed 021402030798, Piscataway Creek (02140203). Tier II: no.                                                                                             |
| B-11 | X    | No highly erodible soils on the property.                                                                                                                                                                                               |
| B-12 | X    | None observed or mapped.                                                                                                                                                                                                                |
| B-13 | X    | No bedrock or Marlboro clay mapped (PGAtlas); geotechnical report per E-2.                                                                                                                                                              |
| B-14 | X    | Not in the Chesapeake Bay Critical Area.                                                                                                                                                                                                |

MISS UTILITY NOTE

Information concerning existing underground utilities was obtained from available records. The contractor must field verify the exact locations and elevations as required for applicable horizontal and vertical clearances by digging test pits by hand, well in advance of excavation. Contact "Miss Utility" at 1-800-251-7777 (811), 48 hours prior to the start of any excavation. Provide results of test pits to the design engineer and coordinate with the engineer, owner/developer and utility company before proceeding with construction to resolve any conflicts or clearances with other utilities, storm drains, grading or other improvements.

STABILIZATION NOTE

Stabilization practices on all projects must be in compliance with the requirements of COMAR 26.17.01.08 G. Following initial soil disturbance or re-disturbance, permanent or temporary stabilization must be completed within: three (3) calendar days as to the surface of all perimeter dikes, swales, ditches, perimeter slopes and all slopes steeper than 3 horizontal to 1 vertical (3:1); and seven (7) calendar days as to all other disturbed or graded areas on the project site not under active grading.

OWNER / DEVELOPER  
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L32062 F.043)

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. \_\_\_\_\_ Expiration date: \_\_\_\_\_

CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

W.L. MEEKINS, INC.  
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115  
PREPARED WITH KEALEE SPATIAL ENGINE / CAD-PLOT

ESTATES AT INDIAN HEAD  
SITE DEVELOPMENT CONCEPT PLAN  
LOTS 1 THRU 6 & ESTATES COURT

200-205 ESTATES COURT, ACCOKEEK, MD 20607  
PLAT PM 228 @ 83, 200-205 ESTATES COURT, ACCOKEEK, MD 20607  
OWNER: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L32062 F.043)

REVISIONS

DATE

2024-09-30

DESCRIPTION

CONCEPT SUBMISSION 1

TITLE


EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES  
C-100

DATE: 2026-09-30

SCALE: 1" = 30'


SHEET: 3 OF 10

KEY MAP

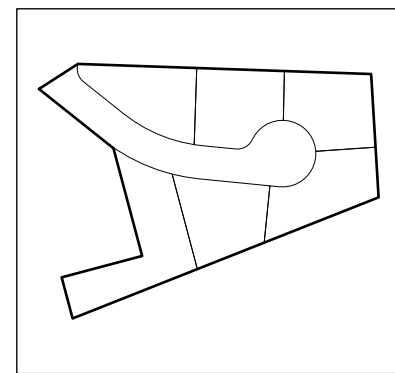

SITE LAYOUT, GRADING AND PAVING PLAN

- LEGEND
- Boundary of record
  - Estates Ct right-of-way
  - Proposed pavement
  - Roadside swale (flowline)
  - Driveway culvert, 15" RCP w/ end sections
  - Proposed dwelling
  - Building restriction line
  - Proposed contour
  - Existing contour
  - Spot elevation (WSSC datum)
  - Limit of disturbance
  - Jennifer Dr sight-distance line

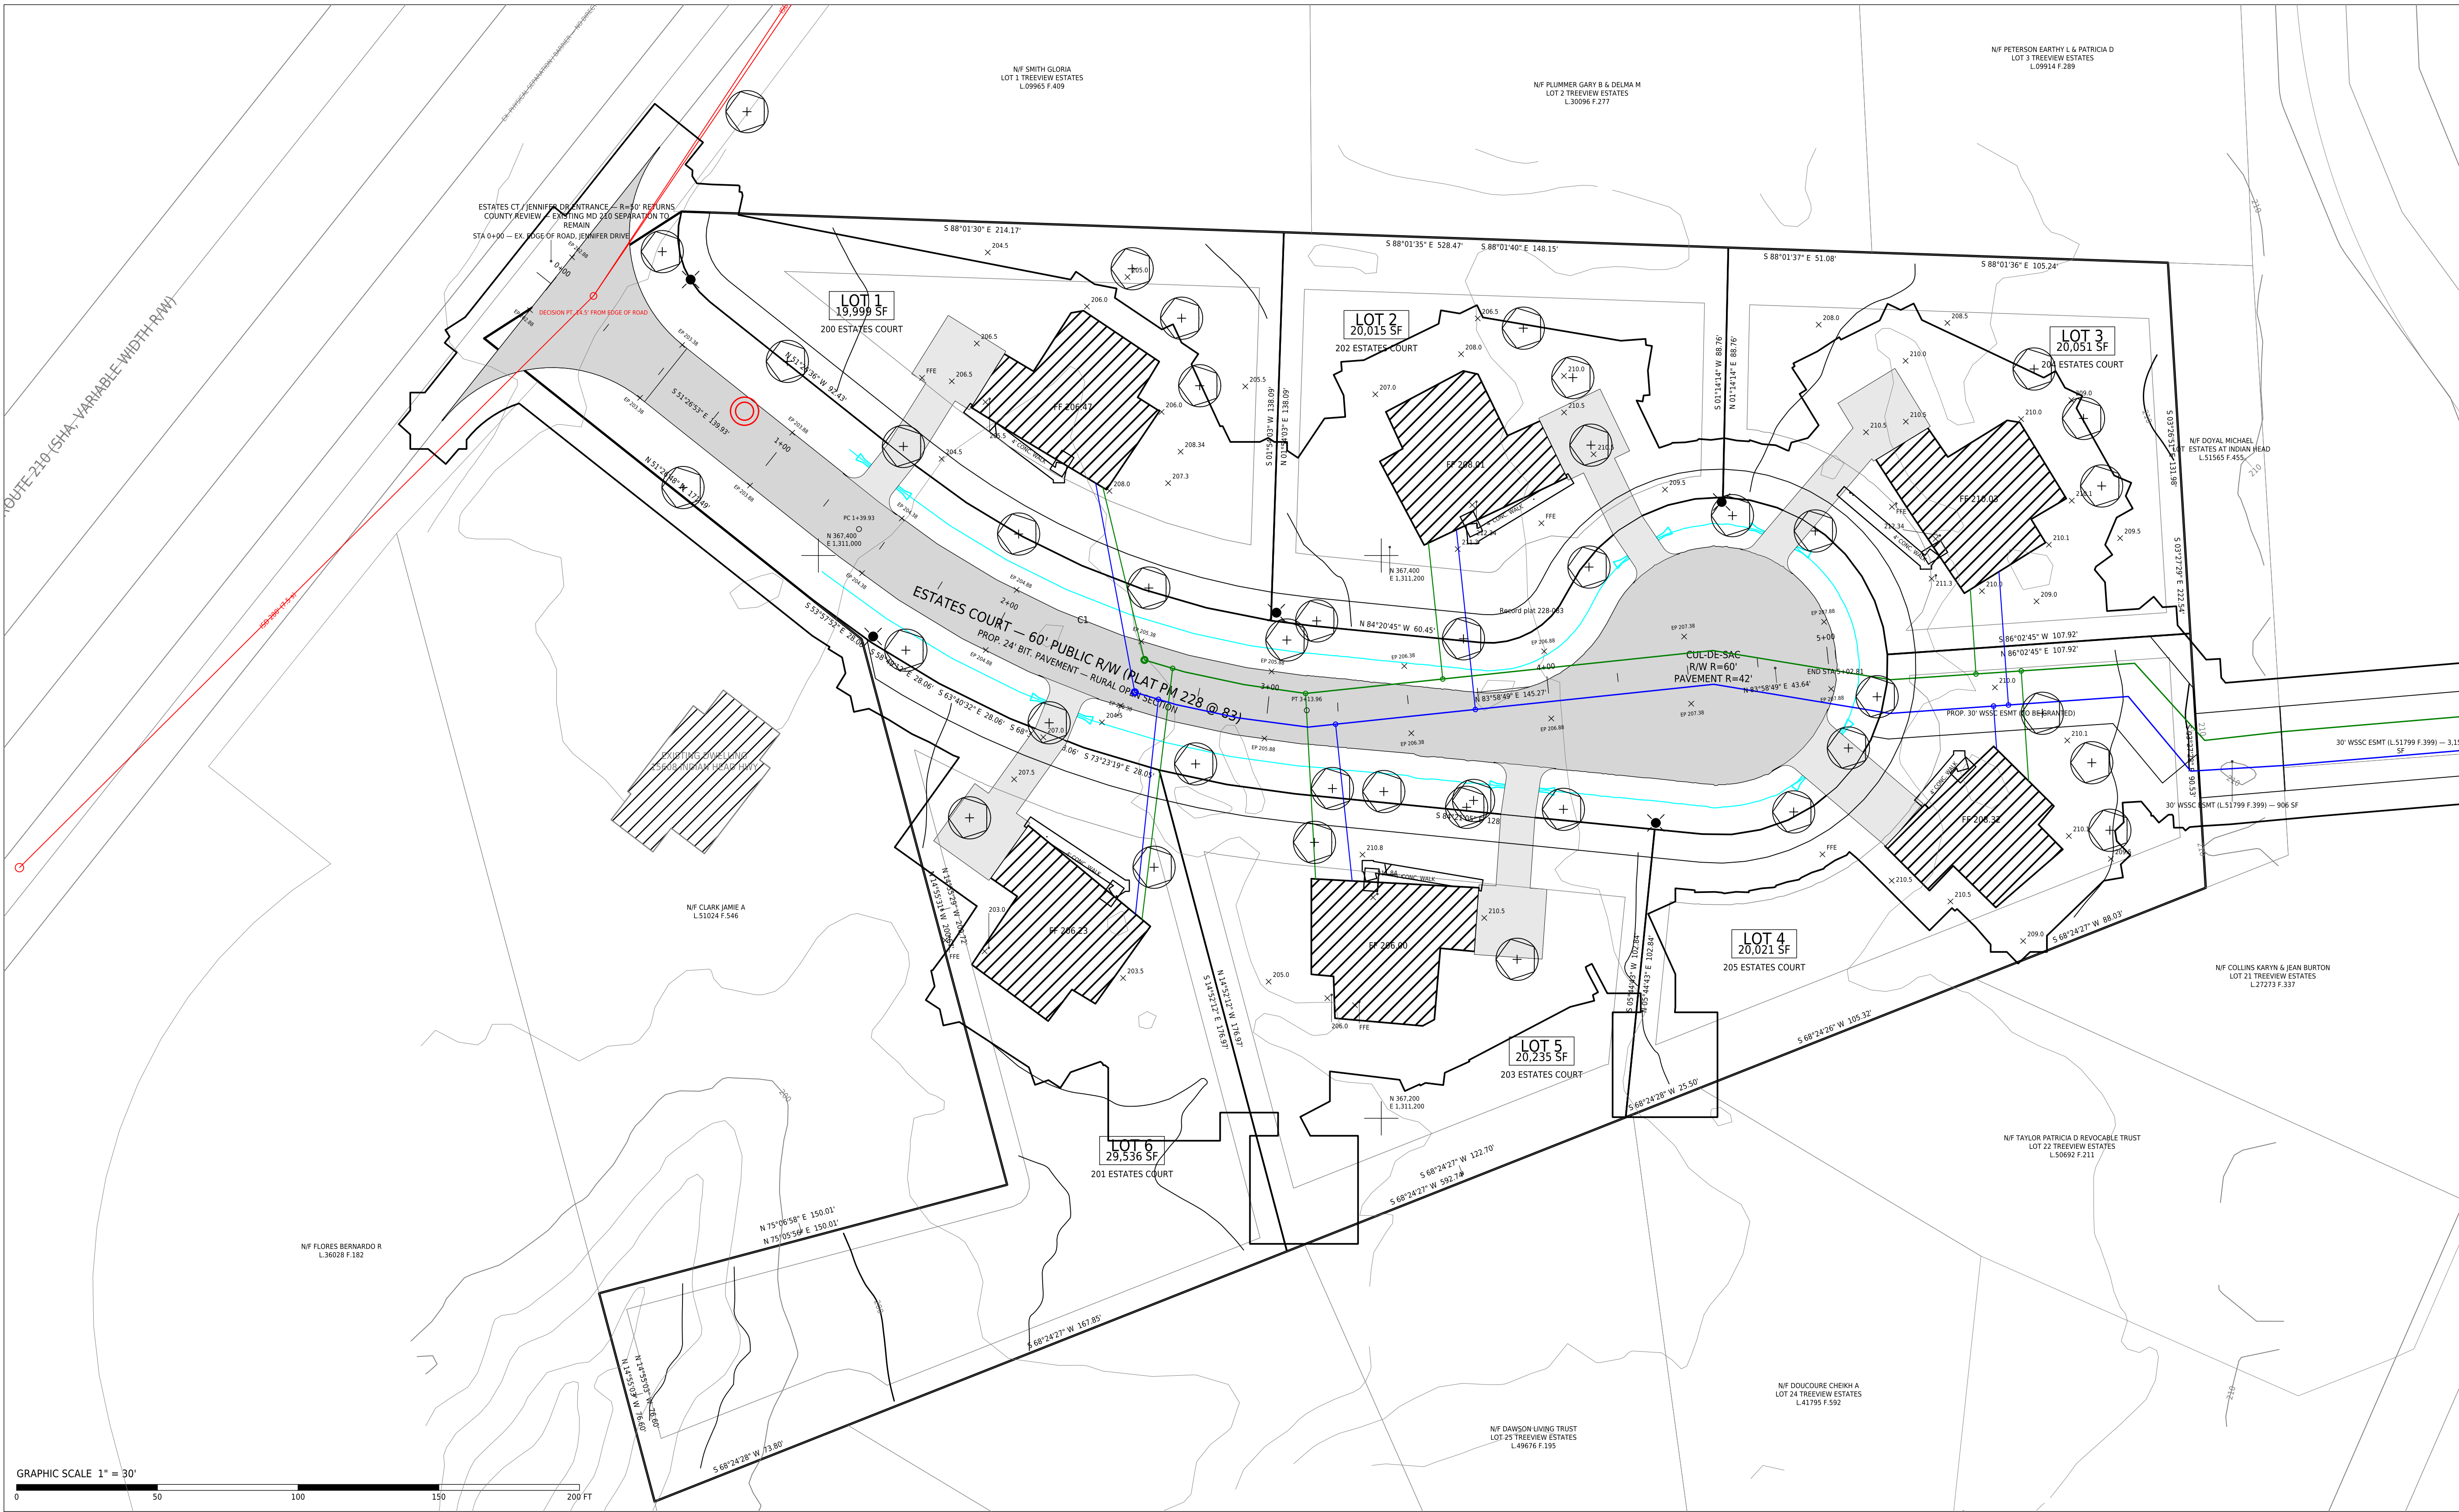

BUILDING DATA

| LOT   | ADDRESS           | FOOTPRINT SF | GARAGE | FF (NAVD 88) | B (NAVD 88) |
|-------|-------------------|--------------|--------|--------------|-------------|
| LOT 1 | 200 ESTATES COURT | 2349         |        | 206.47       | 197.47      |
| LOT 2 | 202 ESTATES COURT | 2325         |        | 208.01       | 199.01      |
| LOT 3 | 204 ESTATES COURT | 2313         |        | 210.03       | 201.03      |
| LOT 4 | 205 ESTATES COURT | 1902         |        | 208.32       | 199.32      |
| LOT 5 | 203 ESTATES COURT | 2408         |        | 206.00       | 197.00      |
| LOT 6 | 201 ESTATES COURT | 2333         |        | 206.23       | 197.23      |

RR ZONING COMPLIANCE MATRIX (CONCEPT)

| LOT   | AREA SF | COVERAGE % | FRONT   | SIDE   | REAR    | STATUS |
|-------|---------|------------|---------|--------|---------|--------|
| LOT 1 | 20041   | 17.30      | 25' MIN | 8' MIN | 20' MIN | PASS*  |
| LOT 2 | 20005   | 17.02      | 25' MIN | 8' MIN | 20' MIN | PASS*  |
| LOT 3 | 20060   | 17.54      | 25' MIN | 8' MIN | 20' MIN | PASS*  |
| LOT 4 | 20004   | 12.94      | 25' MIN | 8' MIN | 20' MIN | PASS*  |
| LOT 5 | 20228   | 17.43      | 25' MIN | 8' MIN | 20' MIN | PASS*  |
| LOT 6 | 28488   | 11.99      | 25' MIN | 8' MIN | 20' MIN | PASS*  |

\* Concept check: RR minimum lot 20,000 sf; maximum coverage 25%; minimum front setback 25/80/20 ft; maximum height 40 ft. Final survey and permit review govern.

INTERSECTION SIGHT DISTANCE AT JENNIFER DRIVE — DESIGN SPEED 25 MPH

| CASE (AASHTO 2018, 9-5.3)                   | Ld (s) | ISD REQ. (FT) |
|---------------------------------------------|--------|---------------|
| B2 RIGHT TURN — LOOKING LEFT ON JENNIFER DR | 6.5    | 240           |
| B1 LEFT TURN — LOOKING LEFT ON JENNIFER DR  | 7.5    | 280           |
| B1 LEFT TURN — LOOKING RIGHT ON JENNIFER DR | 7.5    | 280           |
| STOPPING SIGHT DISTANCE (TABLE 3-1)         | —      | 155           |

Desktop concept check only. Field survey shall verify grades, speed and obstructions; County access approval governs. Existing MD 210 separation remains.

SITE, ROAD AND GRADING NOTES

- Boundary per recorded plat PM 228 @ 83; lot lines reproduce the plat to the second.
- Horizontal datum: Maryland State Plane NAD 83 (US ft). Vertical datum: NAVD 88 (M-NCPPC 2-ft contours). Spot grades are on WSSC datum (≈ NAVD 88 + 1.6 ft). DPIE prefers NGVD 29.
- Six single-family dwellings with side-load garages and courts, street trees and street lights, laid out to current requirements. Lot 4 is front-load (garage to the cul-de-sac) to clear the WSSC easement.
- Estates Court is a rural open section (DPW&T Std. 500.10 / 600.02 / 600.04): 24' pavement, shoulders, roadside swales; driveways cross the swale on 15" RCP culverts with flared end sections.
- Estates Court intersects Jennifer Drive with 50' returns. Jennifer Drive lies between the entrance and MD 210; preserve the existing physical separation/barrier. No direct MD 210 access or auxiliary lanes are proposed. Field-verify Jennifer Drive sight distance for County review.
- Estates Court forms a T-intersection with Jennifer Drive. Jennifer Drive lies between the entrance and MD 210; the existing separation/barrier is to remain. No direct Estates Court connection or auxiliary lane on MD 210 is proposed.

MISS UTILITY NOTE

Information concerning existing underground utilities was obtained from available records. The contractor must field verify the exact locations and elevations as required for applicable horizontal and vertical clearances by digging test pits by hand, well in advance of excavation. Contact "Miss Utility" at 1-800-251-7777 (811), 48 hours prior to the start of any excavation. Provide results of test pits to the design engineer and coordinate with the engineer, owner/developer and utility company before proceeding with construction to resolve any conflicts or clearances with other utilities, storm drains, grading or other improvements.

STABILIZATION NOTE

Stabilization practices on all projects must be in compliance with the requirements of COMAR 26.17.01.08 G. Following initial soil disturbance or re-disturbance, permanent or temporary stabilization must be completed within: three (3) calendar days as to the surface of all perimeter dikes, swales, ditches, perimeter slopes and all slopes steeper than 3 horizontal to 1 vertical (3:1); and seven (7) calendar days as to all other disturbed or graded areas on the project site not under active grading.

OWNER / DEVELOPER

GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L.32062 F.043)

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. \_\_\_\_\_ Expiration date: \_\_\_\_\_

CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL

5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

W.L. MEEKINS, INC.  
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115  
PREPARED WITH KEALEE SPATIAL ENGINE / CAD-PLOT

ESTATES AT INDIAN HEAD  
SITE DEVELOPMENT CONCEPT PLAN  
LOTS 1 THRU 6 & ESTATES COURT

200-205 ESTATES COURT, ACCOKEEK, MD 20607  
PLAT: L.32062 F.043 (RECORDED)  
OWNER: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L.32062 F.043)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2024-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |

TITLE

SITE LAYOUT, GRADING AND PAVING PLAN


DATE: 2026-09-30

SCALE: 1" = 30'

SHEET: 4 OF 10

C-200


DRAWN: KEALEE CAD-PLOT  
DESIGNED:  
CHECKED:

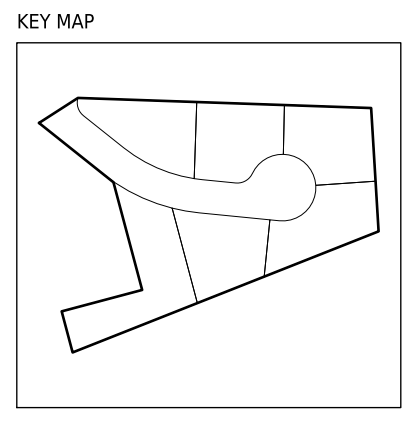



UTILITY, STREET LIGHT AND STREET TREE PLAN

- LEGEND
- Proposed 8" water main
  - Proposed 8" sanitary sewer
  - 1" water house connection (W.H.C.)
  - 4" sewer house connection (S.H.C.)
  - WSSC easement (recorded / proposed)
  - Street tree — Red Maple
  - Street light

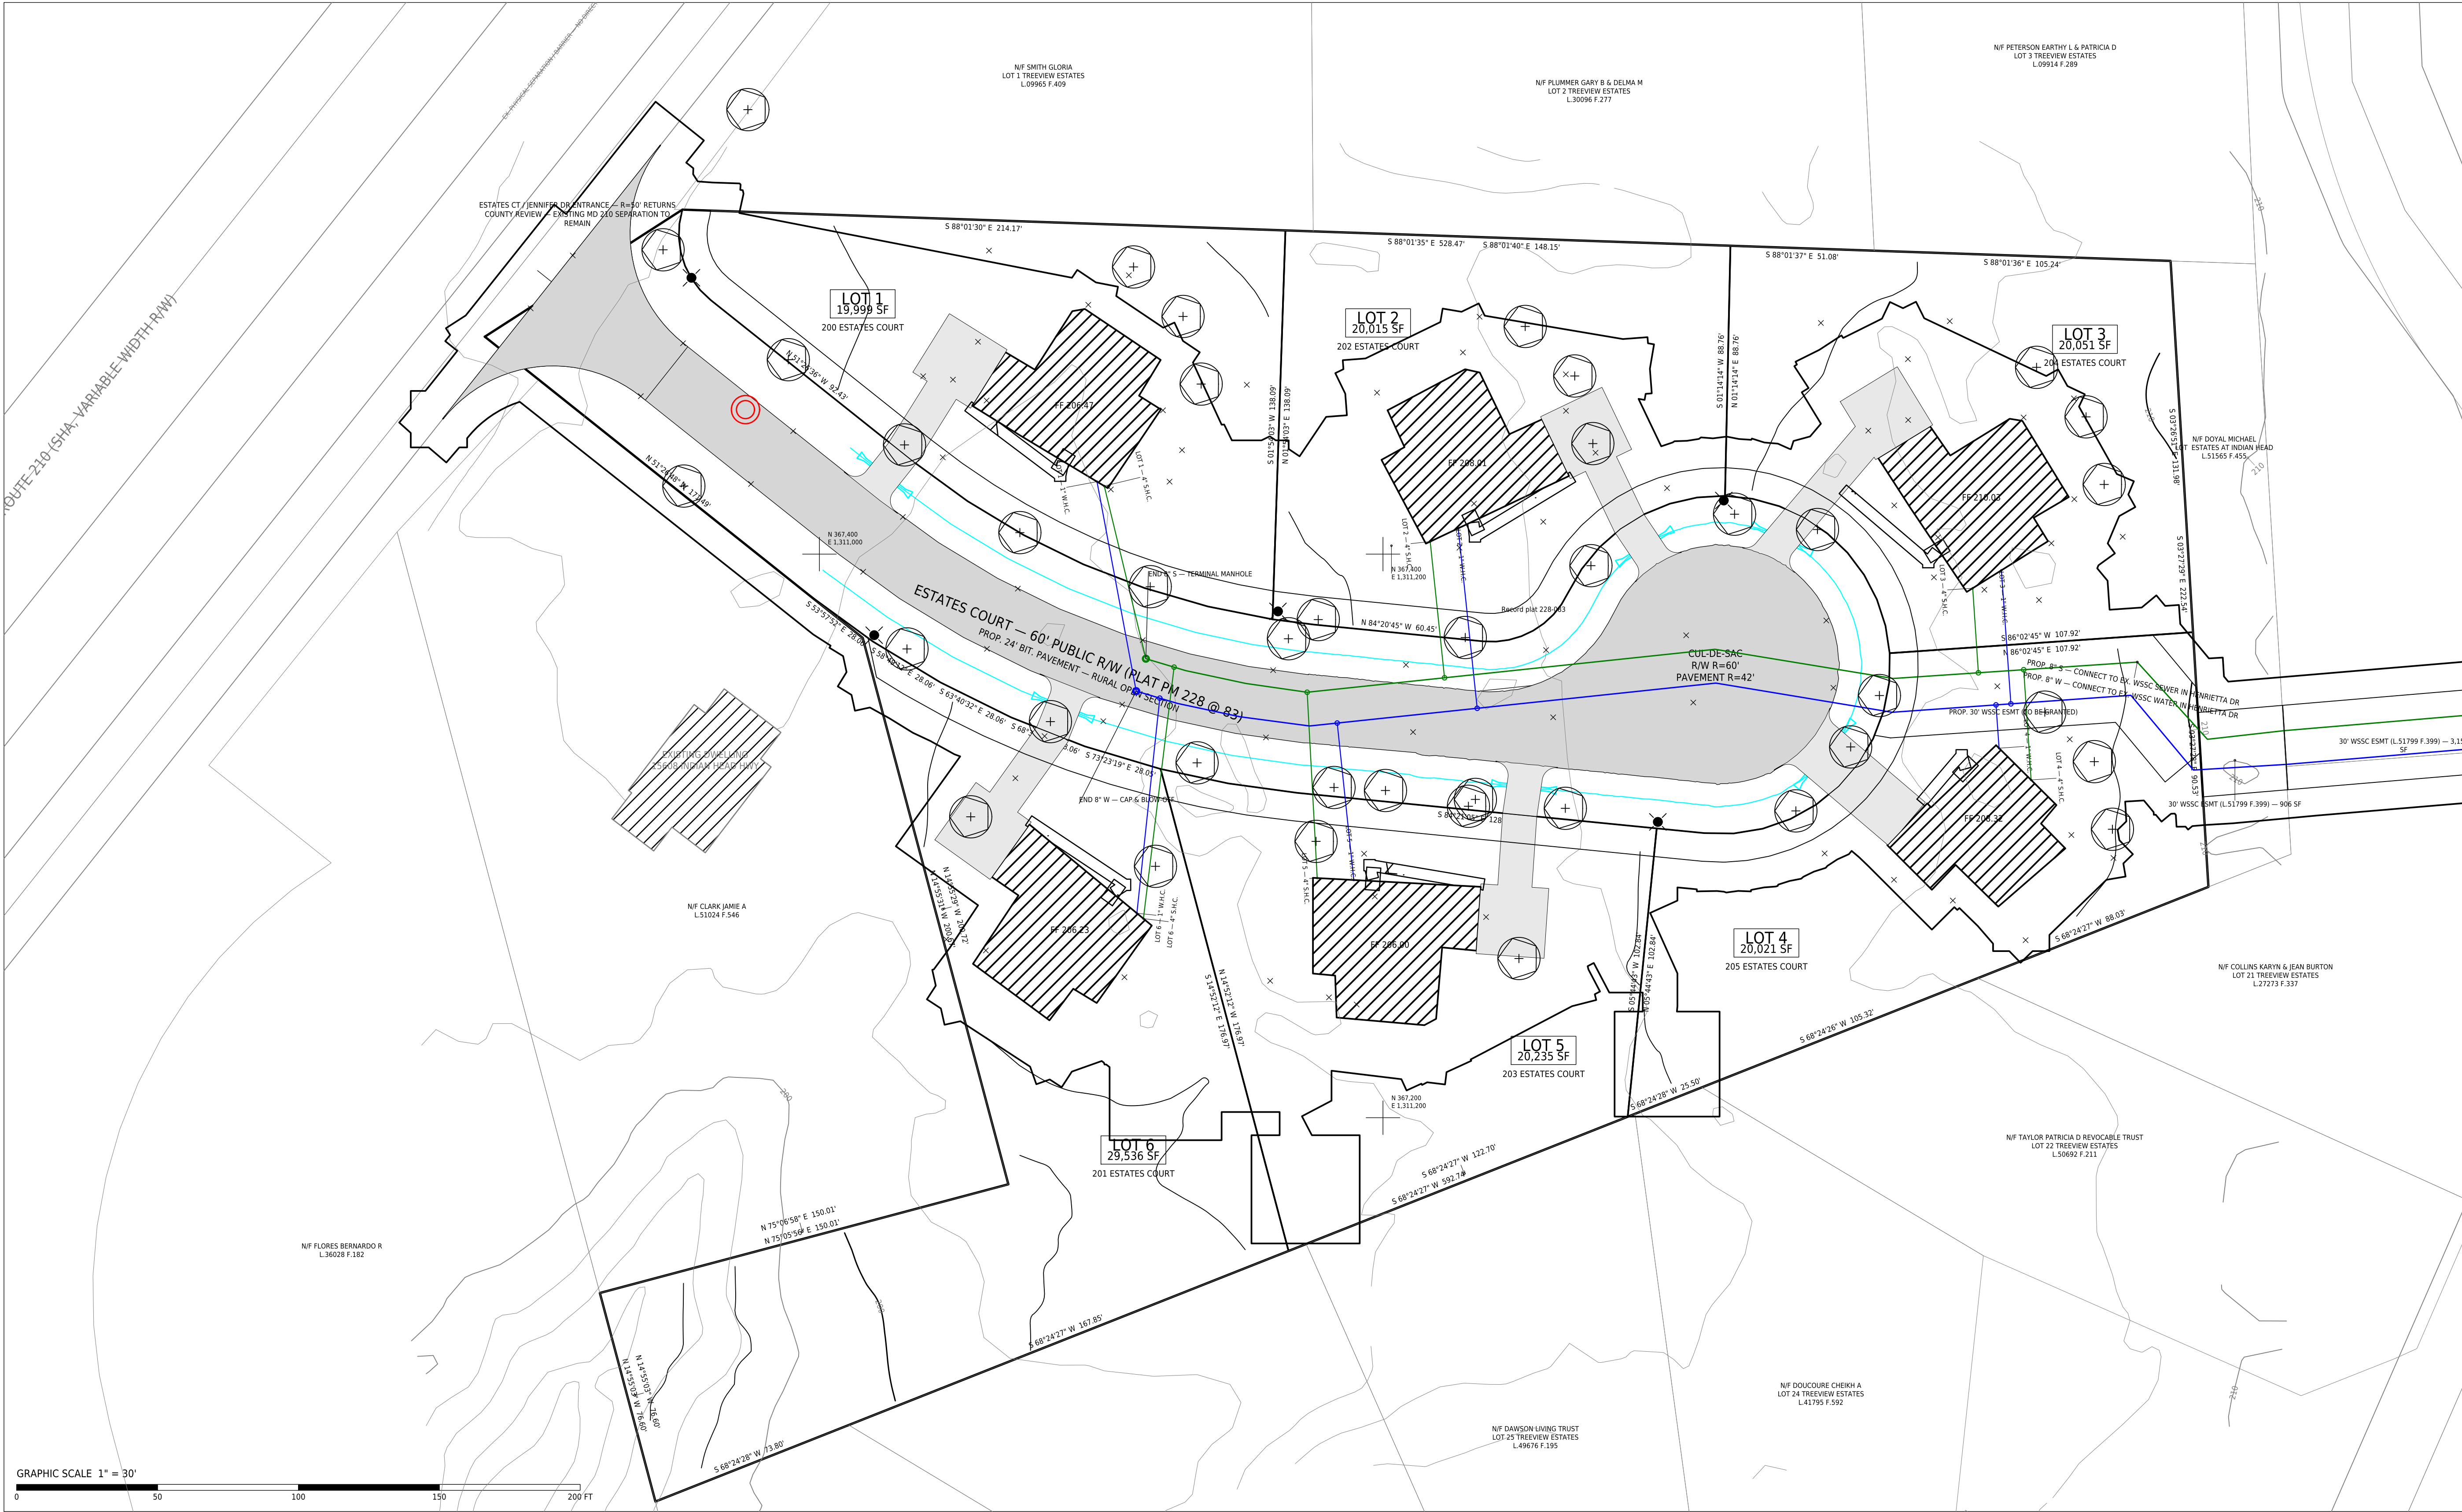

| STREET TREE AND STREET LIGHT SCHEDULE |     |                         |                                                        |                       |
|---------------------------------------|-----|-------------------------|--------------------------------------------------------|-----------------------|
| SYMBOL                                | QTY | ITEM                    | SIZE / TYPE                                            | STANDARD              |
| TREE                                  | 16  | ACER RUBRUM — RED MAPLE | 2 1/2"-3" CAL., B&B                                    | DPW&T 600.02 / 600.04 |
| LIGHT                                 | 5   | STREET LIGHT (SMECO)    | 100 W HPS COLONIAL POST-TOP, TYPE IV, BLACK FIBERGLASS | DPW&T 500.10          |

- UTILITY NOTES
- Water and sewer by WSSC (W-3 / S-3). Mains from the existing WSSC mains in Henrietta Drive through the recorded 30' WSSC easement (L51799 F.399, Outlot A and Lot 20) and a 30' WSSC easement to be granted across Lot 4 along the Lot 3/4 line.
  - The 8" water and 8" sewer mains stop just past the Lot 1 east property line, at the Lot 6 tap (15 ft past the Lot 5 / Lot 6 front corner): water capped with a blow-off, sewer at a terminal manhole. No main runs on toward MD 210; Lot 1 connects at the end of the mains.
  - Sizes and inverts of the Henrietta Drive mains per WSSC 200' sheet 2205E01.
  - Street lights and street trees per DPW&T Std. 500.10, 600.02 and 600.04; electric service by SMECO.
  - Keep street trees 10 ft from water meters and storm structures and 15 ft from street lights (DPW&T 600.02).
  - House connections: 1" copper water service and 4" PVC sewer lateral per lot, each tapped on its own main and run to the dwelling clear of every driveway, apron, walk, stoop, culvert and ESD cell (3 ft min.), so no concrete or structure is removed to lay or repair them; water and sewer 10 ft apart (WSSC).
  - LOT 1, LOT 6: water and sewer in a COMMON TRENCH (no 10-ft corridor clear of the paving) — water on a shelf 12 in above the sewer, subject to WSSC approval at plumbing permit; otherwise relocate the lead walk.

MISS UTILITY NOTE

Information concerning existing underground utilities was obtained from available records. The contractor must field verify the exact locations and elevations as required for applicable horizontal and vertical clearances by digging test pits by hand, well in advance of excavation. Contact "Miss Utility" at 1-800-251-7777 (811), 48 hours prior to the start of any excavation. Provide results of test pits to the design engineer and coordinate with the engineer, owner/developer and utility company before proceeding with construction to resolve any conflicts or clearances with other utilities, storm drains, grading or other improvements.

STABILIZATION NOTE

Stabilization practices on all projects must be in compliance with the requirements of COMAR 26.17.01.08 G. Following initial soil disturbance or re-disturbance, permanent or temporary stabilization must be completed within: three (3) calendar days as to the surface of all perimeter dikes, swales, ditches, perimeter slopes and all slopes steeper than 3 horizontal to 1 vertical (3:1); and seven (7) calendar days as to all other disturbed or graded areas on the project site not under active grading.

OWNER / DEVELOPER  
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L.32062 F.043)

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. \_\_\_\_\_ Expiration date: \_\_\_\_\_

CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

W.L. MEEKINS, INC.  
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115  
PREPARED WITH KEALE SPATIAL ENGINE / CAD-PLOT

ESTATES AT INDIAN HEAD  
SITE DEVELOPMENT CONCEPT PLAN  
LOTS 1 THRU 6 & ESTATES COURT

200-203 ESTATES COURT, ACCOKEEK, MD 20607  
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE DR  
PLAT 24 TREEVIEW ESTATES  
OWNER: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L.32062 F.043)

REVISIONS

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1

DATE

DESCRIPTION

2026-09-30

CONCEPT SUBMISSION 1


DATE

DESCRIPTION

2026-0

**LEGEND**

- ESD practice — micro-bioretentor (M-6)
- Roadside dry swale (M-8)
- Drainage area to practice
- - - Off-site area draining onto site
- - - 100-yr overflow path
- Point of investigation
- Driveway culvert

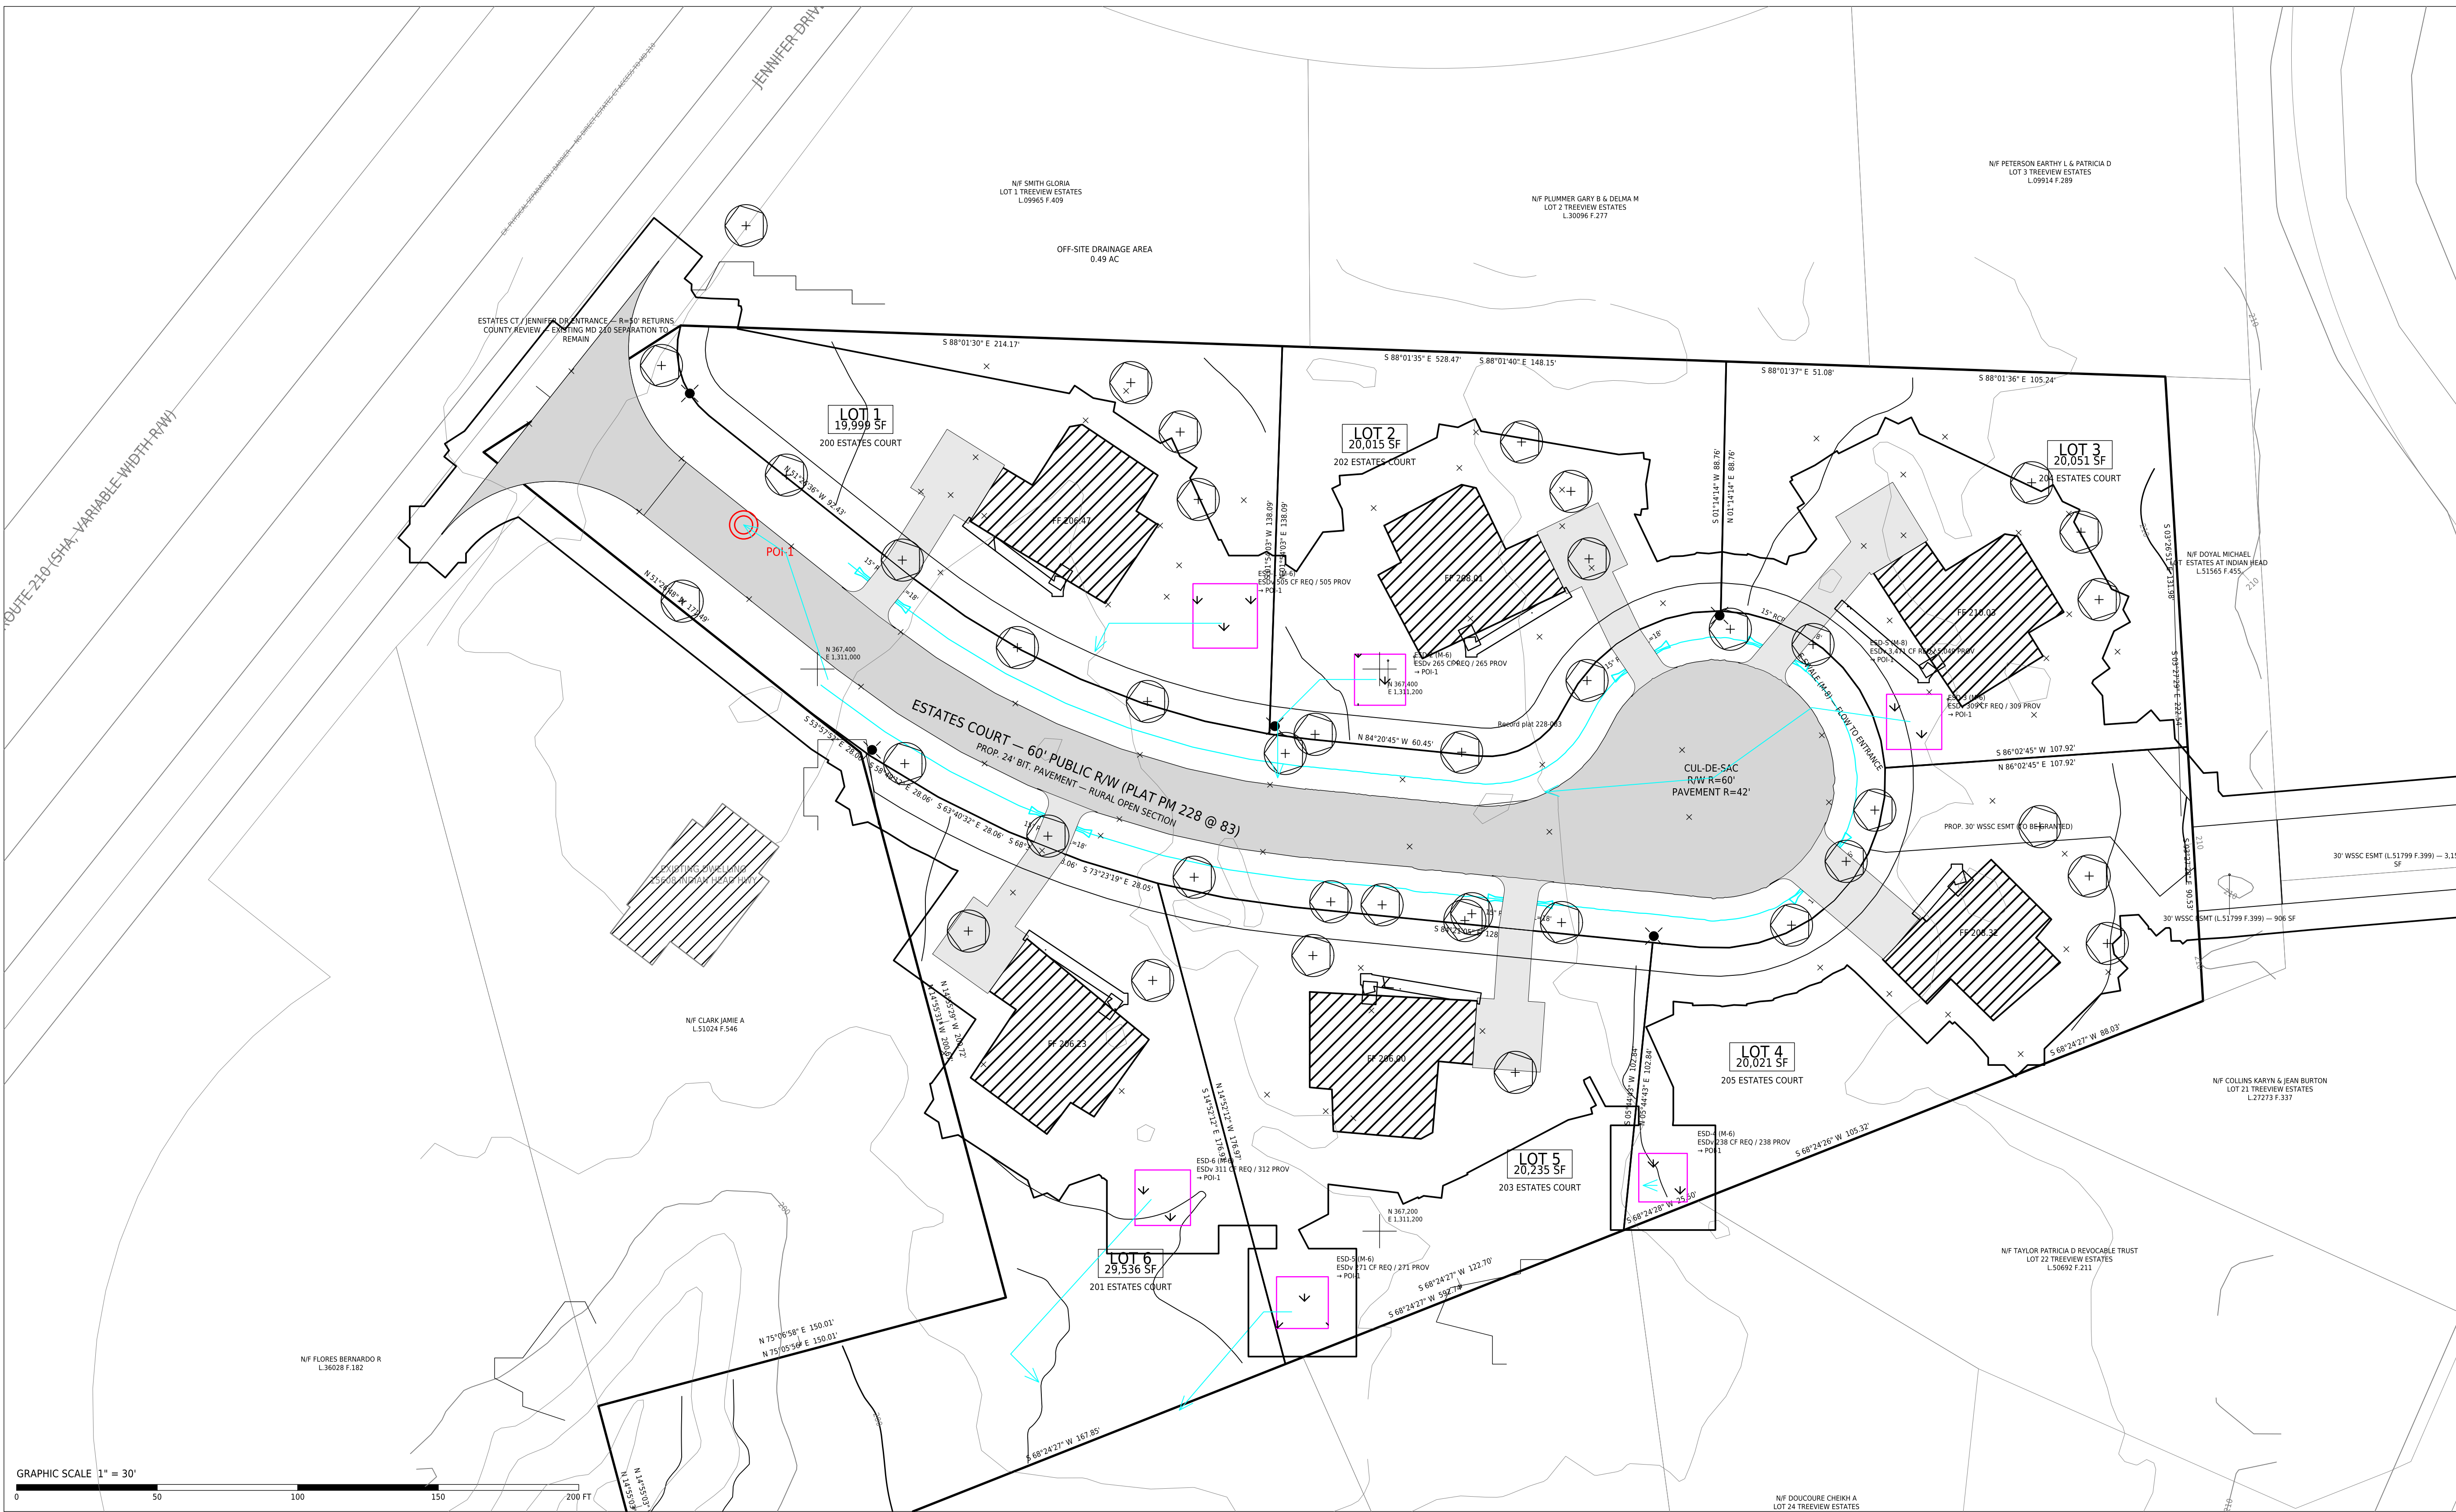

| BMP   | MDE | LOCATION                   | POI   | DA SF  | %    | P E | ESDvs REQ | ESDvs PROV |
|-------|-----|----------------------------|-------|--------|------|-----|-----------|------------|
| ESD-1 | M-6 | Lot 1                      | POI-1 | 19.999 | 22.5 | 1.2 | 505       | 505        |
| ESD-2 | M-6 | Lot 2                      | POI-1 | 20.015 | 12.1 | 1.0 | 265       | 265        |
| ESD-3 | M-6 | Lot 3                      | POI-1 | 20.051 | 15.0 | 1.0 | 309       | 309        |
| ESD-4 | M-6 | Lot 4                      | POI-1 | 20.021 | 10.3 | 1.0 | 238       | 238        |
| ESD-5 | M-6 | Lot 5                      | POI-1 | 20.235 | 12.3 | 1.0 | 271       | 271        |
| ESD-6 | M-6 | Lot 6                      | POI-1 | 29.536 | 8.5  | 1.0 | 311       | 312        |
| ESD-5 | M-8 | Estates Ct R/W, both sides | POI-1 | 36.041 | 58.6 | 2.0 | 3,471     | 5,049      |

| POI   | LOCATION                 | SHARE | ESDv REQ | ESDv PROV |
|-------|--------------------------|-------|----------|-----------|
| POI-1 | N 367,451 E<br>1,310.974 | 100%  | 5,370    | 6,949     |

1. SWM by Environmental Site Design to the MEP CM. Stg Water Management Act of 2007; MDE Design Manual Ch. 5; PGC Subtitle 09-16-01, Part 10. See also Table 5.3 for HSG C at each drainage area's imperviousness.
2. Each lot drains to one micro-bioretention cell (M-B): 12-in max. ponding, 2-5 ft filter media, underdrain to a stable outfall pipe. Court drains to roadside dry swales (M-S) with check dams.
3. Roofed and non-roofed disconnection (N-1, N-2) to be credited at technical design. Infiltration credit only where sec. 10.10 borings show.
4. Private ESD practices; maintenance agreement recorded before permit; public swales in the R/W maintained by DPJE.
5. D8 low routing on a 5-ft surface intercepted from the existing contours; up to 10% of the watershed at 120 ft; P.O.s carrying over 4% of the site settled.

The diagram illustrates a cross-section of a stormwater management system. At the top left, a vertical pipe labeled "4\" observation well / CLEANOUT W/ CAP" extends from the surface down to the stone cover layer. To its right, a horizontal line indicates the water level, labeled "12\" MAX. PONDING (if TYP.)". Further right, another vertical pipe labeled "OVERFLOW RISER, 12\" DOMED GRATE @ PONDING EL." extends from the surface down through multiple layers. The layers are labeled on the right side as follows: "3\" SHREDDED HARDWOOD MULCH", "2.5\" BIORETENTION SOIL MEDIA (INDE APPX. B-4)", "2\" PEA GRAVEL / CHOKER (NO FILTER FABRIC ON SIDES)", "12\" #57 WASHED STONE", and "UNCOMPACTED SUBGRADE --- SCARIFY". A circular feature at the bottom center represents the "4\" PERF. SCH. 40 PVC UNDERDRAIN @ 0.5% MIN., 3\" STONE COVER". On the far left, a sloped embankment is labeled "3:1 MAX."

SIZED PER THE BMP SUMMARY TABLE (C-000); SURFACE AREA, ESD: CELL BOTTOM  $\geq$  2 FT ABOVE SEASONAL HIGH GROUNDWATER UNDERDRIN TO A STABLE OUTFALL; INFILTRATION CREDIT ONLY WHERE BORINGS SHOW  $\geq$  0.52 IN/HR (SEC. 32-131).  
MEDIA PER MDE MANUAL APPENDIX B.4 (SAND/TOPSOIL/ORGANIC); PLANT PER APPENDIX A, TABLE 1.  
BUILD AFTER THE CONTRIBUTING AREA IS STABILIZED; PROTECT FROM CONSTRUCTION TRAFFIC AND SEDIMENT.  
PRIVATE PRACTICE: MAINTENANCE AGREEMENT RECORDED BEFORE PERMIT. MDE DESIGN MANUAL CH. 5, SEC. 5.4.3 (M-6).

Information concerning existing underground utilities was obtained from available records. The contractor must verify the exact locations and elevations as required for applicable horizontal and vertical clearances by digging test pits by hand, well in advance of excavation. Contact "Miss" at 1-800-451-7777 (811) to request a utility map to the site of any excavation. Provide results of test pits to the design engineer and coordinate with the engineer, owner/developer and utility company before proceeding with construction to resolve any conflicts or clearances with other utilities, storm drains, grading or other improvements.


Stabilization practices on all projects must be in compliance with the requirements of COMAR 26.17.01.08 G. Following initial soil disturbance or re-disturbance, permanent or temporary stabilization must be completed within: three (3) calendar days as to the surface of all perimeter dikes, swales, ditches, perimeter slopes and all slopes steeper than 3 horizontal to 1 vertical (3:1); and seven (7) calendar days as to all other disturbed or graded areas on the project site not under active grading.

|                                                                                                  |
|--------------------------------------------------------------------------------------------------|
| OWNER / DEVELOPER                                                                                |
| GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH,<br>FL 33401 (L.32062 F.043) |

I hereby certify that these documents were prepared or approved by me and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. \_\_\_\_\_ Expiration date: \_\_\_\_\_

CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)



|        |            |                                                            |  |            |                      |
|--------|------------|------------------------------------------------------------|--|------------|----------------------|
| DATE:  | 2026-09-30 | TITLE: STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP |  | REVIEWS    |                      |
| SCALE: | 1" = 30'   | C-400                                                      |  | DATE       | DESCRIPTION          |
| SHEET: | 7 OF 10    |                                                            |  | 2026-09-30 | CONCEPT SUBMISSION 1 |
|        |            |                                                            |  |            |                      |
|        |            | DRAWN: KESALEE CAD-PLT                                     |  |            |                      |
|        |            | DESIGNED:                                                  |  |            |                      |
|        |            | CHECKED:                                                   |  |            |                      |

# ESTATES AT INDIAN HEAD

## SITE DEVELOPMENT CONCEPT PLAN

### LOTS 1 THRU 6 & ESTATES COURT

**W.L. MEEKINS, INC.**  
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 • 301-736-7115  
PREPARED WITH KEALEE SPATIAL ENGINE / CAD-PILOT



RESERVED FOR COUNTY ePLAN STAMP  
3" x 3" — KEEP BLANK

KEY MAP

N

D-1 SWM CONCEPT NARRATIVE

1. Natural resources: there are no streams, wetlands, 100-yr floodplain or PMA on the property. Woodland (132,705 sf) is conserved outside the limit of disturbance shown on the sediment control plan.

2. Natural flow patterns: the tract falls toward Jennifer Drive and leaves at one point of investigation, which the proposed grading keeps; no drainage is diverted between POIs.

3. Impervious reduction: rural open section (24-ft pavement, no curb and gutter); side-load courts kept to the turning area at each garage. Proposed impervious 38,129 sf (23.0%).

4. ESD to the MEP: 7 practices — micro-bioretentention (M-6) on each lot and roadside dry swales with check dams (M-8) in the R/W. ESDv required 5,370 cf, provided 6,949 cf (MDE Manual Ch. 5, Table 5.3, HSG C).

5. ESC integration: practice footprints are kept out of the sediment-trapping sequence and are built last, after the contributing area is stabilized; sediment control is shown on C-500.

D-3 OUTFALLS AND RECEIVING AREAS

1. POI-1 lies where the Estates Court swales and overland flow leave the tract, discharging to the existing Jennifer Drive frontage-road drainage system. The outfall is not on a mapped stream or within a mapped 100-yr floodplain. Field survey and County acceptance are required; no direct discharge point to MD 210 is proposed.

D-4 OUTFALL STABILIZATION

1. POI-1: 10-yr velocity 3.2 ft/s is within 4.0 ft/s for a grass-lined channel. The 100-yr velocity is 4.00 ft/s; provide engineered outlet protection and verify receiving-system capacity before technical approval. Normal depth at the 100-yr flow 1.13 ft in the grass-lined roadside swale, 2-ft bottom, 3:1 sides, n = 0.035 at 1.5% slope. Upstream inflow from off site (0.49 ac) enters as sheet flow along the tract line and is carried by the swales; no concentrated inflow point needs stabilization.

POI-1 — COVER, CURVE NUMBER AND Tc (165,902 SF, HSG C)

| CONDITION | WOODS SF | OPEN SPACE SF | IMPERVIOUS SF | CN   | Tc HR |
|-----------|----------|---------------|---------------|------|-------|
| Existing  | 132,705  | 33,197        | 0             | 70.8 | 0.419 |
| Proposed  | 38,977   | 88,796        | 38,129        | 78.6 | 0.285 |

TIME OF CONCENTRATION — PROPOSED (TR-55)

| SEGMENT                       | L FT | S FT/FT | V FPS | Tt HR |
|-------------------------------|------|---------|-------|-------|
| sheet flow, dense grass       | 100  | 0.0152  | 0.10  | 0.266 |
| shallow concentrated, unpaved | 137  | 0.0152  | 1.99  | 0.019 |

POI-1 — PEAK DISCHARGE, EXISTING VS. PROPOSED (NO ESD CREDIT)

| STORM YR | P 24-HR IN | Q EXIST CFS | Q PROP CFS | CHANGE | RUNOFF EXIST CF | RUNOFF PROP CF |
|----------|------------|-------------|------------|--------|-----------------|----------------|
| 1        | 2.63       | 1.19        | 3.12       | +1.93  | 7,598           | 12,488         |
| 2        | 3.19       | 2.18        | 4.78       | +2.60  | 11,918          | 18,003         |
| 10       | 4.93       | 6.24        | 10.94      | +4.70  | 28,312          | 37,377         |
| 100      | 8.51       | 17.21       | 24.42      | +7.21  | 69,143          | 82,032         |

POI-1 — OUTFALL VELOCITY CHECK (MANNING, NORMAL DEPTH)

| SECTION                                                       | S FT/FT | Q10 CFS | V10 FPS | Q100 CFS | V100 FPS | d100 FT | V ALLOW FPS |
|---------------------------------------------------------------|---------|---------|---------|----------|----------|---------|-------------|
| grass-lined roadside swale, 2-ft bottom, 3:1 sides, n = 0.035 | 0.0152  | 10.94   | 3.24    | 24.42    | 4.00     | 1.13    | 4.0         |

D-10 COMPUTATIONS

1. ESDv required and provided per POI: BMP Summary Table (C-000), Rainfall: NOAA Atlas 14 Vol. 2 Ver. 3, PFDS point estimate, 38.6752 N 77.0040 W, partial duration series, 24-hr, retrieved 2026-09-30.

2. POI-1: 3.81 ac, CN 70.8 → 78.6, Tc 0.419 → 0.285 hr; 100-yr 17.2 → 24.4 cfs (+7.2 cfs), runoff 69,143 → 82,032 cf.

3. No ESD credit is taken in the 100-yr comparison (conservative). ESD to the MEP satisfies channel protection where the Table 5.3 target is met.

4. Downstream adequacy of the existing Jennifer Drive frontage-road drainage system for the 10- and 100-yr flows at each POI, using field survey and available County/SHA drainage records, at technical design. If inadequate, quantity control and/or conveyance improvements are required (checklist D-10).

OUTSTANDING FOR TECHNICAL DESIGN

1. Downstream adequacy of the existing Jennifer Drive frontage-road drainage system for the 10- and 100-yr flows at each POI, using field survey and available County/SHA drainage records, at technical design. If inadequate, quantity control and/or conveyance improvements are required (checklist D-10).

2. POIs, flow paths and the time of concentration are computed on M-NCPPC 2-ft topography.

METHOD AND SOURCES

NRCS TR-55 graphical peak discharge, Type II 24-hr; CN from TR-55 Table 2-2 (HSG C: woods 70, open space 74, impervious 98); Tc by TR-55 segments along the routed longest path; no ESD credit on the 100-yr.

NOAA Atlas 14 Vol. 2 Ver. 3, PFDS point estimate, 38.6752 N 77.0040 W, partial duration series, 24-hr, retrieved 2026-09-30

ESTATES AT INDIAN HEAD  
SITE DEVELOPMENT CONCEPT PLAN  
LOTS 1 THRU 6 & ESTATES COURT

200-205 ESTATES COURT, ACCOKEEK, MD 20607  
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE BR  
PLAT: 200-205 ESTATES COURT, ACCOKEEK, MD 20607  
OWNER: GERALD WALDMAN REVOCABLE TRUST AND N. FLAGLER CO., WEST PALM BEACH, FL 33401 (L12082 F 643)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2026-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |
|            |                      |

STORMWATER MANAGEMENT CONCEPT NARRATIVE AND 100-YR COMPUTATIONS

C-410

DATE: 2026-09-30

SCALE: AS NOTED

SHEET: 8 OF 10

DESIGN: KEALEE CAD-PIOT

DESIGNED:

CHECKED:

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. \_\_\_\_\_ Expiration date: \_\_\_\_\_

CONCEPT SUBMISSION 1 — NOT SEALED


RESERVED FOR PRINCE GEORGE'S COUNTY DPPE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

SEAL

W.L. MEEKINS, INC.  
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115  
PREPARED WITH KEALEE SPATIAL ENGINE / CAD-PIOT

SEDIMENT AND EROSION CONTROL PLAN

- LEGEND
- Limit of disturbance
  - Super silt fence
  - Stabilized construction entrance
  - Proposed contour
  - Existing contour

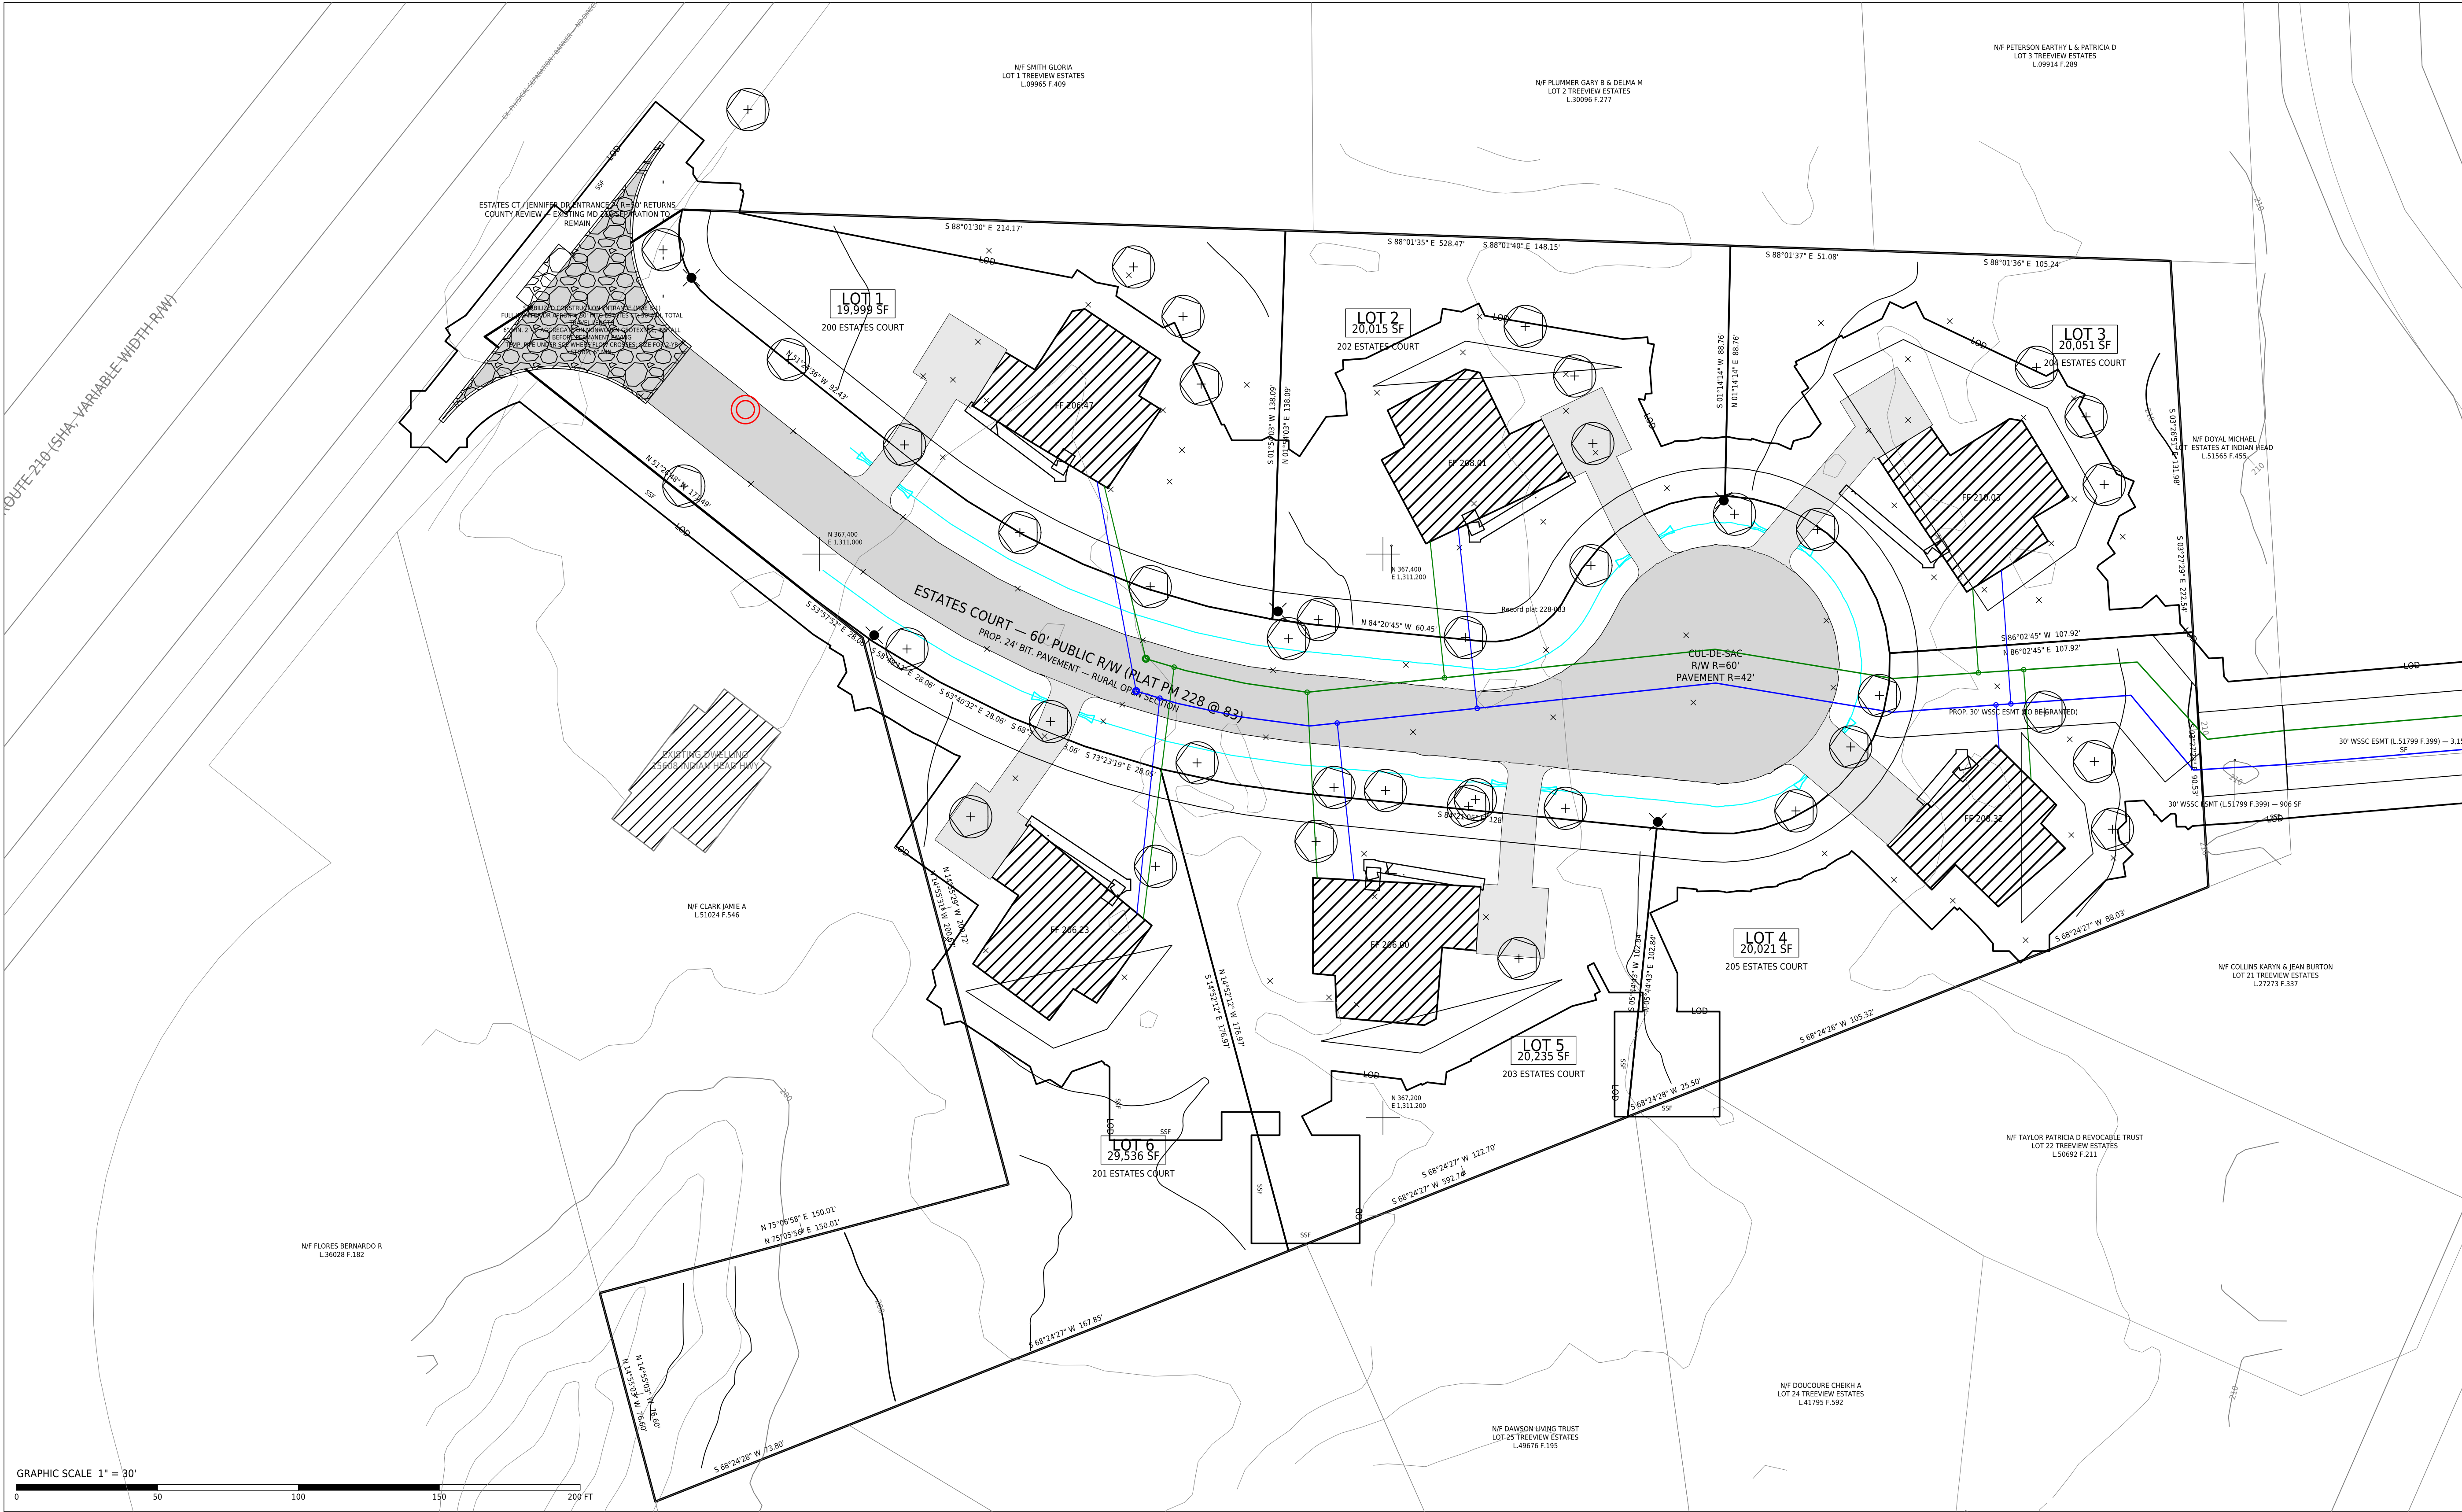

SEDIMENT AND EROSION CONTROL NOTES

- Sediment and erosion control per the 2011 Maryland Standards and Specifications for Soil Erosion and Sediment Control and PGSCD requirements.
- MDE Detail B-1 stabilized construction entrance: cover the full unpaved Jennifer Drive entrance apron and continue 30 ft into Estates Court; provide at least 50 ft total vehicle travel length and 10 ft minimum width, using 6 in minimum depth of 2-3 in aggregate over nonwoven geotextile. Install before permanent paving; do not place stone over existing Jennifer Drive pavement.
- Pipe all surface flow crossing the SCE beneath it, sized for the 2-year, 24-hour storm (6 in minimum), with a mountable berm where not at a high point. Super silt fence along the down-gradient LOD; inlet and swale protection.
- Stabilize disturbed areas within 3 days on slopes  $\geq$  3:1 and within 7 days elsewhere.

SEQUENCE OF CONSTRUCTION

- Pre-construction meeting with the PGSCD / DPIE inspector; Miss Utility.
- Install stabilized construction entrance and perimeter controls; inspector approval.
- Clear and grub within the LOD; rough grade Estates Court and swales.
- Install water and sewer (Henrietta Dr to Estates Ct) and house connections.
- Construct pavement, shoulders, culverts and entrance; stabilize swales.
- Build dwellings, driveways and courts; construct ESD practices after the contributing area is stable.
- Fine grade, permanent stabilization, street trees and lights; remove controls with inspector approval.

MISS UTILITY NOTE

Information concerning existing underground utilities was obtained from available records. The contractor must field verify the exact locations and elevations as required for applicable horizontal and vertical clearances by digging test pits by hand, well in advance of excavation. Contact "Miss Utility" at 1-800-251-7777 (811), 48 hours prior to the start of any excavation. Provide results of test pits to the design engineer and coordinate with the engineer, owner/developer and utility company before proceeding with construction to resolve any conflicts or clearances with other utilities, storm drains, grading or other improvements.

STABILIZATION NOTE

Stabilization practices on all projects must be in compliance with the requirements of COMAR 26.17.01.08 G. Following initial soil disturbance or re-disturbance, permanent or temporary stabilization must be completed within: three (3) calendar days as to the surface of all perimeter dikes, swales, ditches, perimeter slopes and all slopes steeper than 3 horizontal to 1 vertical (3:1); and seven (7) calendar days as to all other disturbed or graded areas on the project site not under active grading.


OWNER / DEVELOPER  
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L32062 F.043)

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. \_\_\_\_\_ Expiration date: \_\_\_\_\_

CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

KEY MAP

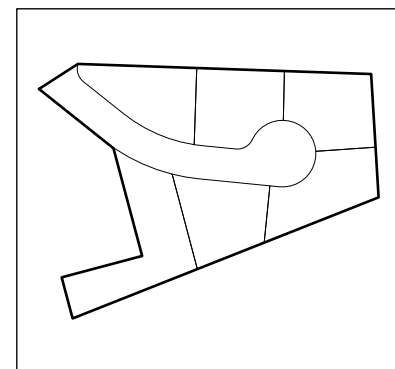

W.L. MEEKINS, INC.  
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115  
PREPARED WITH KSALEE SPATIAL ENGINE / CAD-PLOT

ESTATES AT INDIAN HEAD  
SITE DEVELOPMENT CONCEPT PLAN  
LOTS 1 THRU 6 & ESTATES COURT

200-205 ESTATES COURT, ACCOKEEK, MD 20607  
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE DR  
PLAT 24 THRU 28, 2006  
OWNER: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L32062 F.043)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2024-09-30 | CONCEPT SUBMISSION 1 |

THE

SEDIMENT AND EROSION CONTROL PLAN

DATE: 2026-09-30

SCALE: 1" = 30'

SHEET: 9 OF 10

C-500




DRAWN: KSALEE CAD-PLOT

DESIGNED: \_\_\_\_\_


CHECKED: \_\_\_\_\_

SEAL

DETAILS

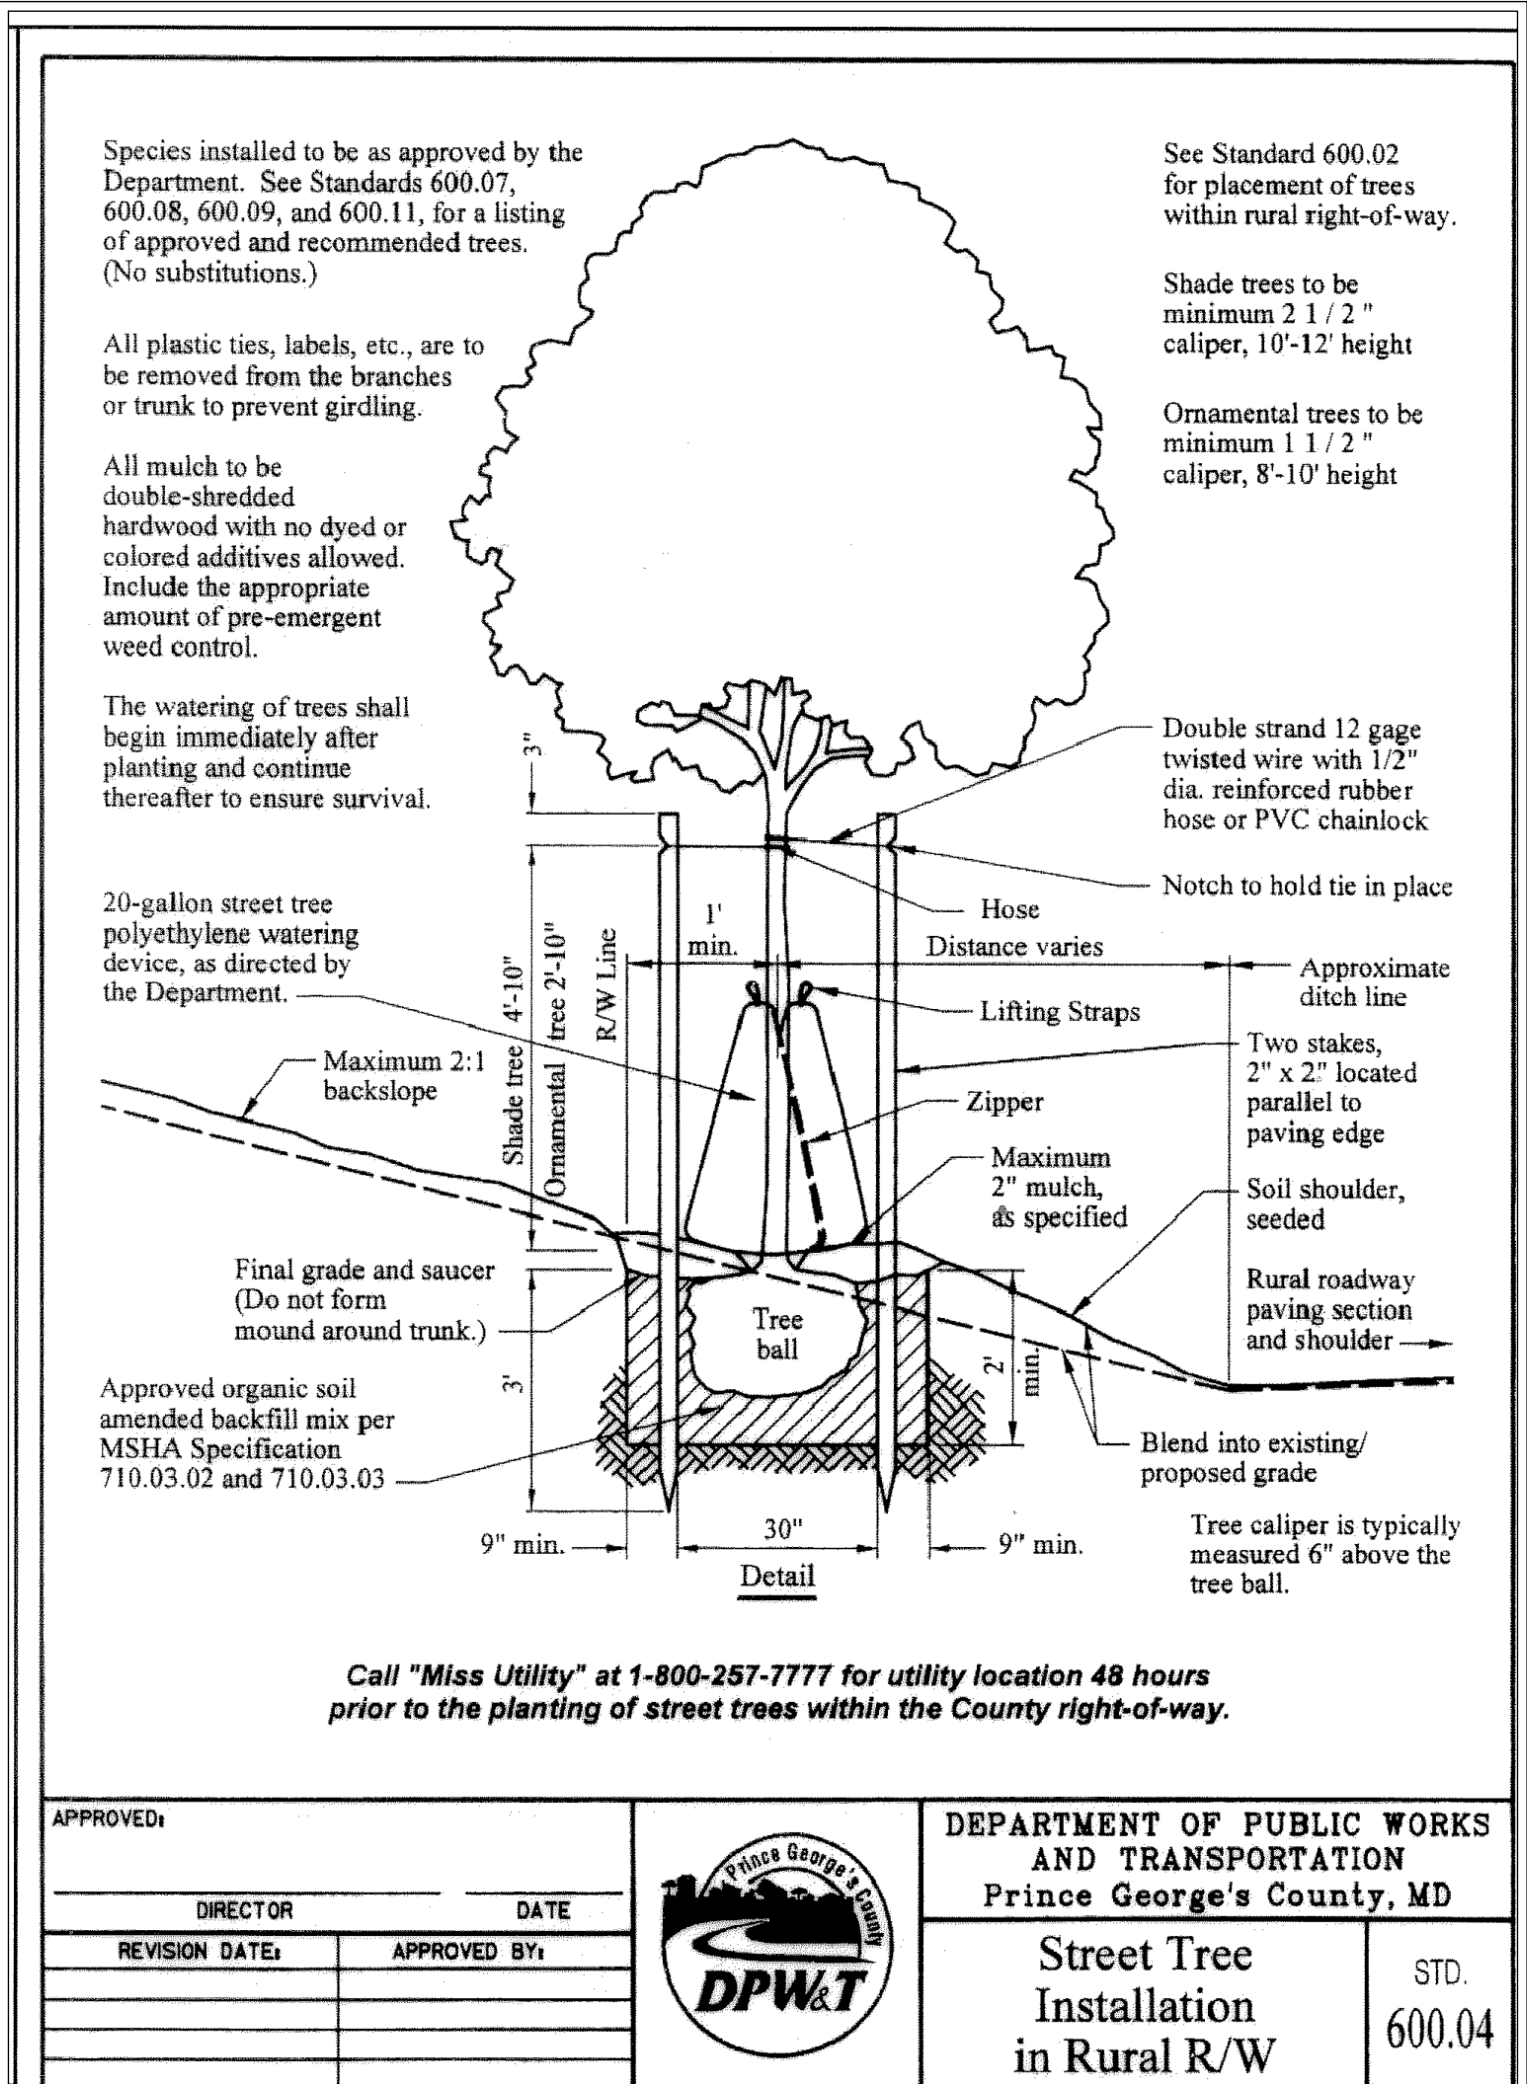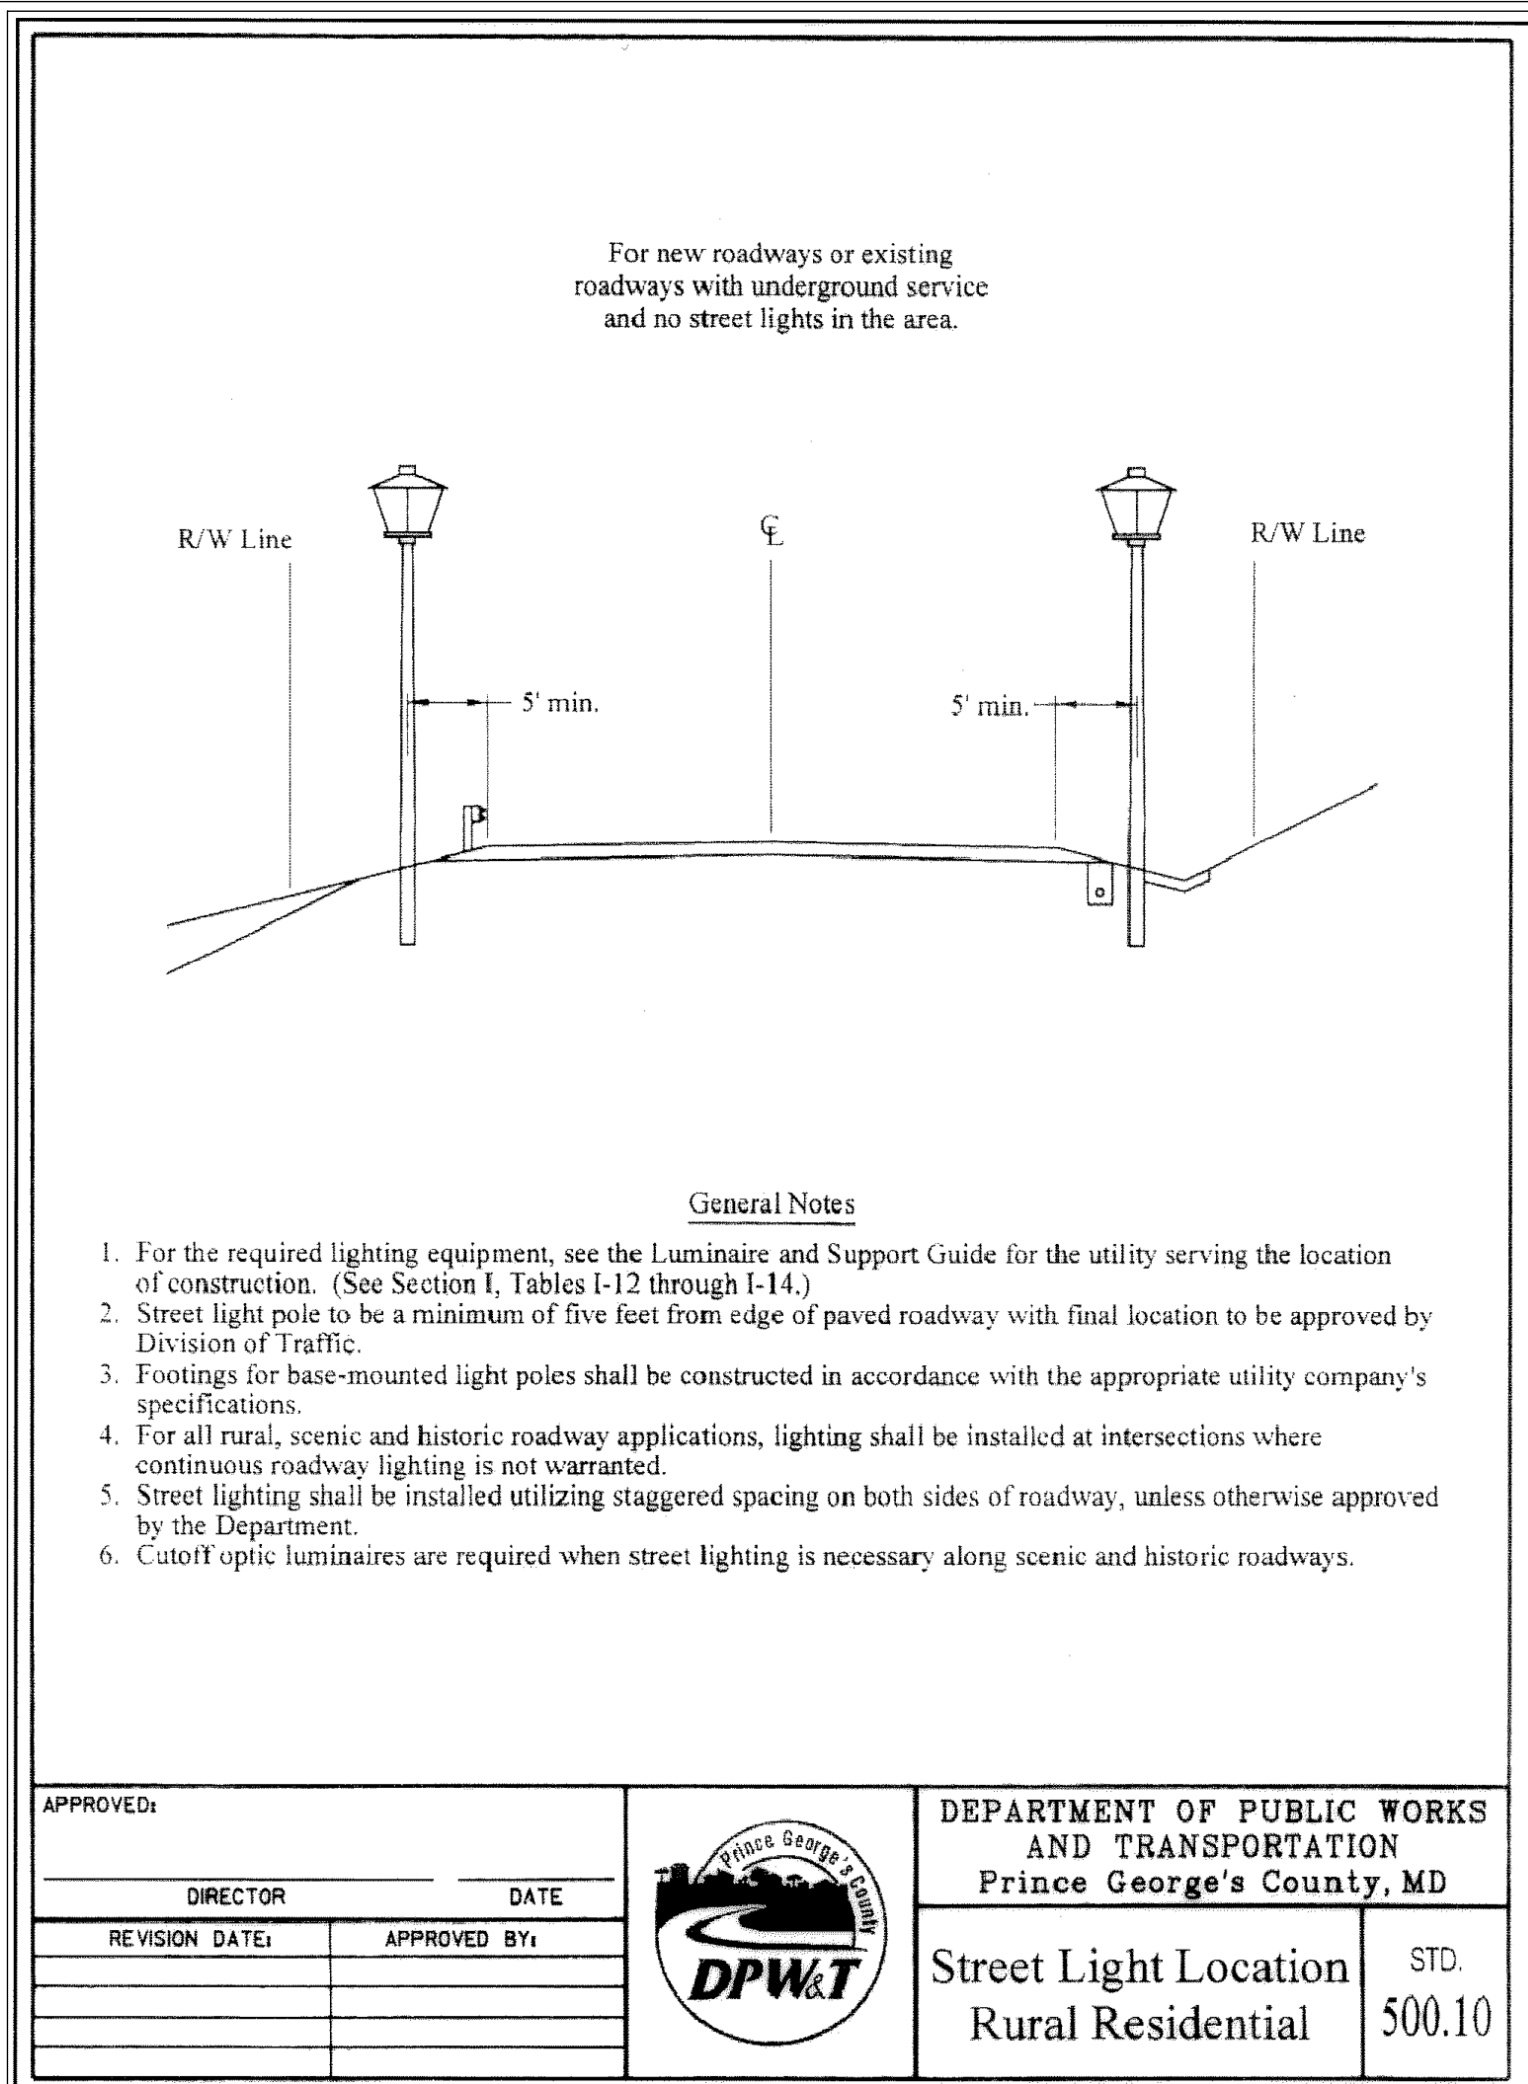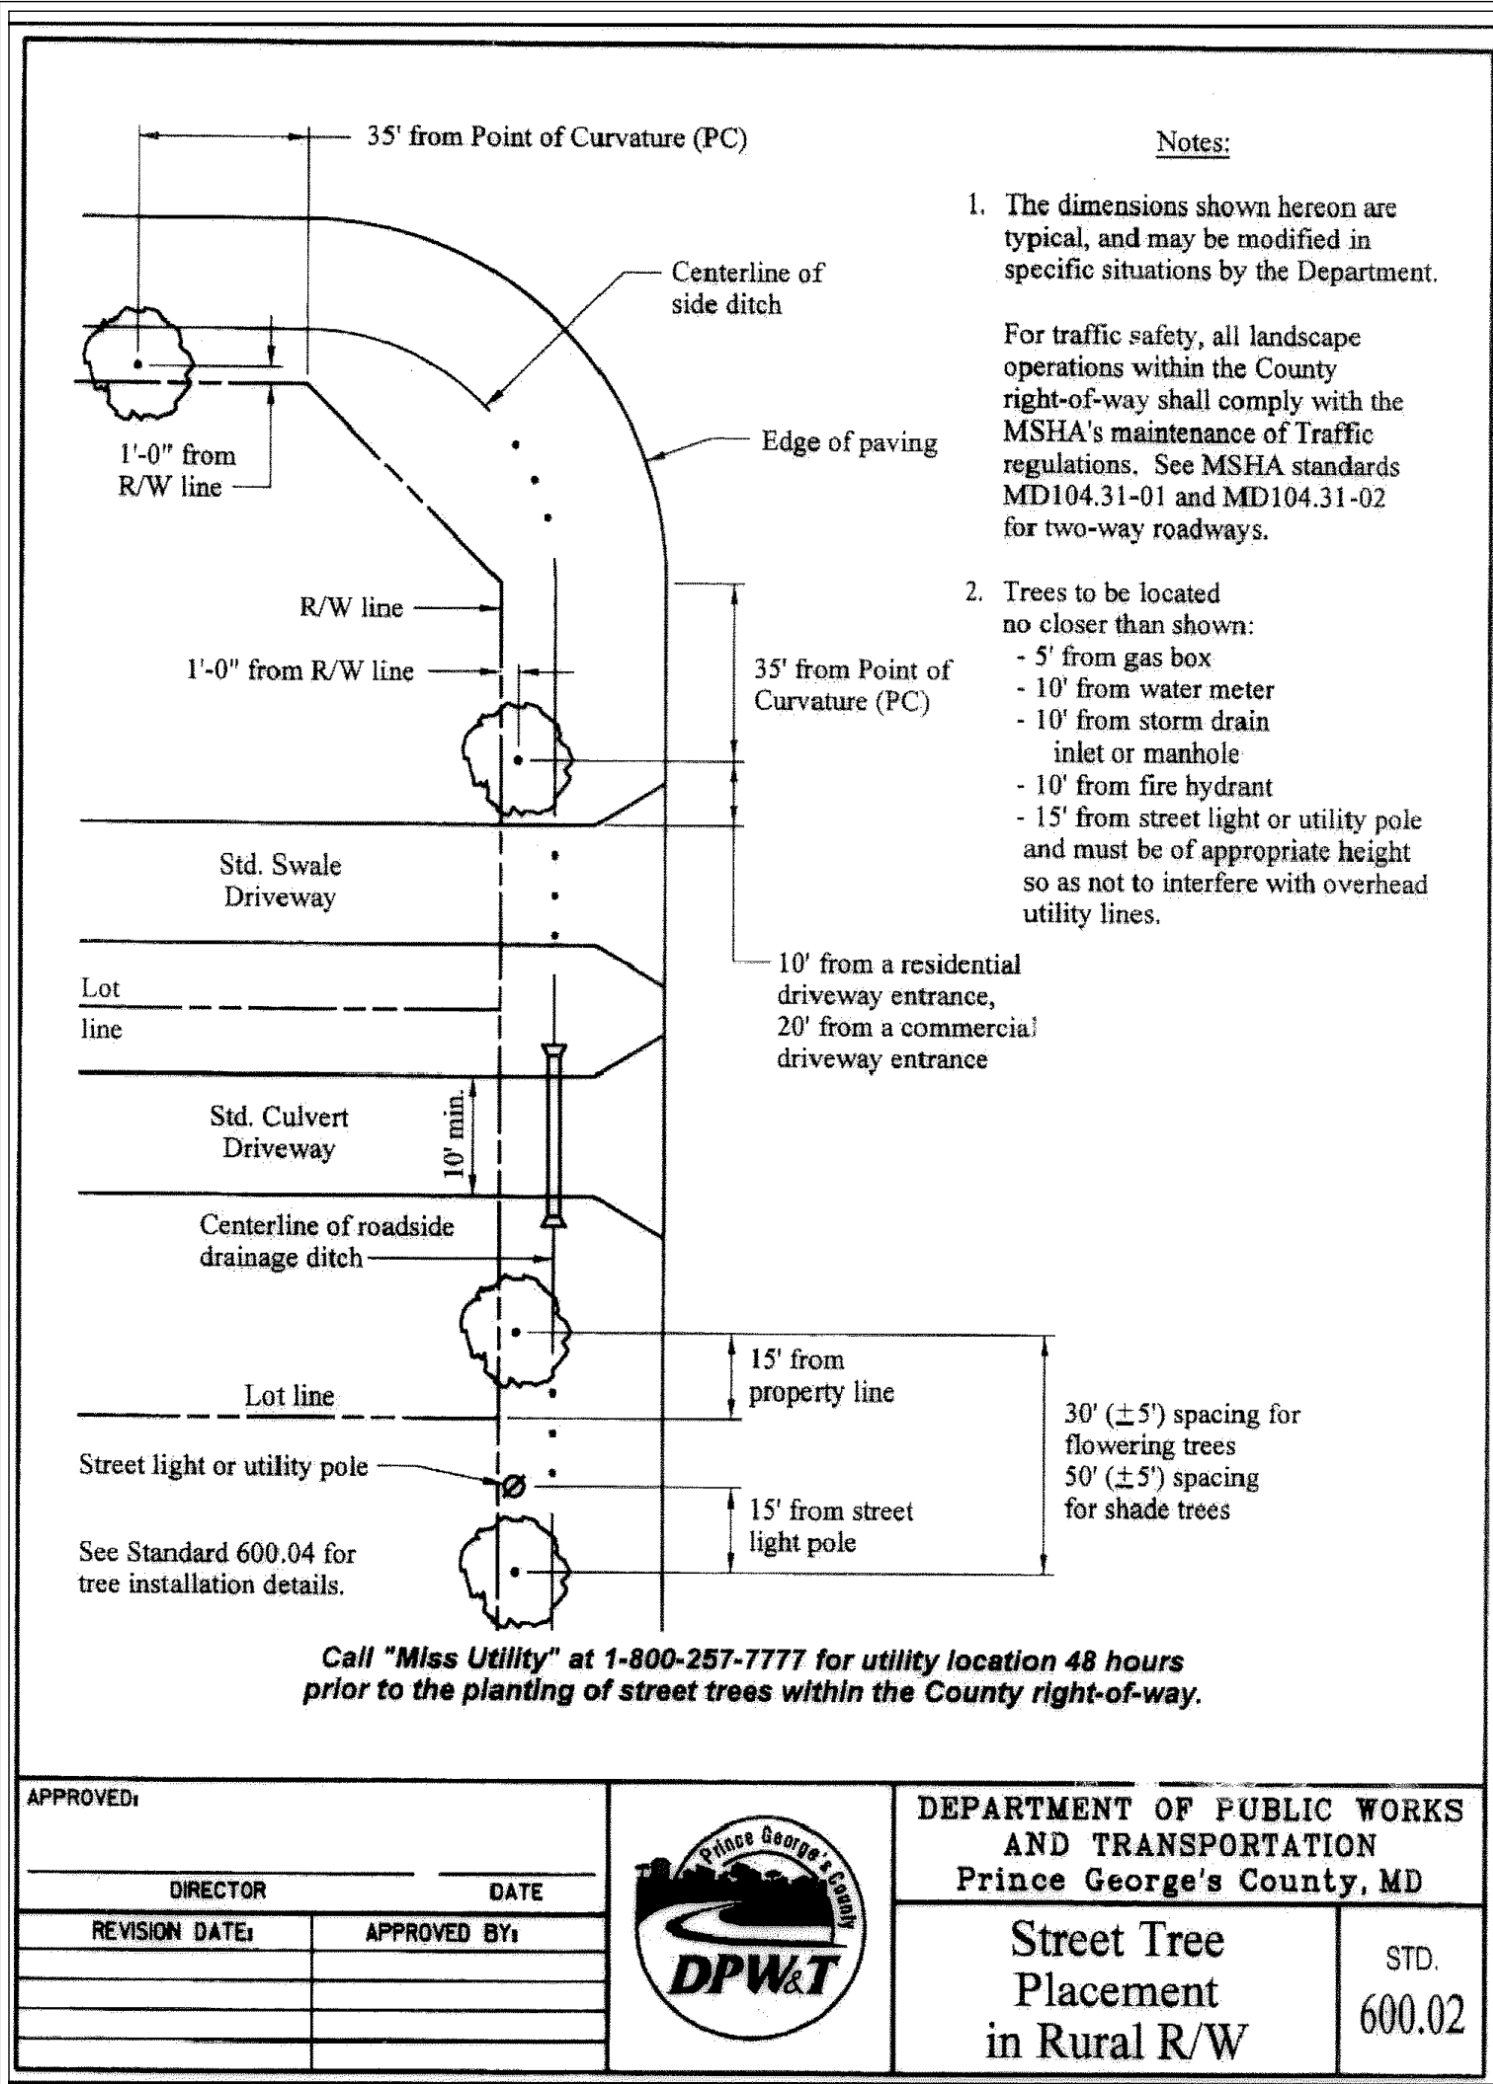

ESTATES COURT — TYPICAL SECTION (RURAL OPEN SECTION, 60' R/W) NTS

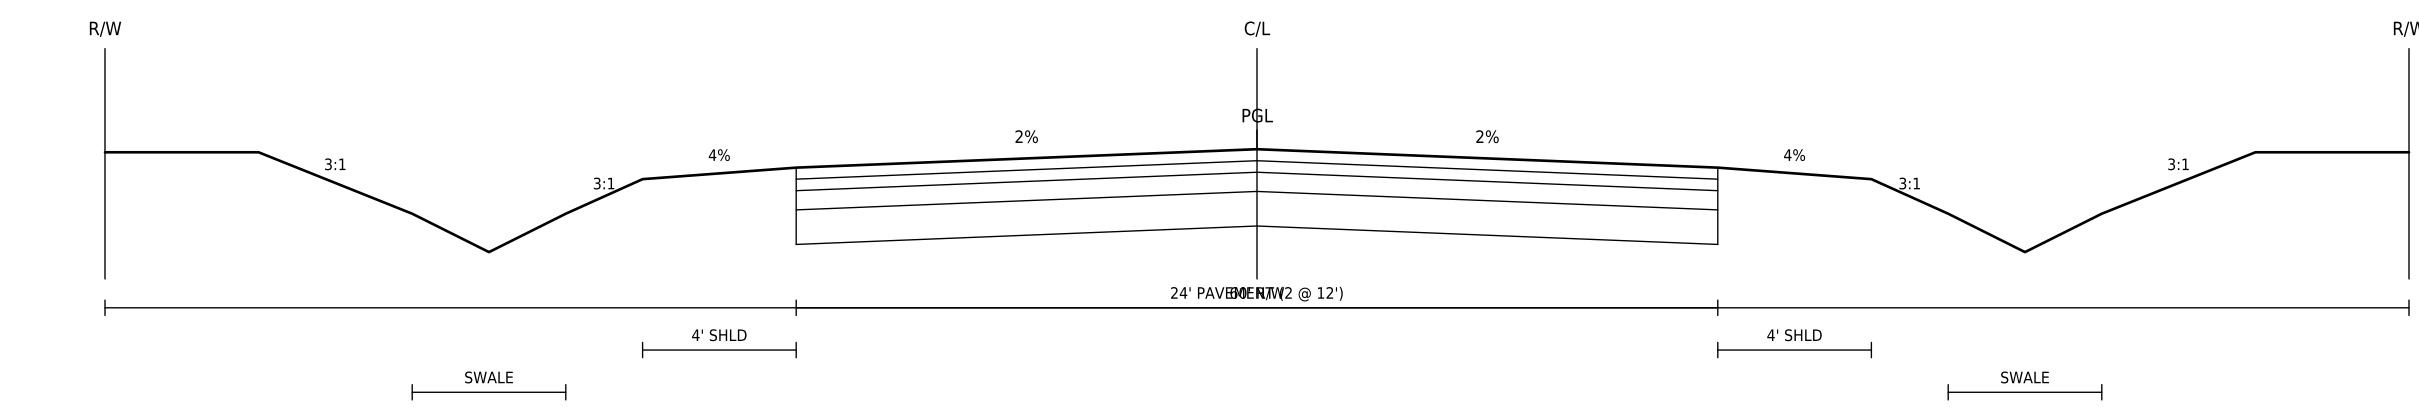


PAVEMENT SECTION — PG DPW&T SPECIFICATIONS AND STANDARDS FOR ROADWAYS AND BRIDGES, SECTION III (RESIDENTIAL)



| LAYER                          | MATERIAL                                         | THICKNESS |
|--------------------------------|--------------------------------------------------|-----------|
| E. FINAL SURFACE COURSE        | SUPERPAVE HMA SURFACE, 9.5 MM, PG 64-22          | 1 1/2"    |
| D. INTERMEDIATE SURFACE COURSE | SUPERPAVE HMA SURFACE, 9.5 MM, PG 64-22          | 1 1/2"    |
| C. BASE COURSE                 | SUPERPAVE HMA BASE, 19 MM, PG 64-22              | 3"        |
| B. SUBBASE                     | GRADED AGGREGATE SUBBASE (GASB)                  | 6"        |
| A. SUBGRADE                    | TOP 12" OF IN-SITU SUBGRADE, CBR >= 7, COMPACTED | 12"       |
| SHOULDER                       | GASB 6", SEEDED TOPSOIL 3" OUTSIDE PAVED AREA    | 4" @ 4%   |

ALL UNPAVED AREAS IN THE R/W: 3" MIN. TOPSOIL AND SEED/SOD. SLOPES 2:1 MAX. (3:1 WHERE MOWED).  
DRAINWAYS CROSS THE SWALE ON 12" RCP CULVERTS WITH FLARED END SECTIONS OR AS SWALE DRAINWAYS (DPW&T STD. 600.02).  
SUBGRADE BELOW CBR 7: UNDERCUT AND REPLACE PER SECTION I, TABLES 3 TO 16, AS DIRECTED BY THE GEOTECHNICAL ENGINEER.

MICRO-BIORETENTION (M-6) — TYPICAL SECTION NTS

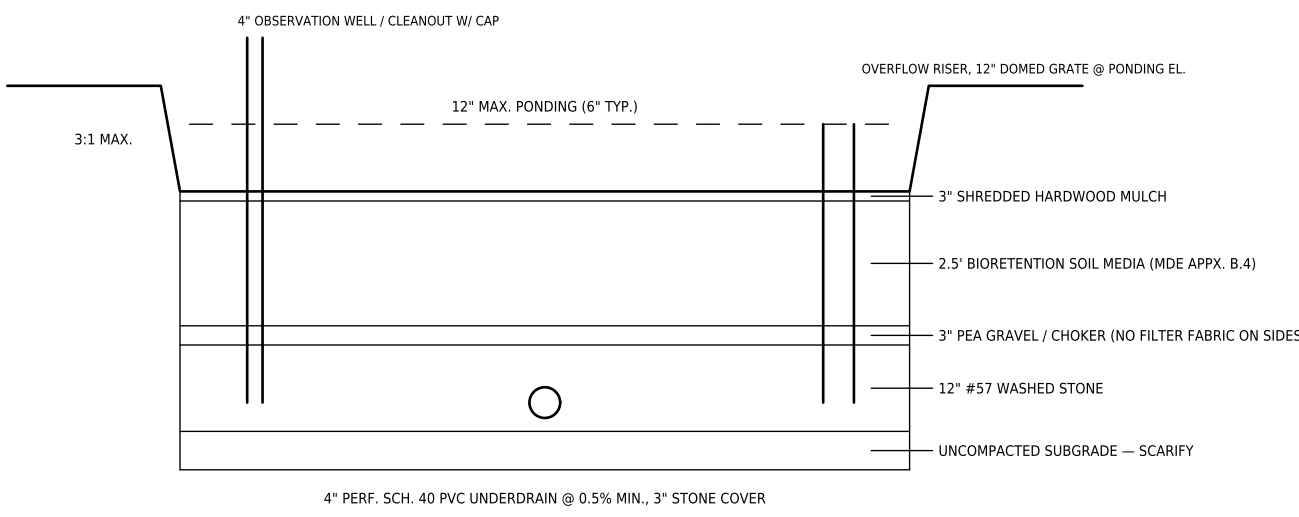

DRY SWALE (M-8) WITH CHECK DAM

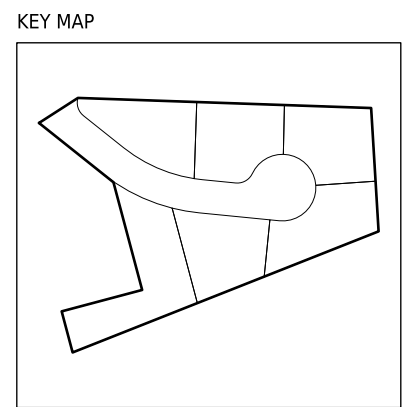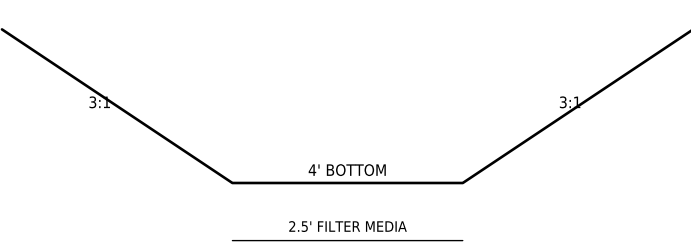

W.L. MEEKINS, INC.  
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115  
PREPARED WITH KEALEE SPATIAL ENGINEERING CONSULTANTS

ESTATES AT INDIAN HEAD  
SITE DEVELOPMENT CONCEPT PLAN  
LOTS 1 THRU 6 & ESTATES COURT

200-205 ESTATES COURT, ACCOKEEK, MD 20607  
PLAT: 200-205 ESTATES COURT, ACCOKEEK, MD 20607  
OWNER: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER AVE., WEST PALM BEACH, FL 33401 (LJ2086 F.648)

REVISIONS

| DATE       | DESCRIPTION          |
|------------|----------------------|
| 2024-09-30 | CONCEPT SUBMISSION 1 |
|            |                      |
|            |                      |
|            |                      |

TITLE

DETAILS  
C-600

DATE: 2026-09-30

SCALE: AS NOTED

SHEET: 10 OF 10

DRAWN: KEALEE CAD/PLOT

DESIGNED:

CHECKED:

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. \_\_\_\_\_ Expiration date: \_\_\_\_\_

SEAL

CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPPE APPROVAL  
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)