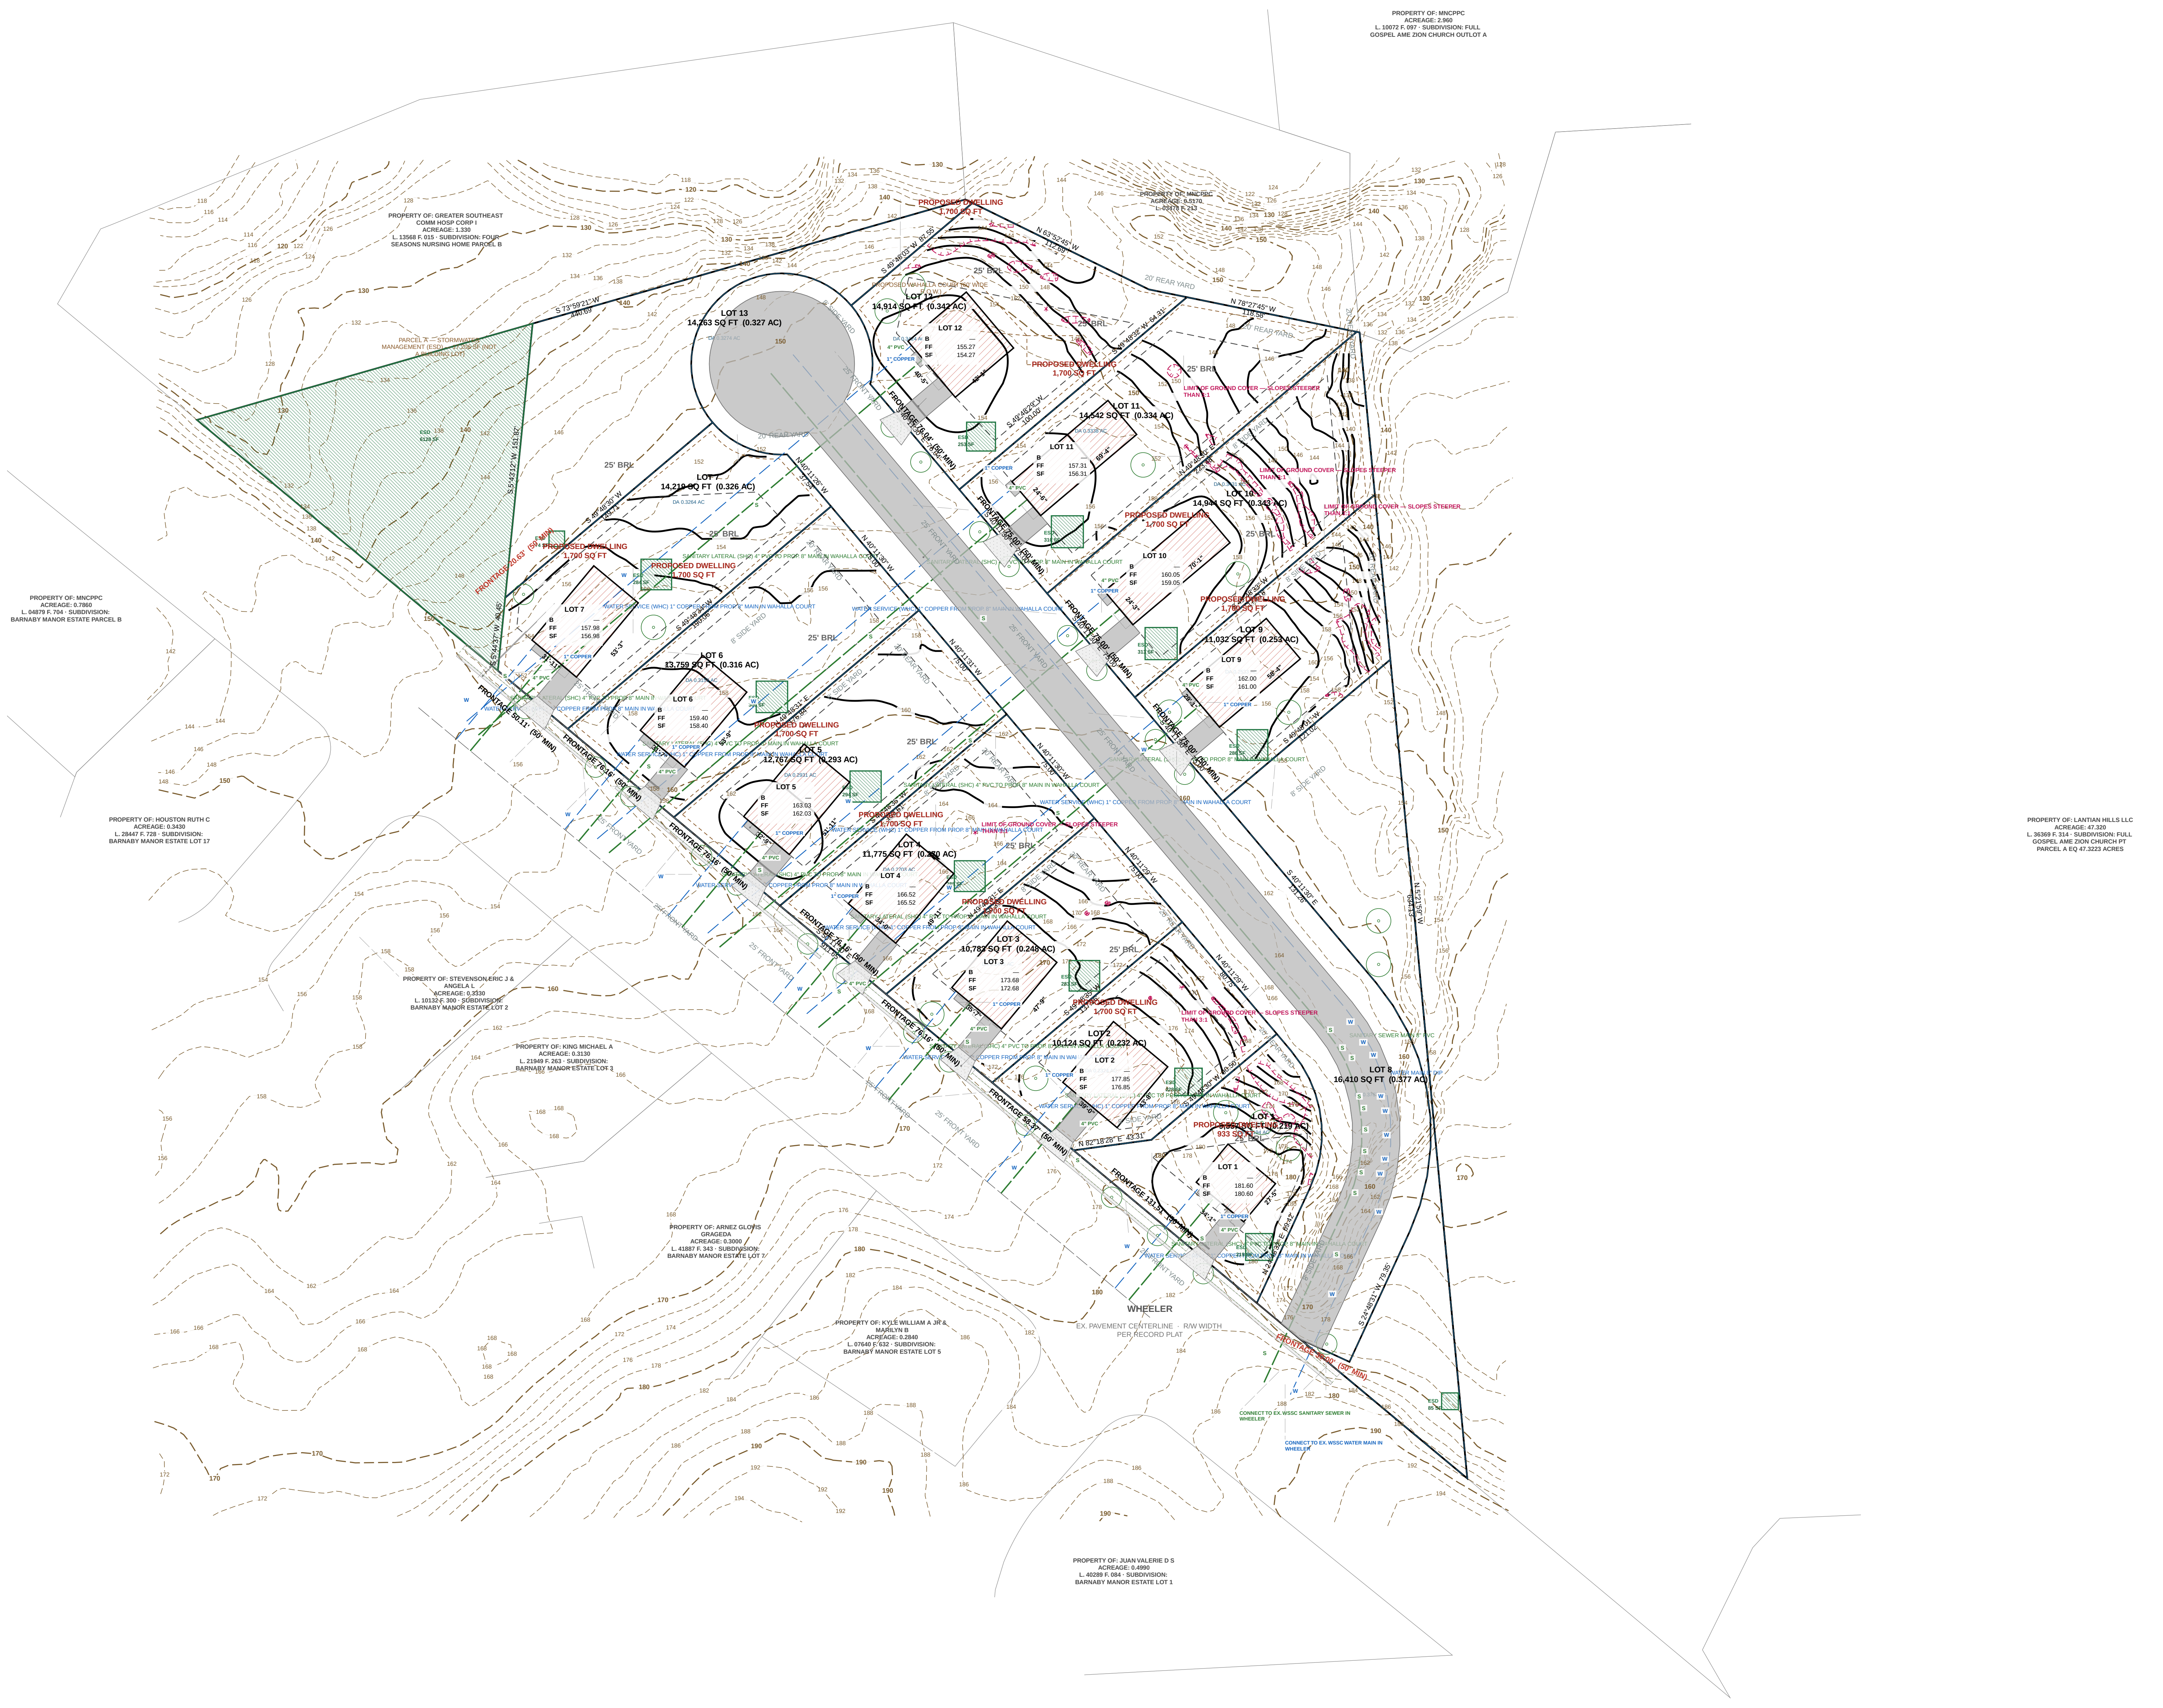

SOILS TABLE

USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

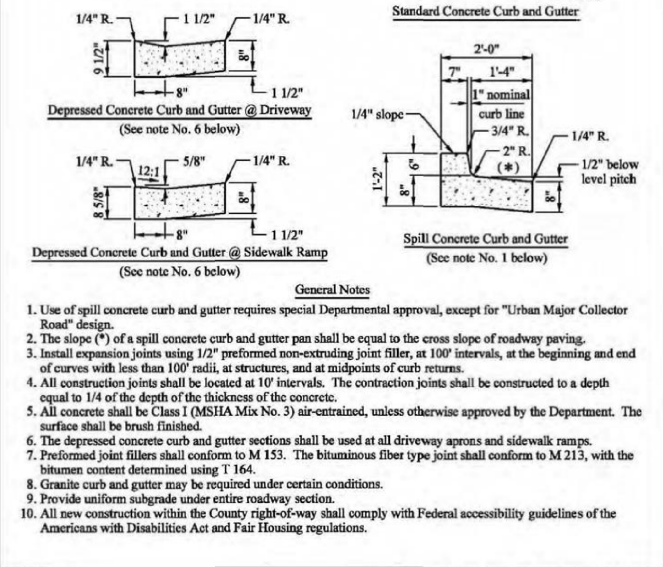
Pavement
(B)
GASB
2 1/2" min.
Uniform Subgrade
Graded Aggregate Subbase Under Concrete Curb and Gutter
Standard Concrete Curb and Gutter
Depressed Concrete Curb and Gutter @ Driveway
(See note No. 6 below)
Depressed Concrete Curb and Gutter @ Sidewalk Ramp
(See note No. 6 below)
Spill Concrete Curb and Gutter
(See note No. 1 below)

General Notes

1. Use of spill concrete curb and gutter requires special Departmental approval, except for "Urban Major Collector Road" design.
2. The slope (*) of a spill concrete curb and gutter pan shall be equal to the cross slope of roadway paving.
3. Install expansion joints using 1/2" preformed non-extruding joint filler, at 100' intervals, at the beginning and end of curves with less than 100' radii, at structures, and at midpoints of curb returns.
4. All construction joints shall be located at 10' intervals. The contraction joints shall be constructed to a depth equal to 1/4 of the depth of the thickness of the concrete.
5. All concrete shall be Class I (MSHA Mix No. 3) air-entrained, unless otherwise approved by the Department. The surface shall be brush finished.
6. The depressed concrete curb and gutter sections shall be used at all driveway aprons and sidewalk ramps.
7. Preformed joint fillers shall conform to M 153. The bituminous fiber type joint shall conform to M 213, with the bitumen content determined using T 164.
8. Granite curb and gutter may be required under certain conditions.
9. Provide uniform subgrade under entire roadway section.
10. All new construction within the County right-of-way shall comply with Federal accessibility guidelines of the Americans with Disabilities Act and Fair Housing regulations.

APPROVED:
DIRECTOR DATE
REVISION DATE: APPROVED BY:

DEPARTMENT OF PUBLIC WORKS AND TRANSPORTATION
Prince George's County, MD

Concrete Curb and Gutter — STD. 300.01

Revision 03/14/12 *Specifications and Standards for Roadways and Bridges* Section III – 45

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

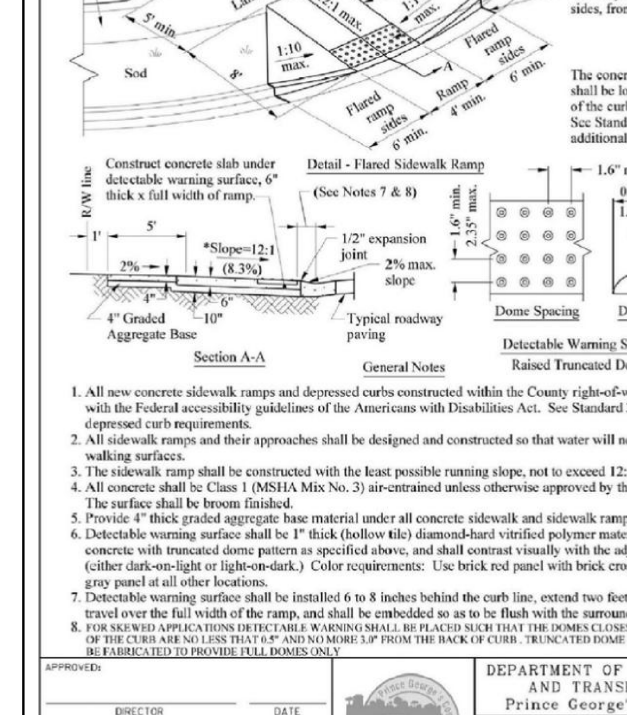
Heavy line shown around sidewalk ramp denotes typical 1/2" premolded expansion joint placement.
1/2" Expansion joint
Sod
Typical curb and gutter
R/W line
6'/8' Hiker/Biker Trail
Contraction joint
4'/5' Sidewalk
2' x 4' Detectable warning surfaces across full ramp width
1/2" Expansion joint (Both sides, front and rear of ramp)
Top Landing
12:1 max.
1:10 max.
Flared ramp sides
Ramp 4' min.
The concrete sidewalk ramp shall be located in the middle of the curbed fillet. See Standard 300.05 for additional information.
Detail - Flared Sidewalk Ramp
Construct concrete slab under detectable warning surface, 6" thick x full width of ramp.
(See Notes 7 & 8)
*Slope=12:1 (8.3%)
1/2" expansion joint
2% max. slope
4" Graded Aggregate Base
Typical roadway paving
Section A-A
Dome Spacing
Dome Section
Detectable Warning Surface Raised Truncated Domes

General Notes

1. All new concrete sidewalk ramps and depressed curbs constructed within the County right-of-way shall comply with the Federal accessibility guidelines of the Americans with Disabilities Act. See Standard 300.01 for depressed curb requirements.
2. All sidewalk ramps and their approaches shall be designed and constructed so that water will not accumulate on walking surfaces.
3. The sidewalk ramp shall be constructed with the least possible running slope, not to exceed 12:1.
4. All concrete shall be Class 1 (MSHA Mix No. 3) air-entrained unless otherwise approved by the Department. The surface shall be broom finished.
5. Provide 4" thick graded aggregate base material under all concrete sidewalk and sidewalk ramps.
6. Detectable warning surface shall be 1" thick (hollow tile) diamond-hard vitrified polymer material, embedded into concrete with truncated dome pattern as specified above, and shall contrast visually with the adjacent surface (either dark-on-light or light-on-dark.) Color requirements: Use brick red panel with brick crosswalk and dark gray panel at all other locations.
7. Detectable warning surface shall be installed 6 to 8 inches behind the curb line, extend two feet in the direction of travel over the full width of the ramp, and shall be embedded so as to be flush with the surrounding surface.
8. FOR SKEWED APPLICATIONS DETECTABLE WARNING SHALL BE PLACED SUCH THAT THE DOMES CLOSEST TO THE BACK OF THE CURB ARE NO LESS THAT 0.5" AND NO MORE 3.0" FROM THE BACK OF CURB. TRUNCATED DOME SURFACES SHALL BE FABRICATED TO PROVIDE FULL DOMES ONLY

APPROVED:
DIRECTOR DATE
REVISION DATE: APPROVED BY:

DEPARTMENT OF PUBLIC WORKS AND TRANSPORTATION
Prince George's County, MD

Concrete Sidewalk Ramp Type "A" — STD. 300.07

Revision 03/14/12 *Specifications and Standards for Roadways and Bridges* Section III – 51

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

GRAPHIC SCALE — 1" = 40'

0 40 80 120 160 FEET

N

KEALEE

design, build, deliver

PROJECT
4600 WHEELER ROAD — PRELIMINARY SUBDIVISION CONCEPT — LOTS 1–13

ADDRESS
4600 WHEELER ROAD

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
C-001 — Site Development Plan — Existing, Proposed, Grading, Paving and Landscape

SCALE
1" = 40'

STATUS
PRELIMINARY

SHEET NO.
1 OF 3

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION

PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-001 — Site Development Plan — Existing, Proposed, Grading, Paving and Landscape
DISCIPLINE	Maryland Professional Engineer / Surveyor (see divided responsibility)
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

1	C-001	Site Development Plan — Existing, Proposed, Grading, Paving and
2	L-100	Landscape and Tree Canopy Plan
3	C-400	Grading and Drainage Plan

SITE DATA

ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	230,997 SF	5.303 AC
LOT 1 AREA	9,557 SF	0.219 AC
LOT 2 AREA	10,124 SF	0.232 AC
LOT 3 AREA	10,783 SF	0.248 AC
LOT 4 AREA	11,775 SF	0.270 AC
LOT 5 AREA	12,767 SF	0.293 AC
LOT 6 AREA	13,759 SF	0.316 AC
LOT 7 AREA	14,219 SF	0.326 AC
LOT 8 AREA	16,410 SF	0.377 AC
LOT 9 AREA	11,032 SF	0.253 AC
LOT 10 AREA	14,944 SF	0.343 AC
LOT 11 AREA	14,542 SF	0.334 AC
LOT 12 AREA	14,914 SF	0.342 AC
LOT 13 AREA	14,263 SF	0.327 AC
NET LOT AREA	169,090 SF	3.882 AC
LOT 1 FRONTAGE	50' MIN	131.51'
LOT 2 FRONTAGE	50' MIN	58.37'
LOT 3 FRONTAGE	50' MIN	76.16'
LOT 4 FRONTAGE	50' MIN	76.16'
LOT 5 FRONTAGE	50' MIN	76.16'
LOT 6 FRONTAGE	50' MIN	76.16'
LOT 7 FRONTAGE	50' MIN	50.11'
LOT 8 FRONTAGE	50' MIN	30.00'
LOT 9 FRONTAGE	50' MIN	75.00'
LOT 10 FRONTAGE	50' MIN	75.00'
LOT 11 FRONTAGE	50' MIN	75.00'
LOT 12 FRONTAGE	50' MIN	76.04'
LOT 13 FRONTAGE	50' MIN	20.63'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	25'	25'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	10.6%
BUILDING FOOTPRINT	—	17,933 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	230,997 SF
2. Area of dwelling	17,933 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	169,090 SF
6. TOTAL AREA DISTURBED	91,062 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
LOT 1	181.27	—	181.60	180.60	20'	2
LOT 2	177.52	—	177.85	176.85	20'	2
LOT 3	173.35	—	173.68	172.68	20'	2
LOT 4	166.19	—	166.52	165.52	20'	2
LOT 5	162.70	—	163.03	162.03	20'	2
LOT 6	159.07	—	159.40	158.40	20'	2
LOT 7	157.65	—	157.98	156.98	20'	2
LOT 9	161.67	—	162.00	161.00	20'	2
LOT 10	159.72	—	160.05	159.05	20'	2
LOT 11	156.98	—	157.31	156.31	20'	2
LOT 12	154.94	—	155.27	154.27	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 1	9,557	14.4%	0.37	0.52	0.15	143
LOT 2	10,124	20.1%	0.39	0.61	0.22	195
LOT 3	10,783	19.5%	0.42	0.64	0.22	202
LOT 4	11,775	17.7%	0.45	0.68	0.23	206
LOT 5	12,767	16.3%	0.49	0.72	0.23	210
LOT 6	13,759	15.2%	0.53	0.75	0.22	214
LOT 7	14,219	14.7%	0.55	0.77	0.22	216
LOT 8	16,410	0.0%	0.63	0.63	0.00	68
LOT 9	11,032	18.9%	0.42	0.65	0.23	202
LOT 10	14,944	14.0%	0.58	0.80	0.22	219
LOT 11	14,542	14.3%	0.56	0.78	0.22	217
LOT 12	14,914	14.5%	0.57	0.81	0.24	224
LOT 13	14,263	0.0%	0.55	0.55	0.00	59
PROJECT TOTAL	**169,090**	**13.2%**	**6.51**	**8.91**	**2.40**	**2,375**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — 4600 WHEELER ROAD — PRELIMINARY SUBDIVISION CONCEPT. ZONE RSF-95, SE-1796. PARCEL 366579 — PARCEL A FOUR SEASONS NURSING HOME, OWNER OF RECORD ETHIOPIAN ORTHODOX TEWAHEDO CHURCH, ACCT 1194943, L. 48054 F. 597, PLAT A12-7298 OF RECORD (NOT READ — OBTAIN IT; IT SUPERSEDES THE GIS OUTLINE DRAWN HERE), GIS 230995 SQ FT, RECORDED 5.115479 AC, ASSESSMENT 5.303 AC. PRELIMINARY. OUTER BOUNDARY FROM THE PRINCE GEORGE'S COUNTY PARCEL LAYER (PGATLAS PROPERTY/MAPSERVER/15), COMPILED FROM TAX MAPS — NOT A BOUNDARY SURVEY AND NOT A PLAT OF RECORD. LOT LINES AND STREETS ARE PROPOSED BY KEALEE. A MARYLAND LICENSED SURVEYOR MUST ESTABLISH THE BOUNDARY BEFORE ANY PLAT IS PREPARED. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

LEGEND

━━	PROPERTY BOUNDARY
– – –	BRL — BUILDING RESTRICTION LINE
━━	PROPOSED STRUCTURE
– – –	EXISTING CONTOUR — 2 FT INTERVAL, NAVD88
━━	PROPOSED CONTOUR — 2 FT INTERVAL
— — -	STREET CENTRELINE
──	PROPOSED PAVEMENT — DRIVEWAY / WALK
— —	EASEMENT
— —	SANITARY LATERAL (SHC) — HEAVIEST
— —	WATER SERVICE (WHC)
━━	STORM DRAIN — TRUNK, RCP
— — -	STORM — HOUSE CONNECTION TO TRUNK
──	DRAINAGE SWALE — INVERT AND GRADED SECTION
━━	RETAINING WALL — TICKS ON THE RETAINED SIDE
– – – -	LIMIT OF GROUND COVER — TICKS ON THE STEEP SIDE
— —	100-YR FLOODPLAIN LIMIT, EXISTING GROUND — FPS-770017, WSSC DATUM, UNTIED
──	100-YR FLOODPLAIN LIMIT, PROPOSED GROUND — SAME ELEVATION, REGRADED SURFACE
──	ESD — STORMWATER PRACTICE

PLAT OF RECORD

4600 WHEELER ROAD — PRELIMINARY SUBDIVISION CONCEPT. Zone RSF-95, SE-1796. Parcel 366579 — PARCEL A FOUR SEASONS NURSING HOME, owner of record ETHIOPIAN ORTHODOX TEWAHEDO CHURCH, acct 1194943, L. 48054 F. 597, PLAT A12-7298 OF RECORD (not read — obtain it; it supersedes the GIS outline drawn here), GIS 230995 sq ft, recorded 5.115479 ac, assessment 5.303 ac. PRELIMINARY. Outer boundary from the Prince…

NOTES OF RECORD

1. This drawing is a preliminary subdivision concept. It is not a plat, not a boundary survey, and not for recording.
2. Street layout follows the 2023 "Wheeler Rd Subdivision Layout" sheet for this parcel (street a tier in from the north and east boundaries, lots both sides) with ONE entrance from Wheeler Road; the second entrance and the private alley on that sheet are omitted and the far end is finished as a cul-de-sac.
3. Lot lines are proposed to meet Sec. 27-4202 RSF-95: minimum net lot area 9500 sq ft, minimum lot width 75 ft, minimum frontage 50 ft, maximum density 4.58 du/ac of net tract area.
4. All lots take access from WAHALLA COURT. No lot takes access from WHEELER; lots backing onto it are double-frontage lots and a no-access reservation along WHEELER is anticipated at platting.
5. Boundary shown from the county parcel layer (Level 1). A field survey by a Maryland licensed surveyor governs.
6. Recorded acreage 5.115479 ac (222830 sq ft) differs from the county GIS polygon (230995 sq ft) by 8165 sq ft. Both are reported; neither is adjusted. The survey resolves it.
7. Special exception SE-1796 is of record on this property. Its conditions have not been read into this concept and govern where they conflict.
8. PARCEL A does not front the proposed street in this layout; a 20-ft access and maintenance easement across the adjoining lot is required at platting.
9. Water and sewer: every lot is served from WAHALLA COURT; no service connects to WHEELER. Proposed 8-in WSSC water main and 8-in sanitary sewer in WAHALLA COURT, extended from the existing WSSC mains in WHEELER at the entrance. As-built size, location, depth and flow direction of…
10. Stormwater management by Environmental Site Design to the maximum extent practicable (Md. Stormwater Management Act of 2007; MDE Design Manual Ch. 5; PGC Sec. 32-172). Preliminary ESD volume: 52521 sq ft impervious (22.7% of the tract: 13 lots × 2000 sq ft, 21217 sq ft pavement,…
11. Proposed public street: 60' R/W and 26' pavement per the approved Joseph Drive section (Yocum Property, DPIE 15927-2020-0). Bend radius 150' centreline and cul-de-sac radii (50' R/W, 40' pavement) are ASSUMED — that approval is a through street with R "e 343'. Confirm against PGC DPW&T…

The surveyor certificate, owner dedication and approval signatures of the recorded plat are NOT reproduced here: they attach to that instrument, not to this drawing.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE ____________ DATE ____________

LICENSE NO. ____________ EXPIRATION DATE ____________

SEAL

REVISIONS
— none —

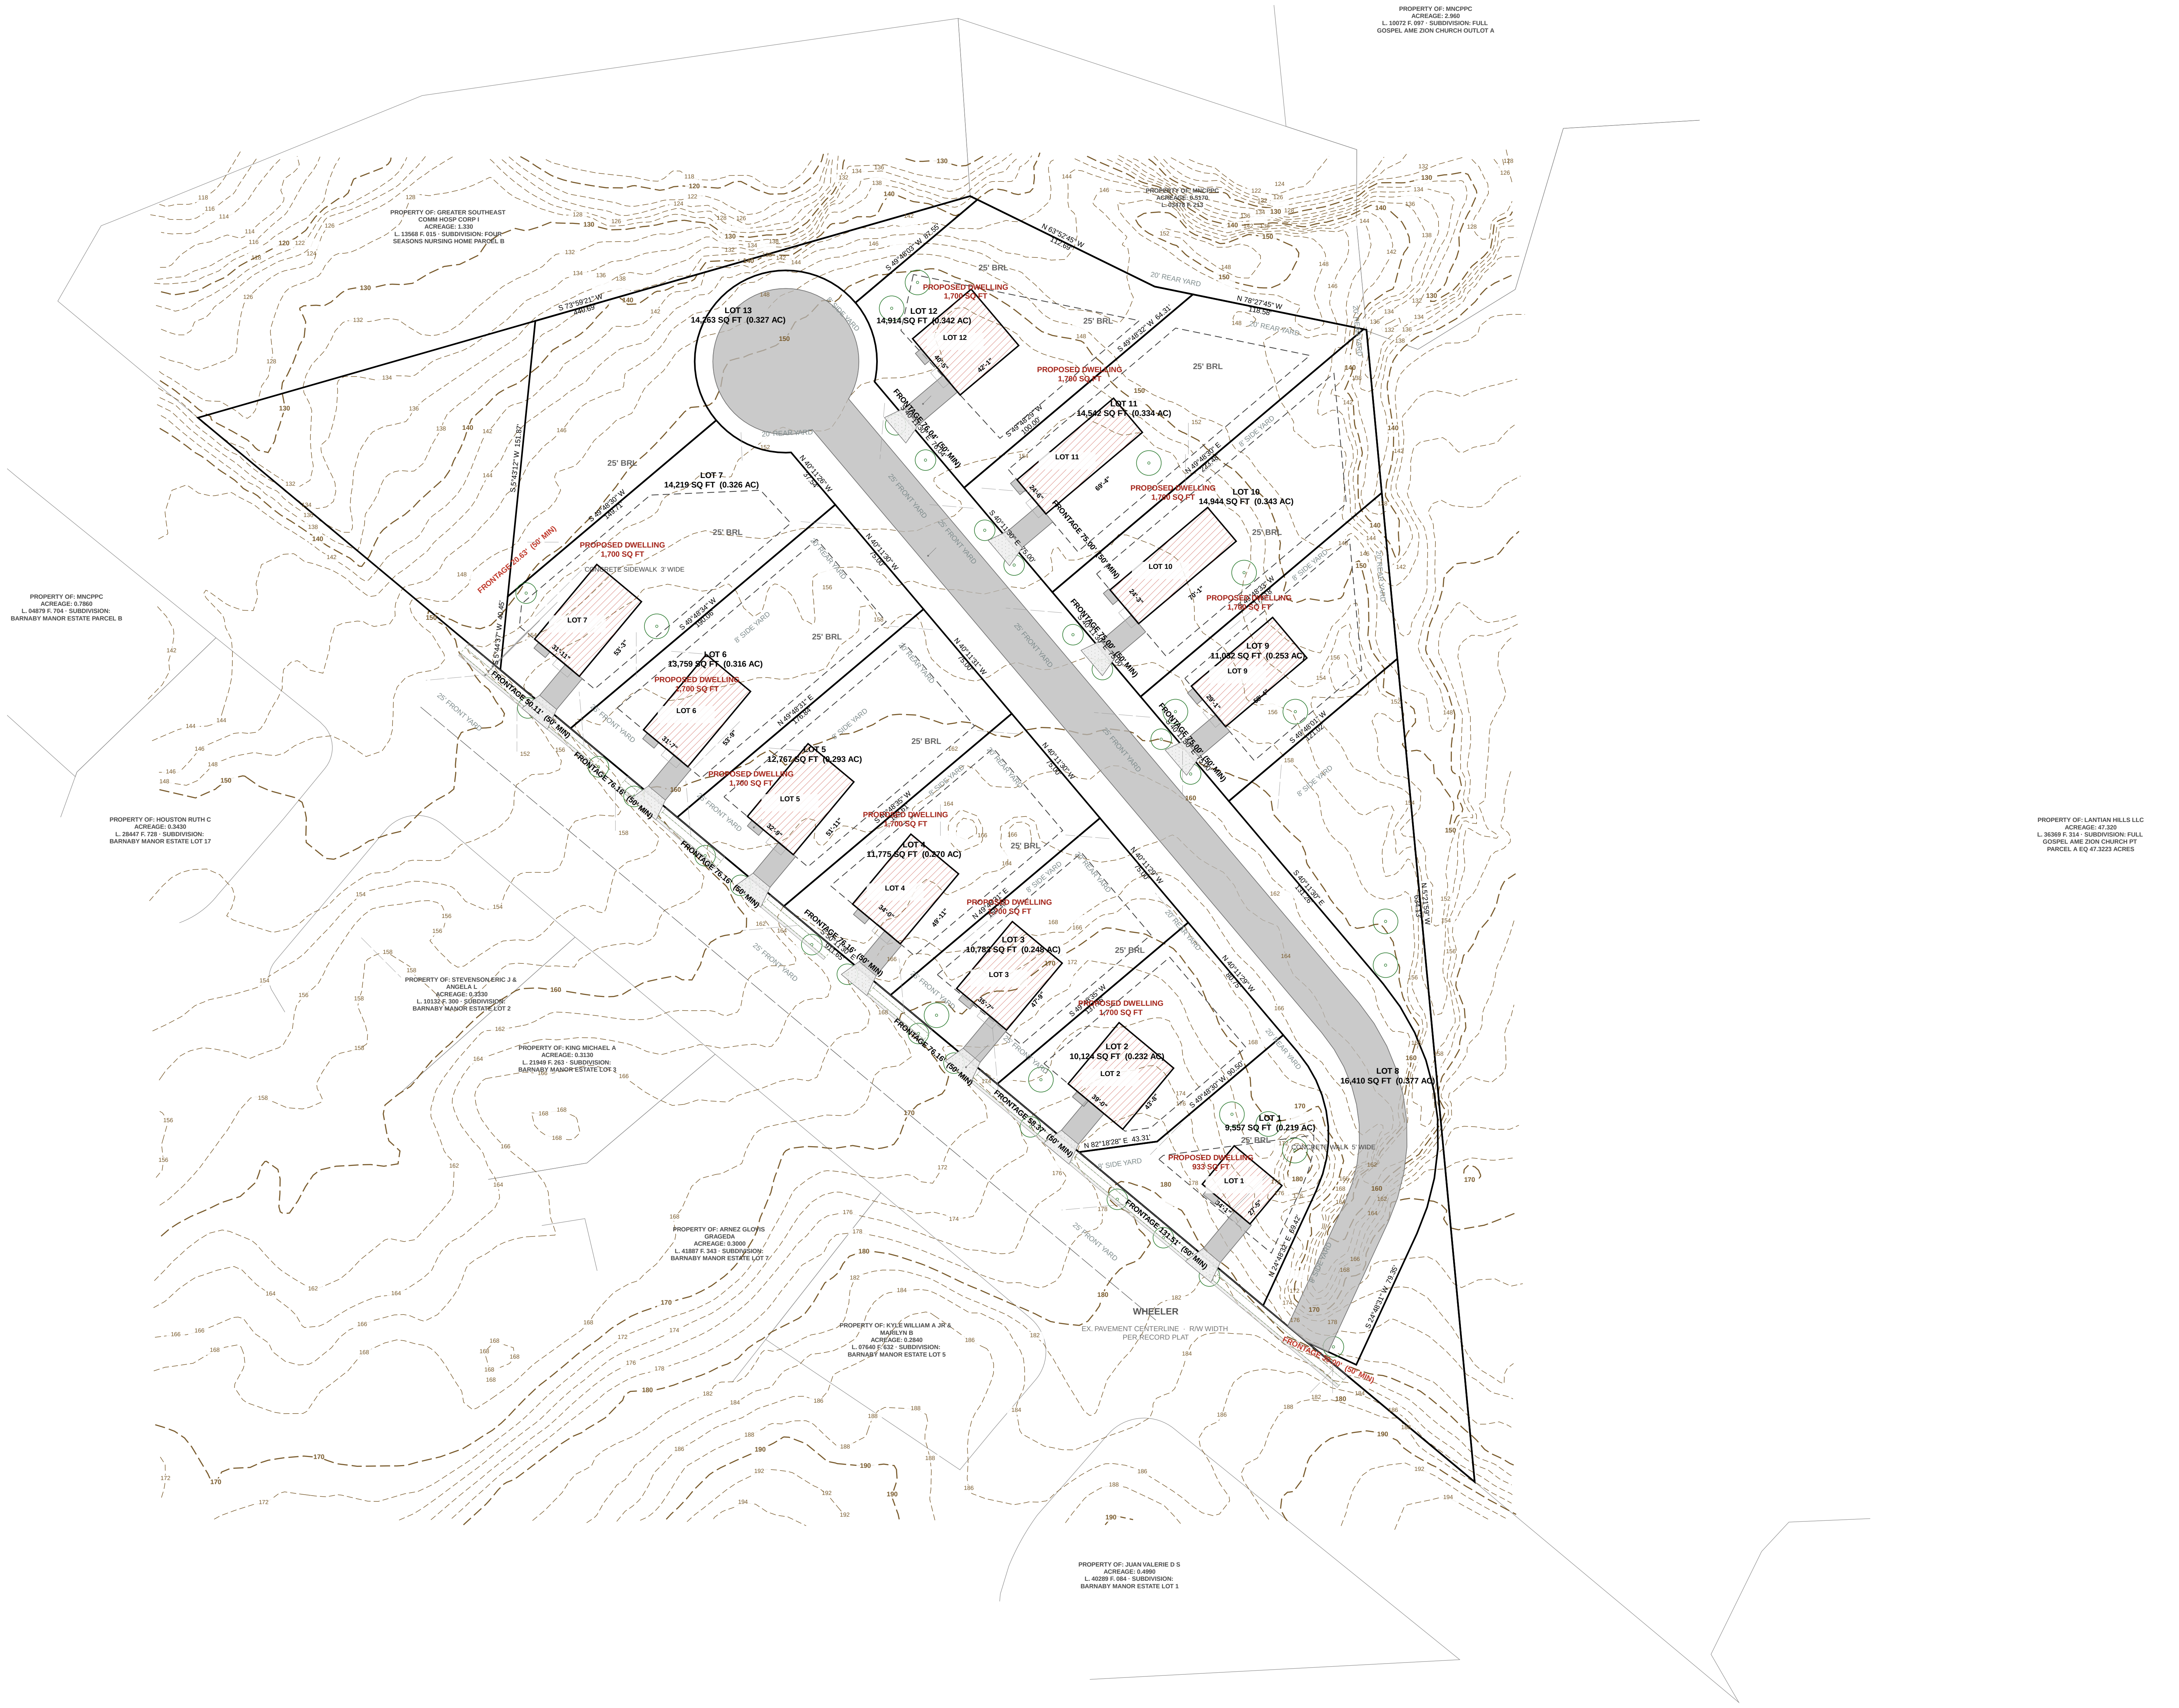

KEALEE

design, build, deliver

PROJECT
4600 WHEELER ROAD — PRELIMINARY SUBDIVISION CONCEPT — LOTS 1–13

ADDRESS
4600 WHEELER ROAD

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
L-100 — Landscape and Tree Canopy Plan

SCALE
1" = 40'

STATUS
PRELIMINARY

SHEET NO.
2 OF 3

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION

PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	L-100 — Landscape and Tree Canopy Plan
DISCIPLINE	Landscape Architect / Qualified Professional
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

1	C-001	Site Development Plan — Existing, Proposed, Grading, Paving and
2	L-100	Landscape and Tree Canopy Plan
3	C-400	Grading and Drainage Plan

SITE DATA

ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	230,997 SF	5.303 AC
LOT 1 AREA	9,557 SF	0.219 AC
LOT 2 AREA	10,124 SF	0.232 AC
LOT 3 AREA	10,783 SF	0.248 AC
LOT 4 AREA	11,775 SF	0.270 AC
LOT 5 AREA	12,767 SF	0.293 AC
LOT 6 AREA	13,759 SF	0.316 AC
LOT 7 AREA	14,219 SF	0.326 AC
LOT 8 AREA	16,410 SF	0.377 AC
LOT 9 AREA	11,032 SF	0.253 AC
LOT 10 AREA	14,944 SF	0.343 AC
LOT 11 AREA	14,542 SF	0.334 AC
LOT 12 AREA	14,914 SF	0.342 AC
LOT 13 AREA	14,263 SF	0.327 AC
NET LOT AREA	169,090 SF	3.882 AC
LOT 1 FRONTAGE	50' MIN	131.51'
LOT 2 FRONTAGE	50' MIN	58.37'
LOT 3 FRONTAGE	50' MIN	76.16'
LOT 4 FRONTAGE	50' MIN	76.16'
LOT 5 FRONTAGE	50' MIN	76.16'
LOT 6 FRONTAGE	50' MIN	76.16'
LOT 7 FRONTAGE	50' MIN	50.11'
LOT 8 FRONTAGE	50' MIN	30.00'
LOT 9 FRONTAGE	50' MIN	75.00'
LOT 10 FRONTAGE	50' MIN	75.00'
LOT 11 FRONTAGE	50' MIN	75.00'
LOT 12 FRONTAGE	50' MIN	76.04'
LOT 13 FRONTAGE	50' MIN	20.63'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	25'	25'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	10.6%
BUILDING FOOTPRINT	—	17,933 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	230,997 SF
2. Area of dwelling	17,933 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	169,090 SF
6. TOTAL AREA DISTURBED	91,062 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
LOT 1	181.27	—	181.60	180.60	20'	2
LOT 2	177.52	—	177.85	176.85	20'	2
LOT 3	173.35	—	173.68	172.68	20'	2
LOT 4	166.19	—	166.52	165.52	20'	2
LOT 5	162.70	—	163.03	162.03	20'	2
LOT 6	159.07	—	159.40	158.40	20'	2
LOT 7	157.65	—	157.98	156.98	20'	2
LOT 9	161.67	—	162.00	161.00	20'	2
LOT 10	159.72	—	160.05	159.05	20'	2
LOT 11	156.98	—	157.31	156.31	20'	2
LOT 12	154.94	—	155.27	154.27	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 1	9,557	14.4%	0.37	0.52	0.15	143
LOT 2	10,124	20.1%	0.39	0.61	0.22	195
LOT 3	10,783	19.5%	0.42	0.64	0.22	202
LOT 4	11,775	17.7%	0.45	0.68	0.23	206
LOT 5	12,767	16.3%	0.49	0.72	0.23	210
LOT 6	13,759	15.2%	0.53	0.75	0.22	214
LOT 7	14,219	14.7%	0.55	0.77	0.22	216
LOT 8	16,410	0.0%	0.63	0.63	0.00	68
LOT 9	11,032	18.9%	0.42	0.65	0.23	202
LOT 10	14,944	14.0%	0.58	0.80	0.22	219
LOT 11	14,542	14.3%	0.56	0.78	0.22	217
LOT 12	14,914	14.5%	0.57	0.81	0.24	224
LOT 13	14,263	0.0%	0.55	0.55	0.00	59
PROJECT TOTAL	**169,090**	**13.2%**	**6.51**	**8.91**	**2.40**	**2,375**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.

2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.

3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.

4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.

5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — 4600 WHEELER ROAD — PRELIMINARY SUBDIVISION CONCEPT. ZONE RSF-95, SE-1796. PARCEL 366579 — PARCEL A FOUR SEASONS NURSING HOME, OWNER OF RECORD ETHIOPIAN ORTHODOX TEWAHEDO CHURCH, ACCT 1194943, L. 48054 F. 597, PLAT A12-7298 OF RECORD (NOT READ — OBTAIN IT; IT SUPERSEDES THE GIS OUTLINE DRAWN HERE), GIS 230995 SQ FT, RECORDED 5.115479 AC, ASSESSMENT 5.303 AC. PRELIMINARY. OUTER BOUNDARY FROM THE PRINCE GEORGE'S COUNTY PARCEL LAYER (PGATLAS PROPERTY/MAPSERVER/15), COMPILED FROM TAX MAPS — NOT A BOUNDARY SURVEY AND NOT A PLAT OF RECORD. LOT LINES AND STREETS ARE PROPOSED BY KEALEE. A MARYLAND LICENSED SURVEYOR MUST ESTABLISH THE BOUNDARY BEFORE ANY PLAT IS PREPARED. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.

6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.

7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

LEGEND

▬	PROPERTY BOUNDARY
– – –	BRL — BUILDING RESTRICTION LINE
▬	PROPOSED STRUCTURE
– – –	EXISTING CONTOUR — 2 FT INTERVAL, NAVD88
▬	PROPOSED CONTOUR — 2 FT INTERVAL
— — -	STREET CENTRELINE
—	PROPOSED PAVEMENT — DRIVEWAY / WALK
– –	EASEMENT
– –	SANITARY LATERAL (SHC) — HEAVIEST
– –	WATER SERVICE (WHC)
▬	STORM DRAIN — TRUNK, RCP
– – -	STORM — HOUSE CONNECTION TO TRUNK
—	DRAINAGE SWALE — INVERT AND GRADED SECTION
▬	RETAINING WALL — TICKS ON THE RETAINED SIDE
- - - -	LIMIT OF GROUND COVER — TICKS ON THE STEEP SIDE
– –	100-YR FLOODPLAIN LIMIT, EXISTING GROUND — FPS-770017, WSSC DATUM, UNTIED
—	100-YR FLOODPLAIN LIMIT, PROPOSED GROUND — SAME ELEVATION, REGRADED SURFACE
—	ESD — STORMWATER PRACTICE

PLAT OF RECORD

4600 WHEELER ROAD — PRELIMINARY SUBDIVISION CONCEPT. Zone RSF-95, SE-1796. Parcel 366579 — PARCEL A FOUR SEASONS NURSING HOME, owner of record ETHIOPIAN ORTHODOX TEWAHEDO CHURCH, acct 1194943, L. 48054 F. 597, PLAT A12-7298 OF RECORD (not read — obtain it; it supersedes the GIS outline drawn here), GIS 230995 sq ft, recorded 5.115479 ac, assessment 5.303 ac. PRELIMINARY. Outer boundary from the Prince…

NOTES OF RECORD

1. This drawing is a preliminary subdivision concept. It is not a plat, not a boundary survey, and not for recording.

2. Street layout follows the 2023 "Wheeler Rd Subdivision Layout" sheet for this parcel (street a tier in from the north and east boundaries, lots both sides) with ONE entrance from Wheeler Road; the second entrance and the private alley on that sheet are omitted and the far end is finished as a cul-de-sac.

3. Lot lines are proposed to meet Sec. 27-4202 RSF-95: minimum net lot area 9500 sq ft, minimum lot width 75 ft, minimum frontage 50 ft, maximum density 4.58 du/ac of net tract area.

4. All lots take access from WAHALLA COURT. No lot takes access from WHEELER; lots backing onto it are double-frontage lots and a no-access reservation along WHEELER is anticipated at platting.

5. Boundary shown from the county parcel layer (Level 1). A field survey by a Maryland licensed surveyor governs.

6. Recorded acreage 5.115479 ac (222830 sq ft) differs from the county GIS polygon (230995 sq ft) by 8165 sq ft. Both are reported; neither is adjusted. The survey resolves it.

7. Special exception SE-1796 is of record on this property. Its conditions have not been read into this concept and govern where they conflict.

8. PARCEL A does not front the proposed street in this layout; a 20-ft access and maintenance easement across the adjoining lot is required at platting.

9. Water and sewer: every lot is served from WAHALLA COURT; no service connects to WHEELER. Proposed 8-in WSSC water main and 8-in sanitary sewer in WAHALLA COURT, extended from the existing WSSC mains in WHEELER at the entrance. As-built size, location, depth and flow direction of…

10. Stormwater management by Environmental Site Design to the maximum extent practicable (Md. Stormwater Management Act of 2007; MDE Design Manual Ch. 5; PGC Sec. 32-172). Preliminary ESD volume: 52521 sq ft impervious (22.7% of the tract: 13 lots × 2000 sq ft, 21217 sq ft pavement,…

11. Proposed public street: 60' R/W and 26' pavement per the approved Joseph Drive section (Yocum Property, DPIE 15927-2020-0). Bend radius 150' centreline and cul-de-sac radii (50' R/W, 40' pavement) are ASSUMED — that approval is a through street with R "e 343'. Confirm against PGC DPW&T…

The surveyor certificate, owner dedication and approval signatures of the recorded plat are NOT reproduced here: they attach to that instrument, not to this drawing.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE ____________ DATE ____________

LICENSE NO. ____________ EXPIRATION DATE ____________

SEAL

REVISIONS
— none —

TREE CANOPY SCHEDULE

Sec. 25-128 Table 1 as amended by CB-021-2024 — 20% of NET tract area on RSF-95, met within it. Per-lot planting per Landscape Manual Sec. 4.1(c)(1). Street trees in the right-of-way count toward canopy under Sec. 25-129.

LOT	NET AREA SF	CANOPY REQ 20% SF	SHADE PROV / REQ	ORN-EVGN PROV / REQ	STREET TREES	10-YR CANOPY PROVIDED
LOT 1	9,557	1,911	3 / 3	0 / 2 SHORT	3	NOT ESTABLISHED
LOT 2	10,124	2,025	1 / 3 SHORT	0 / 2 SHORT	1	NOT ESTABLISHED
LOT 3	10,783	2,157	1 / 3 SHORT	0 / 2 SHORT	2	NOT ESTABLISHED
LOT 4	11,775	2,355	0 / 3 SHORT	0 / 2 SHORT	2	NOT ESTABLISHED
LOT 5	12,767	2,553	0 / 3 SHORT	0 / 2 SHORT	2	NOT ESTABLISHED
LOT 6	13,759	2,752	0 / 3 SHORT	0 / 2 SHORT	2	NOT ESTABLISHED
LOT 7	14,219	2,844	1 / 3 SHORT	0 / 2 SHORT	1	NOT ESTABLISHED
LOT 8	16,410	3,282	2 / 3 SHORT	0 / 2 SHORT	1	NOT ESTABLISHED
LOT 9	11,032	2,206	2 / 3 SHORT	0 / 2 SHORT	2	NOT ESTABLISHED

+ 5 further row(s) — see the accompanying schedule

TEN-YEAR CANOPY IS CREDITED PER SPECIES FROM THE PRINCE GEORGE'S COUNTY LANDSCAPE MANUAL. NO SPECIES HAS BEEN SELECTED ON THIS SET, SO THE CANOPY PROVIDED IS NOT ESTABLISHED AND THE SCHEDULE IS NOT YET BALANCED. EXISTING TREES PRESERVED ALSO COUNT.

NO TREE IS PLANTED WITHIN A STORM DRAIN EASEMENT. THE 60 FT 54/55 EASEMENT CARRIES THE 42 IN RCP MAIN AND THE 10 FT REAR EASEMENT CARRIES THE DRAINAGE SWALE; BOTH ARE SHOWN ON THIS SHEET AND BOTH ARE EXCLUDED FROM PLANTABLE AREA.

A WAIVER OF THE CANOPY REQUIREMENT IS AVAILABLE UNDER SEC. 25-130.

PER-LOT PLANTING IS SHORT ON EVERY LOT AS DRAWN. LANDSCAPE MANUAL SEC. 4.1(c)(1) REQUIRES 4 MAJOR SHADE AND 3 ORNAMENTAL OR EVERGREEN TREES ON A LOT OF 20,000 SF OR MORE, AND 3 AND 2 ON A LOT OF 9,500 TO 19,999 SF. NO ORNAMENTAL OR EVERGREEN TREES ARE DRAWN.

THE CANOPY REQUIREMENT MUST BE MET ON-SITE UNLESS A VARIANCE IS APPROVED, AND WHERE A GRADING PERMIT IS THE ONLY APPLICATION THE CANOPY NOTES BELONG ON THE GRADING PLAN — ENVIRONMENTAL TECHNICAL MANUAL PART D, SEC. 3.0.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

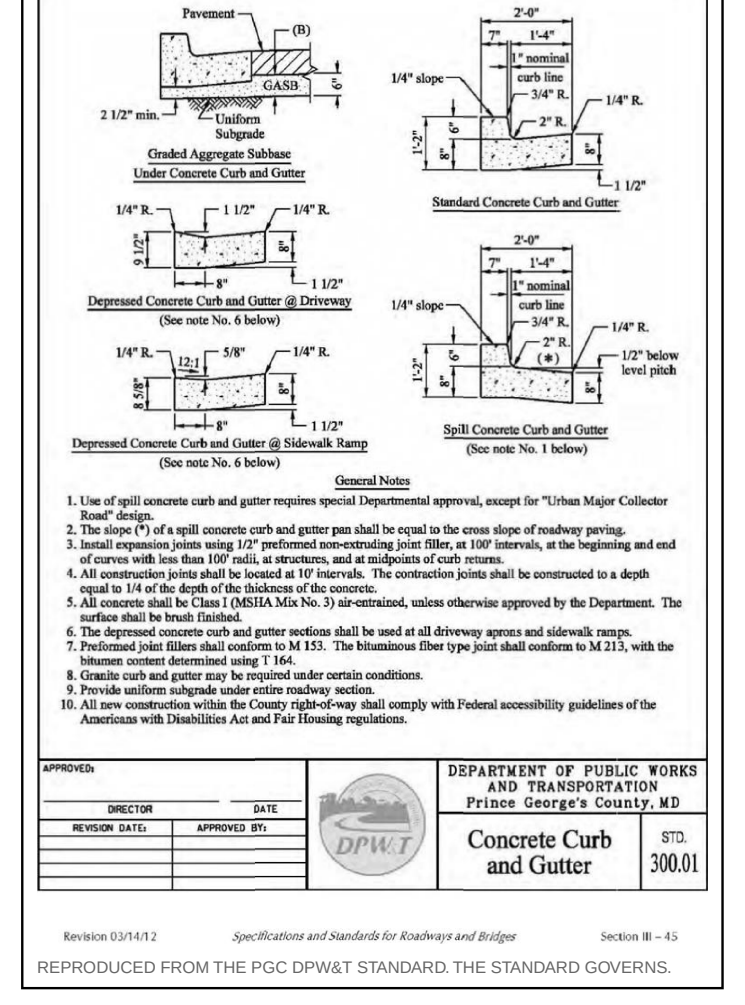

General Notes

1. Use of spill concrete curb and gutter requires special Departmental approval, except for "Urban Major Collector Road" design.
2. The slope (*) of a spill concrete curb and gutter pan shall be equal to the cross slope of roadway paving.
3. Install expansion joints using 1/2" preformed non-extruding joint filler, at 100' intervals, at the beginning and end of curves with less than 100' radii, at structures, and at midpoints of curb returns.
4. All construction joints shall be located at 10' intervals. The contraction joints shall be constructed to a depth equal to 1/4 of the depth of the thickness of the concrete.
5. All concrete shall be Class I (MSHA Mix No. 3) air-entrained, unless otherwise approved by the Department. The surface shall be brush finished.
6. The depressed concrete curb and gutter sections shall be used at all driveway aprons and sidewalk ramps.
7. Preformed joint fillers shall conform to M 153. The bituminous fiber type joint shall conform to M 213, with the bitumen content determined using T 164.
8. Granite curb and gutter may be required under certain conditions.
9. Provide uniform subgrade under entire roadway section.
10. All new construction within the County right-of-way shall comply with Federal accessibility guidelines of the Americans with Disabilities Act and Fair Housing regulations.

DEPARTMENT OF PUBLIC WORKS AND TRANSPORTATION
Prince George's County, MD
Concrete Curb and Gutter
STD. 300.01

Revision 03/14/12 — *Specifications and Standards for Roadways and Bridges* — Section III – 45

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

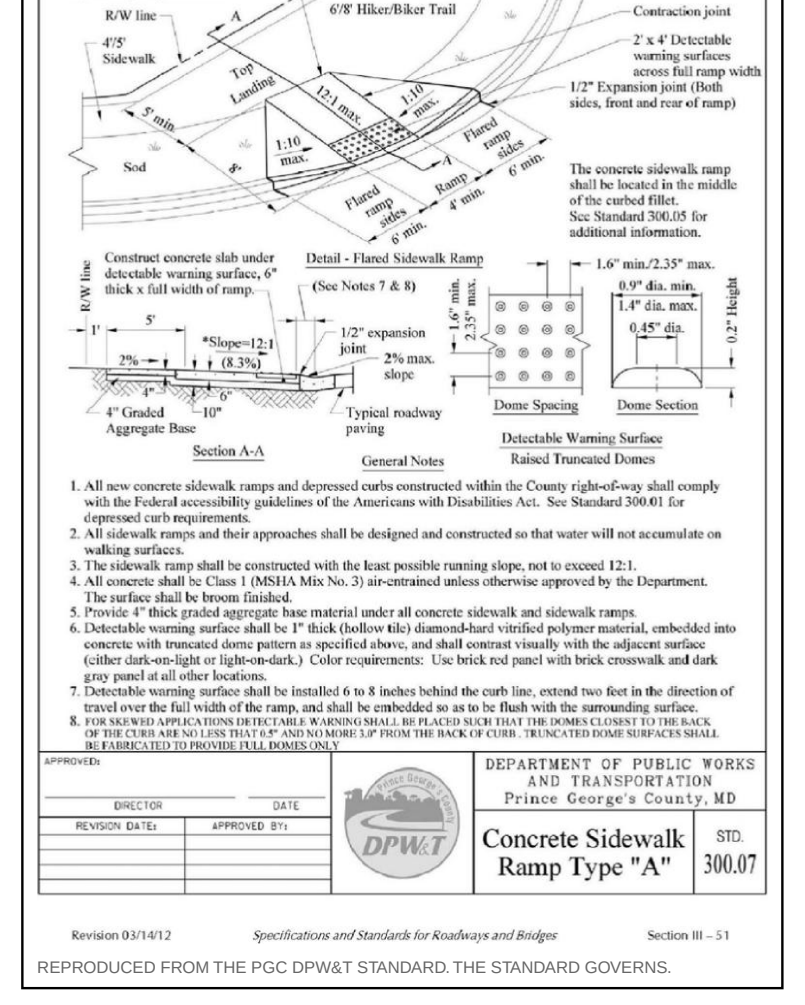

General Notes

1. All new concrete sidewalk ramps and depressed curbs constructed within the County right-of-way shall comply with the Federal accessibility guidelines of the Americans with Disabilities Act. See Standard 300.01 for depressed curb requirements.
2. All sidewalk ramps and their approaches shall be designed and constructed so that water will not accumulate on walking surfaces.
3. The sidewalk ramp shall be constructed with the least possible running slope, not to exceed 12:1.
4. All concrete shall be Class 1 (MSHA Mix No. 3) air-entrained unless otherwise approved by the Department. The surface shall be broom finished.
5. Provide 4" thick graded aggregate base material under all concrete sidewalk and sidewalk ramps.
6. Detectable warning surface shall be 1" thick (hollow tile) diamond-hard vitrified polymer material, embedded into concrete with truncated dome pattern as specified above, and shall contrast visually with the adjacent surface (either dark-on-light or light-on-dark.) Color requirements: Use brick red panel with brick crosswalk and dark gray panel at all other locations.
7. Detectable warning surface shall be installed 6 to 8 inches behind the curb line, extend two feet in the direction of travel over the full width of the ramp, and shall be embedded so as to be flush with the surrounding surface.
8. FOR SKEWED APPLICATIONS DETECTABLE WARNING SHALL BE PLACED SUCH THAT THE DOMES CLOSEST TO THE BACK OF THE CURB ARE NO LESS THAT 0.5" AND NO MORE 3.0" FROM THE BACK OF CURB. TRUNCATED DOME SURFACES SHALL BE FABRICATED TO PROVIDE FULL DOMES ONLY

DEPARTMENT OF PUBLIC WORKS AND TRANSPORTATION
Prince George's County, MD
Concrete Sidewalk Ramp Type "A"
STD. 300.07

Revision 03/14/12 — *Specifications and Standards for Roadways and Bridges* — Section III – 51

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

GRAPHIC SCALE — 1" = 40'

0 — 40 — 80 — 120 — 160 FEET

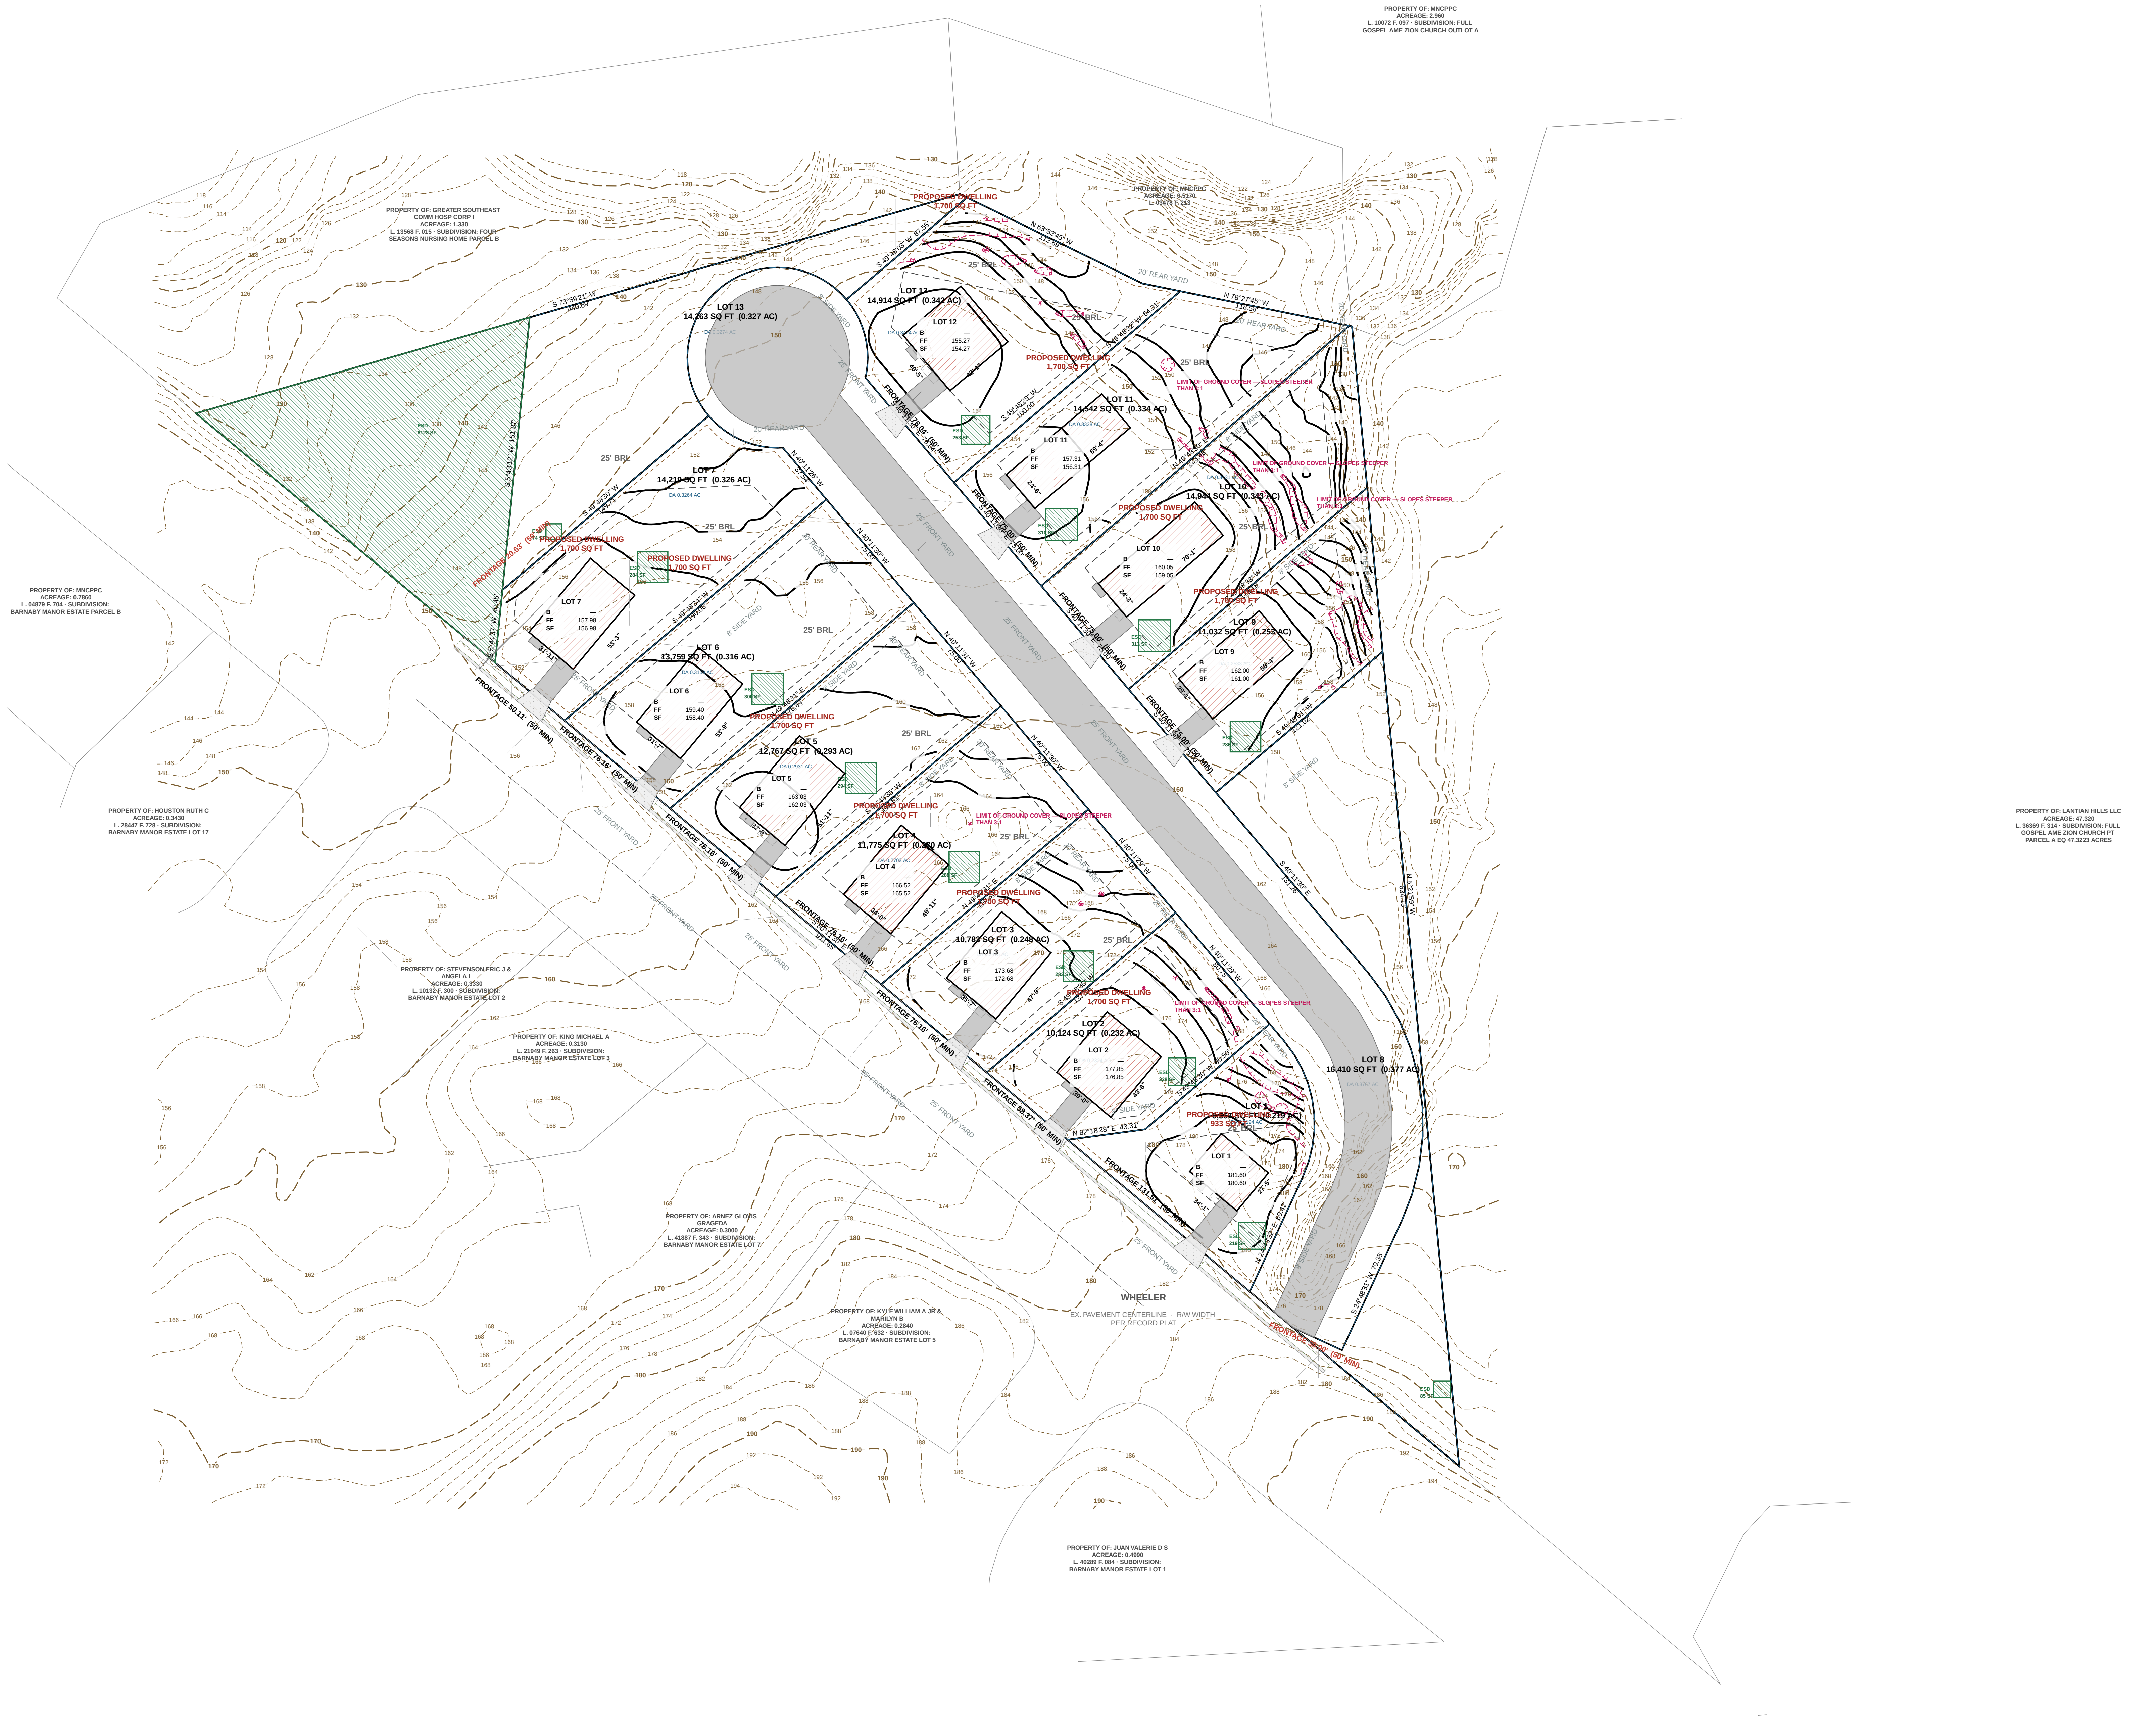
PROPERTY OF: MNCPPC
PROPERTY OF: GREATER SOUTHEAST COMM HOSP CORP I
FOUR SEASONS NURSING HOME PARCEL B
PROPERTY OF: MNCPPC
BARNABY MANOR ESTATE PARCEL B
PROPERTY OF: HOUSTON RUTH C
BARNABY MANOR ESTATE LOT 17
PROPERTY OF: LANTIAN HILLS LLC
GOSPEL AME ZION CHURCH PRT PARCEL A
PROPERTY OF: STEVENSON ERIC J & ANGELA L
BARNABY MANOR ESTATE LOT 2
PROPERTY OF: KING MICHAEL A
BARNABY MANOR ESTATE LOT 3
PROPERTY OF: ARNEZ OLGRA ORADEDA
BARNABY MANOR ESTATE LOT 4
PROPERTY OF: KYLE WILLIAM A JR & MARILYN B
BARNABY MANOR ESTATE LOT 5
PROPERTY OF: JUAN VALERIE D B
BARNABY MANOR ESTATE LOT 1
LOT 13 14,263 SQ FT (0.327 AC)
LOT 12 14,914 SQ FT (0.342 AC)
LOT 11 14,542 SQ FT (0.334 AC)
LOT 10 14,944 SQ FT (0.343 AC)
LOT 9 11,032 SQ FT (0.253 AC)
LOT 8 16,410 SQ FT (0.377 AC)
LOT 7 14,219 SQ FT (0.326 AC)
LOT 6 13,759 SQ FT (0.316 AC)
LOT 5 12,767 SQ FT (0.293 AC)
LOT 4 11,775 SQ FT (0.270 AC)
LOT 3 10,783 SQ FT (0.248 AC)
LOT 2 10,124 SQ FT (0.232 AC)
LOT 1 9,557 SQ FT
PROPOSED DWELLING 1,700 SQ FT
25' BRL
20' REAR YARD
FRONTAGE (50' MIN)
WHEELER
EX. PAVEMENT CENTERLINE — R/W WIDTH PER RECORD PLAT
LIMIT OF GROUND COVER — SLOPES STEEPER

SOILS TABLE
USDA NRCS SSURGO — PGC Code Sec. 32-130(a)(13)

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	.37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	.43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	.24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	.24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	.24	No	B/D	Somewhat poorly drained

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

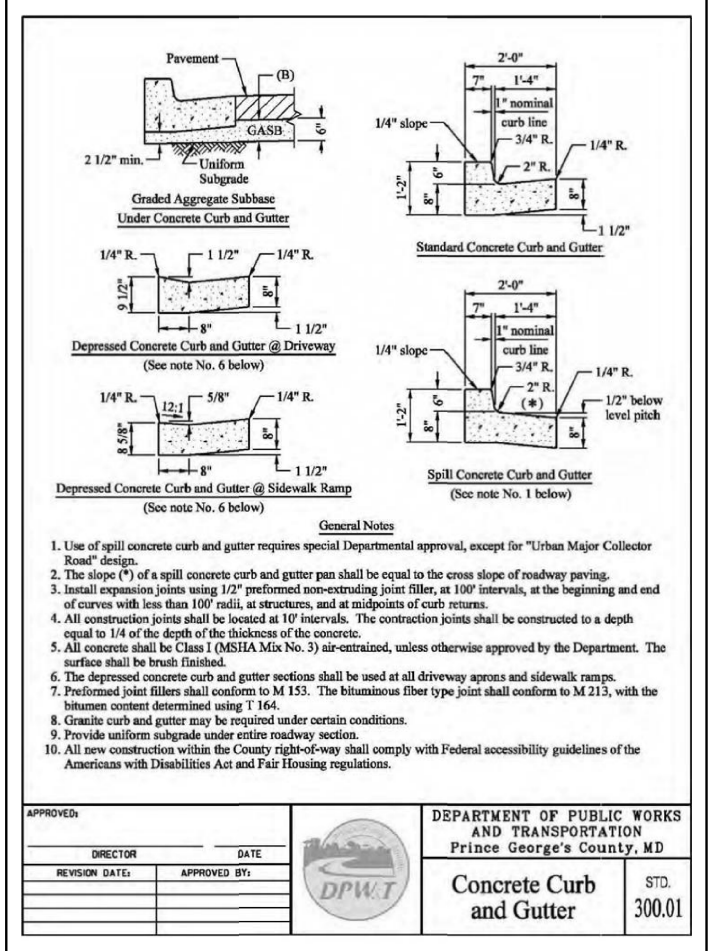
Pavement
(B)
GASB
2 1/2" min.
Uniform Subgrade
Graded Aggregate Subbase Under Concrete Curb and Gutter
Standard Concrete Curb and Gutter
Depressed Concrete Curb and Gutter @ Driveway
(See note No. 6 below)
Depressed Concrete Curb and Gutter @ Sidewalk Ramp
(See note No. 6 below)
Spill Concrete Curb and Gutter
(See note No. 1 below)
DPW&T

General Notes

1. Use of spill concrete curb and gutter requires special Departmental approval, except for "Urban Major Collector Road" design.
2. The slope (*) of a spill concrete curb and gutter pan shall be equal to the cross slope of roadway paving.
3. Install expansion joints using 1/2" preformed non-extruding joint filler, at 100' intervals, at the beginning and end of curves with less than 100' radii, at structures, and at midpoints of curb returns.
4. All construction joints shall be located at 10' intervals. The contraction joints shall be constructed to a depth equal to 1/4 of the depth of the thickness of the concrete.
5. All concrete shall be Class I (MSHA Mix No. 3) air-entrained, unless otherwise approved by the Department. The surface shall be brush finished.
6. The depressed concrete curb and gutter sections shall be used at all driveway aprons and sidewalk ramps.
7. Preformed joint fillers shall conform to M 153. The bituminous fiber type joint shall conform to M 213, with the bitumen content determined using T 164.
8. Granite curb and gutter may be required under certain conditions.
9. Provide uniform subgrade under entire roadway section.
10. All new construction within the County right-of-way shall comply with Federal accessibility guidelines of the Americans with Disabilities Act and Fair Housing regulations.

APPROVED:
DIRECTOR DATE
REVISION DATE: APPROVED BY:

DEPARTMENT OF PUBLIC WORKS AND TRANSPORTATION
Prince George's County, MD
Concrete Curb and Gutter
STD. 300.01

Revision 03/14/12 — *Specifications and Standards for Roadways and Bridges* — Section III – 45

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

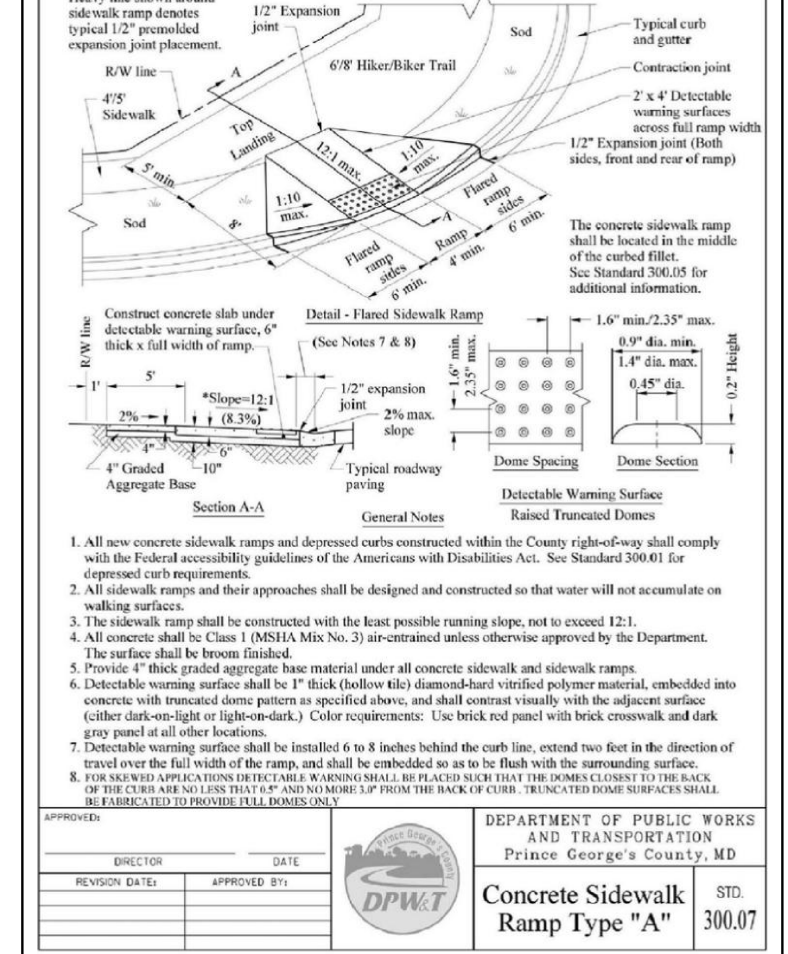
Heavy line shown around sidewalk ramp denotes typical 1/2" premolded expansion joint placement.
1/2" Expansion joint
Sod
Typical curb and gutter
R/W line
6'/8' Hiker/Biker Trail
Contraction joint
4'/5' Sidewalk
2' x 4' Detectable warning surfaces across full ramp width
Top Landing
12:1 max.
1:10 max.
1/2" Expansion joint (Both sides, front and rear of ramp)
Flared ramp sides
The concrete sidewalk ramp shall be located in the middle of the curbed fillet. See Standard 300.05 for additional information.
Detail - Flared Sidewalk Ramp
Construct concrete slab under detectable warning surface, 6" thick x full width of ramp.
(See Notes 7 & 8)
*Slope=12:1 (8.3%)
1/2" expansion joint
2% max. slope
4" Graded Aggregate Base
Typical roadway paving
Section A-A
Dome Spacing
Dome Section
Detectable Warning Surface Raised Truncated Domes
DPW&T

General Notes

1. All new concrete sidewalk ramps and depressed curbs constructed within the County right-of-way shall comply with the Federal accessibility guidelines of the Americans with Disabilities Act. See Standard 300.01 for depressed curb requirements.
2. All sidewalk ramps and their approaches shall be designed and constructed so that water will not accumulate on walking surfaces.
3. The sidewalk ramp shall be constructed with the least possible running slope, not to exceed 12:1.
4. All concrete shall be Class 1 (MSHA Mix No. 3) air-entrained unless otherwise approved by the Department. The surface shall be broom finished.
5. Provide 4" thick graded aggregate base material under all concrete sidewalk and sidewalk ramps.
6. Detectable warning surface shall be 1" thick (hollow tile) diamond-hard vitrified polymer material, embedded into concrete with truncated dome pattern as specified above, and shall contrast visually with the adjacent surface (either dark-on-light or light-on-dark.) Color requirements: Use brick red panel with brick crosswalk and dark gray panel at all other locations.
7. Detectable warning surface shall be installed 6 to 8 inches behind the curb line, extend two feet in the direction of travel over the full width of the ramp, and shall be embedded so as to be flush with the surrounding surface.
8. FOR SKEWED APPLICATIONS DETECTABLE WARNING SHALL BE PLACED SUCH THAT THE DOMES CLOSEST TO THE BACK OF THE CURB ARE NO LESS THAT 0.5" AND NO MORE 3.0" FROM THE BACK OF CURB. TRUNCATED DOME SURFACES SHALL BE FABRICATED TO PROVIDE FULL DOMES ONLY

APPROVED:
DIRECTOR DATE
REVISION DATE: APPROVED BY:

DEPARTMENT OF PUBLIC WORKS AND TRANSPORTATION
Prince George's County, MD
Concrete Sidewalk Ramp Type "A"
STD. 300.07

Revision 03/14/12 — *Specifications and Standards for Roadways and Bridges* — Section III – 51

REPRODUCED FROM THE PGC DPW&T STANDARD. THE STANDARD GOVERNS.

GRAPHIC SCALE — 1" = 40'

0 40 80 120 160 FEET

N

KEALEE
design, build, deliver

PROJECT
4600 WHEELER ROAD — PRELIMINARY SUBDIVISION CONCEPT — LOTS 1–13

ADDRESS
4600 WHEELER ROAD

JURISDICTION
Prince George's County, Maryland

ZONE
RSF-95

SHEET
C-400 — Grading and Drainage Plan

SCALE
1" = 40'

STATUS
PRELIMINARY

SHEET NO.
3 OF 3

COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION	
PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	C-400 — Grading and Drainage Plan
DISCIPLINE	Maryland Professional Engineer
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

INDEX OF DRAWINGS

1	C-001	Site Development Plan — Existing, Proposed, Grading, Paving and
2	L-100	Landscape and Tree Canopy Plan
3	C-400	Grading and Drainage Plan

SITE DATA		
ZONE	RSF-95	
TAX / PARCEL ID	—	
GROSS TRACT AREA	230,997 SF	5.303 AC
LOT 1 AREA	9,557 SF	0.219 AC
LOT 2 AREA	10,124 SF	0.232 AC
LOT 3 AREA	10,783 SF	0.248 AC
LOT 4 AREA	11,775 SF	0.270 AC
LOT 5 AREA	12,767 SF	0.293 AC
LOT 6 AREA	13,759 SF	0.316 AC
LOT 7 AREA	14,219 SF	0.326 AC
LOT 8 AREA	16,410 SF	0.377 AC
LOT 9 AREA	11,032 SF	0.253 AC
LOT 10 AREA	14,944 SF	0.343 AC
LOT 11 AREA	14,542 SF	0.334 AC
LOT 12 AREA	14,914 SF	0.342 AC
LOT 13 AREA	14,263 SF	0.327 AC
NET LOT AREA	169,090 SF	3.882 AC
LOT 1 FRONTAGE	50' MIN	131.51'
LOT 2 FRONTAGE	50' MIN	58.37'
LOT 3 FRONTAGE	50' MIN	76.16'
LOT 4 FRONTAGE	50' MIN	76.16'
LOT 5 FRONTAGE	50' MIN	76.16'
LOT 6 FRONTAGE	50' MIN	76.16'
LOT 7 FRONTAGE	50' MIN	50.11'
LOT 8 FRONTAGE	50' MIN	30.00'
LOT 9 FRONTAGE	50' MIN	75.00'
LOT 10 FRONTAGE	50' MIN	75.00'
LOT 11 FRONTAGE	50' MIN	75.00'
LOT 12 FRONTAGE	50' MIN	76.04'
LOT 13 FRONTAGE	50' MIN	20.63'
SETBACKS	**REQUIRED**	**PROVIDED**
FRONT YARD	25'	25'
SIDE YARD	8'	8'
REAR YARD	20'	20'
COVERAGE	**MAX**	**PROPOSED**
LOT COVERAGE	30%	10.6%
BUILDING FOOTPRINT	—	17,933 SF
DATUM		
HORIZONTAL	EPSG:2248	NAD83
VERTICAL	NAVD88 (feet)	

SITE ANALYSIS

1. Gross tract area	230,997 SF
2. Area of dwelling	17,933 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	169,090 SF
6. TOTAL AREA DISTURBED	91,062 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
LOT 1	181.27	—	181.60	180.60	20'	2
LOT 2	177.52	—	177.85	176.85	20'	2
LOT 3	173.35	—	173.68	172.68	20'	2
LOT 4	166.19	—	166.52	165.52	20'	2
LOT 5	162.70	—	163.03	162.03	20'	2
LOT 6	159.07	—	159.40	158.40	20'	2
LOT 7	157.65	—	157.98	156.98	20'	2
LOT 9	161.67	—	162.00	161.00	20'	2
LOT 10	159.72	—	160.05	159.05	20'	2
LOT 11	156.98	—	157.31	156.31	20'	2
LOT 12	154.94	—	155.27	154.27	20'	2

G garage slab · B basement · FF finished floor · SF subfloor · HT height · STY storeys. A DASH IS NOT ZERO: the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQv CF
LOT 1	9,557	14.4%	0.37	0.52	0.15	143
LOT 2	10,124	20.1%	0.39	0.61	0.22	195
LOT 3	10,783	19.5%	0.42	0.64	0.22	202
LOT 4	11,775	17.7%	0.45	0.68	0.23	206
LOT 5	12,767	16.3%	0.49	0.72	0.23	210
LOT 6	13,759	15.2%	0.53	0.75	0.22	214
LOT 7	14,219	14.7%	0.55	0.77	0.22	216
LOT 8	16,410	0.0%	0.63	0.63	0.00	68
LOT 9	11,032	18.9%	0.42	0.65	0.23	202
LOT 10	14,944	14.0%	0.58	0.80	0.22	219
LOT 11	14,542	14.3%	0.56	0.78	0.22	217
LOT 12	14,914	14.5%	0.57	0.81	0.24	224
LOT 13	14,263	0.0%	0.55	0.55	0.00	59
PROJECT TOTAL	**169,090**	**13.2%**	**6.51**	**8.91**	**2.40**	**2,375**

Peak flows are summed lot catchments; Q in cfs. WQv is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting	**1 DAY**
2. Obtain necessary permits	**2 DAYS**
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation	**1 DAY**
4. Install stabilized construction entrance and perimeter sediment control	**2 DAYS**
5. Rough grade the lot	**5 DAYS**
6. Construct dwelling	**6 MONTHS**
7. Install water, sewer and storm services and the driveway	**10 DAYS**
8. Fine grade and stabilize all disturbed areas	**5 DAYS**
9. Remove sediment control once the inspector gives written permission	**1 DAY**

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION. FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — 4600 WHEELER ROAD — PRELIMINARY SUBDIVISION CONCEPT. ZONE RSF-95, SE-1796. PARCEL 366579 — PARCEL A FOUR SEASONS NURSING HOME, OWNER OF RECORD ETHIOPIAN ORTHODOX TEWAHEDO CHURCH, ACCT 1194943, L. 48054 F. 597, PLAT A12-7298 OF RECORD (NOT READ — OBTAIN IT; IT SUPERSEDES THE GIS OUTLINE DRAWN HERE), GIS 230995 SQ FT, RECORDED 5.115479 AC, ASSESSMENT 5.303 AC. PRELIMINARY. OUTER BOUNDARY FROM THE PRINCE GEORGE'S COUNTY PARCEL LAYER (PGATLAS PROPERTY/MAPSERVER/15), COMPILED FROM TAX MAPS — NOT A BOUNDARY SURVEY AND NOT A PLAT OF RECORD. LOT LINES AND STREETS ARE PROPOSED BY KEALEE. A MARYLAND LICENSED SURVEYOR MUST ESTABLISH THE BOUNDARY BEFORE ANY PLAT IS PREPARED. — TRANSCRIBED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED. THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION: GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSED CURB AT THE APRON PER DPW&T STD. 300.01 NOTE 6. ON-LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

LEGEND

▬	PROPERTY BOUNDARY
– – –	BRL — BUILDING RESTRICTION LINE
▬	PROPOSED STRUCTURE
– – –	EXISTING CONTOUR — 2 FT INTERVAL, NAVD88
▬	PROPOSED CONTOUR — 2 FT INTERVAL
— — -	STREET CENTRELINE
▬	PROPOSED PAVEMENT — DRIVEWAY / WALK
— –	EASEMENT
— –	SANITARY LATERAL (SHC) — HEAVIEST
— –	WATER SERVICE (WHC)
▬	STORM DRAIN — TRUNK, RCP
— — -	STORM — HOUSE CONNECTION TO TRUNK
▬	DRAINAGE SWALE — INVERT AND GRADED SECTION
▬	RETAINING WALL — TICKS ON THE RETAINED SIDE
– – –	LIMIT OF GROUND COVER — TICKS ON THE STEEP SIDE
— —	100-YR FLOODPLAIN LIMIT, EXISTING GROUND — FPS-770017, WSSC DATUM, UNTIED
▬	100-YR FLOODPLAIN LIMIT, PROPOSED GROUND — SAME ELEVATION, REGRADED SURFACE
▬	ESD — STORMWATER PRACTICE

PLAT OF RECORD

4600 WHEELER ROAD — PRELIMINARY SUBDIVISION CONCEPT. Zone RSF-95, SE-1796. Parcel 366579 — PARCEL A FOUR SEASONS NURSING HOME, owner of record ETHIOPIAN ORTHODOX TEWAHEDO CHURCH, acct 1194943, L. 48054 F. 597, PLAT A12-7298 OF RECORD (not read — obtain it; it supersedes the GIS outline drawn here), GIS 230995 sq ft, recorded 5.115479 ac, assessment 5.303 ac. PRELIMINARY. Outer boundary from the Prince…

NOTES OF RECORD

1. This drawing is a preliminary subdivision concept. It is not a plat, not a boundary survey, and not for recording.
2. Street layout follows the 2023 "Wheeler Rd Subdivision Layout" sheet for this parcel (street a tier in from the north and east boundaries, lots both sides) with ONE entrance from Wheeler Road; the second entrance and the private alley on that sheet are omitted and the far end is finished as a cul-de-sac.
3. Lot lines are proposed to meet Sec. 27-4202 RSF-95: minimum net lot area 9500 sq ft, minimum lot width 75 ft, minimum frontage 50 ft, maximum density 4.58 du/ac of net tract area.
4. All lots take access from WAHALLA COURT. No lot takes access from WHEELER; lots backing onto it are double-frontage lots and a no-access reservation along WHEELER is anticipated at platting.
5. Boundary shown from the county parcel layer (Level 1). A field survey by a Maryland licensed surveyor governs.
6. Recorded acreage 5.115479 ac (222830 sq ft) differs from the county GIS polygon (230995 sq ft) by 8165 sq ft. Both are reported; neither is adjusted. The survey resolves it.
7. Special exception SE-1796 is of record on this property. Its conditions have not been read into this concept and govern where they conflict.
8. PARCEL A does not front the proposed street in this layout; a 20-ft access and maintenance easement across the adjoining lot is required at platting.
9. Water and sewer: every lot is served from WAHALLA COURT; no service connects to WHEELER. Proposed 8-in WSSC water main and 8-in sanitary sewer in WAHALLA COURT, extended from the existing WSSC mains in WHEELER at the entrance. As-built size, location, depth and flow direction of…
10. Stormwater management by Environmental Site Design to the maximum extent practicable (Md. Stormwater Management Act of 2007; MDE Design Manual Ch. 5; PGC Sec. 32-172). Preliminary ESD volume: 52521 sq ft impervious (22.7% of the tract: 13 lots × 2000 sq ft, 21217 sq ft pavement,…
11. Proposed public street: 60' R/W and 26' pavement per the approved Joseph Drive section (Yocum Property, DPIE 15927-2020-0). Bend radius 150' centreline and cul-de-sac radii (50' R/W, 40' pavement) are ASSUMED — that approval is a through street with R "e 343'. Confirm against PGC DPW&T…

The surveyor certificate, owner dedication and approval signatures of the recorded plat are NOT reproduced here: they attach to that instrument, not to this drawing.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE ____________ DATE ____________

LICENSE NO. ____________ EXPIRATION DATE ____________

SEAL

REVISIONS
— none

3 REQUIRED NOTE(S) DO NOT FIT THIS SHEET: GRADING CERTIFICATE; STABILIZATION COMPLIANCE PREAMBLE; STANDARD STABILIZATION NOTE. THEY ARE REQUIRED AND ARE NOT ON ANY SHEET IN THIS SET.