

KEALEE

Design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56
ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd
JURISDICTION
Prince George's County, Maryland
ZONE
RSF-95
SHEET
C-001 — Site Development Plan — Existing, Proposed, Grading, Paving and Landscape
SCALE
1" = 30'
STATUS
PRELIMINARY
SHEET NO.
1 OF 3
COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION

PLAN TYPE SITE DEVELOPMENT / FINE GRADING
SHEET C-001 — Site Development Plan — Existing, Proposed, Grading, Paving and Landscape
DISCIPLINE Maryland Professional Engineer / Surveyor (see divided responsibility)
DRAWN BY
DESIGNED BY KEALEE SITE-PLAN ENGINEER
CHECKED BY

REVISIONS

NO.	DATE	DESCRIPTION

SITE DATA

ZONE	RSF-95
TAX / PARCEL ID	—
GROSS TRACT AREA	75,178 SF 1.726 AC
LOT 53 AREA	12,389 SF 0.284 AC
LOT 54 AREA	23,371 SF 0.533 AC
LOT 55 AREA	25,733 SF 0.591 AC
LOT 56 AREA	13,690 SF 0.314 AC
NET LOT AREA	75,184 SF 1.726 AC
LOT 53 FRONTAGE	50' MIN 83.07'
LOT 54 FRONTAGE	50' MIN 173.55'
LOT 55 FRONTAGE	50' MIN 131.07'
LOT 56 FRONTAGE	50' MIN 84.20'
SETBACKS	REQUIRED PROVIDED
FRONT YARD	30' 30'
SIDE YARD	8' 8'
REAR YARD	20' 20'
COVERAGE	MAX PROPOSED
LOT COVERAGE	30% 6.4%
BUILDING FOOTPRINT	— 4,784 SF
DATUM	
HORIZONTAL	EPSG:2248 NAD83
VERTICAL	NAVD88 (feet)

SITE ANALYSIS

1. Gross tract area	75,178 SF
2. Area of dwelling	4,784 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	75,184 SF
6. TOTAL AREA DISTURBED	41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G: garage slab · B: basement · FF: finished floor · SF: subfloor · HT: height · STY: storeys. A DASH IS NOT ZERO; the elevation has not been established and must be set from a field-run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQV CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	182
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	75,184	10.9%	2.96	3.84	0.88	924

Peak flows are summed for catchments; Q in cfs. WQV is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting 1 DAY
2. Obtain necessary permits 2 DAYS
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation 1 DAY
4. Install stabilized construction entrance and perimeter sediment control 2 DAYS
5. Rough grade the lot 5 DAYS
6. Construct dwelling 6 MONTHS
7. Install water, sewer and storm services and the driveway 10 DAYS
8. Fine grade and stabilize all disturbed areas 5 DAYS
9. Remove sediment control once the inspector gives written permission 1 DAY

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION, FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F PLAT BOOK WWW (S. P. 40) (MSA: 33289, 33293) 32TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND, TAX MAP 113, BLOCK F, GRID E4, PLAT DATED 6 JUNE 1987, APPROVED 26 JUNE 1987 BY THE MARYLAND NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD, M-NCPPC RECORD FILE S197863. SCALE 1" = 100'. SURVEYOR: W. L. WICKENS, REGISTERED LAND SURVEYOR NO. 384. TOTAL SUBDIVISION AREA 20,981.1 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. TRANSFERRED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED; THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION. NOT AN OPEN DITCH SECTION. GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSIONED CURB AT THE APRON PER DPW&T STD. 300.01, NOTE 6. ON LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.


PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE	DATE
LICENSE NO.	EXPIRATION DATE
SEAL	

REVISIONS

— NONE —

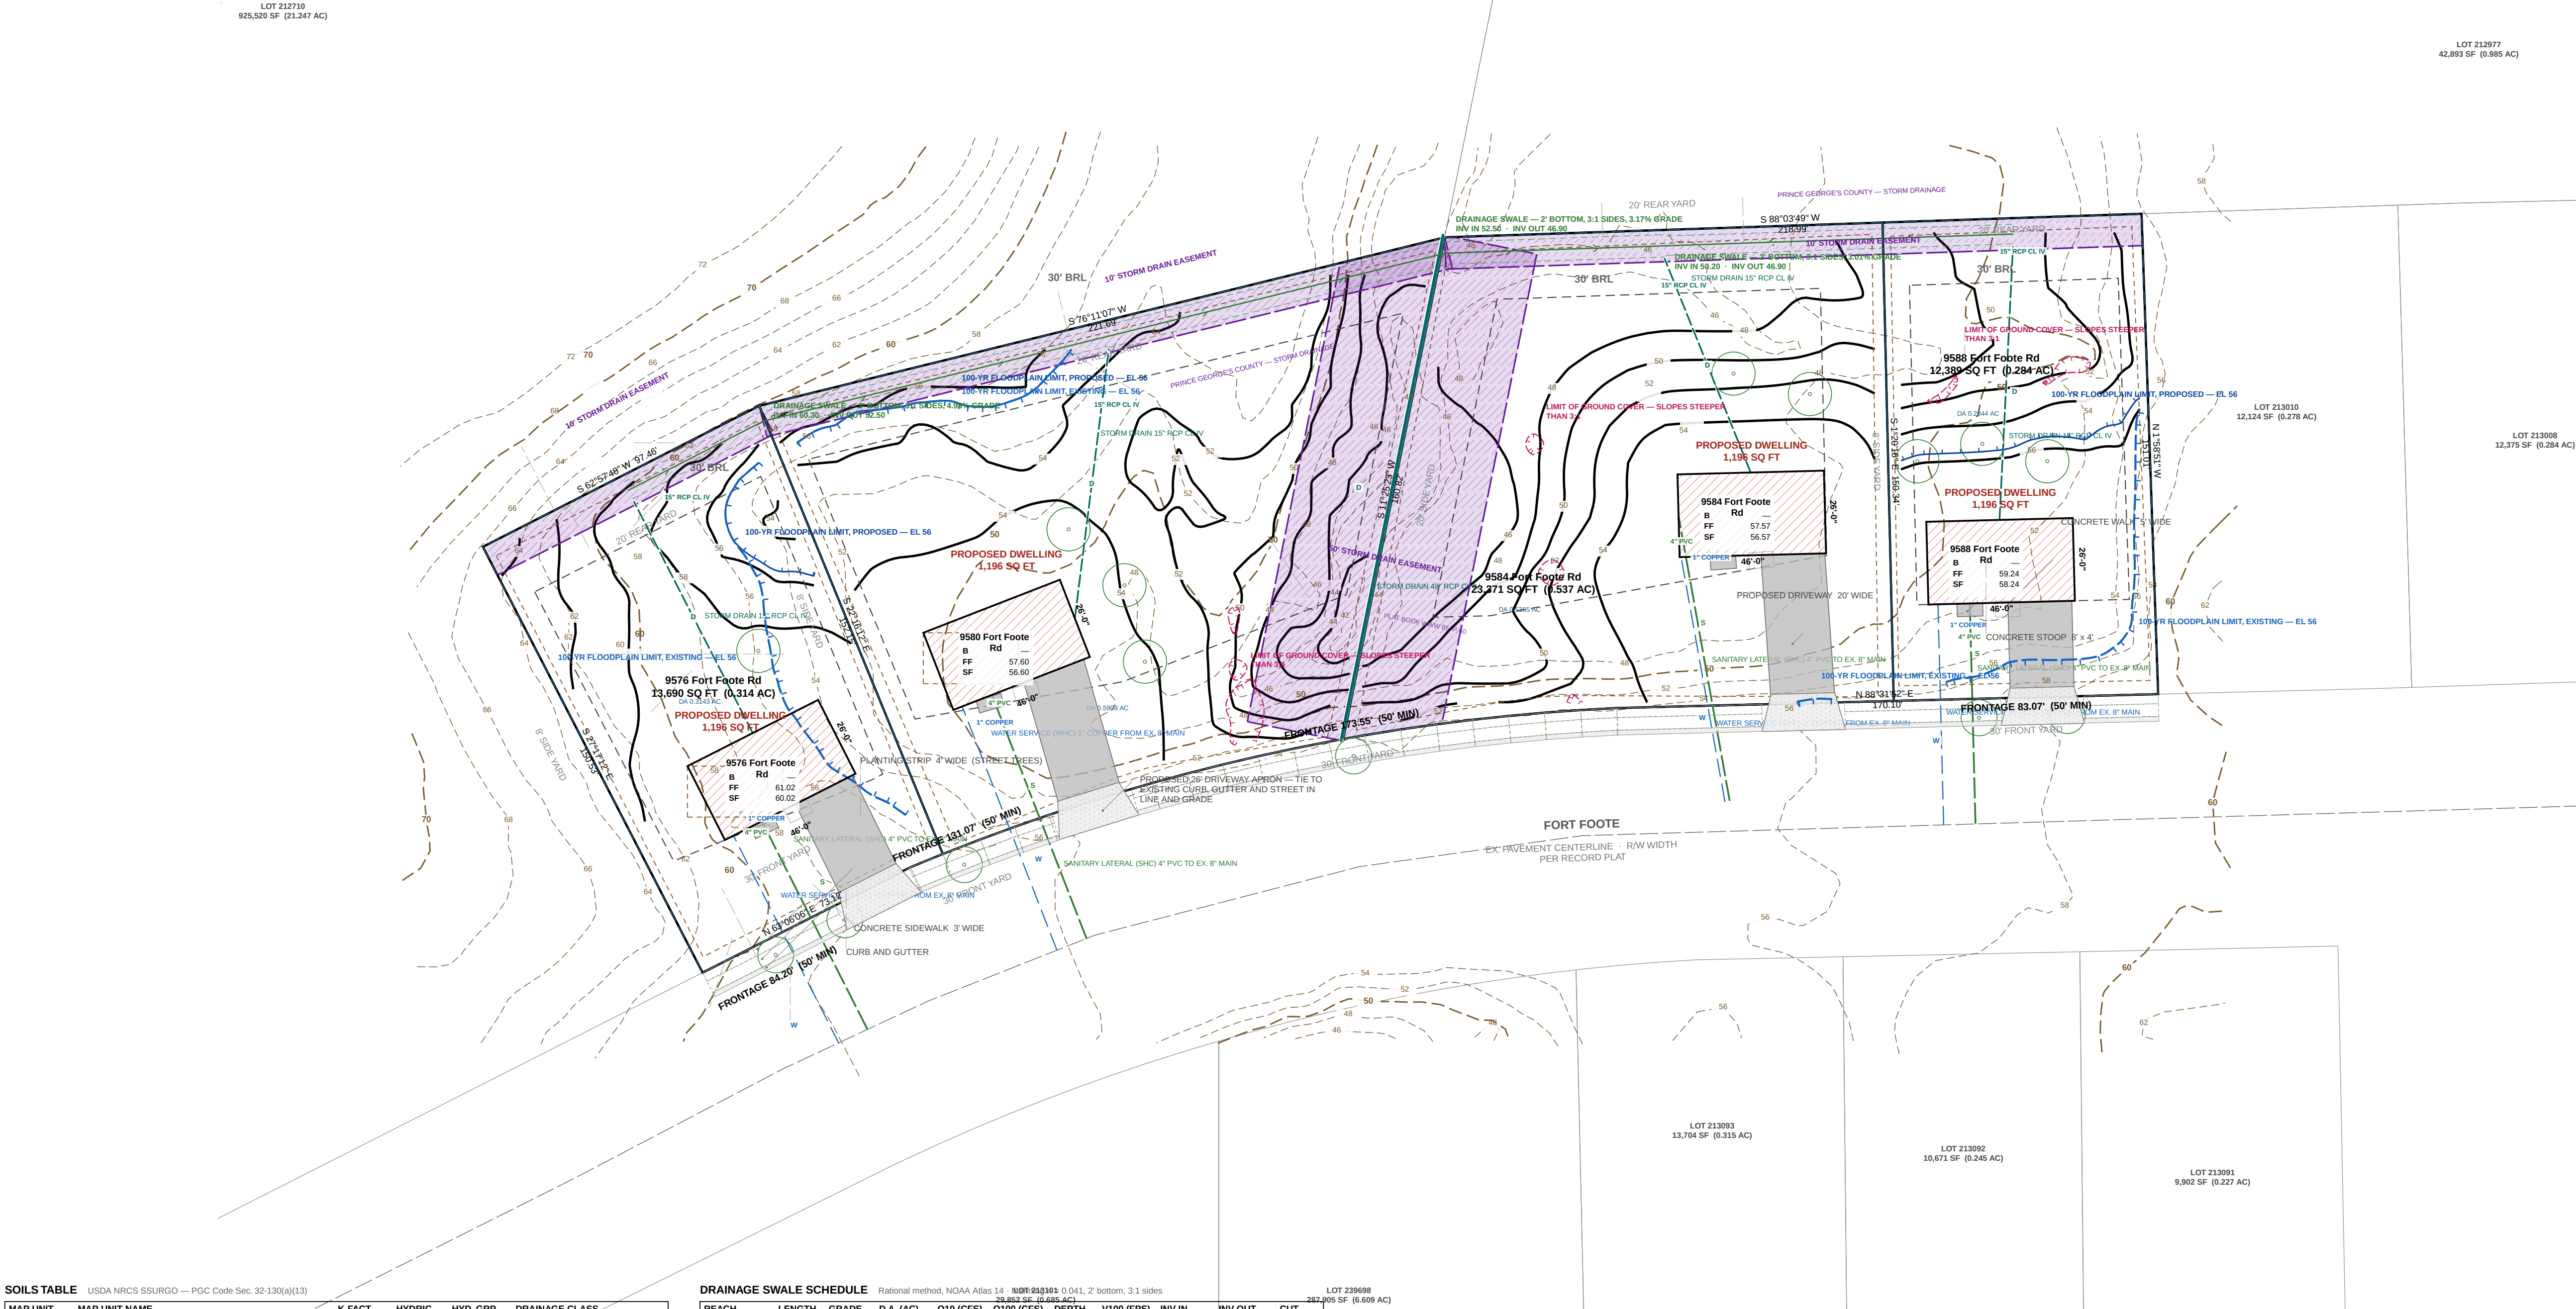

SOILS TABLE

MAP UNIT	MAP UNIT NAME	K-FACT	HYDRIC	HYD. GRP	DRAINAGE CLASS
AaB	Adelphia silt loam, 2 to 5 percent slopes complex	37	No	C	Moderately well drained
AcA	Adelphia-Aquasco complex, 0 to 2 percent slopes	43	No	D	Somewhat poorly drained
AdA	Adelphia-Holmdel complex, 0 to 2 percent slopes	24	No	B/D	Somewhat poorly drained
AdB	Adelphia-Holmdel complex, 2 to 5 percent slopes	24	No	B/D	Somewhat poorly drained
AdC	Adelphia-Holmdel complex, 5 to 10 percent slopes	24	No	B/D	Somewhat poorly drained

DRAINAGE SWALE SCHEDULE


REACH	LENGTH	GRADE	D.A. (AC)	Q10 (CFS)	Q100 (CFS)	DEPTH	V100 (FPS)	INV IN	INV OUT	CUT
ST-1 — ST-2	110'	3.01%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'
ST-4 — ST-3	157'	4.98%	0.3143	0.65	0.86	0.16'	2.12	60.30	52.50	1.0'
ST-3 — ST-2	177'	3.17%	0.9051	1.87	2.47	0.33'	2.51	52.50	46.90	1.0'

GRADE CONTROL SCHEDULE


POINT	LOT	DESCRIPTION	GROUND	SWALE INV
ST-1	LOT 53	Swale grade break / invert control	51.20	50.20
ST-2	LOT 54	Swale grade break / invert control	47.90	46.90
ST-3	LOT 55	Swale grade break / invert control	53.50	52.50
ST-4	LOT 56	Swale grade break / invert control	61.30	60.30
OUT	—	Swale grade break / invert control	48.90	—

SYSTEM AT THE LOW POINT: 1.7260 AC, Q10 3.57 CFS, Q100 4.71 CFS.
MAX VELOCITY 2.61 FPS AT Q100 — WITHIN THE 5 FPS PERMISSIBLE FOR ESTABLISHED GRASS, 0.6 FT FREEBOARD THROUGHOUT.
THE SWALE DISCHARGES TO THE RECORDED 54RS STORM DRAIN EASEMENT, ALONGSIDE THE 40' ROP CL IV EXTENDING THE FORT FOOTE ROAD CULVERT INLET.
THAT MAIN IS BURIED, OD 4.67 FT, 1.5 FT MIN COVER OVER THE CROWN — FINISHED GRADE OVER IT SHALL BE NO LOWER THAN INVERT + 6.17 FT FILL WHERE EXISTING GROUND IS LOWER.
SWALE GRADES AND INVERTS TO BE SET FROM THE FIELD-RUN TOPOGRAPHIC SURVEY. ESTABLISH SOD BEFORE THE CONTRIBUTING AREA IS STABILISED.


CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

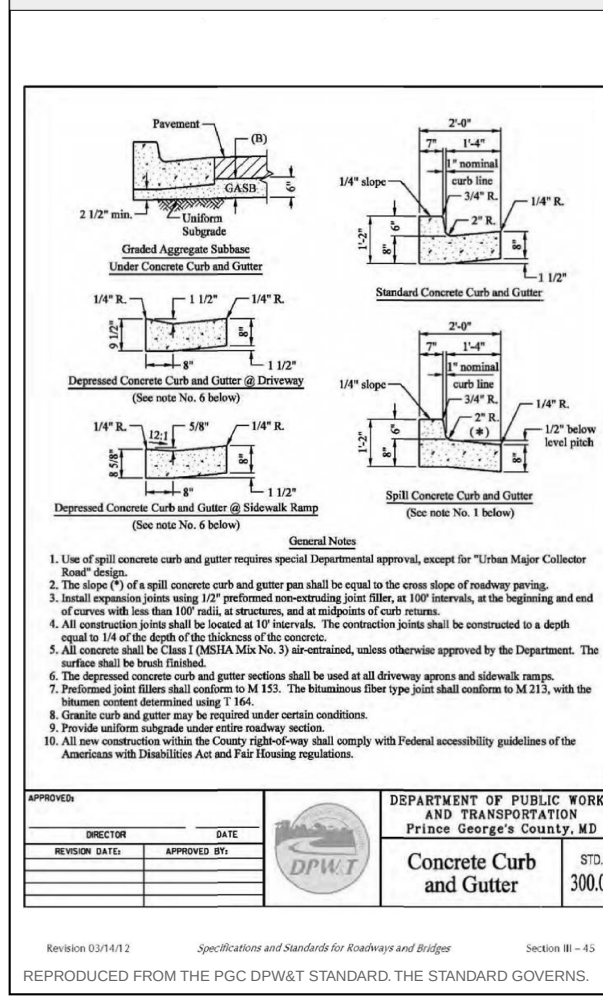

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

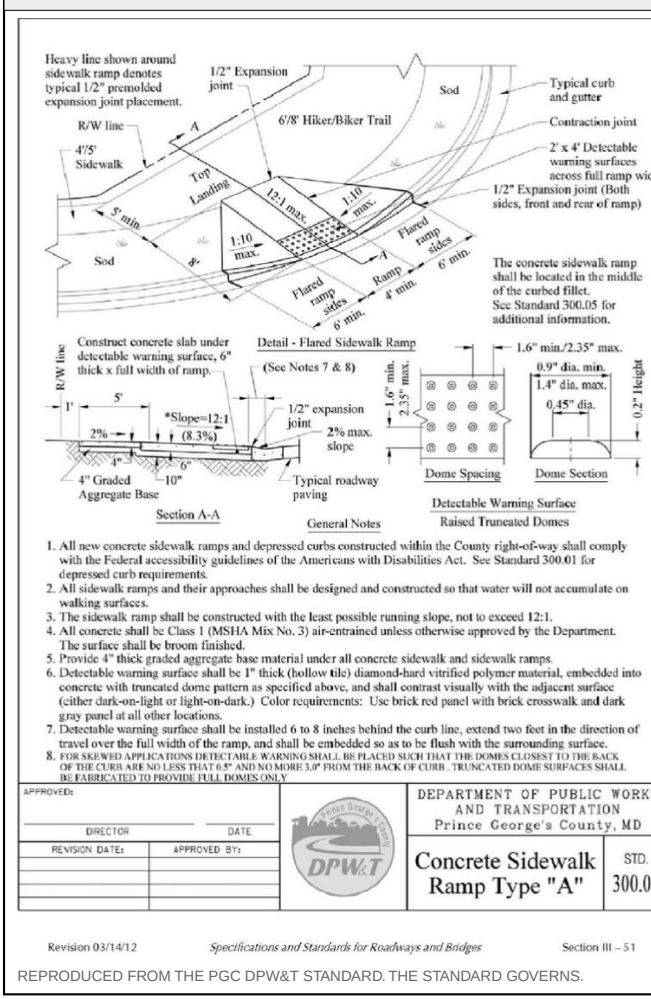


FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL. 61.09

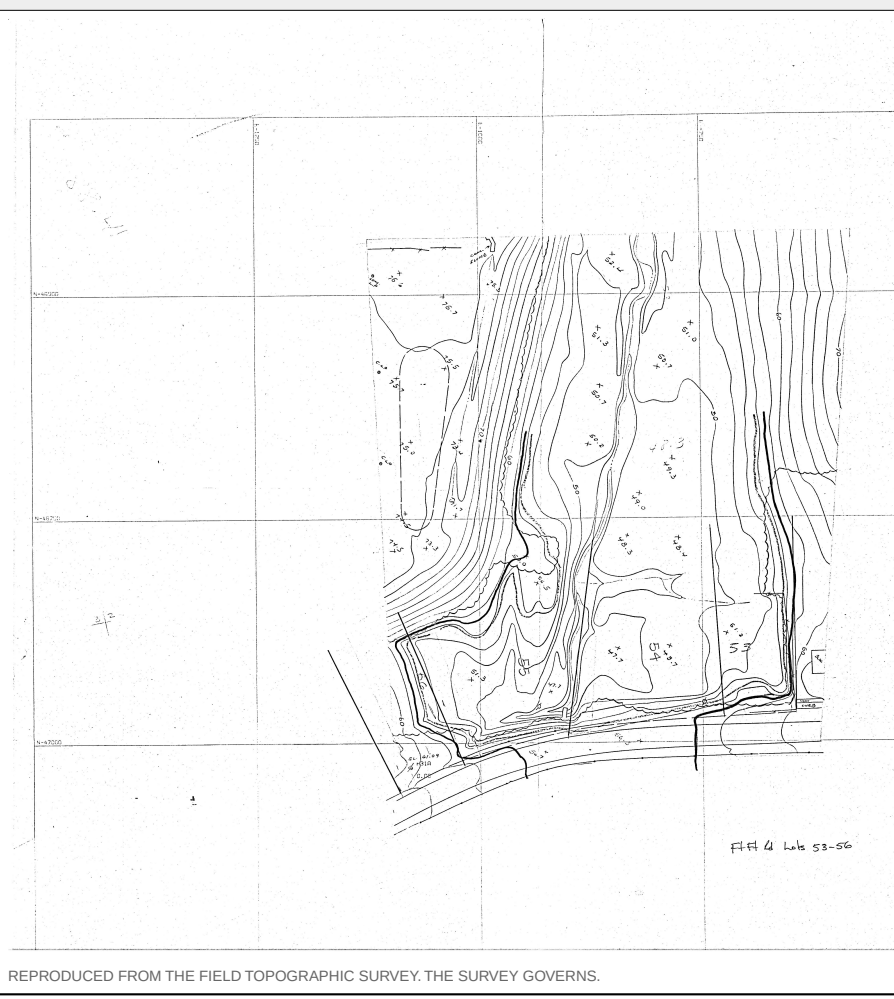

GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

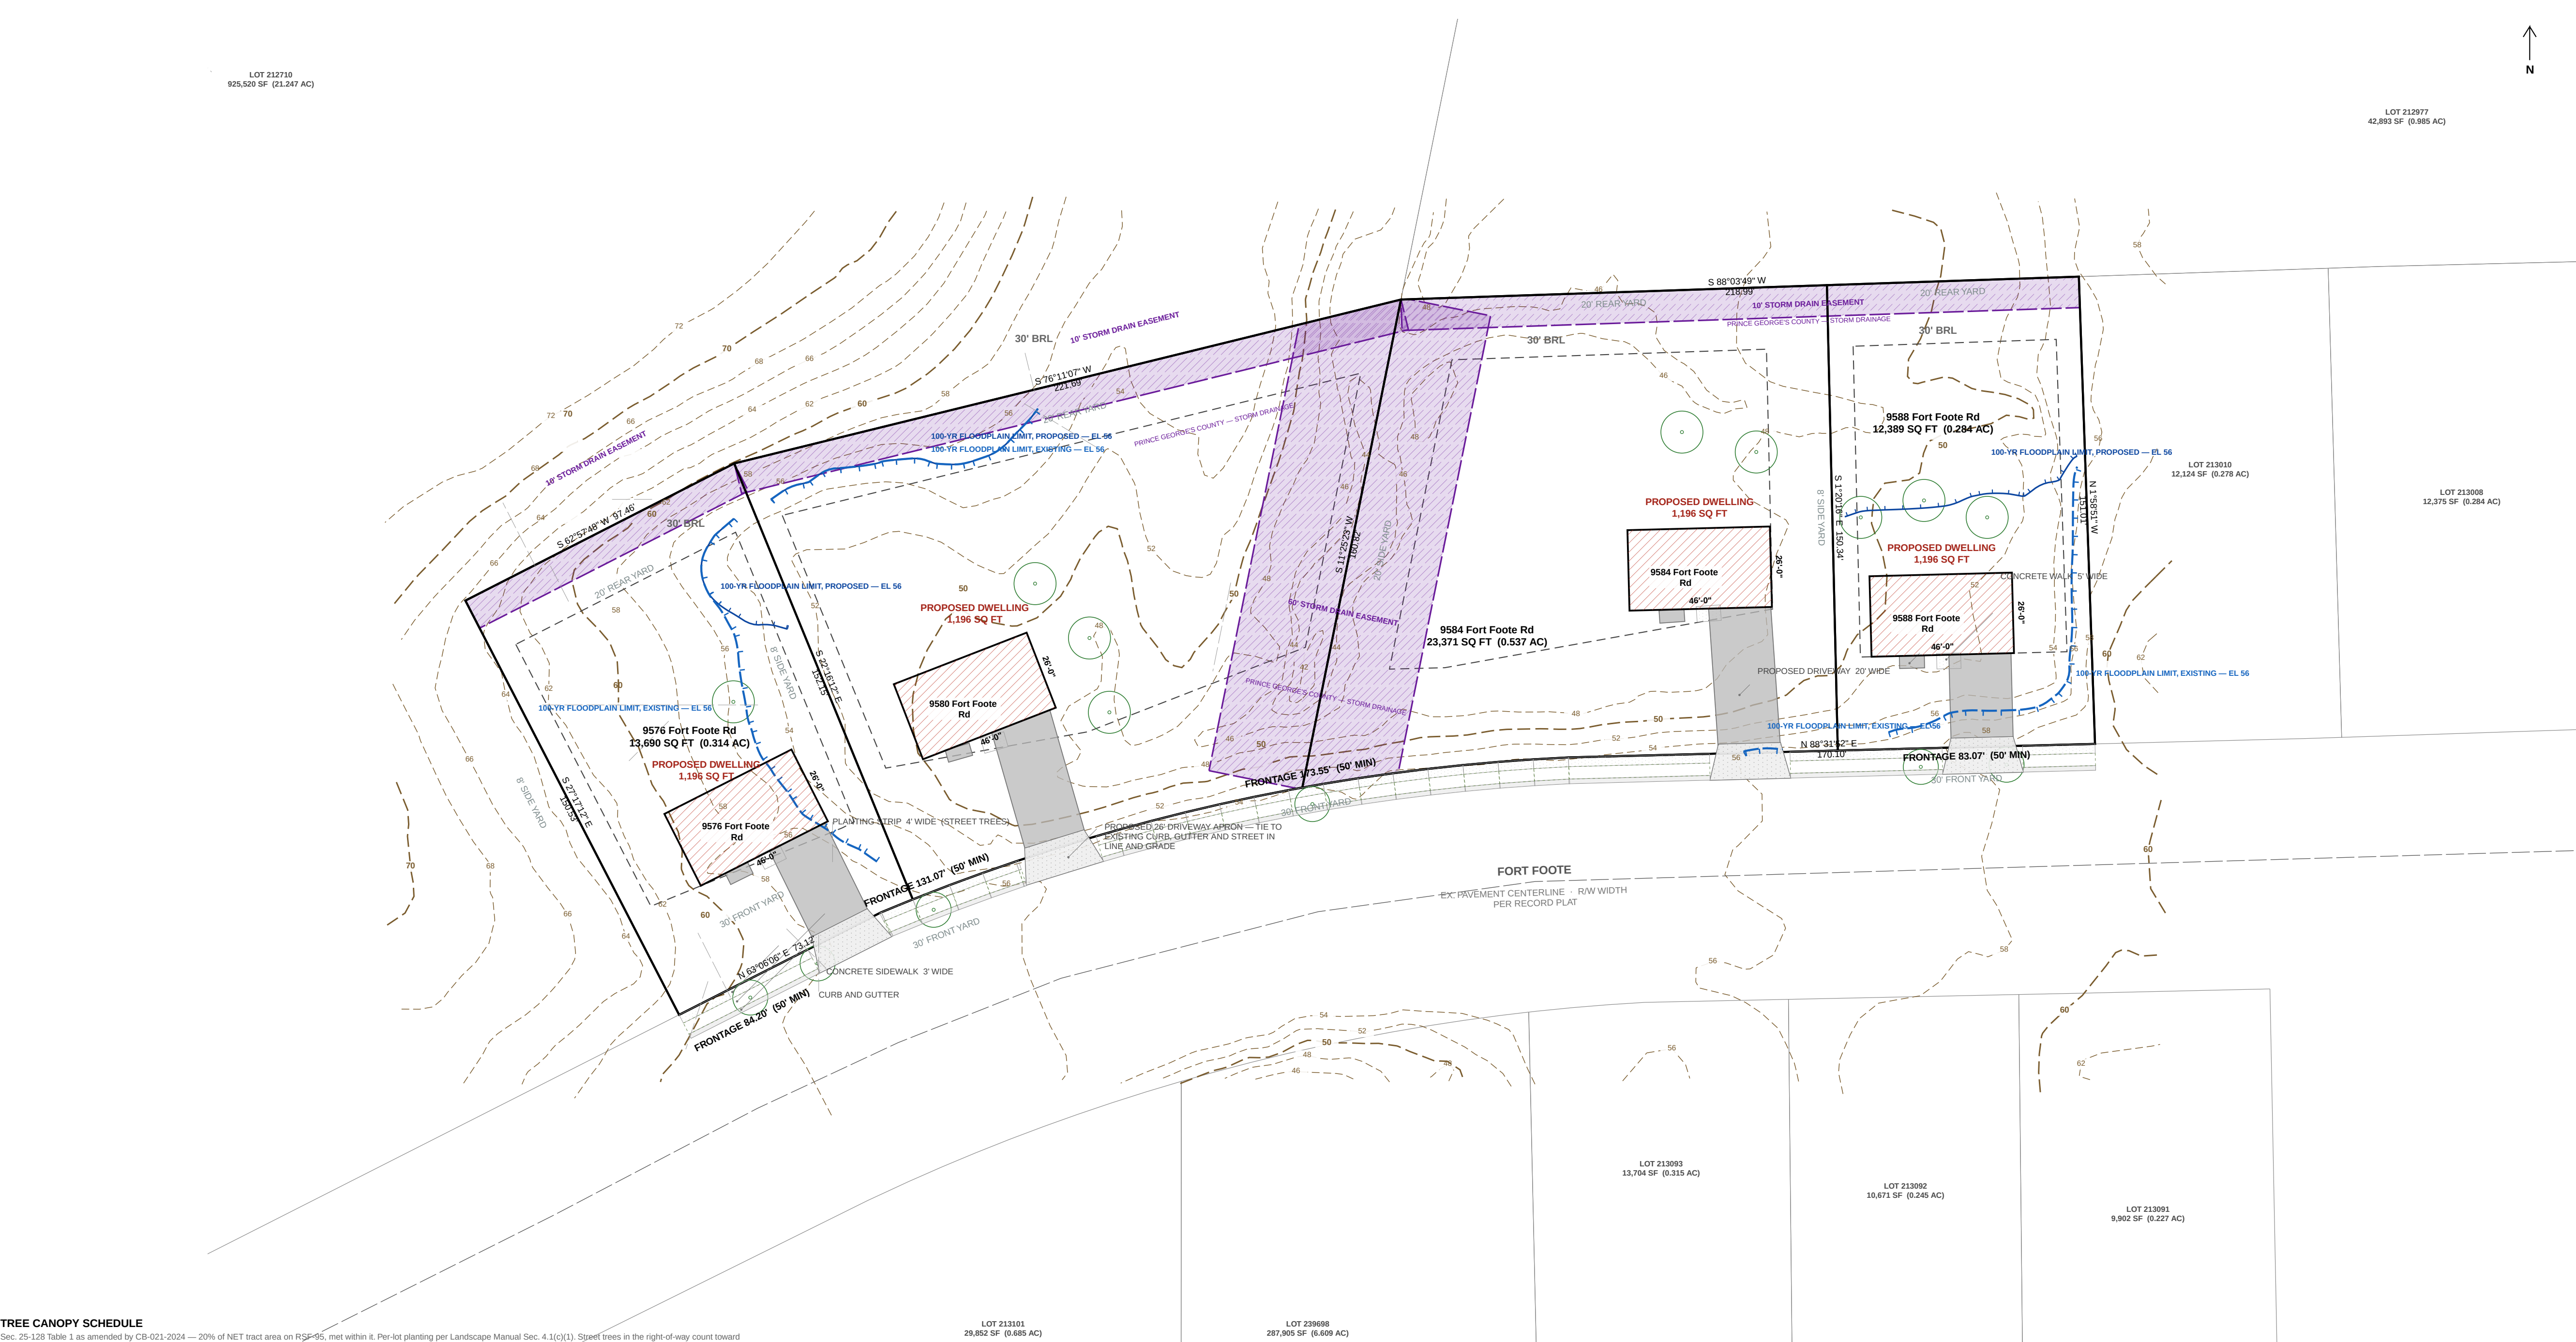

KEALEE

Design, build, deliver

PROJECT
Indian Queen East — LOT 53 & LOT 54 & LOT 55 & LOT 56
ADDRESS
9588 Fort Foote Rd · 9584 Fort Foote Rd · 9580 Fort Foote Rd · 9576 Fort Foote Rd
JURISDICTION
Prince George's County, Maryland
ZONE
RSF-95
SHEET
L-100 — Landscape and Tree Canopy Plan
SCALE
1" = 30'
STATUS
PRELIMINARY
SHEET NO.
2 OF 3
COORDINATES
EPSG:2248
H: NAD83
V: NAVD88 (feet)

PLAN TYPE AND PREPARATION

PLAN TYPE	SITE DEVELOPMENT / FINE GRADING
SHEET	L-100 — Landscape and Tree Canopy Plan
DISCIPLINE	Landscape Architect / Qualified Professional
DRAWN BY	KEALEE SITE-PLAN ENGINE
DESIGNED BY	
CHECKED BY	

REVISIONS

NO.	DATE	DESCRIPTION

SITE DATA

ZONE	RSF-95
TAX / PARCEL ID	—
GROSS TRACT AREA	75,178 SF 1.726 AC
LOT 53 AREA	12,389 SF 0.284 AC
LOT 54 AREA	23,371 SF 0.537 AC
LOT 55 AREA	25,733 SF 0.591 AC
LOT 56 AREA	13,690 SF 0.314 AC
NET LOT AREA	75,184 SF 1.726 AC
LOT 53 FRONTAGE	50' MIN 83.07'
LOT 54 FRONTAGE	50' MIN 173.55'
LOT 55 FRONTAGE	50' MIN 131.07'
LOT 56 FRONTAGE	50' MIN 84.20'
SETBACKS	REQUIRED PROVIDED
FRONT YARD	30' 30'
SIDE YARD	8' 8'
REAR YARD	20' 20'
COVERAGE	MAX PROPOSED
LOT COVERAGE	30% 6.4%
BUILDING FOOTPRINT	— 4,784 SF
DATUM	
HORIZONTAL	EPSG:2248 NAD83
VERTICAL	NAVD88 (feet)

SITE ANALYSIS

1. Gross tract area	75,178 SF
2. Area of dwelling	4,784 SF
3. Wooded area	NOT ESTABLISHED
4. Floodplain area	NOT ESTABLISHED
5. Net lot area	75,184 SF
6. TOTAL AREA DISTURBED	41,662 SF (AT LEAST)
7. SWM REQUIRED — Sec. 32-174(a)(3)	YES — DISTURBANCE EXCEEDS 5,000 SF

BUILDING DATA

	G	B	FF	SF	HT	STY
9588 Fort Foote Rd	58.91	—	59.24	58.24	20'	2
9584 Fort Foote Rd	57.24	—	57.57	56.57	20'	2
9580 Fort Foote Rd	57.27	—	57.60	56.60	20'	2
9576 Fort Foote Rd	60.69	—	61.02	60.02	20'	2

G: garage slab · B: basement · FF: finished floor · SF: subfloor · HT: height · STY: storeys. A DASH IS NOT ZERO; the elevation has not been established and must be set from a field run topographic survey before construction.

DRAINAGE AREA COMPUTATIONS

CATCHMENT	AREA SF	IMPERV.	PRE Q	POST Q	INCREASE	WQV CF
LOT 53	12,389	15.1%	0.49	0.69	0.20	182
LOT 54	23,371	9.4%	0.92	1.16	0.24	263
LOT 55	25,733	8.2%	1.01	1.24	0.23	266
LOT 56	13,690	14.2%	0.54	0.75	0.21	203
PROJECT TOTAL	75,184	10.9%	2.96	3.84	0.88	924

Peak flows are summed for catchments; Q in cfs. WQV is the required water-quality volume.

SEQUENCE OF CONSTRUCTION

1. Pre-construction meeting
2. Obtain necessary permits
3. Notify Miss Utility at 811 at least 48 hours prior to any excavation
4. Install stabilized construction entrance and perimeter sediment control
5. Rough grade the lot
6. Construct dwelling
7. Install water, sewer and storm services and the driveway
8. Fine grade and stabilize all disturbed areas
9. Remove sediment control once the inspector gives written permission

TOTAL ESTIMATED TIME OF CONSTRUCTION: 8 MONTHS

GENERAL NOTES

1. CONTRACTOR SHALL CONTACT MISS UTILITY AT 811 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION, FIELD-VERIFY LOCATION AND DEPTH BY TEST PIT BEFORE CONSTRUCTION.
2. ALL EXISTING AND PROPOSED UTILITIES SHOWN PER PGC CODE SEC. 32-106.
3. PROPOSED GRADE SHOWN SOLID; EXISTING GRADE SHOWN DASHED.
4. ROUGH EARTHWORK GRADES AND UTILITY ELEVATIONS SHOWN TO TENTHS OF A FOOT.
5. BOUNDARY SHOWN IS THE RECORDED PLAT OF SUBDIVISION — INDIAN QUEEN EAST — BLOCK "E" AND PARTS OF BLOCKS D & F PLAT BOOK WWW 65, P. 60 (MSA 33,289, 33,293) 31TH ELECTION DISTRICT, PRINCE GEORGE'S COUNTY, MARYLAND, TAX MAP 113, BLOCK F, GRID E4, PLAT DATED 6 JUNE 1967, APPROVED 26 JUNE 1967 BY THE MARYLAND NATIONAL CAPITAL PARK & PLANNING COMMISSION, PRINCE GEORGE'S COUNTY PLANNING BOARD, M-NCPPC RECORD FILE 5197863. SCALE 1" = 100'. SURVEYOR W. L. WICKENS, REGISTERED LAND SURVEYOR NO. 384, TOTAL SUBDIVISION AREA 20,981.1 ACRES. PLAT LEGEND: FOR PUBLIC SEWER & WATER SYSTEMS ONLY. TRANSFERRED AND CHECKED FOR CLOSURE. THE PLAT IS THE BOUNDARY SURVEY. NO FIELD TOPOGRAPHY IS INCLUDED; EXISTING GRADE IS COUNTY LIDAR CONTOUR MAPPING.
6. CONNECT TO EXISTING PAVEMENT, CURB AND GUTTER, DRIVEWAY AND SIDEWALK IN LINE AND GRADE.
7. NO DRIVEWAY CULVERT IS REQUIRED; THIS FRONTAGE IS AN EXISTING CURB AND GUTTER SECTION, NOT AN OPEN DITCH SECTION. GUTTER FLOW IS CARRIED THROUGH EACH ENTRANCE BY THE DEPRESSIONED CURB AT THE APRON PER DPW&T STD. 300.03 NOTE 6. ON LOT DRAINAGE IS COLLECTED BY THE REAR-YARD SWALE IN THE REAR DRAINAGE EASEMENT AND CROSSES NO DRIVEWAY OR APRON.

PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

SIGNATURE	DATE
LICENSE NO.	EXPIRATION DATE
SEAL	
REVISIONS	
— NONE —	

TREE CANOPY SCHEDULE


Sec. 25-128 Table 1 as amended by CB-021-2024 — 20% of NET tract area on RSF-95, met within 8' Per lot planting per Landscape Manual Sec. 4.1(c)(3). Specif trees in the right-of-way count toward canopy under Sec. 25-129.

LOT	NET AREA SF	CANOPY REQ 20% SF	SHADE PROV / REQ	ORN-EVON PROV / REQ	STREET TREES	10-YR CANOPY PROVIDED
LOT 53	12,389	2,478	3 / 3	0 / 2 SHORT	2	NOT ESTABLISHED
LOT 54	23,371	4,674	2 / 4 SHORT	0 / 3 SHORT	1	NOT ESTABLISHED
LOT 55	25,733	5,147	3 / 4 SHORT	0 / 3 SHORT	1	NOT ESTABLISHED
LOT 56	13,690	2,738	1 / 3 SHORT	0 / 2 SHORT	2	NOT ESTABLISHED
TOTAL	75,184	15,037	9 / 14	0 / 10	6	—


TEN-YEAR CANOPY IS CREDITED FOR SPECIES FROM THE PRINCE GEORGE'S COUNTY LANDSCAPE MANUAL, NO SPECIES HAS BEEN SELECTED ON THIS SET, SO THE CANOPY PROVIDED IS NOT ESTABLISHED AND THE SCHEDULE IS NOT YET BALANCED. EXISTING TREES PRESERVED ALSO COUNT. NO TREE IS PLANTED WITHIN A STORM DRAIN EASEMENT; THE 60 FT 5455 EASEMENT CARRIES THE DRAINAGE SWALE, BOTH ARE SHOWN ON THIS SHEET AND BOTH ARE EXCLUDED FROM PLANTABLE AREA.

A WAIVER OF THE CANOPY REQUIREMENT IS AVAILABLE UNDER SEC. 25-130. PER LOT PLANTING IS SHORT ON EVERY LOT AS DRAWN. LANDSCAPE MANUAL, SEC. 4.3(c)(3) REQUIRES 4 MAJOR SHADE AND 3 ORNAMENTAL, OR EVERGREEN TREES ON A LOT OF 20,000 SF OR MORE, AND 3 AND 3 ON A LOT OF 5,000 TO 19,999 SF. NO ORNAMENTAL, OR EVERGREEN TREES ARE DRAWN, AT LEAST ONE SHADE TREE MUST STAND ON THE SOUTH OR WEST SIDE WITHIN 30 FT OF THE DWELLING, AND AT LEAST ONE REQUIRED TREE IN THE FRONT YARD. SPECIES AND FINAL LOCATIONS BY THE LANDSCAPE ARCHITECT. THE CANOPY REQUIREMENT MUST BE MET ON-SITE UNLESS A VARIANCE IS APPROVED, AND WHERE A GRADING PERMIT IS THE ONLY APPLICATION THE CANOPY NOTES BELONG ON THE GRADING PLAN — ENVIRONMENTAL TECHNICAL MANUAL PART D, SEC. 3.0.

CONCRETE CURB AND GUTTER — PGC DPW&T STD. 300.01

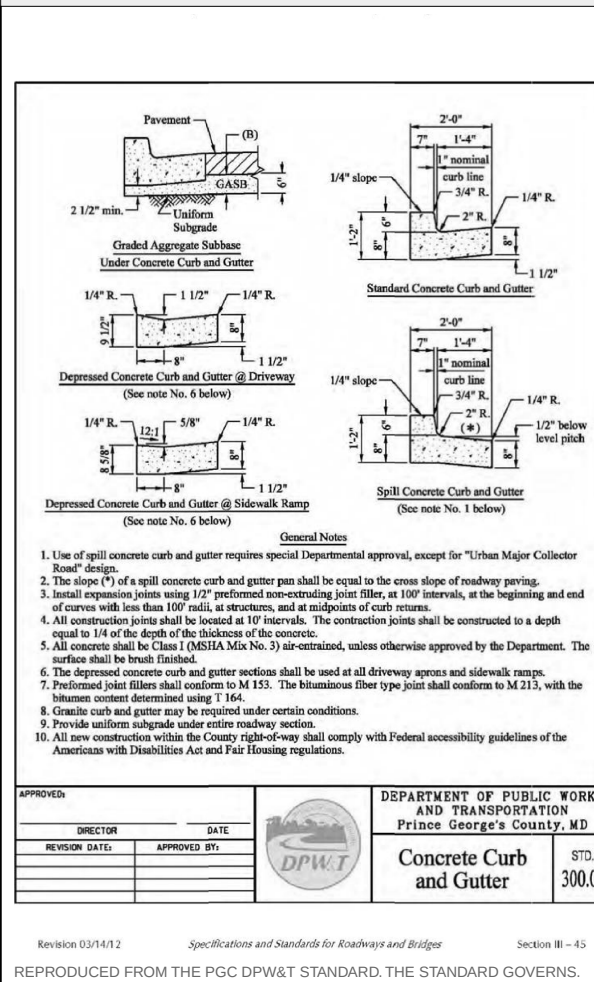

CONCRETE SIDEWALK RAMP TYPE A — PGC DPW&T STD. 300.07

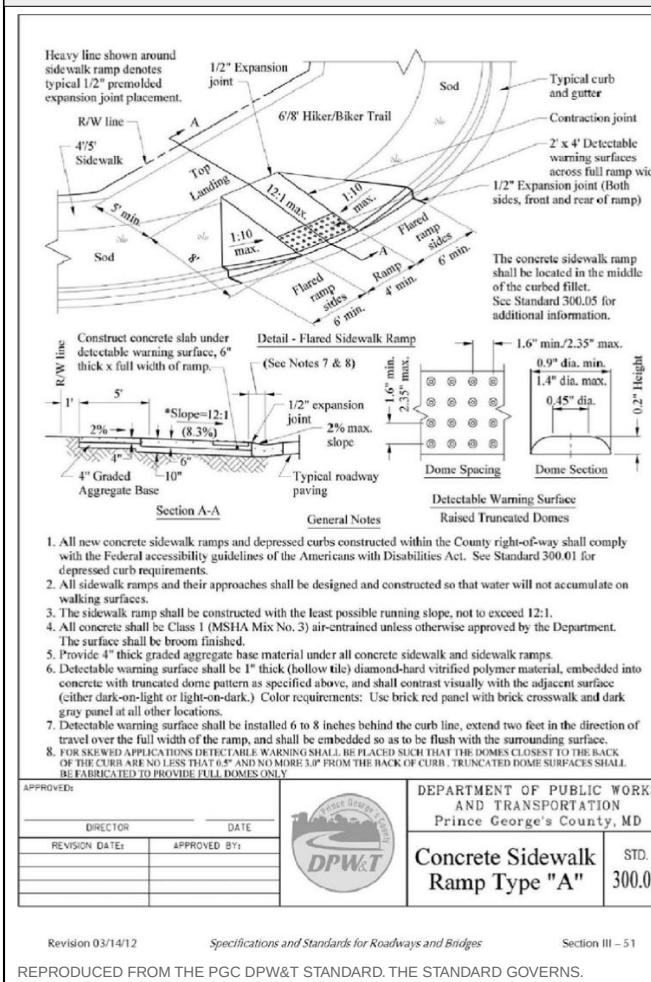


FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL. 61.09



GRAPHIC SCALE — 1" = 30'

0 30 60 90 120 FEET

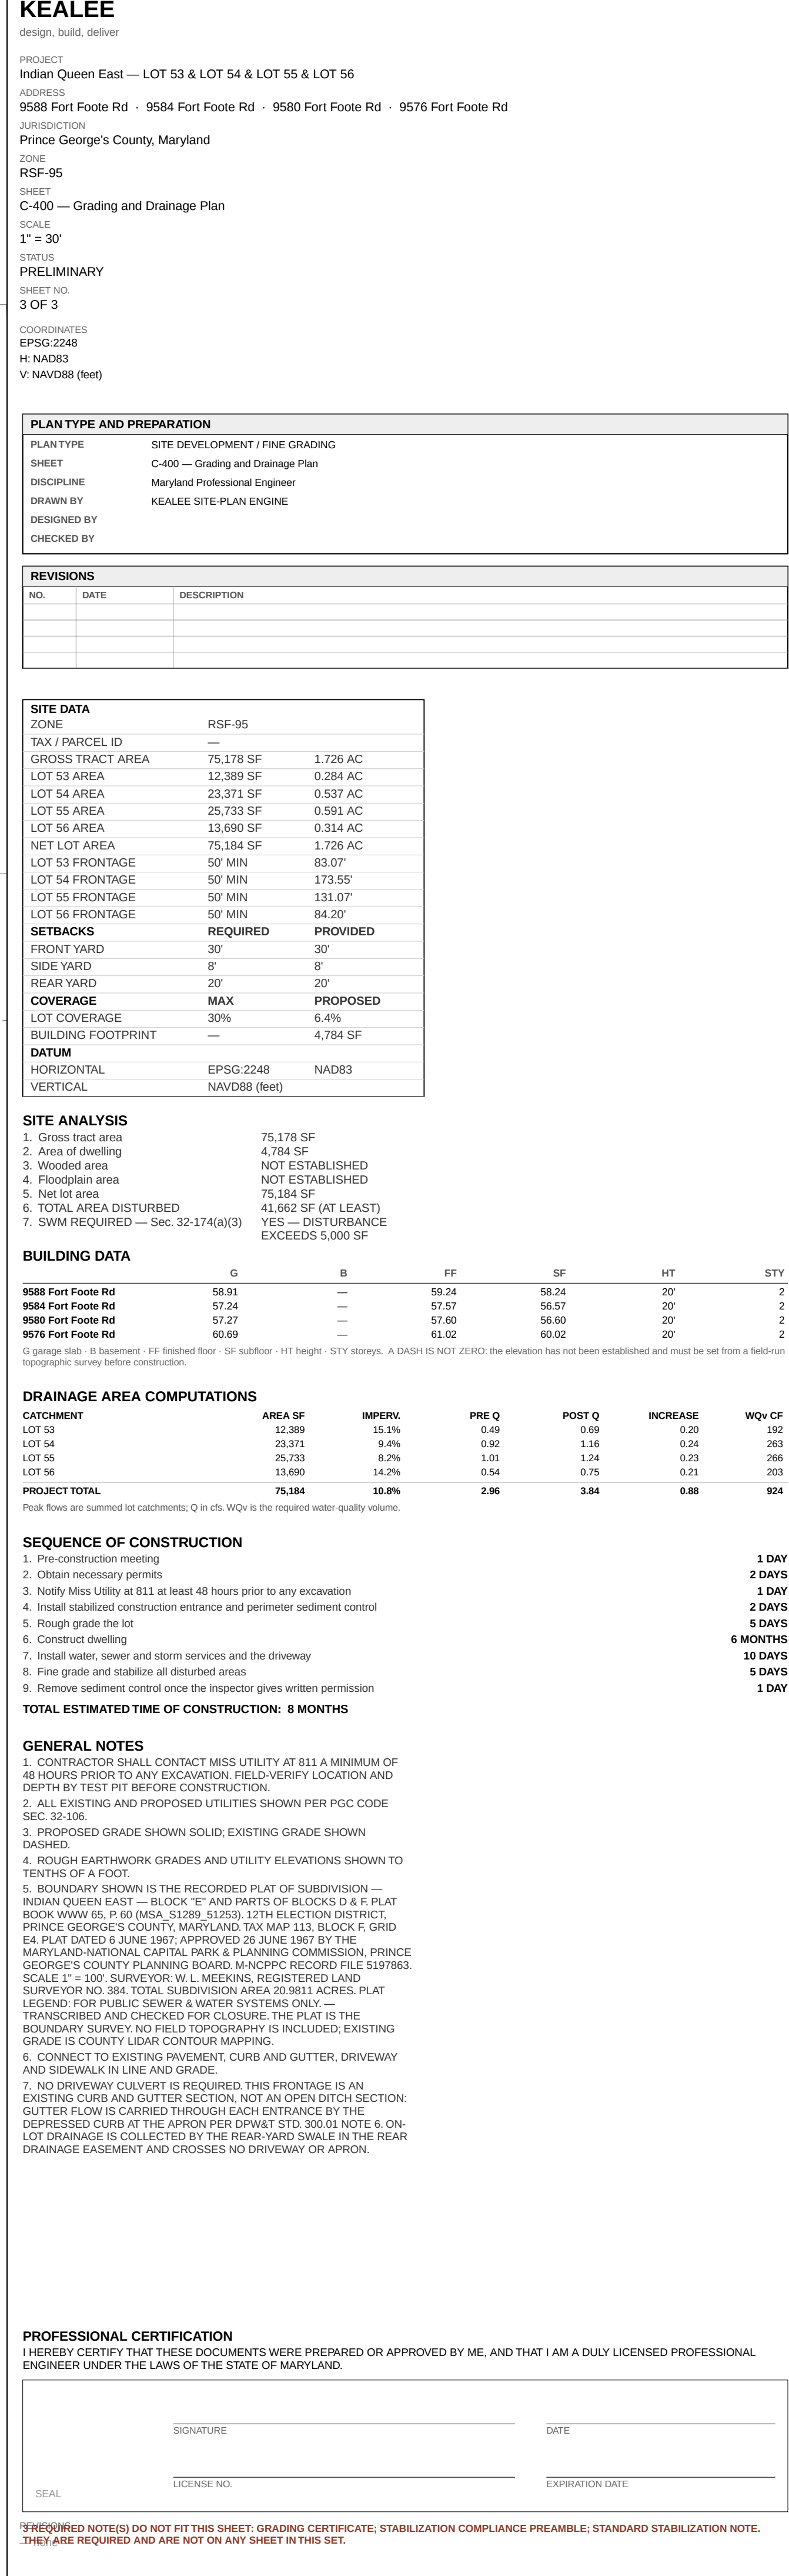

DRAINAGE SWALE SCHEDULE										Rational method, NOAA Atlas 14 : 2006 2.2.2(3) 0.041 : 2.7 bottom, 3.1 sides		LOT 239098 SE 29.95 SW 36.00 AC	
REACH	LENGTH	GRADE	D.A. (IAC)	10% (CFS)	10% (CFS)	DEPTH	10% (CFS)	INV IN	INV OUT	CUT			
ST1- ST2	110'	3.03%	0.2844	0.59	0.78	0.18'	1.73	50.20	46.90	1.0'			
ST2- ST3	157'	4.73%	0.3343	0.65	0.86	0.18'	2.33	50.30	52.50	1.0'			
ST3- ST4	177'	3.17%	0.9051	1.87	2.48	0.33'	2.51	52.50	46.90	1.0'			
GRADE CONTROL SCHEDULE													
POINT	LOT	DESCRIPTION				GROUND	SWALE INV						
ST1	LOT 53	Swale grade break / invert control				51.20	50.20						
ST2	LOT 54	Swale grade break / invert control				47.90	46.90						
ST3	LOT 55	Swale grade break / invert control				53.50	52.50						
ST4	LOT 56	Swale grade break / invert control				61.30	60.30						
OUT	—	Swale grade break / invert control				46.90	—						

CONCRETE SIDEWALK RAMP TYPE A – PGC DPW&T Std. 300.07

Plan View Details:

- Top Left:** "Here the above and below sidewalk surface is to be finished and finished 1" provided additional finish." (Note: The image contains a typo "1" which has been corrected to "1/2" in the transcription).
- Top Right:** "1/2" Expansion joint", "1/2" Half-Header Transition", "Soil", "Typical curb and gutter", "Concrete gutter".
- Left Side:** "R/W line", "4' Sidewalk", "1/2" Expansion joint", "1/2" Half-Header Transition", "Soil", "Typical curb and gutter", "Concrete gutter".
- Bottom Left:** "Concrete sidewalk slab under existing sidewalk surface, 4" thick", "1/2" Expansion joint", "1/2" Half-Header Transition", "Soil", "Typical curb and gutter", "Concrete gutter".
- Bottom Center:** "1/2" Expansion joint", "1/2" Half-Header Transition", "Soil", "Typical curb and gutter", "Concrete gutter".
- Bottom Right:** "1/2" Expansion joint", "1/2" Half-Header Transition", "Soil", "Typical curb and gutter", "Concrete gutter".

Elevation View Details:

- Top Left:** "1/2" Expansion joint", "1/2" Half-Header Transition", "Soil", "Typical curb and gutter", "Concrete gutter".
- Top Right:** "1/2" Expansion joint", "1/2" Half-Header Transition", "Soil", "Typical curb and gutter", "Concrete gutter".
- Bottom Left:** "1/2" Expansion joint", "1/2" Half-Header Transition", "Soil", "Typical curb and gutter", "Concrete gutter".
- Bottom Center:** "1/2" Expansion joint", "1/2" Half-Header Transition", "Soil", "Typical curb and gutter", "Concrete gutter".
- Bottom Right:** "1/2" Expansion joint", "1/2" Half-Header Transition", "Soil", "Typical curb and gutter", "Concrete gutter".

Notes:

1. All new concrete sidewalks and driveway curbs shall be finished with the G-Series 4000-1000 and comply with the Federal Accessibility Guidelines of the Transportation with Disabilities Act, No. November 1990 (ADA).
2. The concrete sidewalk shall be finished with the G-Series 4000-1000 and comply with the Federal Accessibility Guidelines of the Transportation with Disabilities Act, No. November 1990 (ADA).
3. The concrete sidewalk shall be finished with the G-Series 4000-1000 and comply with the Federal Accessibility Guidelines of the Transportation with Disabilities Act, No. November 1990 (ADA).
4. The concrete sidewalk shall be finished with the G-Series 4000-1000 and comply with the Federal Accessibility Guidelines of the Transportation with Disabilities Act, No. November 1990 (ADA).
5. The concrete sidewalk shall be finished with the G-Series 4000-1000 and comply with the Federal Accessibility Guidelines of the Transportation with Disabilities Act, No. November 1990 (ADA).
6. The concrete sidewalk shall be finished with the G-Series 4000-1000 and comply with the Federal Accessibility Guidelines of the Transportation with Disabilities Act, No. November 1990 (ADA).
7. The concrete sidewalk shall be finished with the G-Series 4000-1000 and comply with the Federal Accessibility Guidelines of the Transportation with Disabilities Act, No. November 1990 (ADA).
8. The concrete sidewalk shall be finished with the G-Series 4000-1000 and comply with the Federal Accessibility Guidelines of the Transportation with Disabilities Act, No. November 1990 (ADA).
9. The concrete sidewalk shall be finished with the G-Series 4000-1000 and comply with the Federal Accessibility Guidelines of the Transportation with Disabilities Act, No. November 1990 (ADA).
10. The concrete sidewalk shall be finished with the G-Series 4000-1000 and comply with the Federal Accessibility Guidelines of the Transportation with Disabilities Act, No. November 1990 (ADA).

REVISION DATE

APPROVED DATE

DEPARTMENT OF PUBLIC WORKS
PRINCE GEORGE'S COUNTY, MD

Concrete Sidewalk Ramp Type "A"

300.07

Revised 01/14/12 Specification for Standard and Grading Section W - 31

REPRODUCED FROM THE PGC DPW&T STANDARD, THE STANDARD GOVERNOR.

FIELD TOPOGRAPHIC SURVEY — EXISTING CONTOURS — SURVEYED — BM H31A EL. 61.09

100' 0' 1/4" 20' 0' 1/4" 30' 0' 1/4" 40' 0' 1/4" 50' 0' 1/4" 60' 0' 1/4" 70' 0' 1/4" 80' 0' 1/4" 90' 0' 1/4" 100' 0' 1/4"

REPRODUCED FROM THE FIELD TOPOGRAPHIC SURVEY THE SURVEY GOVERNS.

