

LOT COVERAGE ANALYSIS					LEGEND			INDEX OF DRAWINGS			GRADING CERTIFICATION		
LOT #	DRIVEWAY AREA (SF)	COVERED AREA (SF)	TOTAL AREA (SF)	LOT AREA (SF)	LOT COVERAGE (%)	ITEM	NEW	EXISTING	NO.	SHEET	TITLE	I hereby certify that this plan conforms to the requirements of Subtitle 32, Division 2 of the Code of Prince George's County (Water Resources Protection and Grading Code), and that drainage flows from uphill properties onto this site, and from this site onto downhill properties, have been addressed in substantial accordance with applicable codes. Signed, sealed and dated by a professional engineer licensed in the State of Maryland. SIGNATURE: _____ M.D.E. LICENSE NO. _____	
LOT 1	1013	2349	3362	19999	16.81	PROPERTY LINE	_____	_____	1	C-000	COVER SHEET		
LOT 2	021	2215	2215	22225	16.65		_____	_____	2	C-001	GENERAL NOTES AND DPIPE CHECKLIST		

ROADSIDE SWALE		
DRIVEWAY CULVERT		
ESD PRACTICE (M-6)		
DRAINAGE AREA		
LIMITS OF DISTURBANCE		
SILT FENCE		
SOIL BOUNDARY		
STREET TREE		
STREET LIGHT		
SPOT ELEVATION		

OWNER / DEVELOPER
 GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L32062 F.043)

ESTATES AT
 SITE DEVELOPMENT
 LOTS 1 THRU 6
 PLAT BOOK PM 225 PLAT
 OWNER: GERALD WALDMAN REVOCABLE TRUST

[illegible]


COVER SHEET		TITLE:
C-000		

CONCEPT SUBMISSION 1 — NOT SEALED

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Expiration date: _____

SEAL

[illegible]

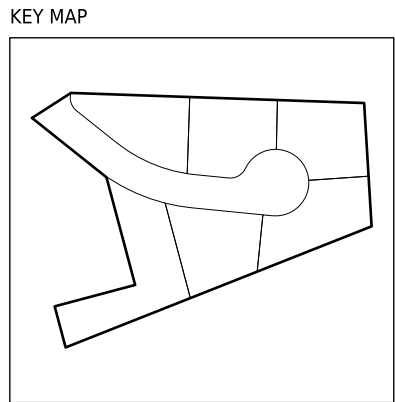

GENERAL NOTES AND DPIE CHECKLIST

SITE DATA

ITEM	DATA
Project	Estates at Indian Head, Lots 1-6 and Estates Court
Location	S. side of MD 210, ±3,000 ft NE of MD 210 / MD 373; 200-205 Estates Ct, Accokeek 20607
Record	Plat Book PM 228 Plat 83 (final plat 5-08238); Tax Map 151 F-3; WSSC 200' 220SE01
Accounts	3987666, 3987674, 3987682, 3987690, 3987708, 3987716
Owner	Gerald Waldman Revocable Trust, L 32062 F.043
Zone / use	RR (no change) — 6 single-family detached dwellings
Tract	165,019 sf of record (3.788 ac) = plat 171,505 sf less Outlot A (6.486 sf, conveyed L 51565 F.455)
Public dedication	Estates Court 60' R/W, 35,173 sf of record — rural open section, 24' pavement, cul-de-sac
Water / sewer	W-3 / S-3 (WSSC) — mains from Henrietta Dr via 30' WSSC esmt L 51799 F.399 and prop. Lot 4 esmt
Watershed	Piscataway Creek, MD 021402030798; not Tier II; not CBCA; FEMA Zone X
Master plan	2013 Subregion 5 Master Plan & SMA; Planning Area 84; Council Dist. 9; Election Dist. 5
Datum	NAD 83 MD State Plane (US ft); NAVD 88 (M-NCPPC 2-ft); spot grades on WSSC datum

APPROVALS OF RECORD

CASE	STATUS
NRI-015-06	Prior approval — base work; updated NRI required
TCP1-018-06	Prior approval — base work
TCP2-016-09	Prior approval — base work; revision or new TCP per M-NCPPC
5-08238	Final plat, PM 228 @ 83 — recorded
L 51799 F.399	30' WSSC easement (Outlot A, Lot 20) — recorded 2025

GENERAL NOTES

- Boundary per recorded plat PM 228 @ 83; lot lines reproduce the plat to the second.
- Horizontal datum: Maryland State Plane NAD 83 (US ft). Vertical datum: NAVD 88 (M-NCPPC 2-ft contours). Spot grades are on WSSC datum (= NAVD 88 + 1.6 ft). DPIE prefers NGVD 29.
- Six single-family dwellings with side-load garages and courts, street trees and street lights, laid out to current requirements. Lot 4 is front-load (garage to the cul-de-sac) to clear the WSSC easement.
- Estates Court is a rural open section (DPW&T Std. 500.10 / 600.02 / 600.04): 24' pavement, shoulders, roadside swales; driveways cross the swale on 15" RCP culverts with flared end sections.
- Entrance to MD 210 (SHA) with 50' returns; SHA access permit and sight-distance analysis required. MD 210 auxiliary lanes shown for SHA review; R/W dedication may be required.
- Water and sewer: WSSC mains from Henrietta Dr through the recorded 30' WSSC easement (L 51799 F.399) and a 30' WSSC easement to be granted across Lot 4. Record discrepancies in the easement description to be resolved with WSSC.
- NEW SUBMITTAL (2026). Prior approvals NRI-015-06, TCP1-018-06 and TCP2-016-09 are used as base work only and do not carry this submittal. Additional work: an updated/revision NRI (draft with this submission, approved copy before concept approval, Sec. 32-182(a)); a TCP2-016-09 revision or new TCP / letter of exemption as M-NCPPC Environmental Planning determines; street trees and lighting reviewed to current DPW&T/DPIE standards; SWM by ESD to the MEP under current Subtitle 32.
- No environmental features on the property: no streams, stream buffers, wetlands, floodplain, PMA, steep slopes, woodland, highly erodible soils or Chesapeake Bay Critical Area.
- Contact Miss Utility (811) at least 48 hours before any excavation.

DPIE CONCEPT PLAN DESIGN REVIEW CHECKLIST (08/25/2021) — C = SHOWN · X = N/A · O = OUTSTANDING

ITEM	REQUIREMENT	REF.	C/X/O	RESPONSE / WHERE SHOWN	SHEET
A-1	Plan is labeled as Site Development Concept Plan (aka Concept Plan from MDE Step 1)		C	Every sheet is titled SITE DEVELOPMENT CONCEPT PLAN.	ALL
A-2	Plan sheet size does not exceed 30" x 42" and all sheets are printed on same size paper.	5.3.2	C	All sheets 24" x 36" (ARCH D).	ALL
A-3	A 5-inch, full-height open area is provided on the right-hand side of the drawing for County approval block.	2.2.1.A	C	5-inch full-height strip at the right edge, kept clear for DPIE.	ALL
A-4	If more than 4 plan sheets, composite plan showing match lines and sheet numbers (scale not to exceed 1"=200'); key map on each plan sheet.	2.2.1.O	C	9 sheets; the whole site is on each plan sheet at one scale, so no match lines; key map in every tie block.	ALL
A-5	Match lines have a minimum length of 4 inches and identify the matching sheet number.	2.2.1.M	X	No match lines — the entire site fits one viewpoint.	
A-6	Vicinity map at a minimum scale of 1" =2,000' with north arrow and scale, upper right hand corner of cover sheet.	2.2.1.B	C	Vicinity map at 1" = 2,000' with north arrow and bar scale, upper right.	C-000
A-7	A bar scale is provided on every sheet.		C	Graphic bar scale in every plan viewpoint.	ALL
A-8	Three grid ticks are provided as described in the manual.	2.2.1.E	C	Three State Plane grid ticks with N/E values on each plan.	C-200
A-9	Horizontal (MD Coordinate System, NAD 83) and vertical (NGVD 29 preferred) datum is stated on the plan.		C	Horizontal Maryland State Plane, NAD 83 (EPSG 2248), US ft; vertical NAVD 88 (M-NCPPC 2-R); spot grades WSSC datum as noted.	ALL
A-10	General notes about the project are provided.		C	General notes on C-001.	C-001
A-11	The entire property is shown at a maximum plan scale of 1 inch = 50 feet (preferred) within the plan set.	5.3.2	C	Entire property at 1" = 30'.	C-200
A-12	All existing structures and site features including cultural features, historic sites and easements, and any visible foundations or ruins are shown.	5.3.2	C	Existing structures, adjoining houses, fences, sheds, well, easements of record shown; no historic sites or ruins.	C-100
A-13	Topographic contours at maximum 2 foot interval, extending at least 100 feet beyond the property.	32-182 C	C	M-NCPPC 2-ft contours, 100 ft beyond the property.	C-100
A-14	All existing utilities and utility easements are shown.		C	WSSC easement L 51799 F.399 and the proposed Lot 4 WSSC easement; public utility easements along the frontage; existing mains in Henrietta Dr noted (sizes to verify on WSSC 220SE01).	C-300
A-15	The County BMP Summary Table is provided. Preferred location is on the cover sheet.	5.3.1	C	County BMP Summary Table, 7 practices.	C-000
B-1	Banks of all regulated streams or a centerline if the banks are too close together to graphically show.	MDE 5.7	X	No streams on site. New submittal: prior NRI-015-06 (with TCP1-018-06, TCP2-016-09) is base work only. Updated/revision NRI to be provided in draft with this submission, approved copy required before concept approval (Sec. 32-182(a)).	
B-2	Location of stream and stream buffers and/or enhanced buffers per MNCPPC and SCD criteria.	MDE 5.7	X	No streams, no stream buffers.	
B-3	Location of wetlands and/or wetlands of special state concern and appropriate wetland buffers.	MDE 5.7	X	No wetlands on or within 100 ft (DNR; NRI).	
B-4	Delineation of the 100-year floodplain, per Techno-Gram 004-2020.	MDE 5.7	X	FEMA Zone X; no 100-yr floodplain on or within 100 ft.	
B-5	Location of steep slopes (15% and greater) clearly shown on the plan and in the legend.	M-NCPPC X	C	No steep slopes (15% and greater) on the property.	
B-6	The Primary Management Area is delineated.	MDE 5.7	X	No PMA on the property.	
B-7	Existing woodland is delineated on the property.	MDE 5.7	X	No existing woodland on the property.	
B-8	Existing environmental features extend off the property 100 feet in all directions.	MNCPPC X	C	No environmental features on or within 100 ft of the property.	
B-9	Soils types and soil boundaries from USDA NRCS Soil Survey (Dec. 2009 or latest).		C	Soil types and boundaries from USDA NRCS (PGAtlas Soil layer): CwE (HSG C); UdaF (HSG —); BaB (HSG C); BuB (HSG C).	C-100
B-10	Plan notes identify TMDL watershed (sediment, nitrogen, phosphorus) and Tier II waters/watershed.		C	Chesapeake Bay TMDL (nitrogen, phosphorus, sediment) applies; MD 12-digit watershed 021402030798, Piscataway Creek (02140203). Tier II; no.	C-001
B-11	Highly erodible soils noted.	MDE 5.7	X	No highly erodible soils on the property.	
B-12	Springs and seeps noted.	MDE 5.7	X	None observed or mapped.	
B-13	Bedrock and Marlboro Clay outcrops noted.	MDE 5.7	X	No bedrock or Marlboro clay mapped (PGAtlas); geotechnical report per E-2.	
B-14	Chesapeake Bay Critical Areas delineated.	MDE 5.7	X	Not in the Chesapeake Bay Critical Area.	

CHECKLIST (CONT.)

ITEM	REQUIREMENT	REF.	C/X/O	RESPONSE / WHERE SHOWN	SHEET
C-1	Project layout is shown, including roads, buildings, parking, sidewalk and other improvements and associated grading.	32-182	C	Estates Court, 6 dwellings, driveways and courts, entrance at MD 210, grading.	C-200
C-2	Preliminary locations of ESD and structural stormwater practices; grading for devices where slopes exceed 15%.	32-182	C	7 ESD practices (micro-bioretentation M-6 per lot; roadside dry swales M-8).	C-400
C-3	Preliminary locations of storm drain inlets and culverts; entrance and outfall structures located beyond project limits (easements may be required).	5.2.4.4.2B / 32-162.A.6	C	Open section — no inlets; 6 driveway culverts (15" RCP) with end sections; swales outfall at the entrance to the MD 210 roadside ditch (SHA).	C-400
C-4	Limit of Disturbance shown for all site work, incl. water, sewer, storm drain, SWM, road improvements, sediment control, stockpile.	32-182	C	LOD 22,365 sf incl. mains, easement work off site, sediment control and stockpile.	C-500
C-5	Existing easements shown and any required offsite proposed easements.		C	Recorded WSSC easement (Outlot A, Lot 20) and proposed Lot 4 WSSC easement; private SWM easements over ESD practices.	C-300
C-6	Locations, names and widths of existing and ultimate rights-of-way of adjacent streets and alleys; public vs. private noted.		C	MD 210 (variable R/W, SHA), Estates Ct (60' public), Henrietta Dr and Jennifer Dr (50' public), 30' R/W in common L 10142 F.725 (private).	C-200
C-7	Existing and proposed water well and septic field locations are shown.		C	No wells or septic proposed (public water and sewer). Existing well on Parcel 199 (15608 Indian Head Hwy), off site, shown.	C-100
C-8	Proposed public dedication area including any proposed parkland is shown and labeled.		C	Estates Court public dedication 36,041 sf (plat PM 228 @ 83); no parkland.	C-200
C-9	Point(s) of investigation shown; ESDv computations and BMP Summary Table broken out to show ESD Required is Provided within each POI.		C	1 POI(s); ESDv required vs. provided tabulated per POI.	C-400
C-10	The ultimate 100-year stormwater overflow path is shown throughout the site using flow arrows.		C	100-yr overflow arrows from every practice to its POI (11).	C-400
C-11	Drainage areas to each device, offsite drainage onto the site, and to site outfalls; diverted areas analysed for no increase in 100-yr discharge.		C	Drainage area to each practice; off-site area onto the site 0.48 ac; no diversion between POIs.	C-400
C-12	Where grading blocks a drainage course, ponding limits before and after grading are shown.		X	No fill across a drainage course.	
D-1	Report addresses natural resource protection, natural flow patterns, impervious reduction, ESC, integration, ESD planning to the MEP.	MDE 5.11	C	SWM concept narrative: natural resources, natural flow patterns, impervious reduction, ESD to the MEP, ESC integration.	C-410
D-2	If in the Chesapeake Bay Critical Area, discussion of how requirements are met; preliminary computations.		X	Not in the Chesapeake Bay Critical Area.	
D-3	Outfalls located outside the site, to existing storm drain or 100-yr floodplain; otherwise the discharge area is described.		C	Outfall at each POI and the receiving area described.	C-410
D-4	Stabilization at downstream outfall and upstream inflow evaluated; measures against gully formation discussed.		C	Outfall velocity checked at the 10- and 100-yr flows; rock outlet protection at each POI; upstream inflow evaluated.	C-410
D-5	Photographs of the stream at the downstream outfall and upstream property line; eroded slopes.		X	No stream at the outfalls.	
D-6	If outfall is to an existing SWM facility, its capacity for the added area and flow is documented.		X	No existing SWM facility receives the site.	
D-7	If rezoned to higher imperviousness, effects on downstream properties analysed.		X	No rezoning (IRR remains RRR).	
D-8	Floodplain ordinance discussion (drainage courses, buildings within 25 ft of floodplain, dams, downstream crossings).		X	No floodplain or drainage course on or downstream within the site; no dams.	
D-9	If a waiver of water quality or quantity is requested, the basis is provided.		X	No waiver requested.	
D-10	Computations: ESDWOv required and provided; 100-yr existing and proposed runoff; downstream storm drain analysis with 10-yr control, if inadequate.	5.3.3 / 5.2.6.1 / 5.2.4.2 / TG 002-2019	O	ESDv per POI on the cover; 100-yr existing vs. proposed runoff at each POI on C-410. Outstanding: downstream adequacy analysis at technical design.	C-410
E-1	A Geotechnical Report for SWM is provided to support concept development and feasibility.	5.3.3 / TG 004-2018	O	Geotechnical report for SWM (borings and Sec. 32-131 infiltration tests at each practice) — to be submitted.	
E-2	Geotechnical Report addresses Marlboro and Christiansa clays, sulfidic and diatomaceous soils.	5.3.3 / TG 005-2018 / PGSCD I-8	O	Geotechnical report to address Marlboro/Christiansa clays, sulfidic and diatomaceous soils.	
E-3	Affidavit of Public Informational mailing is provided with second submission.	32-182(g)	O	Affidavit of the adjacent-owner mailing (within 7 days of submittal) — with second submission.	
E-4	A draft Natural Resource Inventory is provided with initial submission (approved copy required prior to approval).	32-182(a)	O	New submittal: prior NRI-015-06 (with TCP1-018-06, TCP2-016-09) is base work only. Updated/revision NRI to be provided in draft with this submission; approved copy required before concept approval (Sec. 32-182(a)).	

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Expiration date: _____



CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

ESTATES AT INDIAN HEAD
SITE DEVELOPMENT CONCEPT PLAN
LOTS 1 THRU 6 & ESTATES COURT

PLAT: 200-205 ESTATES COURT, ACCOKEEK, MD 20607
OWNER: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER AVE., WEST PALM BEACH, FL 33401 (L 32062 F.453)

W.L. MEEKINS, INC.
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115
PREPARED WITH KEALE SPATIAL ENGINE / CAD-LDT

REVISIONS

DATE

DESCRIPTION

CONCEPT SUBMISSION 1

DATE

FILE

GENERAL NOTES AND DPIE CHECKLIST

C-001

DATE: 2026-09-30

SCALE: AS NOTED

DRAWN:


DESIGNED:

CHECKED:

SHEET: 2 OF 9

EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES

- LEGEND
- Boundary of record (plat PM 228 @ 83)
 - Lot line
 - Adjoining property
 - Existing contour, 10-ft (NAVD 88)
 - Existing contour, 2-ft
 - Existing edge of road
 - Existing right-of-way
 - Soil boundary (USDA NRCS)
 - Easement

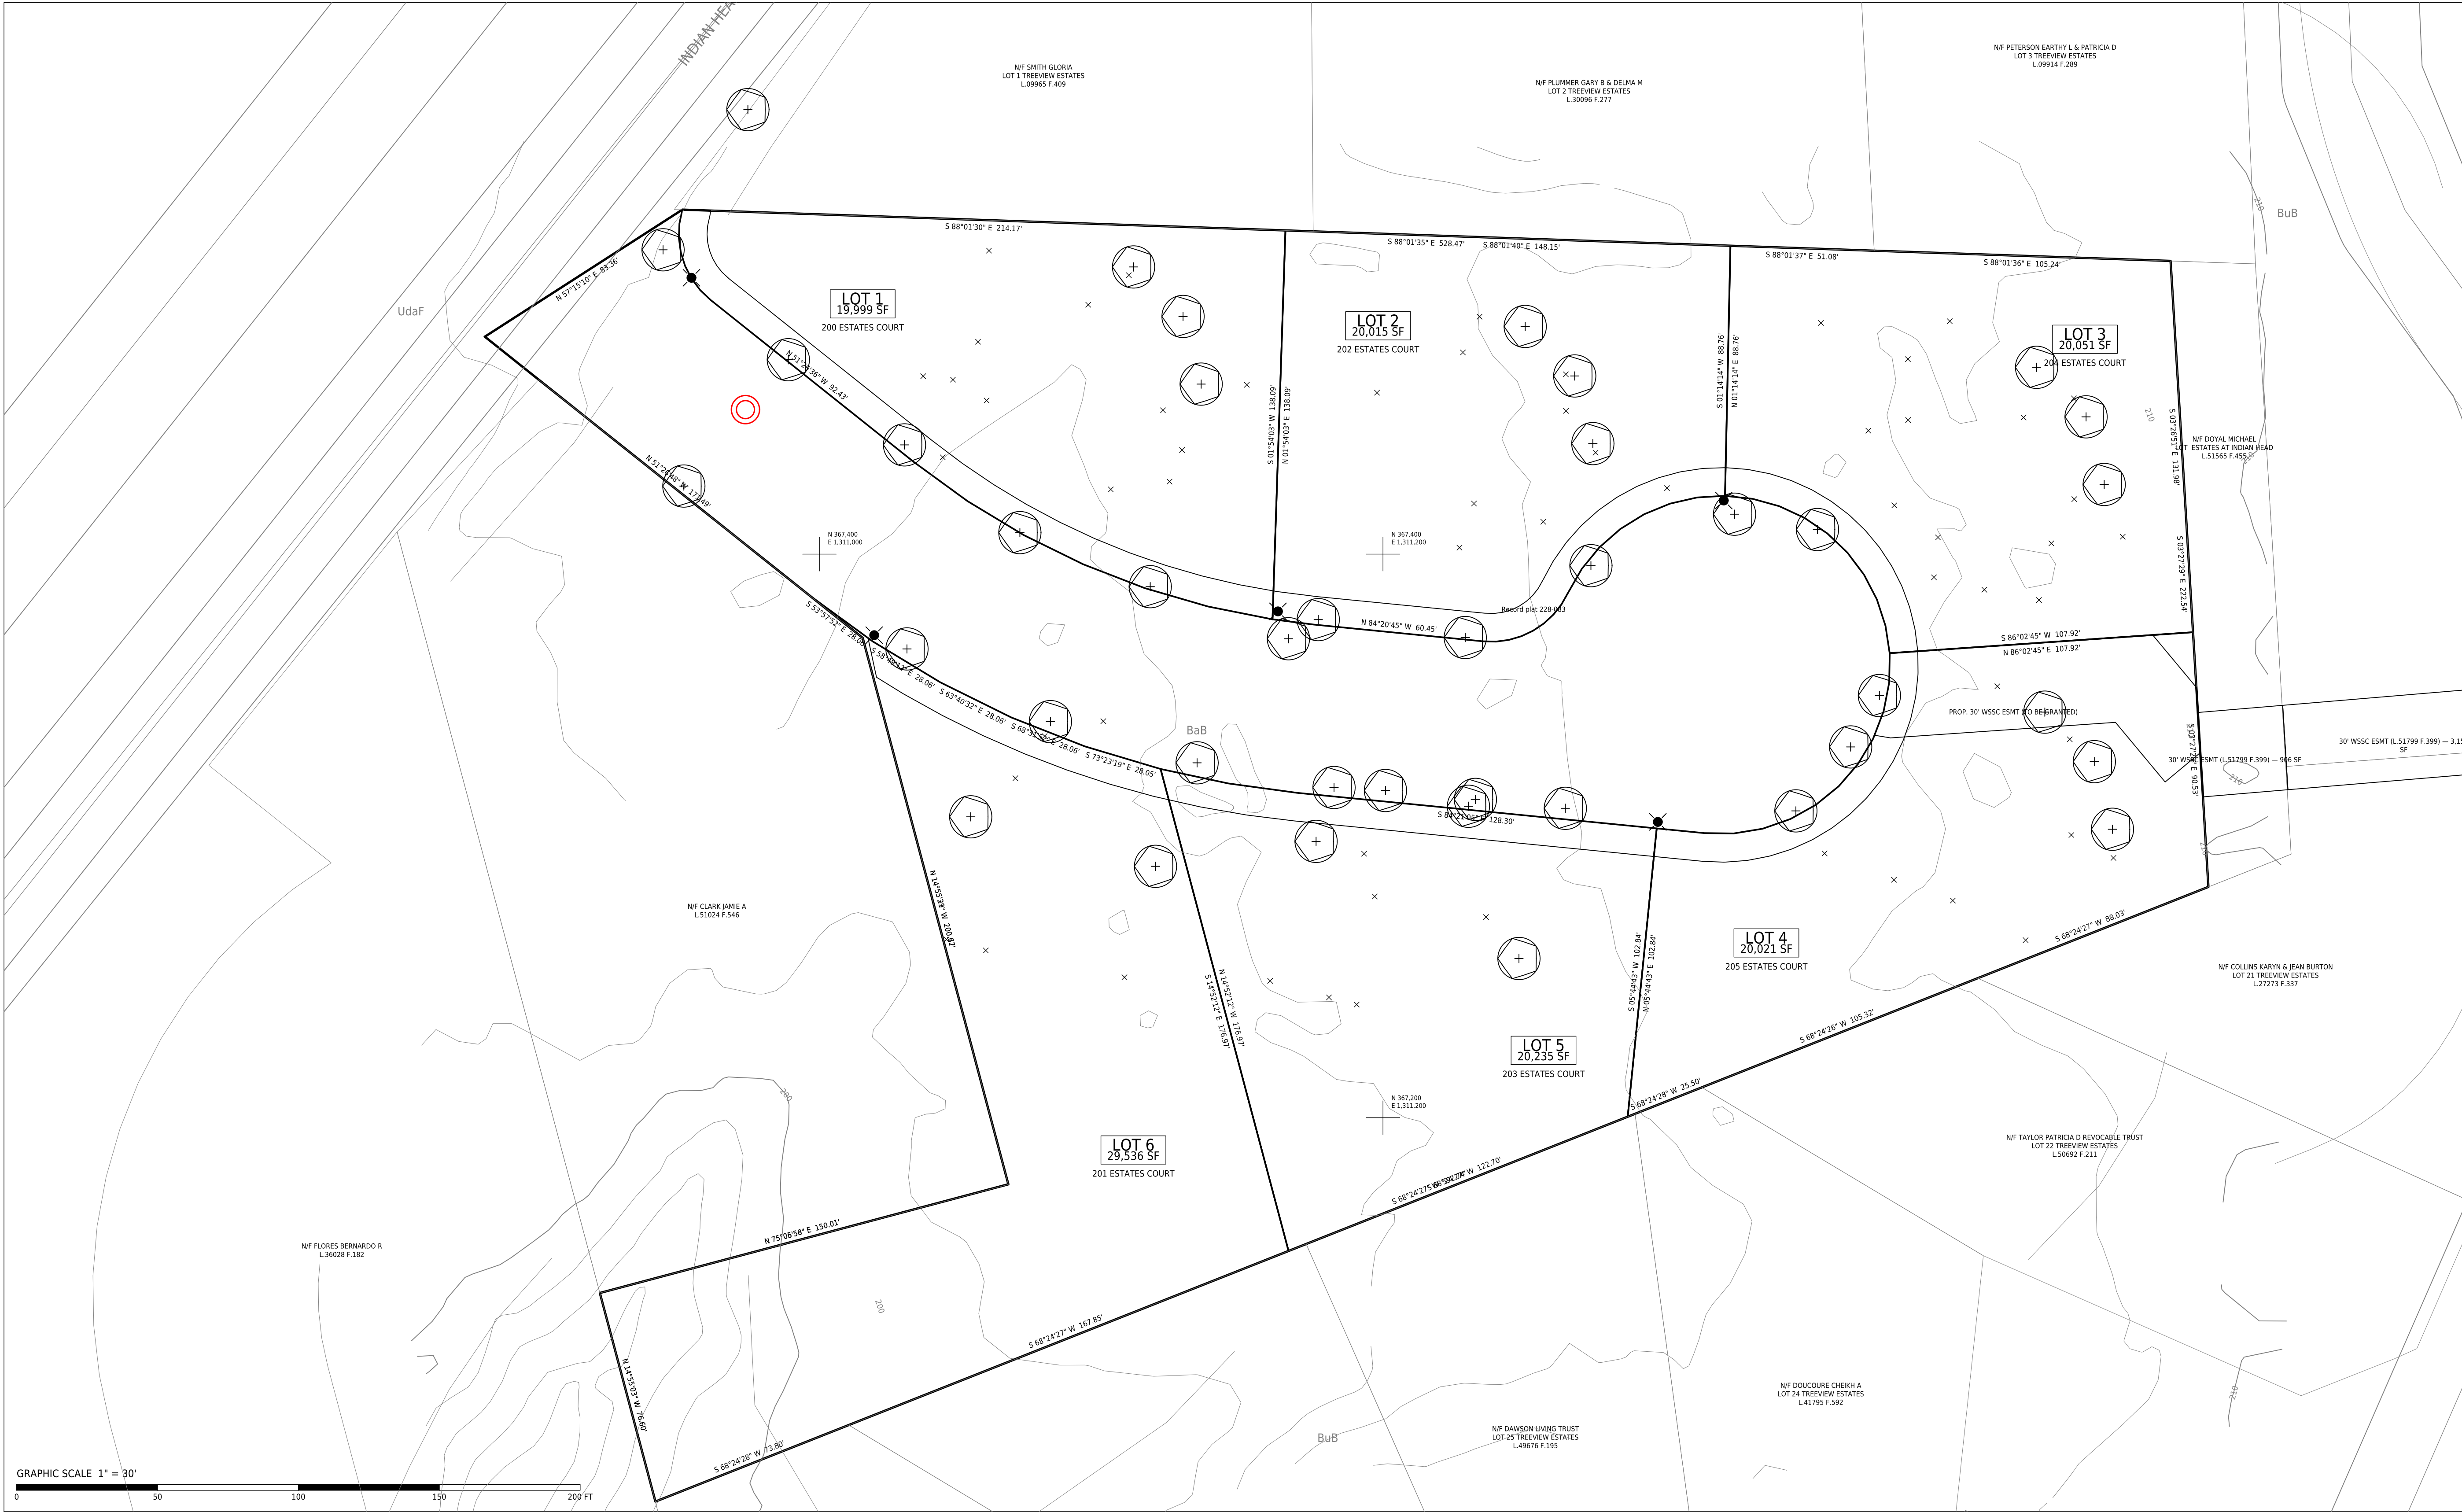

SOILS (USDA NRCS)

SYMBOL	NAME	HSG	K	HIGHLY ERODIBLE
CwE	Croom-Marr complex, 15 to 25 percent slopes	C	.15	NO
UdaF	Udorthents, highway, 0 to 65 percent slopes	—	—	NO
BaB	Beltsville silt loam, 2 to 5 percent slopes	C	.37	NO
BuB	Beltsville-Urban land complex, 0 to 5 percent slopes	C	.37	NO

ENVIRONMENTAL FEATURES — DPIE CHECKLIST B

ITEM	CXID	FINDING
B-1	X	No streams on site. New submittal: prior NRI-015-06 (with TCP1-018-06, TCP2-016-09) is base work only. Updated/revised NRI to be provided in draft with this submission; approved copy required before concept approval (Sec. 32.182(a)).
B-2	X	No streams, no stream buffers.
B-3	X	No wetlands on or within 100 ft (DNR; NRI).
B-4	X	FEMA Zone X; no 100-yr floodplain on or within 100 ft.
B-5	X	No steep slopes (15% and greater) on the property.
B-6	X	No PMA on the property.
B-7	X	No existing woodland on the property.
B-8	X	No environmental features on or within 100 ft of the property.
B-9	C	Soil types and boundaries from USDA NRCS (PGAtlas Soil layer); CwE (HSG C); UdaF (HSG —); BaB (HSG C); BuB (HSG C).
B-10	C	Chesapeake Bay TMDL (nitrogen, phosphorus, sediment) applies; MD 12-digit watershed 021402030798, Piscataway Creek (02140203). Tier II: no.
B-11	X	No highly erodible soils on the property.
B-12	X	None observed or mapped.
B-13	X	No bedrock or Marlboro clay mapped (PGAtlas); geotechnical report per E-2.
B-14	X	Not in the Chesapeake Bay Critical Area.

MISS UTILITY NOTE

Information concerning existing underground utilities was obtained from available records. The contractor must field verify the exact locations and elevations as required for applicable horizontal and vertical clearances by digging test pits by hand, well in advance of excavation. Contact "Miss Utility" at 1-800-251-7777 (811), 48 hours prior to the start of any excavation. Provide results of test pits to the design engineer and coordinate with the engineer, owner/developer and utility company before proceeding with construction to resolve any conflicts or clearances with other utilities, storm drains, grading or other improvements.

STABILIZATION NOTE

Stabilization practices on all projects must be in compliance with the requirements of COMAR 26.17.01.08-G. Following initial soil disturbance or re-disturbance, permanent or temporary stabilization must be completed within: three (3) calendar days as to the surface of all perimeter dikes, swales, ditches, perimeter slopes and all slopes steeper than 3 horizontal to 1 vertical (3:1); and seven (7) calendar days as to all other disturbed or graded areas on the project site not under active grading.

OWNER / DEVELOPER

GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L.32062 F.043)

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Expiration date: _____

CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL

5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

REVISIONS

DATE	DESCRIPTION
2024-09-30	CONCEPT SUBMISSION 1

TITLE

EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES

C-100

DATE: 2026-09-30

SCALE: 1" = 30'


SHEET: 3 OF 9

W.L. MEEKINS, INC.
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115
PREPARED WITH KEALEE SPATIAL ENGINE / CAD-PLOT

ESTATES AT INDIAN HEAD
SITE DEVELOPMENT CONCEPT PLAN
LOTS 1 THRU 6 & ESTATES COURT

200-205 ESTATES COURT, ACCOKEEK, MD 20607
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE BR
PLAT L.32062 F.043, L.32062 F.044, L.32062 F.045
OWNER: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L.32062 F.043)

KEY MAP

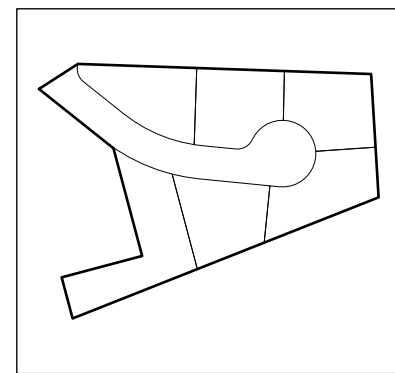

- Boundary of record
- Estates Ct right-of-way
- Proposed pavement
- Roadside swale (flowline)
- Roadway culvert, 15" RCP w/ end sections
- Proposed dwelling
- Building restriction line
- Proposed contour
- Existing contour
- Spot elevation (WSSC datum)
- - - Limit of disturbance
- MD 210 auxiliary lane (SHA)



LOT	ADDRESS	FOOTPRINT SF	GARAGE	FF (NAVD 88)	B (NAVD 88)
LOT 1	200 ESTATES COURT	2349		206.47	197.47
LOT 2	202 ESTATES COURT	2325		208.01	199.01
LOT 3	204 ESTATES COURT	2313		210.03	201.03
LOT 4	205 ESTATES COURT	1902		208.32	199.32
LOT 5	203 ESTATES COURT	2408		206.00	197.00
LOT 6	201 ESTATES COURT	2333		206.23	197.23

1. Boundary per recorded plat PM 228 @ 83; lot lines reproduce the plat to the second.
2. Horizontal datum: Maryland State Plane NAD 83 (US ft). Vertical datum: NAVD 88 (M-NCPPC 2-ft contour). Spot grades are on WSSC datum ($\approx$ NAVD 88 + 1.6 ft). DPIPE prefers NGVD 29.
3. Single-family dwellings with side-lawn garages and courts, street trees and street lights, laid out to current regulations. Lot 4 is front-lawn (garage to the cul-de-sac) to clear the WSSC easement.
4. Entries at a single rural section (DPIPE SD 500 10' 600 02' 24' perimeter, shoulders, roadside swales; driveways cross the swale on 15' R/W culverts to clear wet sections).
5. MD 210 (MD 504) with 50' returns; SHA access to the 50' right-of-way distance alignment. MD 210 auxiliary lane shown for dedication. R/W dedication may be required.
6. MD 210 frontage improvements are shown for SHA review. At the entrance the MD 210 R/W line lies about 6 ft off the edge of road, so a 12-ft lane needs R/W dedication along Lots 1 and 6 or SHA agreement. Lane lengths and tapers are set by SHA's access-permit review and traffic study.

Information concerning existing underground utilities was obtained from available records. The contractor must field verify the exact locations and depths as required for applications for horizontal and vertical clearances by digging test pits by hand, well in advance of excavation. Contact "Miss Utility" at 1-800-257-7777 (811), 48 hours prior to the start of any excavation. Provide results of test pits to the design engineer and coordinate with the engineer, owner/developer and utility company before proceeding with construction to resolve any conflicts or clearances with other utilities, storm drains, grading or other improvements.

Stabilization practices on all projects must be in compliance with the requirements of COMAR 26.17.01.08 G. Following initial soil disturbance or re-disturbance, permanent or temporary stabilization must be completed within: three (3) calendar days as to the surface of all perimeter dikes, swales, ditches, perimeter slopes and all slopes steeper than 3 horizontal to 1 vertical (3:1); and seven (7) calendar days as to all other disturbed or graded areas on the project site not under active grading.

OWNER / DEVELOPER
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L.32062 F.043)

CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

SEA

ESTATES AT INDIAN HEAD

SITE DEVELOPMENT CONCEPT PLAN

LOTS 1 THRU 6 & ESTATES COURT

REVISIONS	
DATE	DESCRIPTION
2026-09-30	CONCEPT SUBMISSION 1

TITLE: SITE LAYOUT, GRADING AND PAVING PLAN

DATE:	2026-09-30
SCALE:	1" = 30'
SHEET:	4 OF 9

W.L. MEEKINS, INC.
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115
PREPARED WITH KEALEE SPATIAL ENGINE / CAD-PILOT

- Proposed 8" water main
- Proposed 8" sanitary sewer
-  1" water house connection (W.H.C.)
- 4" sewer house connection (S.H.C.)
- WSSC easement (recorded / proposed)
-  Street tree — Red Maple
- Street light



SYMBOL	QTY	ITEM	SIZE / TYPE	STANDARD
TREE	16	ACER RUBRUM — RED MAPLE	2 1/2"-3" CAL., B&B	DPW&T 600.02 / 600.04
LIGHT	5	STREET LIGHT (SMECO)	100 W HPS COLONIAL POST-TOP, TYPE IV, BLACK FIBERGLASS	DPW&T 500.10

1. Water and sewer by WSSC (W-3 to S-3). Mains from the existing WSSC mains in Henriette Drive through the recorded 30" WSSC easement (L51799 to F399, Outfall and Lot 20) and a 30" WSSC easement on the south side of Henriette Drive.
2. The 8" water and 8" sewer mains stop just past the Lot 1 east property line, at the Lot 6 tap (15 ft past the Lot 5 / Lot 6 front corner); water capped with a blow-off, sewer at a terminal manhole. No main runs on toward MD 210; Lot 1 connects at the end of the mains.
3. Sizes and Inverts of the Henriette Drive mains per WSSC 2007 sheet 2205E01.
4. Street lights and street trees per DPW&T Std. 500.10, 600.02 and 600.04; electric service by SMECO.
5. Keep street trees 10 ft from water meters and storm structures and 15 ft from street lights (DPW&T 600.02).
6. House connections: 1" copper water service and 4" PVC sewer lateral per lot, each tapped on its own main and run to the dwelling clear of every driveway, apron, walk, stoop, culvert and ESD cell (3 ft min.), so no concrete or structure is removed to lay or repair them; water and sewer 10 ft apart (WSSC).
7. The 10" Lot 1 sewer and 8" sewer in a COMMON TRENCH (no 10-ft corridor clear of the piping) — water on a shelf 12 ft above the sewer, subject to WSSC approval at plumbing permit; otherwise relocate the lead walk.

Information concerning existing underground utilities was obtained from available records. The contractor must field verify the exact locations and elevations as required for horizontal and vertical clearances by digging test pits and hand well advances of excavation. Contact "Mass Utility" at 1-800-257-7777 (811), 48 hours prior to the start of any excavation. Provide results of test pits to the design engineer and coordinate with the engineer, owner/developer and utility company before proceeding with construction to resolve any conflicts or clearances with other utilities, storm drains, grading or other improvements.


Stabilization practices on all projects must be in compliance with the requirements of COMAR 26.17.01.08 G. Following initial soil disturbance or re-disturbance, permanent or temporary stabilization must be completed within: three (3) calendar days as to the surface of all perimeter ditches, swales, ditches, perimeter slopes and all slopes steeper than 3 horizontal to 1 vertical (3:1); and seven (7) calendar days as to all other disturbed or graded areas on the project site not under active grading.

OWNER / DEVELOPER
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH,
FL 33401 (L.32062 F.043)

I hereby certify that these documents were prepared or approved by me
and that I am a duly licensed professional engineer under the laws of
the State of Maryland. License No. _____ Expiration date: _____

CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)



W.L. MEEKINS, INC.
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 • 301-736-7115
PREPARED WITH KEALEE SPATIAL ENGINE / CAD-PILOT

ESTATES AT INDIAN HEAD

SITE DEVELOPMENT CONCEPT PLAN

LOTS 1 THRU 6 & ESTATES COURT

PLAT BOOK PM 228 PLAT 83 · TAX MAP 151 F-3 · WSSC 2205E01
OWNER: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33400

PLAT BOOK PM 228 PLAT 83 · TAX MAP 151 F-3 · WSSC 220SE01
OWNER: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L-32062 F.043)

REVISIONS	
DATE	DESCRIPTION
2026-09-30	CONCEPT SUBMISSION 1


UTILITY, STREET LIGHT AND STREET
TREE PLAN
C-300

C-300

DATE:	2026-09-30
SCALE:	1" = 30'
SHEET:	5 OF 9
DRAWN BY:	
DESIGN:	
CHECKED:	

STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP

- LEGEND
- ESD practice — micro-bioretentation (M-6)
 - Roadside dry swale (M-8)
 - Drainage area to practice
 - Off-site area draining onto site
 - 100-yr overflow path
 - Point of investigation
 - Driveway culvert

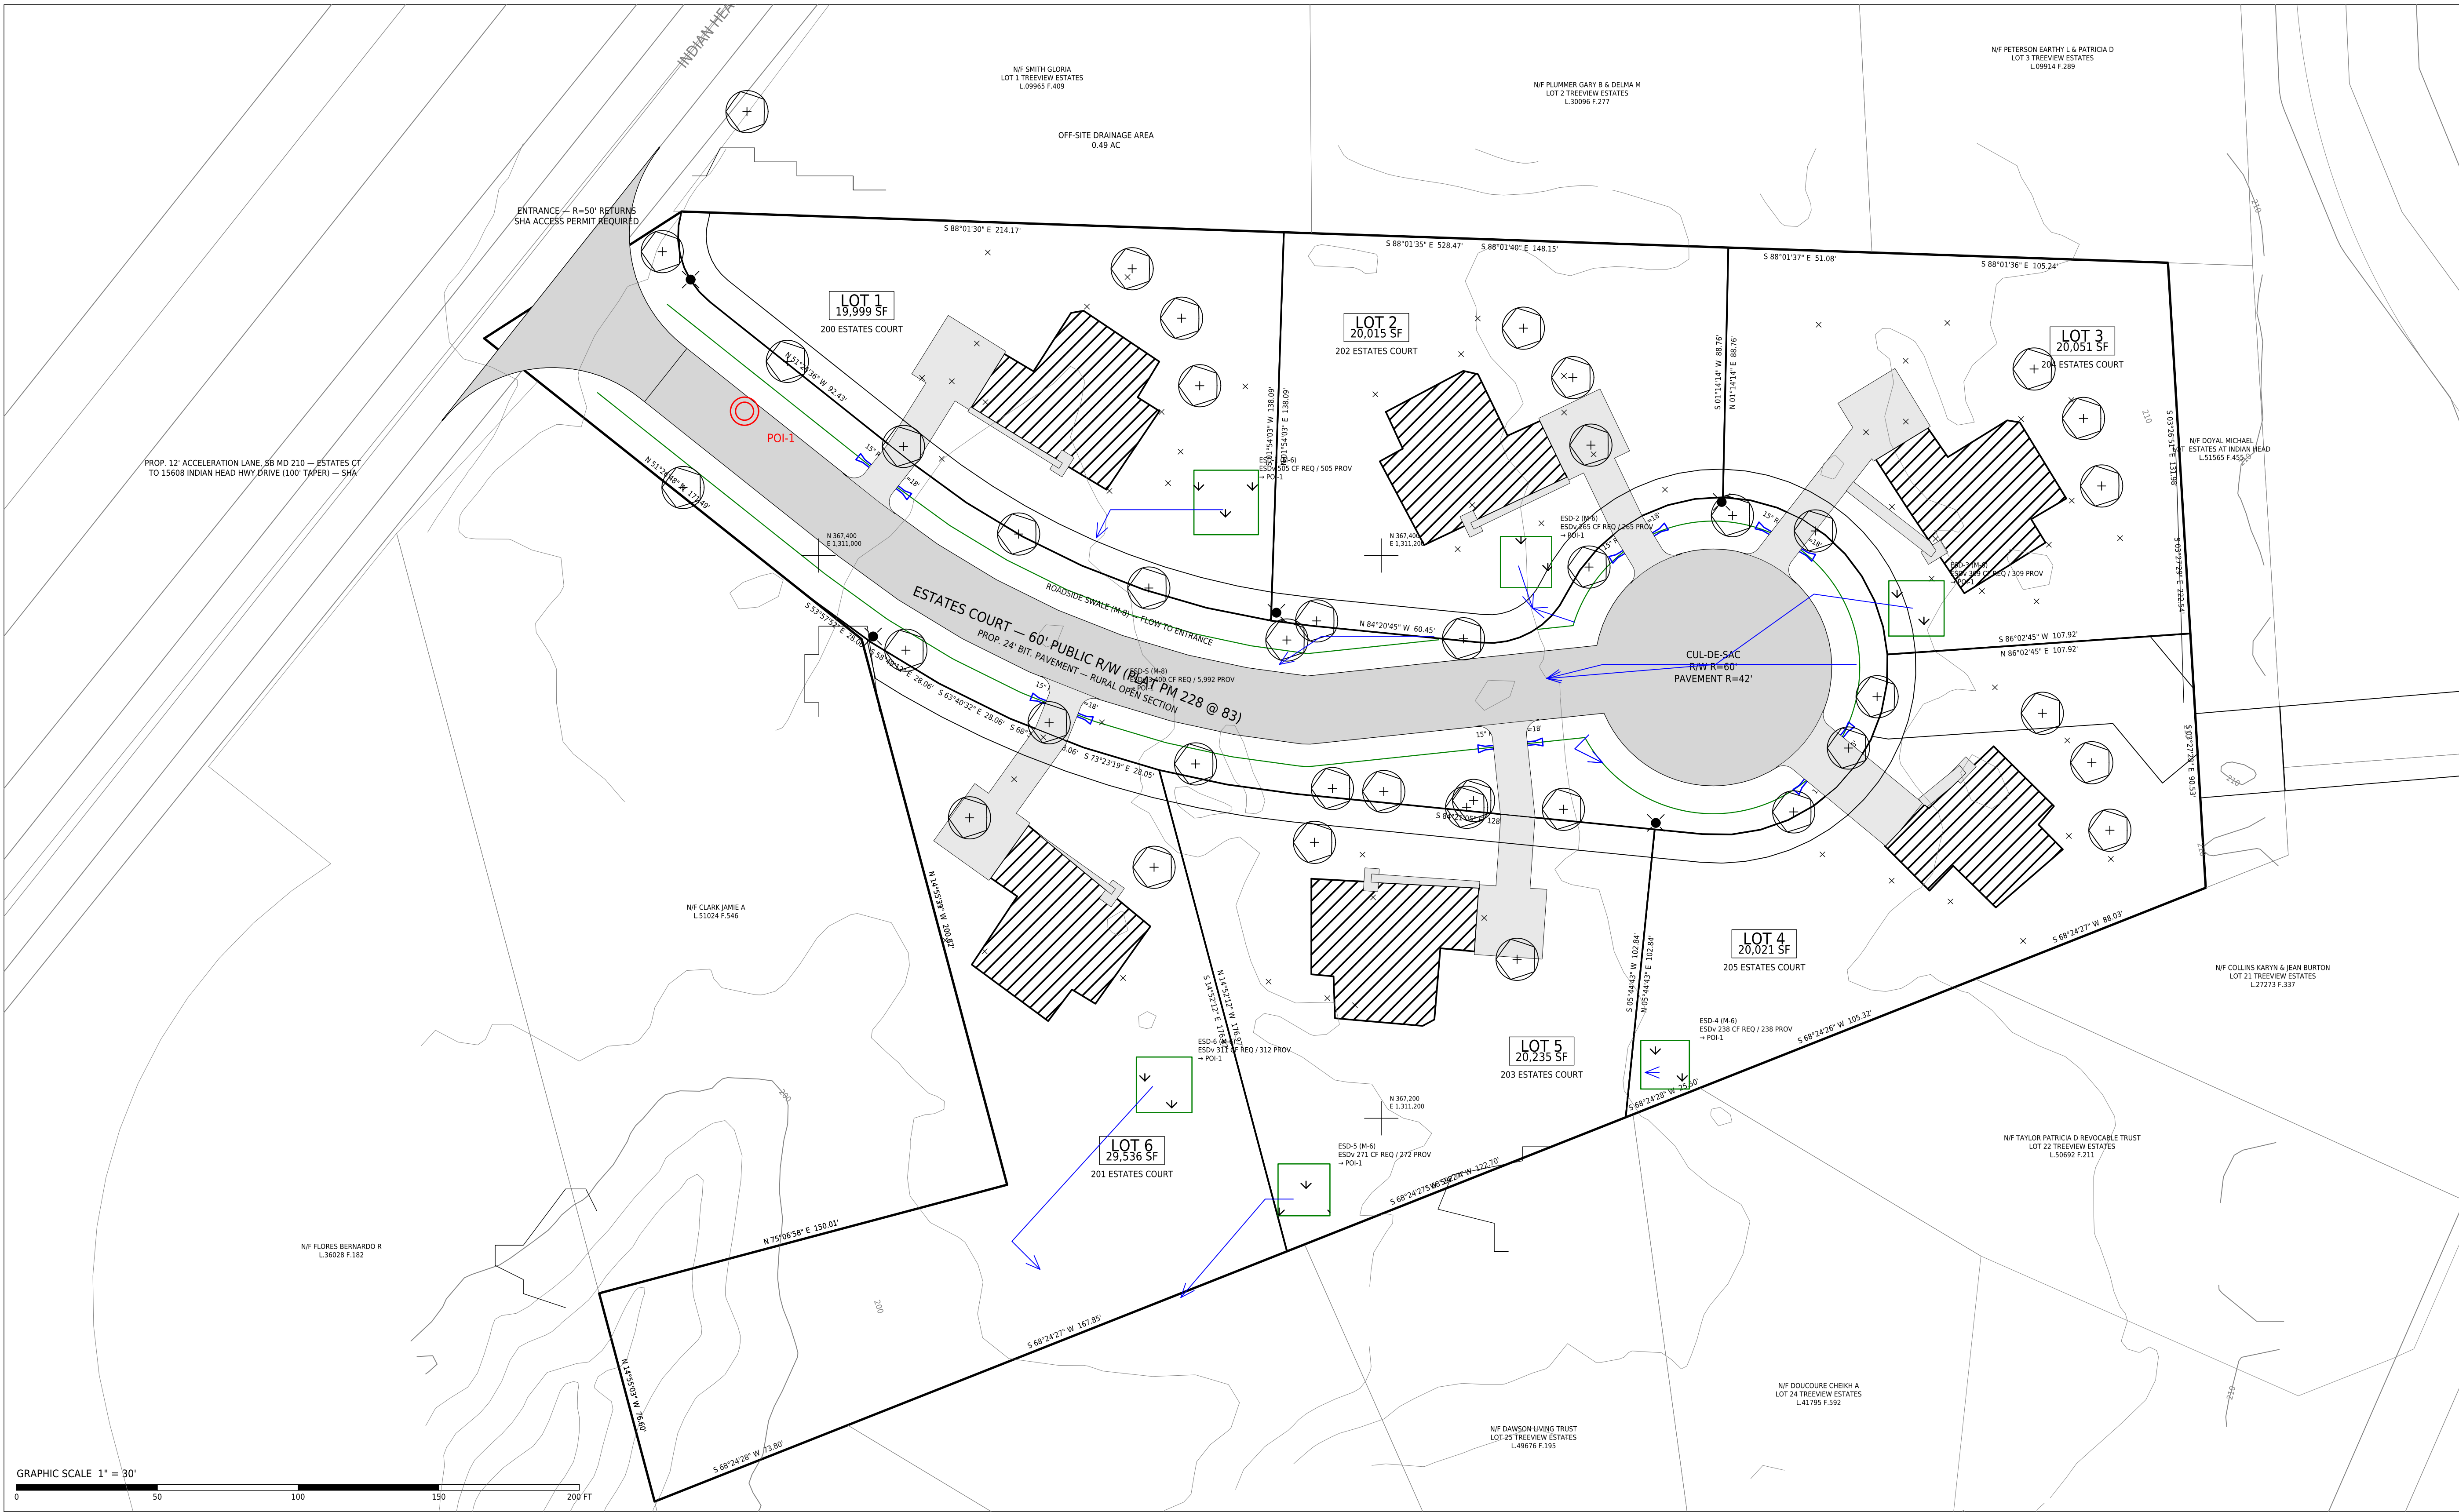

ESD PER PRACTICE (FULL TABLE ON C-000)

BMP	MDE	LOCATION	POI	DA SF	%	P E	ESDv REQ	ESDv PROV
ESD-1	M-6	Lot 1	POI-1	19,999	22.5	1.2	505	505
ESD-2	M-6	Lot 2	POI-1	20,015	12.1	1.0	265	265
ESD-3	M-6	Lot 3	POI-1	20,051	15.0	1.0	309	309
ESD-4	M-6	Lot 4	POI-1	20,021	10.3	1.0	238	238
ESD-5	M-6	Lot 5	POI-1	20,235	12.3	1.0	271	272
ESD-6	M-6	Lot 6	POI-1	29,536	8.5	1.0	311	312
ESD-S	M-8	Estates Ct R/W, both sides	POI-1	36,041	57.3	2.0	3,400	5,992

POINTS OF INVESTIGATION (C-9)

POI	LOCATION	SHARE	ESDv REQ	ESDv PROV
POI-1	N 367.451 E 1,310.974	100%	5,299	7,893

- SWM NOTES
- SWM by Environmental Site Design to the MEP (Md. Stormwater Management Act of 2007; MDE Design Manual Ch. 5; PGC Subtitle 32). Target rainfall P_E from MDE Table 5.3 for HSG C at each drainage area's imperviousness.
 - Each lot drains to one micro-bioretentation cell (M-6): 12-in max. ponding, 2.5-ft filter media, underdrain to a stable outfall. Estates Court drains to roadside dry swales (M-8) with check dams.
 - Rooftop and non-rooftop disconnection (N-1, N-2) to be credited at technical design. Infiltration credit only where Sec. 32-131 borings show ≥ 0.52 in/hr.
 - Private ESD practices: maintenance agreement recorded before permit; public swales in the R/W maintained by DPPE.
 - D8 flow routing on a 5-ft surface interpolated from the existing 2-ft contours; exit points clustered at 120 ft; POIs carrying under 4% of the site omitted.

MISS UTILITY NOTE
Information concerning existing underground utilities was obtained from available records. The contractor must field verify the exact locations and elevations as required for applicable horizontal and vertical clearances by digging test pits by hand well in advance of excavation. Contact "Miss Utility" at 1-800-251-7777 (811), 48 hours prior to the start of any excavation. Provide results of test pits to the design engineer and coordinate with the engineer, owner/developer and utility company before proceeding with construction to resolve any conflicts or clearances with other utilities, storm drains, grading or other improvements.

STABILIZATION NOTE
Stabilization practices on all projects must be in compliance with the requirements of COMAR 26.17.01.08 G. Following initial soil disturbance or re-disturbance, permanent or temporary stabilization must be completed within: three (3) calendar days as to the surface of all perimeter dikes, swales, ditches, perimeter slopes and all slopes steeper than 3 horizontal to 1 vertical (3:1); and seven (7) calendar days as to all other disturbed or graded areas on the project site not under active grading.


OWNER / DEVELOPER
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L32062 F.043)

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Expiration date: _____

CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPPE APPROVAL
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

KEY MAP

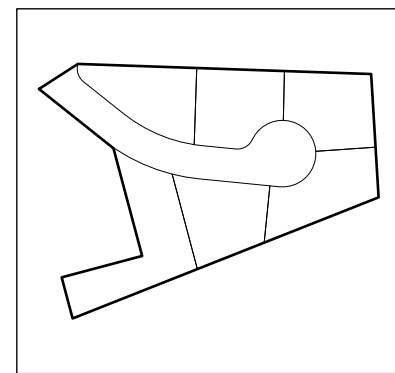

W.L. MEEKINS, INC.
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115
PREPARED WITH KEALEE SPATIAL ENGINE / CAD-PLOT

ESTATES AT INDIAN HEAD
SITE DEVELOPMENT CONCEPT PLAN
LOTS 1 THRU 6 & ESTATES COURT
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE BR
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT 14-15-20-25 S
OWNER: GERALD WALDMAN REVOCABLE TRUST AND N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L32062 F.043)

REVISIONS

DATE	DESCRIPTION
2024-09-30	CONCEPT SUBMISSION 1

THE STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP


DATE: 2026-09-30

SCALE: 1" = 30'

SHEET: 6 OF 9

C-400

DRAWN: KEALEE CAD-PLOT
DESIGNED:
CHECKED:

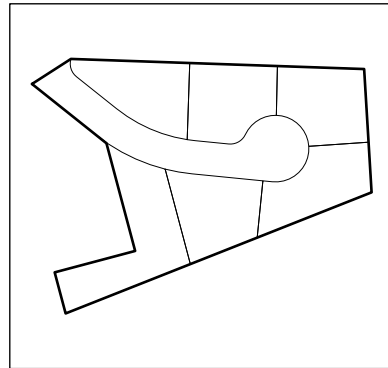

D-1 SWM CONCEPT NARRATIVE

1. Natural resources: there are no environmental features on the property — no streams, wetlands, 100-yr floodplain, PMA or woodland. Disturbance is held to the limit shown on the sediment control plan.
2. Impervious footprints: the tract falls toward MD 210 and leaves at one point of investigation, which the proposed grading keeps; no drainage is diverted between the PMA and the road.
3. Impervious diversions: rural open section (24 ft pavement, no curb and gutter); side-lawn curbs kept to the turning area at each garage. Proposed impervious 37,658 sf (22.7%).
4. ESD to the MEP: 7 practices — micro-bioremediation (M-6) on one table and roadside dry swales with check dams (M-8) in the R/W. ESD required: 259 cf, provided 788 cf (3.04 times required) (Table 5-3, HSG C).
5. ESC integration: practice footprints are kept out of the sediment-trapping areas and are built last, after the contributing area is stabilized; sediment control is shown on C-500.

1. POI-1 lies where the Estates Court swales and the overland flow from the lots leave the tract, discharging to the MD 210 roadside ditch (SHA). The outfall is not on a stream or within a 100-yr floodplain; the receiving area is the state highway drainage system, which SHA must accept under the access permit.

1. POI-1: 10-yr velocity 3.3 ft/s within 4.0 ft/s for a grass-lined channel; rock outlet protection is still provided where the swale meets the MD 210 roadside ditch (SHA), so the 100-yr flow (4.0 ft/s) does not cut a gully at the transition. Normal depth at the 100-yr flow 1.14 ft in the grass-lined roadside swale, 2-ft bottom, 3:1 sides, $n = 0.035$ at 1.5% slope. Upstream inflow from off site (0.49 ac) enters as sheet flow along the tract line and is carried by the swales; no concentrated inflow point needs stabilization.

CONDITION	WOODS SF	OPEN SPACE SF	IMPERVIOUS SF	CN	Tc HR
Existing	0	165,902	0	74	0.285
Proposed	0	128,244	37,658	79.4	0.285

SEGMENT	L FT	S FT/FT	V FPS	Tt HR
sheet flow, dense grass	100	0.0152	0.10	0.266
shallow concentrated, unpaved	137	0.0152	1.99	0.019

STORM YR	P 24-HR IN	Q EXIST CFS	Q PROP CFS	CHANGE CF	RUNOFF EXIST	RUNOFF PROP CF
1	2.63	2.08	3.35	+1.27	9,439	13,130
2	3.19	3.48	5.06	+1.58	14,253	18,776
10	4.93	8.87	11.36	+2.49	31,916	38,459
100	8.51	22.16	24.85	+2.69	74,438	83,480

SECTION	S FT/FT	Q10 CFS	V10 FPS	Q100 CFS	V100 FPS	d100 FT	V ALLOW FPS
grass-lined roadside swale, 2-ft bottom, 3:1 sides, n = 0.035	0.0152	11.36	3.27	24.85	4.01	1.14	4.0

1. ESDY required and provided per POI: BMP Summary Table (C-000). Rainfall: NOAA Atlas 14 Vol. 2 Ver. 3. PFDS point estimate, 38,675.2 mm/77,040 W, partial duration series, 24-hr, retrieved 2026-09-30.
2. POI: 3.81 ac, CN 74 → 79, C to 285 = 285 hr, 10-yr QW 22.2 + 24.9 cfs (+2.7 cfs), runoff 74,438 → 83,480 cf.
3. No ESD credit taken in the 10-yr comparison (conservative). ESD to the MEP specifies channel protection where the Table
4. Downstream adequacy of the MD 210 roadside ditch (SHA) for the 10- and 10-yr flows at each POI, from the receiving system's section and capacity (SHA as-built), at technical design, If inadequate, 10-yr quantity control is added (checklist D-10).

1. Downstream adequacy of the MD 210 roadside ditch (SHA) for the 10- and 100-yr flows at each POL from the receiving system's section and capacity (SHA as-built), at technical design. If inadequate, 10-yr quantity control is added (checklist D-10).
2. POLs, flow paths and the time of concentration are computed on M-NCPPC 2-ft topography.

NRCS TR-55 graphical peak discharge, Type II 24-hr; CN from TR-55 Table 2-2 (HSG C: woods 70, open space 74, impervious 98)
Tc by TR-55 segments along the routed longest path; no ESD credit on the 100-yr.
NOAA Atlas 14 Vol. 2 Ver. 3, PFDS point estimate, 38.6752 N 77.0040 W, partial duration series, 24-hr, retrieved 2026-09-30

I hereby certify that these documents were prepared or approved by me
and that I am a duly licensed professional engineer under the laws of
the State of Maryland, License No. _____ Expiration date: _____

CONCEPT SUBMISSION 1 — NOT SEALED

SEAL

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL
5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

W.L. MEEKINS, INC.
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115
PREPARED WITH KEALEE SPATIAL ENGINE / CAD-PILOT

ESTATES AT INDIAN HEAD


SITE DEVELOPMENT CONCEPT PLAN

LOTS 1 THRU 6 & ESTATES COURT

200-203 ESTATES COURT, ACCOKEE, MD 20607
PLAT BOOK PM 228 PLAT 83 - TAX MAP 151 F-3 - WSSC 2205E01
OWNER: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L-32062 F-043)

SEDIMENT AND EROSION CONTROL PLAN

- LEGEND
- Limit of disturbance
 - Super silt fence
 - Stabilized construction entrance
 - Proposed contour
 - Existing contour

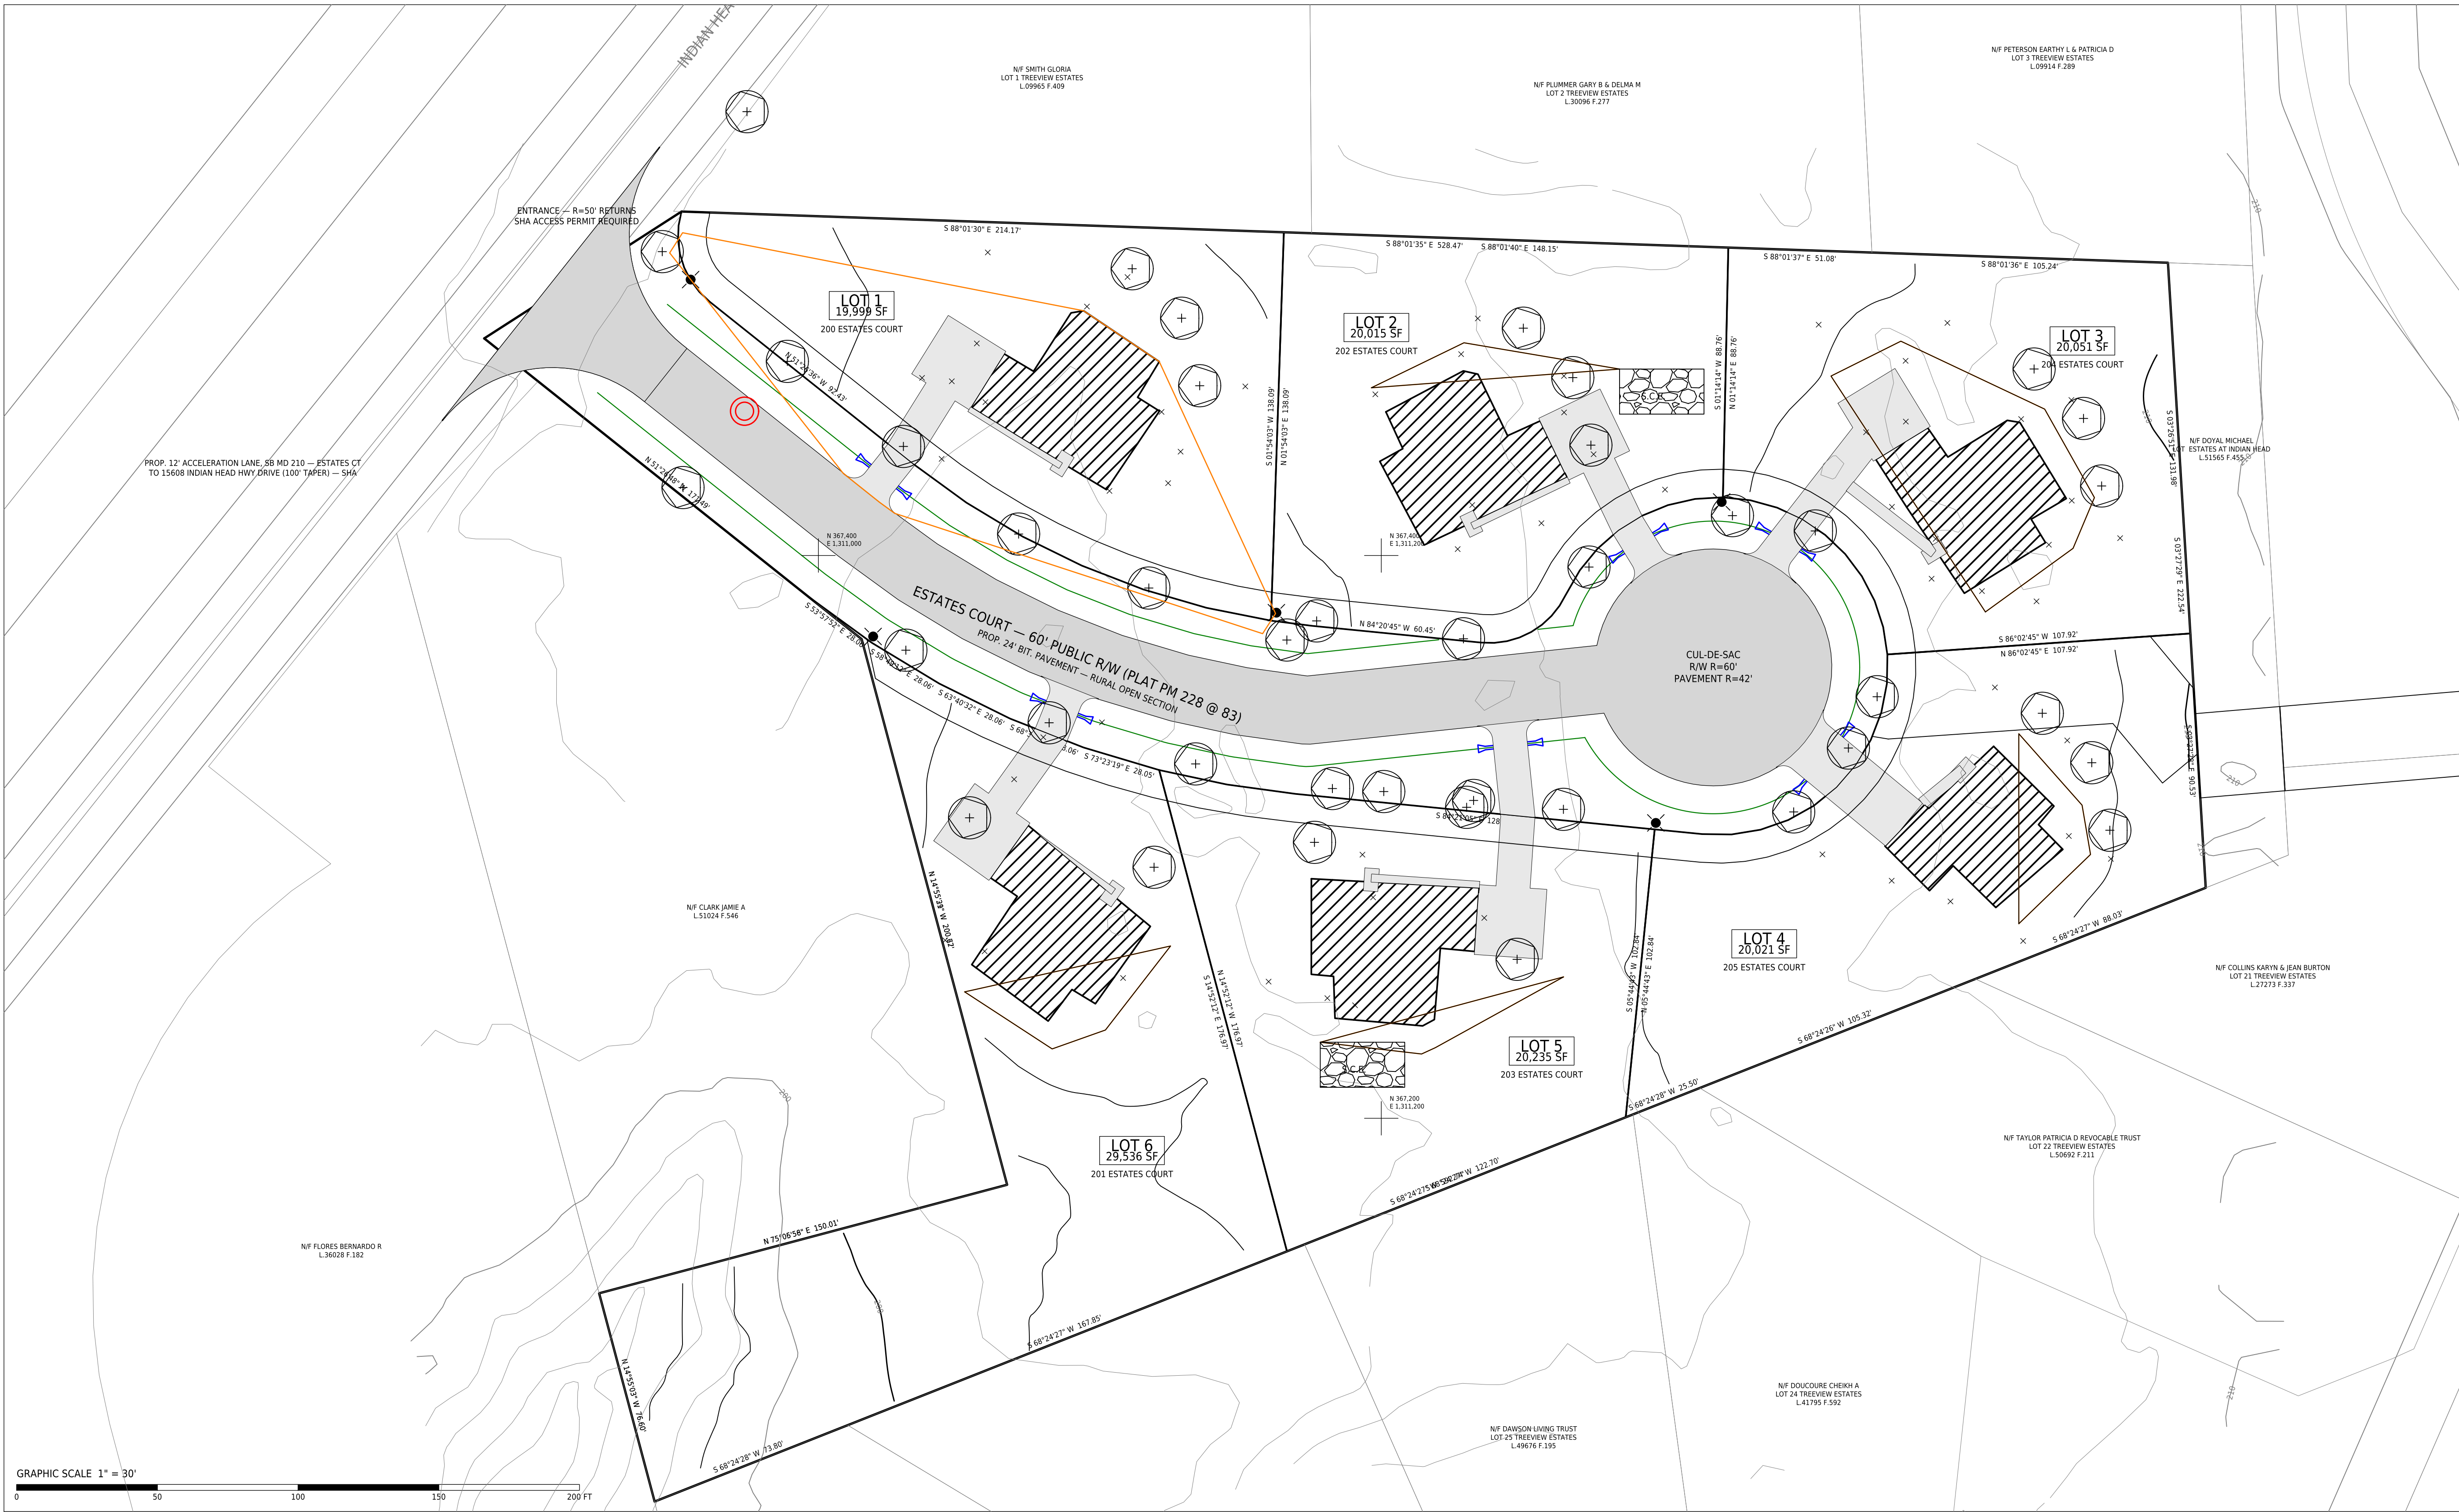

- SEDIMENT AND EROSION CONTROL NOTES
- Sediment and erosion control per the 2011 Maryland Standards and Specifications for Soil Erosion and Sediment Control and PGSCD requirements.
 - Stabilized construction entrance at the Estates Court entrance; super silt fence along the down-gradient limit of disturbance; inlet and swale protection.
 - Stabilize disturbed areas within 3 days on slopes $\geq$ 3:1 and within 7 days elsewhere.

- SEQUENCE OF CONSTRUCTION
- Pre-construction meeting with the PGSCD / DPIE inspector; Miss Utility.
 - Install stabilized construction entrance and perimeter controls; inspector approval.
 - Clear and grub within the LOD; rough grade Estates Court and swales.
 - Install water and sewer (Henrietta Dr to Estates Ct) and house connections.
 - Construct pavement, shoulders, culverts and entrance; stabilize swales.
 - Build dwellings, driveways and courts; construct ESD practices after the contributing area is stable.
 - Fine grade, permanent stabilization, street trees and lights; remove controls with inspector approval.

MISS UTILITY NOTE

Information concerning existing underground utilities was obtained from available records. The contractor must field verify the exact locations and elevations as required for applicable horizontal and vertical clearances by digging test pits by hand well in advance of excavation. Contact "Miss Utility" at 1-800-251-7777 (811), 48 hours prior to the start of any excavation. Provide results of test pits to the design engineer and coordinate with the engineer, owner/developer and utility company before proceeding with construction to resolve any conflicts or clearances with other utilities, storm drains, grading or other improvements.

STABILIZATION NOTE

Stabilization practices on all projects must be in compliance with the requirements of COMAR 26.17.01.08 G. Following initial soil disturbance or re-disturbance, permanent or temporary stabilization must be completed within: three (3) calendar days as to the surface of all perimeter dikes, swales, ditches, perimeter slopes and all slopes steeper than 3 horizontal to 1 vertical (3:1); and seven (7) calendar days as to all other disturbed or graded areas on the project site not under active grading.

OWNER / DEVELOPER

GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L.32062 F.043)


I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Expiration date: _____

CONCEPT SUBMISSION 1 — NOT SEALED

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL

5" x 3" — KEEP BLANK (ePLAN 5" RIGHT MARGIN, CHECKLIST A-3)

KEY MAP

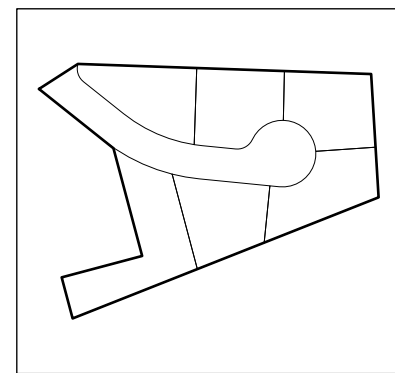

W.L. MEEKINS, INC.
BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115
PREPARED WITH KSALEE SPATIAL ENGINE / CAD-PLOT

ESTATES AT INDIAN HEAD
SITE DEVELOPMENT CONCEPT PLAN
LOTS 1 THRU 6 & ESTATES COURT

200-205 ESTATES COURT, ACCOKEEK, MD 20607
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE BR
PLAT 24 THREVIEW ESTATES L.30996 F.277
OWNER: GERALD WALDMAN REVOCABLE TRUST AND N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L.32062 F.043)

REVISIONS

DATE	DESCRIPTION
2024-09-30	CONCEPT SUBMISSION 1

THE

SEDIMENT AND EROSION CONTROL PLAN



C-500

DATE: 2026-09-30

SCALE: 1" = 30'

SHEET: 8 OF 9

DRAWN: KSALEE CAD-PLOT
DESIGNED:
CHECKED:



PLAT BOOK PM 228 PLAT 83 · TAX MAP 151 F-3 · WSSC 2205E01
OWNER: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L 332062 F.043)

[illegible]