

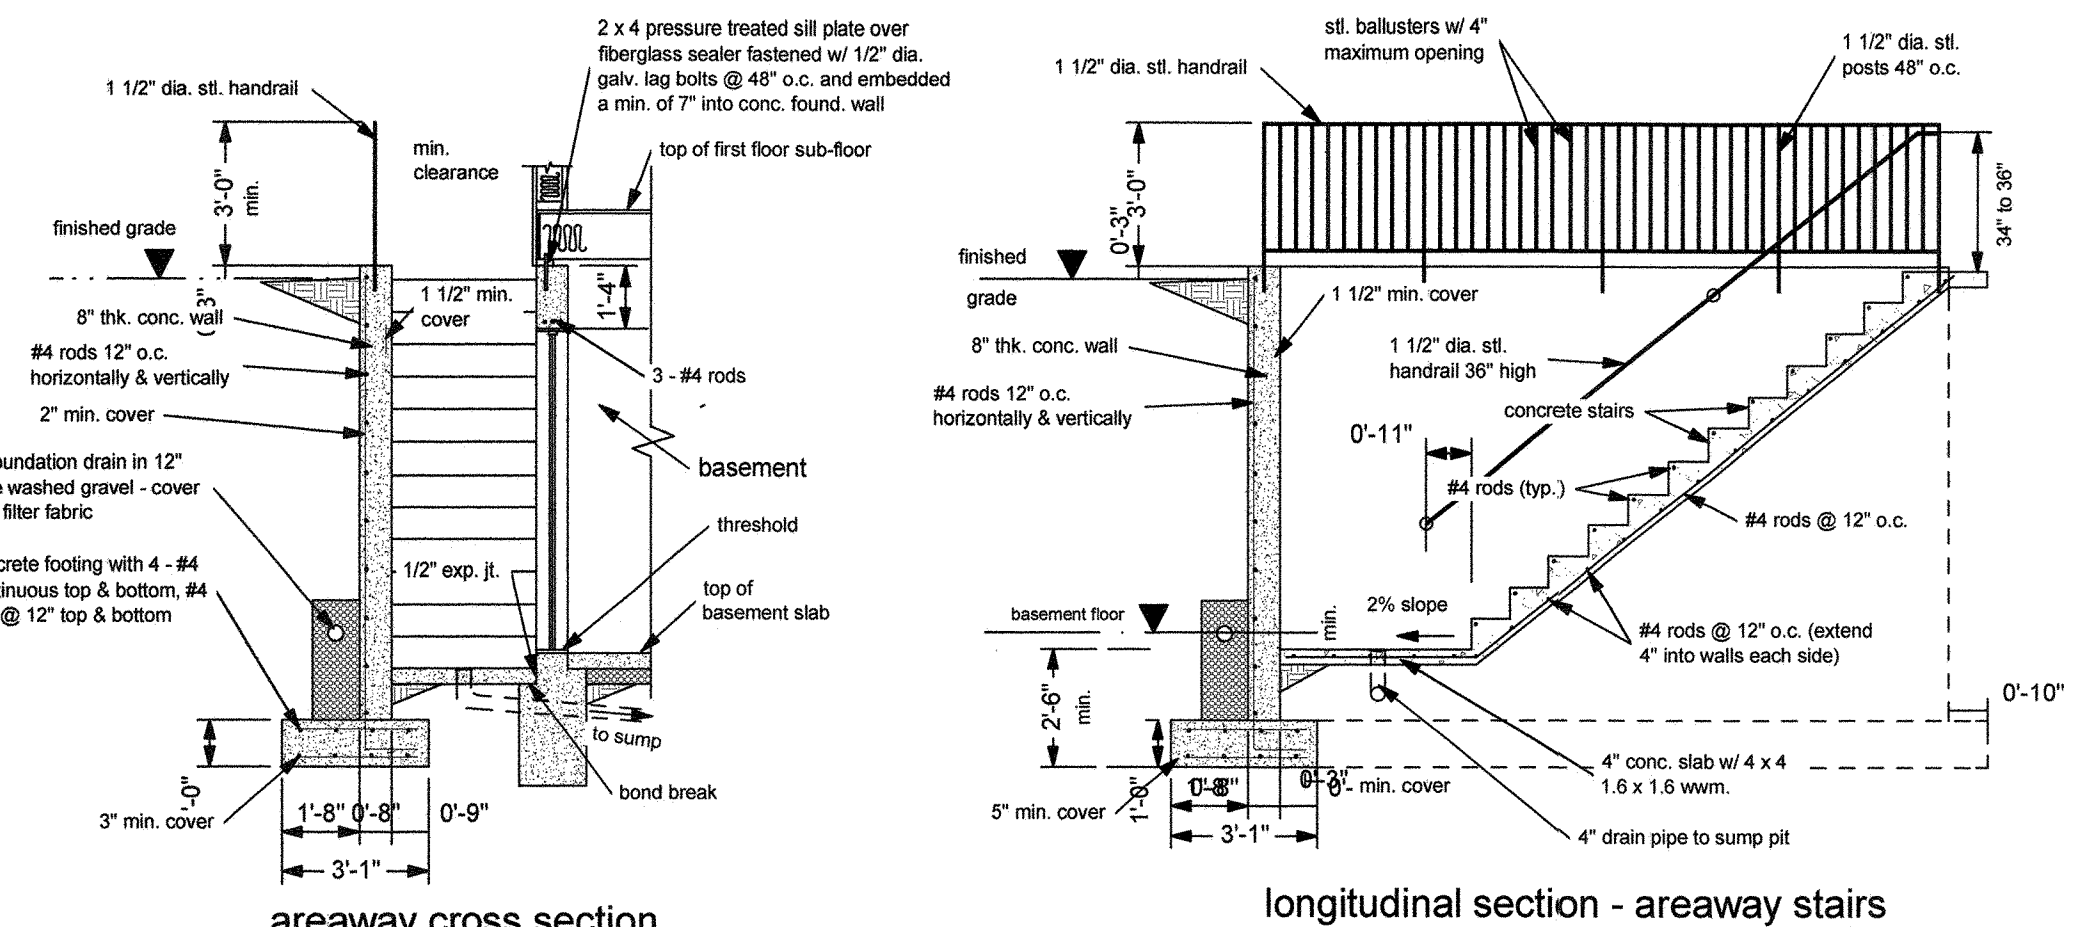
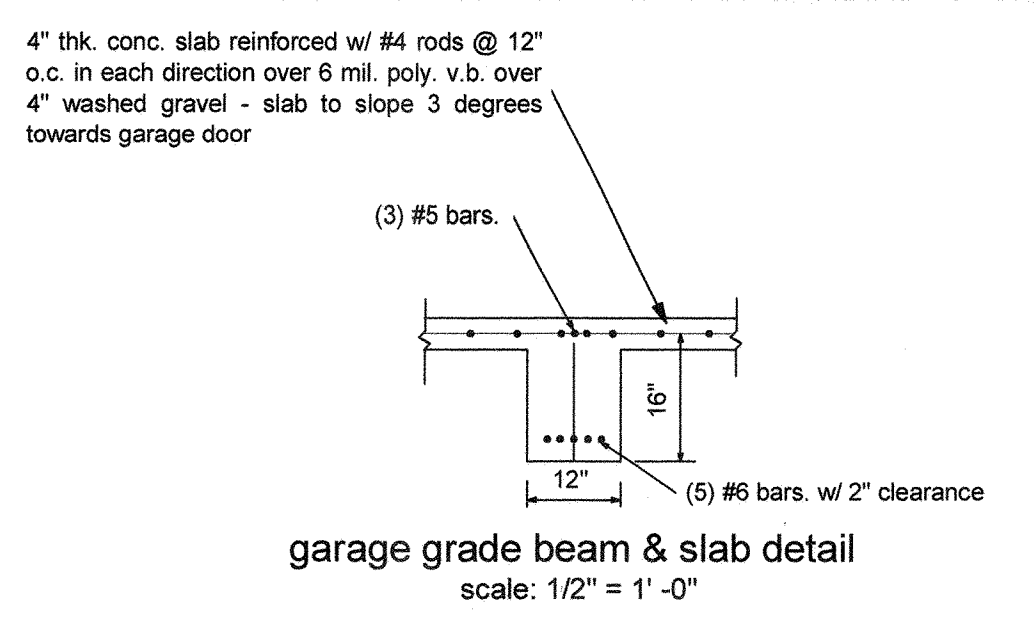
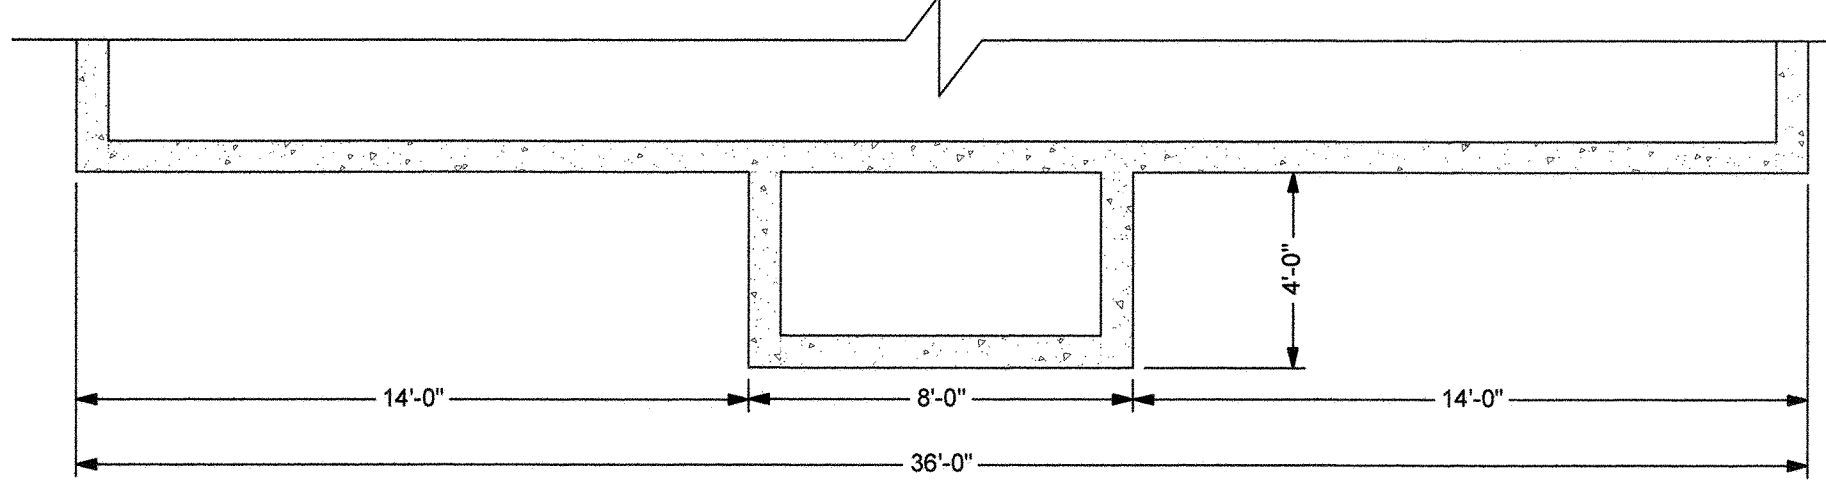
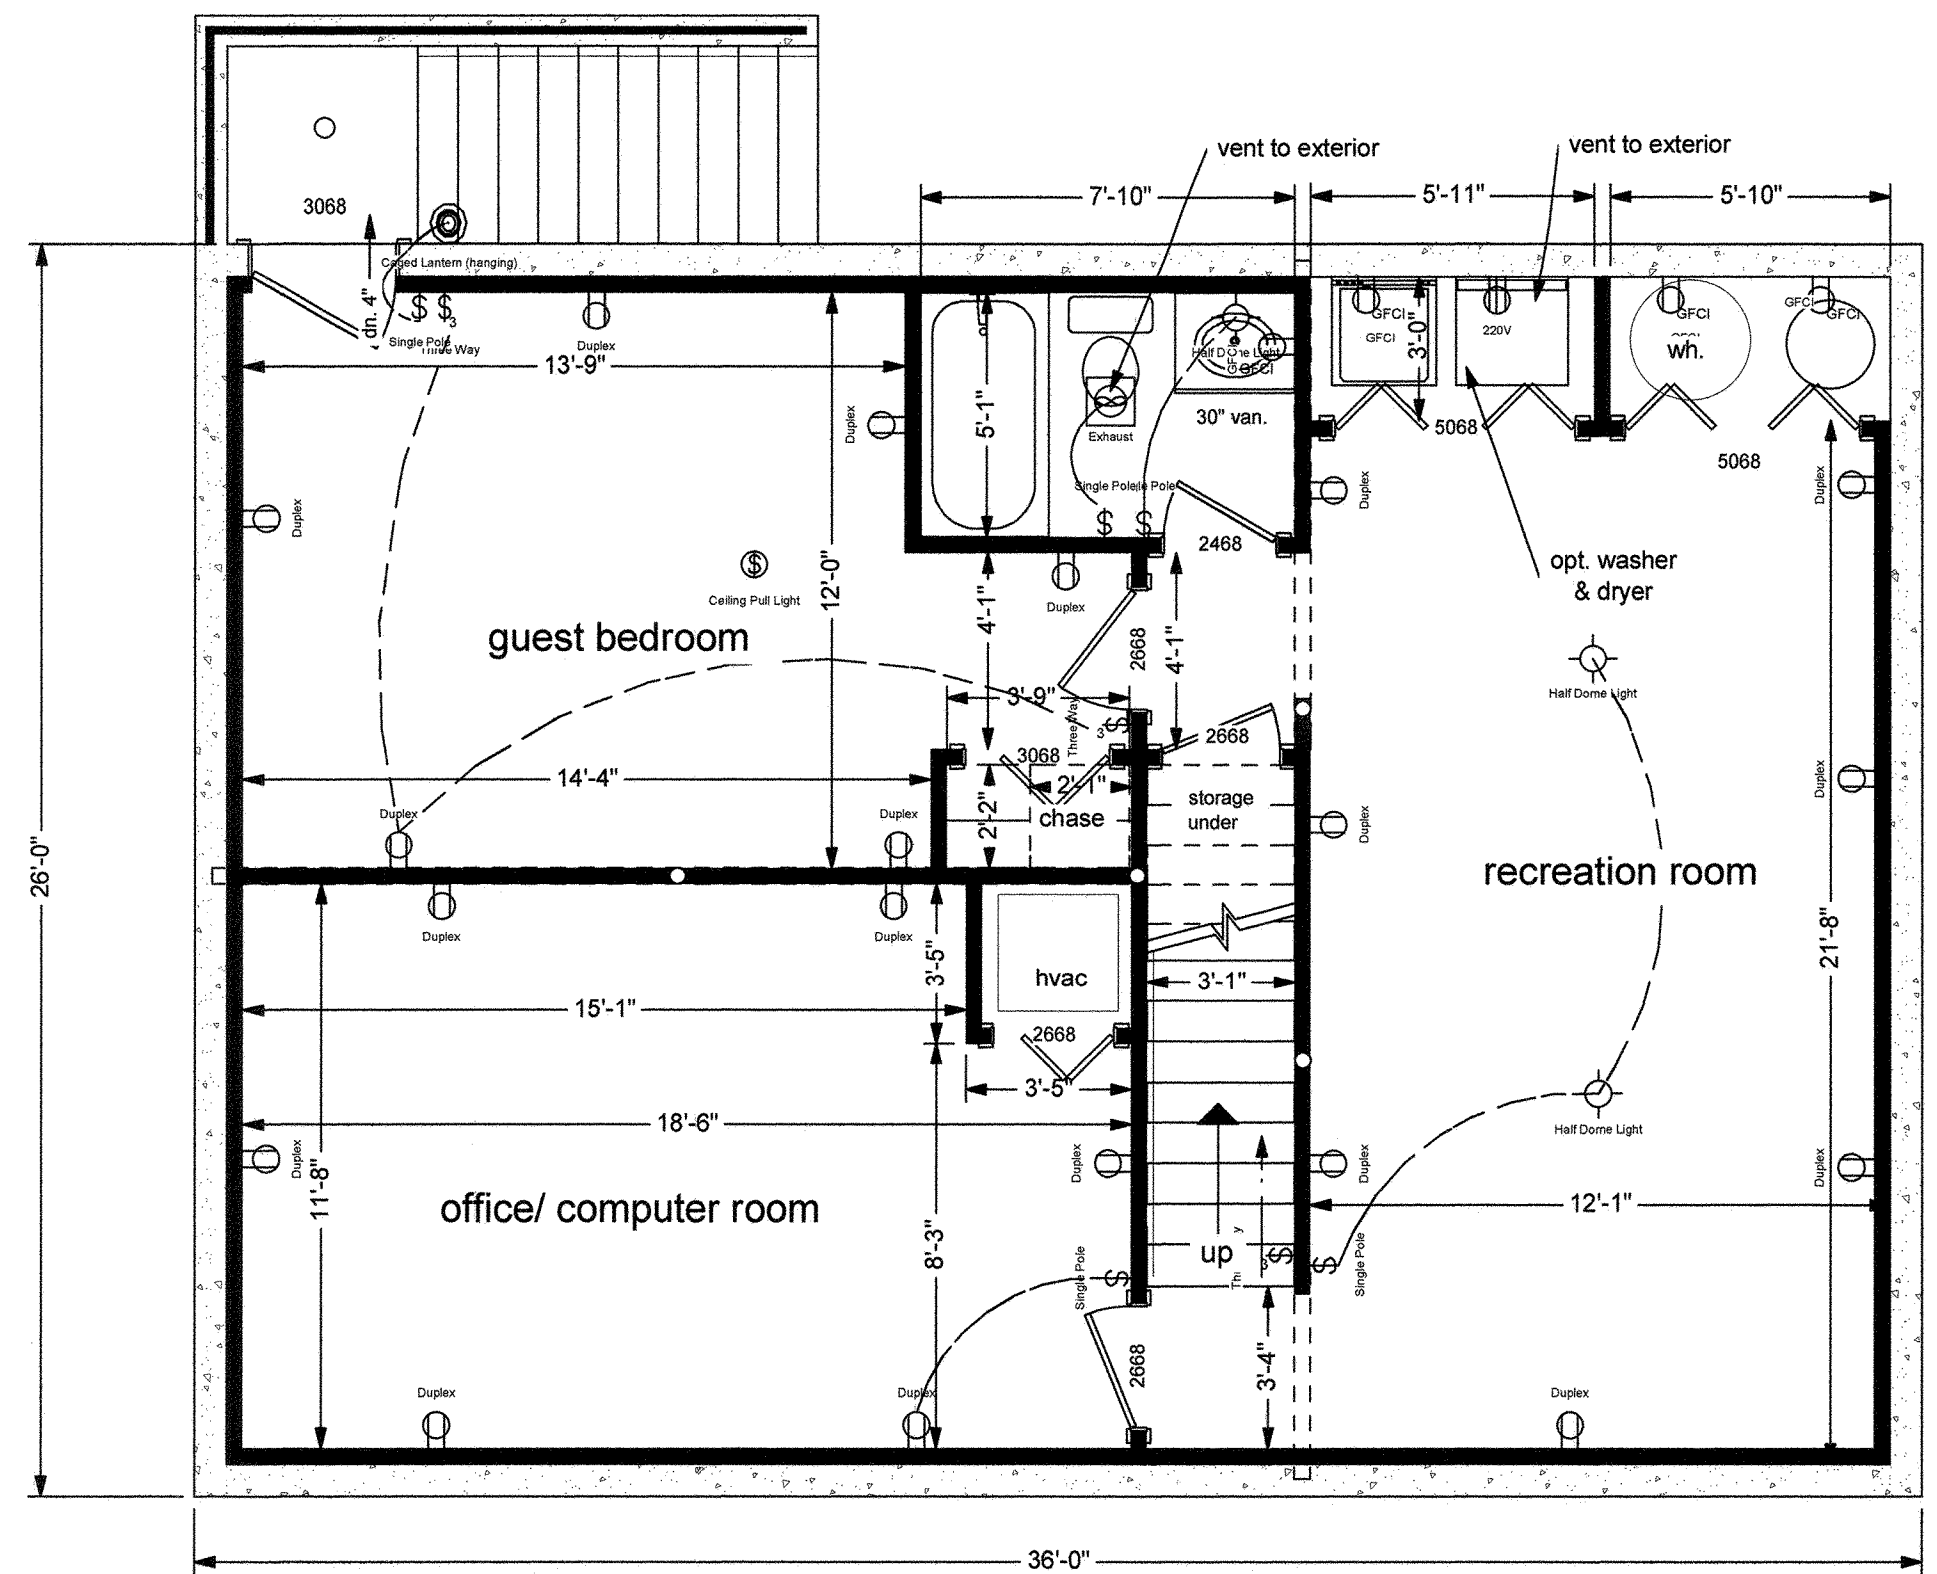


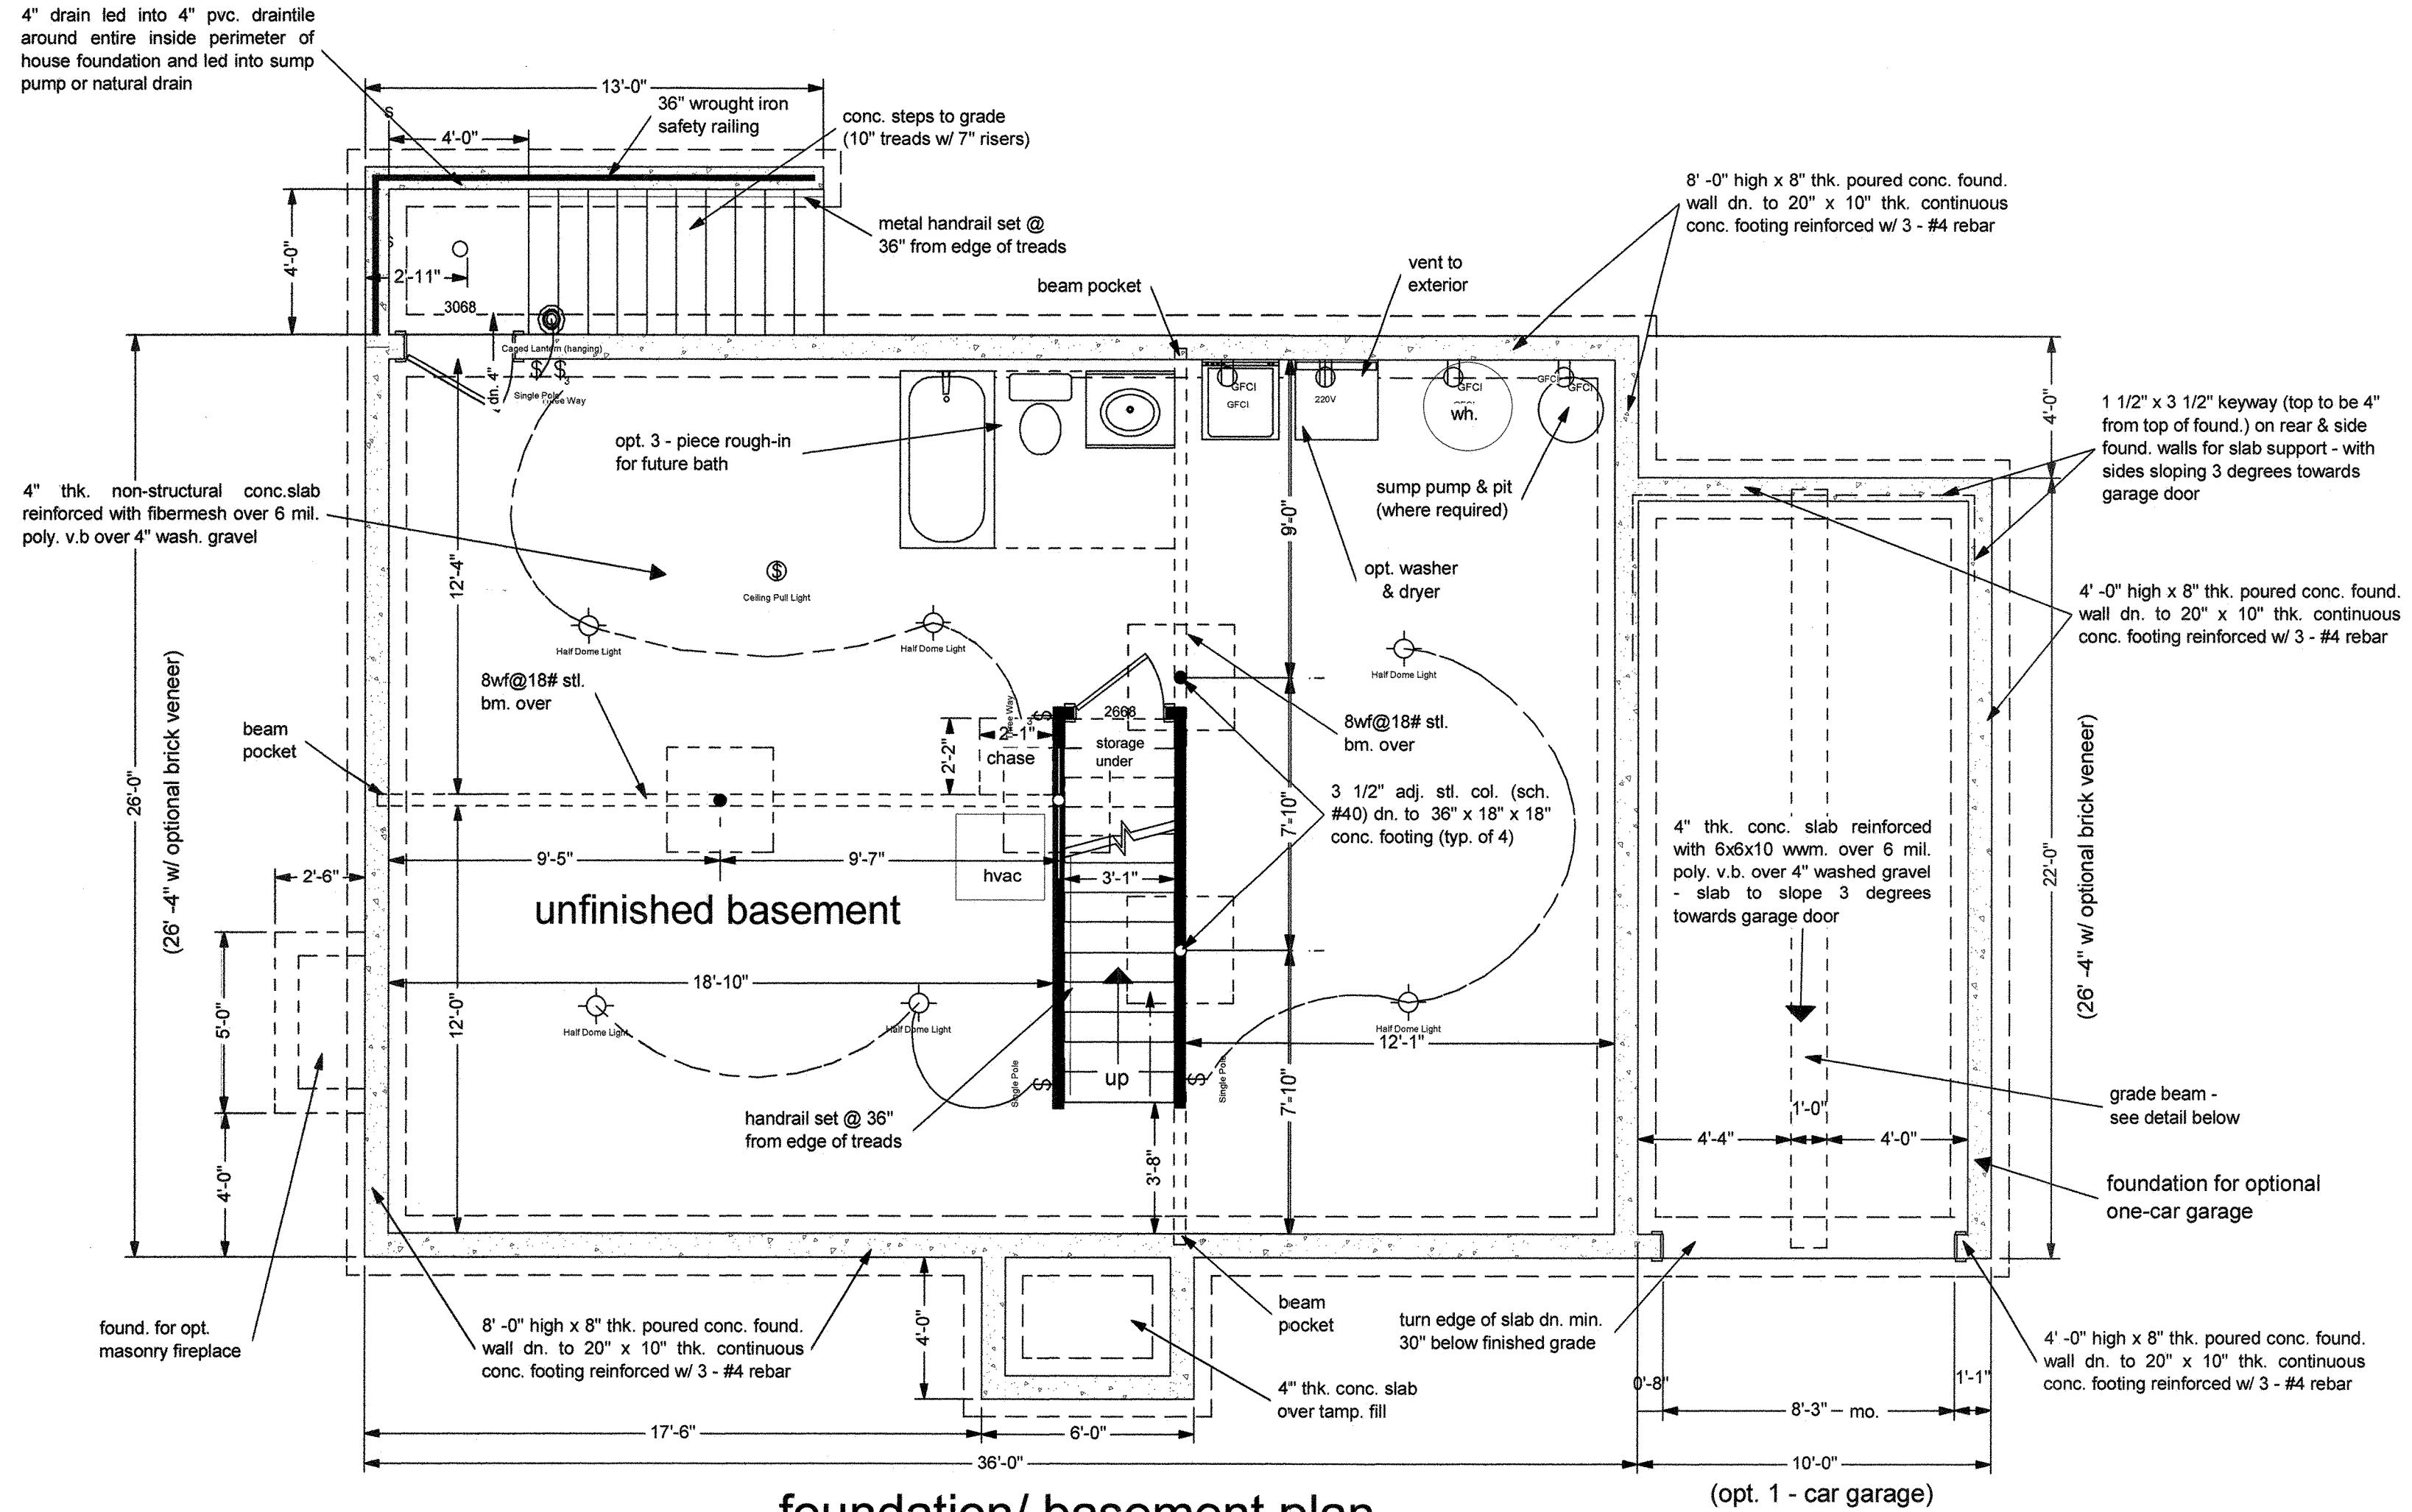

- residential areaway/ drain notes
- 1.) The areaway stair landing shall be at least 4" below the interior floor slab and slope to drain to an approved general purpose area drain.
 - 2.) The general purpose drain shall have an intake or strainer with a minimum diameter of 6" and a minimum pipe outfall of 4".
 - 3.) The drain shall have a strainer lid or body that provides accessibility for maintenance of drain body and pipe.
 - 4.) The areaway drain shall be connected to a rigid pipe with minimum fall of 1/8" per foot piped to sump pump crock or a day-lighted outfall at grade.
 - 5.) The rigid pipe shall not be connected to the interior or exterior foundation drain or drain tile.
 - 6.) The pipe shall be sleeved where it passes through the foundation wall or frost protected footing.
 - 7.) The general purpose drain assembly and rigid pipe may be constructed of Schedule 40 PVC, cast iron, or equivalent approved rigid pipe.

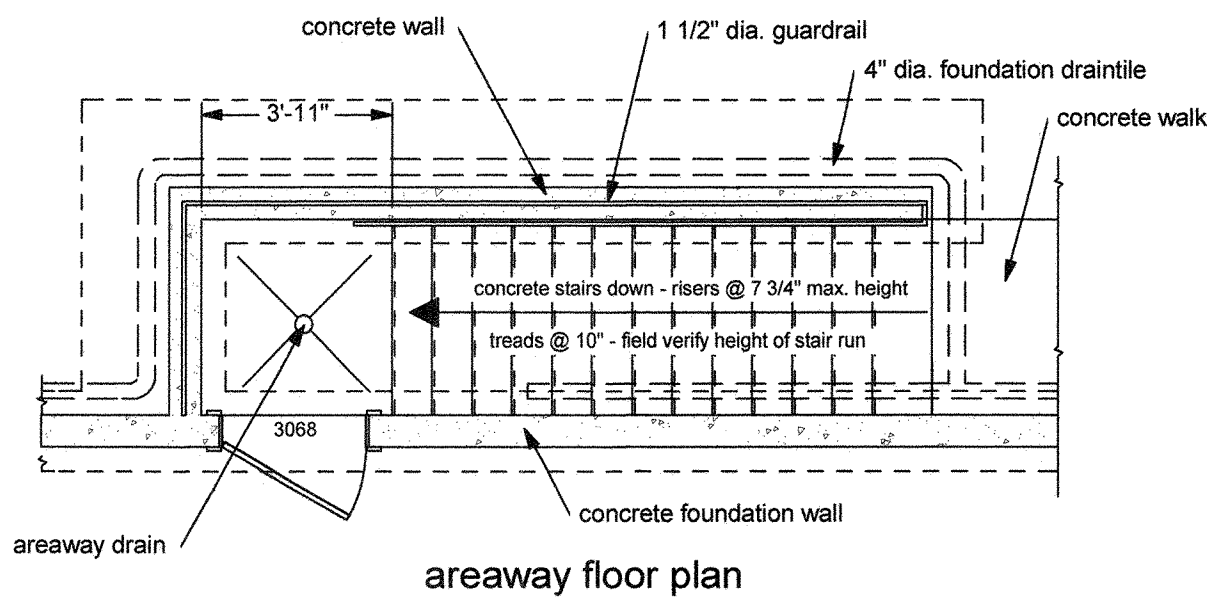

optional finished basement plan

note: smoke & carbon monoxide detectors to be installed in all bedrooms

foundation/ basement plan

scale: 1/4" = 1' -0"

note: all lumber coming in contact with concrete to be pressure treated

custom designs unlimited, inc.		name: Kingsworth	date	revisions:
INTERNATIONAL 15 mooring point court annapolis, md. 21403		scale: 1/4" = 1' -0"		
tel: (443) 336-8763 email: rlang38208@aol.com http://customdesignsinternational.net		dwg. no: 260811		
		drwn. by: bob lang	date: 8/6/26	
		Foundation/ Basement Plan		sht no: