

ROLLINS AVENUE | 1005 & 1009

Record conditions and property schedule

Porter Subdivision, Lots 1 and 2. Recorded plat PM 231 / 50. This dossier accompanies the revised user-selected C-001. It does not establish current agency approval.

PROPERTY	RECORDED AREA	DWELLING
Lot 1 / 1005	9,598 SF	1,196 SF
Lot 2 / 1009	8,008 SF	1,196 SF
Net lots	17,606 SF	2,392 SF
Public dedication	4,219 SF	
Gross tract	21,825 SF	

1. Development of this property shall be in accordance with the approved Stormwater Management Concept Plan 41230-2006-00, or any approved revisions thereafter.
2. Approval of this plat is based upon a reasonable expectation that public water and sewer service will be available when needed, and is conditioned on fulfilling all of the Washington Suburban Sanitary Commission authorization DA 4916 Z 08 commitments.
3. The applicant, his heirs, successors and or assignees shall utilize an abutting driveway design, constructed per DPW&T standards and requirements. Separate, standard residential driveway aprons shall be provided along Rollins Avenue, if deemed appropriate by DPW&T upon the issuance of street construction permits.

ADJOINERS OF RECORD

LOTS 13, 14 AND 15 - Addition to Pleasant Park, Plat Book VJ 185, Plat 76

LOT 12 - Addition to Pleasant Park, Plat Book VJ 185, Plat 76

OUTLOT A - Addition to Pleasant Park, Plat Book VJ 185, Plat 76

JEAN M. YOUNG - L.14377 F.589

MAITLAND W. DADE - L.11452 F.473

PATRICIA L. FERRELL - L.12766 F.721

VALLE GARGAN SUBDIVISION - P.B. WWW 19, P. 41

EDWARD B. ROLLINS, TRUSTEE, ET AL - L.12790 F.155

ROLLINS AVENUE | 1005 & 1009

Measurements and proposed work-limit takeoff

Quantities use the selected PDF geometry at 3.6 points per foot, with the documented 0.70-ft Lot 2 translation applied. Both dwelling footprints remain 1,196 SF. The areaways add 52 SF each outside those nominal footprints.

MEASURE	LOT 1	LOT 2
Front clearance	31.00 ft	30.30 ft
Side clearances	8.10 / 10.90	11.10 / 8.15
Footprint coverage	12.46%	14.94%
Polygon work area	9,598.47 SF	8,008.84 SF

Total proposed LOD union: 19,170.91 SF, rounded up to 19,171 SF on C-001. Offsite polygon area outside both lots: 1,563.60 SF. Small PDF path-rounding differences are included in geometric takeoffs, while recorded areas govern the property schedule.

The proposed LOD covers full-lot development and the depicted paving/public utility corridor. Utility reconstruction and work access may change its final extent. Final ESC design and offsite authorizations remain required. The work-limit outline is not a designed sediment barrier.

BOUNDARY / BUILDING COORDINATION

Bearing labels were corrected to the recorded 79-29-14 and 10-30-46 calls; frontage is 134.64 ft on Lot 2. The outer frontage label is 222.27 ft. The source coordinate geometry is retained for survey reconciliation. No legal boundary has been adjusted merely to force numerical closure.

The selected PDF shows both nominal 46 x 26 dwellings. Kingsworth basement areaways have been added, 13 x 4 ft each. Lot 2 moves 0.70 ft toward Rollins Avenue to maintain the current 8-ft side design criterion at the areaway while keeping the dwelling front beyond 30 ft. Basement vertical design, veneer and roof projections still require coordination.

ROLLINS AVENUE | 1005 & 1009

Soils and environmental evidence

Soil map unit AeB: Adelpia-Holmdel-Urban land complex, 0 to 5 percent slopes. Parcel-intersection query retrieved September 9, 2026. Component properties follow; these regional map properties do not replace site testing.

HSG	DRAINAGE	HYDRIC	K FACTOR
B/D	Somewhat poorly drained	No	.24
C	Moderately well drained	No	.37
D	Not reported	No	Not reported

Source: USDA NRCS Soil Data Access. The returned major-component rows include B/D, C and D groups. Do not assign a single infiltration rate or hydrologic group to facility design without site investigation.

HISTORICAL PLANNING RECORD

The Porter 4-06111 staff report identifies NRI/116/06, a woodland exemption dated June 7, 2007, and Stormwater Concept 41230-2006-00 dated May 21, 2007 with drywells. It reports no streams, wetlands, 100-year floodplain or Marlboro clay on the site. These are historical findings; the current applicable approvals and exemption letter must be obtained and checked.

FACILITY DESIGN INPUTS STILL REQUIRED

- Surveyed drainage areas, flow paths and receiving outfall; field grades and floor/slab elevations.
- Soil profile, tested infiltration rate, seasonal groundwater and limiting-layer elevations.
- Approved design storm criteria, ESD sizing, facility sections and storage; outlet, overflow, drawdown and maintenance design.
- Current tree-conservation approval or exemption; final species, quantities, sizes, canopy calculations and planting locations.
- The selected plan's ESD footprints and Q/WQv summary were preliminary. This revision does not promote those screening quantities into approved hydraulic design. Supporting engineering calculations must use the final building and pavement coverage, including all applicable contributing areas.

ROLLINS AVENUE | 1005 & 1009

Professional certification blocks - unsigned

GRADING CERTIFICATE

I HEREBY CERTIFY THAT THIS PLAN CONFORMS TO THE REQUIREMENTS OF SUBTITLE 32, DIVISION 2 OF THE CODE OF PRINCE GEORGE'S COUNTY WATER RESOURCES PROTECTION AND GRADING CODE; AND THAT I OR MY STAFF HAVE INSPECTED THIS SITE AND THAT DRAINAGE FLOWS FROM UPHILL PROPERTIES ONTO THIS SITE, AND FROM THIS SITE ONTO DOWNHILL PROPERTIES, HAVE BEEN ADDRESSED IN SUBSTANTIAL ACCORDANCE WITH APPLICABLE CODES. SIGNED, SEALED AND DATED BY A PROFESSIONAL ENGINEER LICENSED IN THE STATE OF MARYLAND.

MARYLAND PROFESSIONAL CERTIFICATION

I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND.

NAME / LICENSE NUMBER / EXPIRATION

SIGNATURE / DATE

SEAL

OWNER / APPLICANT NAME / ADDRESS / PHONE

DESIGNER NAME / ADDRESS / PHONE

CHECKER / DATE

ROLLINS AVENUE | 1005 & 1009

Application completion worksheet

DRAFT FOR THE RESPONSIBLE DESIGN PROFESSIONAL. Status reflects the files available here; it is not a county certification or agency decision. Complete official submittal and applicable design-review checklists with the application.

R01 - PARTIAL: Recorded boundary survey and WSSC benchmarks documented; vertical datum, grading, floor and utility design remain

R02 - PARTIAL: Both addresses added; owner and responsible professional details/signatures required

R03 - OPEN: Public utility containment and continuous approved connections

R04 - PARTIAL: Recorded status confirmed by applicant; upper private extension removed; no unlettered width asserted

R05 - OPEN: Approved concept and full stormwater design/report

R06 - PARTIAL: Proposed measured LOD added; final ESC design and approvals remain

R07 - PARTIAL: Soil component table/historical evidence added; current environmental/landscape documents remain

R08 - PARTIAL: Measured per-lot footprint clearances/ratios added; yard interpretation and projections remain

R09 - PARTIAL: Recorded areas and label corrections made; survey/control reconciliation remains

R10 - CLOSED: Full recorded conditions/adjoiners/legend supplied without ellipses

R11 - OPEN: Frontage width, cross slopes, driveway profiles and DPW&T determination

R12 - PARTIAL: Kingsworth areaways added; Lot 2 shifted to clear 8-foot side; complete upper building/trade designs remain

R13 - PARTIAL: Source dossier and preparation worksheet supplied; executed applications/approvals remain


REFERENCE AND SUBMISSION FILES

County Building Permit / Site-Road Design Review Checklist: [DocumentCenter/View/33110](#). Fine Grading Design Checklist: [DocumentCenter/View/4549](#). Fine Grading Submittal Checklist: [DocumentCenter/View/4569](#). Current county index checked September 9, 2026; direct PDF downloads returned HTTP 403. Use the linked official forms listed in README.md.

Attach applicable current concept, fine-grading, ESC, stormwater, WSSC, street and environmental approvals; ownership/authorization and parcel identification; executed professional certifications and supporting calculations. Check application-stage versus issuance-stage prerequisites with the responsible reviewer.

ROLLINS AVENUE | 1005 & 1009

Utility source reference - original page 2

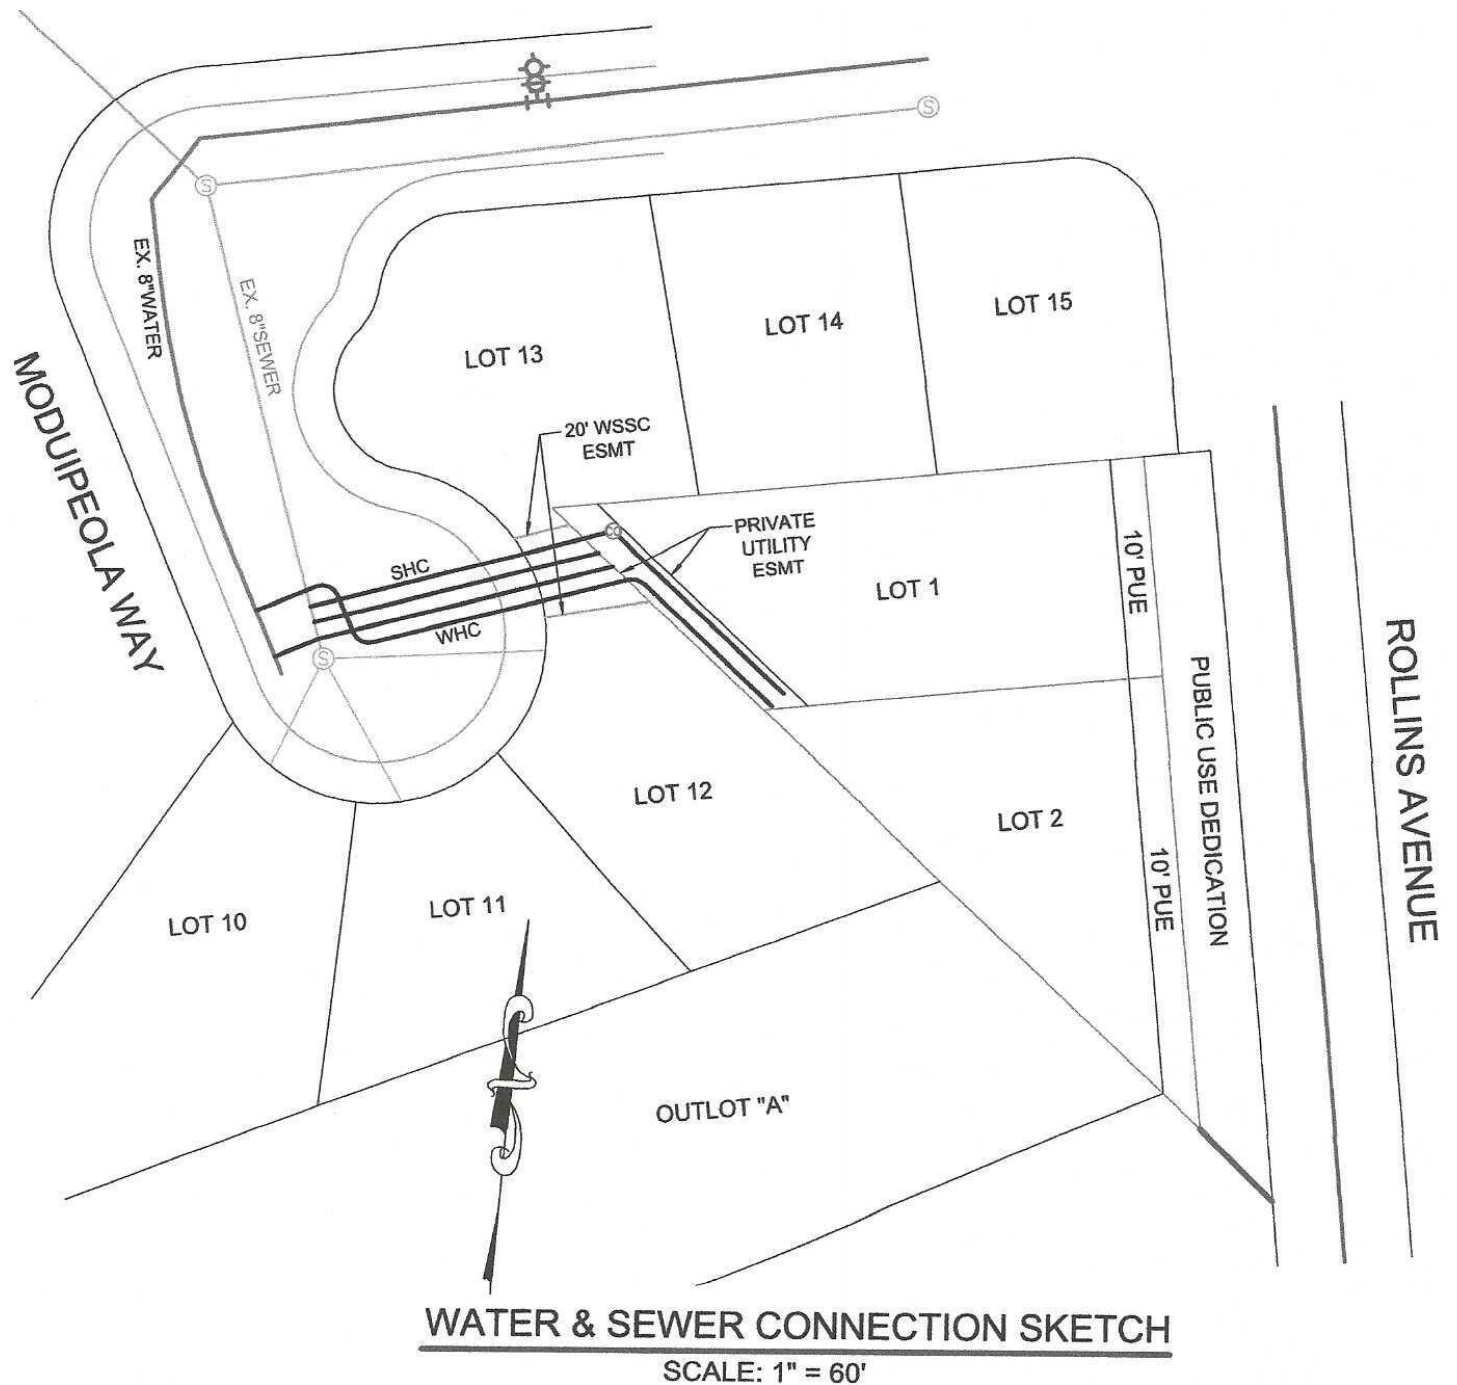

Source reproduction only. The original sketch controls the depicted connection concept; it does not supply a dimensioned private legal width or final surveyed vertical design.

ROLLINS AVENUE | 1005 & 1009

Baseline drainage summary - preliminary

The selected baseline contains the following drainage summary. It is retained here for design coordination. These are baseline screening outputs, not a completed hydraulic report or final ESD facility sizing.

PARAMETER	LOT 1	LOT 2
Baseline catchment SF	9,599	8,009
Baseline impervious %	17.0	20.4
Baseline pre Q (cfs)	0.37	0.31
Baseline post Q (cfs)	0.55	0.48
Baseline WQv (CF)	163	156
Depicted ESD footprint	214 SF	241 SF

The property schedule uses recorded areas 9,598 / 8,008 SF. The baseline catchment values above were computed geometry values. Recalculate the drainage model from final surveyed catchments and the complete selected building/pavement design before sizing facilities.

CALCULATION PACKAGE TO COMPLETE

Existing and proposed drainage maps with tributary areas and runoff classifications.

Rainfall depths/intensities, documented times of concentration and pre/post discharge calculations.

ESD volume, recharge and applicable quantity-control analysis; tested infiltration and facility storage/outlet computations.

Finished grades, facility sections, groundwater/limiting-layer separation and drawdown.

Receiving outfall capacity and the 100-year blocked-system overflow route; coordinated building protection levels.

No new stormwater performance is claimed by reproducing these values. Final approval must be coordinated with Concept 41230-2006-00 or its applicable approved revision.

ROLLINS AVENUE | 1005 & 1009

WSSC record benchmarks and utility evidence

The supplied WSSC final as-built sheet contains record benchmark elevations, existing utility profiles and adjoining-lot connection annotations. These values were omitted from the earlier source inventory. The applicant confirms that the supplied plats/easements are the recorded project documents.

BENCHMARK	RECORD ELEVATION
BM 1	213.89 ft
BM 2	218.28 ft
BM 3	214.61 ft

BM 1: PK nail in west side of Pepco pole 826379-0261, east side of Rollins Avenue, approximately 700 ft south of District Avenue. BM 2: PK nail in west side of Pepco pole, east side of Rollins Avenue, approximately 500 ft south of District Avenue. BM 3: high point in concrete monument, approximately 48 ft northeast near the right corner of house 5912 and 46 ft northeast near the left corner of house 5910. Verify identification against the original image before field use.

These are historical WSSC record elevations, not newly observed benchmark recoveries. The scan does not expressly establish their relationship to the NAVD88 contour data used on C-001. Profile labels DATUM 190 / 200 identify plot baselines and are not a vertical-datum transformation. No datum offset has been guessed.


EASEMENT AND BASEMENT COORDINATION

Use the supplied recorded easement documents as the project basis. Page 2 shows a 20-ft public WSSC corridor on Lot 13 and the private route on the lower portion of Lot 1. The source does not dimension the private width; the revised site sheet therefore shows the private route without the earlier rectangular width assumption. Public-junction geometry and service continuity remain to be reconciled.

The foundation source supplies basement/areaway geometry, not site-specific slab or service elevations. Basement plumbing and areaway drainage must be checked against the applicable WSSC sewer profile and a consistent vertical datum before selecting gravity connections or a pump design.

ROLLINS AVENUE | 1005 & 1009

Kingsworth basement/areaway source

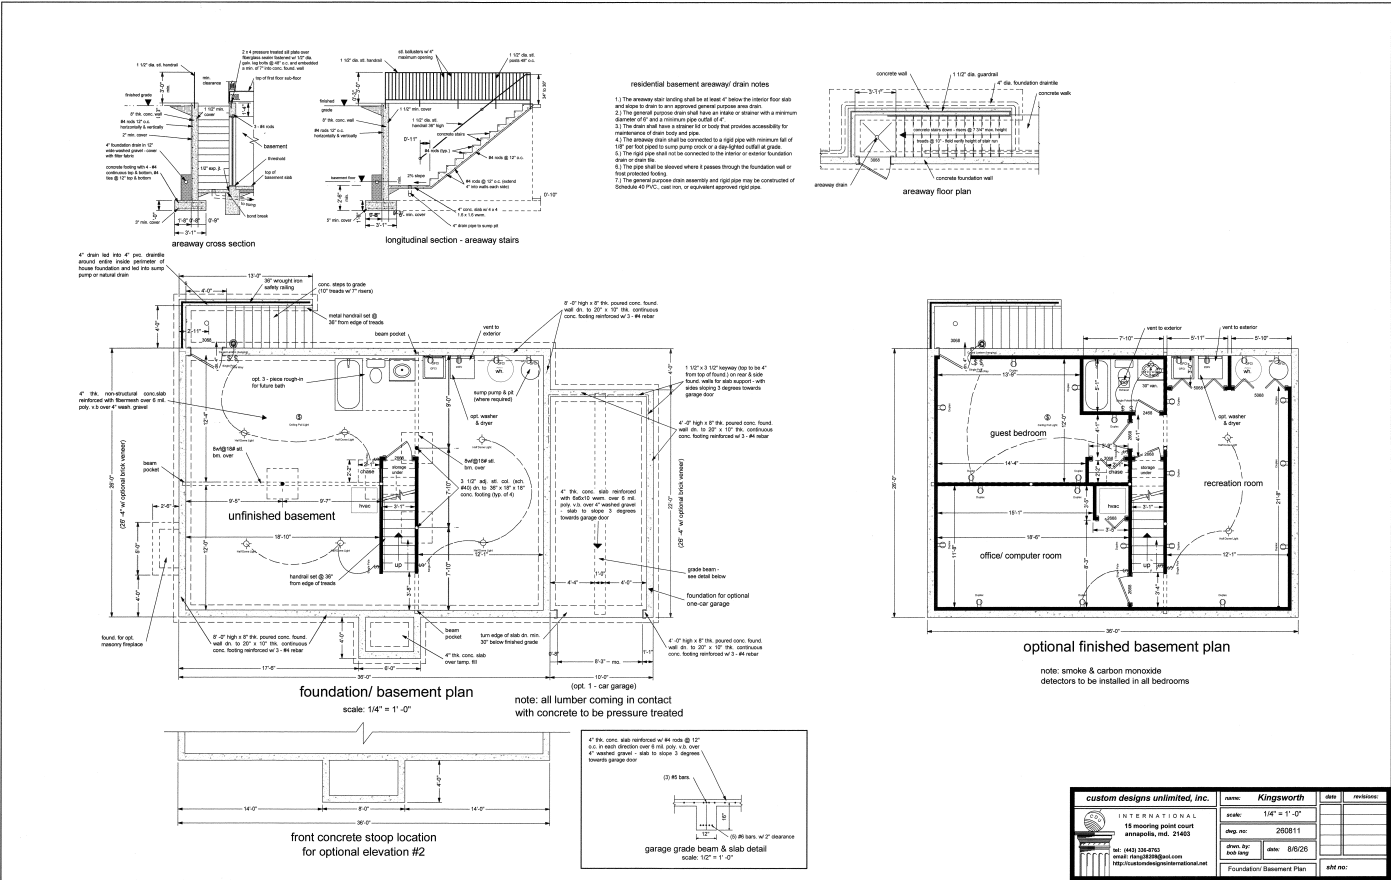

Original foundation/basement drawing retained as source evidence. Site areaways AW-1 and AW-2 follow its 13-ft overall length and 4-ft depth. The original author's notes apply to this source document; this reproduction does not constitute new professional approval.