

SITE DEVELOPMENT CONCEPT PLAN

ESTATES AT INDIAN HEAD — LOTS 1-6

200-205 ESTATES COURT, ACCOKEEK, MD 20607 · PLAT BOOK PM 228 PLAT 83 · TAX MAP 151 F-3 · WSSC 220SE01 · ELECTION DIST. 5 · COUNCIL DIST. 9 · ZONE RR
Stormwater management by Environmental Site Design to the Maximum Extent Practicable (MDE Design Manual Ch. 5; PGC Subtitle 32). Layout per the approved 2009 Street Tree & Lighting Plan, DPW&T 9399-2009-00.

PRINCE GEORGE'S COUNTY BMP SUMMARY TABLE — ESD BY POINT OF INVESTIGATION (A-15, C-9)

BMP	PRACTICE	MDE	LOCATION	OWNERSHIP / MAINT.	POI	DA SF	IMP SF	%I	HSG	P_E IN	Rv	ESDv REQ CF	ESDv PROV CF	Rev REQ CF	SURFACE SF	COORDINATES (NAD 83)
ESD-1	Micro-bioretentation	M-6	Lot 1	Private — lot owner (maintenance agreement)	POI-1	19,999	4,500	22.5	C	1.2	0.253	505	505	55	525	N 367.417 E 1,311.143
ESD-2	Micro-bioretentation	M-6	Lot 2	Private — lot owner (maintenance agreement)	POI-1	20,015	2,422	12.1	C	1.0	0.159	265	265	34	330	N 367.396 E 1,311.250
ESD-3	Micro-bioretentation	M-6	Lot 3	Private — lot owner (maintenance agreement)	POI-1	20,051	3,008	15.0	C	1.0	0.185	309	309	40	386	N 367.379 E 1,311.388
ESD-4	Micro-bioretentation	M-6	Lot 4	Private — lot owner (maintenance agreement)	POI-1	20,021	2,062	10.3	C	1.0	0.143	238	238	31	298	N 367.217 E 1,311.299
ESD-5	Micro-bioretentation	M-6	Lot 5	Private — lot owner (maintenance agreement)	POI-1	20,235	2,489	12.3	C	1.0	0.161	271	272	35	340	N 367.173 E 1,311.171
ESD-6	Micro-bioretentation	M-6	Lot 6	Private — lot owner (maintenance agreement)	POI-1	29,536	2,511	8.5	C	1.0	0.127	311	312	40	390	N 367.210 E 1,311.121
ESD-5	Roadside dry swales w/ check dams (999 LF)	M-8	Estates Ct R/W, both sides	Public — DPPE	POI-1	36,041	20,666	57.3	C	2.0	0.566	3,400	5,992	221	3,995	N 367.342 E 1,311.097
SUBTOTAL POI-1						POI-1						5,299	7,893			
TOTAL 7 ESD practices							165,898	37,658				5,299	7,893	456	6,264	

P, E from MDE Stormwater Design Manual (2000, Supp. 1 2009), Ch. 5, Table 5.3 — rainfall targets for ESD; HSG C governing; Rv = 0.05 + 0.009 L; ESDv = P_E Rv A12.15 = 0.13 in; HSG C1, met within ESDv; M-8 provided = 6 of per ft (4 ft bottom, 4" ponding, 2.5" media at n=0.40).

SITE DATA

ITEM	DATA
Project	Estates at Indian Head, Lots 1-6 and Estates Court
Location	5, side of MD 210, ±3,000 ft NE of MD 210 / MD 373; 200-205 Estates Ct, Accokeek 20607
Record	Plat Book PM 228 Plat 83 (final plat 5-08238); Tax Map 151 F-3; WSSC 2001 220SE01
Accounts	3987666, 3987674, 3987682, 3987690, 3987708, 3987716
Owner	Gerald Waldman Revocable Trust, L 32062 F.043
Zone / use	RR (no change) — 6 single-family detached dwellings
Tract	165,019 sf of record (3,788 ac) = plat 171,505 sf less Outlot A (6,486 sf, conveyed L 51565 F.455)
Public dedication	Estates Court 60' R/W, 35,173 sf of record — rural open section, 24' pavement, cul-de-sac
Water / sewer	W-3 / S-3 (WSSC) — mains from Henrietta Dr via 30' WSSC esmt; L 51799 F 399 and prop. Lot 4 esmt
Watershed	Piscataway Creek, MD 021402030798; not Tier II; not CBA; FEMA Zone X
Master plan	2013 Subregion 5 Master Plan & SMA; Planning Area 84; Council Dist. 9; Election Dist. 5
Datum	NAD 83 MD State Plane (US ft); NAVD 88 (M-NCPPC 2-ft); 2009 spot grades on WSSC datum

APPROVALS OF RECORD

CASE	STATUS
NRI-015-06	Approved — current
TCP1-018-06	Current
TCP2-016-09	Approved — current
5-08238	Final plat, PM 228 @ 83 — recorded
DPW&T 9399-2009-00	Street tree & lighting plan (2009) — layout followed
L 51799 F 399	30' WSSC easement (Outlot A, Lot 20) — recorded 2025

GENERAL NOTES


- Boundary per recorded plat PM 228 @ 83; lot lines reproduce the plat to the second. A Maryland licensed surveyor shall confirm the boundary and the MD 210 R/W before technical plans.
- Horizontal datum: Maryland State Plane NAD 83 (US ft). Vertical datum: NAVD 88 (M-NCPPC 2-ft contours). 2009 spot grades are on WSSC datum (= NAVD 88 + 1.6 ft, to be confirmed by the field-run survey). DPPE prefers NGVD 29 — the survey shall state the conversion.
- The layout follows the approved 2009 Street Tree & Lighting Plan (DPW&T 9399-2009-00): dwellings, side-load garages and courts, street trees and street lights. Lot 4 is front-load (garage to the cul-de-sac) to clear the WSSC easement.
- Estates Court is a rural open section (DPW&T Std. 500.10 / 600.02 / 600.04); 24' pavement, shoulders, roadside swales; driveways cross the swale on 15" RCP culverts with flared end sections.
- Entrance to MD 210 (SHA) with 50' returns as the 2009 plan; SHA access permit and sight-distance analysis required. MD 210 auxiliary lanes shown for SHA review; R/W dedication may be required.
- Water and sewer: WSSC mains from Henrietta Dr through the recorded 30' WSSC easement (L 51799 F 399) and a 30' WSSC easement to be granted across Lot 4. Record discrepancies in the easement description to be resolved with WSSC.
- Approvals of record NRI-015-06, TCP1-018-06 and TCP2-016-09 are current. No environmental features on the property: no streams, stream buffers, wetlands, floodplain, PMA, steep slopes, woodland, highly erodible soils or Chesapeake Bay Critical Area.
- Contact Miss Utility (811) at least 48 hours before any excavation.

DPIE CONCEPT PLAN DESIGN REVIEW CHECKLIST (08/25/2021) — C = SHOWN · X = N/A · 0 = OUTSTANDING

ITEM	REQUIREMENT	REF.	C/X/0	RESPONSE / WHERE SHOWN	SHEET
A-1	Plan is labeled as Site Development Concept Plan (aka Concept Plan from MDE step 1)		C	Every sheet is titled SITE DEVELOPMENT CONCEPT PLAN.	ALL
A-2	Plan sheet size does not exceed 30" x 42" and all sheets are printed on same size paper.	5.3.2	C	All sheets 24" x 36" (ARCH D).	ALL
A-3	A 5-inch, full-height open area is provided on the right-hand side of the drawing for County approval block.	2.2.1.A	C	5-inch full-height strip at the right edge, kept clear for DPPE.	ALL
A-4	If more than 4 plan sheets, composite plan showing match lines and sheet numbers (scale not to exceed 1"=200'); key map on each plan sheet.	2.2.1.C	C	8 sheets: the whole site is on each plan sheet at one scale, so no match lines; key map in every title block.	ALL
A-5	Match lines have a minimum length of 4 inches and identify the matching sheet number.	2.2.1.M	X	No match lines — the entire site fits one viewpoint.	
A-6	Vicinity map at a minimum scale of 1"=2,000' with north arrow and scale, upper right hand corner of cover sheet.	2.2.1.B	C	Vicinity map at 1" = 2,000' with north arrow and bar scale, upper right.	C-000
A-7	A bar scale is provided on every sheet.		C	Graphic bar scale in every plan viewpoint.	ALL
A-8	Three grid ticks are provided as described in the manual.	2.2.1.E	C	Three State Plane grid ticks with N/E values on each plan.	C-200
A-9	Horizontal (MD Coordinate System, NAD 83) and vertical (NGVD 29 preferred) datum is stated on the plan.		C	Horizontal Maryland State Plane, NAD 83 (EPSG 2248); US ft; vertical NAVD 88 (M-NCPPC 2-ft); 2009 spot grades WSSC datum as noted. NGVD 29 conversion to be stated by the field-run survey.	ALL
A-10	General notes about the project are provided.		C	General notes on the cover sheet.	C-000
A-11	The entire property is shown at a maximum plan scale of 1 inch = 50 feet (preferred) within the plan set.	5.3.2	C	Entire property at 1" = 30'.	C-200
A-12	All existing structures and site features including cultural features, historic sites and easements, and any visible foundations or ruins are shown.	5.3.2	C	Existing structures, adjoining houses, fences, sheds, well, easements of record shown; no historic sites or ruins.	C-100
A-13	Topographic contours at maximum 2 foot interval, extending at least 100 feet beyond the property.	32-182	C	M-NCPPC 2-ft contours, 100 ft beyond the property.	C-100
A-14	All existing utilities and utility easements are shown.		C	WSSC easement; L 51799 F 399 and the proposed Lot 4 WSSC easement; public utility easements along the frontage; existing mains in Henrietta Dr noted (sizes to verify on WSSC 220SE01).	C-300
A-15	The County BMP Summary Table is provided. Preferred location is on the cover sheet.	5.3.1	C	County BMP Summary Table, 7 practices.	C-000
B-1	Banks of all regulated streams or a centerline if the banks are too close together to graphically show.	MDE 5.7	X	No streams on site. NRI-015-06 approved (current); TCP1-018-06 and TCP2-016-09 (current).	
B-2	Location of stream and stream buffers and/or enhanced buffers per MNCPPC and SCD criteria.	MDE 5.7	X	No streams, no stream buffers.	
B-3	Location of wetlands and/or wetlands of special state concern and appropriate wetland buffers.	MDE 5.7	X	No wetlands on or within 100 ft (DNR, NRI).	
B-4	Delineation of the 100-year floodplain, per Techno-Gram 004-2020.	MDE 5.7	X	FEMA Zone X; no 100-yr floodplain on or within 100 ft.	
B-5	Location of steep slopes (15% and greater) clearly shown on the plan and in the legend.	M-NCPPC	X	No steep slopes (15% and greater) on the property.	
B-6	The Primary Management Area is delineated.	MDE 5.7	X	No PMA on the property.	
B-7	Existing woodland is delineated on the property.	MDE 5.7	X	No existing woodland on the property.	
B-8	Existing environmental features extend off the property 100 feet in all directions.	MNCPPC	X	No environmental features on or within 100 ft of the property.	
B-9	Soil types and soil boundaries from USDA NRCS Soil Survey (Dec. 2009 or latest).	C	C	Soil types and boundaries from USDA NRCS (PGAtlas Soil layer); CwE (HSG C); UdaE (HSG —); BaB (HSG C); BuB (HSG C).	C-100
B-10	Plan notes identify TMDL watershed (sediment, nitrogen, phosphorus) and Tier II waters/watershed.	C	C	Chesapeake Bay TMDL (nitrogen, phosphorus, sediment) applies; MD 12-digit watershed 021402030798, Piscataway Creek (02140203). Tier II: no.	C-000
B-11	Highly erodible soils noted.	MDE 5.7	X	No highly erodible soils on the property.	
B-12	Springs and seeps noted.	MDE 5.7	X	None observed or mapped.	
B-13	Bedrock and Marlboro Clay outcrops noted.	MDE 5.7	X	No bedrock or Marlboro clay mapped (PGAtlas); geotechnical report to confirm (E-2).	
B-14	Chesapeake Bay Critical Areas delineated.	MDE 5.7	X	Not in the Chesapeake Bay Critical Area.	

CHECKLIST (CONT.)

ITEM	REQUIREMENT	REF.	C/X/0	RESPONSE / WHERE SHOWN	SHEET
C-1	Project layout is shown, including roads, buildings, parking, sidewalk and other improvements and associated grading.	32-182	C	Estates Court, 6 dwellings, driveways and courts, entrance at MD 210, grading.	C-200
C-2	Preliminary locations of ESD and structural stormwater practices; grading for devices where slopes exceed 15%.	32-182	C	7 ESD practices (micro-bioretentation M-6 per lot; roadside dry swales M-8).	C-400
C-3	Preliminary locations of storm drain inlets and culverts; entrance and outfall structures located beyond project limits (easements may be required).	5.2.4.4.2B / 32-162.A.6	C	Open section — no inlets; 6 driveway culverts (15" RCP) with end sections; swales outfall at the entrance to the MD 210 roadside ditch (SHA).	C-400
C-4	Limit of Disturbance shown for all site work, incl. water, sewer, storm drain, SWM, road improvements, sediment control, stockpile.	32-182	C	LOD 22,365 sf incl. mains, easement work off site, sediment control and stockpile.	C-500
C-5	Existing easements shown and any required offsite proposed easements.		C	Recorded WSSC easement (Outlot A, Lot 20) and proposed Lot 4 WSSC easement; private SWM easements over ESD practices.	C-300
C-6	Locations, names and widths of existing and ultimate rights-of-way of adjacent streets and alleys; public vs. private noted.		C	MD 210 (variable R/W, SHA); Estates Ct (60' public), Henrietta Dr and Jennifer Dr (50' public), 30' R/W in common; L 10142 F 725 (private).	C-200
C-7	Existing and proposed water well and septic field locations are shown.		C	No wells or septic proposed (public water and sewer); Existing well on Parcel 199 (15608 Indian Head Hwy), off site, shown.	C-100
C-8	Proposed public dedication area including any proposed parkland is shown and labeled.		C	Estates Court public dedication 36,041 sf (plat PM 228 @ 83); no parkland.	C-200
C-9	Points of investigation shown; ESDv computations and BMP Summary Table broken out to show ESD Required is Provided within each POI.		C	1 POI(s); ESDv required vs. provided tabulated per POI.	C-400
C-10	The ultimate 100-year stormwater overflow path is shown throughout the site using flow arrows.		C	100-yr overflow arrows from every practice to its POI (11).	C-400
C-11	Drainage areas to each device, offsite drainage onto the site, and to site outfalls; diverted areas analysed for no increase in 100-yr discharge.		C	Drainage area to each practice; off-site area onto the site 0.49 ac; no diversion between POIs.	C-400
C-12	Where grading blocks a drainage course, ponding limits before and after grading are shown.		X	No fill across a drainage course.	
D-1	Report addresses natural resource protection, natural flow patterns, impervious reduction, ESC integration, ESD planning to the MEP.	MDE 5.11	C	SWM concept narrative; natural resources, natural flow patterns, impervious reduction, ESD to the MEP, ESC integration.	C-410
D-2	If in the Chesapeake Bay Critical Area, discussion of flow requirements are met; preliminary computations.		X	Not in the Chesapeake Bay Critical Area.	
D-3	Outfalls located outside the site, to existing storm drain or 100-yr floodplain, otherwise the discharge area is described.		C	Outfall at each POI and the receiving area described.	C-410
D-4	Stabilization at downstream outfall and upstream inflow evaluated; measures against gully formation discussed.		C	Outfall velocity checked at the 10- and 100-yr flows; rock outlet protection at each POI; upstream inflow evaluated.	C-410
D-5	Photographs of the stream at the downstream outfall and upstream property line; eroded slopes.		X	No stream at the outfalls.	
D-6	If outfall is to an existing SWM facility, its capacity for the added area and flow is documented.		X	No existing SWM facility receives the site.	
D-7	If rezoned to higher imperviousness, effects on downstream properties analysed.		X	No rezoning (RR remains RR).	
D-8	Floodplain ordinance discussion (drainage courses, buildings within 25 ft of floodplain, dams, downstream crossings).		X	No floodplain or drainage course on or downstream within the site; no dams.	
D-9	If a waiver of water quality or quantity is requested, the basis is provided.		X	No waiver requested.	
D-10	Computations: ESD/WQv required and provided; 100-yr existing and proposed runoff; downstream storm drain analysis with 10-yr control if inadequate.	5.3.3 / 5.2.6.1 / 5.2.4.2 / TG 002-2019	O	ESDv per POI on the cover; 100-yr existing vs. proposed runoff at each POI on C-410. Outstanding: downstream adequacy analysis (field-run survey).	C-410
E-1	A Geotechnical Report for SWM is provided to support concept development and feasibility.	5.3.3 / TG 004-2018	O	Geotechnical report for SWM (borings and Sec. 32-131 infiltration tests at each practice) — to be submitted.	
E-2	Geotechnical Report addresses Marlboro and Christiana clays, sulfidic and diatomaceous soils.	5.3.3 / TG 005-2018 / PGSCD I-8	O	Geotechnical report to address Marlboro/Christiana clays, sulfidic and diatomaceous soils.	
E-3	Affidavit of Public Informational mailing is provided with second submission.	32-182(g)	O	Affidavit of the adjacent-owner mailing (within 7 days of submital) — with second submission.	
E-4	A draft Natural Resource Inventory is provided with initial submission (approved copy required prior to approval).	32-182(a)	C	NRI-015-06 approved (current); TCP1-018-06 and TCP2-016-09 (current).	

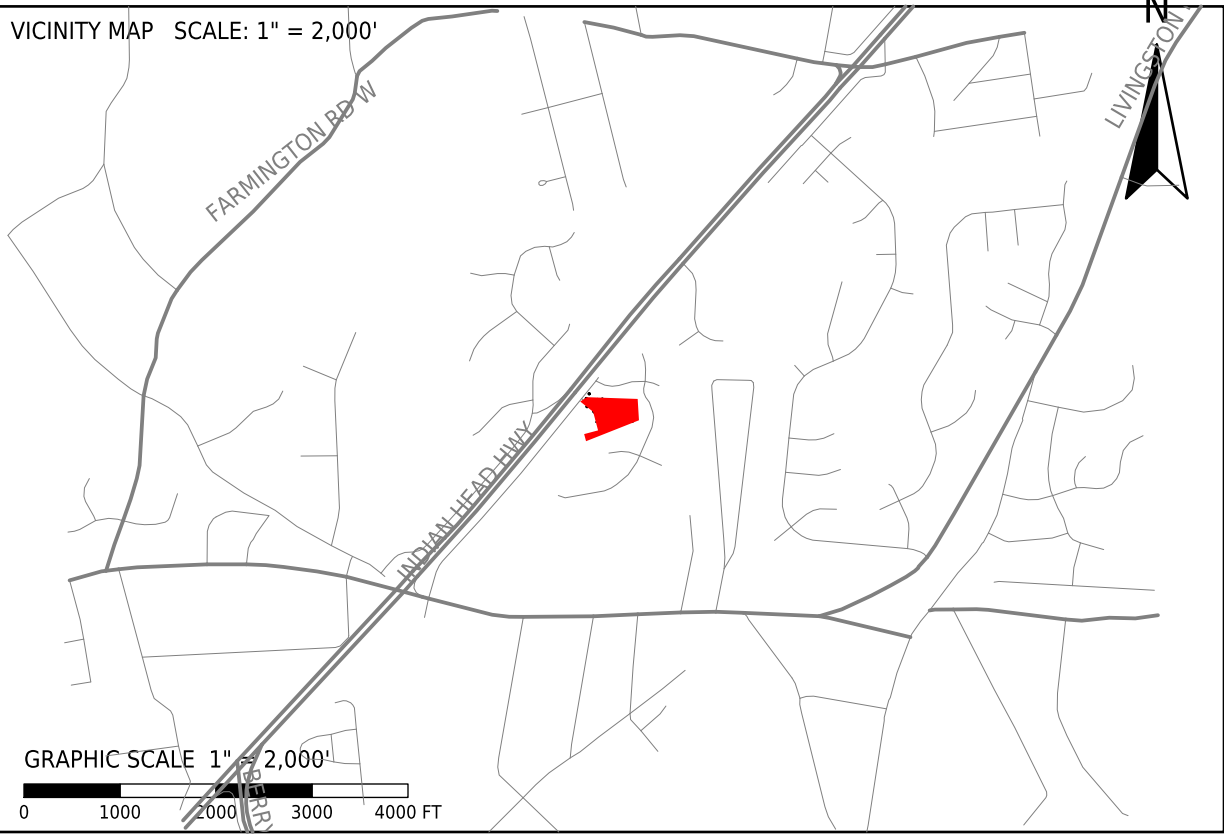

PLAN TYPE

SITE DEVELOPMENT CONCEPT PLAN


PROJECT: ESTATES AT INDIAN HEAD — LOTS 1-6
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT BOOK PM 228 PLAT 83 · TAX MAP 151 F-3 · WSSC 220SE01
ELECTION DIST. 5 · COUNCIL DIST. 9 · ZONE RR
OWNER / APPLICANT: GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L 32062 F.043)

ENGINEER OF RECORD: W.L. MECKINS, INC. — BILL MECKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747 · 301-736-7115

SHEET TITLE

COVER SHEET — BMP SUMMARY, DPPE CHECKLIST AND NOTES

KEY MAP

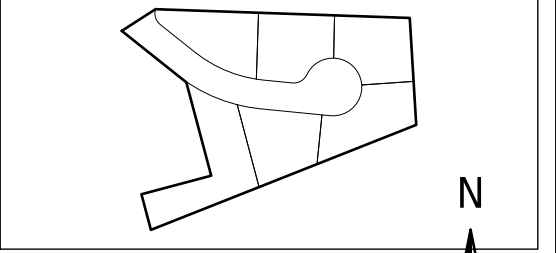


SCALE

AS NOTED

DATUM: NAD 83 MD STATE PLANE (US FT) / NAVD 88

REVISIONS	NO.	DATE	DESCRIPTION
1	2026-09-30	CONCEPT SUBMISSION 1	

PROFESSIONAL CERTIFICATION
I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____, Exp. _____

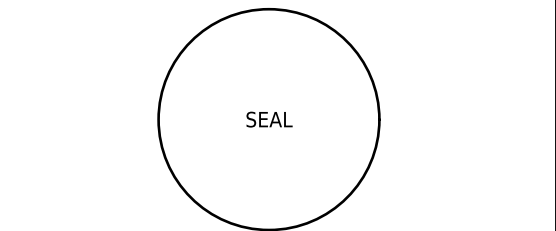

CONCEPT SUBMISSION 1 — NOT SEALED

DATE: 2026-09-30 · JOB: KEA-EH-2026
PREPARED WITH: KHAUS DATAL, ENGINEER / CAD / LOT

SHEET INDEX

C-000 COVER SHEET — BMP SUMMARY, DPPE CHECKLIST AND NOTES
C-100 EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES
C-200 SITE LAYOUT, GRADING AND PAVING PLAN
C-300 UTILITY, STREET LIGHT AND STREET TREE PLAN
C-400 STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP
C-410 STORMWATER MANAGEMENT CONCEPT NARRATIVE AND 100-YR COMPUTATIONS
C-500 SEDIMENT AND EROSION CONTROL PLAN
C-600 DETAILS


SHEET

C-000

1 OF 8

RESERVED FOR PRINCE GEORGE'S COUNTY DPPE APPROVAL BLOCK
(5-IN FULL-HEIGHT AREA KEPT OPEN — CHECKLIST A-3)

EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES

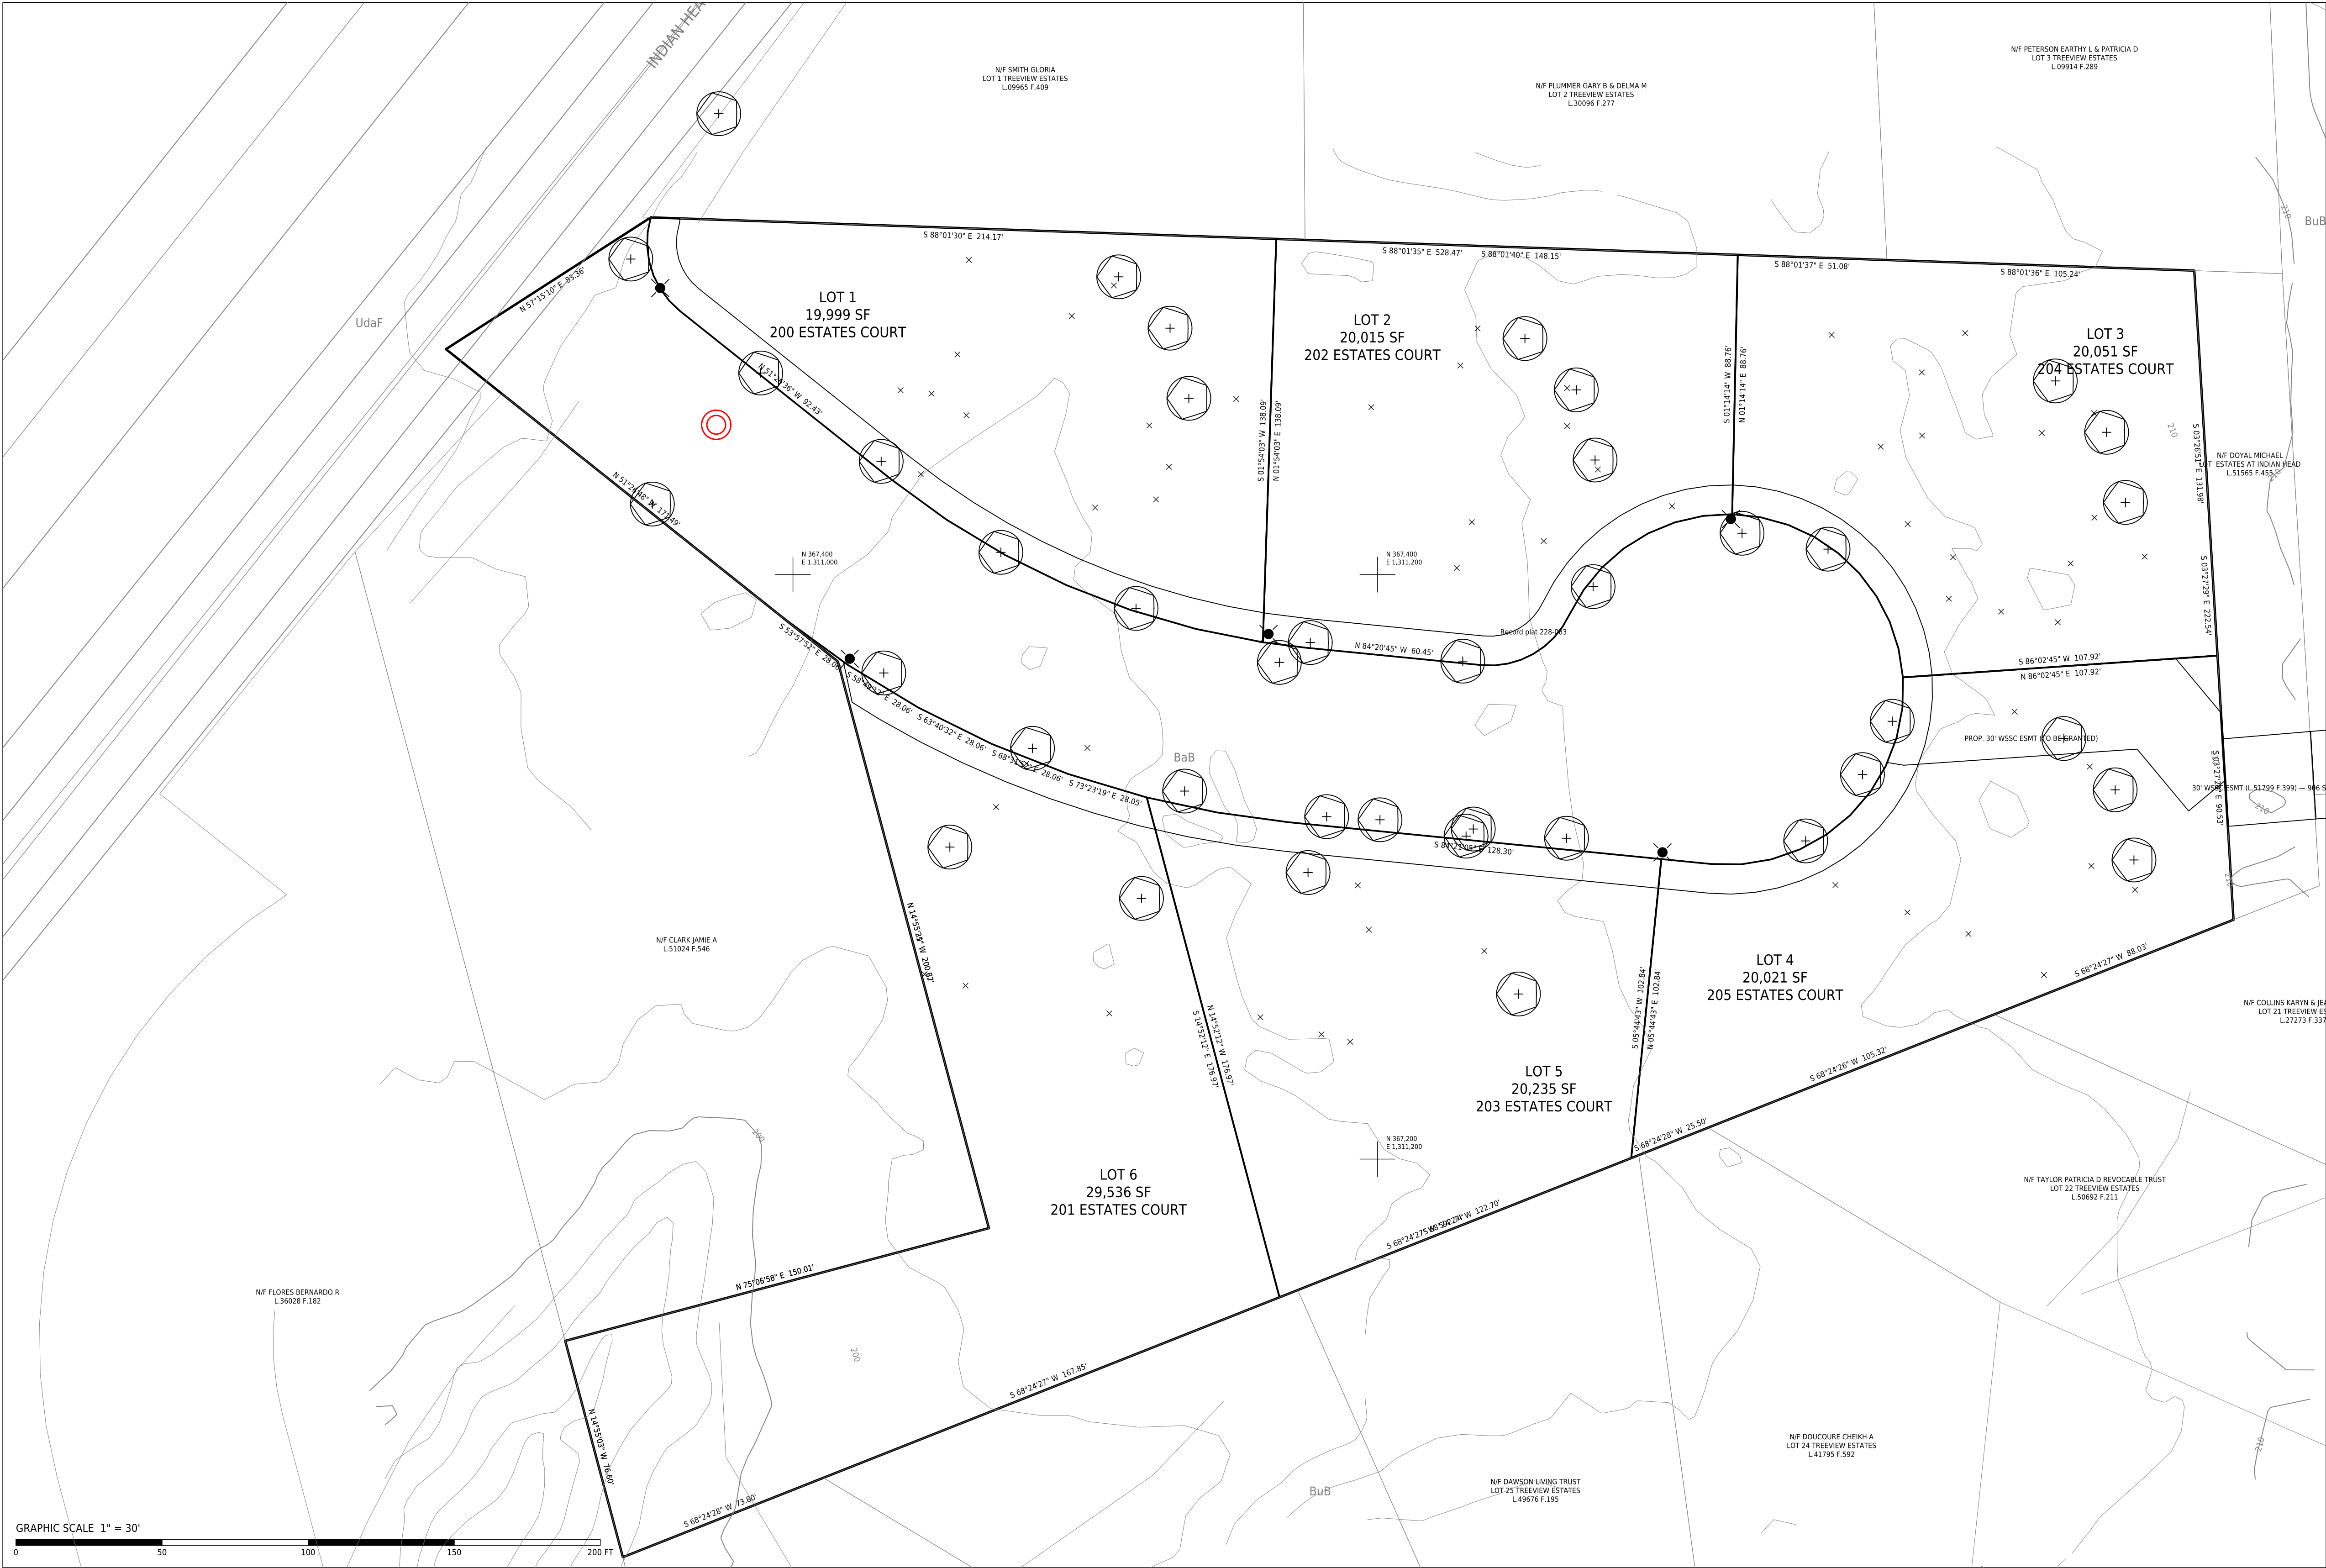

LEGEND

- Boundary of record (plat PM 228 @ 83)
- Lot line
- Adjoining property
- Existing contour, 10-ft (NAVD 88)
- UdaF
- Existing contour, 2-ft
- Existing edge of road
- Existing right-of-way
- Soil boundary (USDA NRCS)
- Easement

SOILS (USDA NRCS)

SYMBOL	NAME	HSG	K	HIGHLY ERODIBLE
CwE	Croom-Marr complex, 15 to 25 percent slopes	C	.15	NO
UdaF	Udorthents, highway, 0 to 65 percent slopes	—	—	NO
BaB	Beltsville silt loam, 2 to 5 percent slopes	C	.37	NO
BuB	Beltsville-Urban land complex, 0 to 5 percent slopes	C	.37	NO

ENVIRONMENTAL FEATURES — DPIE CHECKLIST B

ITEM	CX/D	FINDING
B-1	X	No streams on site. NRI-015-06 approved (current); TCP1-018-06 and TCP2-016-09 (current).
B-2	X	No streams, no stream buffers.
B-3	X	No wetlands on or within 100 ft (DNR, NRI).
B-4	X	FEMA Zone X: no 100-yr floodplain on or within 100 ft.
B-5	X	No steep slopes (15% and greater) on the property.
B-6	X	No PMA on the property.
B-7	X	No existing woodland on the property.
B-8	X	No environmental features on or within 100 ft of the property.
B-9	C	Soil types and boundaries from USDA NRCS (PGAtlas Soil layer): CwE (HSG C); UdaF (HSG —); BaB (HSG C); BuB (HSG C).
B-10	C	Chesapeake Bay TMDL (nitrogen, phosphorus, sediment) applies; MD 12-digit watershed 021402030798, Piscataway Creek (02140203). Tier II: No.
B-11	X	No highly erodible soils on the property.
B-12	X	None observed or mapped.
B-13	X	No bedrock or Marlboro clay mapped (PGAtlas); geotechnical report to confirm (E-2).
B-14	X	Not in the Chesapeake Bay Critical Area.

PLAN TYPE
SITE DEVELOPMENT CONCEPT PLAN


PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT BOOK PM 228 PLAT 83 - TAX MAP 151 F-3 - WSSC
220501
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE RR

OWNER / APPLICANT
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST
PALM BEACH, FL 33401 (L 32062 F 043)

ENGINEER OF RECORD
W.L. MEEKINS, INC. — BILL MEEKINS, JR., 3101 RITCHIE ROAD,
FORESTVILLE, MD 20747 - 301-736-7115

SHEET TITLE
EXISTING CONDITIONS AND ENVIRONMENTAL
FEATURES


KEY MAP

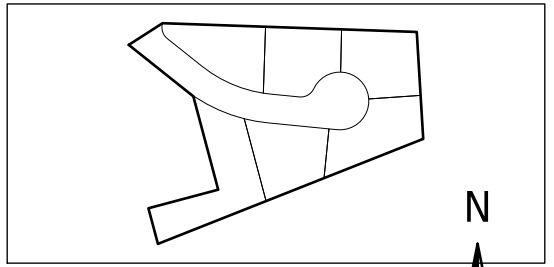

SCALE
1" = 30'
DATUM: NAD 83 MD STATE PLANE (US FT) / NAVD 88

REVISIONS	NO.	DATE	DESCRIPTION
1	2026-09-30	CONCEPT SUBMISSION 1	

PROFESSIONAL CERTIFICATION
I hereby certify that these documents were prepared or approved by me,
and that I am a duly licensed professional engineer under the laws of
the State of Maryland. License No. _____ Exp. _____

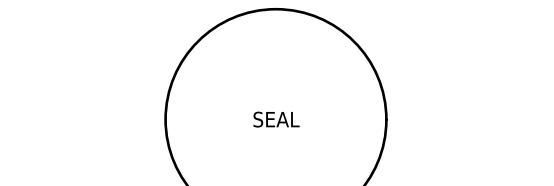


CONCEPT SUBMISSION 1 — NOT SEALED

DATE: 2026-09-30 - JOB: KEA-EIH-2026
PREPARED WITH: SCALE: 1"=30' (1"=30' PLAT)
SHEET INDEX:
C-100 COVER SHEET - BMP SUMMARY, DPIE CHECKLIST AND NOTES
C-100 EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES
C-200 SITE LAYOUT, GRADING AND DRAINAGE PLAN
C-300 UTILITY, STREET LIGHT AND STREET TREE PLAN
C-400 STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP
C-410 STORMWATER MANAGEMENT CONCEPT NARRATIVE AND 100-YR
COMPUTATIONS
C-500 SEDIMENT AND EROSION CONTROL PLAN
C-600 DETAILS

RESERVED FOR PRINCE GEORGE'S COUNTY DPIE APPROVAL BLOCK
(5-IN FULL-HEIGHT AREA KEPT OPEN — CHECKLIST A-3)

SITE LAYOUT, GRADING AND PAVING PLAN

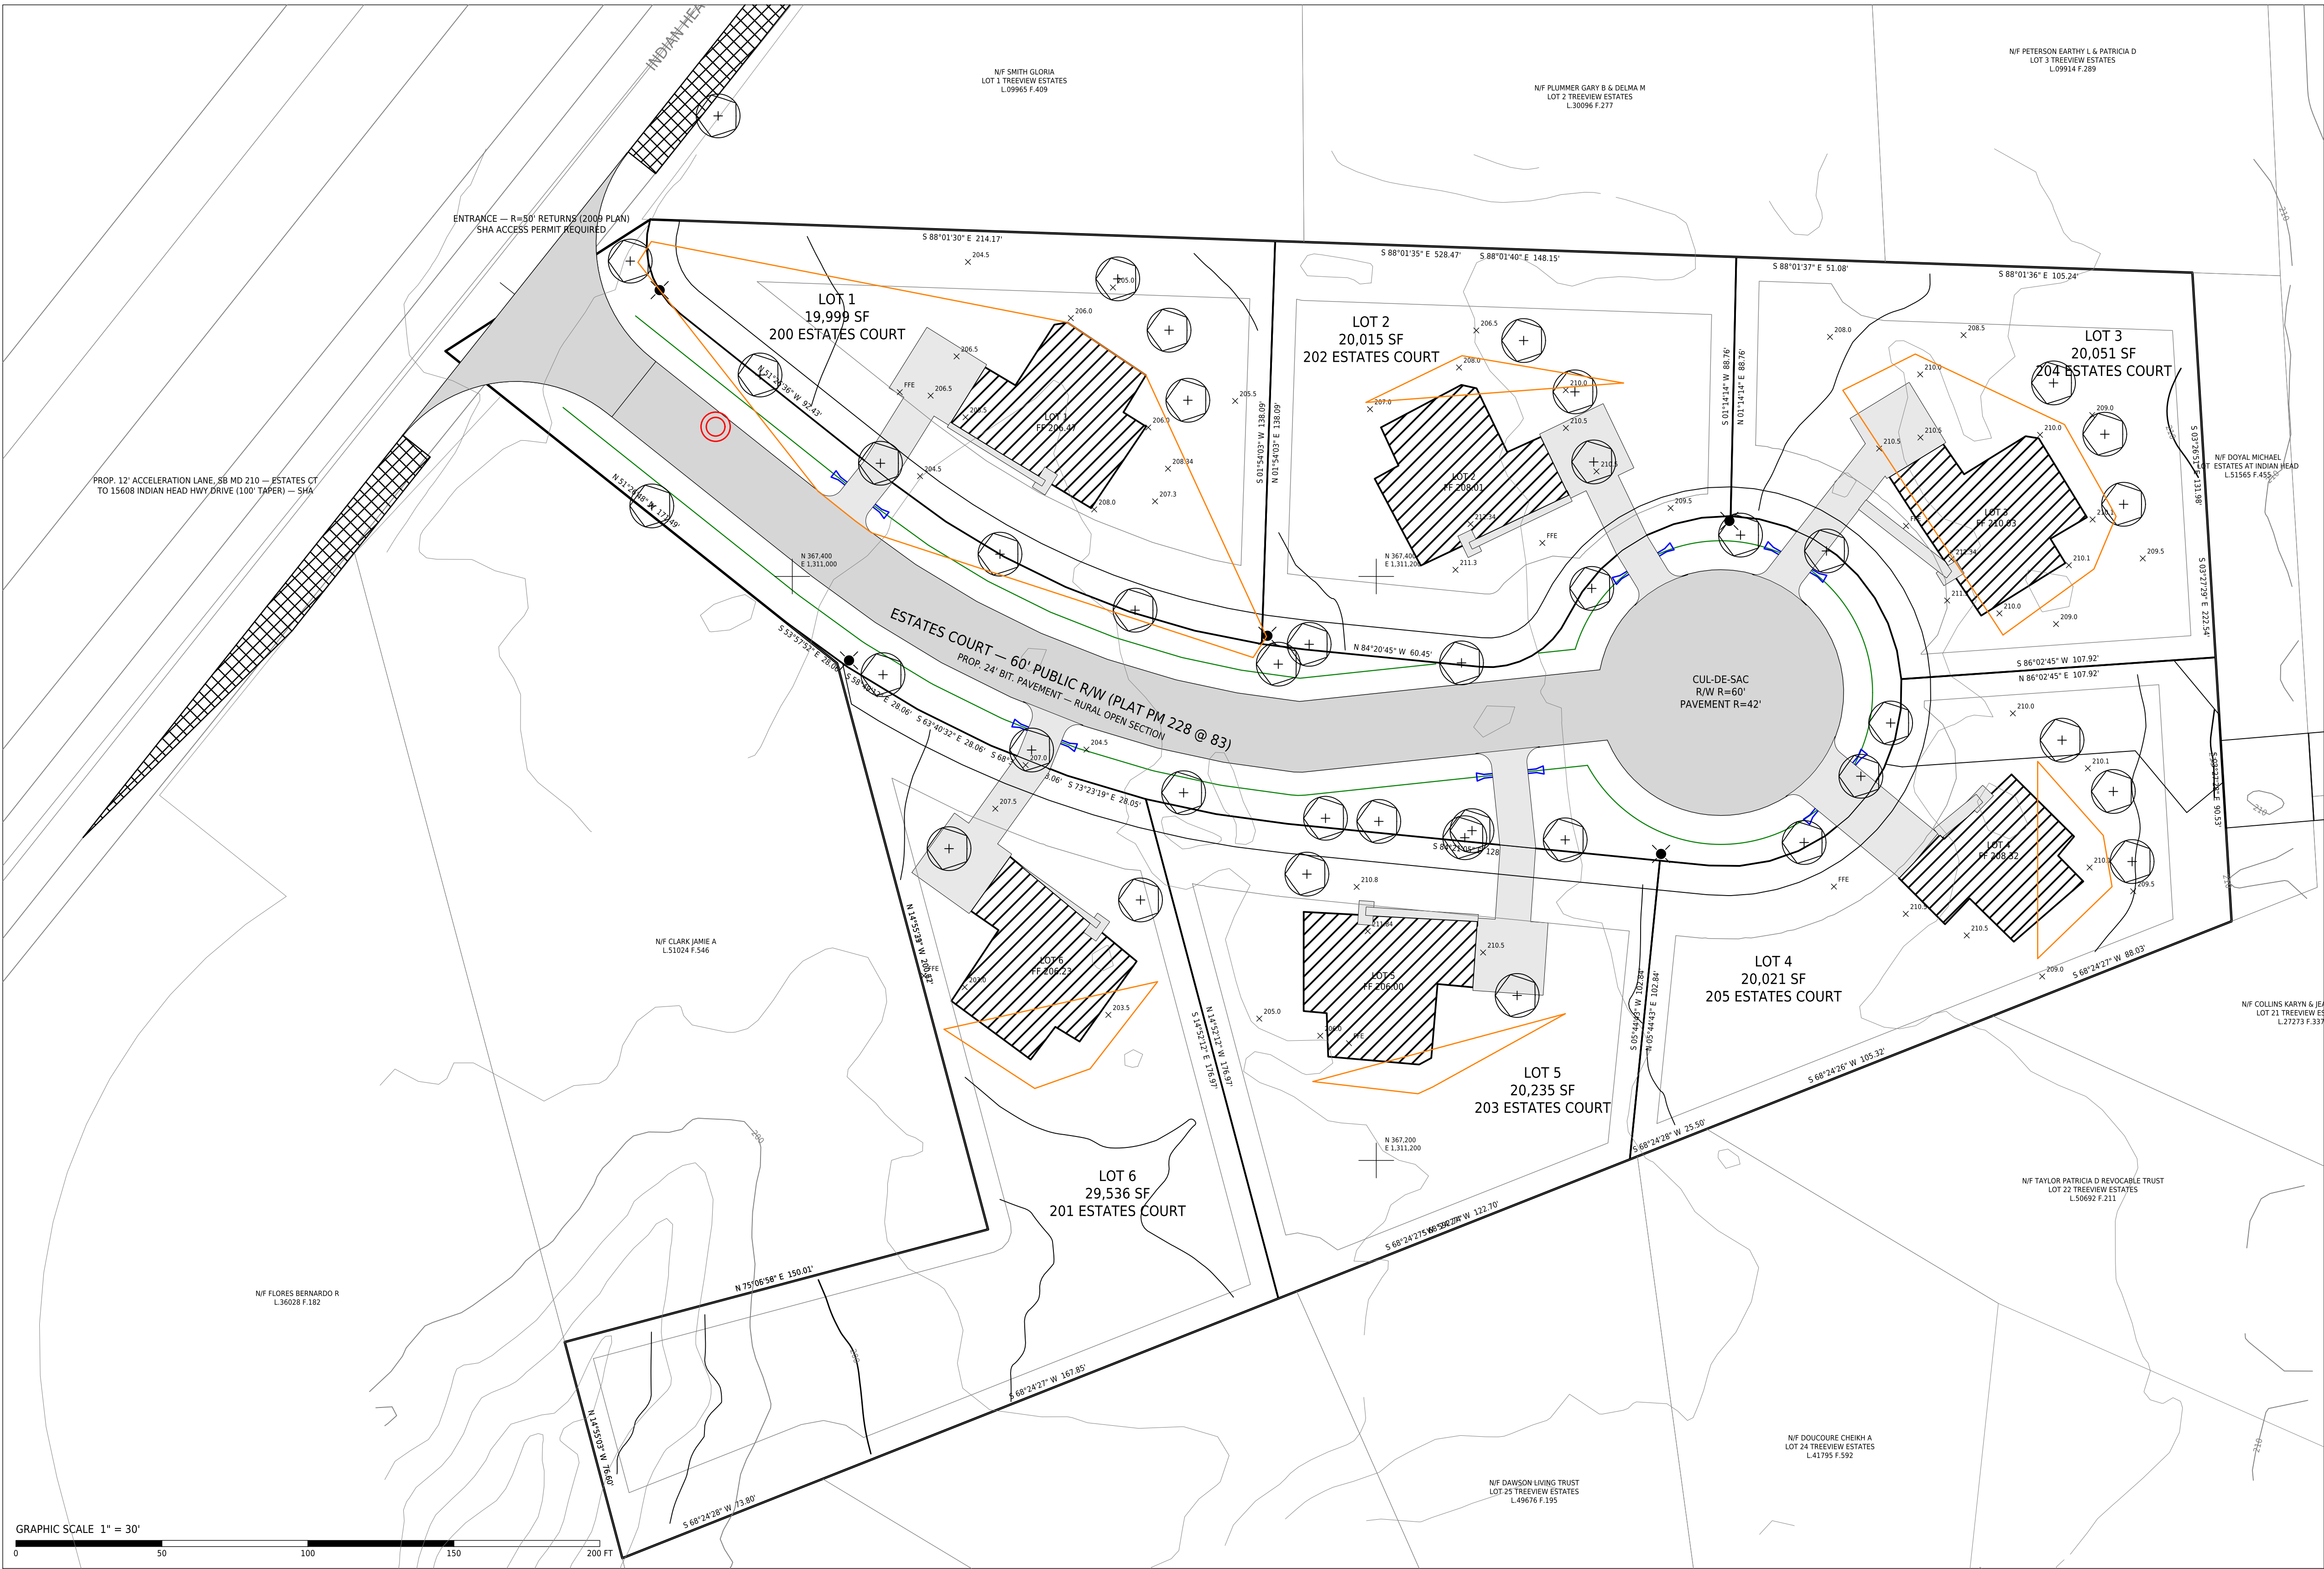

- LEGEND**
- Boundary of record
 - Estates Ct right-of-way
 - Proposed pavement
 - Roadside swale (flowline)
 - Driveway culvert, 15" RCP w/ end sections
 - Proposed dwelling
 - Building restriction line
 - Proposed contour
 - Existing contour
 - Spot elevation (2009 plan, WSSC datum)
 - Limit of disturbance
 - MD 210 auxiliary lane (SHA)

BUILDING DATA				
LOT	ADDRESS	FOOTPRINT SF	GARAGE FF (NAVD 88)	B (NAVD 88)
LOT 1	200 ESTATES COURT	2349	206.47	197.47
LOT 2	202 ESTATES COURT	2325	208.01	199.01
LOT 3	204 ESTATES COURT	2313	210.03	201.03
LOT 4	205 ESTATES COURT	1902	208.32	199.32
LOT 5	203 ESTATES COURT	2408	206.00	197.00
LOT 6	201 ESTATES COURT	2333	206.23	197.23

- SITE, ROAD AND GRADING NOTES**
- Boundary per recorded plat PM 228 @ 83; lot lines reproduce the plat to the second. A Maryland licensed surveyor shall confirm the boundary and the MD 210 R/W before technical plans.
 - Horizontal datum: Maryland State Plane NAD 83 (US ft). Vertical datum: NAVD 88 (M-NCPPC 2-ft contours). 2009 spot grades are on WSSC datum (= NAVD 88 + 1.6 ft, to be confirmed by the field-run survey). DP/IE prefers NGVD 29 — the survey shall state the conversion.
 - The layout follows the approved 2009 Street Tree & Lighting Plan (DPW&T 9399-2009-00); dwellings, side-load garages and courts, street trees and street lights. Lot 4 is front-load (garage to the cul-de-sac) to clear the WSSC easement.
 - Estates Court is a rural open section (DPW&T Std. 500.10 / 600.02 / 600.04); 24' pavement, shoulders, roadside swales; driveways cross the swale on 15" RCP culverts with flared end sections.
 - Entrance to MD 210 (SHA) with 50' returns as the 2009 plan; SHA access permit and sight-distance analysis required. MD 210 auxiliary lanes shown for SHA review; R/W dedication may be required.
 - MD 210 frontage improvements are shown for SHA review. At the entrance the MD 210 R/W line lies about 6 ft off the edge of road (2009 sheet), so a 12-ft lane needs R/W dedication along Lots 1 and 6 or SHA agreement. Lane lengths and tapers are set by SHA's access-permit review and traffic study.


PLAN TYPE
SITE DEVELOPMENT CONCEPT PLAN

PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT BOOK PM 228 PLAT 83 - TAX MAP 151 F-3 - WSSC 220501
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE RR

OWNER / APPLICANT
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L 32062 F 043)

ENGINEER OF RECORD
W.L. MECKINS, INC. — BILL MECKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747-301-736-7115


SHEET TITLE
SITE LAYOUT, GRADING AND PAVING PLAN

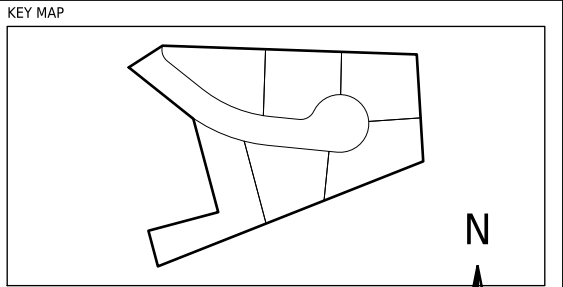

SCALE
1" = 30'
DATUM: NAD 83 MD STATE PLANE (US FT) / NAVD 88

REVISIONS	NO.	DATE	DESCRIPTION
	0	2026-09-30	CONCEPT SUBMISSION 1


PROFESSIONAL CERTIFICATION
I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Exp. _____

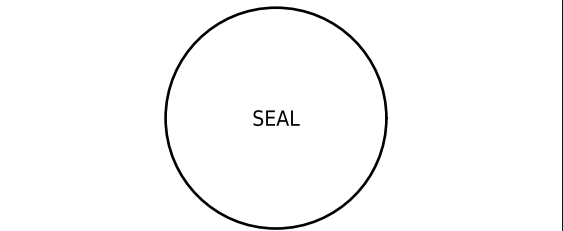

CONCEPT SUBMISSION 1 — NOT SEALED
DATE 2026-09-30 - JOB KEA-EH-2026
PREPARED WITH RESCALE SPATIAL ENGINEERING, LLC (PLOT)

- SHEET INDEX**
- C-000 COVER SHEET — BMP SUMMARY, DP/IE CHECKLIST AND NOTES
 - C-100 EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES
 - C-200 SITE LAYOUT, GRADING AND PAVING PLAN
 - C-300 UTILITY, STREET LIGHT AND STREET TREE PLAN
 - C-400 STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP
 - C-410 STORMWATER MANAGEMENT CONCEPT NARRATIVE AND 100-YR COMPUTATIONS
 - C-500 SEDIMENT AND EROSION CONTROL PLAN
 - C-600 DETAILS

UTILITY, STREET LIGHT AND STREET TREE PLAN

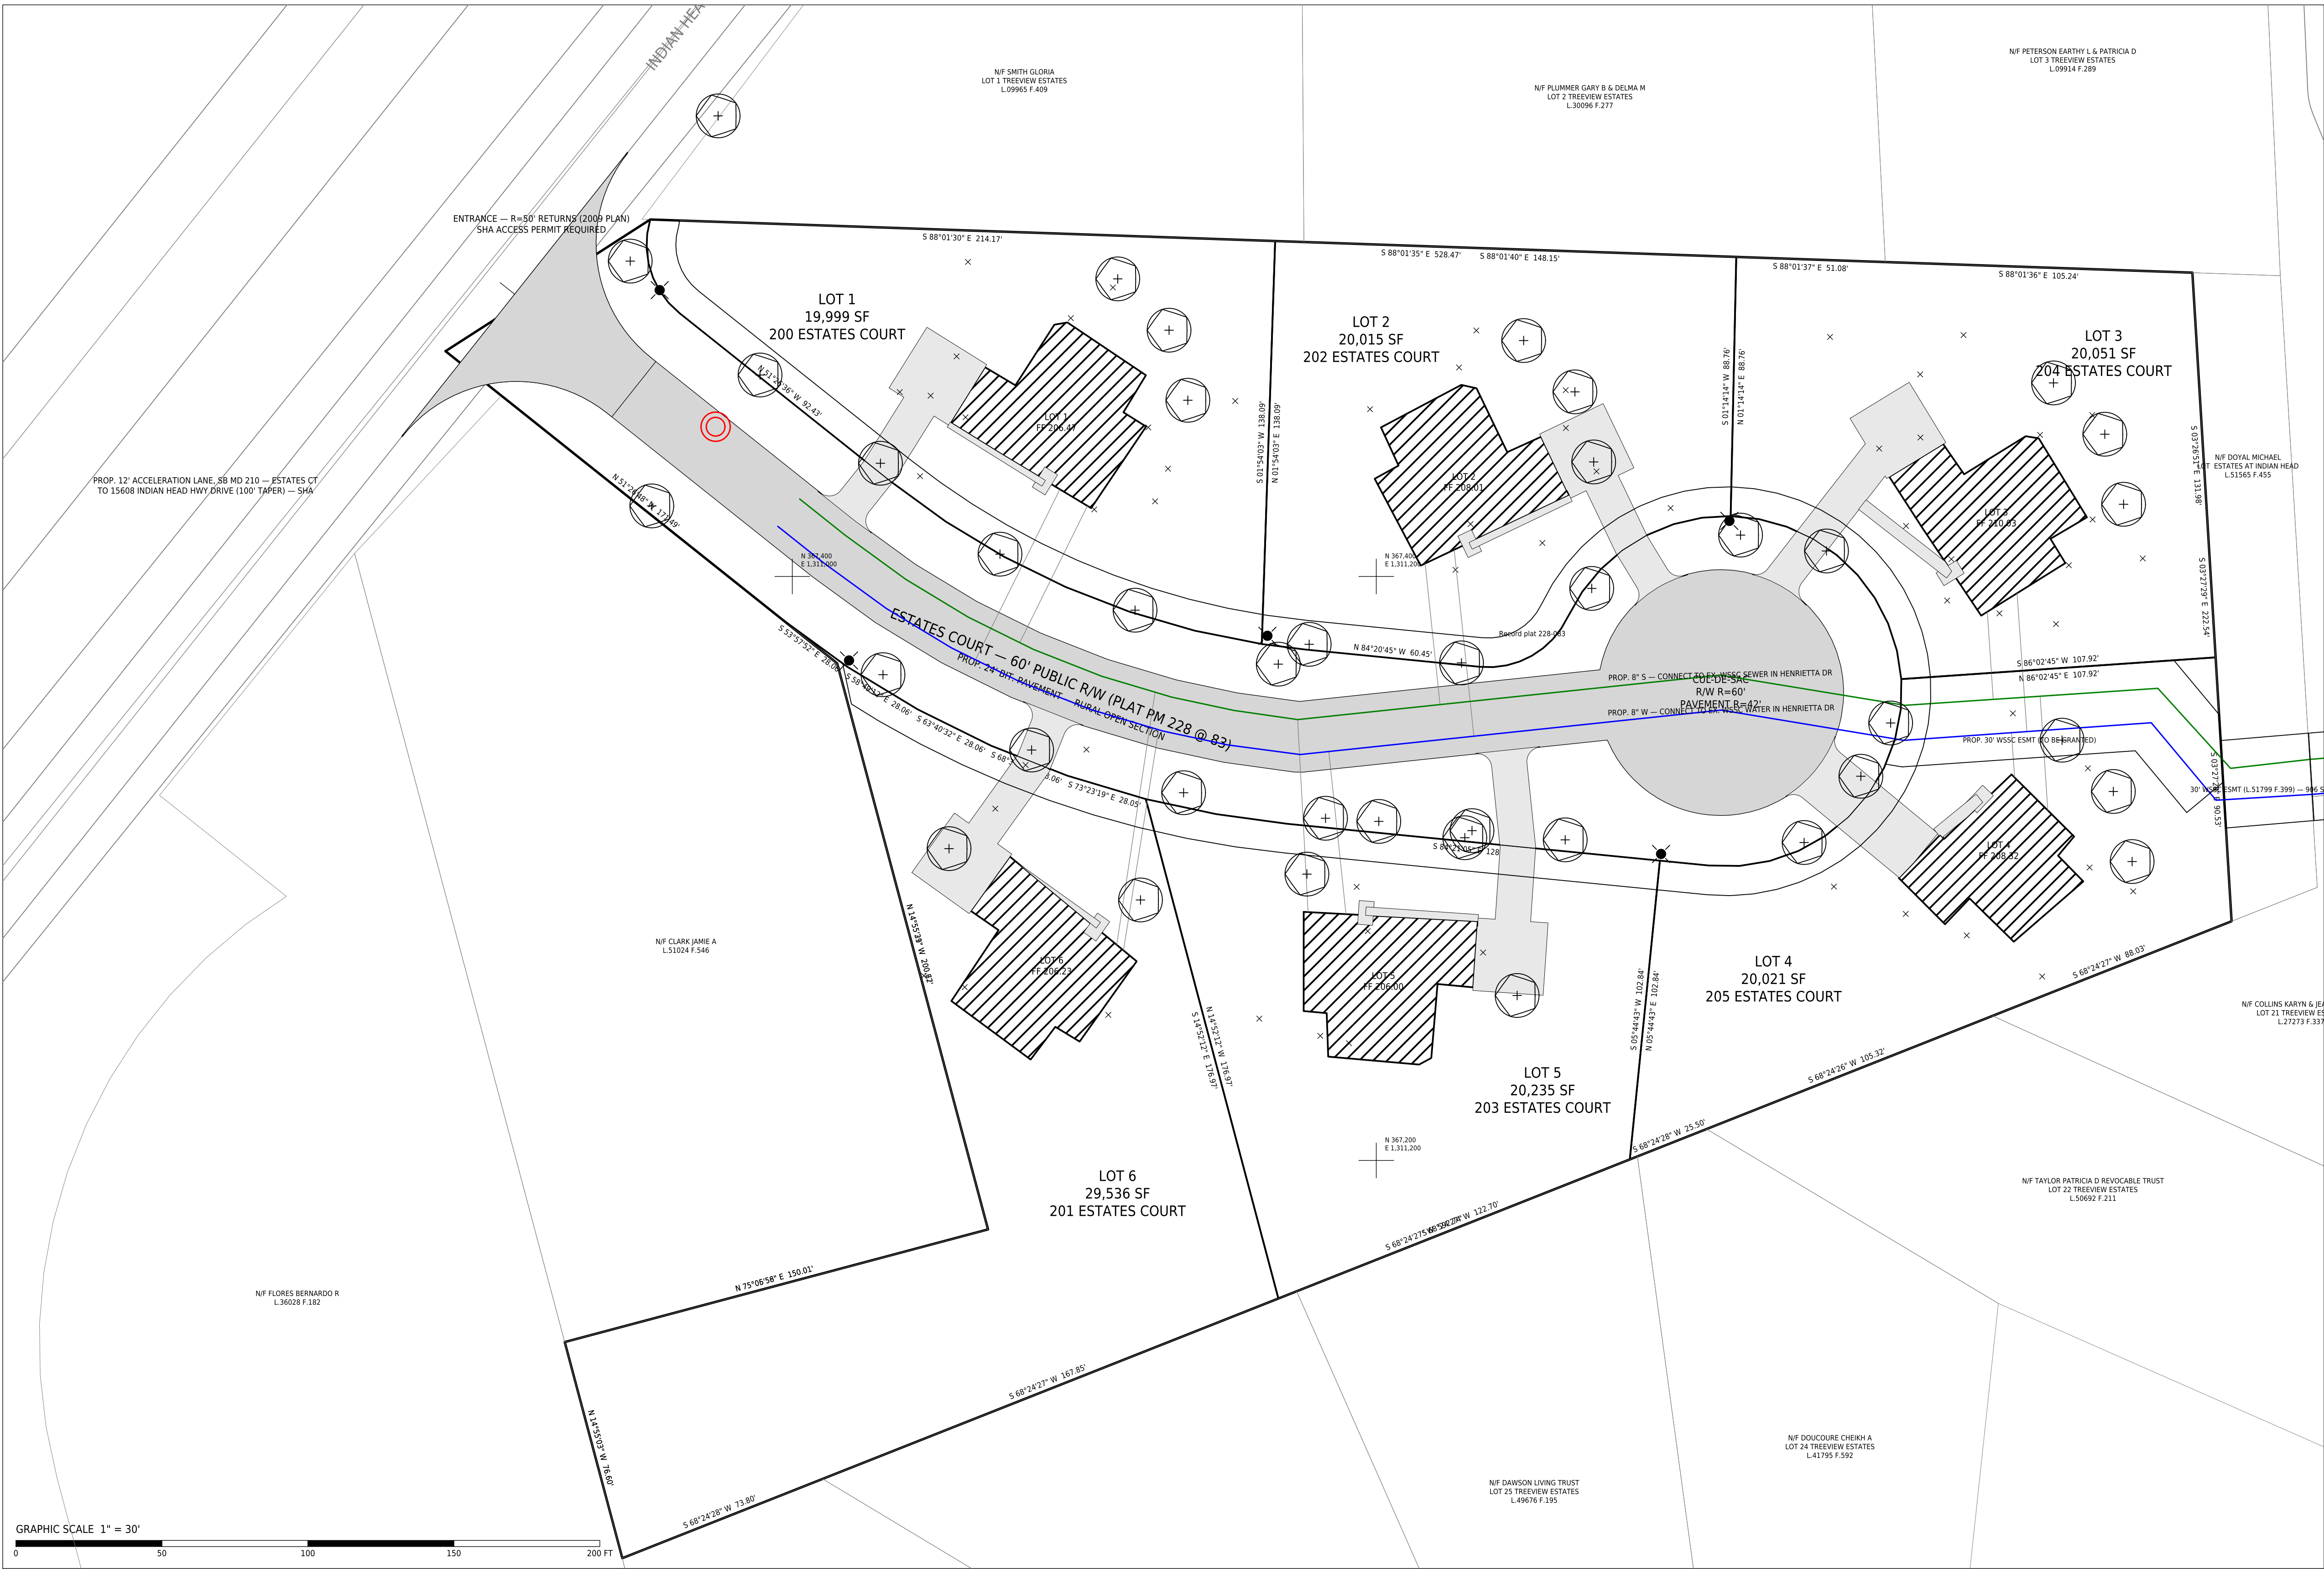

LEGEND				
—	Proposed 8" water main			
—	Proposed 8" sanitary sewer			
—	House connection			
---	WSSC easement (recorded / proposed)			
●	Street tree — Red Maple (2009 plan)			
●	Street light (2009 plan)			

STREET TREE AND STREET LIGHT SCHEDULE (2009 PLAN)				
SYMBOL	QTY	ITEM	SIZE / TYPE	STANDARD
TREE	16	ACER RUBRUM — RED MAPLE	2"-3" CAL., B&B	DPW&T 600.02 / 600.04
LIGHT	5	STREET LIGHT (SMECO)	100 W HPS COLONIAL POST-TOP, TYPE IV, BLACK FIBERGLASS	DPW&T 500.10

- UTILITY NOTES
- Water and sewer by WSSC (W-3 / S-3). Mains from the existing WSSC mains in Henrietta Drive through the recorded 30' WSSC easement (L.51799 F.399, Outlot A and Lot 20) and a 30' WSSC easement to be granted across Lot 4 along the Lot 3/4 line.
 - Sizes and inverts of the Henrietta Drive mains to be verified on WSSC 200' sheet 2205E01 before technical design.
 - Street lights and street trees follow the approved 2009 Street Tree & Lighting Plan (DPW&T 9399-2009; light permit 09.09399); electric service by SMECO.
 - Keep street trees 10 ft from water meters and storm structures and 15 ft from street lights (DPW&T 600.02).
 - House connections: 1" copper water service and 4" PVC sewer lateral per lot, each tapped on its own main and run to the dwelling clear of every driveway, apron, walk, stoop, culvert and ESD cell (3 ft min.), so no concrete or structure is removed to lay or repair them; water and sewer 10 ft apart (WSSC).
 - LOT 6: water and sewer in a COMMON TRENCH (no 10-ft corridor clear of the paving) — water on a shelf 12 in above the sewer, subject to WSSC approval at plumbing permit; otherwise relocate the lead walk.
 - Contact Miss Utility (811) at least 48 hours before excavation.


PLAN TYPE
SITE DEVELOPMENT CONCEPT PLAN

PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT BOOK PM 228 PLAT 83 - TAX MAP 151 F-3 - WSSC
2205E01
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE RR

OWNER / APPLICANT
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST
PALM BEACH, FL 33401 (L.32062 F.043)

ENGINEER OF RECORD
W.L. MEEKINS, INC. — BILL MEEKINS, JR., 3101 RITCHIE ROAD,
FORESTVILLE, MD 20747-301-736-7115


SHEET TITLE
UTILITY, STREET LIGHT AND STREET TREE
PLAN

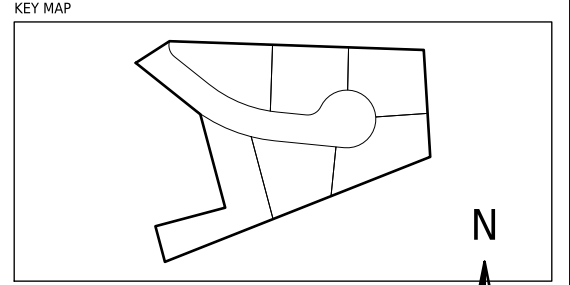

SCALE
1" = 30'
DATUM: NAD 83 MD STATE PLANE (US FT) / NAVD 88

REVISIONS	NO.	DATE	DESCRIPTION
1	2026-09-30	CONCEPT SUBMISSION 1	

PROFESSIONAL CERTIFICATION
I hereby certify that these documents were prepared or approved by me,
and that I am a duly licensed professional engineer under the laws of
the State of Maryland, License No. _____ Exp. _____

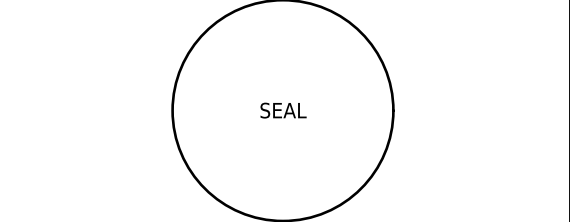


CONCEPT SUBMISSION 1 — NOT SEALED
DATE: 2026-09-30 / JOB: KEA-EIH-2026
PREPARED WITH SCALE: GRAPHIC ENGINE / CAD-PLT

SHEET INDEX
C-300 COVER SHEET — BMP SUMMARY, DRIE CHECKLIST AND NOTES
C-100 EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES
C-200 SITE LAYOUT, GRADING AND PAVING PLAN
C-300 UTILITY, STREET LIGHT AND STREET TREE PLAN
C-400 STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP
C-410 STORMWATER MANAGEMENT CONCEPT NARRATIVE AND 100-YR
COMPUTATIONS
C-500 SEDIMENT AND EROSION CONTROL PLAN
C-600 DETAILS

RESERVED FOR PRINCE GEORGE'S COUNTY DRIE APPROVAL BLOCK
(5-IN FULL-HEIGHT AREA KEPT OPEN — CHECKLIST A-3)

STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP

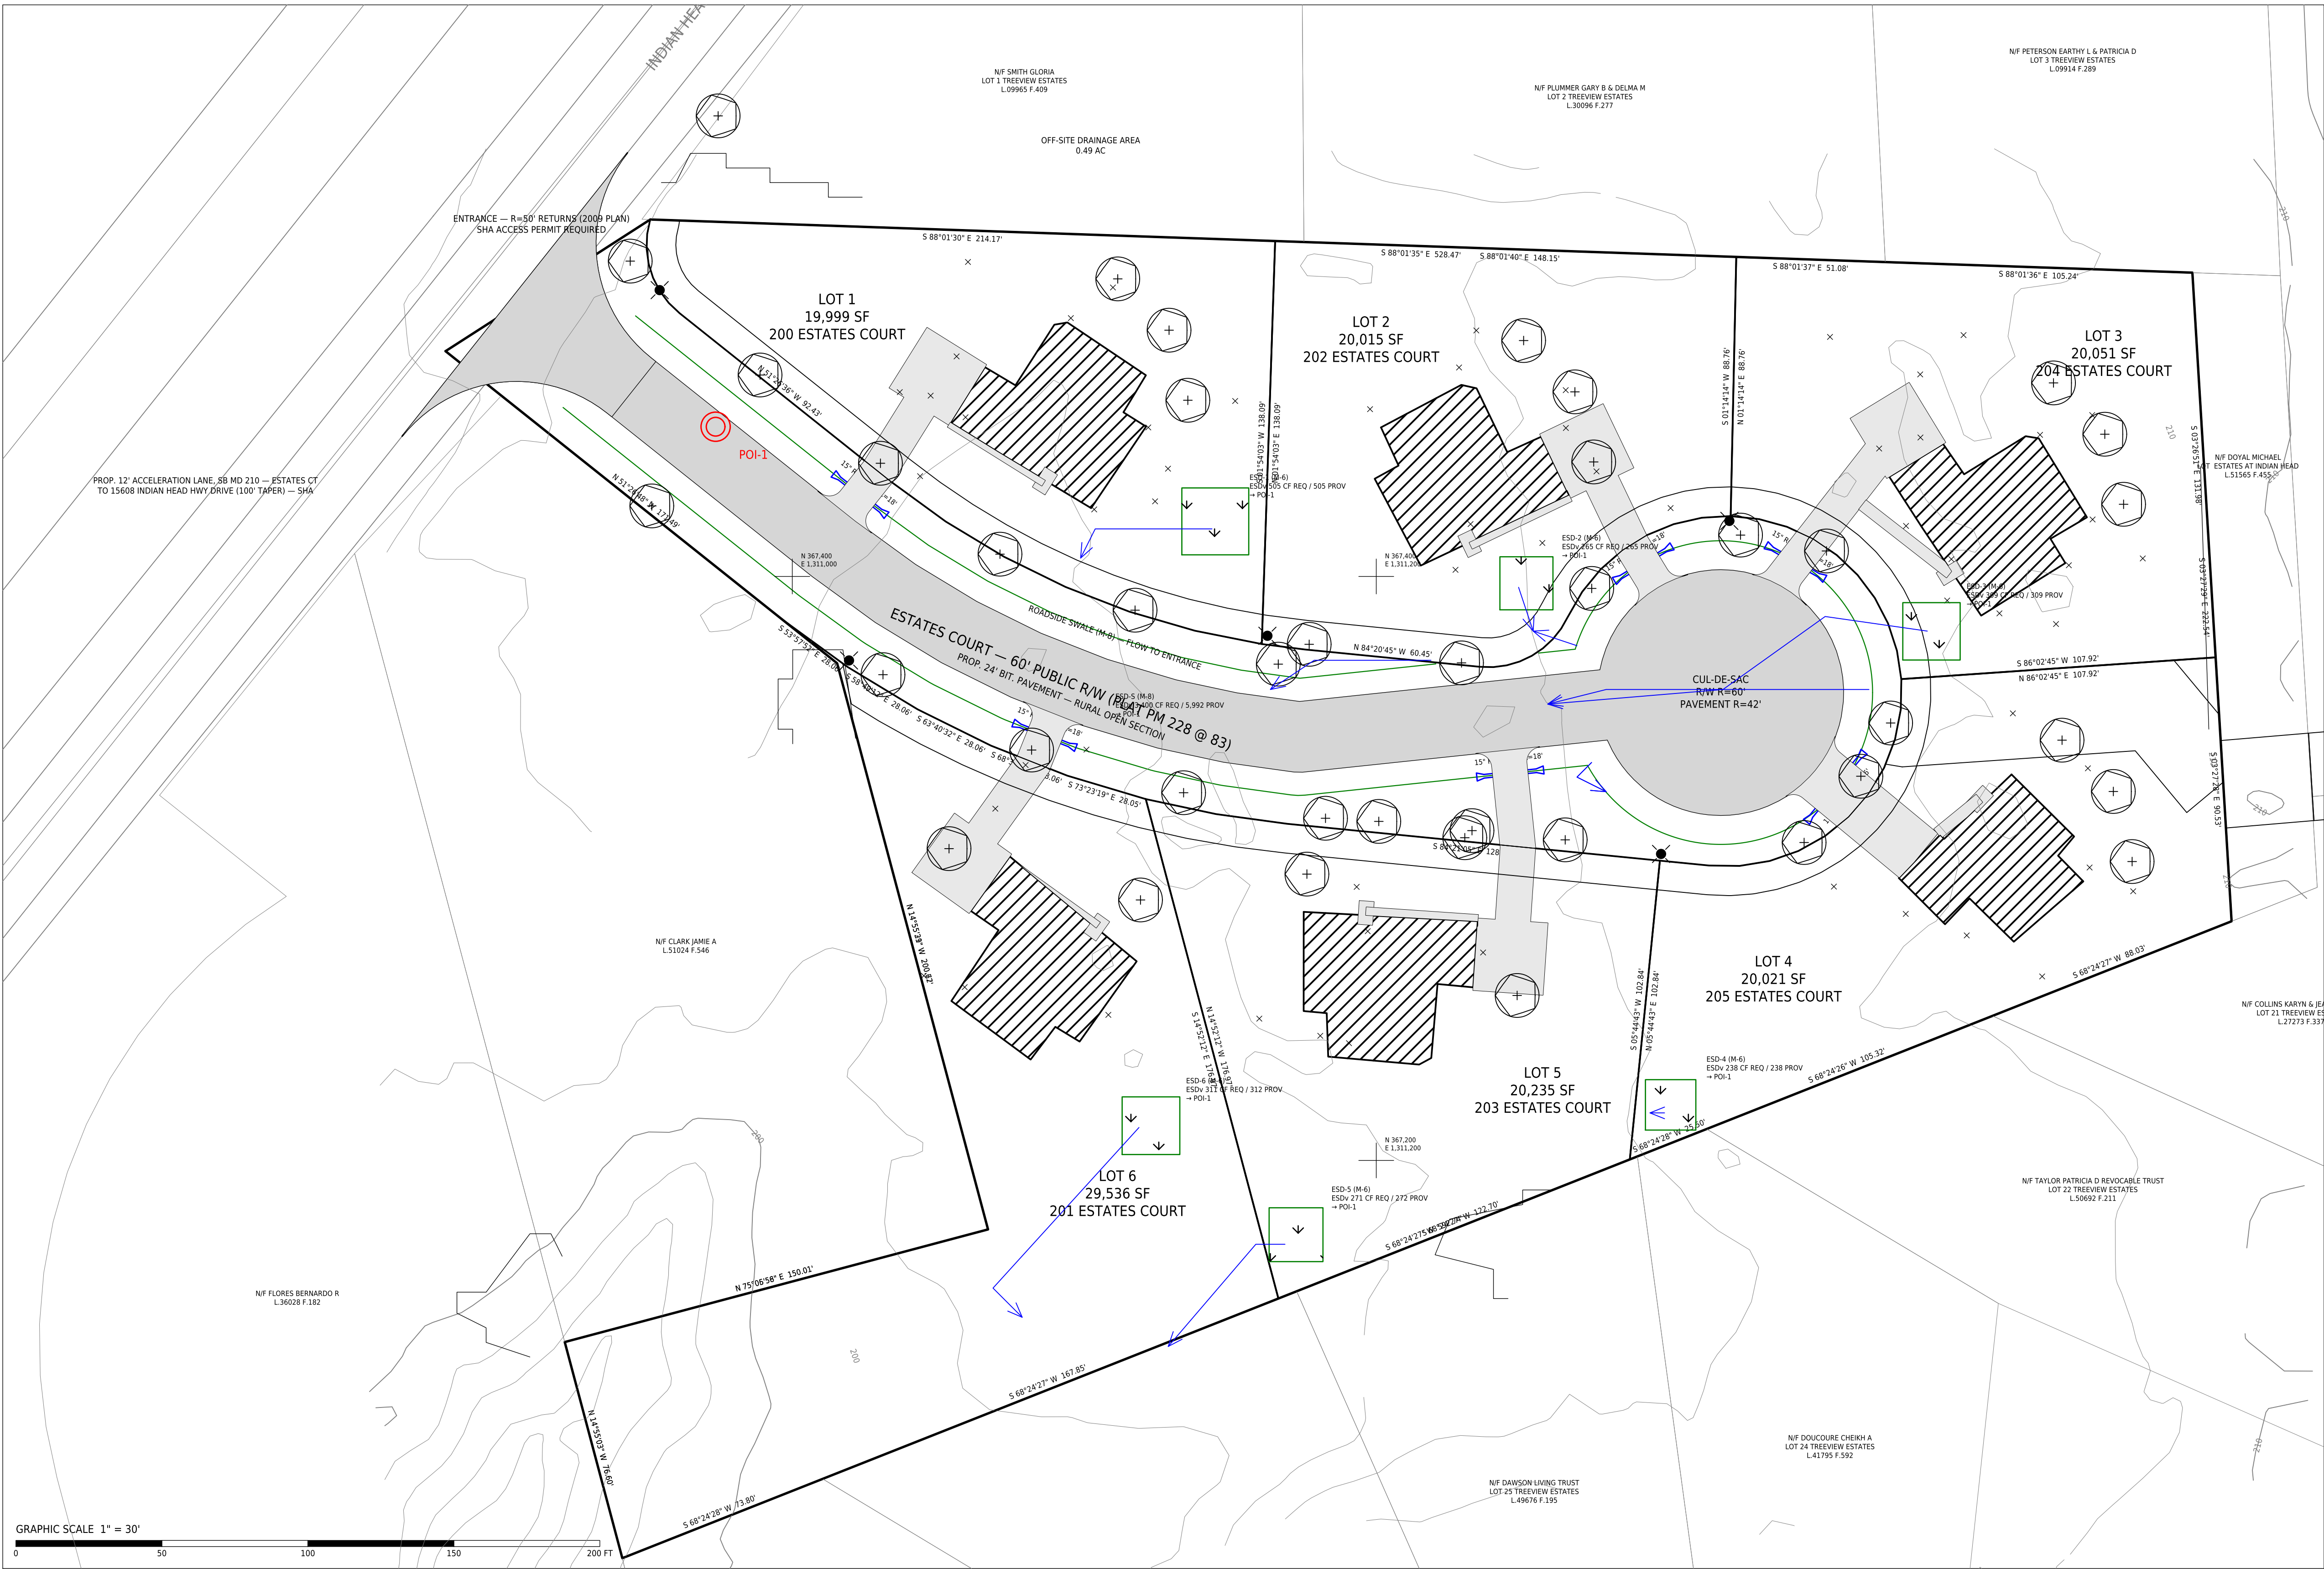

LEGEND

- ESD practice — micro-bioretentation (M-6)
- Roadside dry swale (M-8)
- Drainage area to practice
- Off-site area draining onto site
- 100-yr overflow path
- Point of investigation
- Driveway culvert

ESD PER PRACTICE (FULL TABLE ON C-000)

BMP	MDE	LOCATION	POI	DA SF	%I	P_E	ESDv REQ	ESDv PROV
ESD-1	M-6	Lot 1	POI-1	19,999	22.5	1.2	505	505
ESD-2	M-6	Lot 2	POI-1	20,015	12.1	1.0	265	265
ESD-3	M-6	Lot 3	POI-1	20,051	15.0	1.0	309	309
ESD-4	M-6	Lot 4	POI-1	20,021	10.3	1.0	238	238
ESD-5	M-6	Lot 5	POI-1	20,235	12.3	1.0	271	272
ESD-6	M-6	Lot 6	POI-1	29,536	8.5	1.0	311	312
ESD-5	M-8	Estates Ct R/W, both sides	POI-1	36,041	57.3	2.0	3,400	5,992

POINTS OF INVESTIGATION (C-9)

POI	LOCATION	SHARE	ESDv REQ	ESDv PROV
POI-1	N 367.451 E 1.310.974	100%	5,299	7,893

SWM NOTES

- SWM by Environmental Site Design to the MEP (Md. Stormwater Management Act of 2007; MDE Design Manual Ch. 5; PGc Subtitle 32). Target rainfall P_E from MDE Table 5.3 for HSG C at each drainage area's imperviousness.
- Each lot drains to one micro-bioretentation cell (M-6); 12-in max. ponding; 2.5-ft filter media; underdrain to a stable outfall. Estates Court drains to roadside dry swales (M-8) with check dams.
- Rooftop and non-rooftop disconnection (N-1, N-2) to be credited at technical design. Infiltration credit only where Sec. 32-131 borings show ≥ 0.52 in/hr.
- Private ESD practices: maintenance agreement recorded before permit; public swales in the R/W maintained by DP/E.
- D8 flow routing on a 5-ft surface interpolated from the existing 2-ft contours; exit points clustered at 120 ft; POIs carrying under 4% of the site omitted. Concept-level — reset from the field-run survey.

PLAN TYPE
SITE DEVELOPMENT CONCEPT PLAN


PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT BOOK PM 228 PLAT 83 - TAX MAP 151 F-3 - WSSC
220501
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE RR

OWNER / APPLICANT
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST
PALM BEACH, FL 33401 (L 32062 F 043)

ENGINEER OF RECORD
W.L. MEEKINS, INC. — BILL MEEKINS, JR., 3101 RITCHIE ROAD,
FORESTVILLE, MD 20747 - 301-736-7115

SHEET TITLE
STORMWATER MANAGEMENT CONCEPT AND
DRAINAGE AREA MAP

KEY MAP

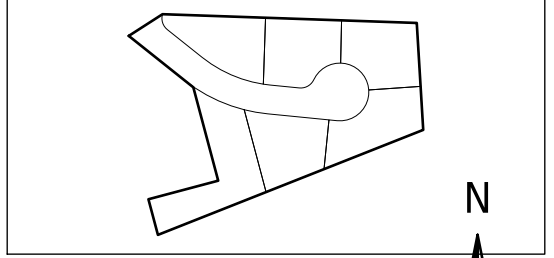

SCALE
1" = 30'
DATUM: NAD 83 MD STATE PLANE (US FT) / NAVD 88

REVISIONS	NO.	DATE	DESCRIPTION
1	2026-09-30	CONCEPT SUBMISSION 1	

PROFESSIONAL CERTIFICATION
I hereby certify that these documents were prepared or approved by me,
and that I am a duly licensed professional engineer under the laws of
the State of Maryland, License No. _____, Exp. _____



CONCEPT SUBMISSION 1 — NOT SEALED

DATE: 2026-09-30 - JOB: KEA-EH-2026
PREPARED WITH: SCALE: 1"=30', ENGINE: C-400-PL01

SHEET INDEX:
C-000 COVER SHEET — BMP SUMMARY, DRIE CHECKLIST AND NOTES
C-100 EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES
C-200 SITE LAYOUT, GRADING AND PAVING PLAN
C-300 UTILITY, STREET LIGHT AND STREET TREE PLAN
C-400 STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP
C-410 STORMWATER MANAGEMENT CONCEPT NARRATIVE AND 100-YR
COMPUTATIONS
C-500 SEDIMENT AND EROSION CONTROL PLAN
C-600 DETAILS

STORMWATER MANAGEMENT CONCEPT NARRATIVE AND 100-YR COMPUTATIONS

D-1 SWM CONCEPT NARRATIVE

1. Natural resources: there are no environmental features on the property — no streams, wetlands, 100-yr floodplain, PMA or woodland (NRI-015-06, current). The layout follows the approved 2009 plan and disturbance is held to the limit shown on the sediment control plan.
2. Natural flow patterns: the tract falls toward MD 210 and leaves at one point of investigation, which the proposed grading keeps; no drainage is diverted between POIs.
3. Impervious reduction: rural open section (24-ft pavement, no curb and gutter), as approved in 2009; side-load courts sized to the 2009 aprons. Proposed impervious 37,658 sf (22.7%).
4. ESD to the MEP: 7 practices — micro-bioretentation (M-6) on each lot and roadside dry swales with check dams (M-8) in the R/W. ESDv required 5,299 cf, provided 7,893 cf (MDE Manual Ch. 5, Table 5.3, HSG C).
5. ESC integration: practice footprints are kept out of the sediment-trapping sequence and are built last, after the contributing area is stabilized; sediment control is shown on C-500.

D-3 OUTFALLS AND RECEIVING AREAS

1. POI-1 lies where the Estates Court swales and the overland flow from the lots leave the tract, discharging to the MD 210 roadside ditch (SHA). The outfall is not on a stream or within a 100-yr floodplain; the receiving area is the state highway drainage system, which SHA must accept under the access permit.

D-4 OUTFALL STABILIZATION

1. POI-1: 10-yr velocity 3.3 ft/s is within 4.0 ft/s for a grass-lined channel; rock outlet protection is still provided where the swale meets the MD 210 roadside ditch (SHA), so the 100-yr flow (4.0 ft/s) does not cut a gully at the transition. Normal depth at the 100-yr flow 1.14 ft in the grass-lined roadside swale, 2-ft bottom, 3:1 sides, n = 0.035 at 1.5% slope. Upstream inflow from off site (0.49 ac) enters as sheet flow along the tract line and is carried by the swales; no concentrated inflow point needs stabilization.

POI-1 — COVER, CURVE NUMBER AND Tc (165,902 SF, HSG C)

CONDITION	WOODS SF	OPEN SPACE SF	IMPERVIOUS SF	CN	Tc HR
Existing	0	165,902	0	74	0.285
Proposed	0	128,244	37,658	79.4	0.285

TIME OF CONCENTRATION — PROPOSED (TR-55)

SEGMENT	L FT	S FT/FT	V FPS	Tt HR
sheet flow, dense grass	100	0.0152	0.10	0.266
shallow concentrated, unpaved	137	0.0152	1.99	0.019

POI-1 — PEAK DISCHARGE, EXISTING VS. PROPOSED (NO ESD CREDIT)

STORM YR	P 24-HR IN	Q EXIST CFS	Q PROP CFS	CHANGE	RUNOFF EXIST CF	RUNOFF PROP CF
1	2.63	2.08	3.35	+1.27	9,439	13,130
2	3.19	3.48	5.06	+1.58	14,253	18,776
10	4.93	8.87	11.36	+2.49	31,916	38,459
100	8.51	22.16	24.85	+2.69	74,438	83,480

POI-1 — OUTFALL VELOCITY CHECK (MANNING, NORMAL DEPTH)

SECTION	S FT/FT	Q10 CFS	V10 FPS	Q100 CFS	V100 FPS	d100 FT	V ALLOW FPS
grass-lined roadside swale, 2-ft bottom, 3:1 sides, n = 0.035	0.0152	11.36	3.27	24.85	4.01	1.14	4.0

D-10 COMPUTATIONS

1. ESDv required and provided per POI: BMP Summary Table (C-000), Rainfall: NOAA Atlas 14 Vol. 2 Ver. 3, PFDS point estimate, 38.6752 N 77.0040 W, partial duration series, 24-hr, retrieved 2026-09-30.
2. POI-1: 3.81 ac, CN 74 → 79.4, Tc 0.285 → 0.285 hr; 100-yr 22.2 → 24.9 cfs (+2.7 cfs), runoff 74,438 → 83,480 cf.
3. No ESD credit is taken in the 100-yr comparison (conservative). ESD to the MEP satisfies channel protection where the Table 5.3 target is met.
4. Downstream adequacy of the MD 210 roadside ditch (SHA) for the 10- and 100-yr flows at each POI — needs the receiving system's section and capacity from a field-run survey (and SHA as-builts). If inadequate, 10-yr quantity control is added (checklist D-10).

OUTSTANDING FOR TECHNICAL DESIGN

1. Downstream adequacy of the MD 210 roadside ditch (SHA) for the 10- and 100-yr flows at each POI — needs the receiving system's section and capacity from a field-run survey (and SHA as-builts). If inadequate, 10-yr quantity control is added (checklist D-10).
2. Field-run topography to confirm the POIs, flow paths and the time of concentration; this analysis is on M-NCPPC 2-ft mapping.

METHOD AND SOURCES

NRCS TR-55 graphical peak discharge, Type II 24-hr; CN from TR-55 Table 2-2 (HSG C: woods 70, open space 74, impervious 98); Tc by TR-55 segments along the routed longest path; no ESD credit on the 100-yr. Concept-level — reset from the field-run survey.
NOAA Atlas 14 Vol. 2 Ver. 3, PFDS point estimate, 38.6752 N 77.0040 W, partial duration series, 24-hr, retrieved 2026-09-30

PLAN TYPE
SITE DEVELOPMENT CONCEPT PLAN


PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT BOOK PM 226 PLAT 83 - TAX MAP 151 F-3 - WSSC
2205E01
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE RR

OWNER / APPLICANT
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST
PALM BEACH, FL 33401 (L 32062 F 043)

ENGINEER OF RECORD
W.L. MEEKINS, INC. — BILL MEEKINS, JR., 3101 RITCHIE ROAD,
FORESTVILLE, MD 20747 - 301-736-7115

SHEET TITLE
STORMWATER MANAGEMENT CONCEPT
NARRATIVE AND 100-YR COMPUTATIONS


KEY MAP

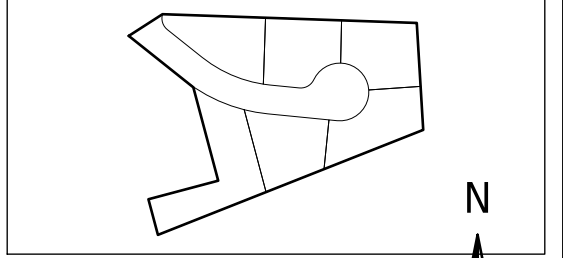

SCALE
AS NOTED
DATUM: NAD 83 MD STATE PLANE (US FT) / NAVD 83

REVISIONS	NO.	DATE	DESCRIPTION
1	2026-09-30	CONCEPT SUBMISSION 1	


PROFESSIONAL CERTIFICATION
I hereby certify that these documents were prepared or approved by me,
and that I am a duly licensed professional engineer under the laws of
the State of Maryland. License No. _____ Exp. _____



CONCEPT SUBMISSION 1 — NOT SEALED
DATE: 2026-09-30 - JOB: KEA-EIH-2026
PREPARED WITH: KEA-EIH-2026 - C-000-PL01

SHEET INDEX
C-000 COVER SHEET — BMP SUMMARY, DRIE CHECKLIST AND NOTES
C-100 EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES
C-200 SITE LAYOUT, GRADING AND PAVING PLAN
C-300 UTILITY, STREET LIGHT AND STREET TREE PLAN
C-400 STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP
C-410 STORMWATER MANAGEMENT CONCEPT NARRATIVE AND 100-YR
COMPUTATIONS
C-500 SEDIMENT AND EROSION CONTROL PLAN
C-600 DETAILS

SEDIMENT AND EROSION CONTROL PLAN

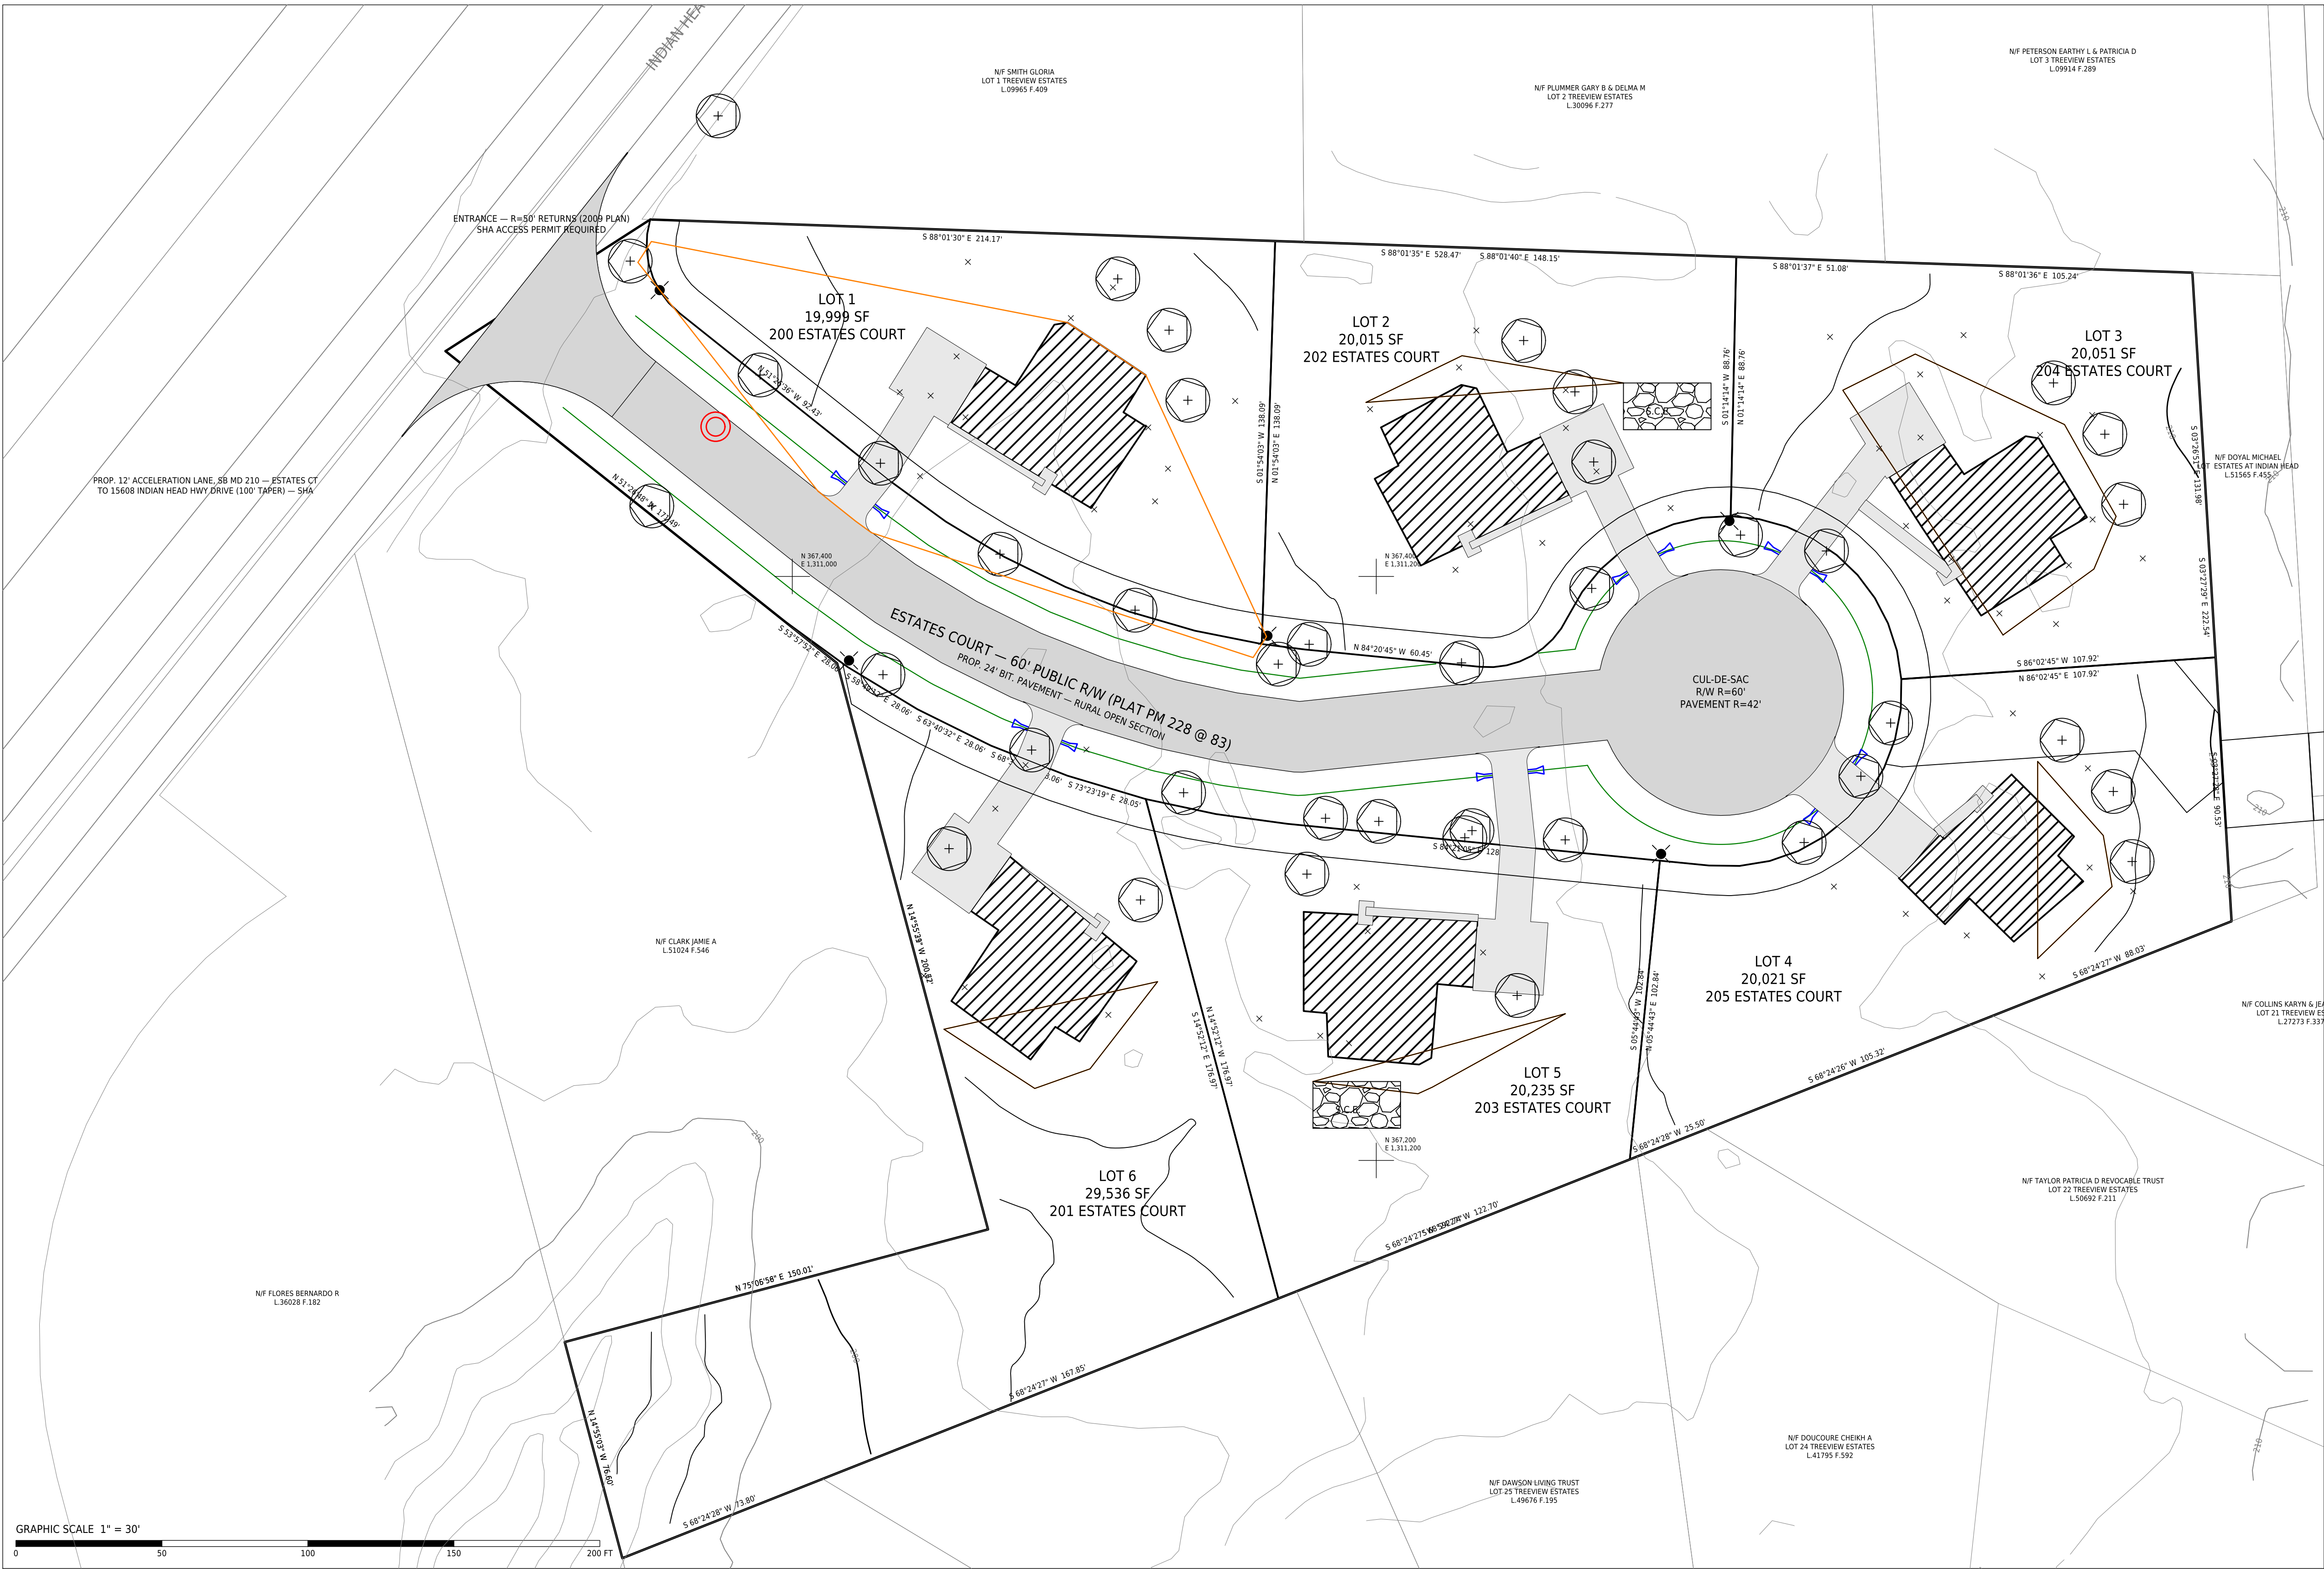

- LEGEND**
- Limit of disturbance
 - Super silt fence
 - Stabilized construction entrance
 - Proposed contour
 - Existing contour

- SEDIMENT AND EROSION CONTROL NOTES**
- Sediment and erosion control per the 2011 Maryland Standards and Specifications for Soil Erosion and Sediment Control and PGSCD requirements.
 - Stabilized construction entrance at the Estates Court entrance; super silt fence along the down-gradient limit of disturbance; inlet and swale protection.
 - Stabilize disturbed areas within 3 days on slopes $\geq 3:1$ and within 7 days elsewhere.

- SEQUENCE OF CONSTRUCTION**
- Pre-construction meeting with the PGSCD / DPE inspector; Miss Utility.
 - Install stabilized construction entrance and perimeter controls; inspector approval.
 - Clear and grub within the LOD; rough grade Estates Court and swales.
 - Install water and sewer (Henrietta Dr to Estates Ct) and house connections.
 - Construct pavement, shoulders, culverts and entrance; stabilize swales.
 - Build dwellings, driveways and courts; construct ESD practices after the contributing area is stable.
 - Fine grade, permanent stabilization, street trees and lights; remove controls with inspector approval.


PLAN TYPE
SITE DEVELOPMENT CONCEPT PLAN

PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT BOOK PM 228 PLAT 83 - TAX MAP 151 F-3 - WSSC
220501
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE RR

OWNER / APPLICANT
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST
PALM BEACH, FL 33401 (L 32062 F 043)

ENGINEER OF RECORD
W.L. MEEKINS, INC. — BILL MEEKINS, JR., 3101 RITCHIE ROAD,
FORESTVILLE, MD 20747-301-736-7115


SEDIMENT AND EROSION CONTROL PLAN

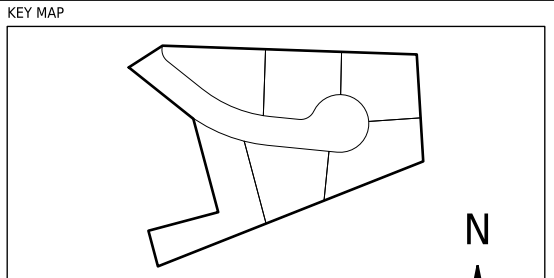

SCALE
1" = 30'
DATUM: NAD 83 MD STATE PLANE (US FT) / NAVD 88

NO.	DATE	DESCRIPTION
0	2026-09-30	CONCEPT SUBMISSION 1




PROFESSIONAL CERTIFICATION
I hereby certify that these documents were prepared or approved by me,
and that I am a duly licensed professional engineer under the laws of
the State of Maryland. License No. _____ Exp. _____

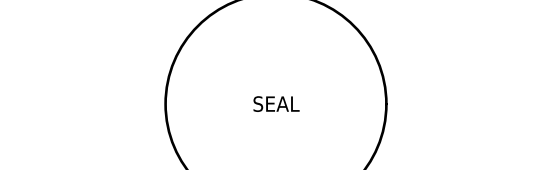


CONCEPT SUBMISSION 1 — NOT SEALED
DATE 2026-09-30 - JOB KEA-EH-2026
PREPARED WITH READER SPATIAL ENGINE / CAD-R-IT

- SHEET INDEX**
- C-000 COVER SHEET — BMP SUMMARY, DPE CHECKLIST AND NOTES
 - C-100 EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES
 - C-200 SITE LAYOUT, GRADING AND PAVING PLAN
 - C-300 UTILITY, STREET LIGHT AND STREET TREE PLAN
 - C-400 STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP
 - C-410 STORMWATER MANAGEMENT CONCEPT NARRATIVE AND 100-YR COMPARISONS
 - C-500 SEDIMENT AND EROSION CONTROL PLAN
 - C-600 DETAILS


DETAILS

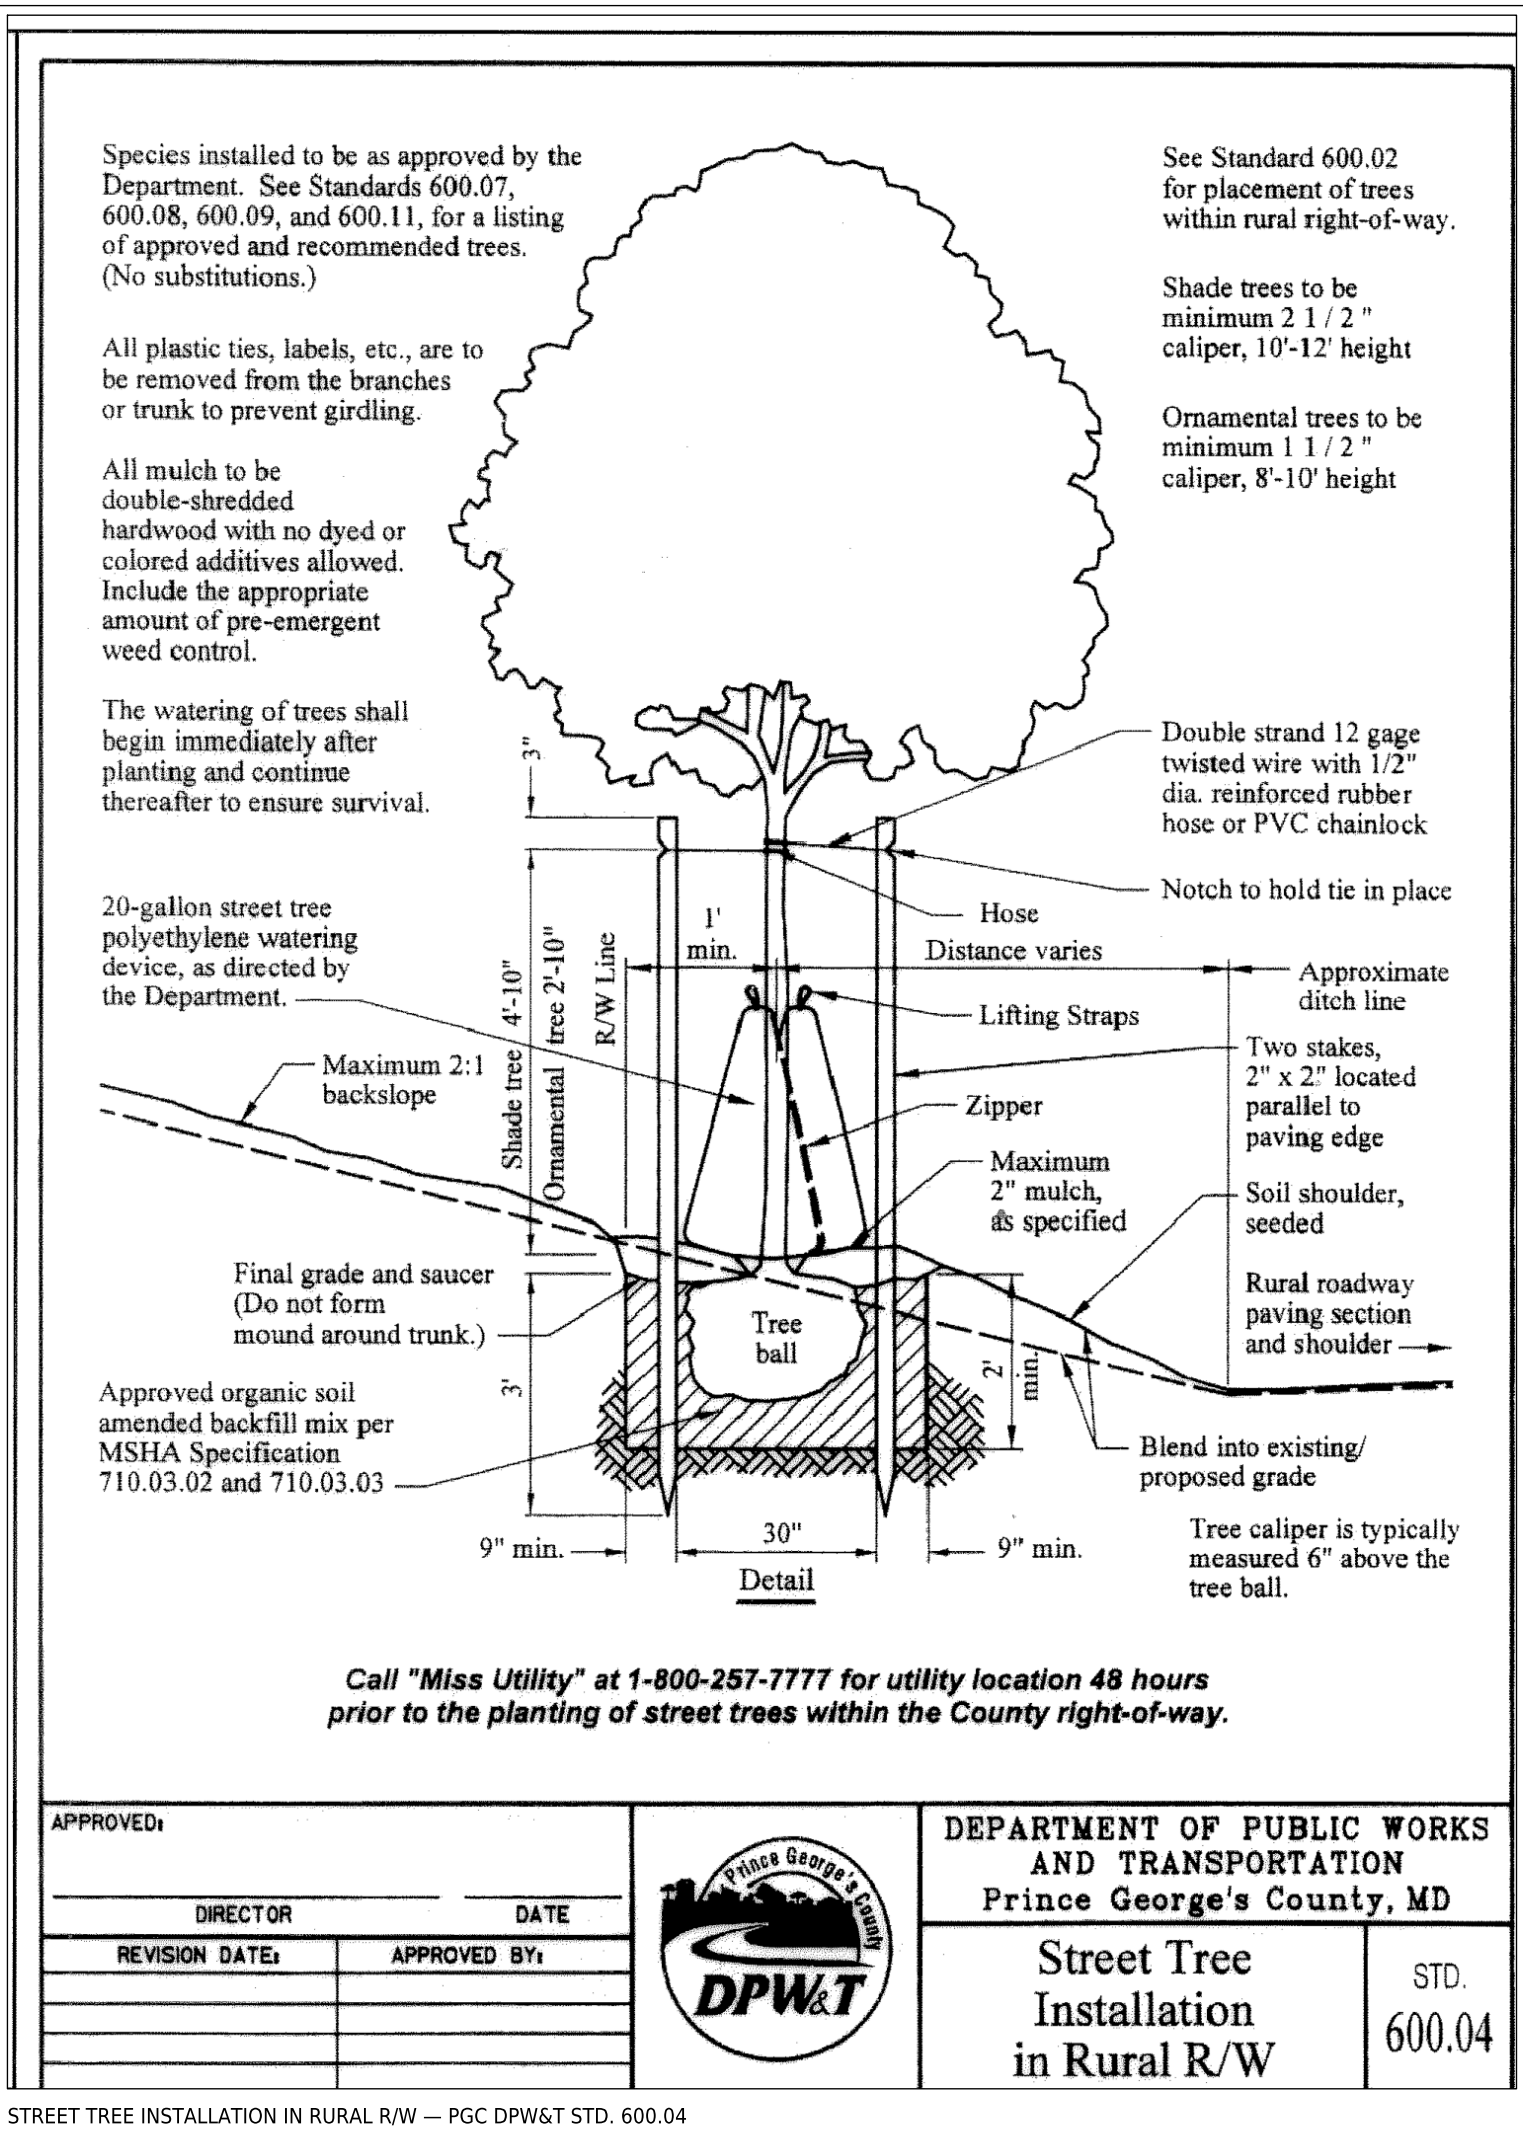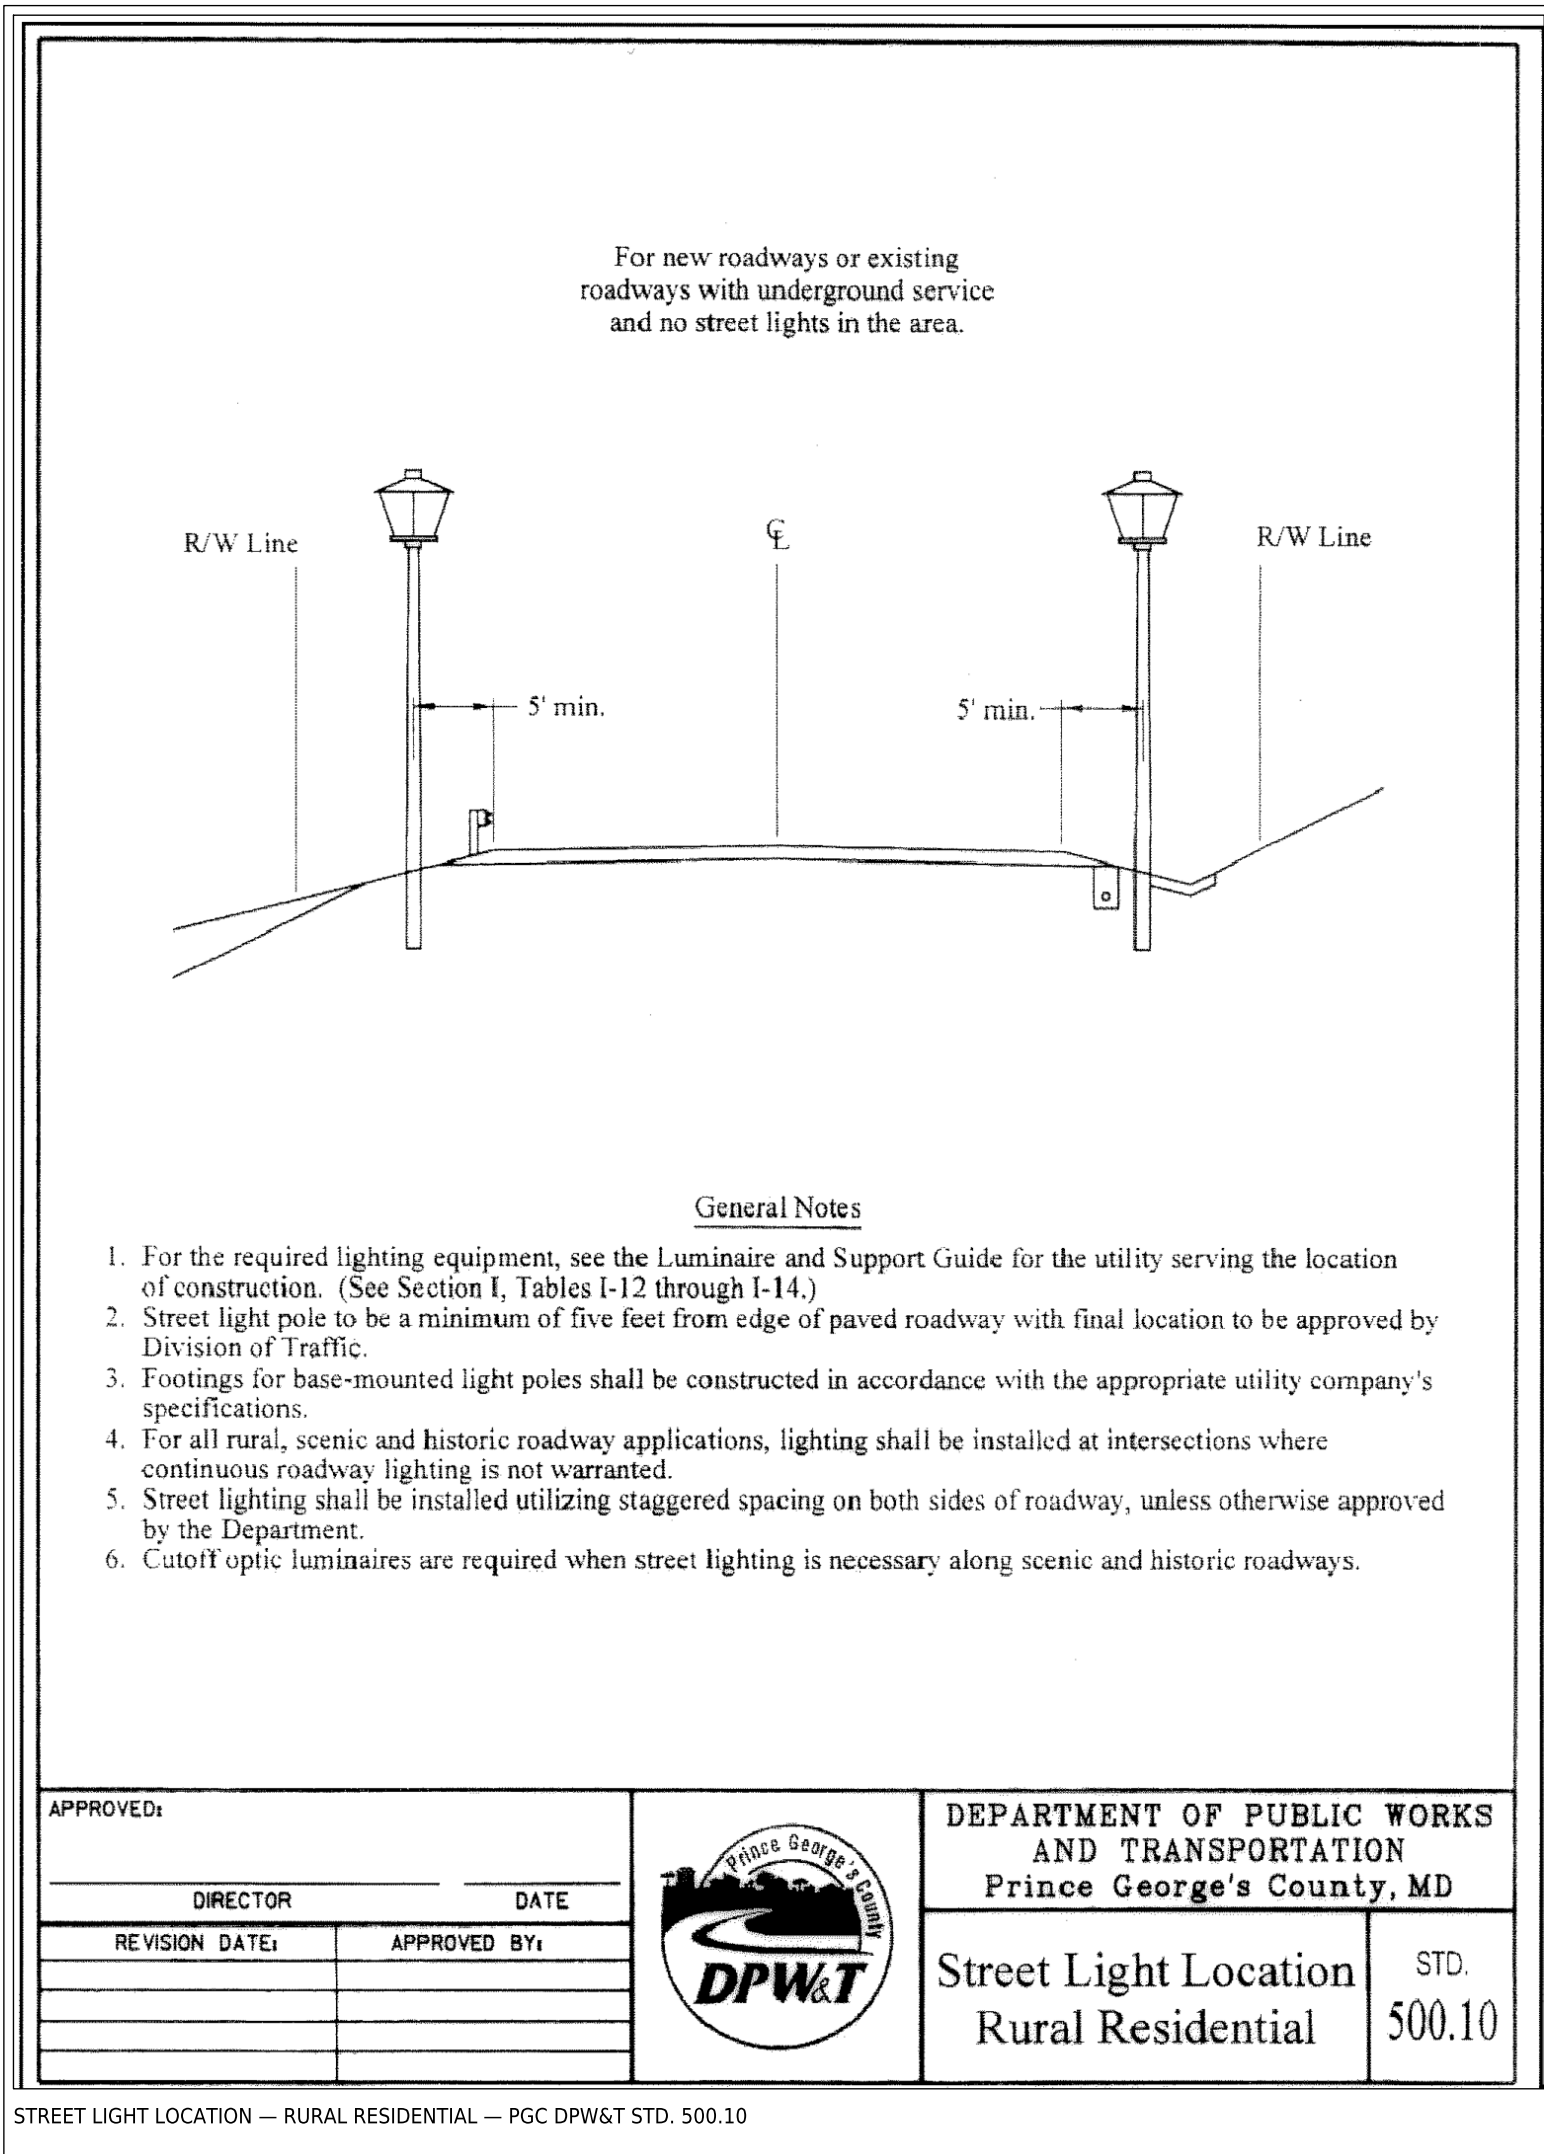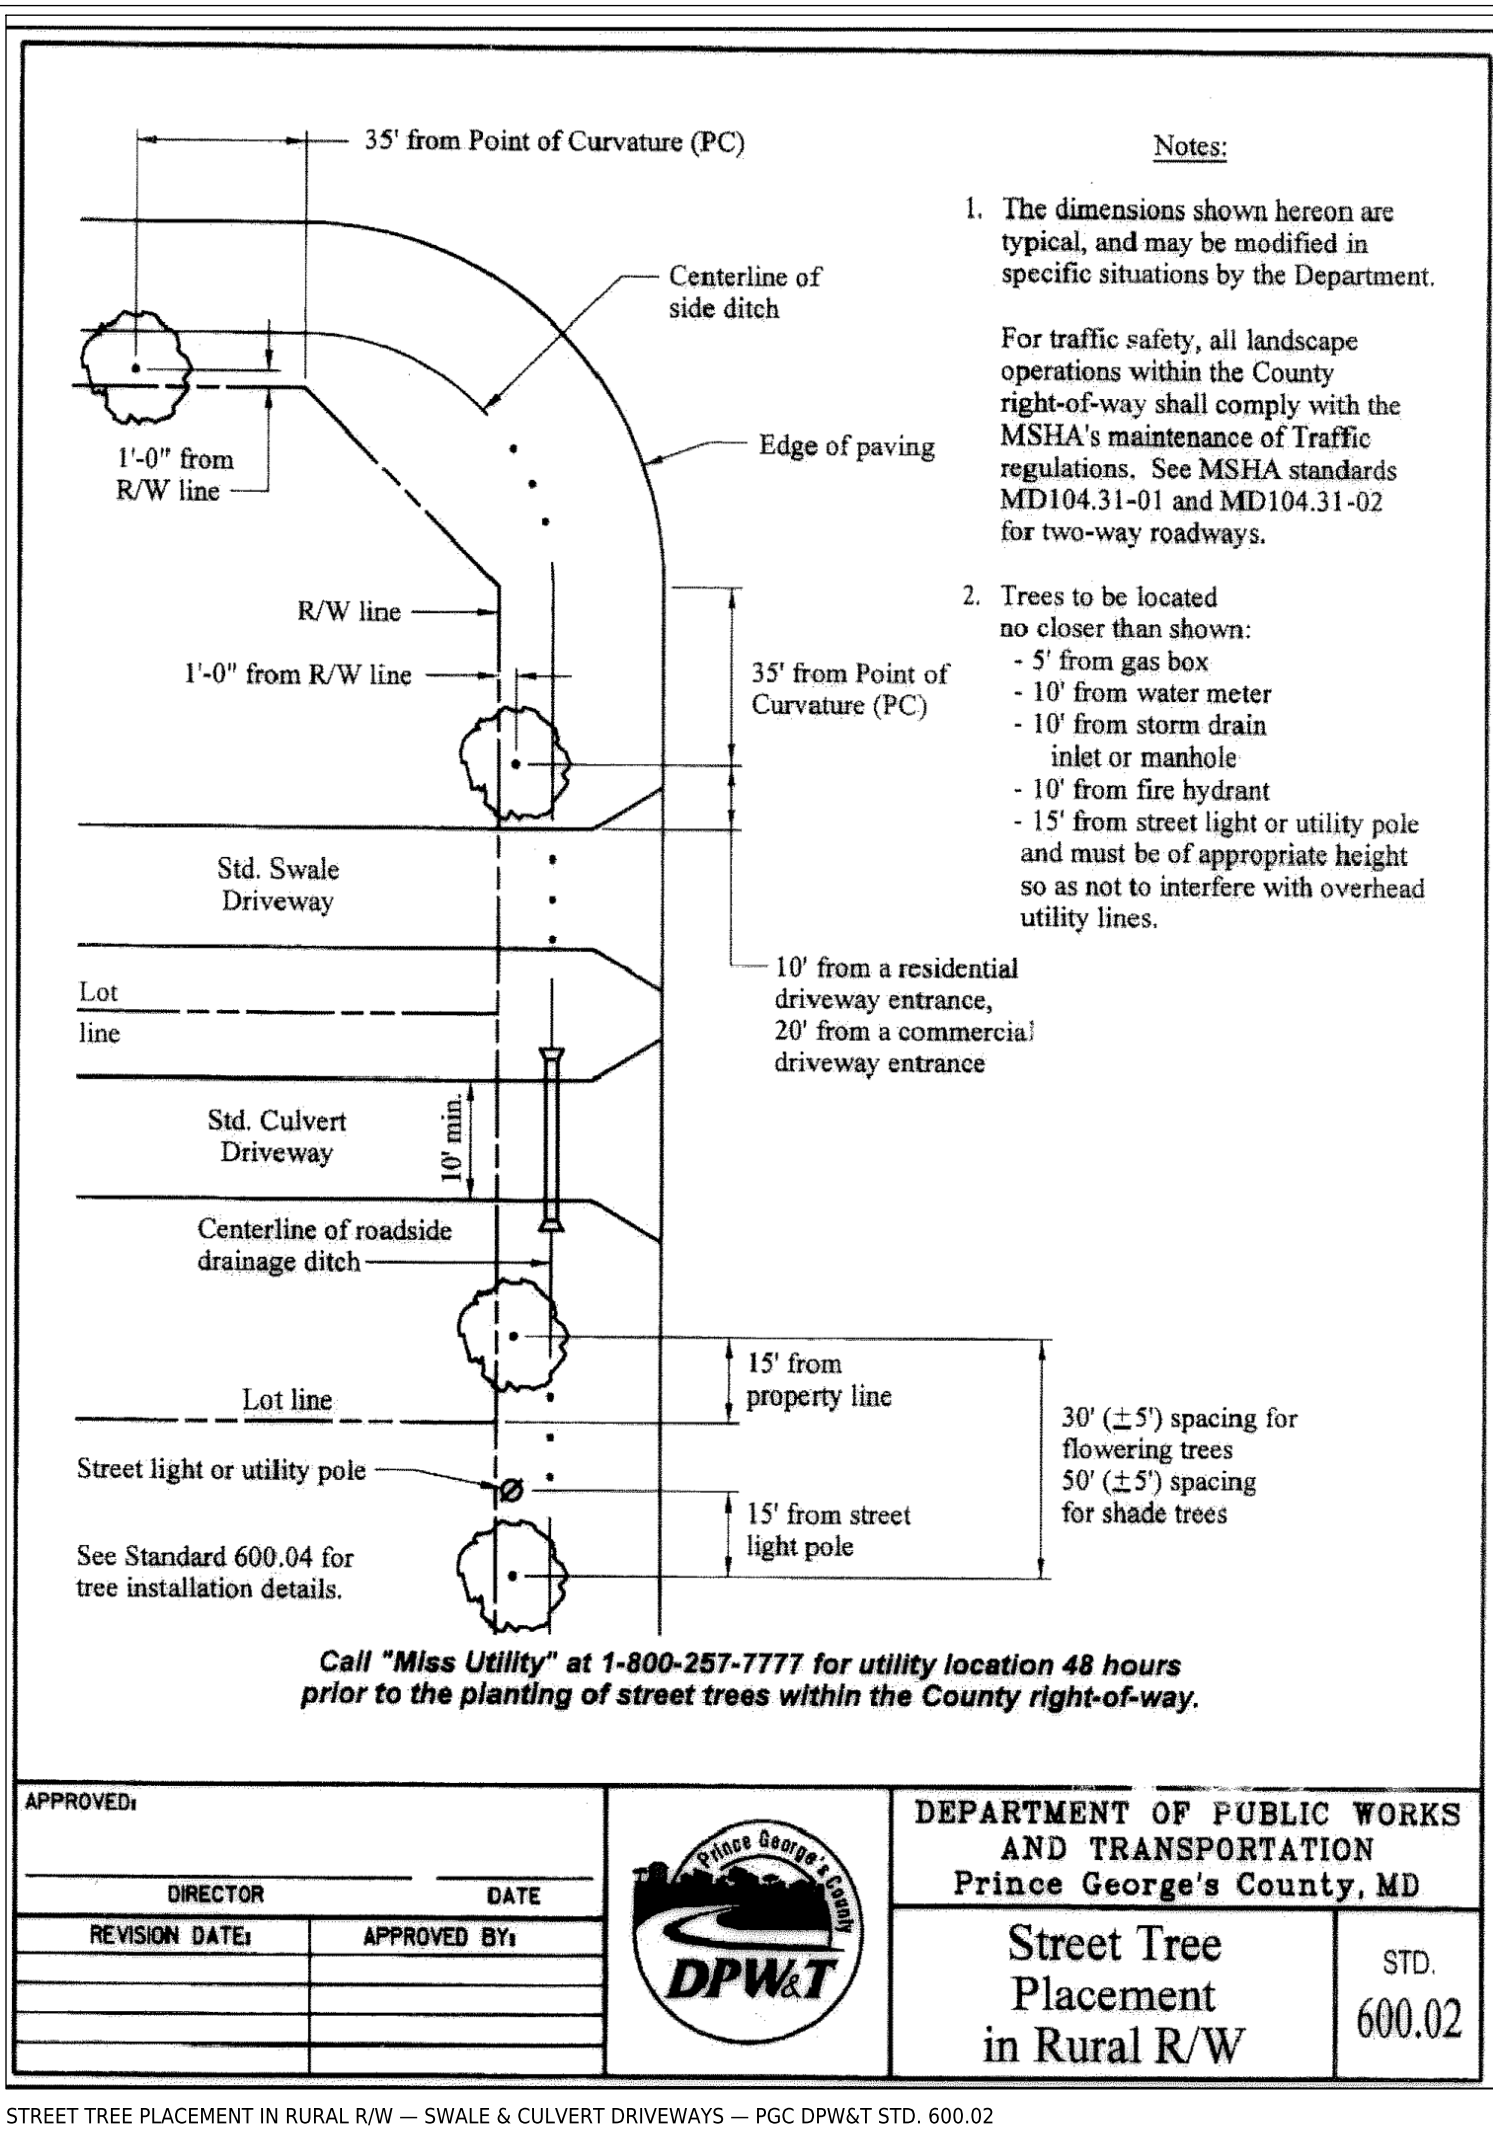


ESTATES COURT — TYPICAL SECTION (RURAL OPEN SECTION, 60' R/W)

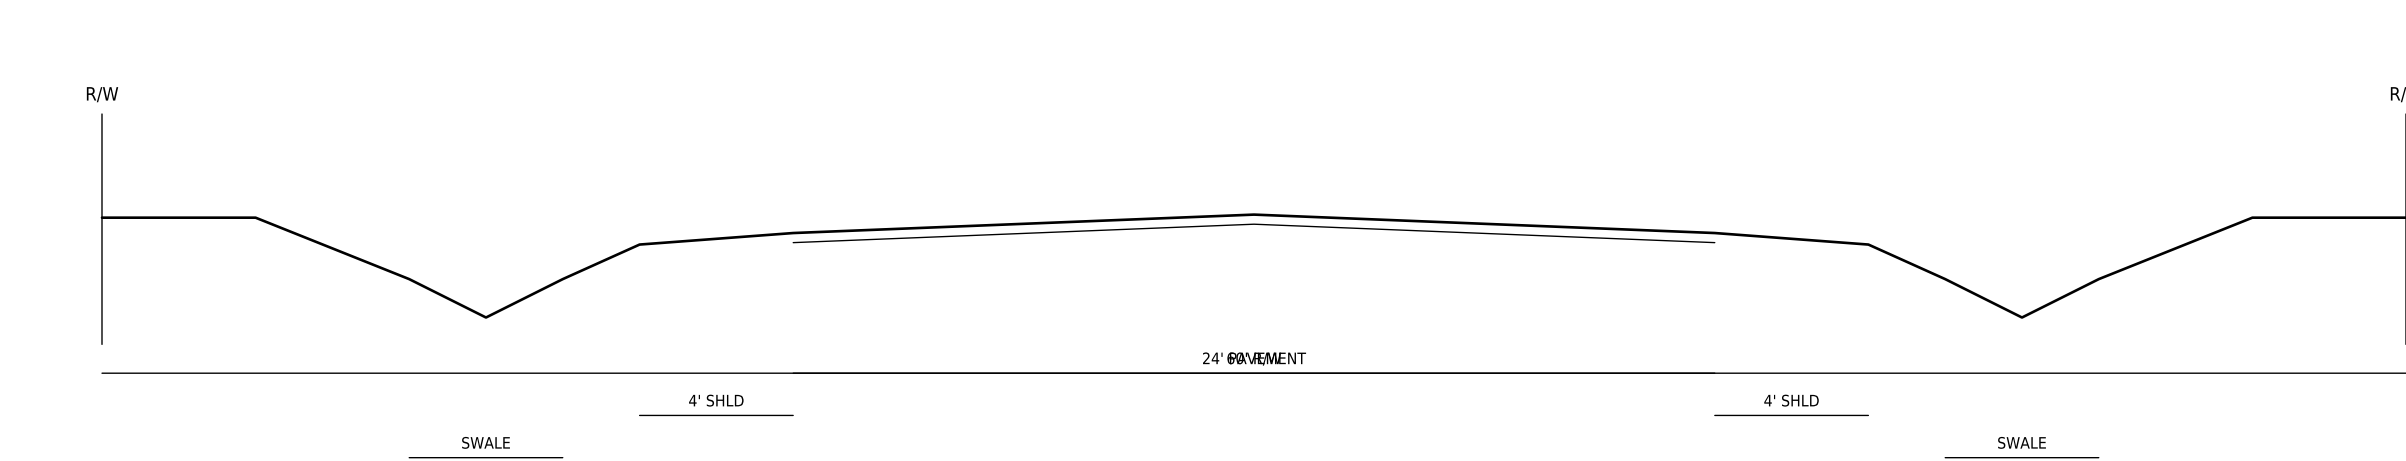

MICRO-BIORETENTION (M-6) — TYPICAL SECTION

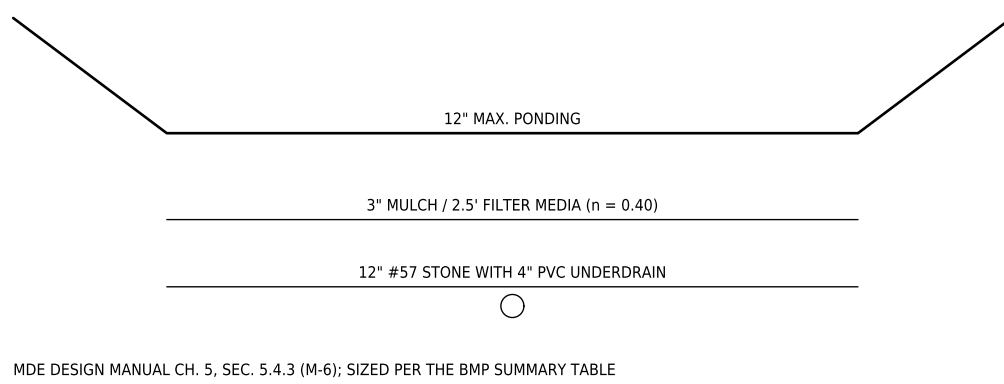

DRY SWALE (M-8) WITH CHECK DAM

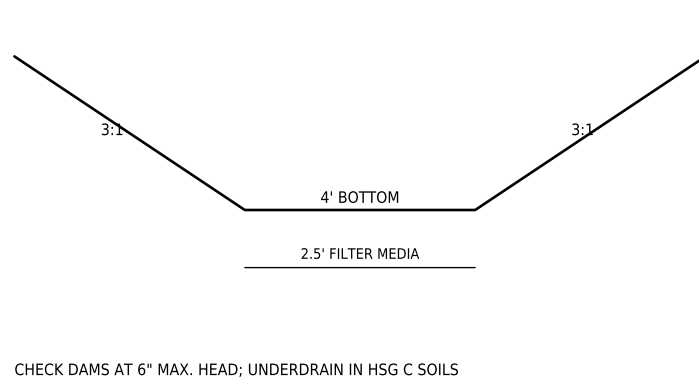

PLAN TYPE
SITE DEVELOPMENT CONCEPT PLAN

PROJECT
ESTATES AT INDIAN HEAD — LOTS 1-6
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT BOOK PW 228 PLAT 83 - TAX MAP 151 F-3 - WSSC
220501
ELECTION DIST. 5 - COUNCIL DIST. 9 - ZONE RR

OWNER / APPLICANT
GERALD WALDMAN REVOCABLE TRUST, 400 N. FLAGLER DR., WEST PALM BEACH, FL 33401 (L 32062 F 043)

ENGINEER OF RECORD
W.L. MEEKINS, INC. — BILL MEEKINS, JR., 3101 RITCHIE ROAD, FORESTVILLE, MD 20747-301-736-7115

SHEET TITLE
DETAILS

KEY MAP

SCALE
AS NOTED
DATUM: NAD 83 MD STATE PLANE (US FT) / NAVD 88

REVISIONS

NO.	DATE	DESCRIPTION
0	2026-09-30	CONCEPT SUBMISSION 1

PROFESSIONAL CERTIFICATION
I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Exp. _____

SEAL

CONCEPT SUBMISSION 1 — NOT SEALED
DATE 2026-09-30 - JOB KEA-EH-2026
PREPARED WITH READER SPATIAL ENGINE / CAD/PLOT

SHEET INDEX

- C-000 COVER SHEET — BMP SUMMARY, DPE CHECKLIST AND NOTES
- C-100 EXISTING CONDITIONS AND ENVIRONMENTAL FEATURES
- C-200 SITE EROSION, GRADING AND PAVING PLAN
- C-300 UTILITY, STREET LIGHT AND STREET TREE PLAN
- C-400 STORMWATER MANAGEMENT CONCEPT AND DRAINAGE AREA MAP
- C-410 STORMWATER MANAGEMENT CONCEPT NARRATIVE AND 100-YR COMPUTATIONS
- C-500 SEDIMENT AND EROSION CONTROL PLAN
- C-600 DETAILS

RESERVED FOR PRINCE GEORGE'S COUNTY DPE APPROVAL BLOCK
(5-IN FULL-HEIGHT AREA KEPT OPEN — CHECKLIST A-3)