

SITE DEVELOPMENT CONCEPT PLAN

ESTATES AT INDIAN HEAD — LOTS 1-6 AND ESTATES COURT

Plat Book PM 228 Plat 83 · 200-205 Estates Court, Accokeek, MD 20607 · Tax Map 151 Grid F-3 · Zone RR · Piscataway Election District 5 · Prince George's County, Maryland

Stormwater management by Environmental Site Design to the Maximum Extent Practicable (MDE Design Manual Ch. 5; PGC Subtitle 32, Div. 3). New submittal; base layout from the prior 2009 Street Tree & Lighting Plan (DPW&T permit 9399-2009-00).

PRINCE GEORGE'S COUNTY BMP SUMMARY TABLE (ESD broken out by Point of Investigation — checklist A-15, C-9)

BMP	PRACTICE (HRS)	LOCATION / OWNERSHIP	POI	DA (SF)	% I	P E (IN)	Rv	ESDv REQ (CF)	ESDv PRODV (CF)	Rvw REQ (CF)	SURFACE (SF)	N (NAD83)	E (NAD83)
ESD-1	Micro bio-retention (M-4)	Lot 1 (200 Estates Ct), private	POI-1	19,899	3.362	16.8	1.0	0.201	336	420	525	367,419	1,311,149
ESD-2	Micro bio-retention (M-4)	Lot 2 (202 Estates Ct), private	POI-1	20,015	3.315	16.6	1.0	0.199	332	332	330	367,398	1,311,251
ESD-3	Micro bio-retention (M-4)	Lot 3 (204 Estates Ct), private	POI-1	20,051	3.459	17.3	1.0	0.205	343	343	386	367,381	1,311,390
ESD-4	Micro bio-retention (M-4)	Lot 4 (205 Estates Ct), private	POI-1	20,021	2.558	12.8	1.0	0.165	275	275	298	367,219	1,311,301
ESD-5	Micro bio-retention (M-4)	Lot 5 (203 Estates Ct), private	POI-1	20,235	3.441	17.0	1.0	0.203	342	342	340	367,175	1,311,173
ESD-6	Micro bio-retention (M-4)	Lot 6 (201 Estates Ct), private	POI-1	29,536	3.370	11.4	1.0	0.153	376	376	389	367,084	1,310,952
ESD-S1	Dry swale (M-8) w/ check dams — street	Estates Ct R/W, north roadside (public, DPBE)	POI-1	18,020	9.187	51.0	1.8	0.509	1,375	99	4,340	367,401	1,311,069
ESD-S2	Dry swale (M-8) w/ check dams — street	Estates Ct R/W, south roadside (public, DPBE)	POI-1	18,020	9.187	51.0	1.8	0.509	1,375	99	8,266	367,327	1,311,175
SUBTOTAL POI-1				165,898	37,881				4,755	489			
TOTAL 8 ESD practices									4,755	489		14,874	

P_E from MDE Design Manual Table 5.3, HSG C (governing on site). Rv = 0.05 + (0.0090). ESDv = P_E·Rv·A12. Rev = 5·Rv·A12. S = 0.13 in (HSG C); Rev is met within ESDv (percent-volume method). Micro bio-retention: 12 in max. ponding, 2.5 ft filter media (n = 0.40), underdrain to stable outfall; infiltration credit only where the Sec. 32-131 soil borings show ≥ 0.52 in/hr.

SITE DATA (DPBE Concept Application, rev. 07/28/2021)

APPLICATION DATA	
Project name	Estates at Indian Head, Lots 1-6
Geographic location	S. side of MD 210 (Indian Head Hwy), ±3,000 ft NE of MD 210 / MD 373 (Livingston Rd)
Street address	200, 201, 202, 203, 204, 205 Estates Court, Accokeek, MD 20607
Companion cases	Prior (base work, not carrying this submittal): NRH-015-06, TCP1-018-06, TCP2-016-00, DPW&T 9399-2009-00 street tree & lighting. Of record: final plat S-08238 (PM 228 @ 83)
Lots / area	6 lots + public R/W: 165,902 sf (3,809 ac) computed, 165,019 sf of record (plat 171,505 sf less Outlet A)
Tax accounts	3987666, 3987674, 3987682, 3987690, 3987708, 3987716
Tax map / WSSC 200'	151 F-3 / 2205E01
Master plan	2013 Approved Subregion 5 Master Plan & SMA (CR 808B1-2013); Planning Area 84, Piscataway & Vicinity
Master plan road	MD 210 Indian Head Highway (Frontage, SHA) — access by Estates Court only
Council / election district	District 9 / District 5 (Piscataway)
Municipality	None (unincorporated) — PGAtlas Administrative/30
Historic site / scenic road	None / none; Mount Vernon Viewshed Area of Primary Concern covers the site
Zone (current / proposed)	RR / RR (no change) — Sec. 27-4202: 20,000 sf min., 25' front, 8' side, 20' rear, 25% max. coverage
MD 12-digit watershed	021402030798 — Piscataway Creek (MD 8-digit 02140203); County watershed: Piscataway Creek
Impaired / TMDL	Chesapeake Bay TMDL (N, P, sediment) applies; Piscataway Creek listings to be confirmed on MDE TMDL data center at submission
Tier I / habitat	No (no MDE Tier II catchment intersect) / No (single-family residential)
Ex. site imp. area	0 sf (vacant, wooded; DEVELOPED = N on all six accounts)
New site imp. area	37,881 sf (22.8% of tract) — roofs, driveways, walks, Estates Court pavement, curb and sidewalk
Est. disturbed area	71,636 sf (1.64 ac), incl. 4,054 sf off-site in the WSSC easement (Outlet A, Lot 20)
Marlboro clay / public project	No (PGAtlas Environmental/7; none within 100 ft) / No
Road section	Open section (rural), per the 2009 base plan: Estates Court 60' R/W, 24' pavement, 4' shoulders, roadside swales, cul-de-sac
Water / sewer	W-3 / S-3 community systems (WSSC), Piscataway Creek sewer basin; mains from Henrietta Dr via 30" WSSC esent L.S1799 F.399

INDEX OF SHEETS

SHEET	TITLE
SDC-1	Site Development Concept Plan — Cover, BMP Summary Table, ESD Computations, Notes
SDC-2	Site Development Concept Plan — Plan View, Drainage Area Map and Environmental Features, 1" = 40'
C-000 - L-100	Site Development Plan set (11 sheets, companion): existing conditions, site/zoning, grading, utility, SWM, ESC, road, details, landscape

GENERAL NOTES

- Boundary: recorded plat PM 228 @ 83 (final plat S-08238). Lot lines are the county parcel geometry, which reproduces the plat bearings to the second and distances to 0.02 ft; closure of every lot ± 0.02 ft. A Maryland licensed surveyor shall confirm the boundary and set the Indian Head Hwy R/W before technical plans.
- Topography: M-NCPPC 2-ft contours (NAD83), extended ±100 ft beyond the property (A-13). The 2009 approved sheet (2005 Landside field survey, WSSC datum) is georeferenced and shown faint on SDC-2 for reference. V-1: DPBE prefers NGVD 29; the field-run update shall state the datum and conversion.
- Outlet A (6,486 sf) was conveyed to M. & K. Doyal (L-51565 F455) and is not part of this site. Water and sewer reach Estates Court through the recorded 30" R/WSSC easement across Outlet A and Lot 20. Treeview Estates (L.S1789 F.399, Rev. 2023) and a 30" R/WSSC easement to be granted across Lot 4.
- Easement record discrepancies to resolve with WSSC before technical plans: Schedule A describes N 03°24'09" W where the plat and Exhibit A show N 03°27'26" W; the curve is written "N 04°07'06" W"; the recited deed dates are inconsistent.
- Estates Court (60-R R/W, 35,173 sf of record) is dedicated to public use on the plat and is not built. The entrance is on MD 210 (SHA): an SMA access permit and a sight-distance analysis (checklist item A.10) are required. The 30-R R/W for use in common (L10142 F.723) adjoins to the south-west and is not used.
- R-1: Estates Court keeps the 2009 rural open section (DPW&T Std. 500.10 / 600.02 / 600.04): 24-ft pavement, 4-ft shoulders and roadside dry swales (M-8). Driveways cross the swale on 15-in culverts or as swale driveways per DPW&T; aprons are 12 ft at the R/W with 5-ft flares at the edge of pavement. Confirm the section with DPBE/DPW&T for a rural residential cul-de-sac.
- All six lots are vacant (no existing impervious area, no structures to remove). No wells or septic systems are proposed; the existing well on Parcel 199 (15608 Indian Head Hwy) is ≥100 ft from the proposed mains.
- Stormwater management to ESD to the MEP: each lot drains to one micro-bio-retention cell (M-6) sized for its own roof and paving; Estates Court sheet-flows off the shoulders into roadside dry swales (M-8) with check dams, north and south, draining west to the entrance. Rooftop and non-rooftop disconnection (N-1, N-2) are to be credited at technical design and will reduce the cells.
- Quantity: the site is <1 ac of new impervious area on HSG C soils. The 10-yr and 100-yr (Op10/Qf) analyses at each POI accompany this plan in the concept narrative. ESD storage is subtracted per MDE Ch. 5. Outfalls as tabulated; each discharges as sheet flow through a level spreader.
- NEW SUBMITTAL (2026): Prior approvals NRH-015-06, TCP2-016-09 and DPW&T 9399-2009-00 are used as base work only and do not carry this submittal. Additional work: an updated/revised NRH (draft with this submission, approved copy before concept approval, Sec. 32-182(a)); a TCP2-016-09 revision or new TCP (letter of exemption as M-NCPPC Environmental Planning determines; street tree and lighting plan re-reviewed to current DPW&T/DPBE standards; SWM by ESD to the MEP under current Subtitle 32. Also still to be submitted: geotechnical report with Sec. 32-131 infiltration tests (E-1, E-2), soil borings, affidavit of the adjacent-owner notification (Sec. 32-182(g), mailed within 7 days of submittal), and the application fee (ESD = 5% technology fee).
- Contact Miss Utility (811) at least 48 hours before any excavation.

ENVIRONMENTAL FEATURES


ENVIRONMENTAL FEATURE (CHECKLIST B)	FINDING AND SOURCE
B-1B-2 Streams & buffers	None on site (verified on PGAtlas; prior NRH-015-06). Updated NRI required (new submittal).
B-3 Wetlands	None mapped on or within 100 ft (DNR wetlands, WSSC). Confirm by NRI field delineation.
B-4 100-yr floodplain	None. FEMA Zone X (area of minimal flood hazard); no DPBE or consultant floodplain within 100 ft.
B-5 Steep slopes	15–25%: 2,757 sf, >25%: 520 sf on site (PGAtlas Slope 2023) — isolated.
B-6 PMA	None on site (prior NRH-015-06). Updated NRI required (new submittal).
B-7 Woodland	Per updated NRI (prior NRH-015-06/TCP2-016-09 = base work); TCP2 revision or new TCP per M-NCPPC.
B-9 Soils	C&E Croom-Marr complex, 15 to 25 percent slopes (HSG C, K-15) 2%; UdaF Udorthents, highway, 0 to 65 percent slopes (HSG None, K None) 2%; BaB Beltsville silt loam, 2 to 5 percent slopes (HSG C, K-37) 9.
B-10 TMDL / Tier II	Chesapeake Bay TMDL watershed; not within a Tier II catchment; DNR Stronghold watershed (021402030798).
B-11 Highly erodible	Slopes ≥15% with K ≥ 0.35 are highly erodible: the 15–25% patches on BaB (K-37) qualify — stabilize within 3 days.
B-12B-13 Springs, bedrock, Marlboro clay	None observed (2005 field survey) or mapped. Geotechnical report to confirm (E-1, E-2).
B-14 Chesapeake Bay Critical Area	Not in the CBCA overlay (PGAtlas Zoning/3).
Other	FIDS habitat (DNR) overlaps 1.9 ac; Green Infrastructure Evaluation Area; Priority Woodlands for Retention; ESA 2 (Plan 2035).

POINTS OF INVESTIGATION (C-9) — from D8 flow routing on M-NCPPC 2-ft topography

POI	LOCATION (NAD83)	SHARE OF SITE	ESD PRACTICES
POI-1	N 367,259 E 1,311,041	89%	ESD-1, ESD-2, ESD-3, ESD-4, ESD-5, ESD-6, ESD-S1, ESD-S2
POI-2	N 367,499 E 1,311,246	10%	—

Off-site drainage onto the tract: 116,500 sf (2.67 ac), from the Treeview Estates rear yards to the north and east (C-11). It is passed through by sheet flow around the ESD cells; no off-site area is routed into a practice.

VICINITY MAP SCALE: 1" = 2,000'

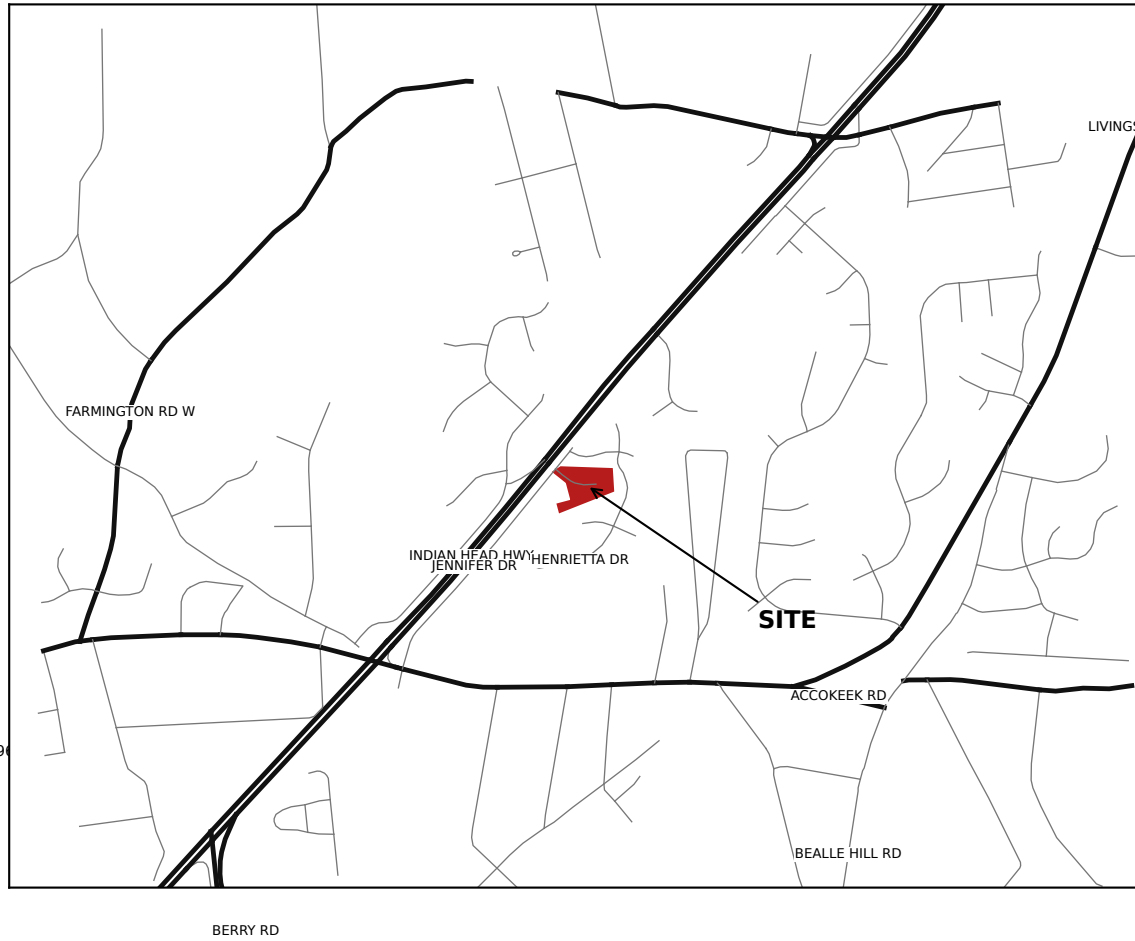

PLAN TYPE SITE DEVELOPMENT CONCEPT PLAN

PROJECT ESTATES AT INDIAN HEAD LOTS 1-6 AND ESTATES COURT

LOCATION:
200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT PM 228 @ 83 · TAX MAP 151 F-3
WSSC 2205E01 · ELECTION DIST. 5
COUNCIL DIST. 9 · ZONE RR

OWNER / APPLICANT:
GERALD WALDMAN REVOCABLE TRUST
400 N. FLAGLER DR., WEST PALM BEACH, FL 33401
(L-32062 F043)

ENGINEER:
W.L. MEEKINS, INC. — BILL MEEKINS, JR.
3101 RITCHIE ROAD, FORESTVILLE, MD 20747
301.736-0115 · info@meekins.net

PREPARED WITH:
KEALEE SITE-PLAN ENGINE (DRAFT FOR PE REVIEW)

SHEET TITLE COVER SHEET, BMP SUMMARY TABLE, ESD COMPUTATIONS AND NOTES

SCALE:
AS NOTED

DATUM:
HORIZ: MD STATE PLANE NAD 83 (EPSG 2248), US FT
VERT: NAD 83 (M-NCPPC 2-FT TOPOGRAPHY)
DPBE PREFERS NGVD 29 — SEE NOTE V-3

DATE:
2026-09-30 · CONCEPT SUBMISSION 1

REVISIONS

PROFESSIONAL CERTIFICATION

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Expiration _____

(SEAL)

NOT SEALED — DRAFT FOR PE REVIEW

SHEET

SDC-1

RESERVED FOR PRINCE GEORGE'S COUNTY
DPBE APPROVAL BLOCK — KEEP CLEAR

SITE DEVELOPMENT CONCEPT PLAN — PLAN VIEW / DRAINAGE AREA MAP



LEGEND

- Site boundary (plat PM 228 @ 83)
- Lot line / RW line
- Proposed pavement, walk, driveway
- Proposed dwelling (1,900 sf ft.)
- ESD practice — micro-bioretenion (M-6)
- ESD practice — roadside dry swale (M-8)
- Drainage area divide (to device)
- Off-site drainage area onto site
- 100-yr overflow path
- Point of investigation
- Limit of disturbance
- Slopes 15-25%
- Slopes > 25%
- Existing tree canopy (2023)
- Soil boundary (NRCS)
- WSSC easement (recorded / proposed)
- Prop. 8" water main
- Prop. 8" sewer main
- Ex. contour, 2 ft (NAVD 88)
- 2009 approved sheet (reference)

PLAN NOTES

- Plan scale 1" = 40' (± 1" = 50'; A-11); the whole property is on this sheet. Three grid ticks (A-B) are State Plane NAD 83.
- Drainage areas are the engineer's per-lot catchments; POI and the 100-yr overflow path are from DB flow routing on the WACPC 2-R surface. Rest from the field-run survey.
- Every lot drains to one M-6 catchment; Estates Court drains to roadside dry swales ESD-51/52 (M-8), which discharge at the entrance-low point (EL) 220.4 to the MD 210 roadside ditch (SHA review).
- No disturbance in floodplain, wetlands or slopes > 25% (prior NRI-015-06, updated NRI required).
- The faint underlay is the 2009 approved Street Tree & Lighting sheet (2005 field topography, WSSC datum), grandfathered to the plat (median residual 0.44 ft). Its houses, mains and street lights are superseded.
- Easements: 30' WSSC L51799 F399 (Outlet A 906 sf; Lot 20 1.154 acf recorded; 30' WSSC across Lot 4 proposed. Private SWM easements over ESD-51/52 to be recorded with a maintenance agreement.

PLAN TYPE

SITE DEVELOPMENT CONCEPT PLAN

PROJECT

ESTATES AT INDIAN HEAD LOTS 1-6 AND ESTATES COURT

LOCATION

200-205 ESTATES COURT, ACCOKEEK, MD 20607
PLAT PM 228 @ 83 - TAX MAP 151 F-3
WSSC 220501 - ELECTION DIST. 5
COUNCIL DIST. 9 - ZONE RR

OWNER / APPLICANT

GERALD WALDMAN REVOCABLE TRUST
400 N. FLAGLER DR., WEST PALM BEACH, FL 33401
(L-32062 F043)

ENGINEER

W.L. MEEKINS, INC. — BILL MEEKINS, JR.
3101 RITCHIE ROAD, FORESTVILLE, MD 20747
301.736.7115 - info@meekins.net

PREPARED WITH

KEALEE SITE-PLAN ENGINE (DRAFT FOR PE REVIEW)

SHEET TITLE

PLAN VIEW, DRAINAGE AREA MAP AND ENVIRONMENTAL FEATURES

SCALE

1" = 40'

DATUM

HORIZ: MD STATE PLANE NAD 83 (EPSG 2248), US FT
VERT: NAVD 88 (M-NCPC 2-FT TOPOGRAPHY)
DPIE PREFERS NGVD 29 — SEE NOTE V-3

DATE

2026-09-30 - CONCEPT SUBMISSION 1

REVISIONS

PROFESSIONAL CERTIFICATION

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. _____ Expiration _____

(SEAL)

NOT SEALED — DRAFT FOR PE REVIEW

SHEET

SDC-2

RESERVED FOR PRINCE GEORGE'S COUNTY
DPIE APPROVAL BLOCK — KEEP CLEAR