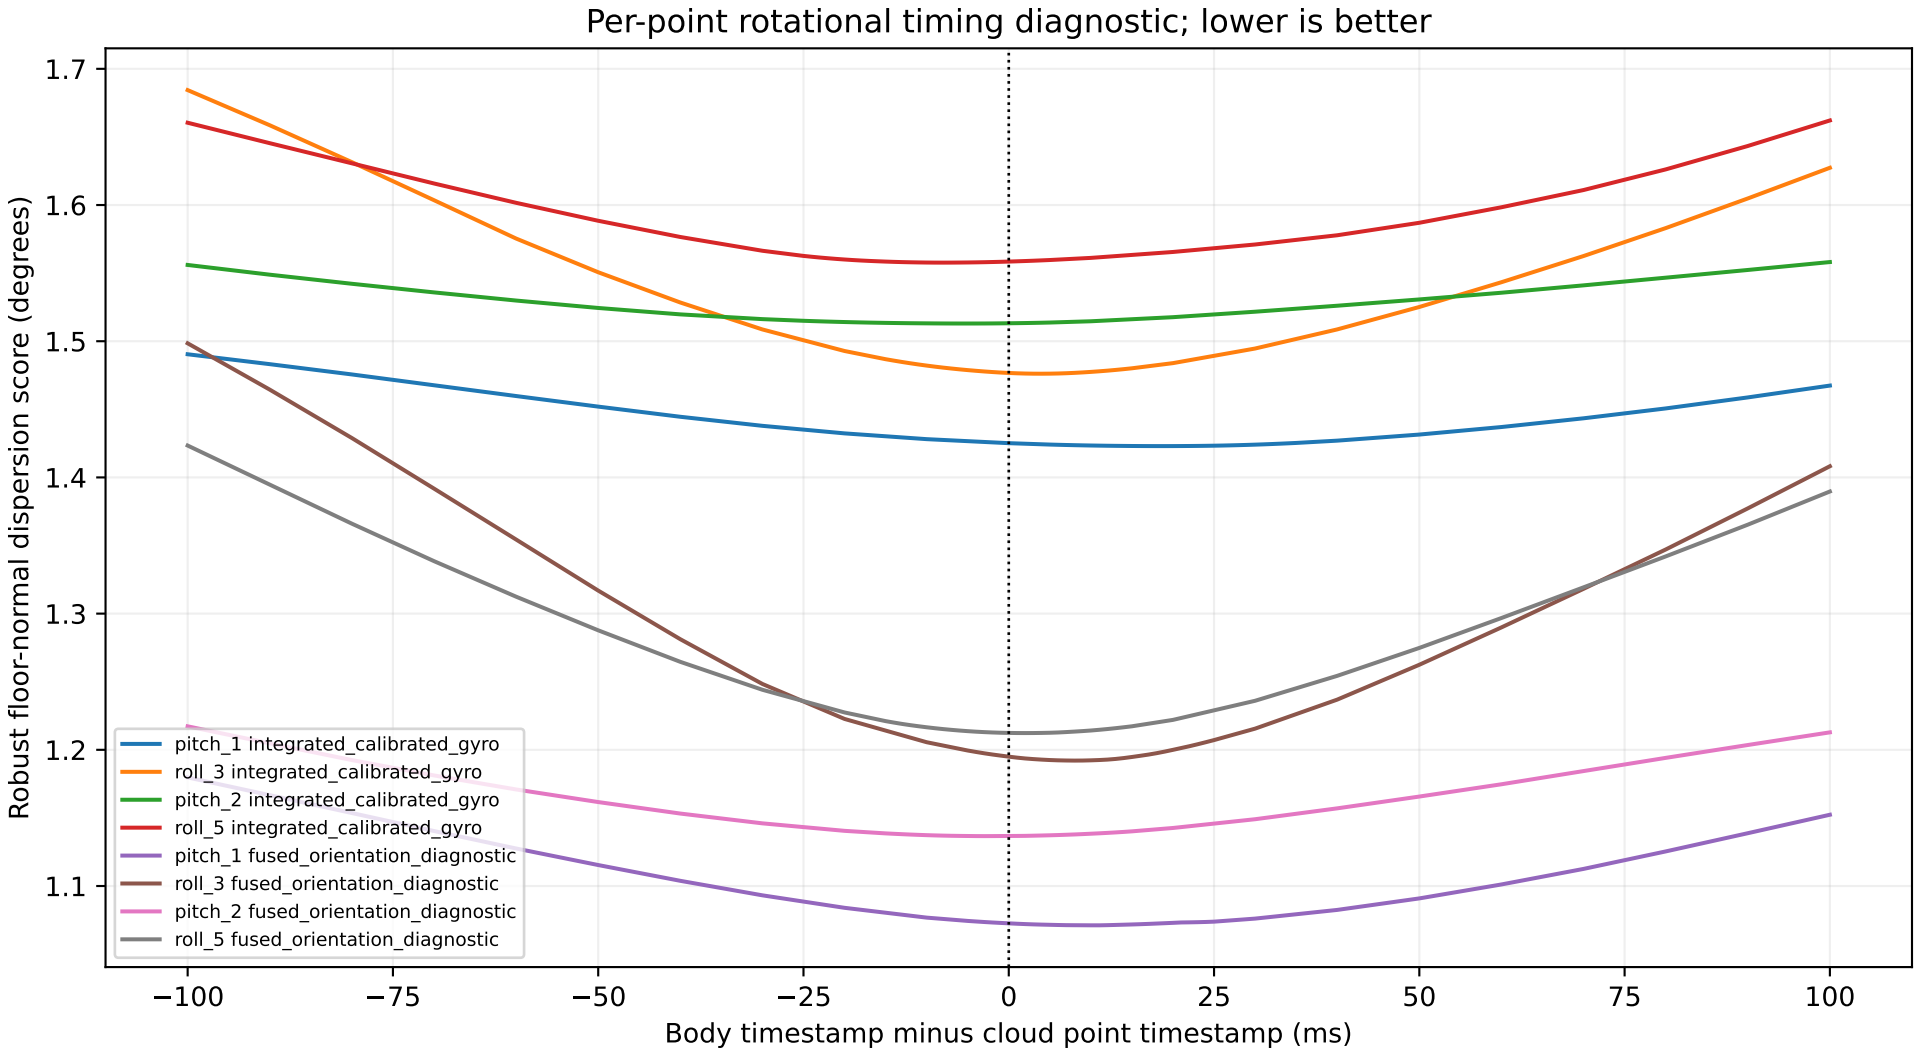
Per-point rotational timing diagnostic; lower is better
Robust floor-normal dispersion score (degrees)
1.7
1.6
1.5
1.4
1.3
1.2
1.1
−100
−75
−50
−25
0
25
50
75
100
Body timestamp minus cloud point timestamp (ms)
pitch_1 integrated_calibrated_gyro
roll_3 integrated_calibrated_gyro
pitch_2 integrated_calibrated_gyro
roll_5 integrated_calibrated_gyro
pitch_1 fused_orientation_diagnostic
roll_3 fused_orientation_diagnostic
pitch_2 fused_orientation_diagnostic
roll_5 fused_orientation_diagnostic