Endothelial cluster 3 Hallmark: P4 minus Control

HALLMARK UV RESPONSE DN

P4 minus Control | NES -1.51
BH FDR 0.0412 | favours Control

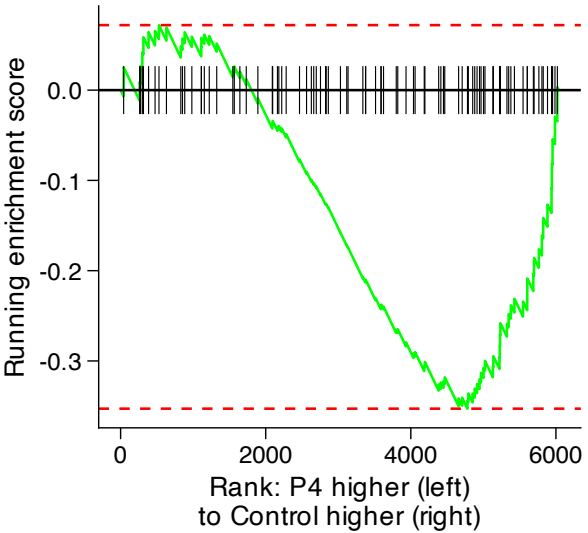

HALLMARK MYC TARGETS V1

P4 minus Control | NES 2.34
BH FDR 3.82e-10 | favours P4

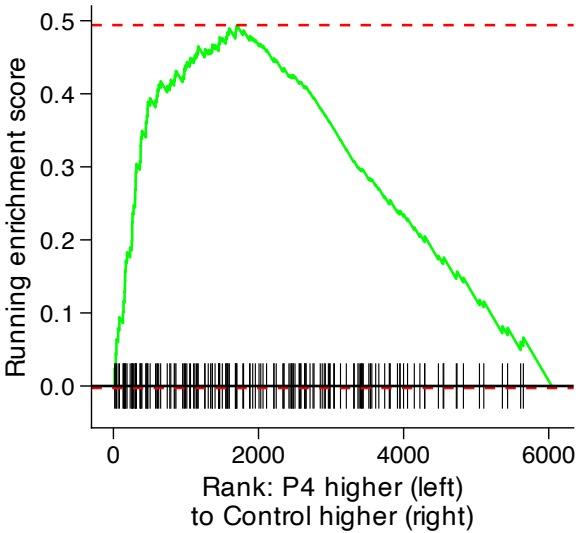

Lowest-FDR pathway in each direction, regardless of significance. Pig orthologue projection; no claim of pathway activation.