


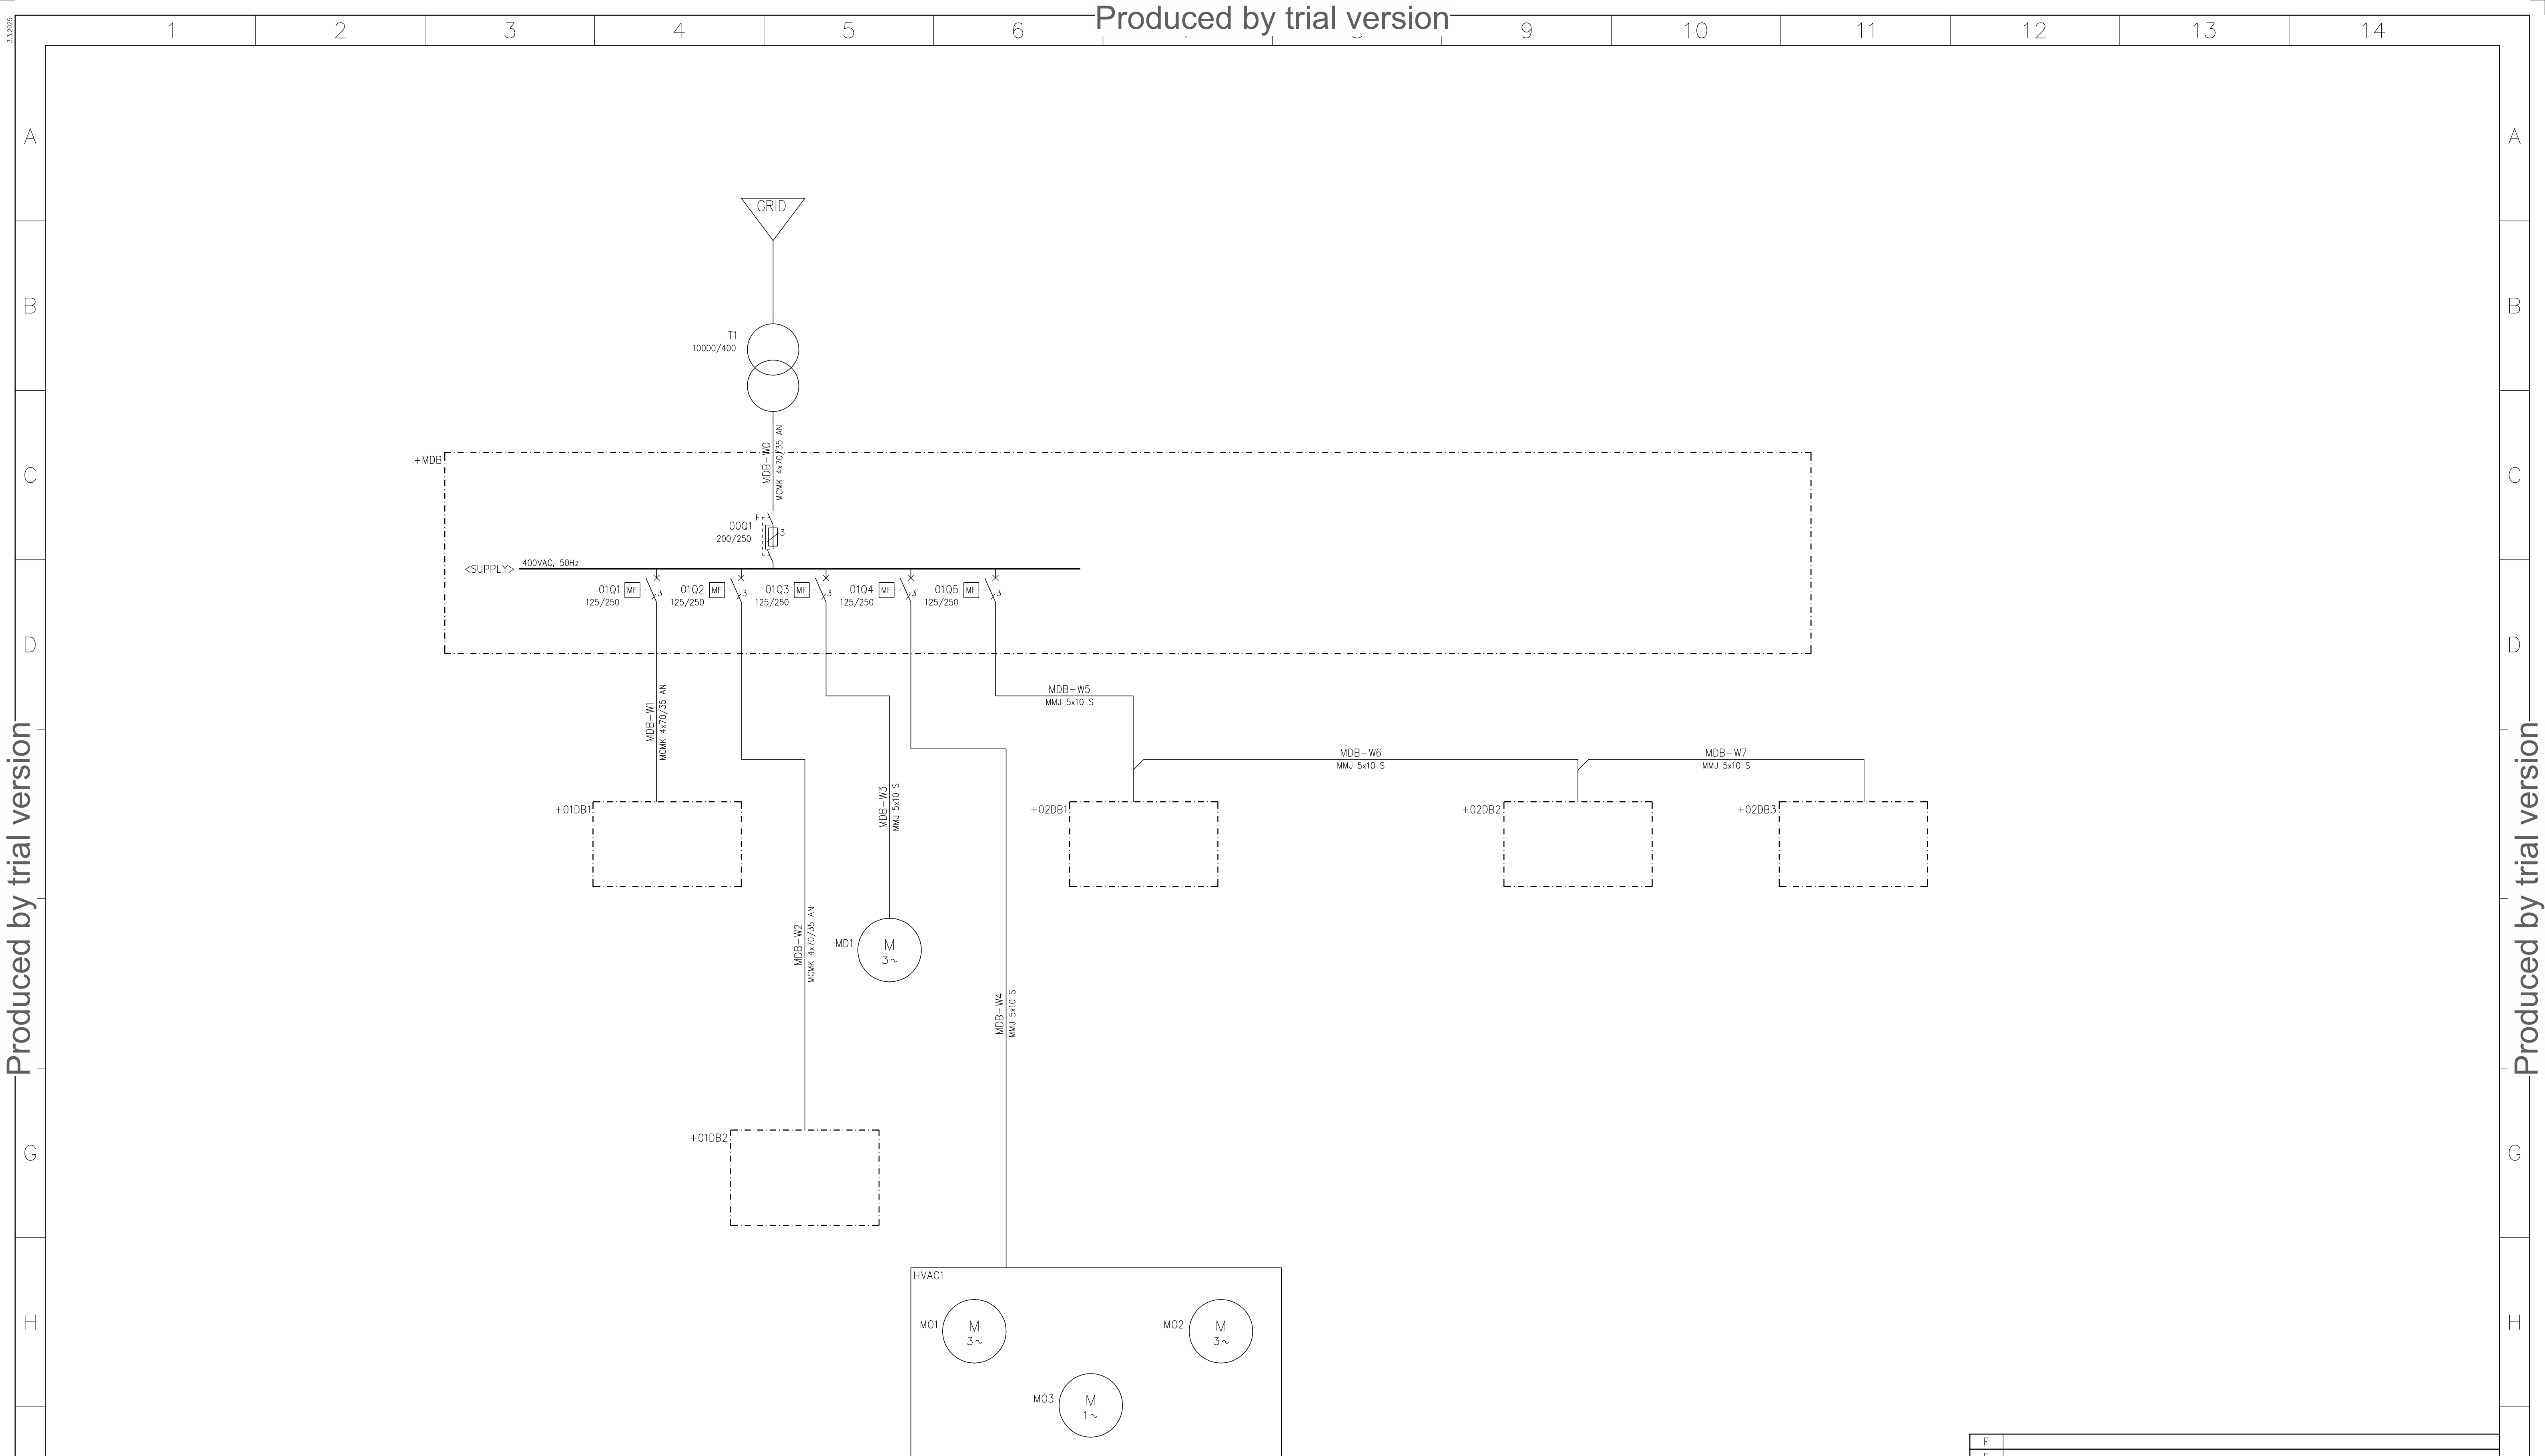

Produced by trial version

1 2 3 4 5 6 9 10 11 12 13 14

A

B

C

D

G

H

J

132295

GRID

T1
10000/400

MDB-W0
MCMK 4x70/25 AN

0001
200/250

<SUPPLY> 400VAC, 50Hz

0101 MF 125/250

0102 MF 125/250

0103 MF 125/250

0104 MF 125/250

0105 MF 125/250

MDB-W1
MCMK 4x70/25 AN

+01DB1

MDB-W2
MCMK 4x70/25 AN

+01DB2

MD1
M
3~

MDB-W3
MMJ 5x10 S

MDB-W4
MMJ 5x10 S

MDB-W5
MMJ 5x10 S

+02DB1

MDB-W6
MMJ 5x10 S

+02DB2

MDB-W7
MMJ 5x10 S

+02DB3

HVAC1

MO1
M
3~

MO2
M
3~

MO3
M
1~

Rev.	Description
F	
E	
D	
C	
B	
A	

Produced by trial version

[illegible]