



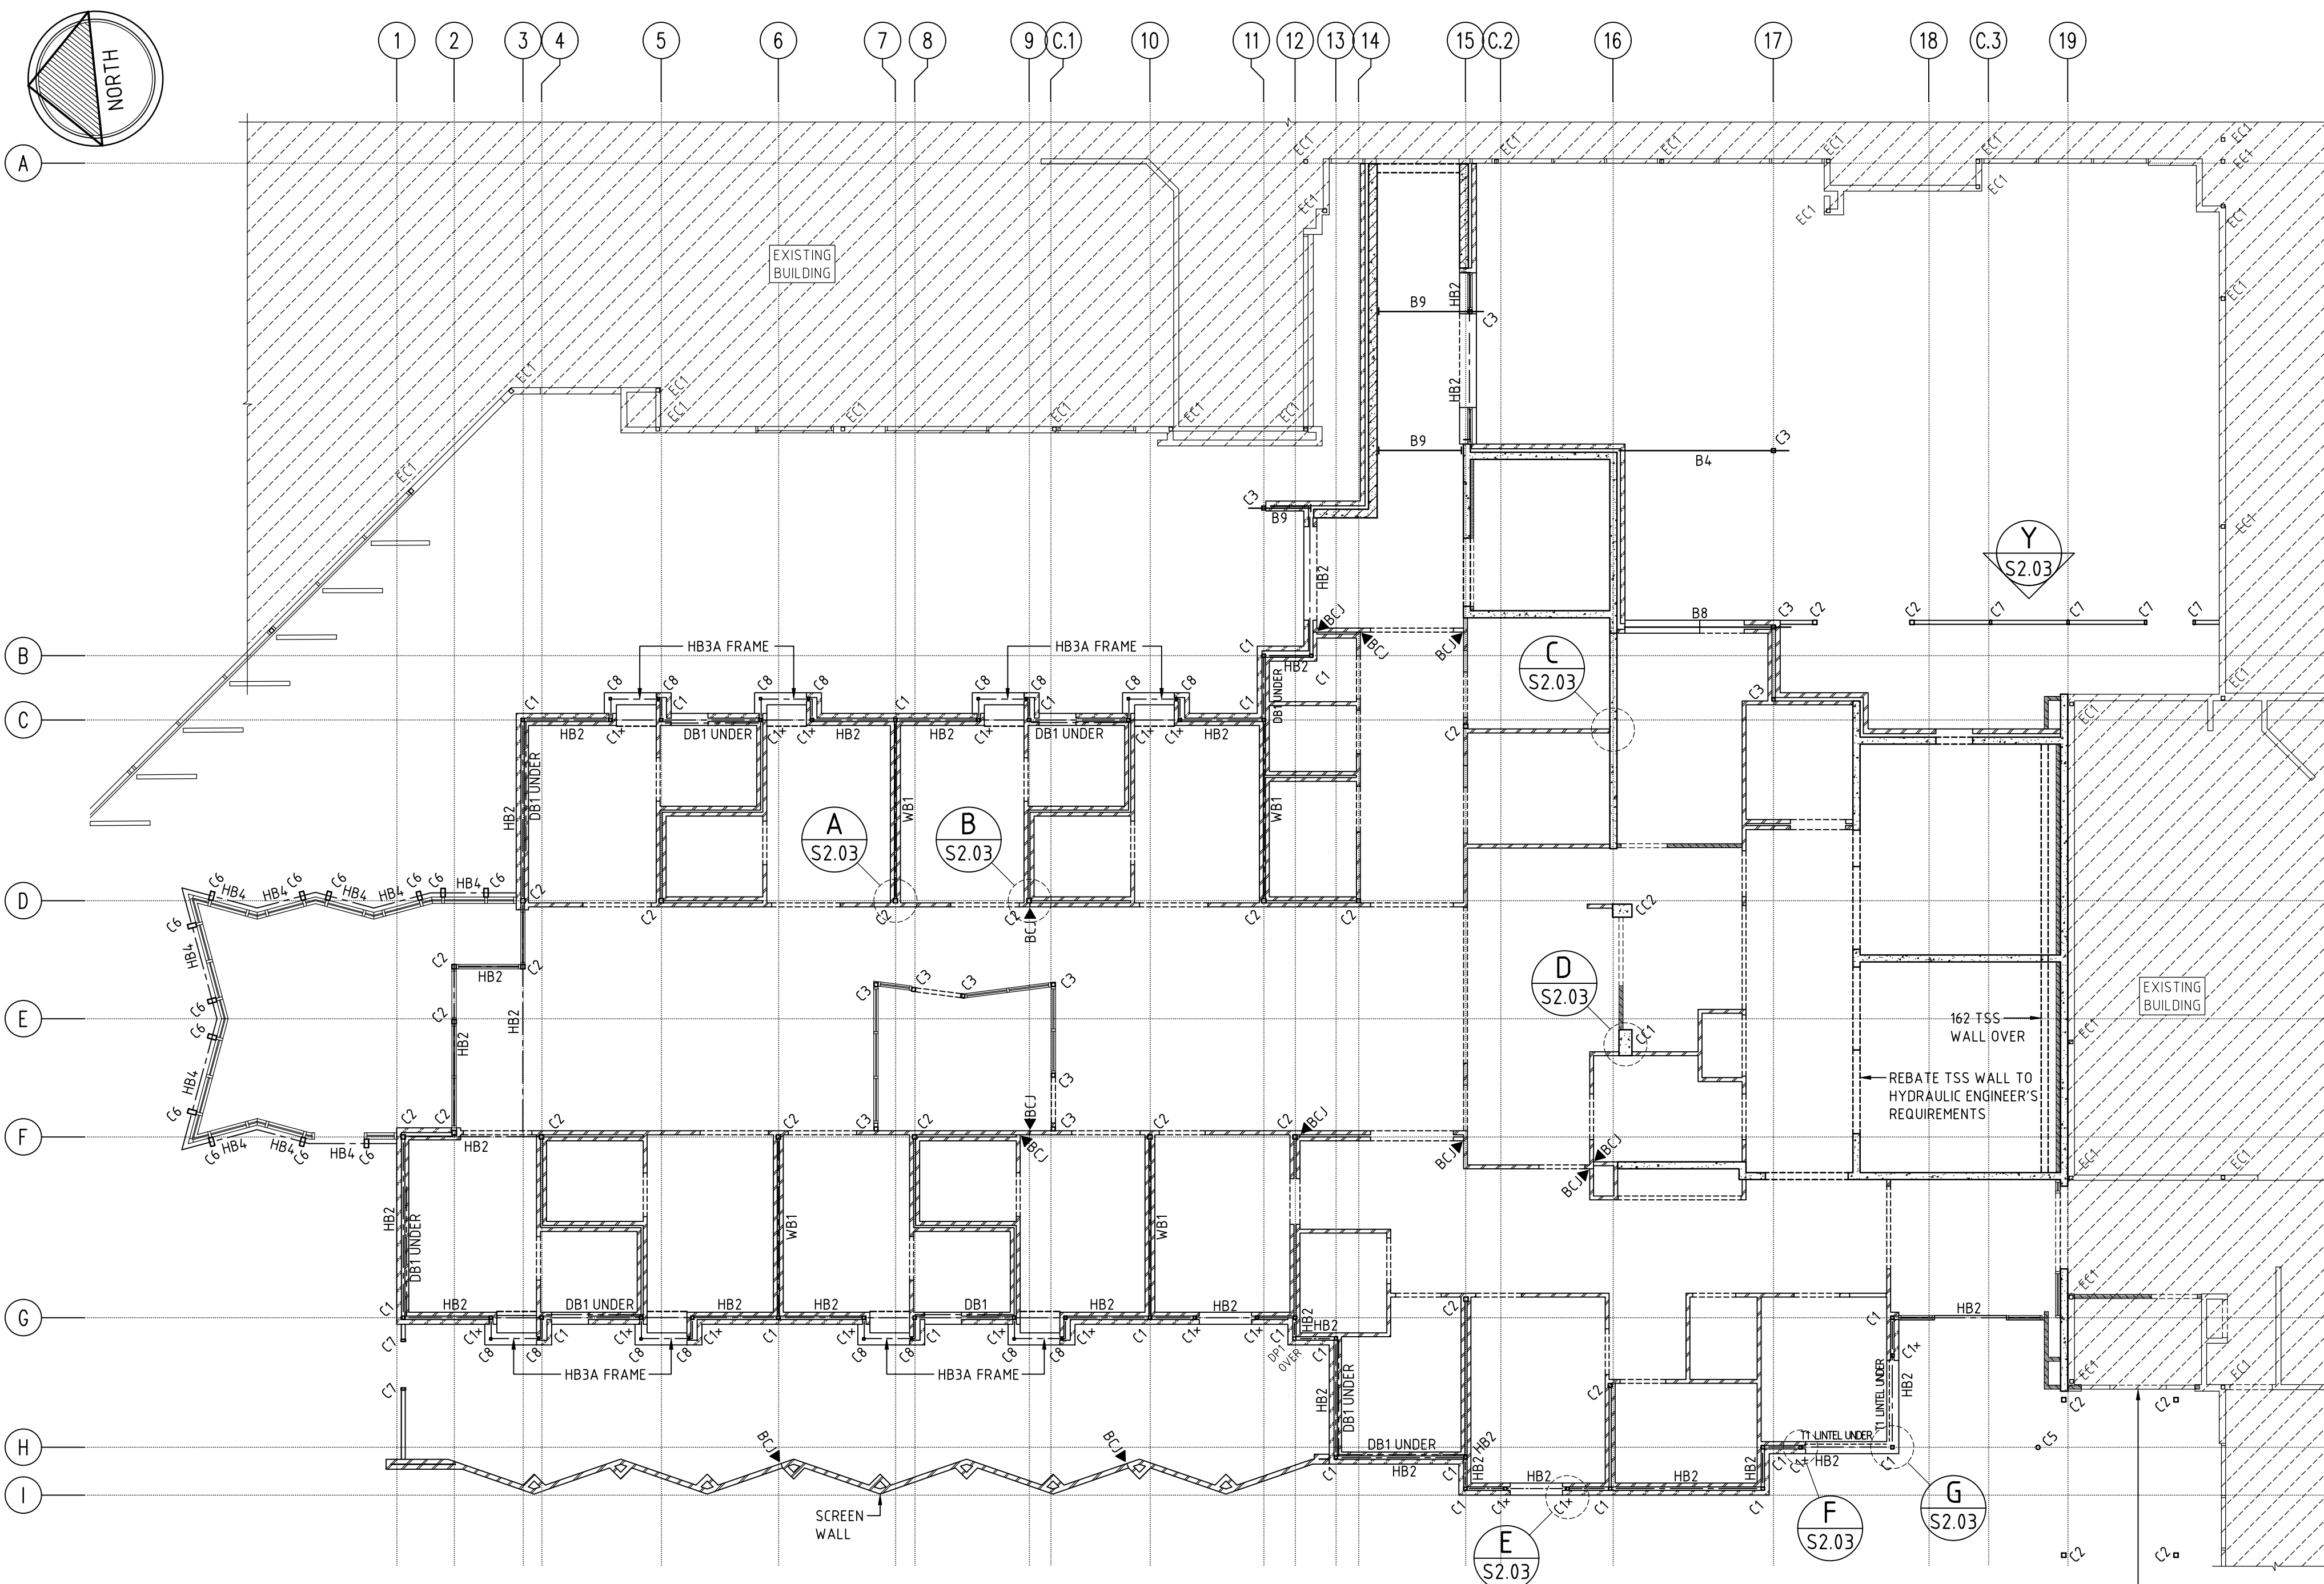


COLUMN AND WALL LAYOUT PLAN 1:100

- DENOTES EXISTING BUILDING
- DENOTES 90mm LONGREACH BRICKWORK
- DENOTES 110mm EXTERNAL BRICK WALL
- DENOTES 76 STEEL STUD FRAME
- DENOTES 92 STEEL STUD FRAME
- DENOTES 162mm TSS CONCRETE WALL OR SIMILAR APPROVED
- DENOTES 200mm TSS CONCRETE WALL OR SIMILAR APPROVED
- DENOTES BRICK CONTROL JOINT IN MASONRY. REFER DETAILS.

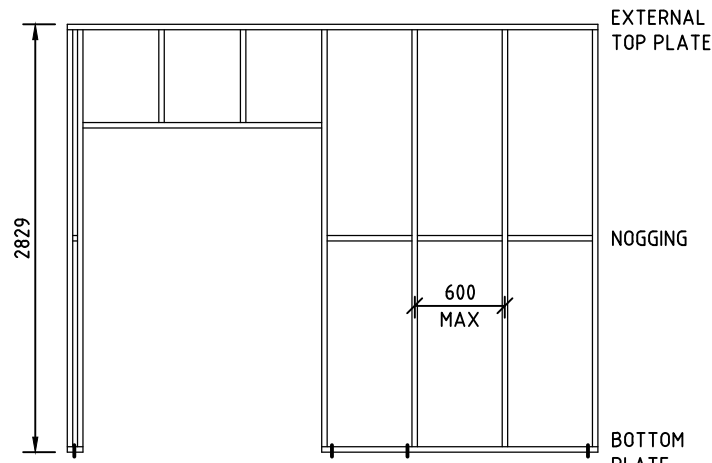

76mm WIDE STUD FRAMING N.T.S.

- REFER WALL LAYOUT PLAN FOR LOCATION.
- RONDO MAXIFRAME 115 BMT STUD WALL FRAMING AND NOGGING OR A SIMILAR PRODUCT EQUIVALENT IN FUNCTION, QUALITY, ETC. TO THE APPROVAL OF THE SUPERINTENDENT'S REPRESENTATIVE TO SUIT ALL INSTALL IN ACCORDANCE WITH MANUFACTURERS SPECIFICATION.
- PROVIDE 1-ROW OF NOGGING FOR WALLS LESS THAN 3m IN HEIGHT. PROVIDE 2-ROWS OF NOGGING FOR WALLS GREATER THAN 3m IN HEIGHT.
- WALL FRAMING MEMBERS FIXED TO EACH OTHER VIA 1-No.10 WAFER HEAD TEK SCREW EACH FACE AT EACH CONNECTION LOCATION.
- TOP AND BOTTOM PLATE FIXED TO CONCRETE WITH 1-M8 SCREW BOLT (100mm LONG (GALV.)) WITH 90mm MIN EMBEDMENT AND #30 STANDARD WASHER AT THE FOLLOWING LOCATIONS:
 - i) EACH END OF WALL PANEL.
 - ii) ADJACENT TO AND WITHIN 50mm OF EVERY SECOND STUD (1200 MAX CRS).
 - iii) ADJACENT TO AND WITHIN 50mm OF DOUBLE STUDS

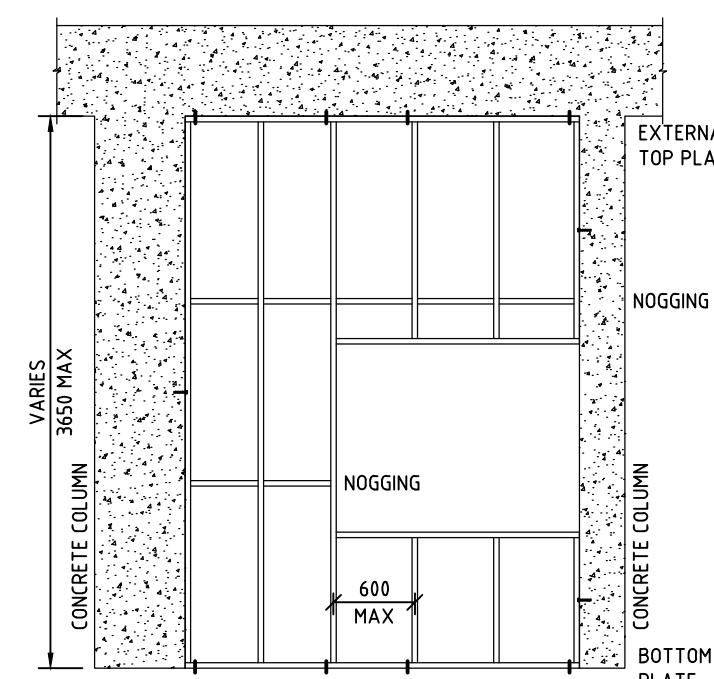

92mm WIDE STUD FRAMING N.T.S.

- REFER WALL LAYOUT PLAN FOR LOCATION.
- RONDO MAXIFRAME 115 BMT STUD WALL FRAMING AND NOGGING OR A SIMILAR PRODUCT EQUIVALENT IN FUNCTION, QUALITY, ETC. TO THE APPROVAL OF THE SUPERINTENDENT'S REPRESENTATIVE TO SUIT ALL INSTALL IN ACCORDANCE WITH MANUFACTURERS SPECIFICATION.
- PROVIDE 1-ROW OF NOGGING FOR WALLS LESS THAN 3m IN HEIGHT. PROVIDE 2-ROWS OF NOGGING FOR WALLS GREATER THAN 3m IN HEIGHT.
- WALL FRAMING MEMBERS FIXED TO EACH OTHER VIA 1-No.10 WAFER HEAD TEK SCREW EACH FACE AT EACH CONNECTION LOCATION.
- TOP AND BOTTOM PLATE FIXED TO CONCRETE WITH 1-M8 SCREW BOLT (100mm LONG (GALV.)) WITH 90mm MIN EMBEDMENT AND #30 STANDARD WASHER AT THE FOLLOWING LOCATIONS:
 - i) EACH END OF WALL PANEL.
 - ii) ADJACENT TO AND WITHIN 50mm OF EVERY SECOND STUD (1200 MAX CRS).
 - iii) ADJACENT TO AND WITHIN 50mm OF DOUBLE STUDS
- WALL FRAMING FIXED TO CONCRETE COLUMNS VIA 1-M8 SCREW BOLT (75mm LONG (GALV.)) WITH 60mm MIN EMBEDMENT AND #30 STANDARD WASHER AT THE FOLLOWING LOCATIONS:
 - i) 1 x FIXING 150 ABOVE BOTTOM PLATE
 - ii) 1 x FIXING 150 BELOW TOP PLATE
 - iii) 1 x FIXING AT MID SPAN

MEMBER SCHEDULE

ITEM	MEMBER
EC1	EXISTING COLUMN
CC1	600 x 300 CONCRETE COLUMN
CC2	450 x 300 CONCRETE COLUMN
C1	75 SHS 5.0
C1*	75 SHS 5.0 CAVITY COLUMN TO U/S OF BEAM
C2	100 SHS 5.0
C3	89 SHS 5.0
C4	389 x 200 RHS 6.0
C5	101.6 CHS
C6	150 x 100 RHS 5.0
C7	100 x 50 RHS 4.0
C8	50 SHS 5.0
DP1	75 SHS 4.0 DROPPER
B9	89 SHS 5.0
B10	180 UB 18.1
HB1	180 PFC HEAD BEAM
HB2	150 x 100 RHS 5.0 HEAD BEAM
HB2A	150 x 100 RHS 5.0 HEAD BEAM
HB3	125 x 75 RHS 4.0 HEAD BEAM
HB3A	125 x 75 RHS 4.0 HEAD BEAM
HB4	200 x 100 RHS 4.0 HEAD BEAM
HB5	C15019 HEAD BEAM
HB6	89 SHS 5.0 HEAD BEAM
FB1	150 x 100 RHS 5.0 FASCIA BEAM
DB1	125 x 75 RHS 4.0 DIAGONAL BRACE
WB1	2-16# RODS DIAGONAL BRACE

SHEET ROOF CONSTRUCTION

LINTEL SCHEDULE

ITEM	MEMBER
T1	250 x 10 PLATE
	250 x 10 PLATE
	WELDING TO LINTELS - 6/ 50 (100) WELD END 200
	ALL LINTELS SHALL BE TREATED IN ACCORDANCE WITH THE EXPOSED STEEL WORK NOTES.
	PROVIDE 250mm MIN. BEARING TO LINTELS OR 2-M16 8.8/S BOLTS TO EX 10 PLATE "T" CLEAT.
	BRICKWORK OVER LINTELS SHALL BE REINFORCED WITH #6 WIRES (REFER MASONRY NOTES FOR REQUIRED DURABILITY CLASS), CONTINUOUS AND EXTEND 500mm PAST OPENINGS AND COG 300 AROUND CORNERS.

SHEET ROOF CONSTRUCTION

0	ISSUED FOR TENDER	12.03.26	J.V.
E	ISSUED FOR BOQ	13.02.26	J.V.
D	ISSUED FOR COORDINATION	24.10.25	J.V.
C	OUTDOOR AREA AMENDED	13.05.25	J.V.
B	ISSUED FOR DESIGN DEVELOPMENT COST REVIEW	12.05.25	J.V.
NO.	AMENDMENT	DATE	INIT.

TENDER



ph: (08) 9389 7228 f: (08) 9389 7291
info@terpkos.com.au | www.terpkos.com
Unit 1018 Spring HWY Nedlands Perth, WA 6009



Government of Western Australia
Department of Housing and Works
Buildings and Contracts

STRUCTURAL

ROCKINGHAM MHEC & BAC
ROCKINGHAM GENERAL HOSPITAL
71 ELANORA DRIVE, COOLOONGUP
COLUMN AND WALL LAYOUT PLAN

DRAWN	J.V.	DESIGNED	P.T.	REDUCTION
CHECKED	P.T.	DHW TENDER No.	DHW1018123	0 25
APPROVED	-			
SCALE	1:100 AT A1	DATE	NOV 2023	DRAWING No.
DHW PROJ No.	15365	DHW FILE No.	2023/01081	S2.01