




Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0302_0_100.csv

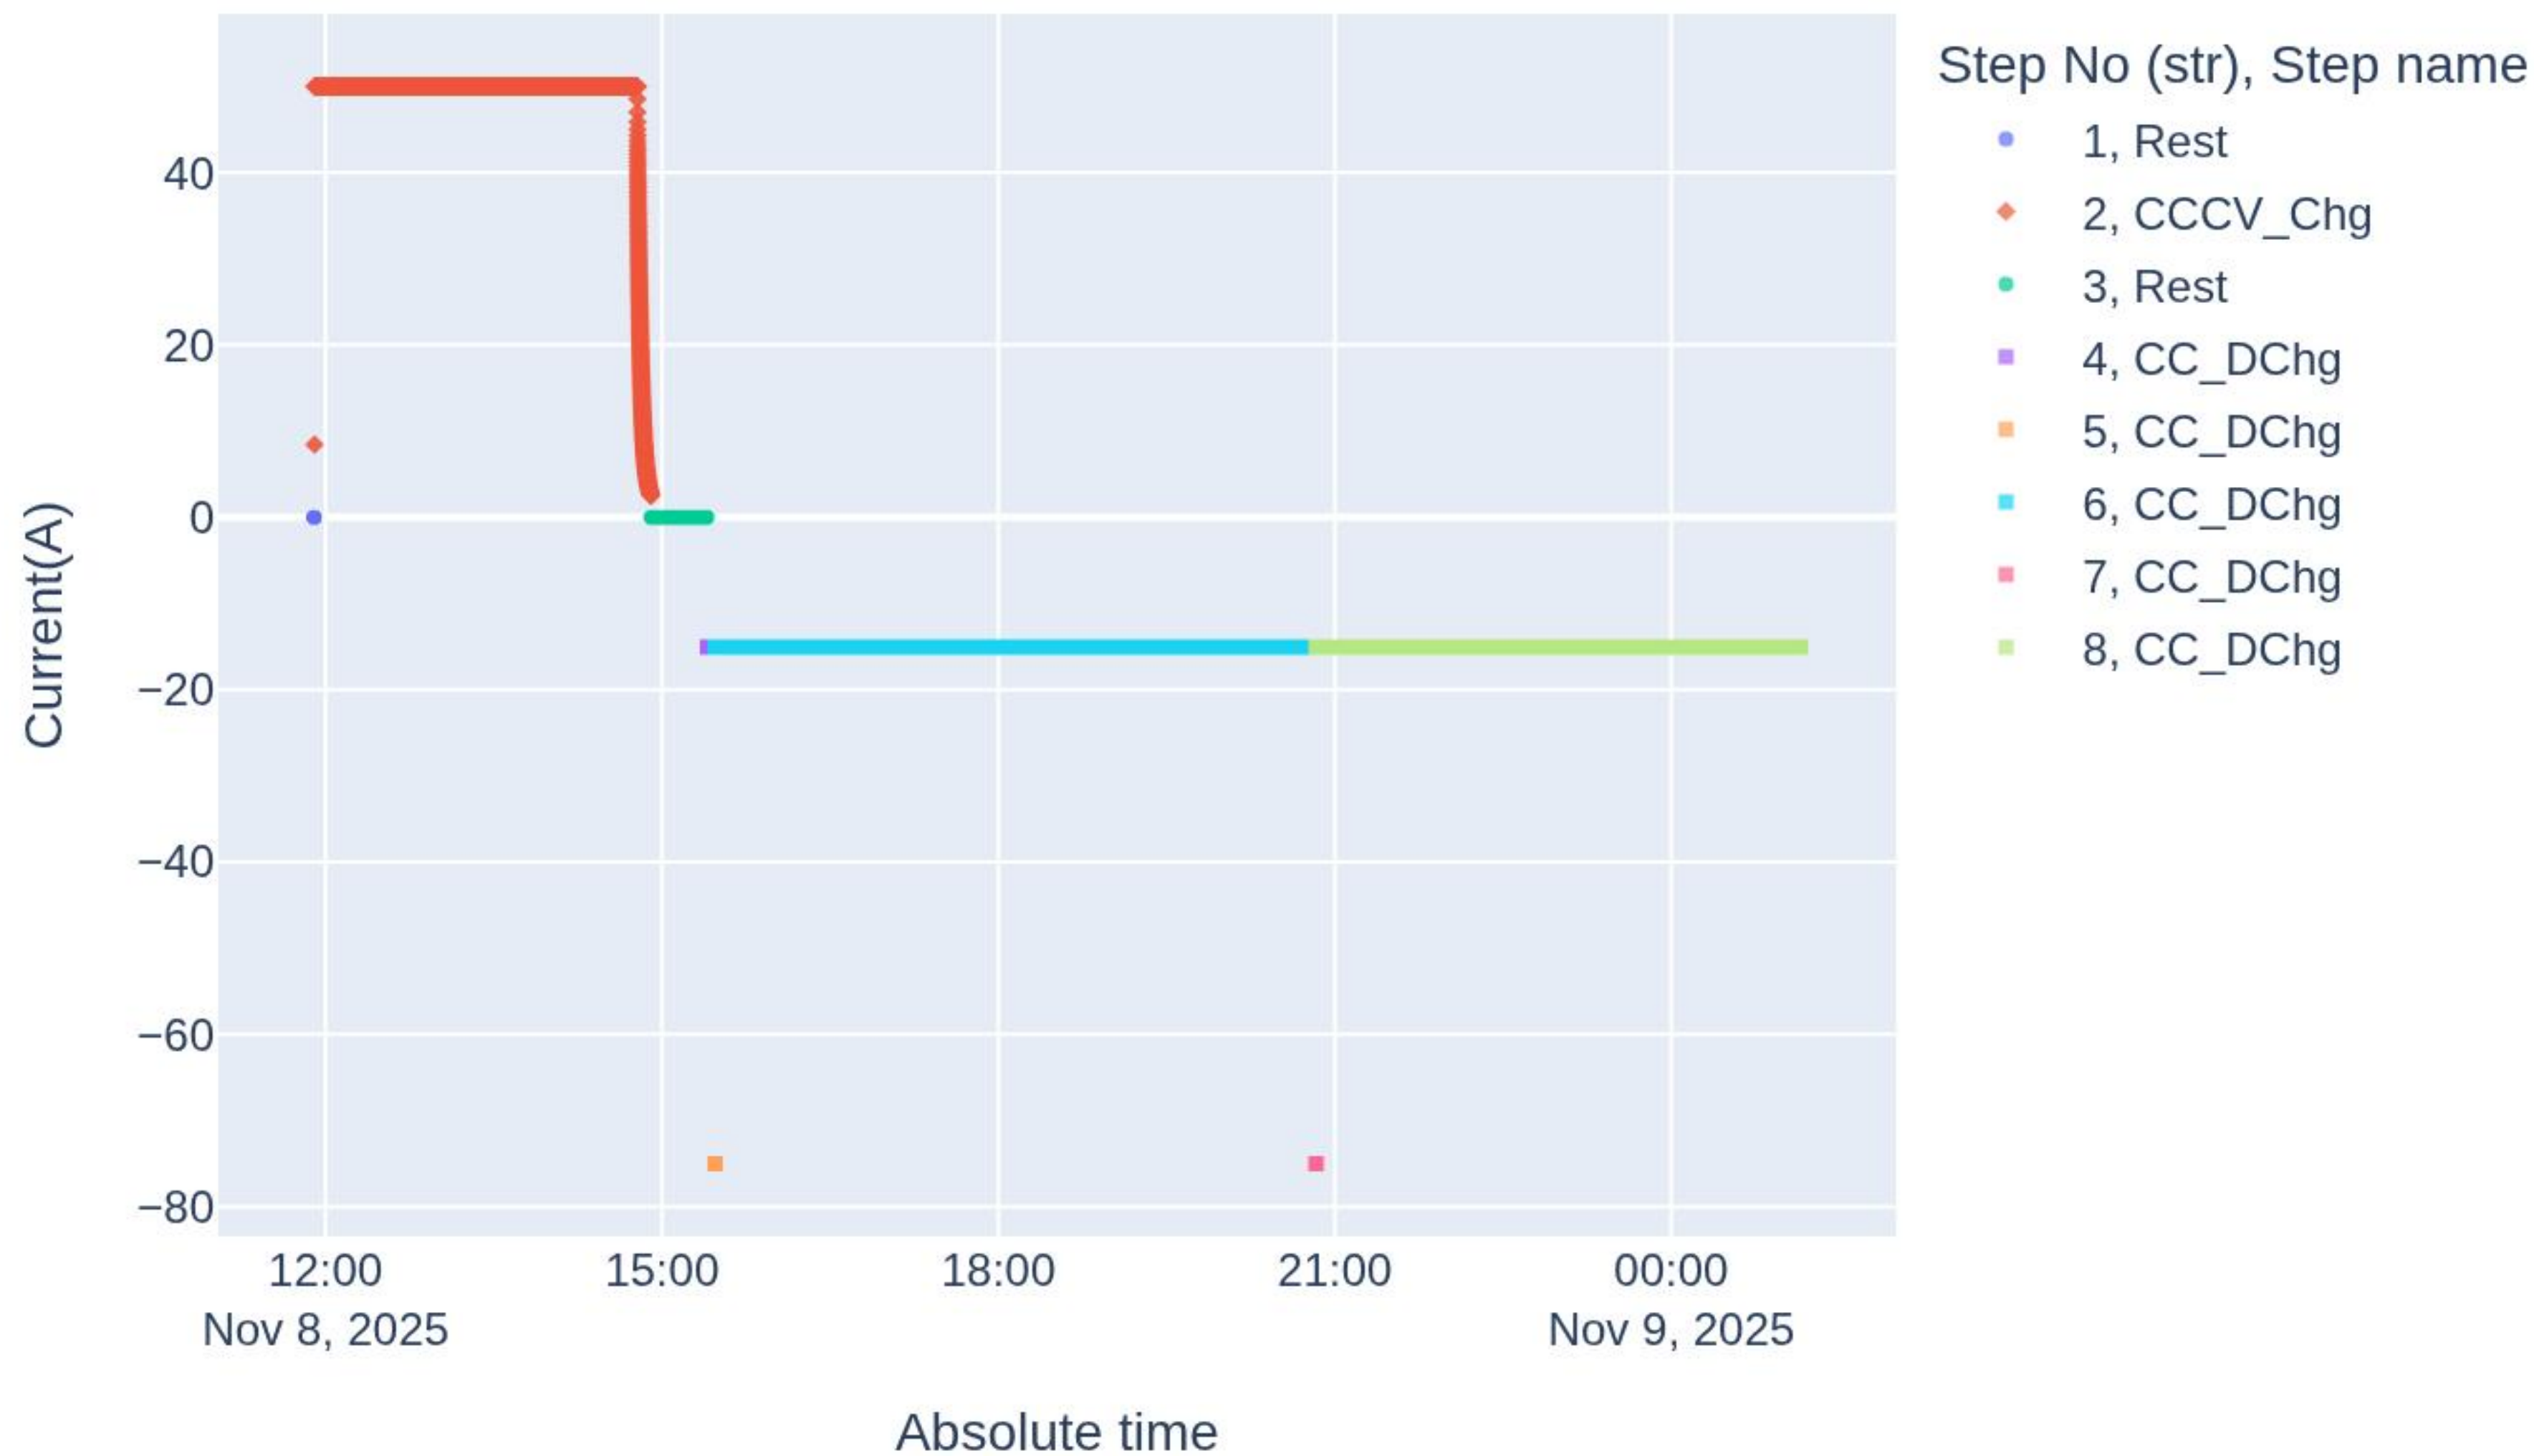


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0302_0_100.csv

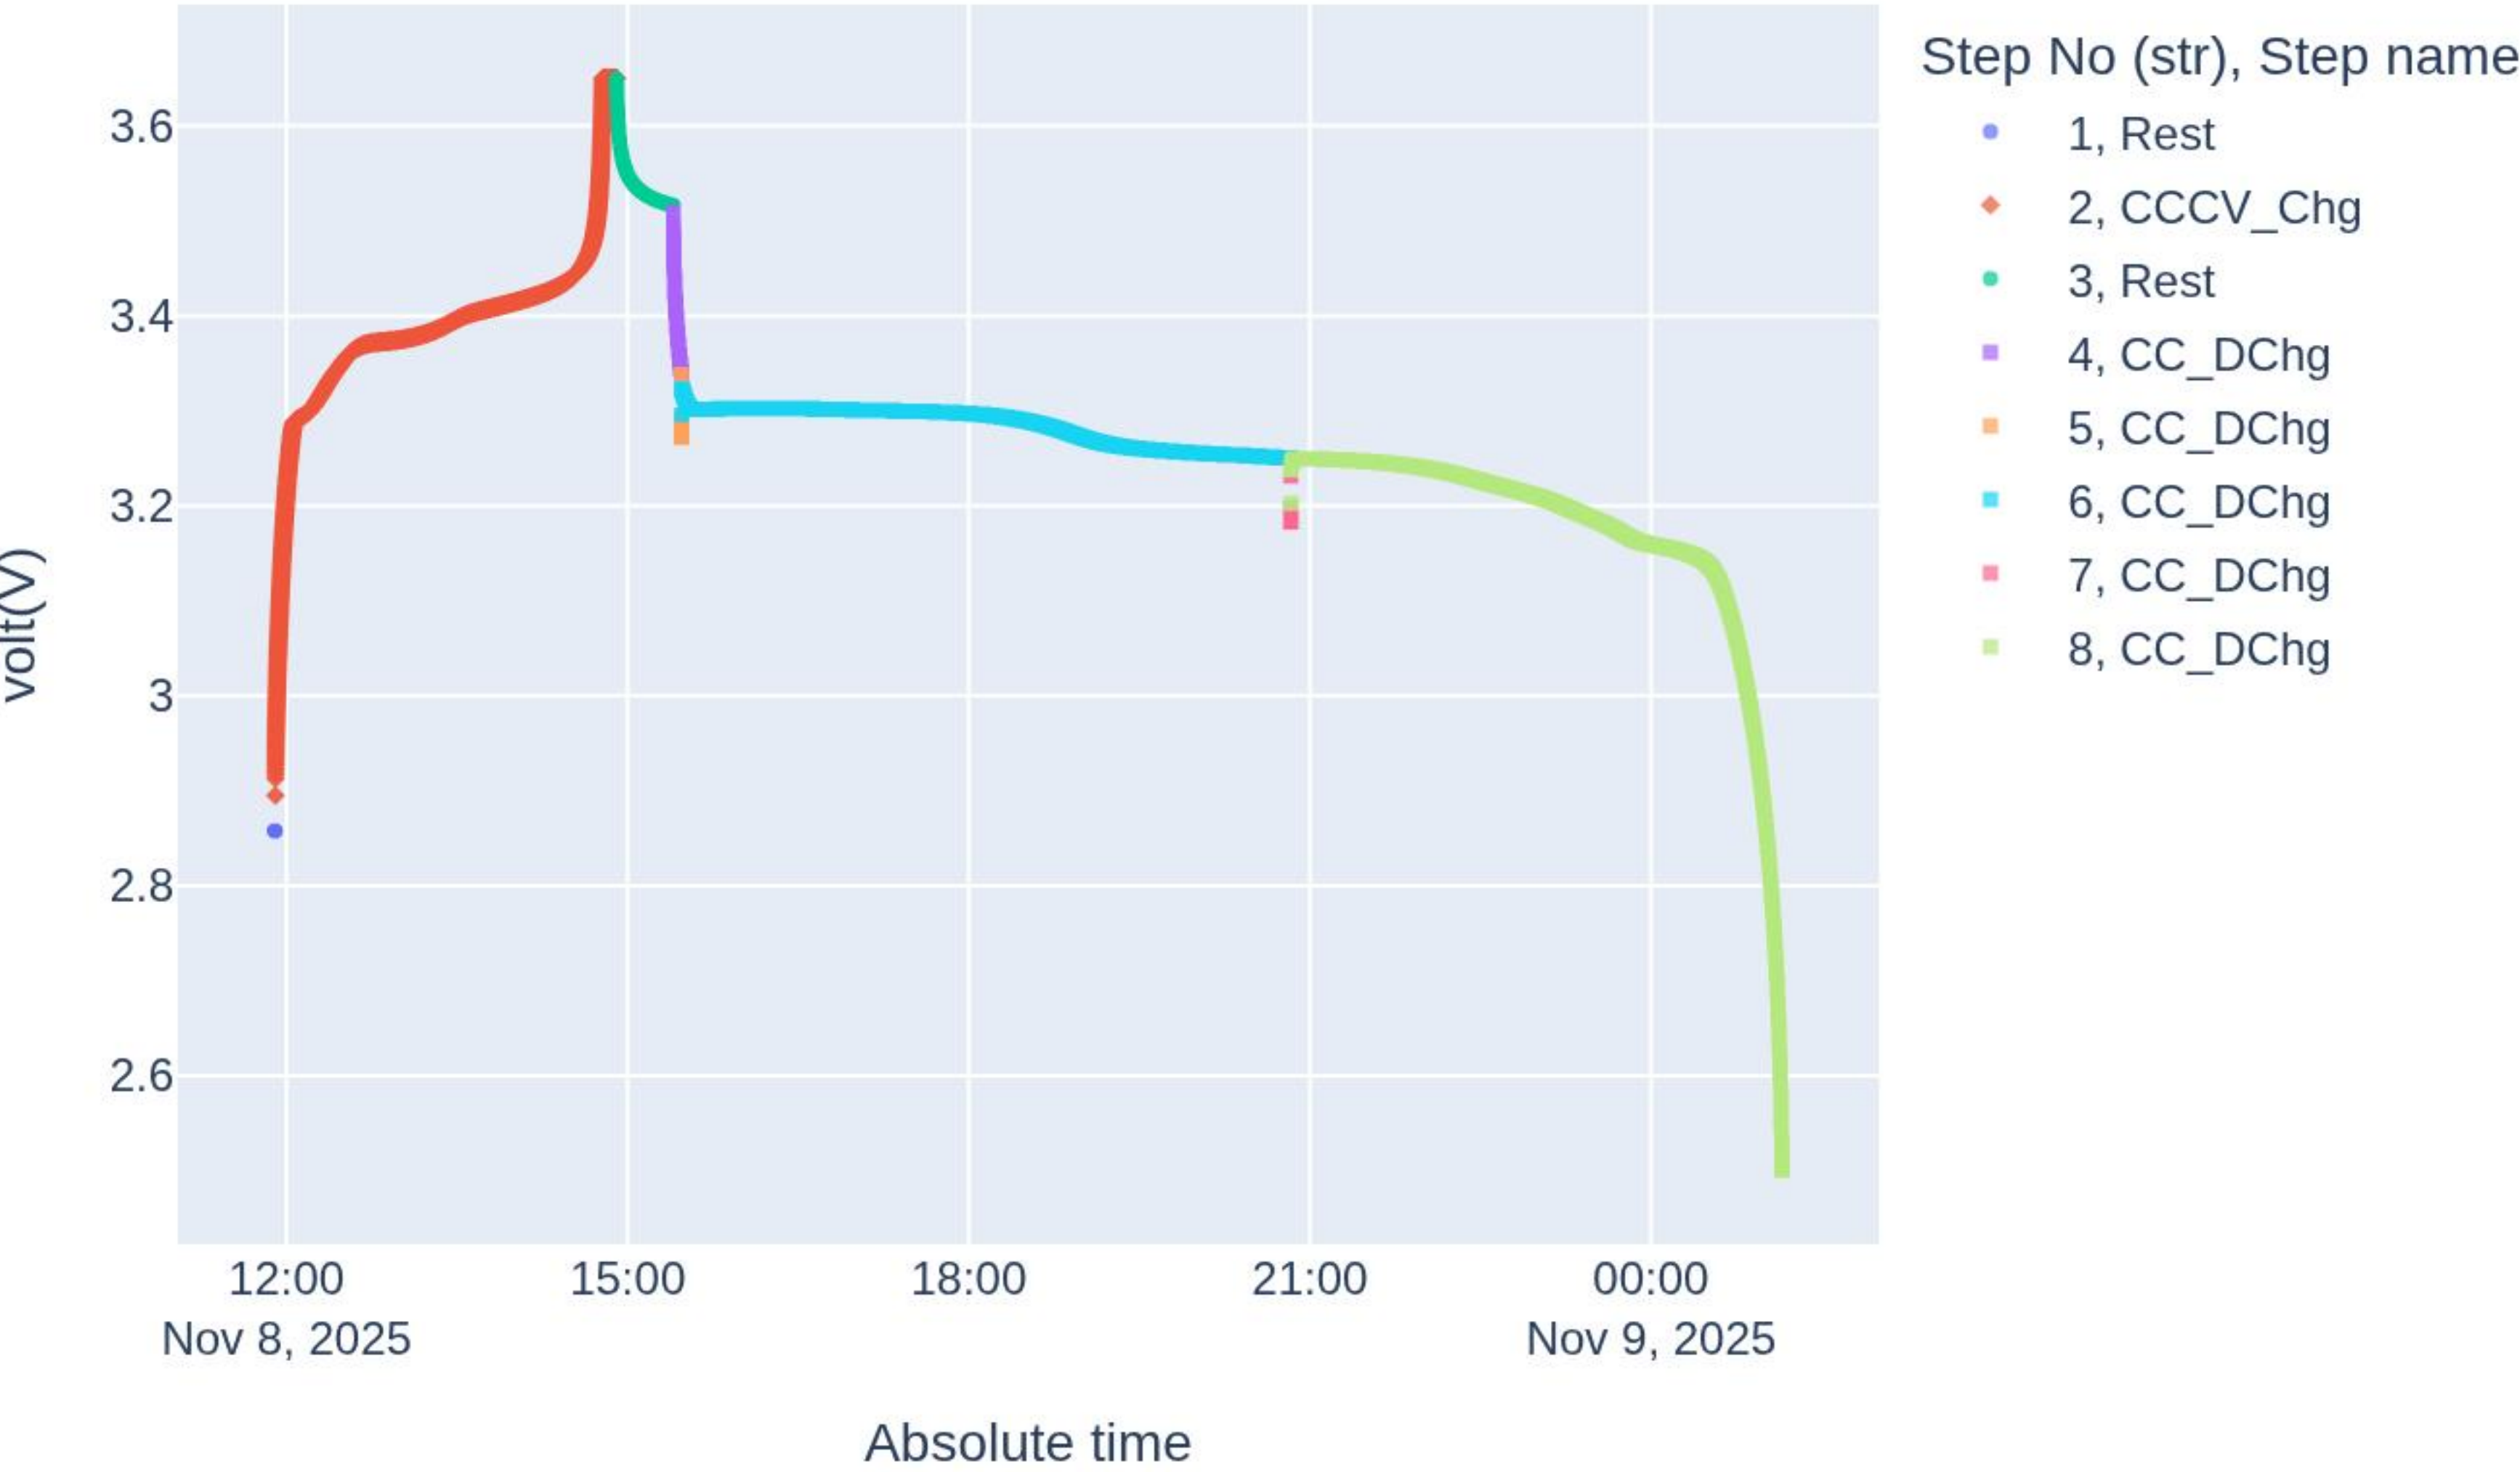


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0303_0_100.csv

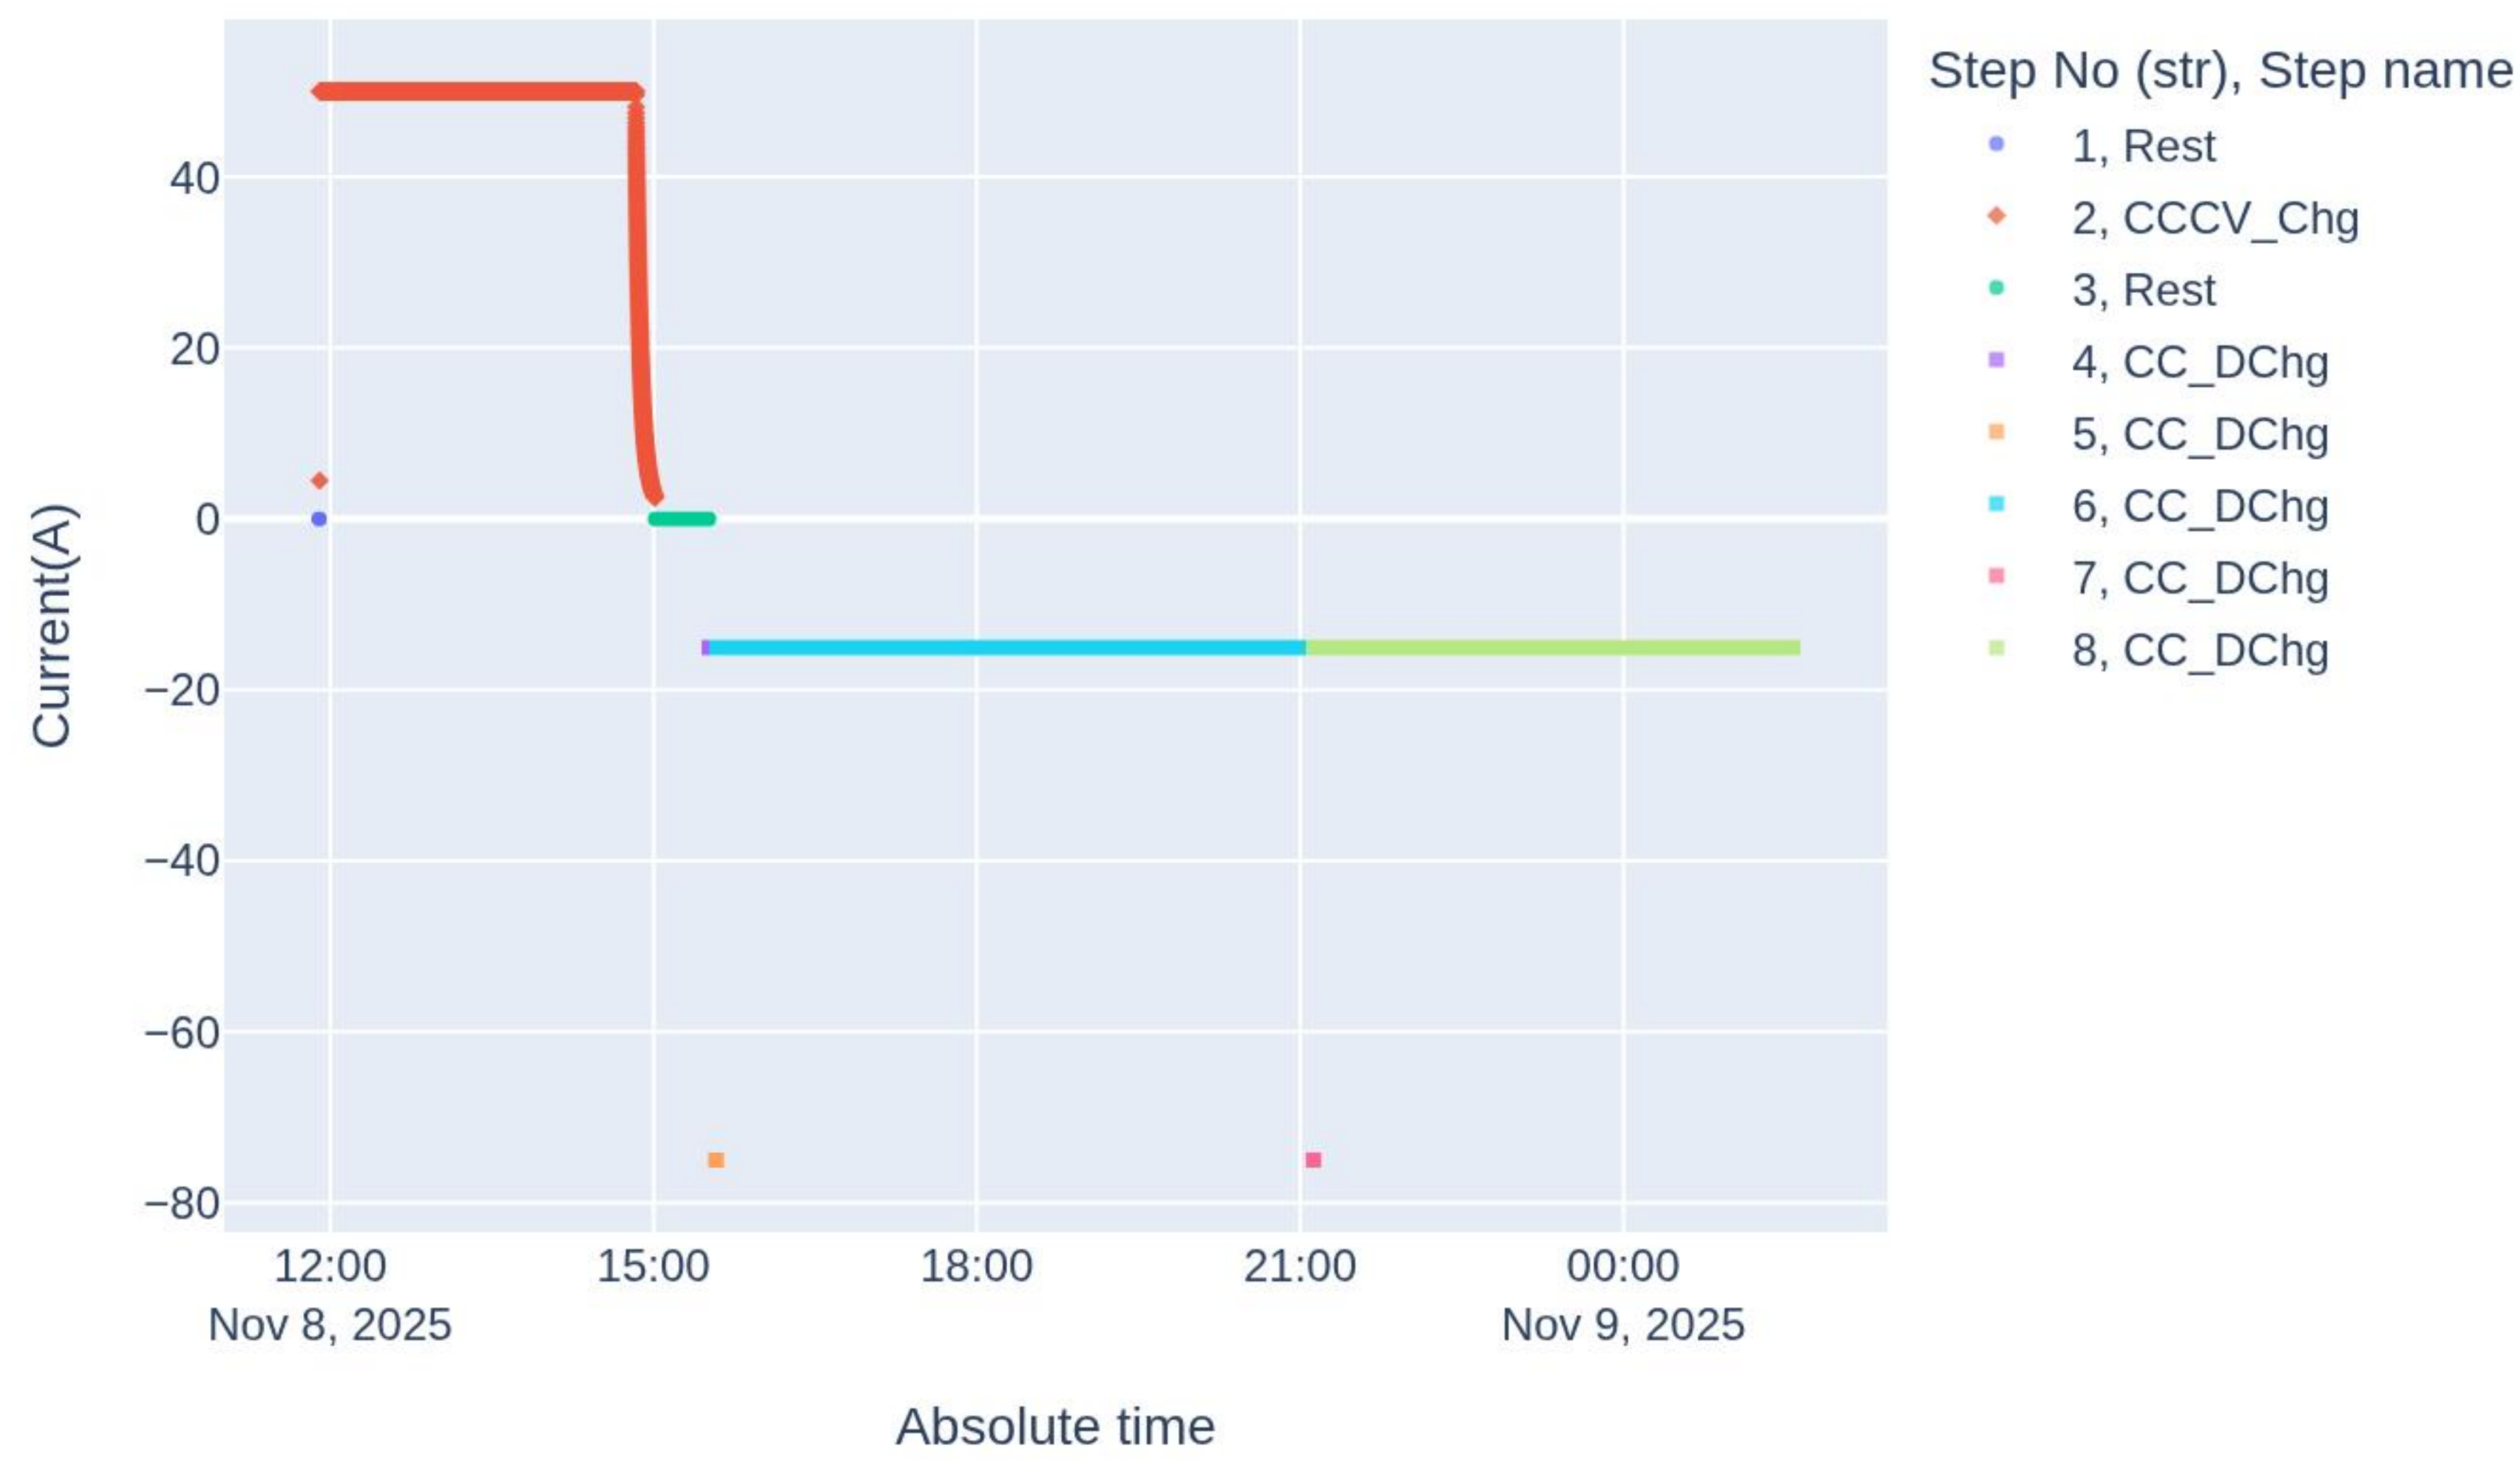


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0303_0_100.csv

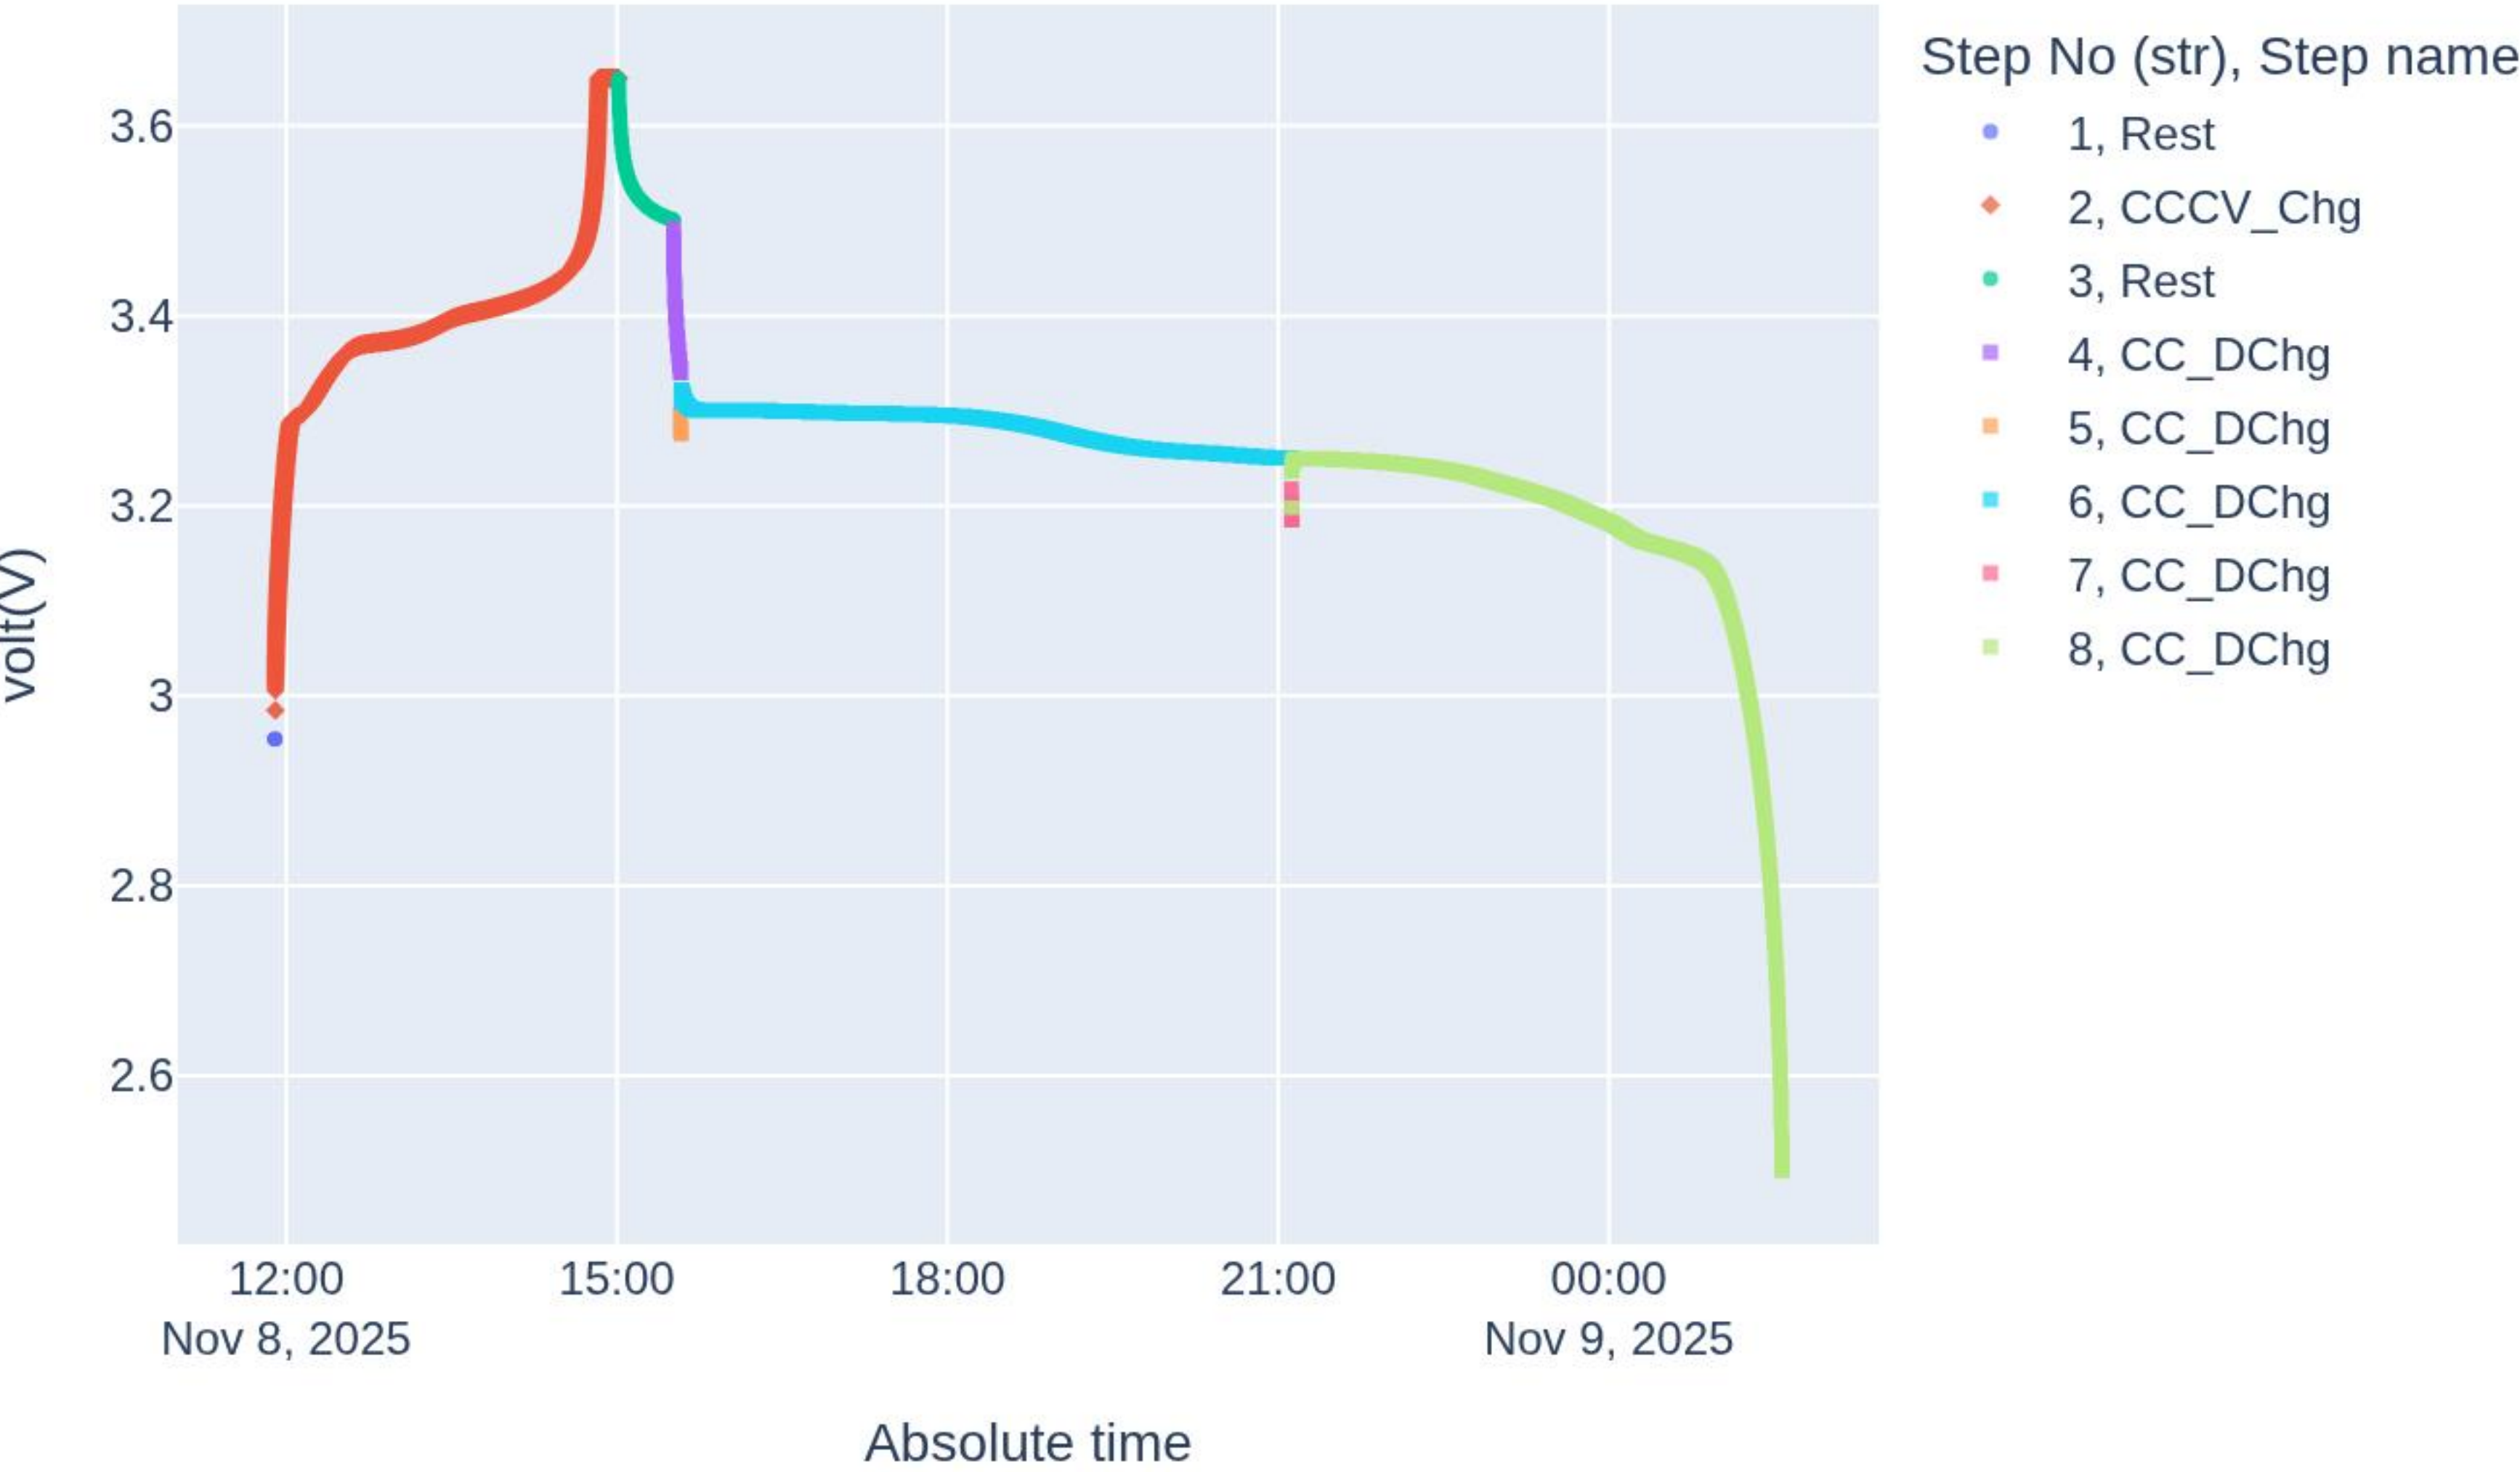


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0304_0_100.csv

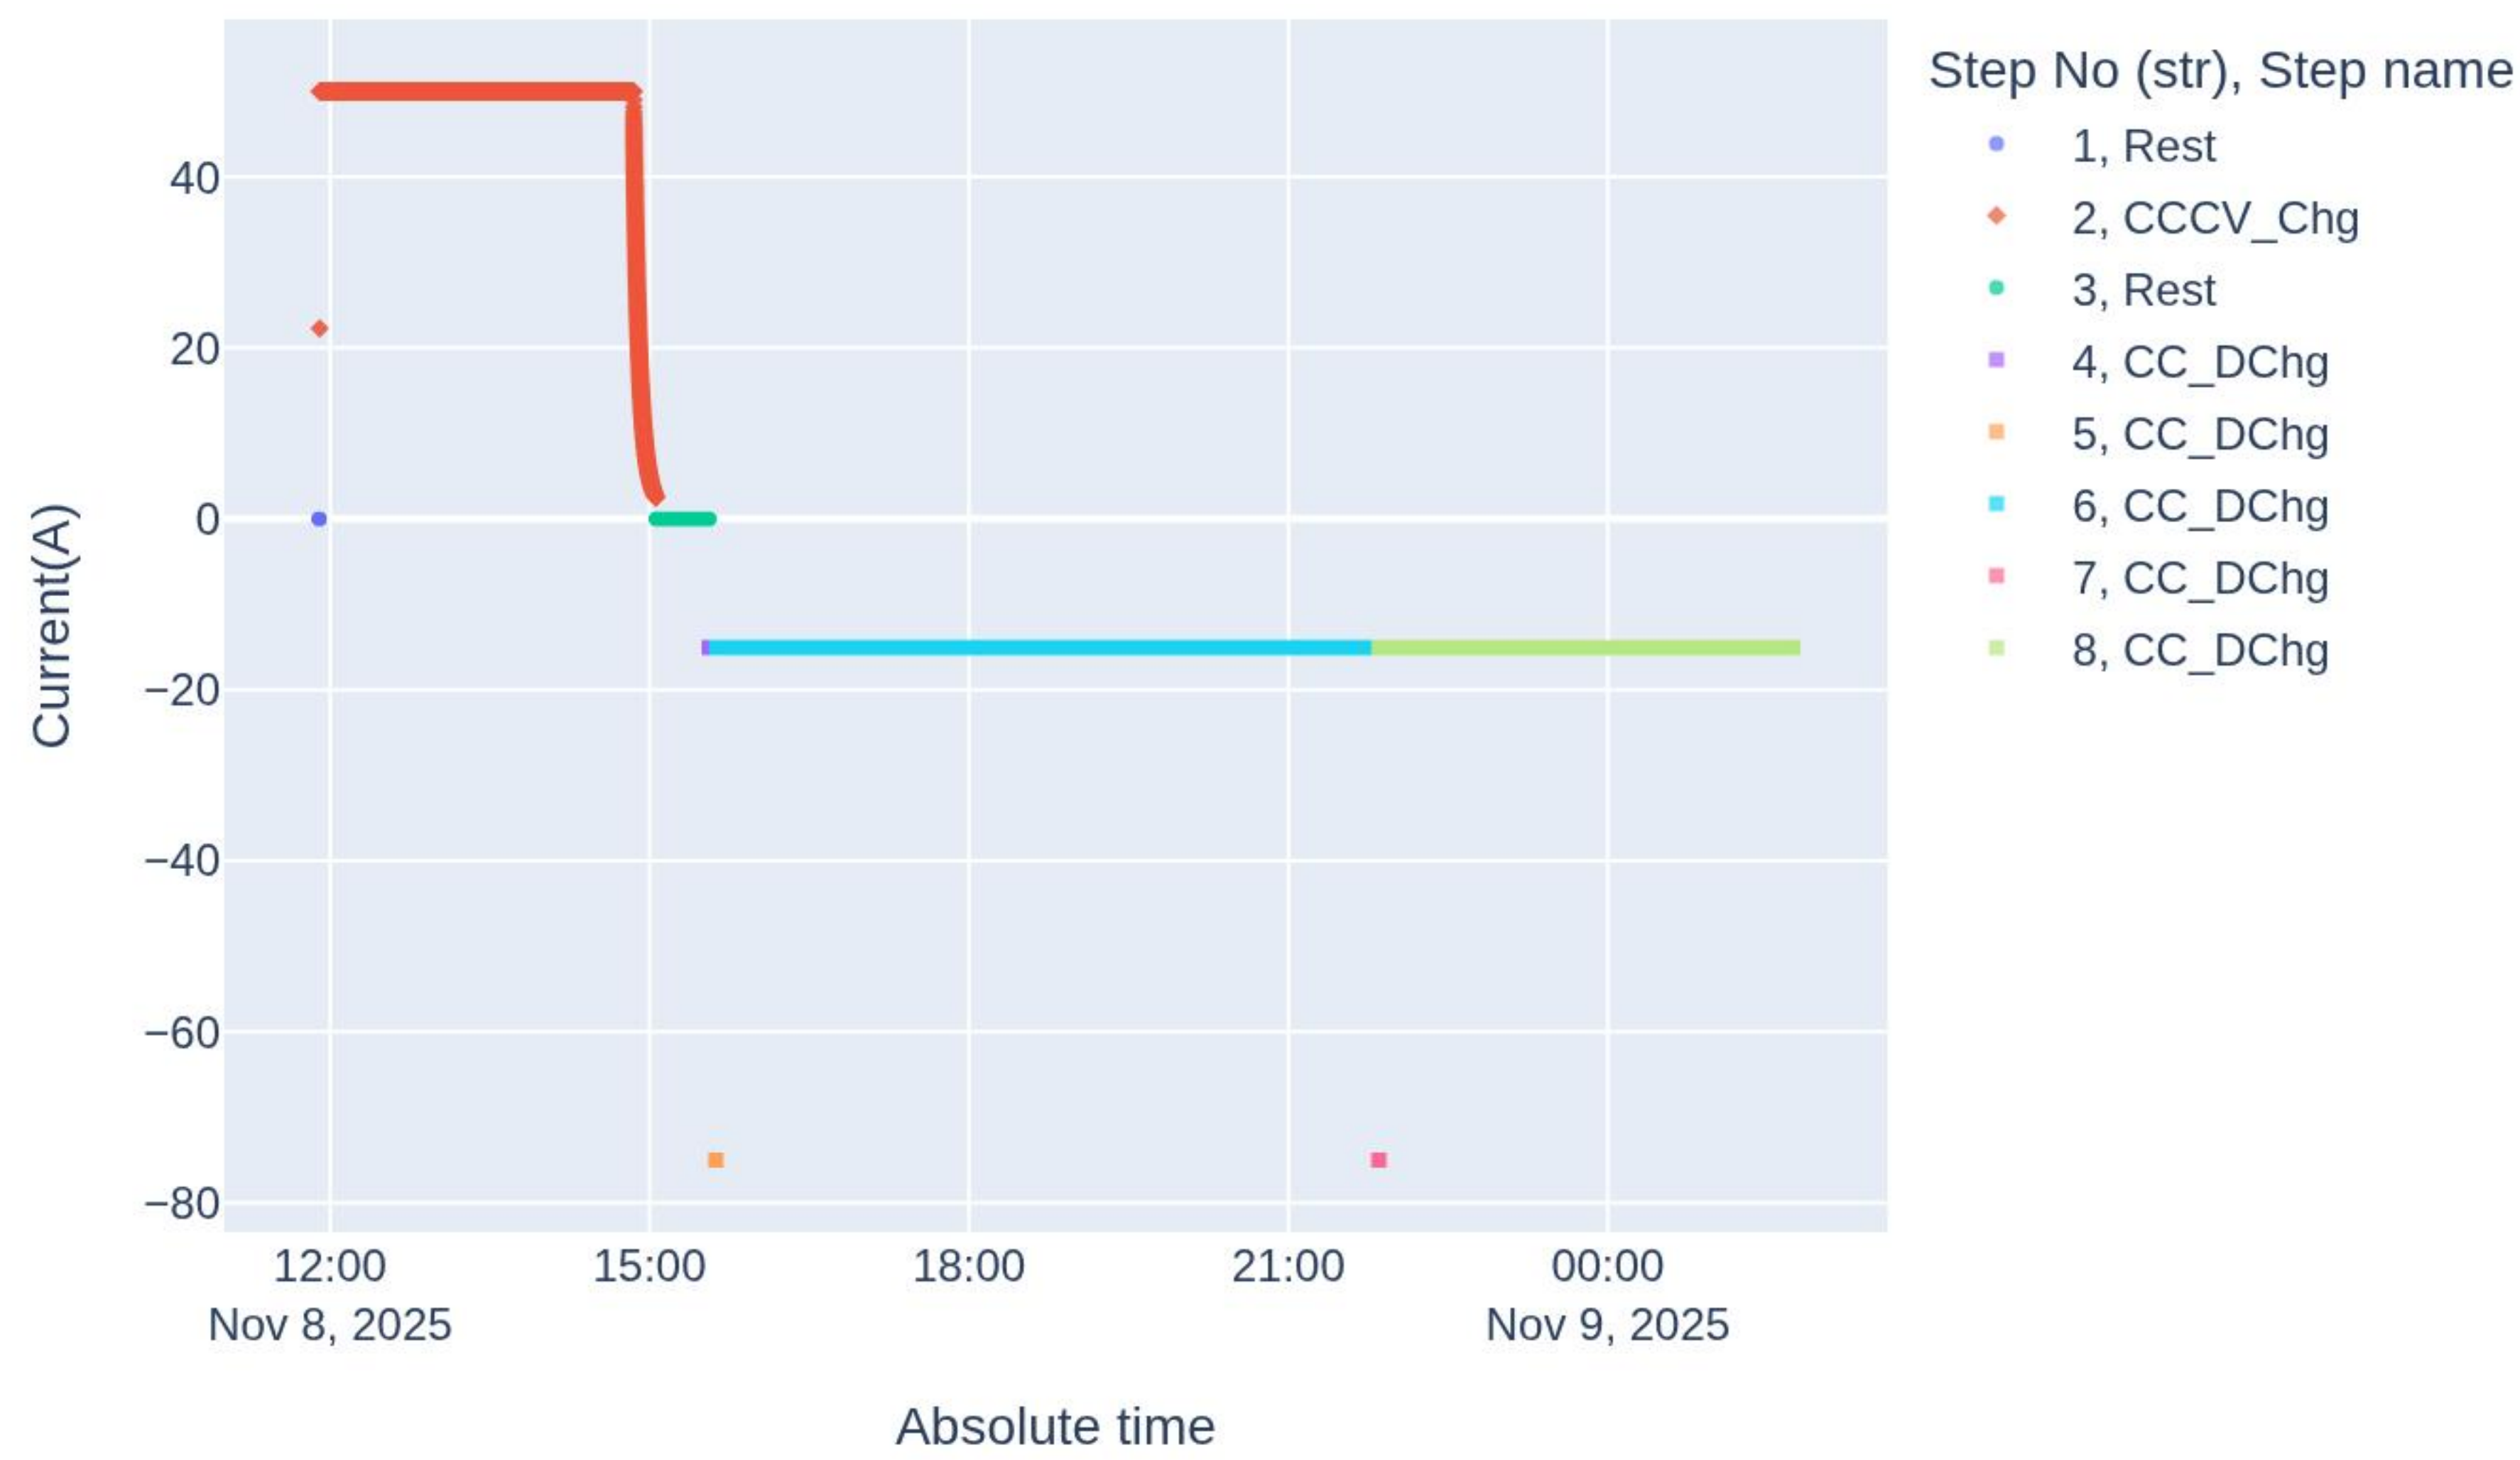


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0304_0_100.csv

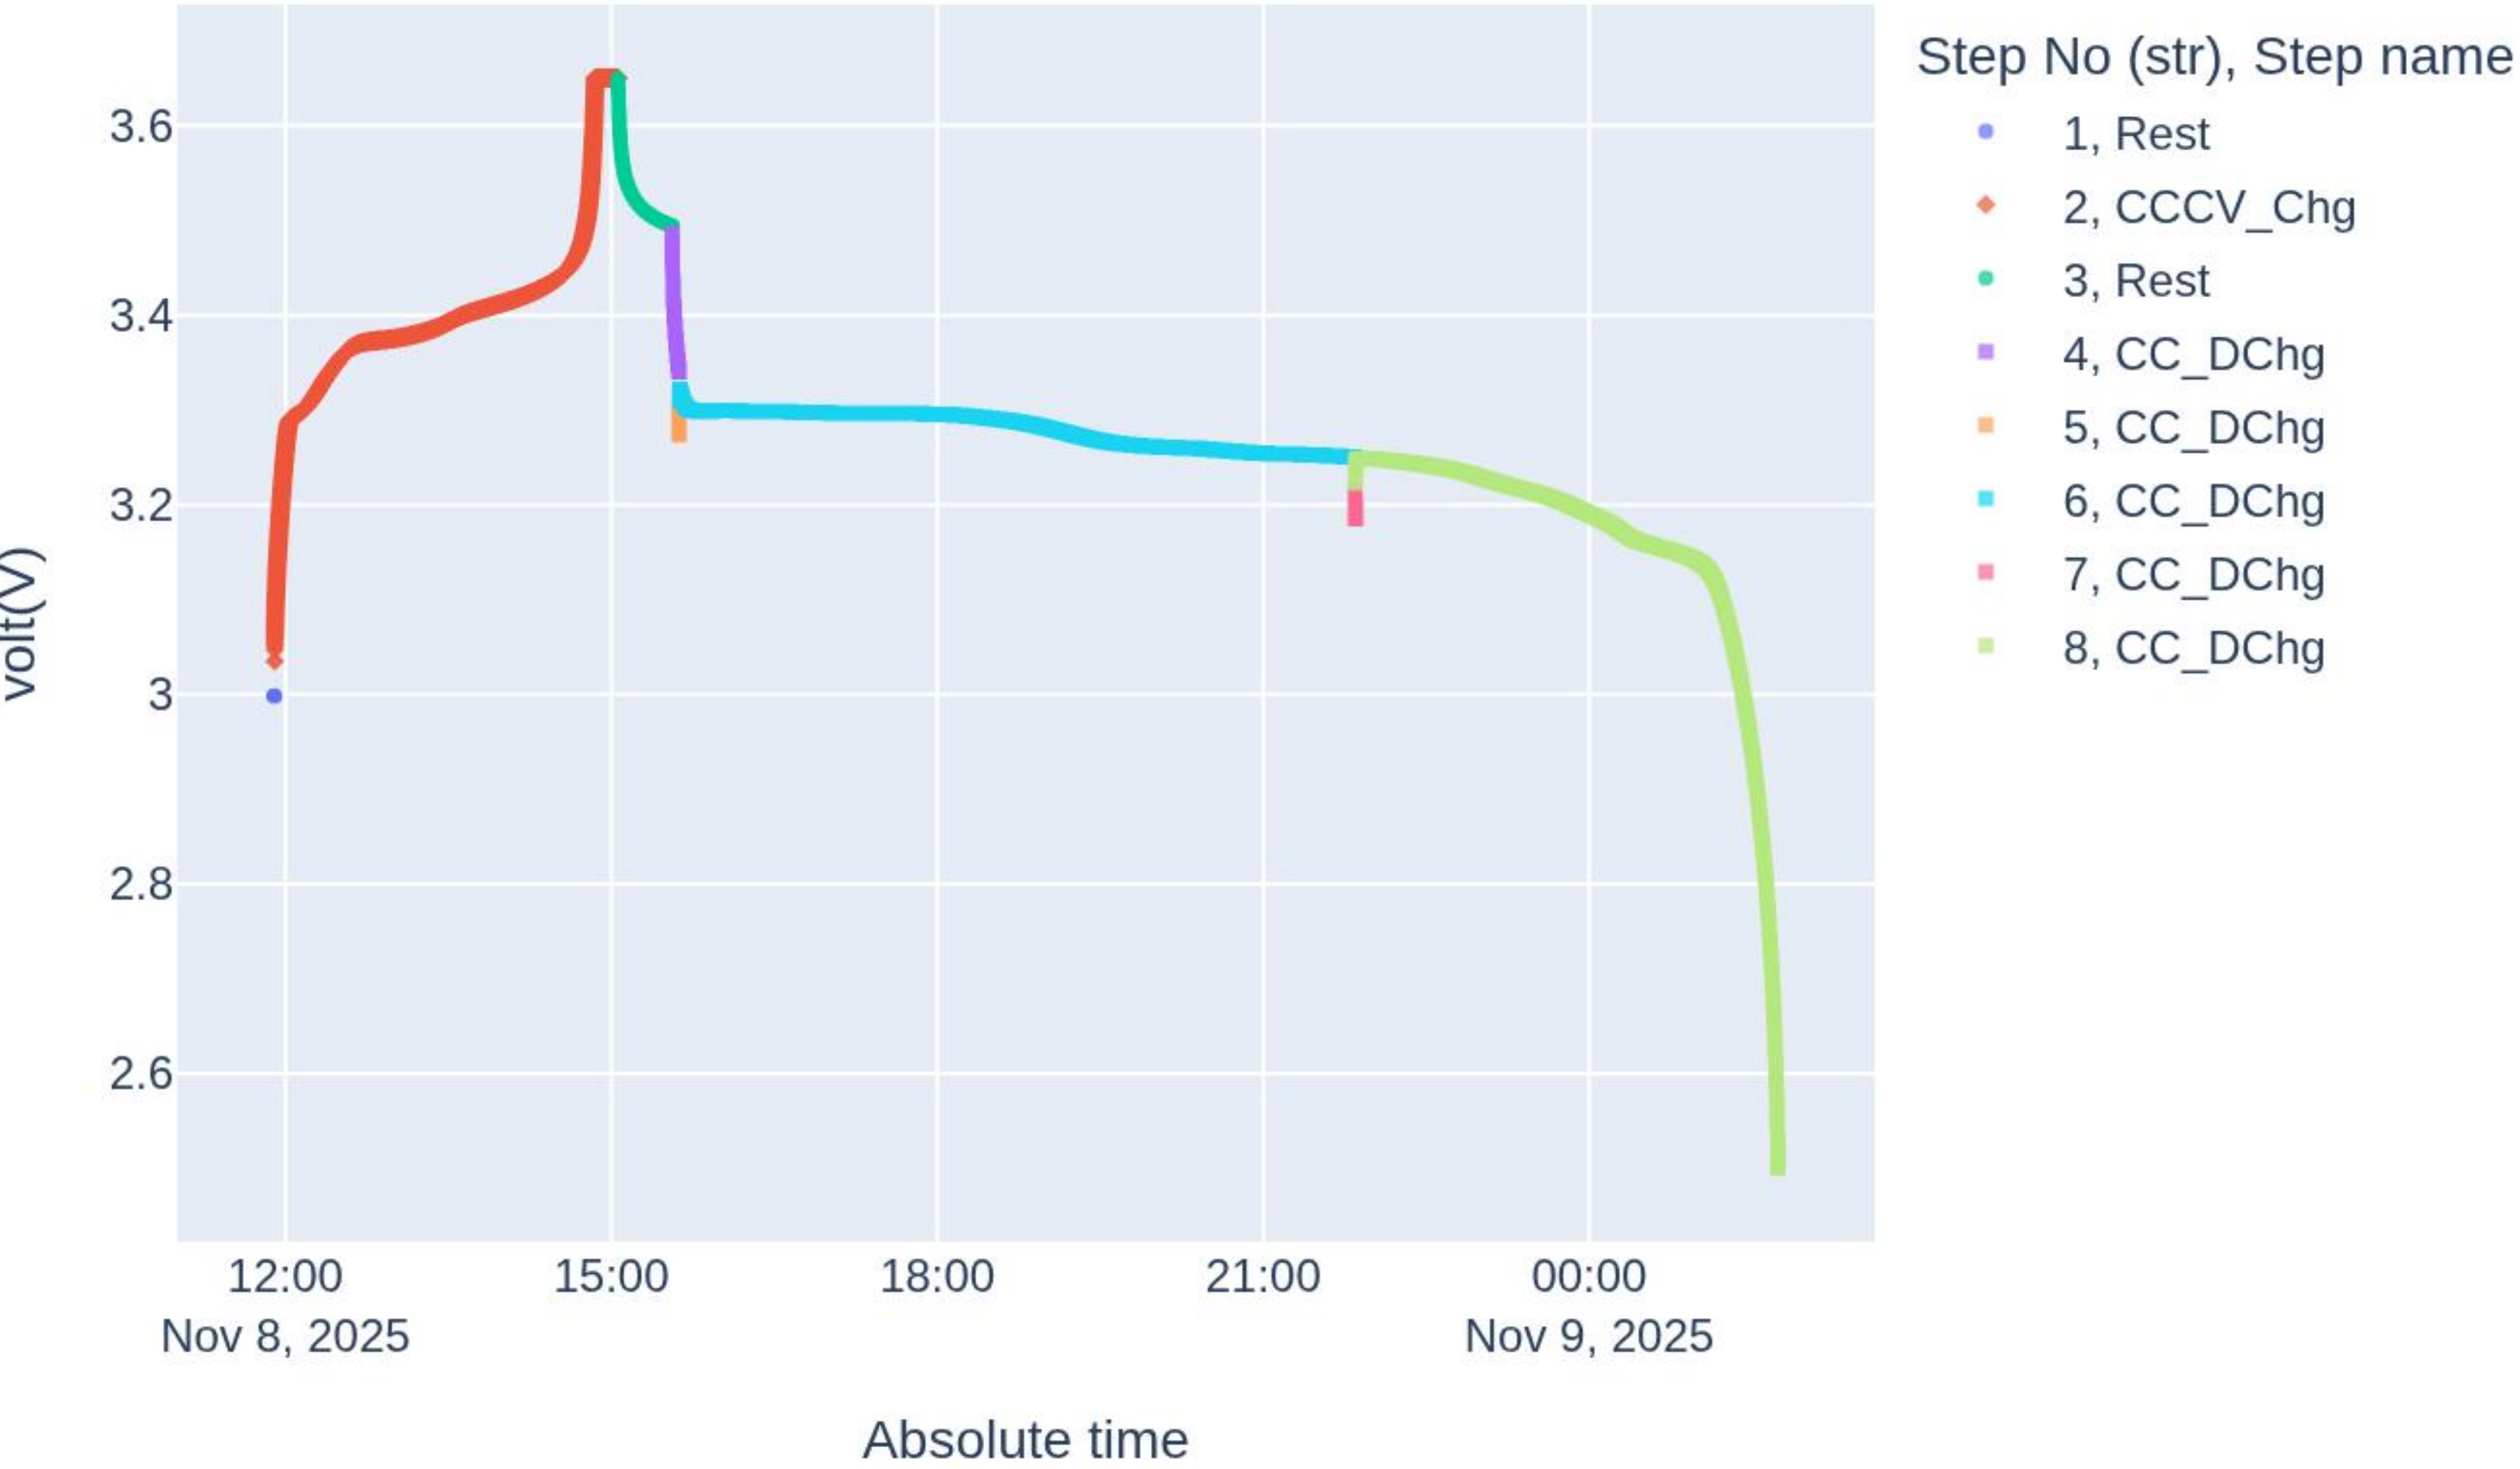


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0305_0_100.csv

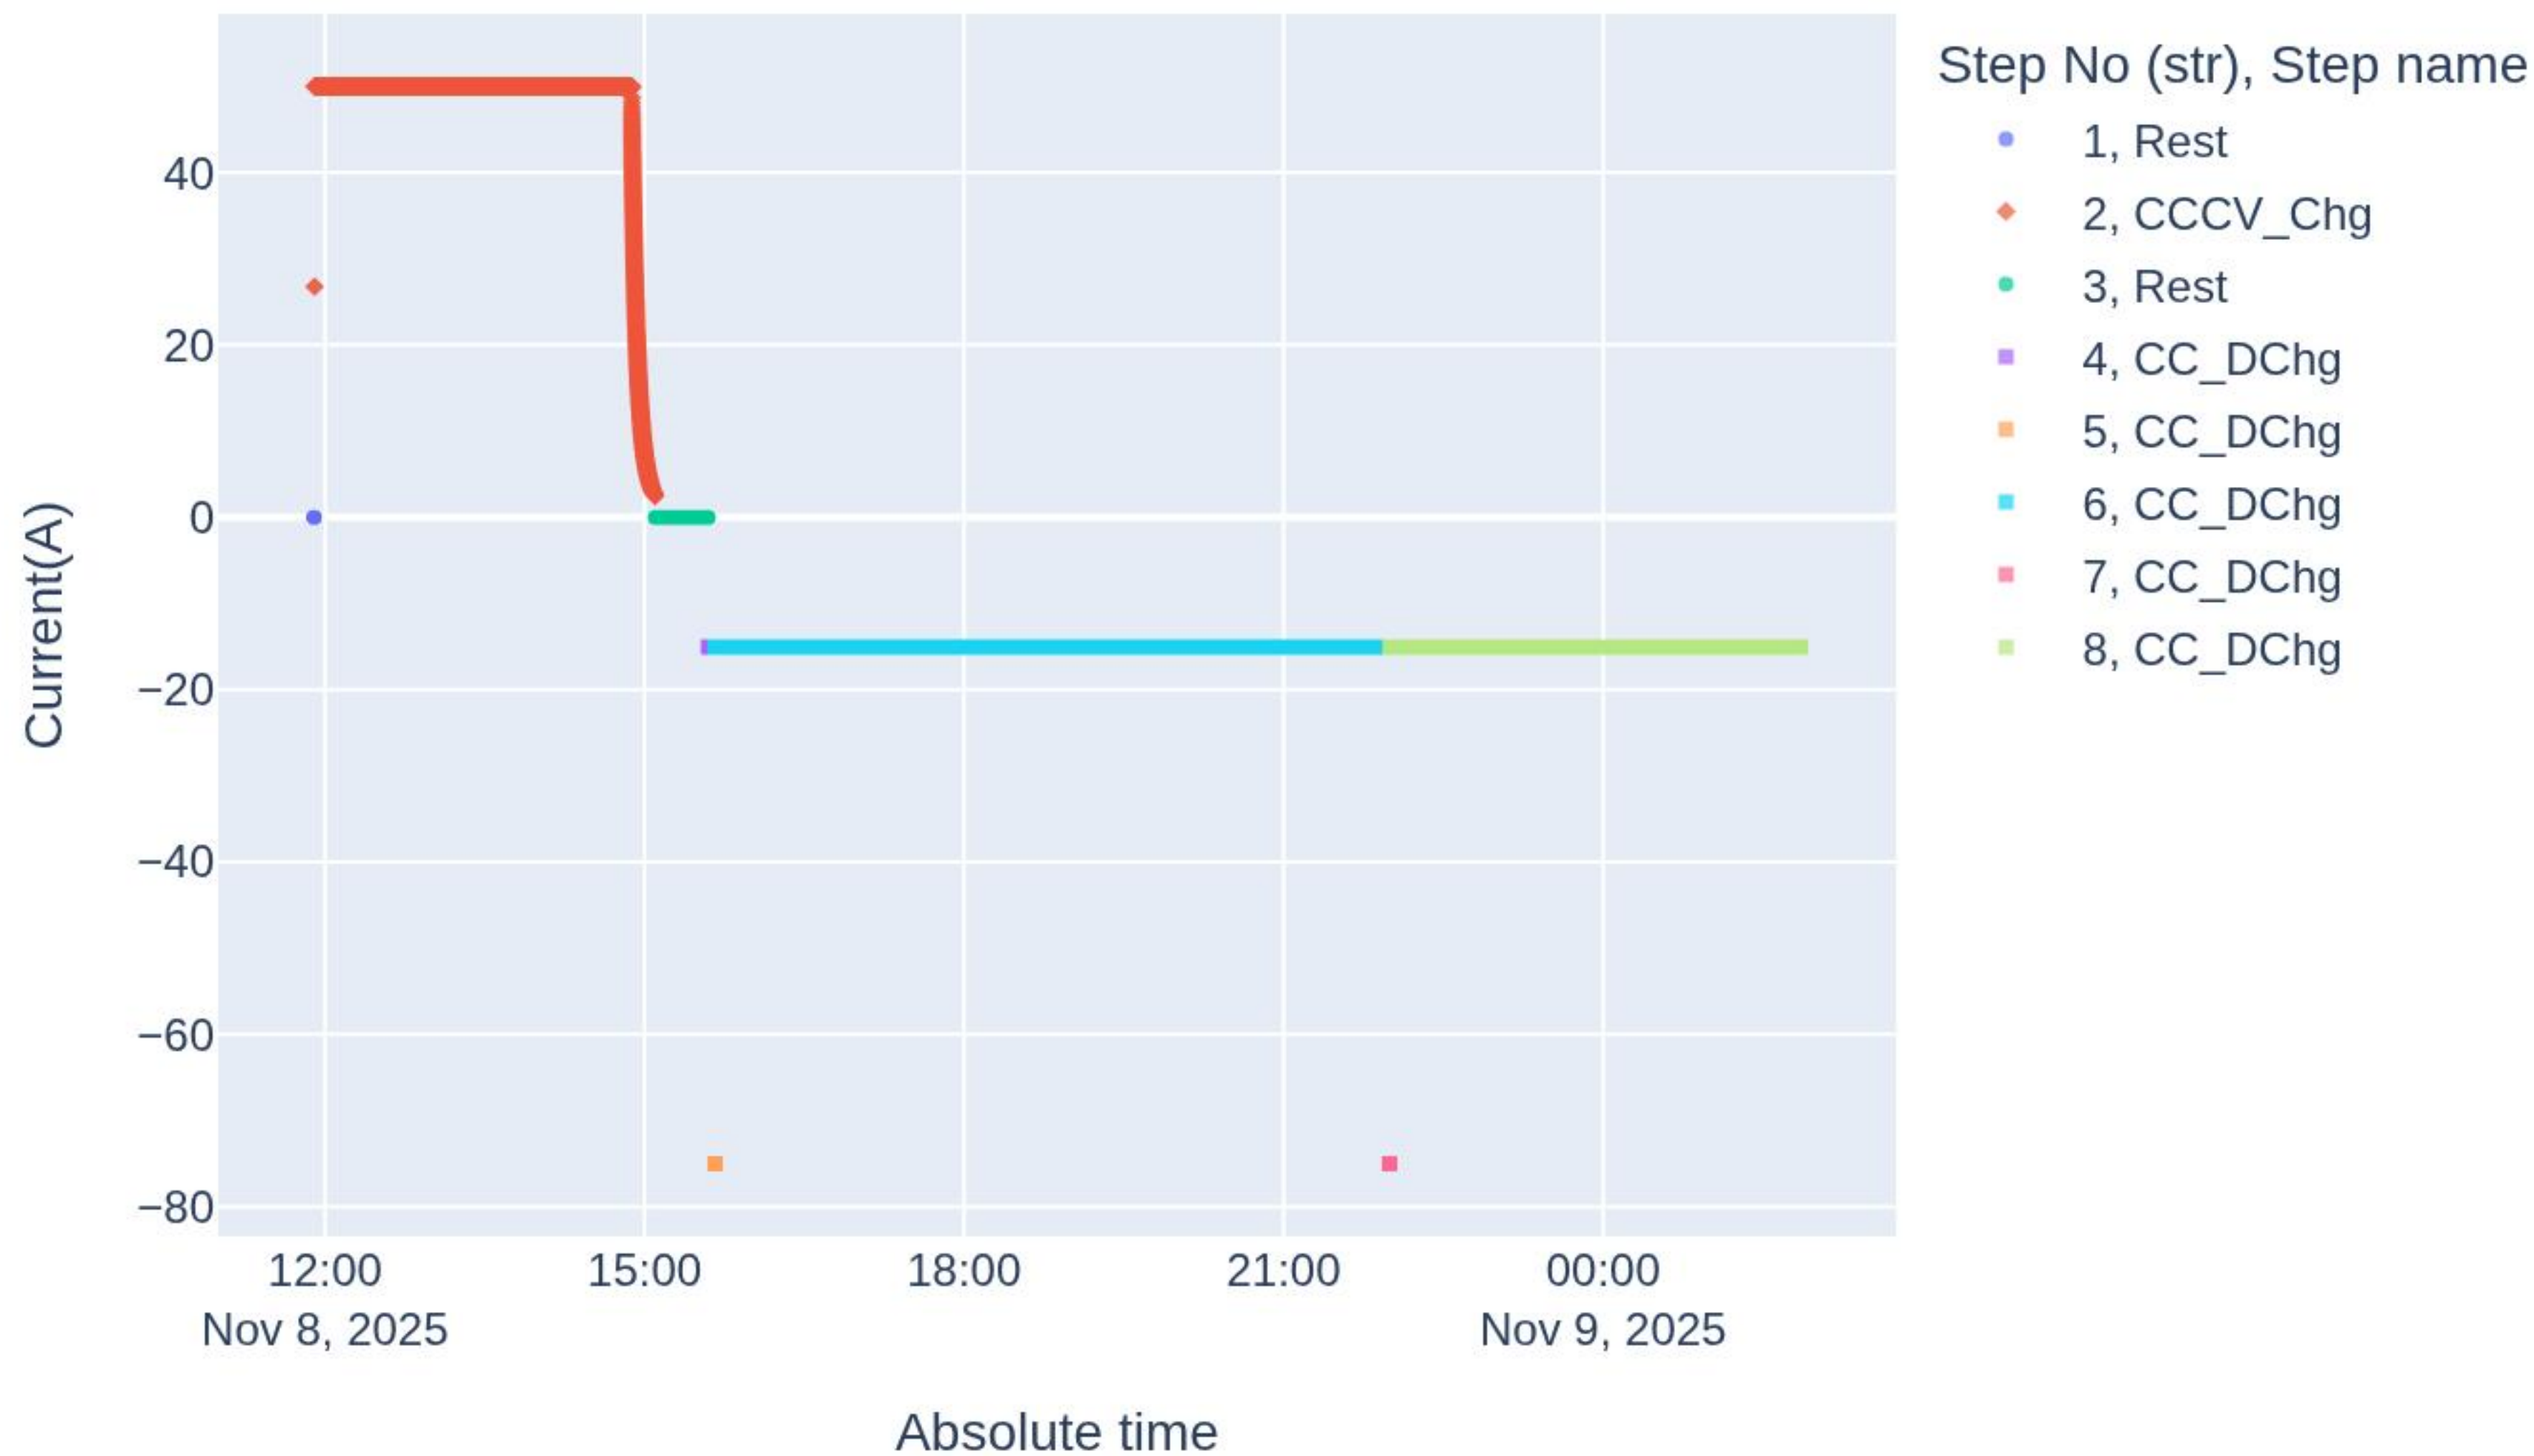


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0305_0_100.csv

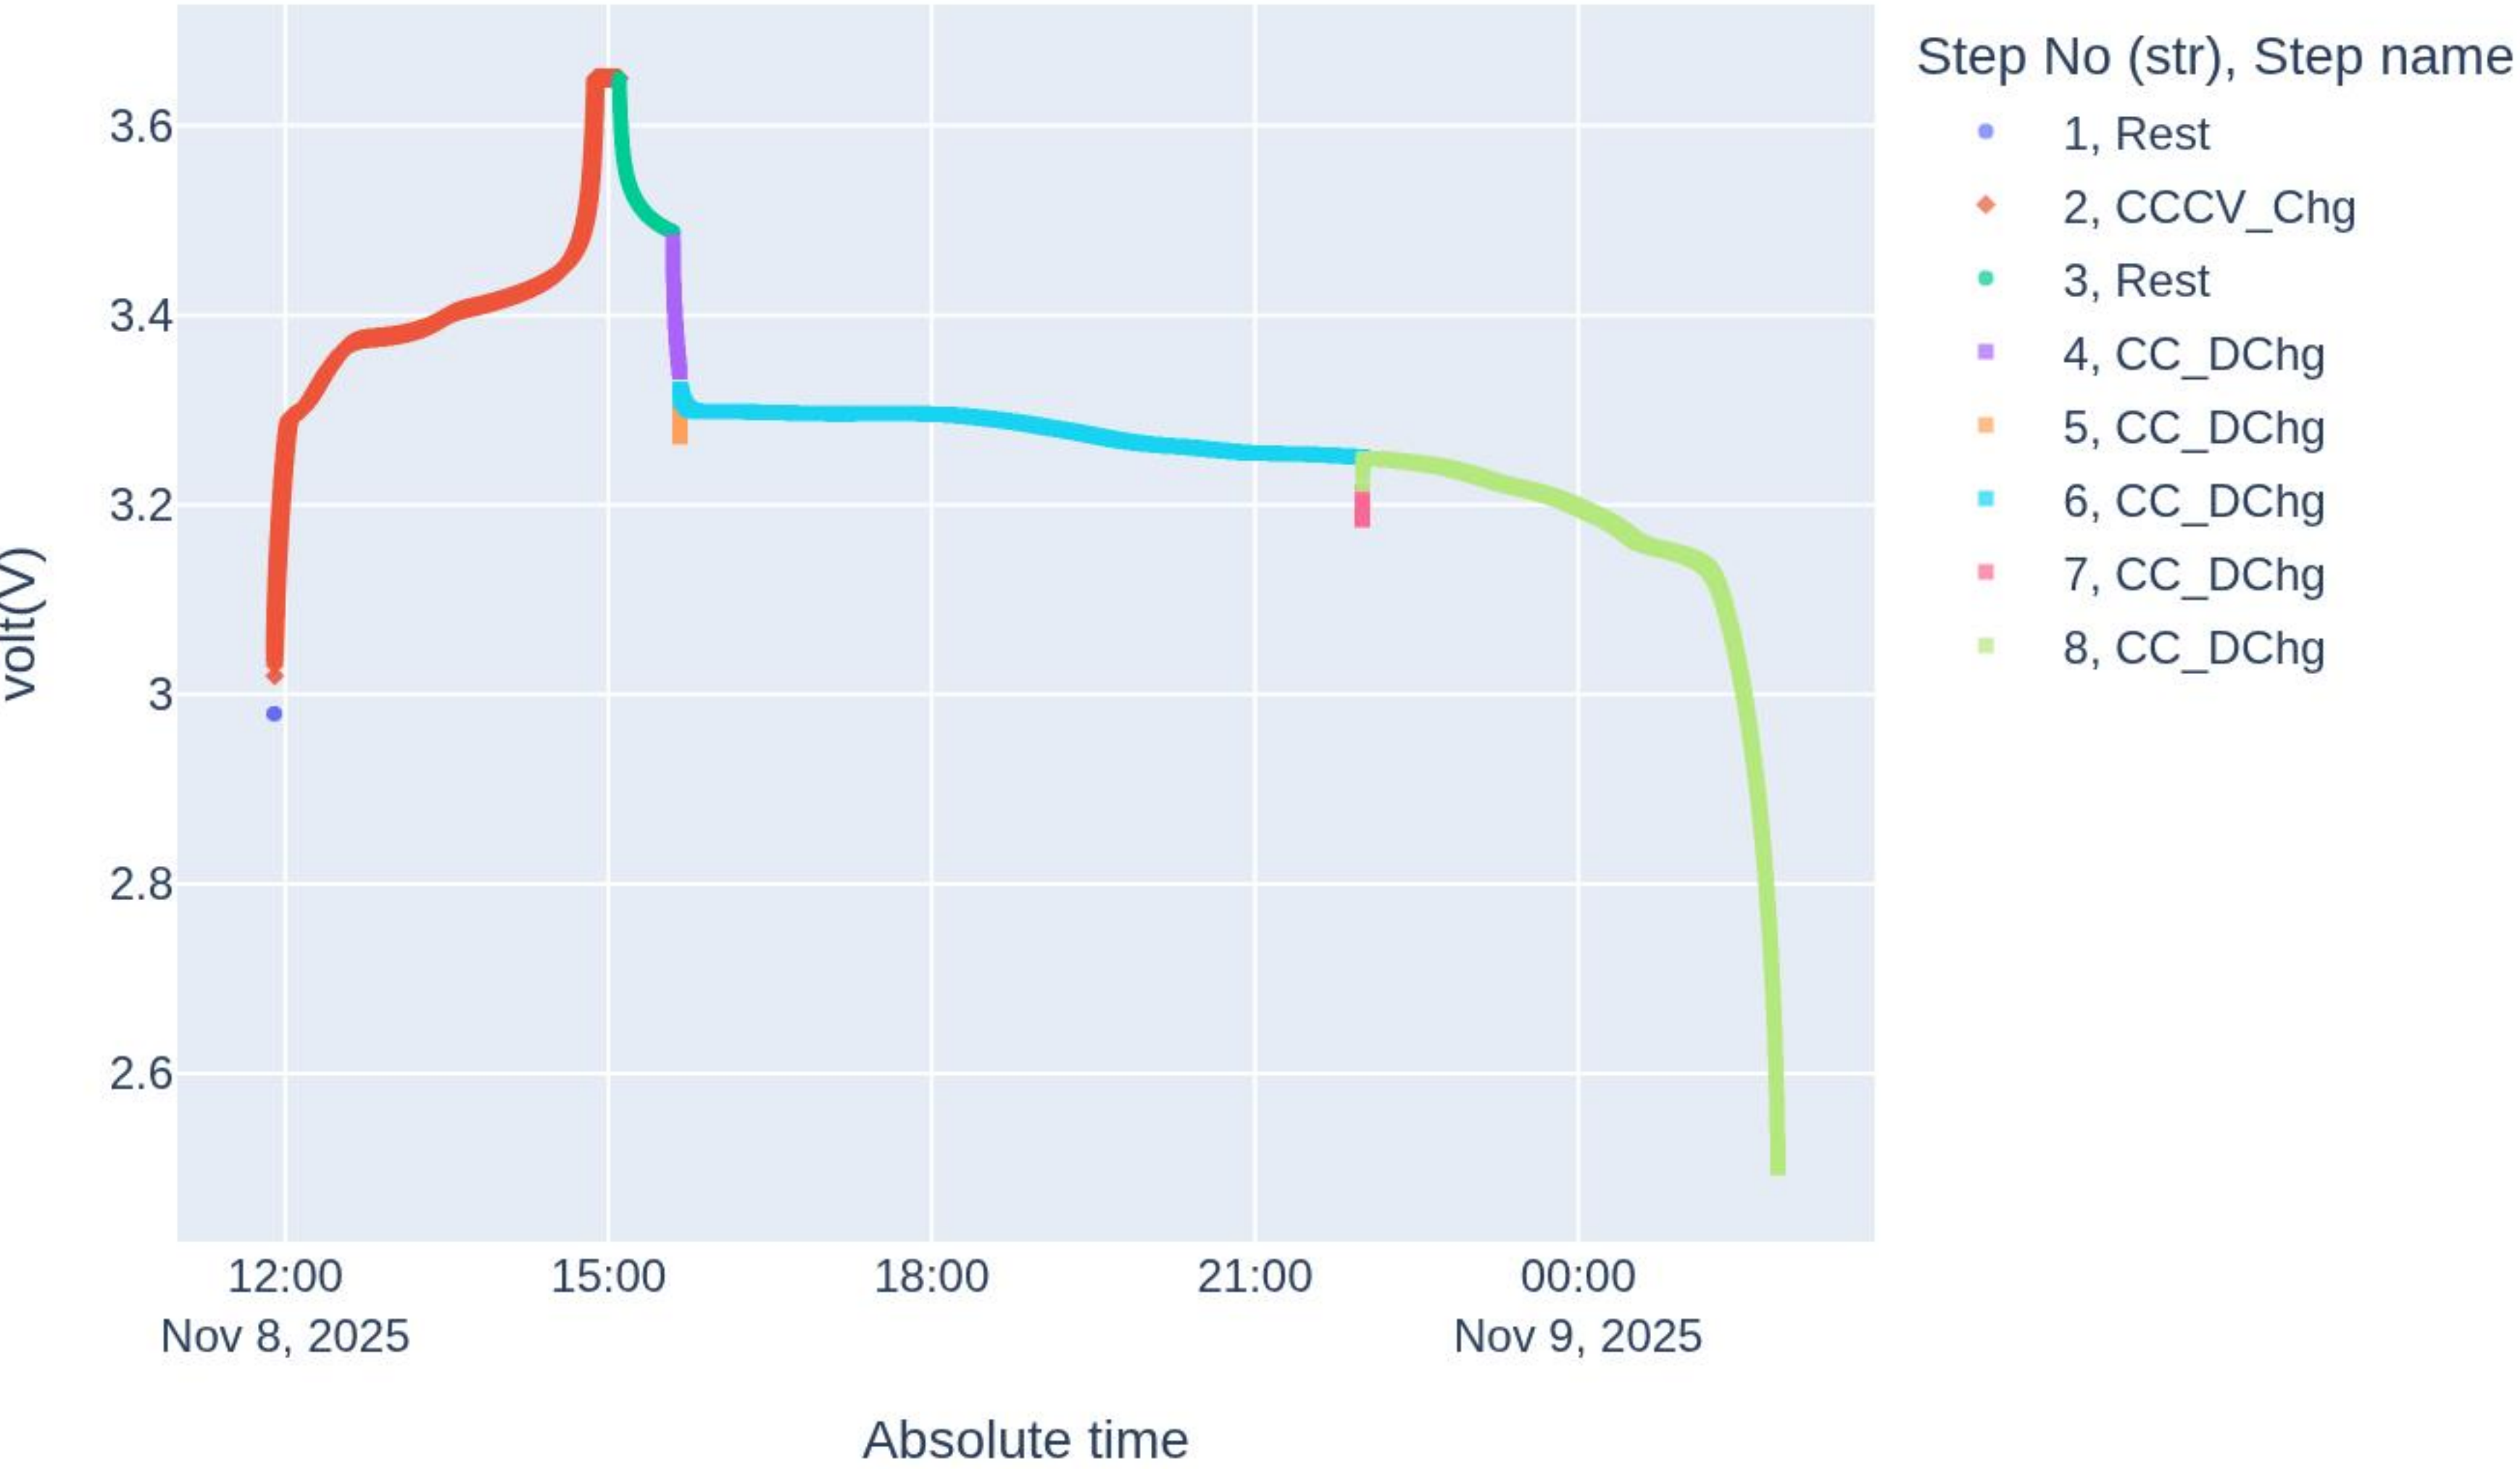


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0306_0_100.csv

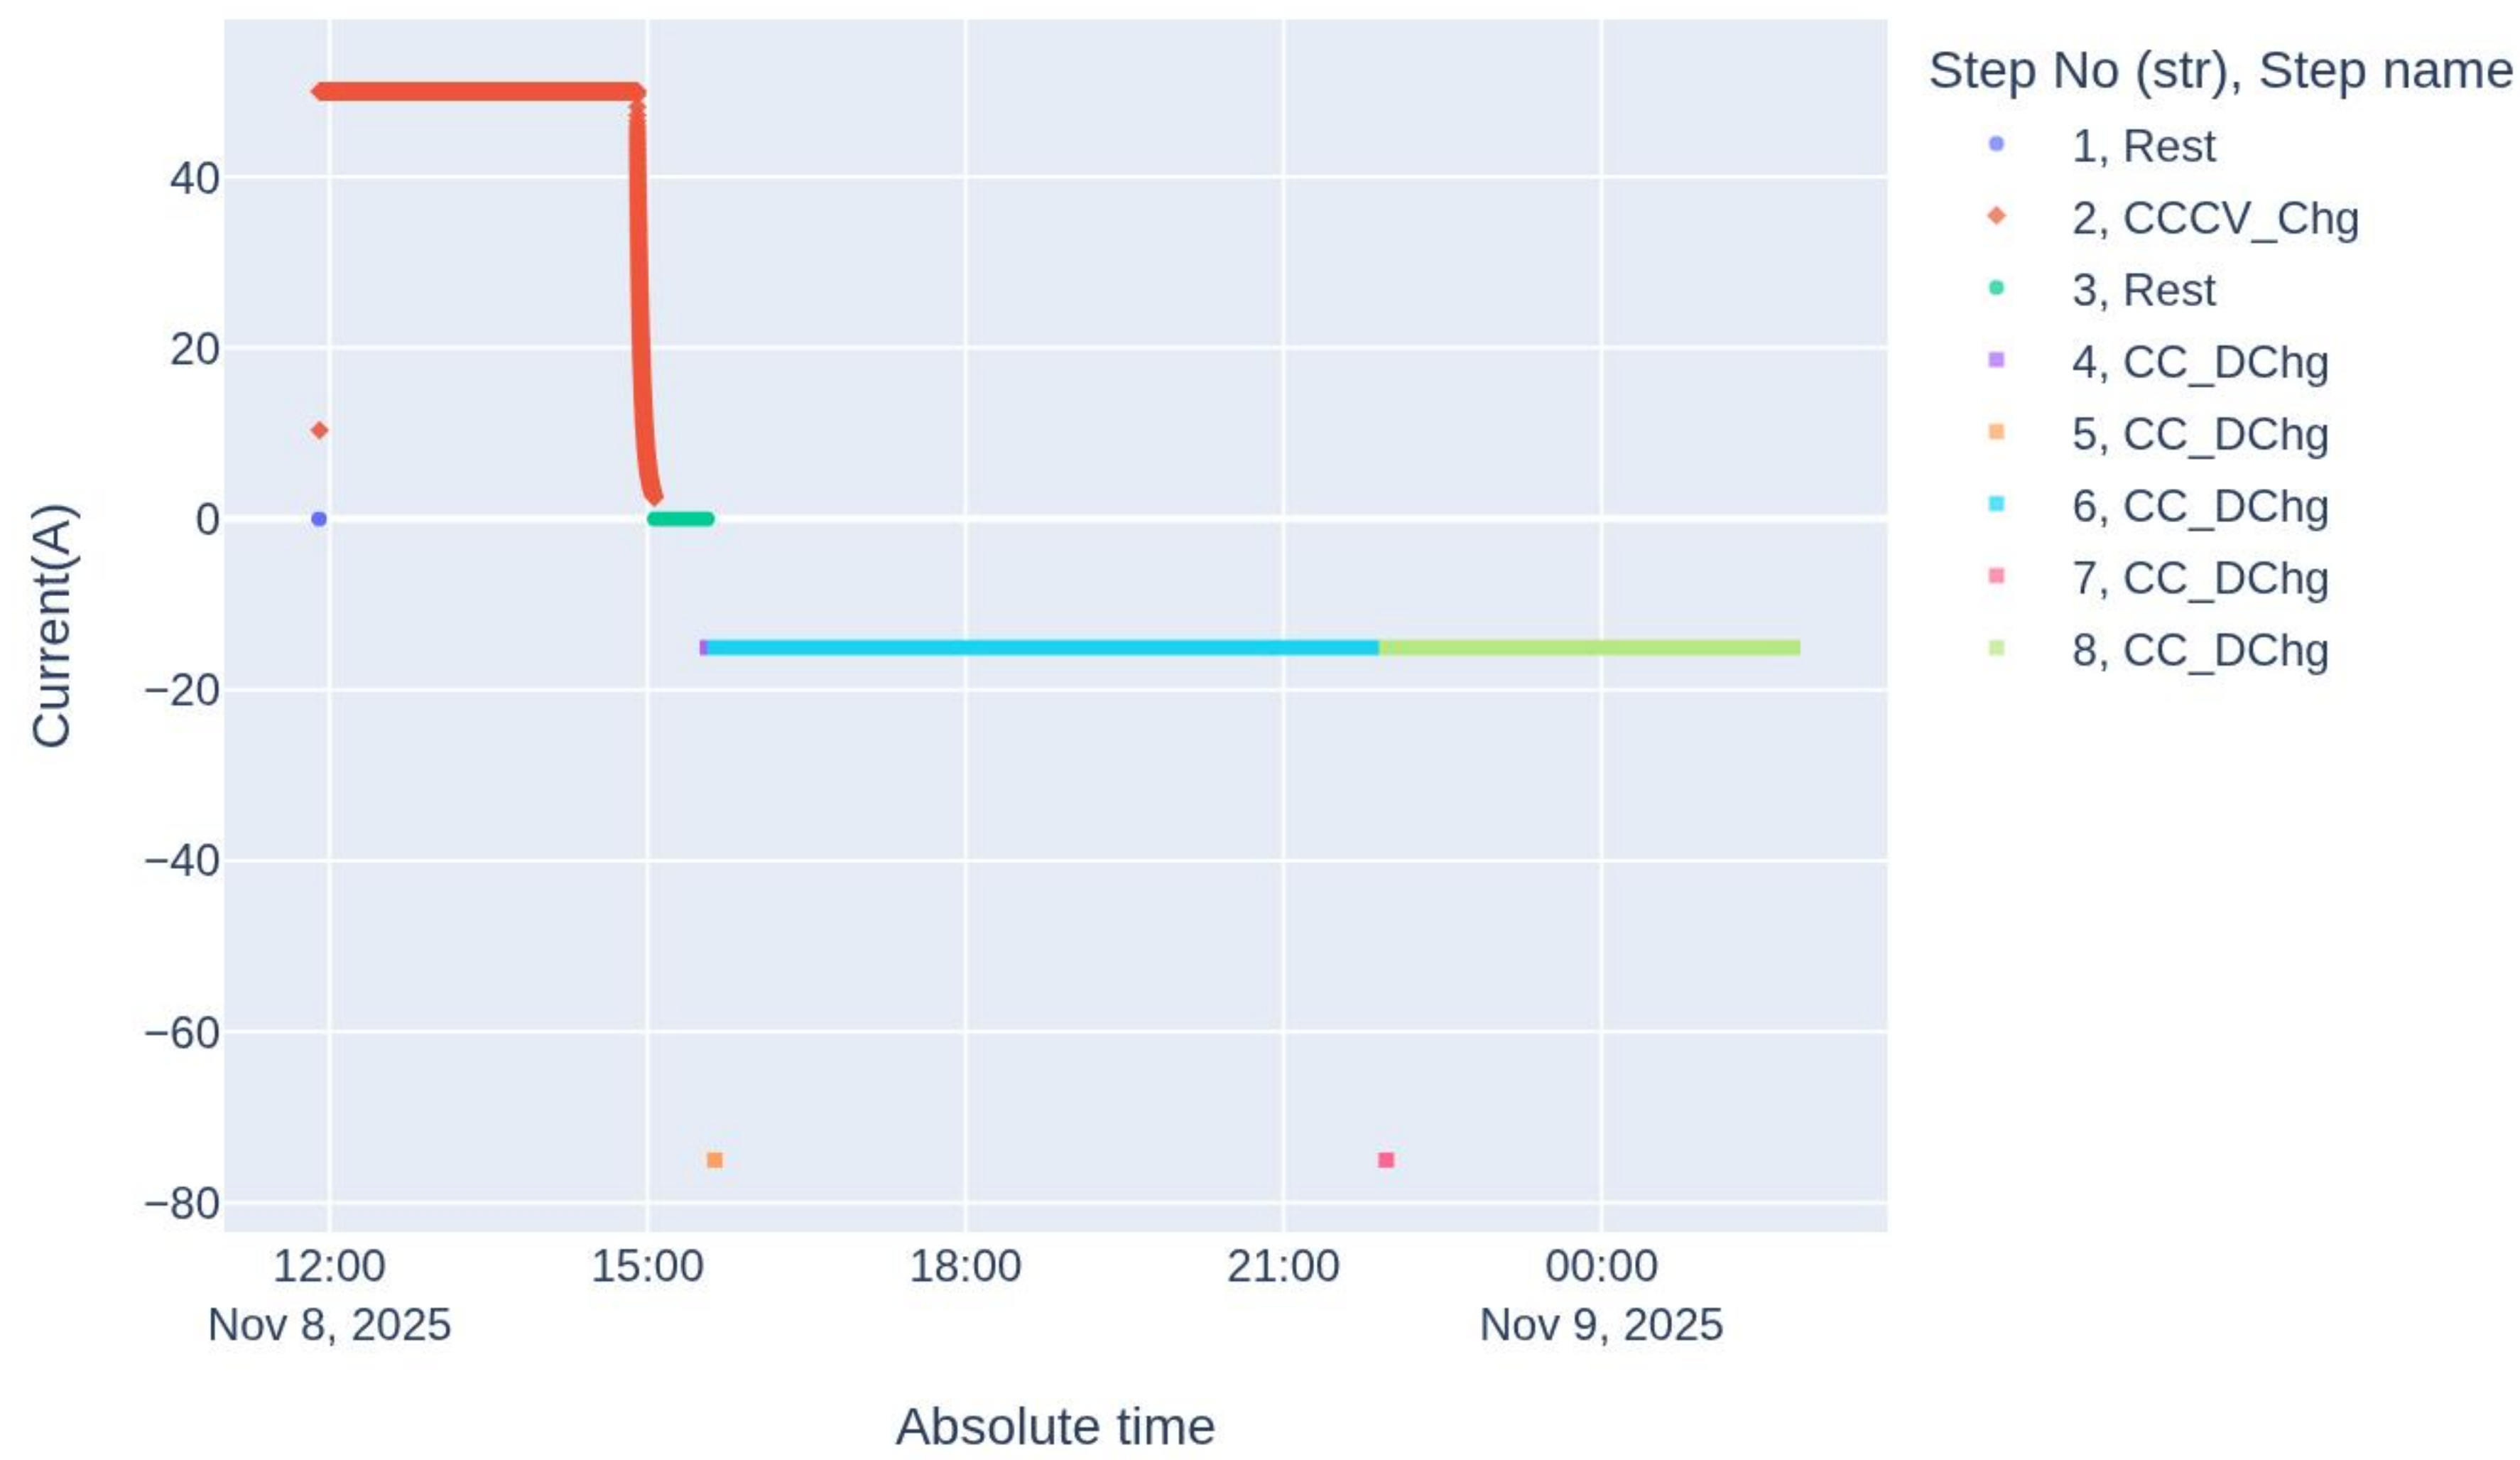


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0306_0_100.csv

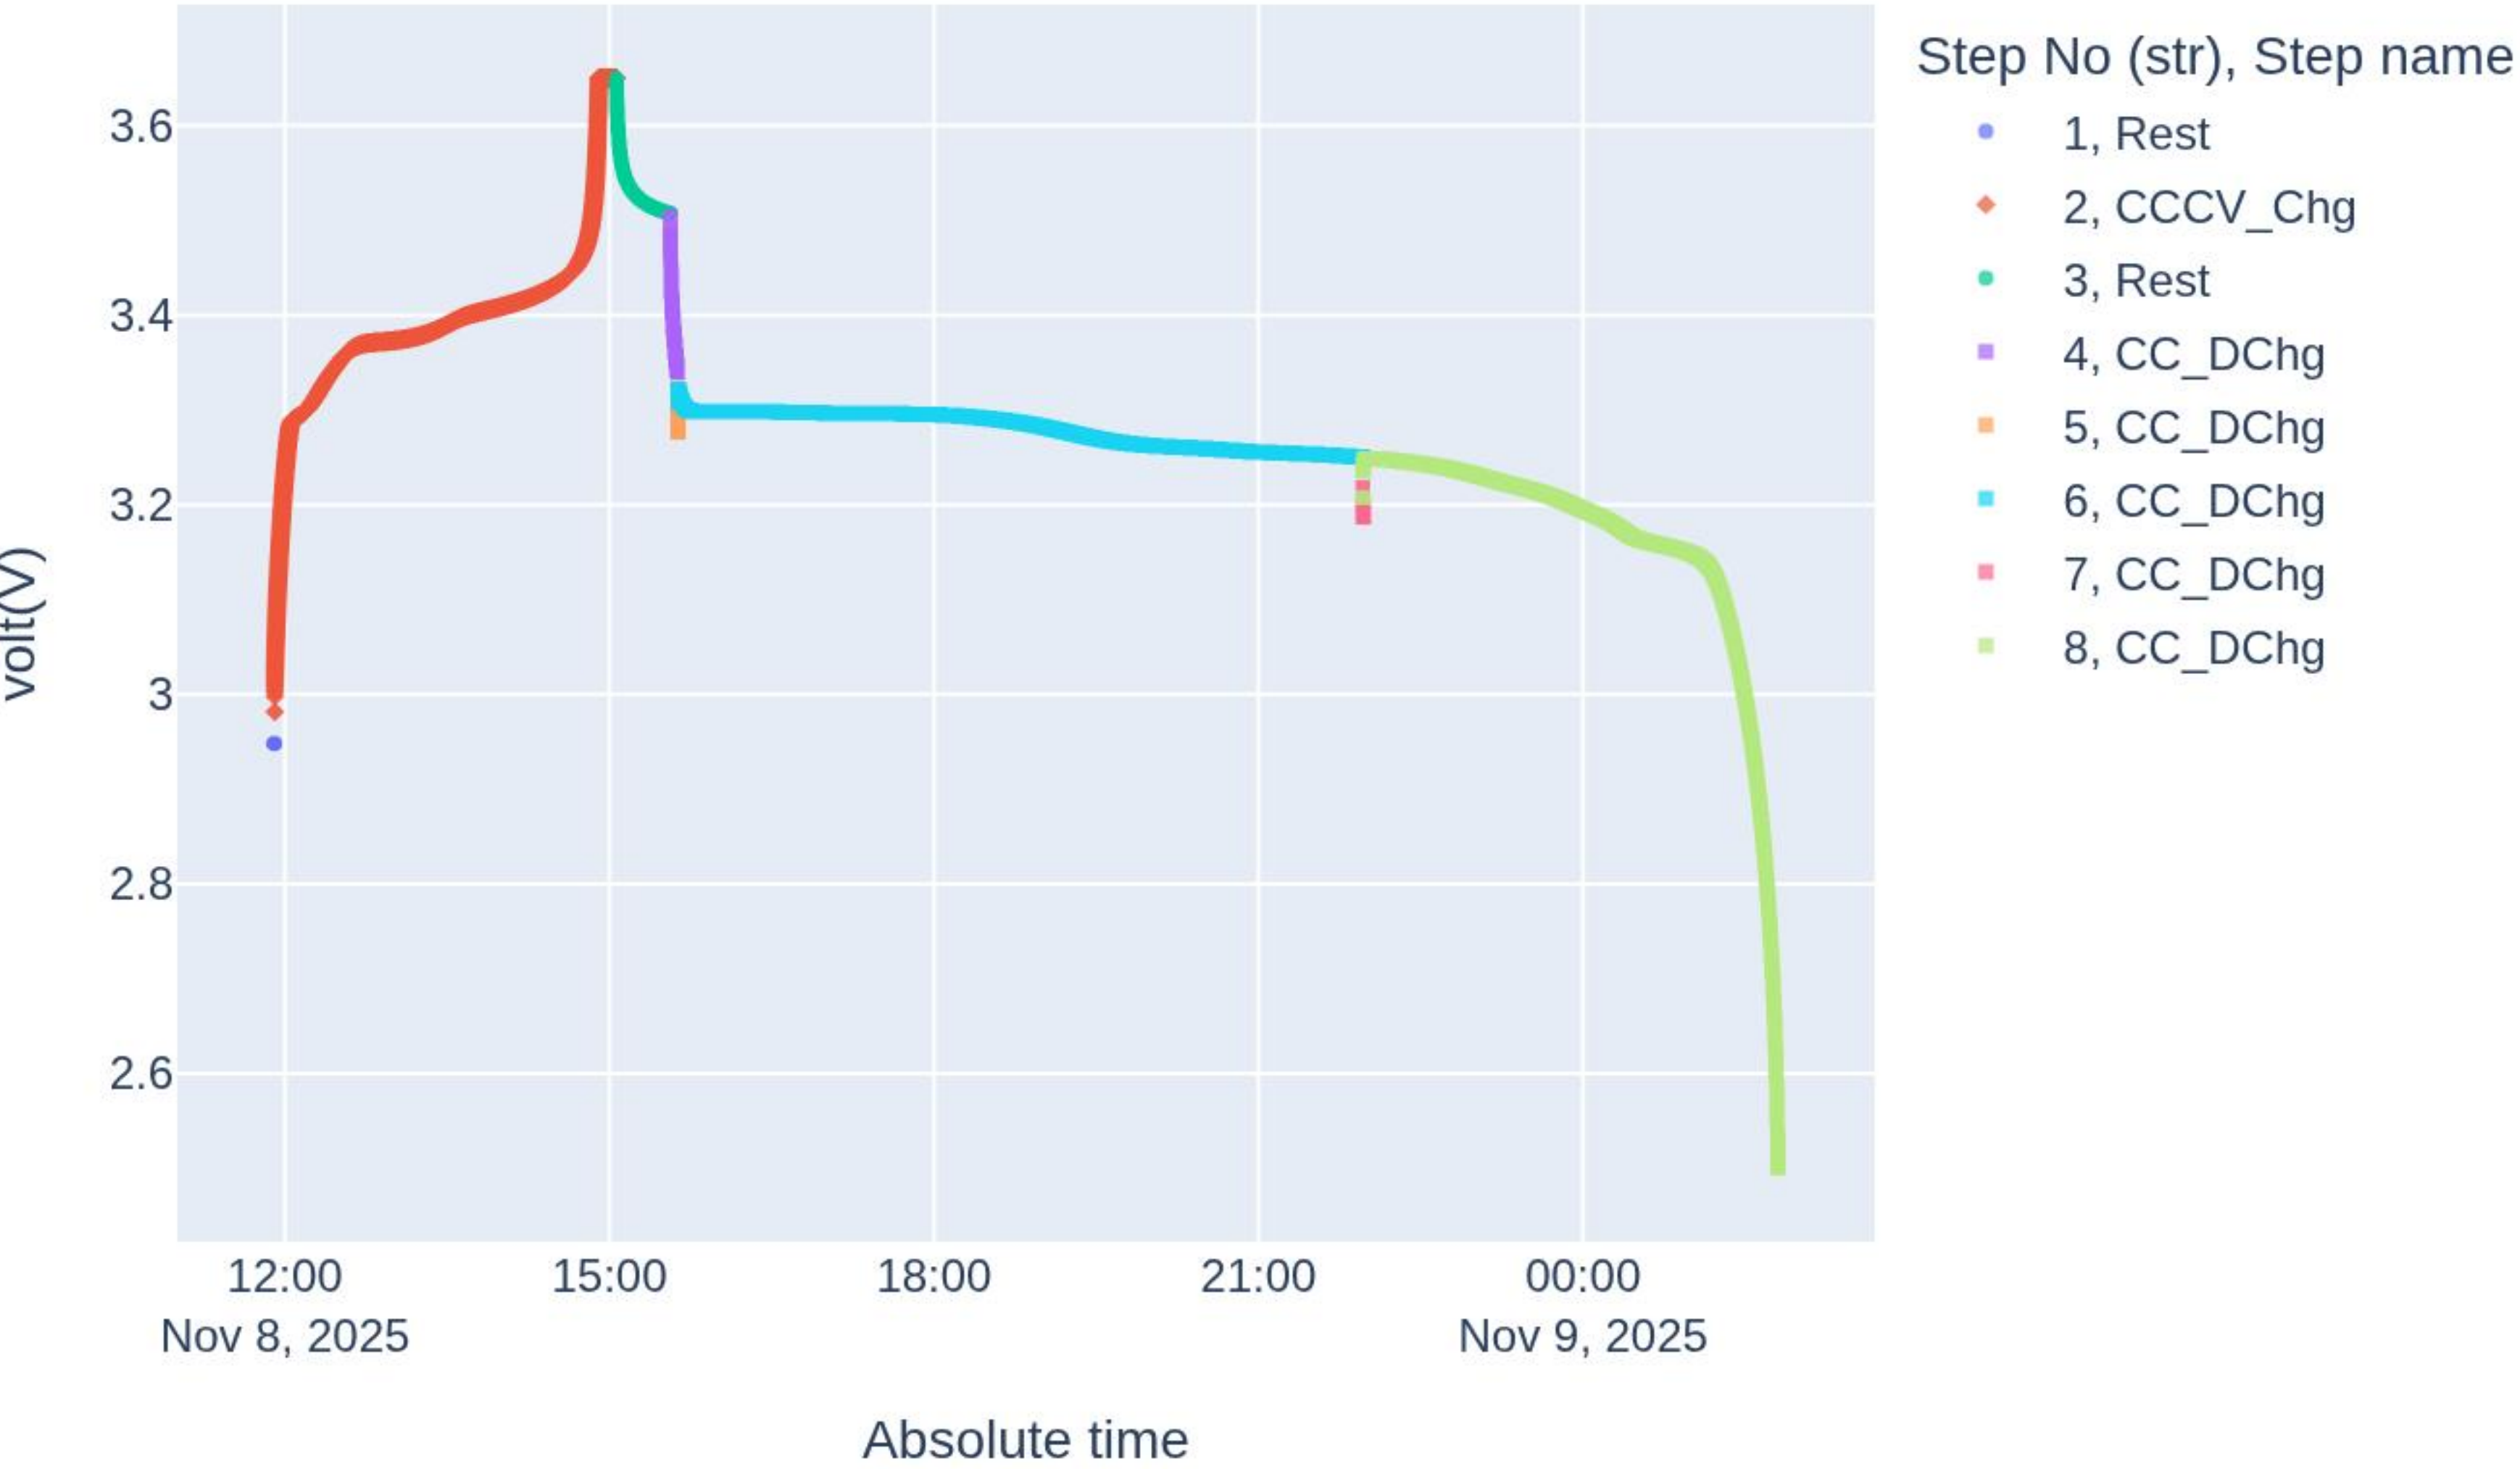


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0307_0_100.csv

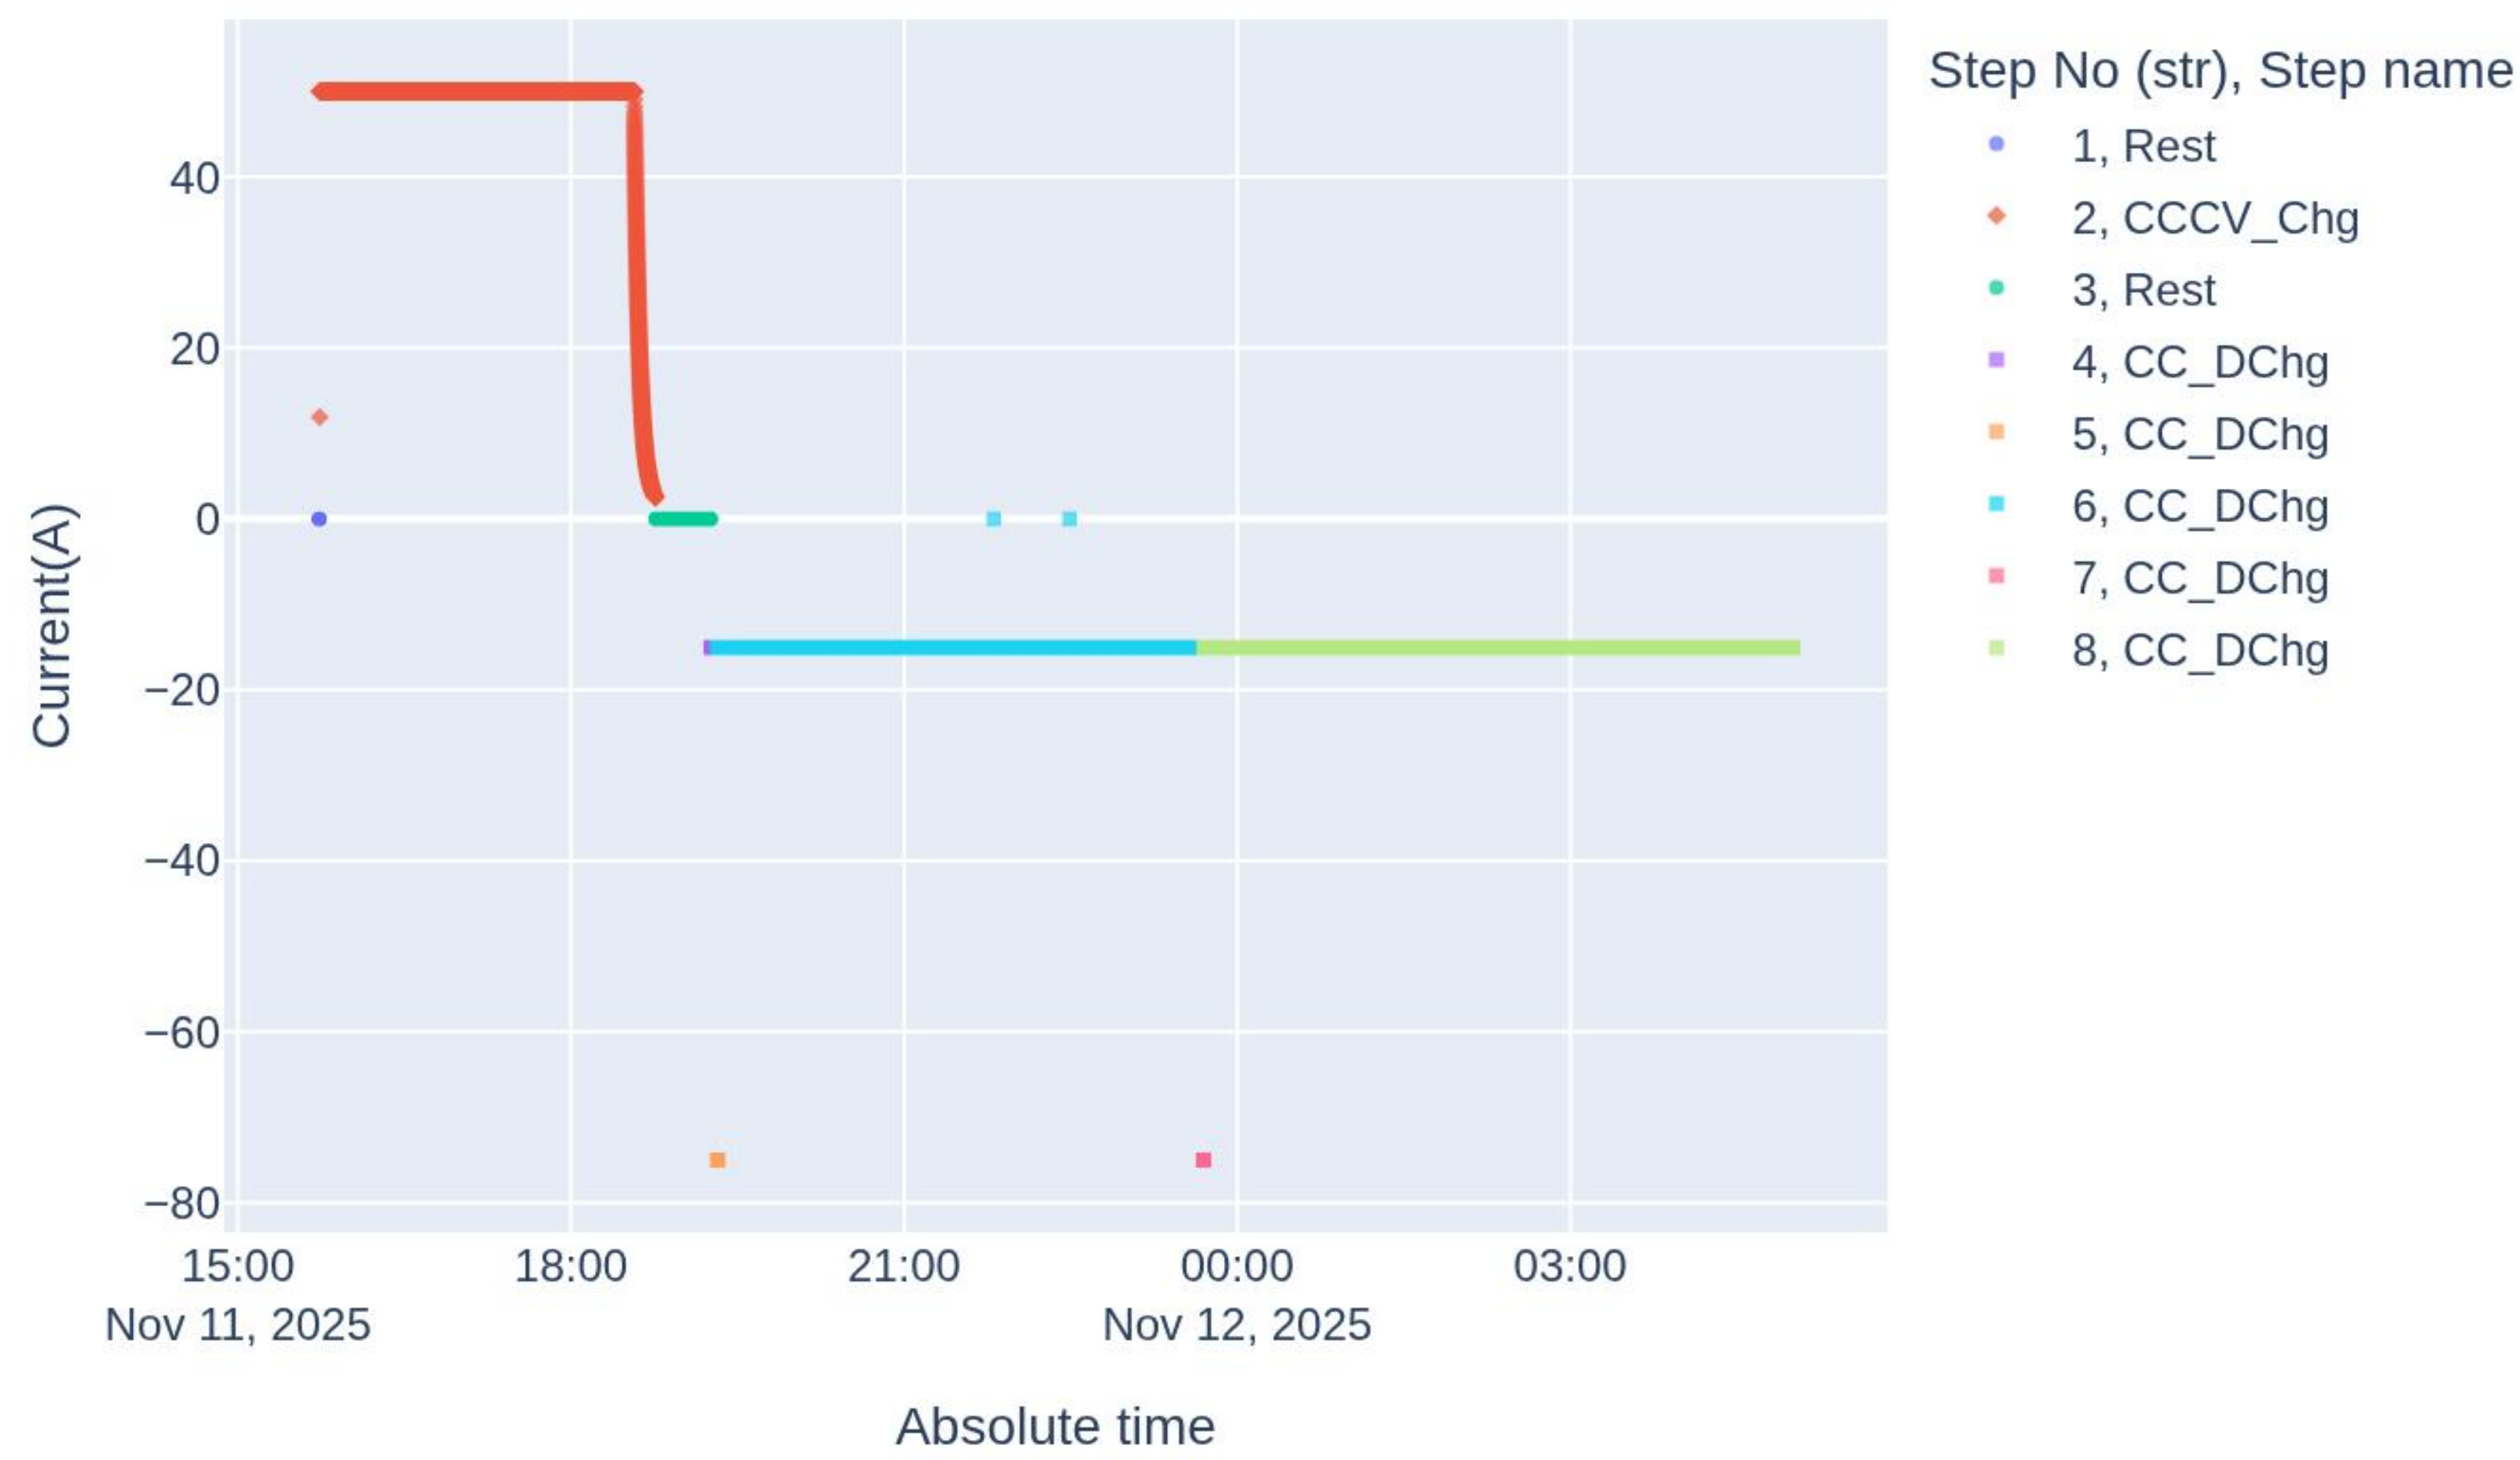


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0307_0_100.csv

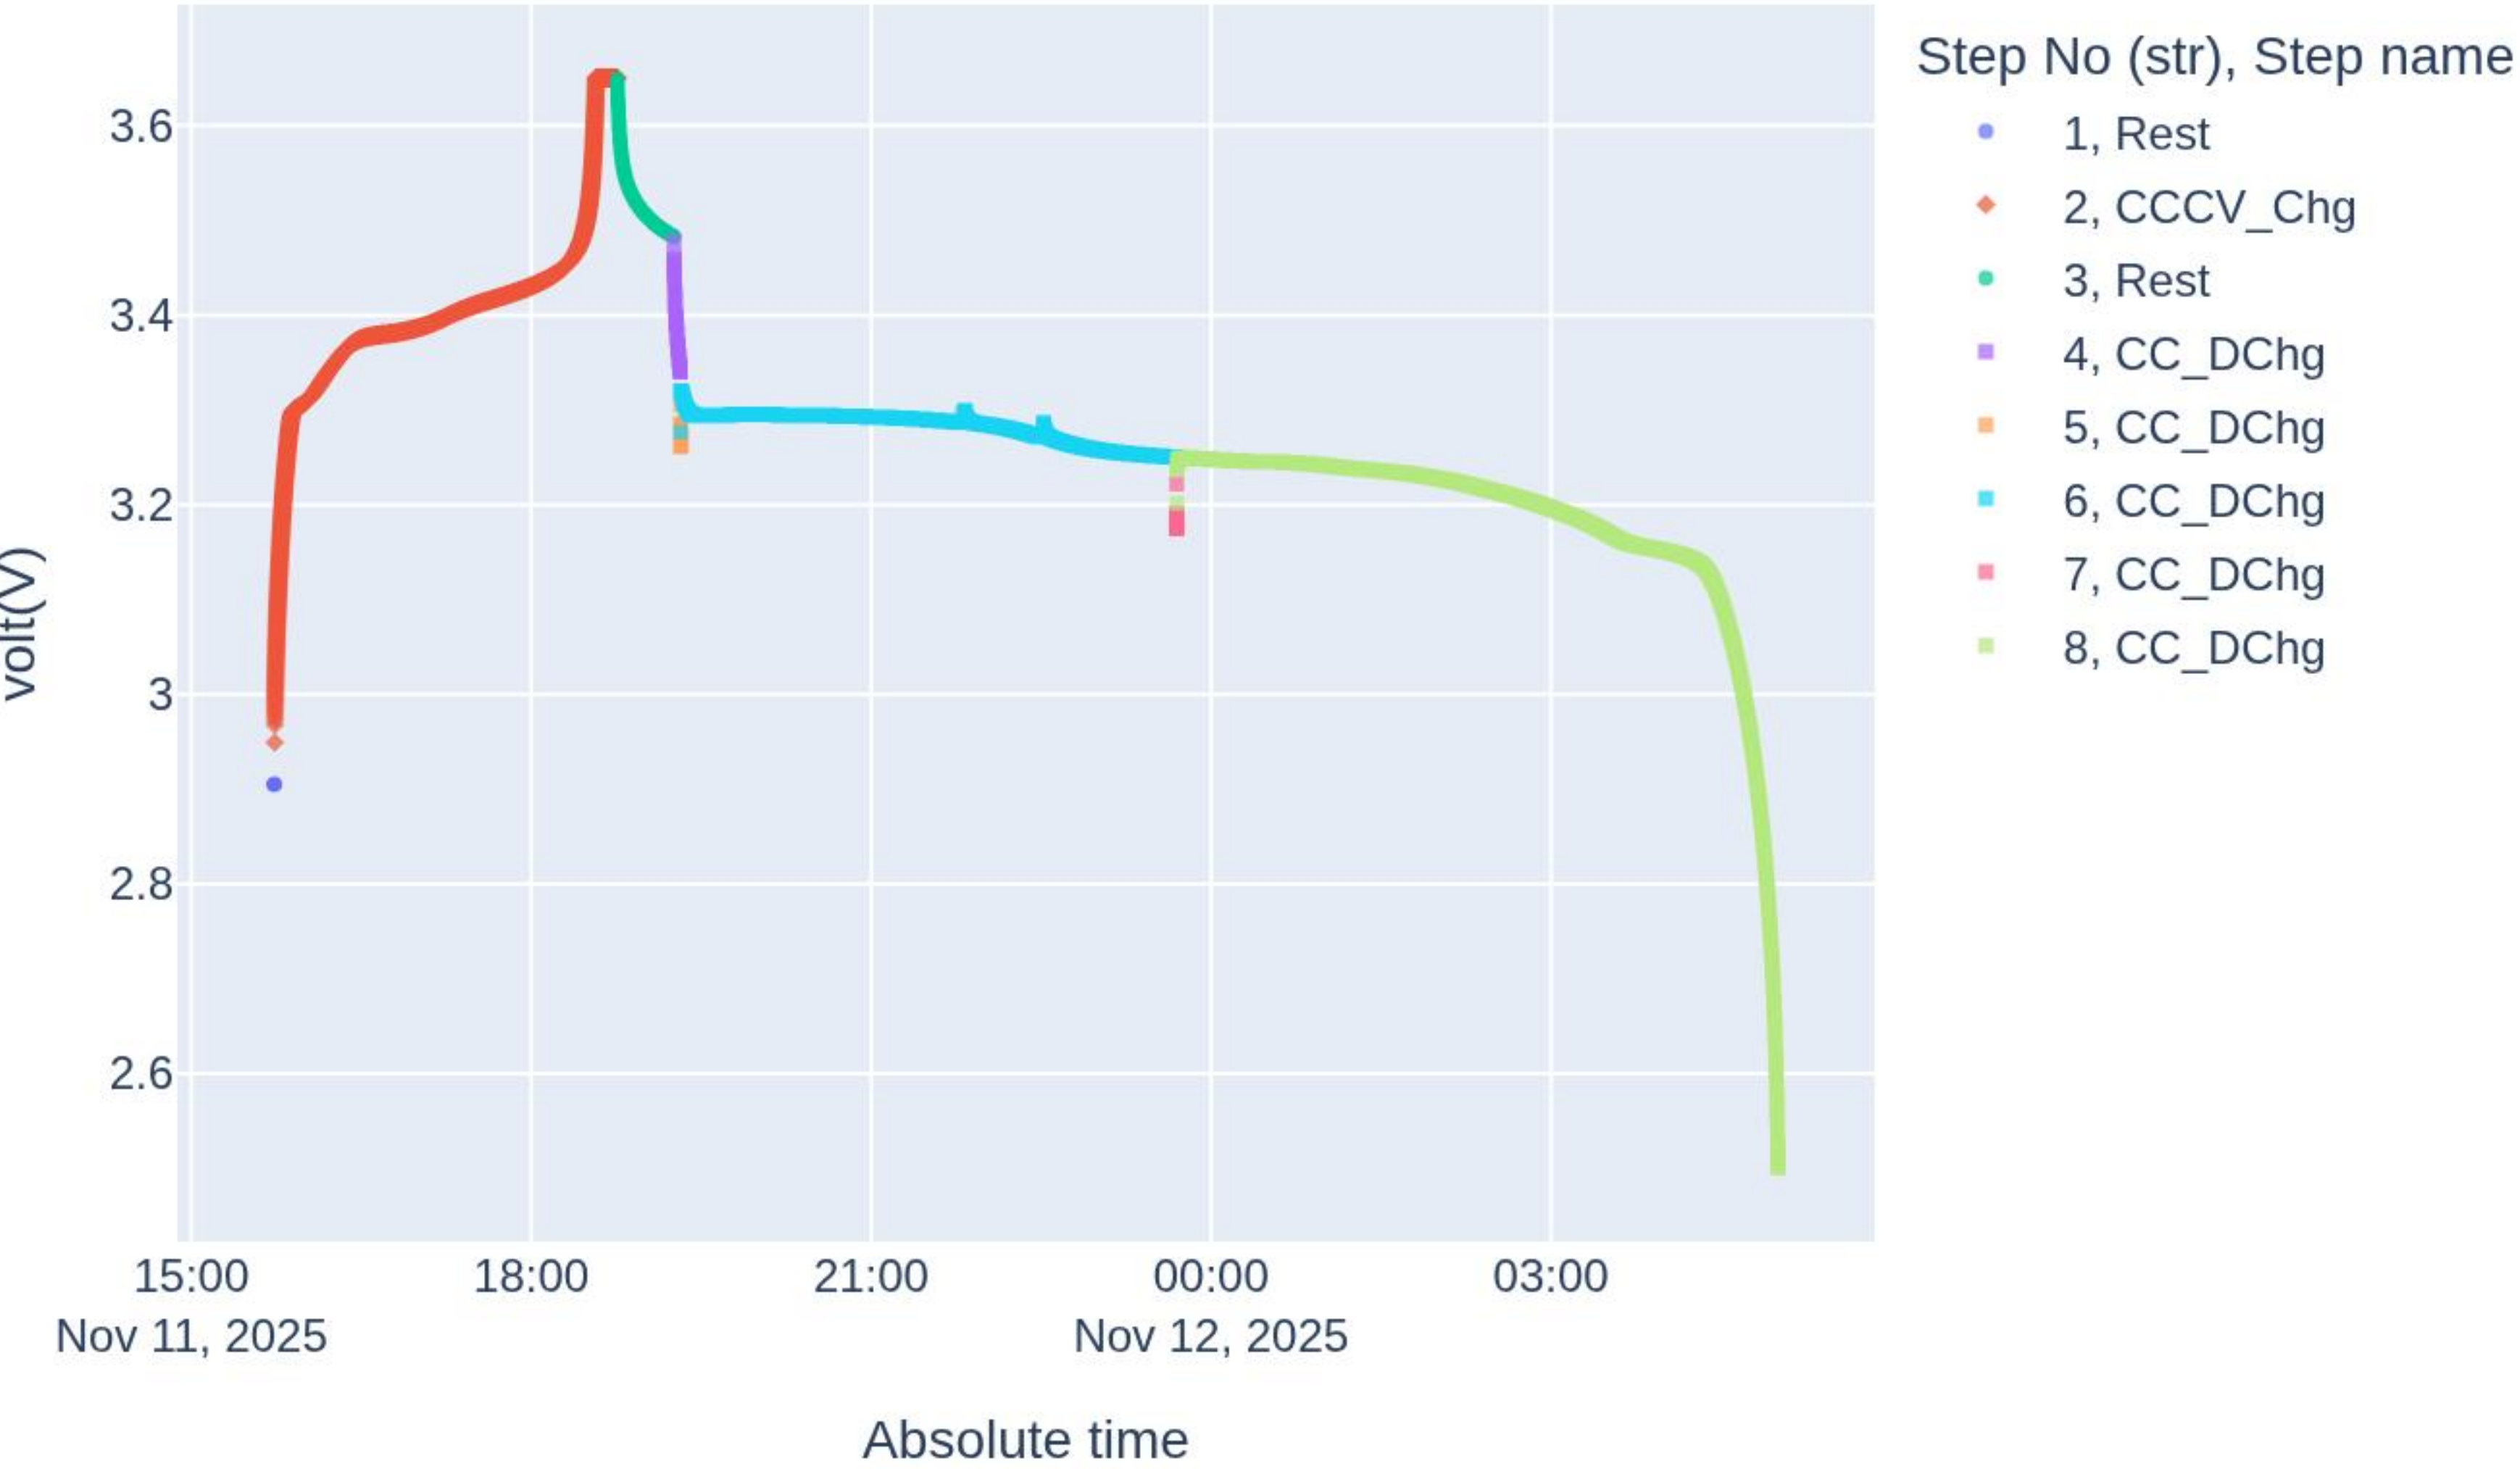


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0308_0_100.csv

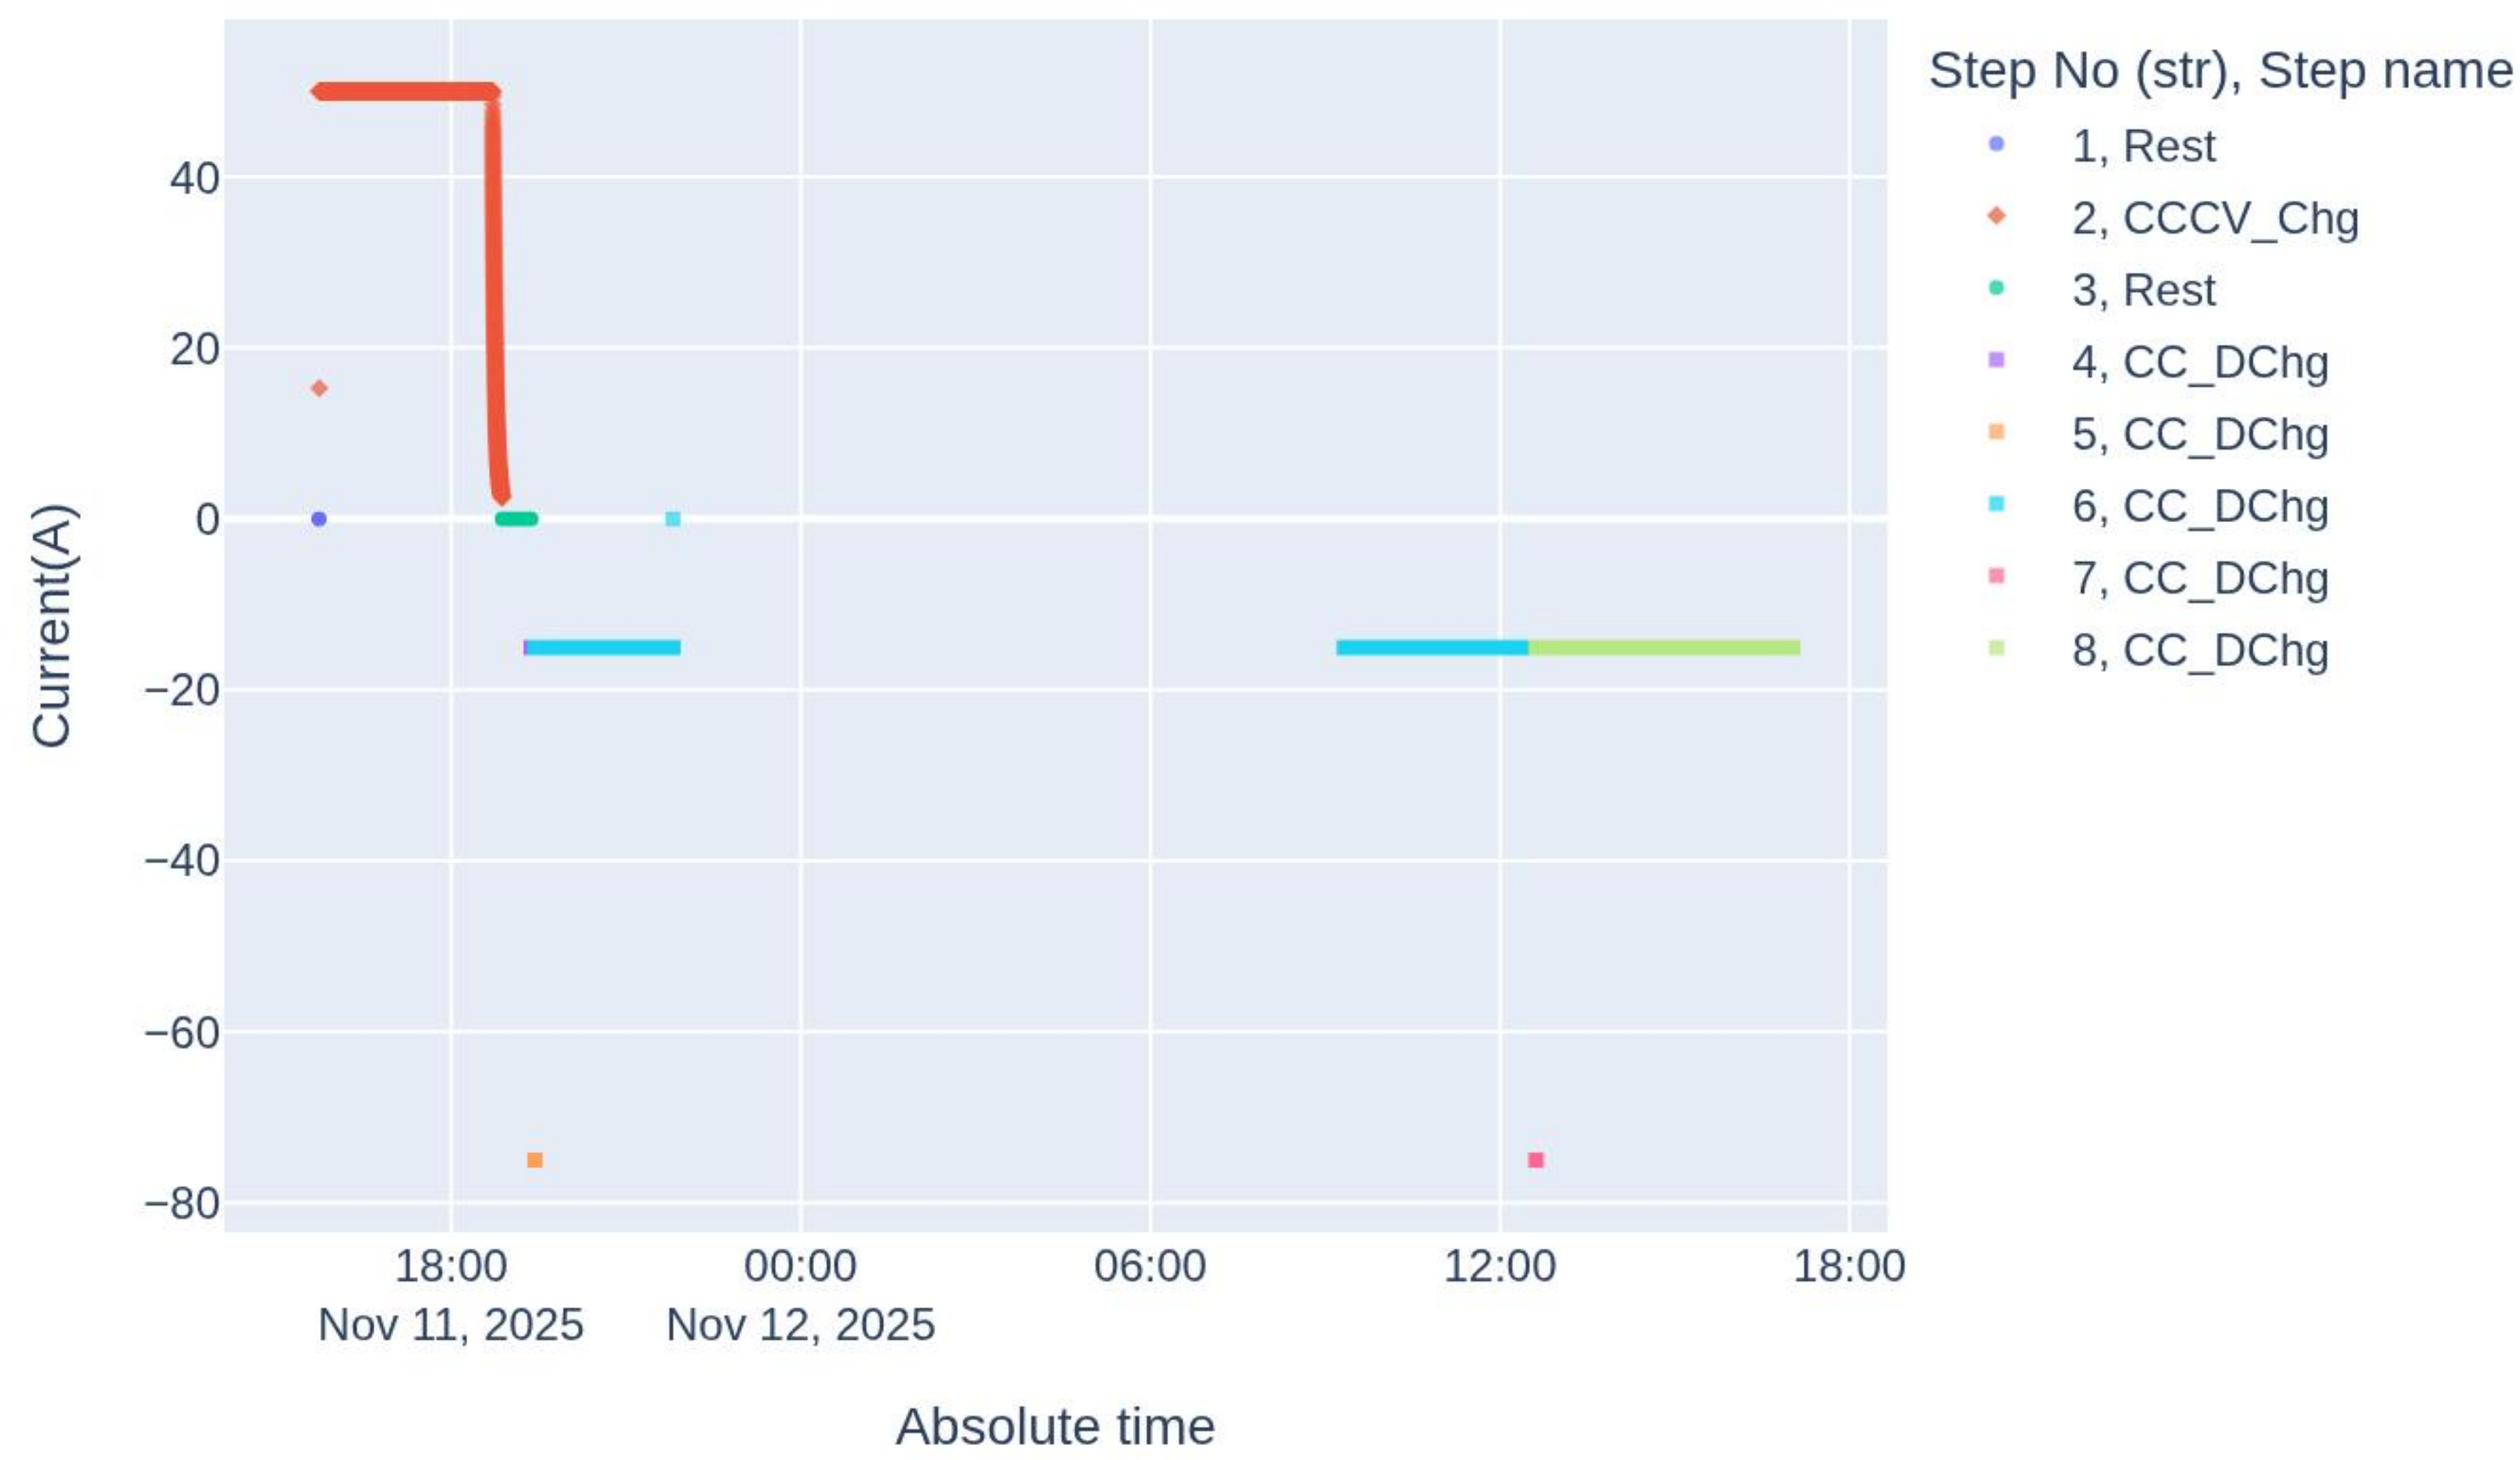


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0308_0_100.csv

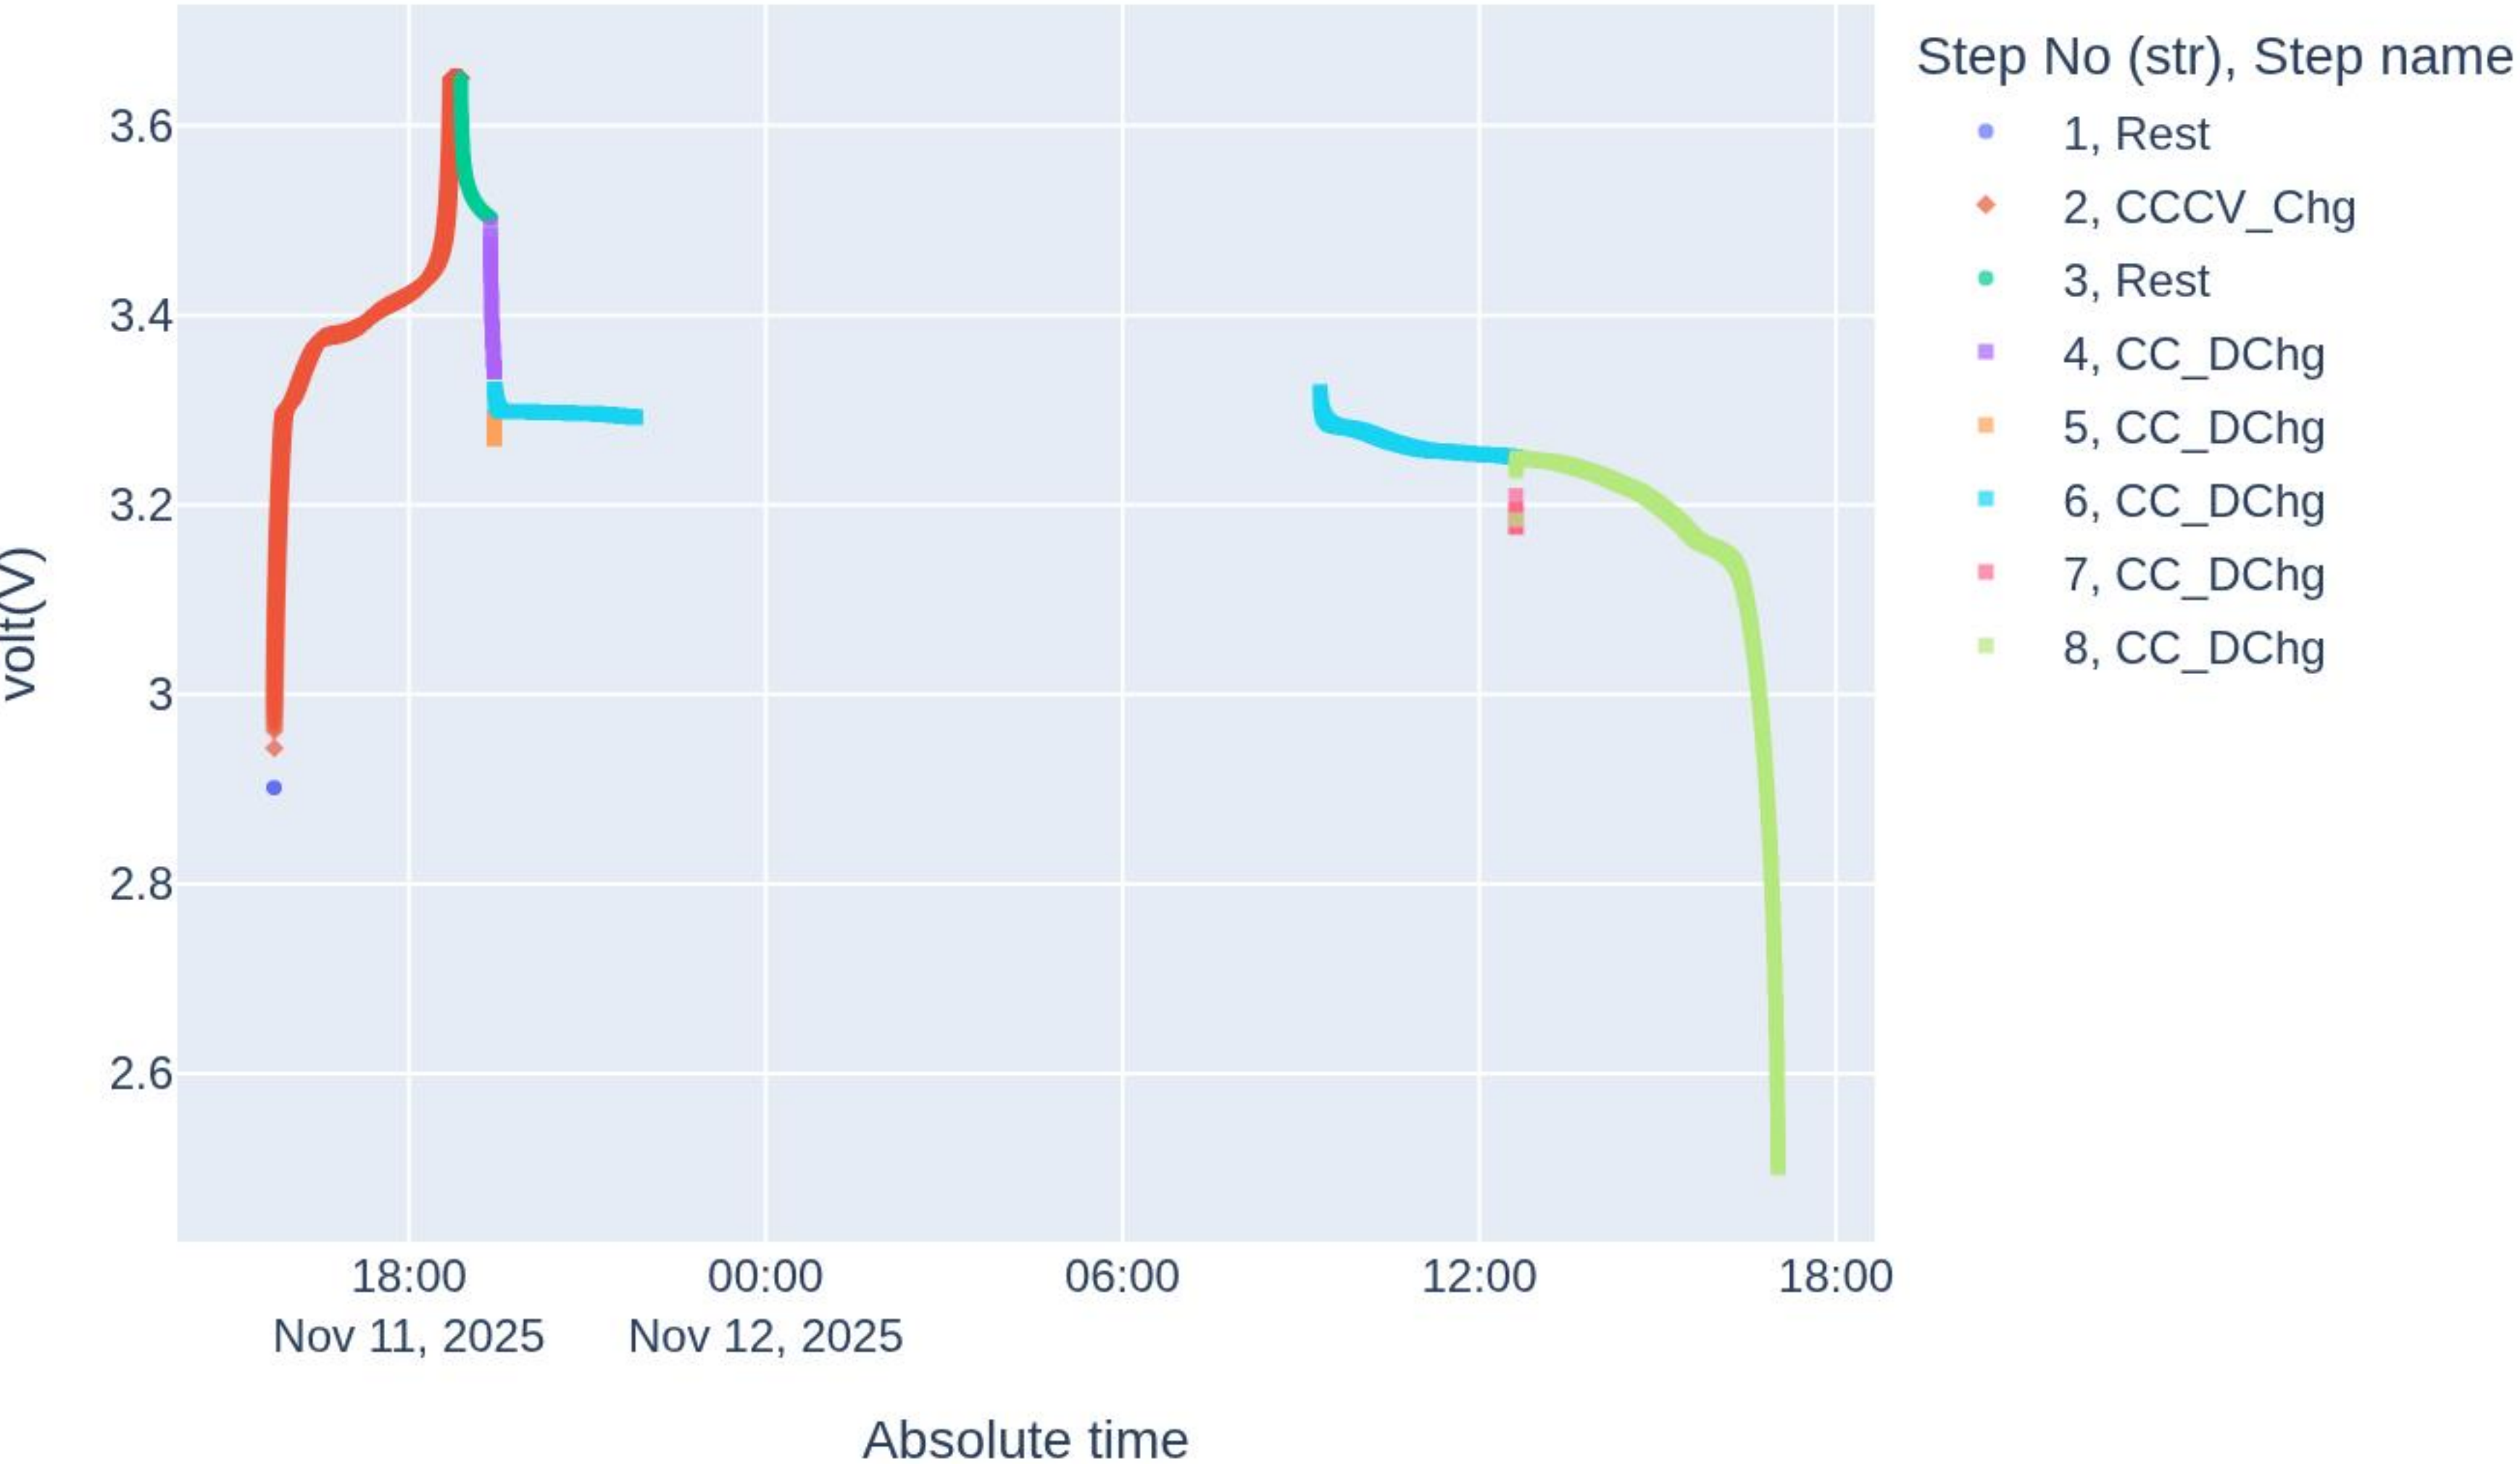


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0309_0_100.csv

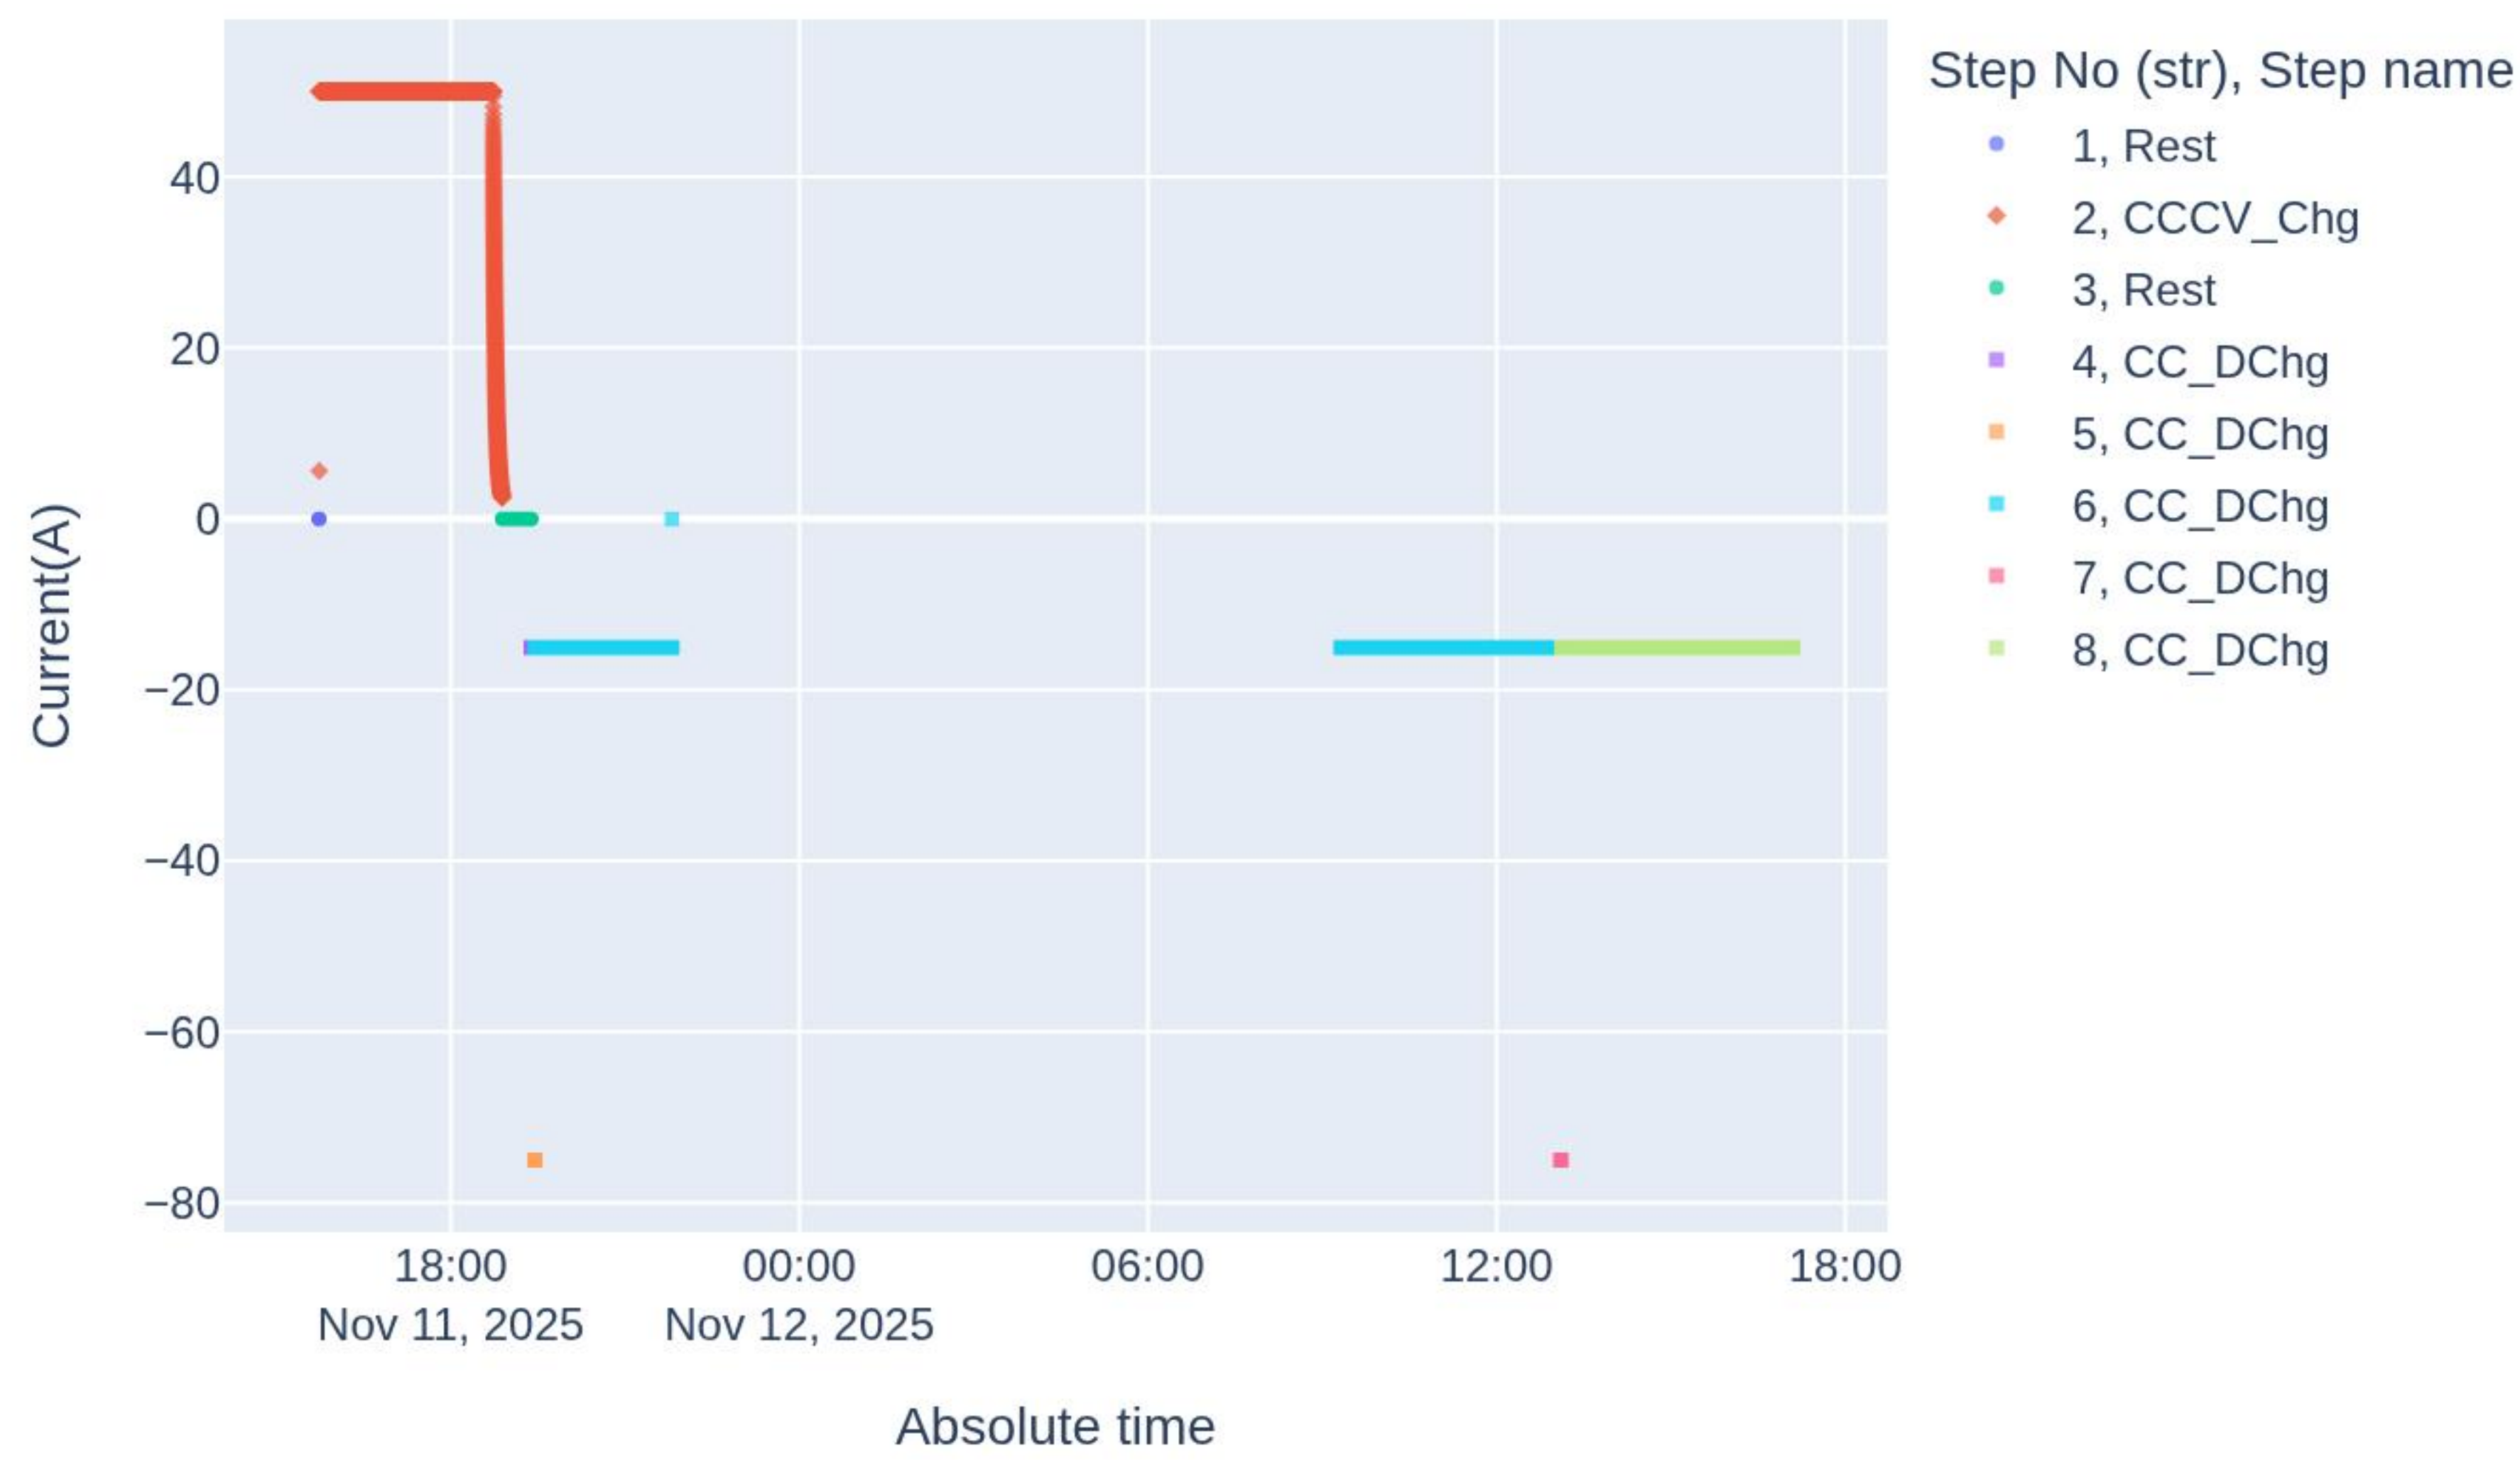


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0309_0_100.csv

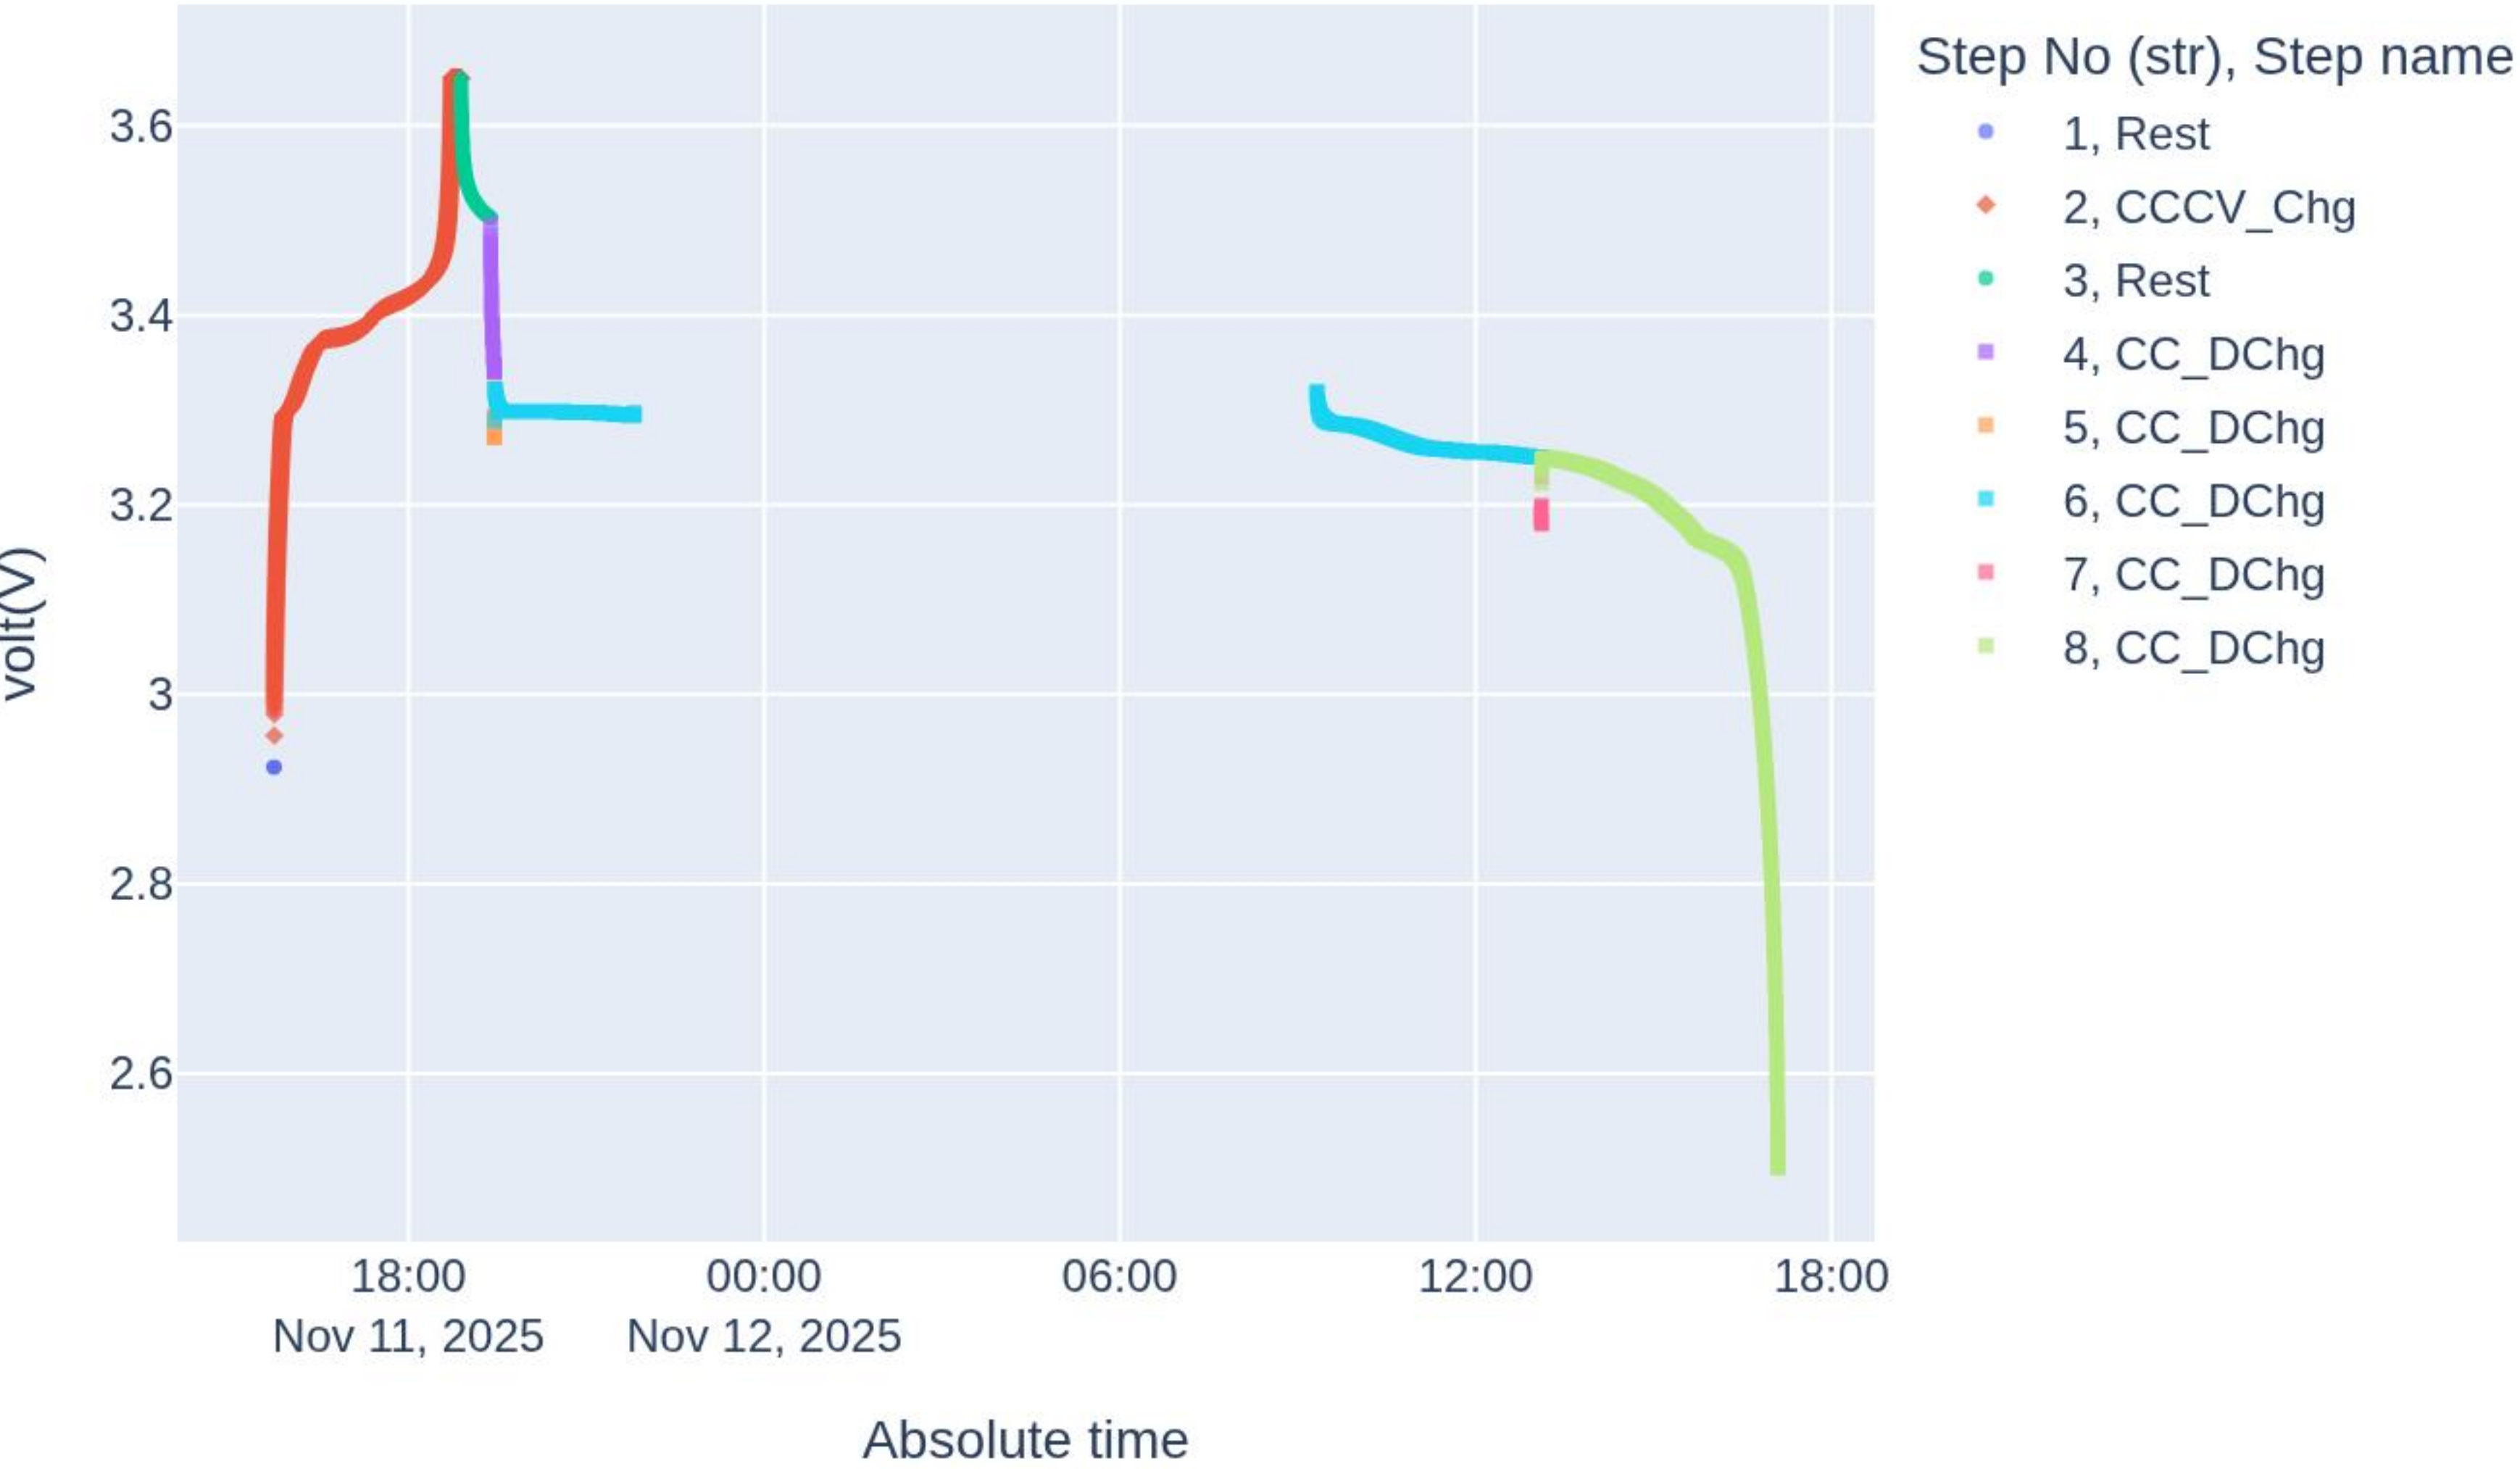


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0310_0_100.csv

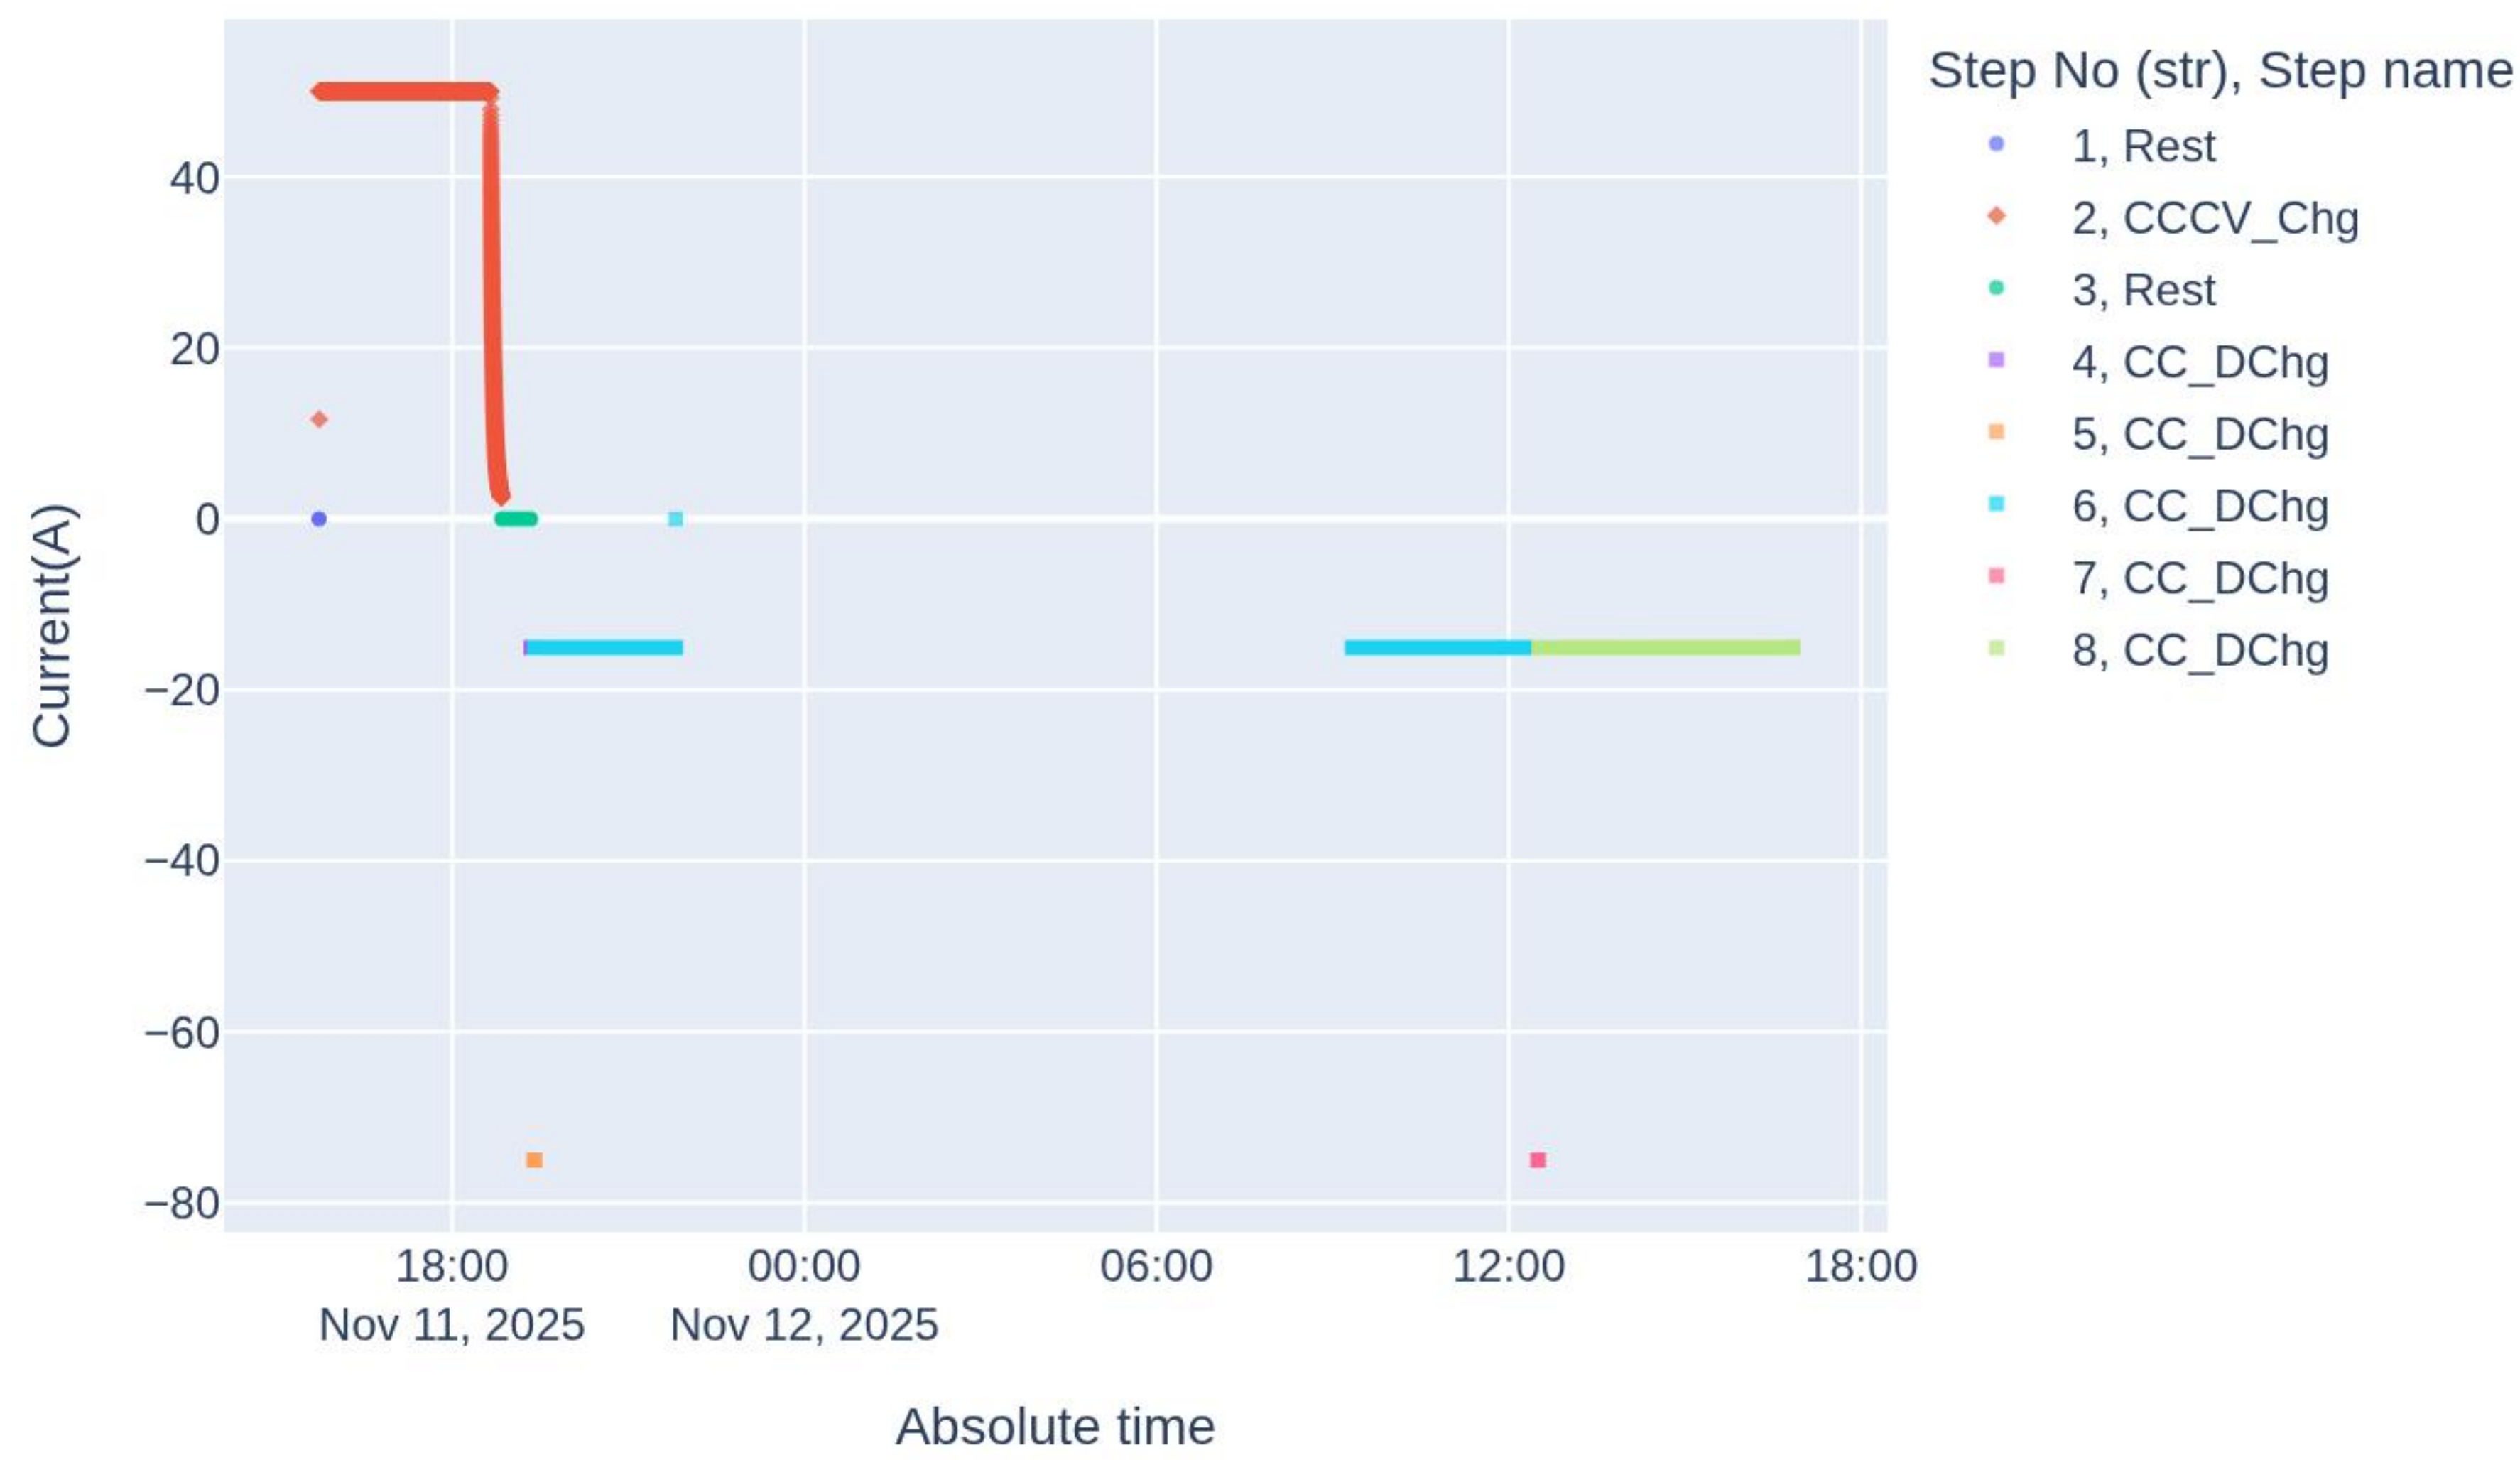


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0310_0_100.csv

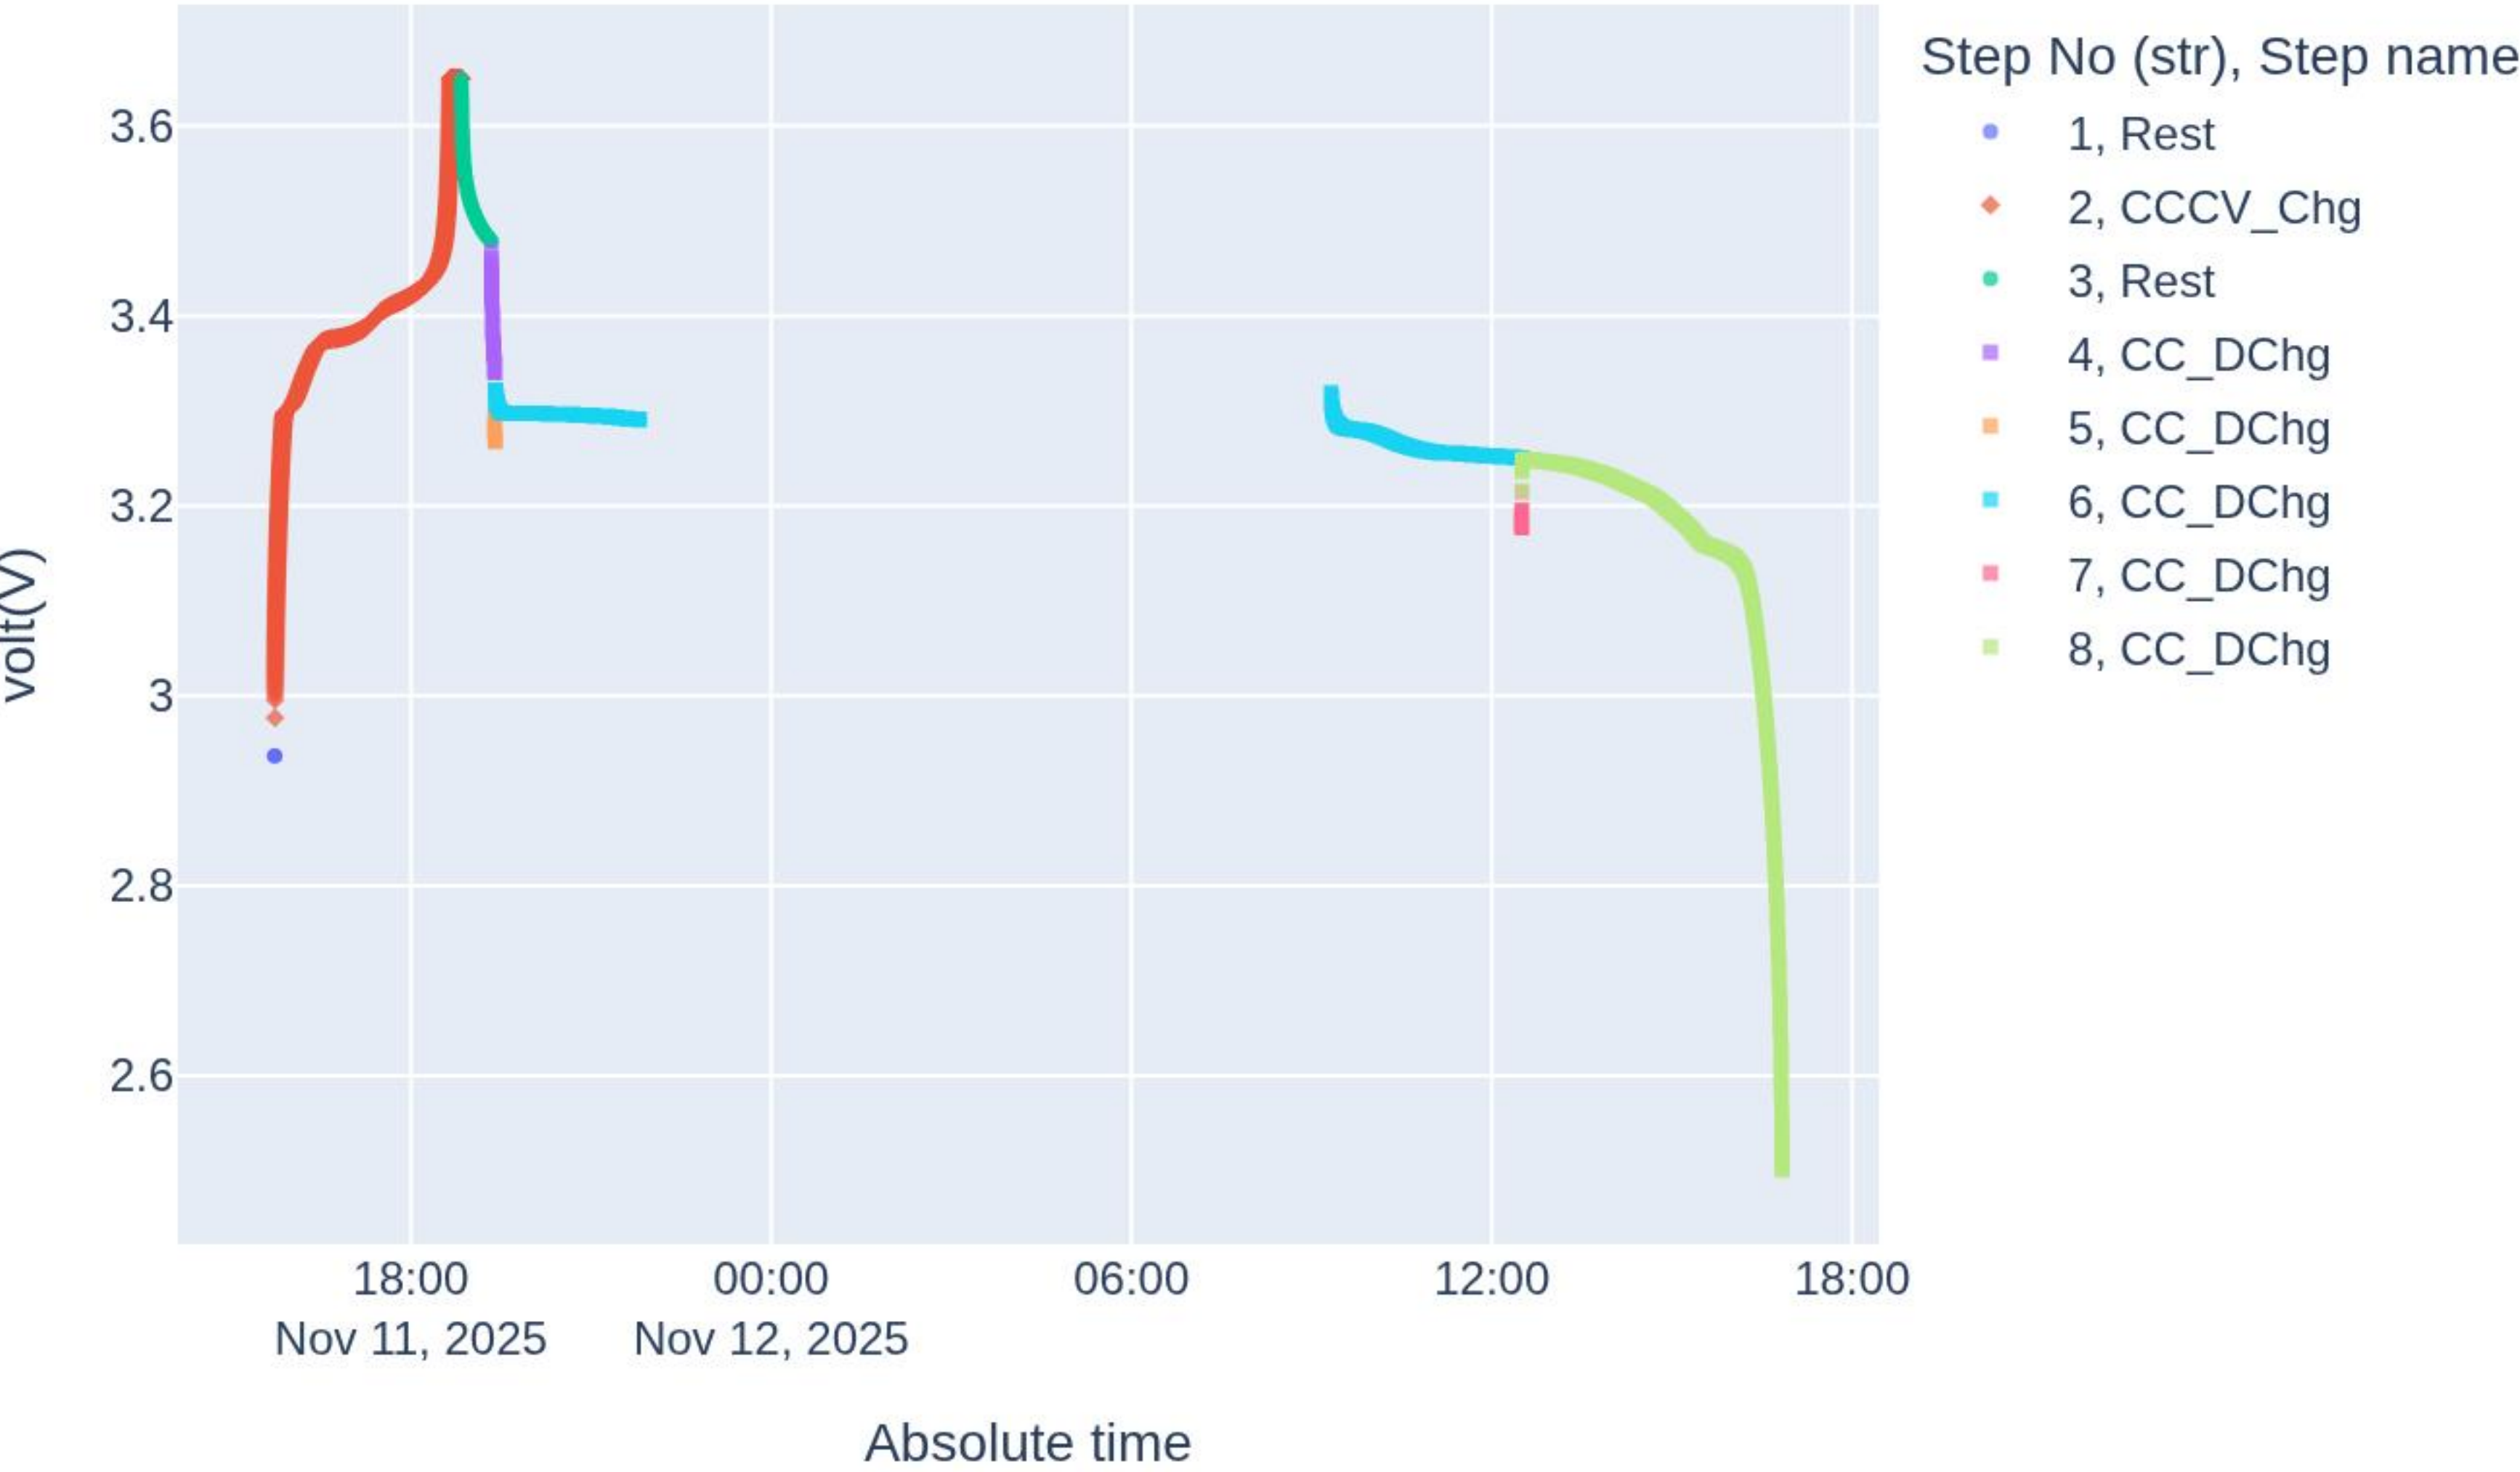


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0311_0_100.csv

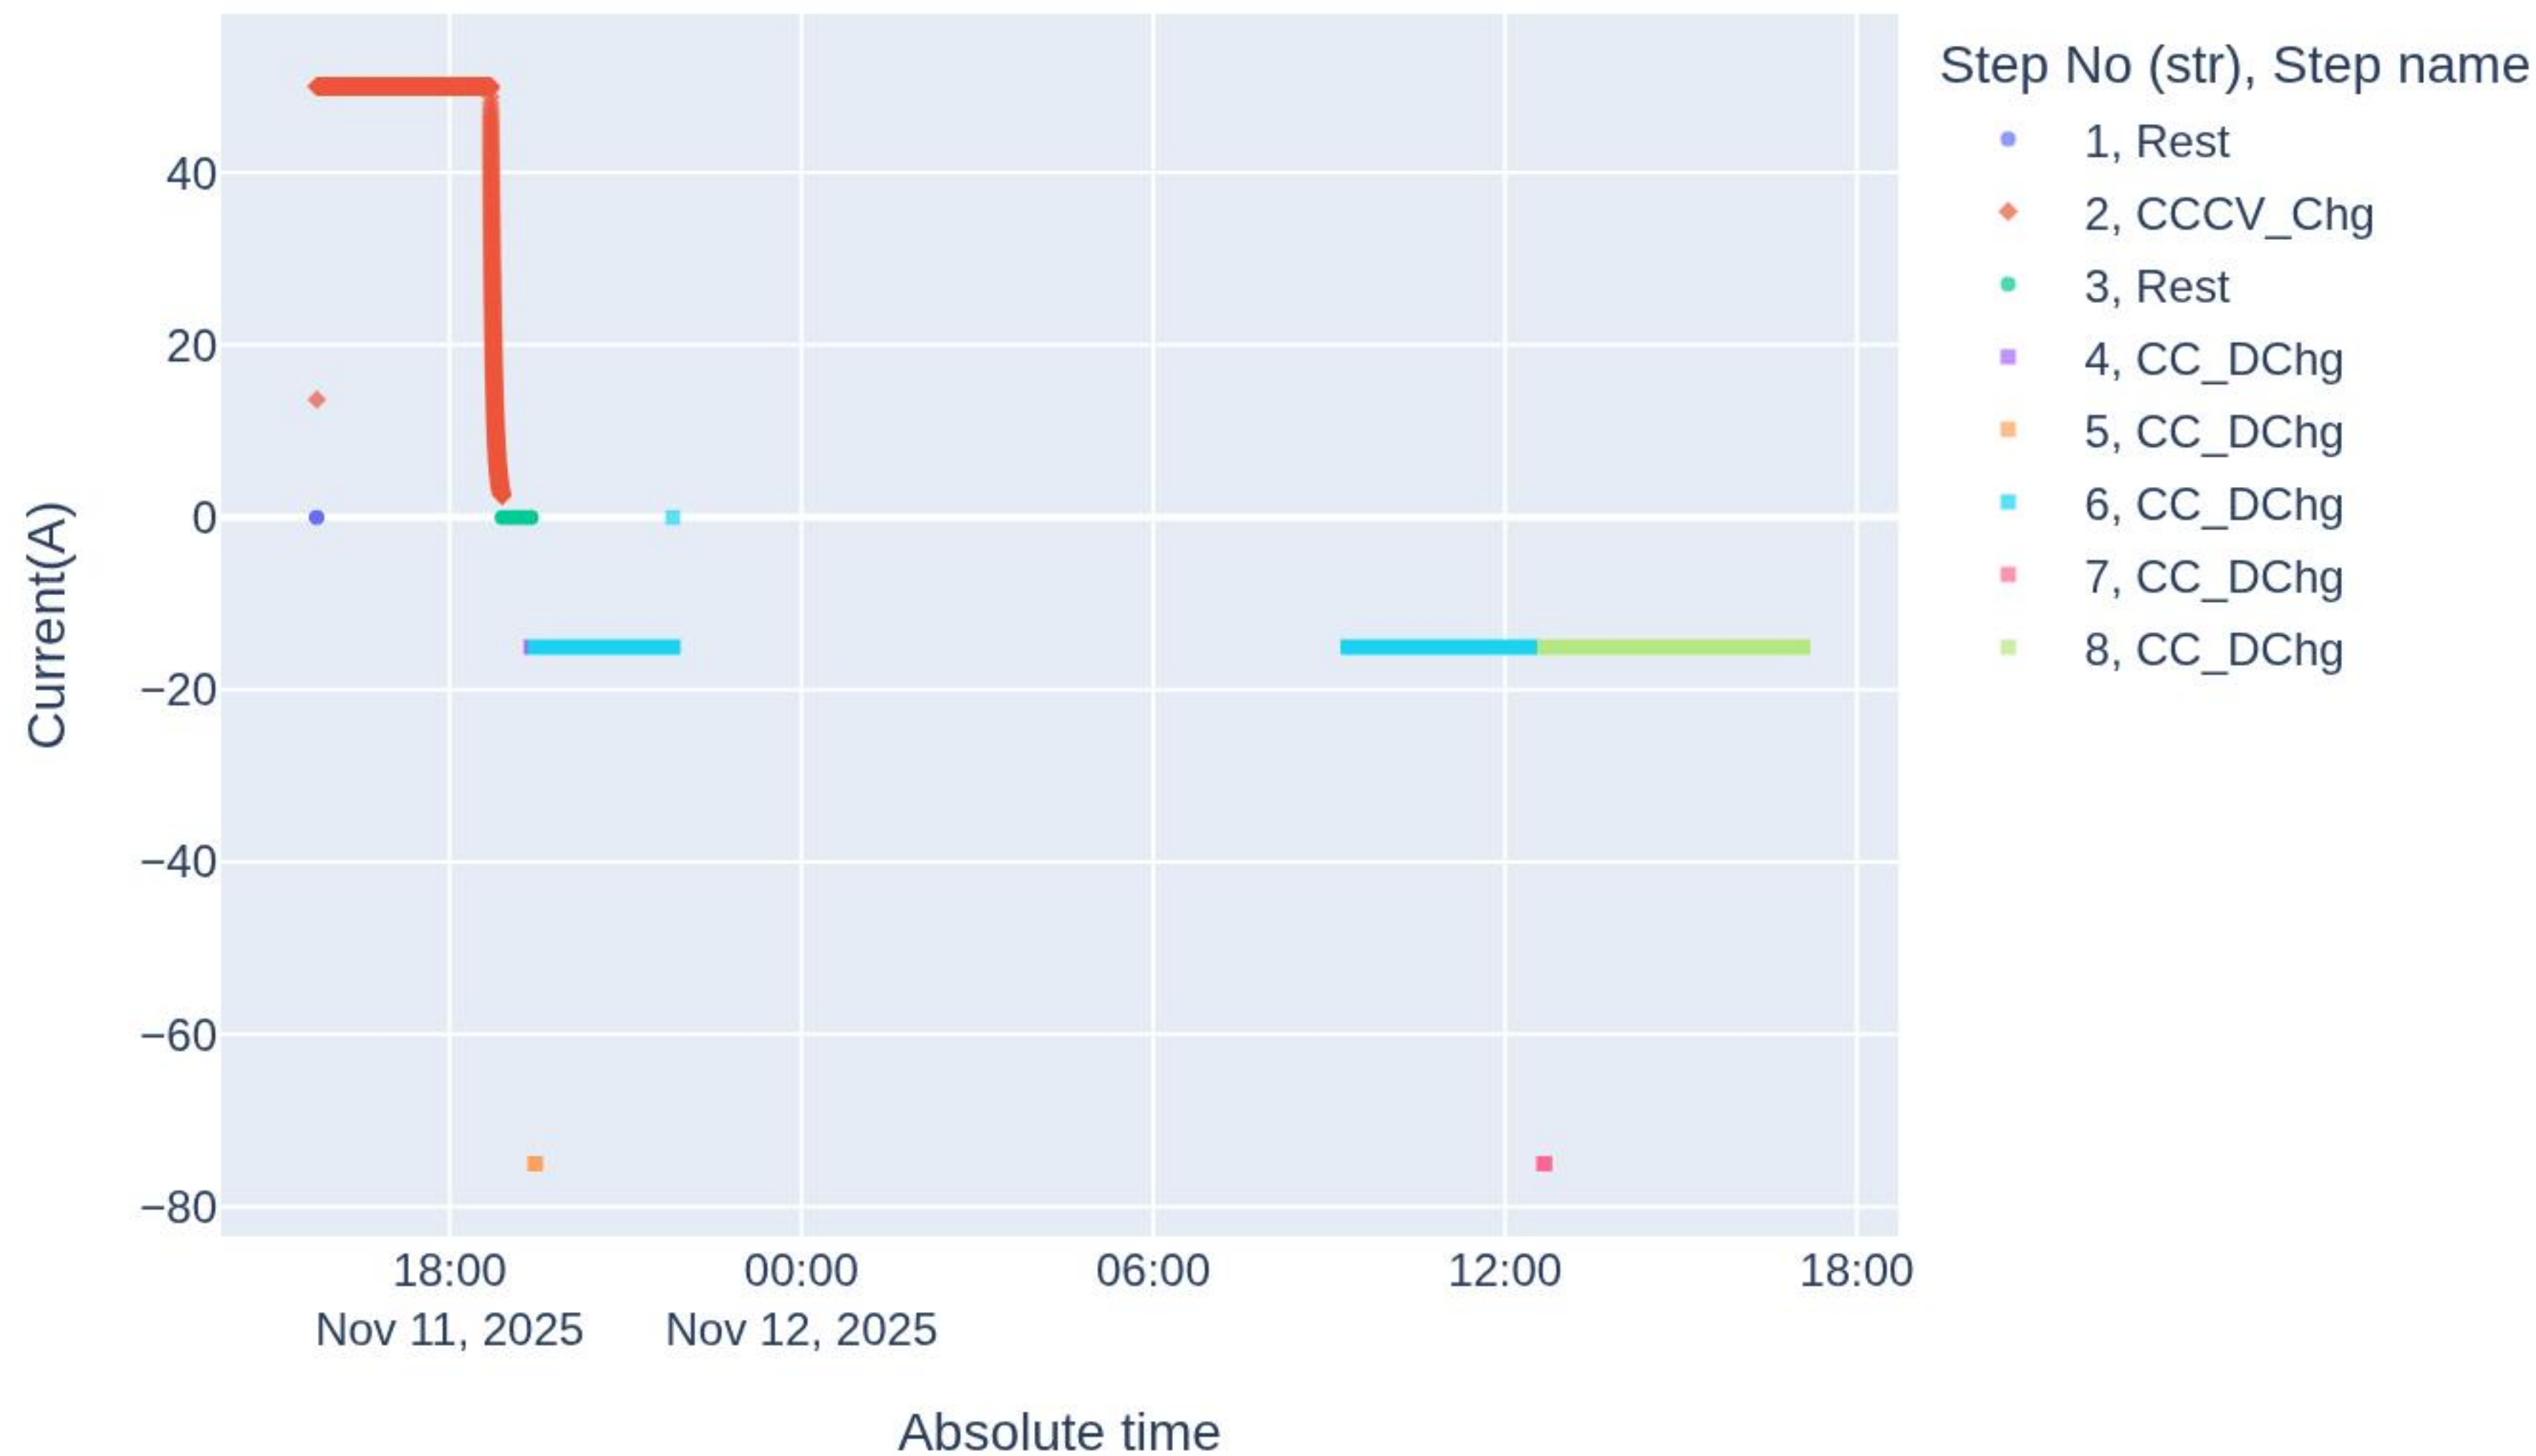


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0311_0_100.csv

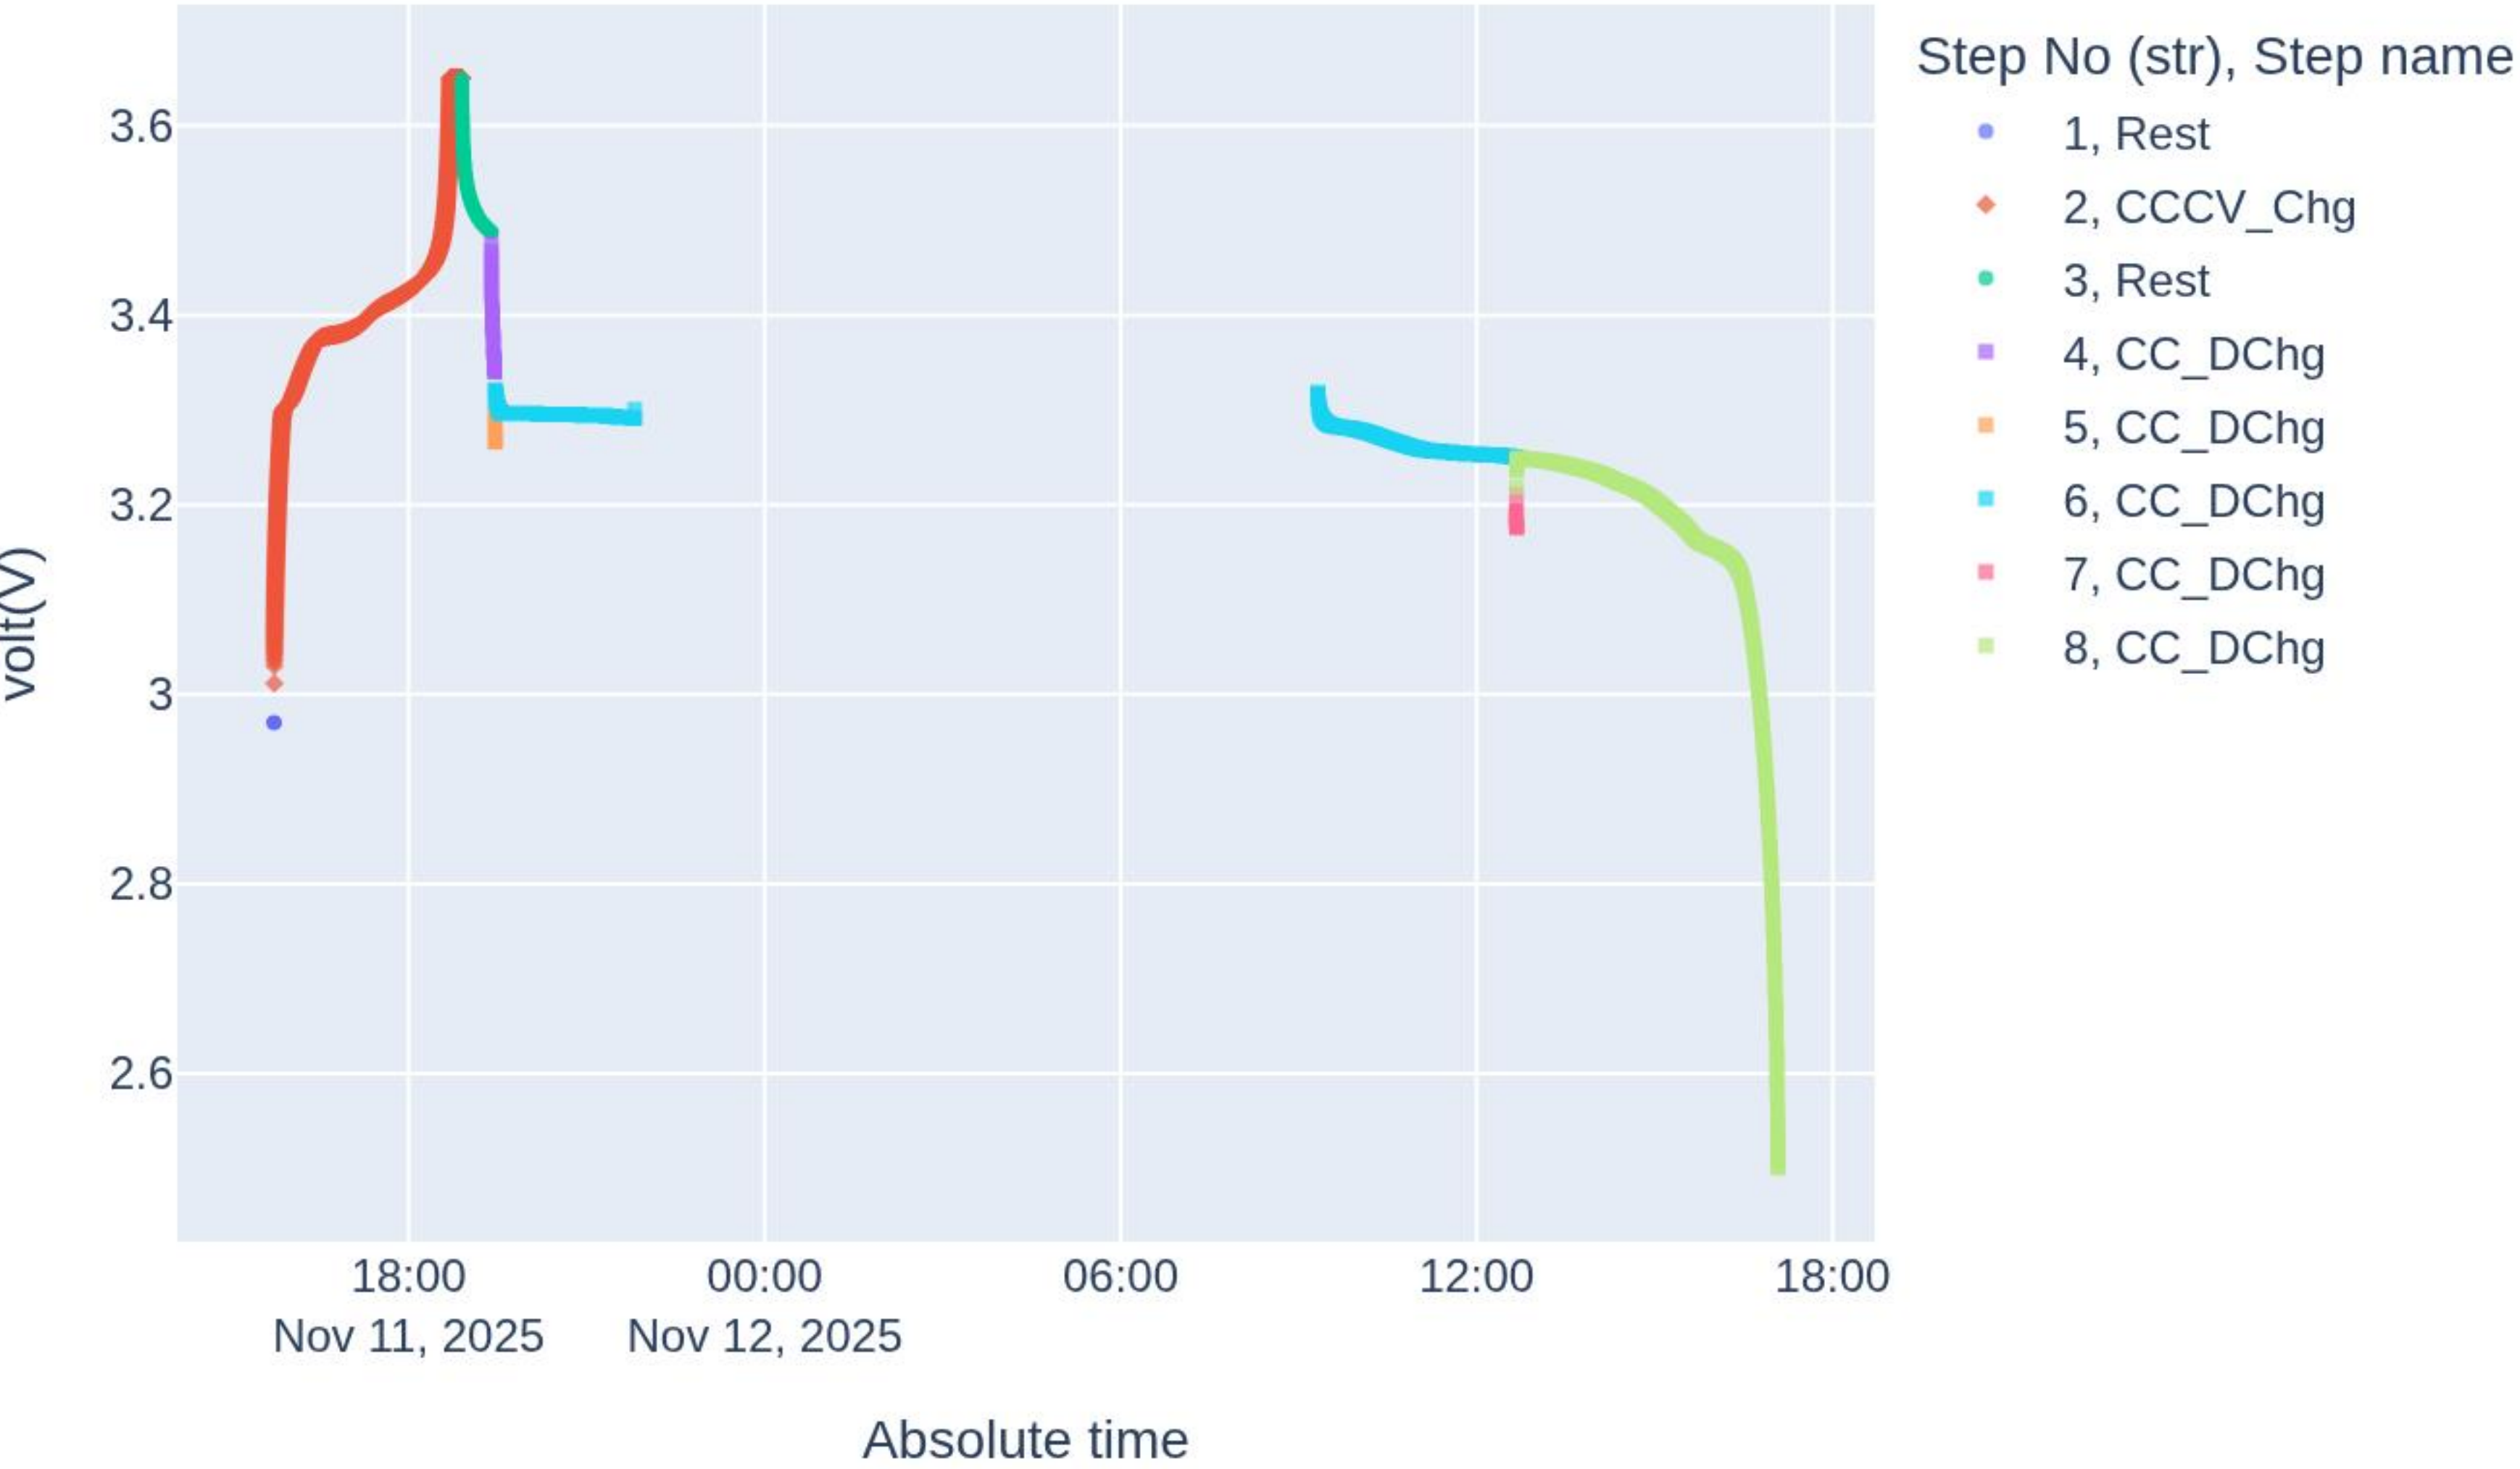


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0312_0_100.csv

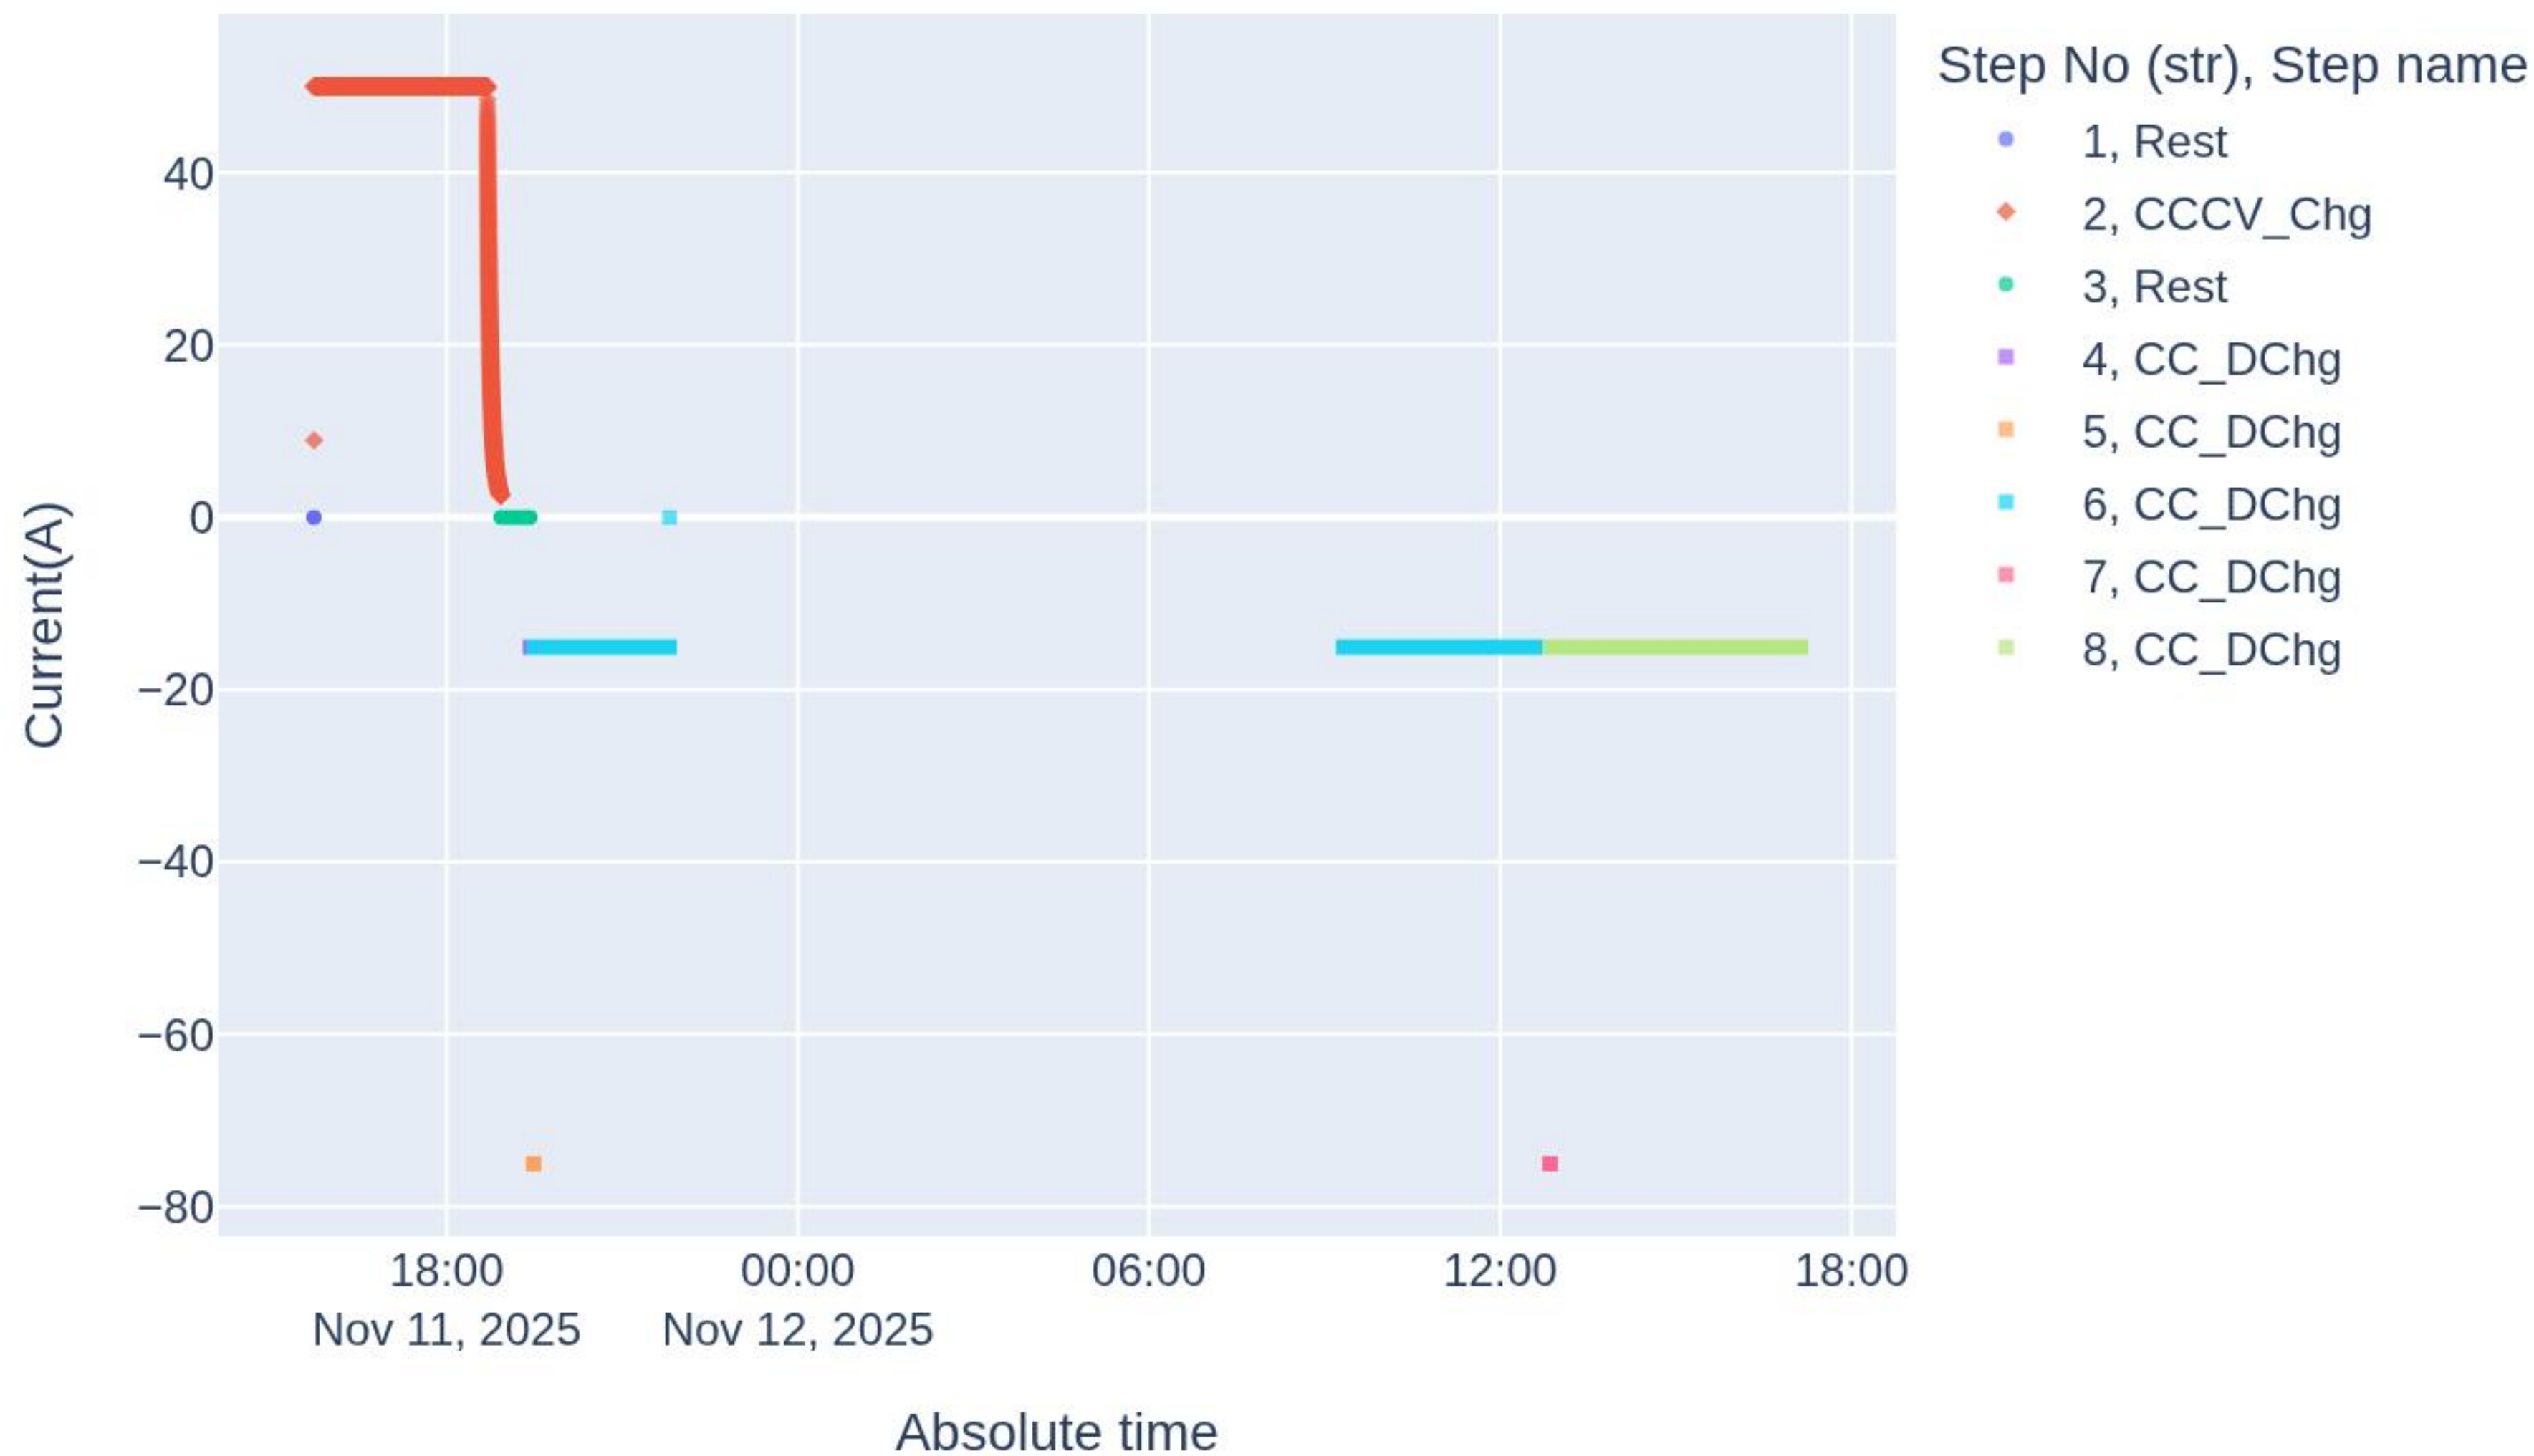


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0312_0_100.csv

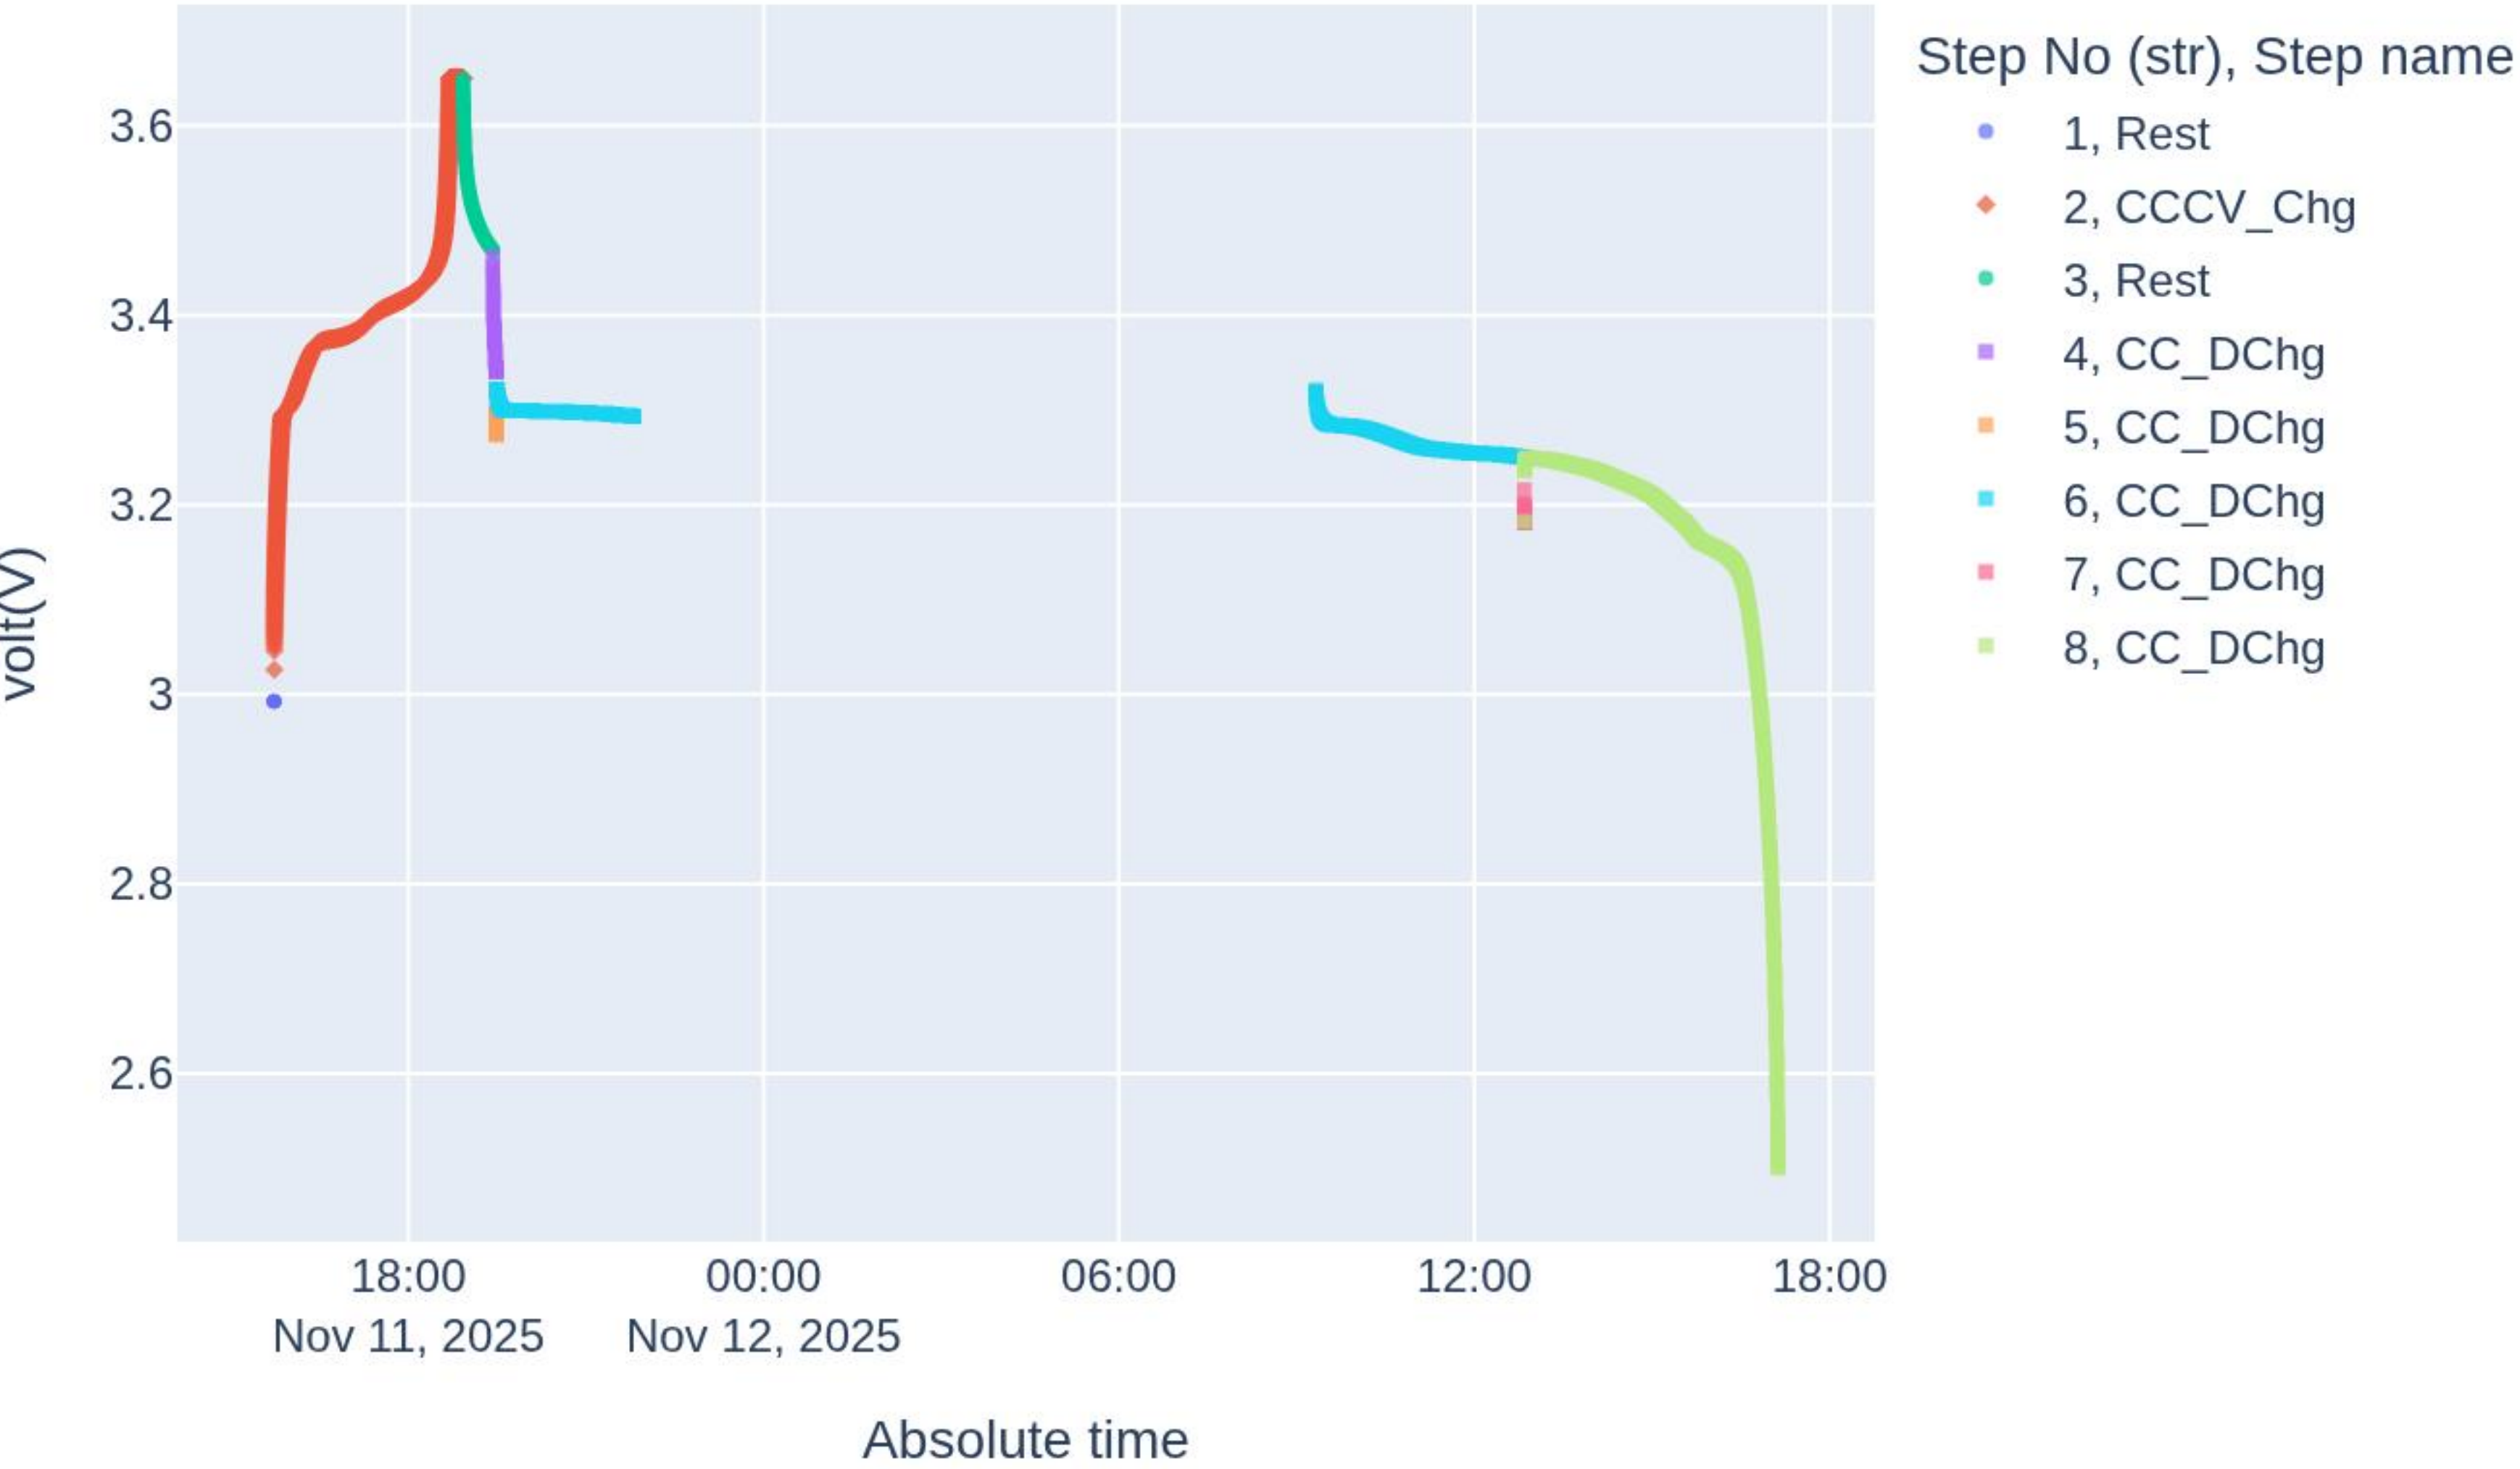


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0313_0_100.csv

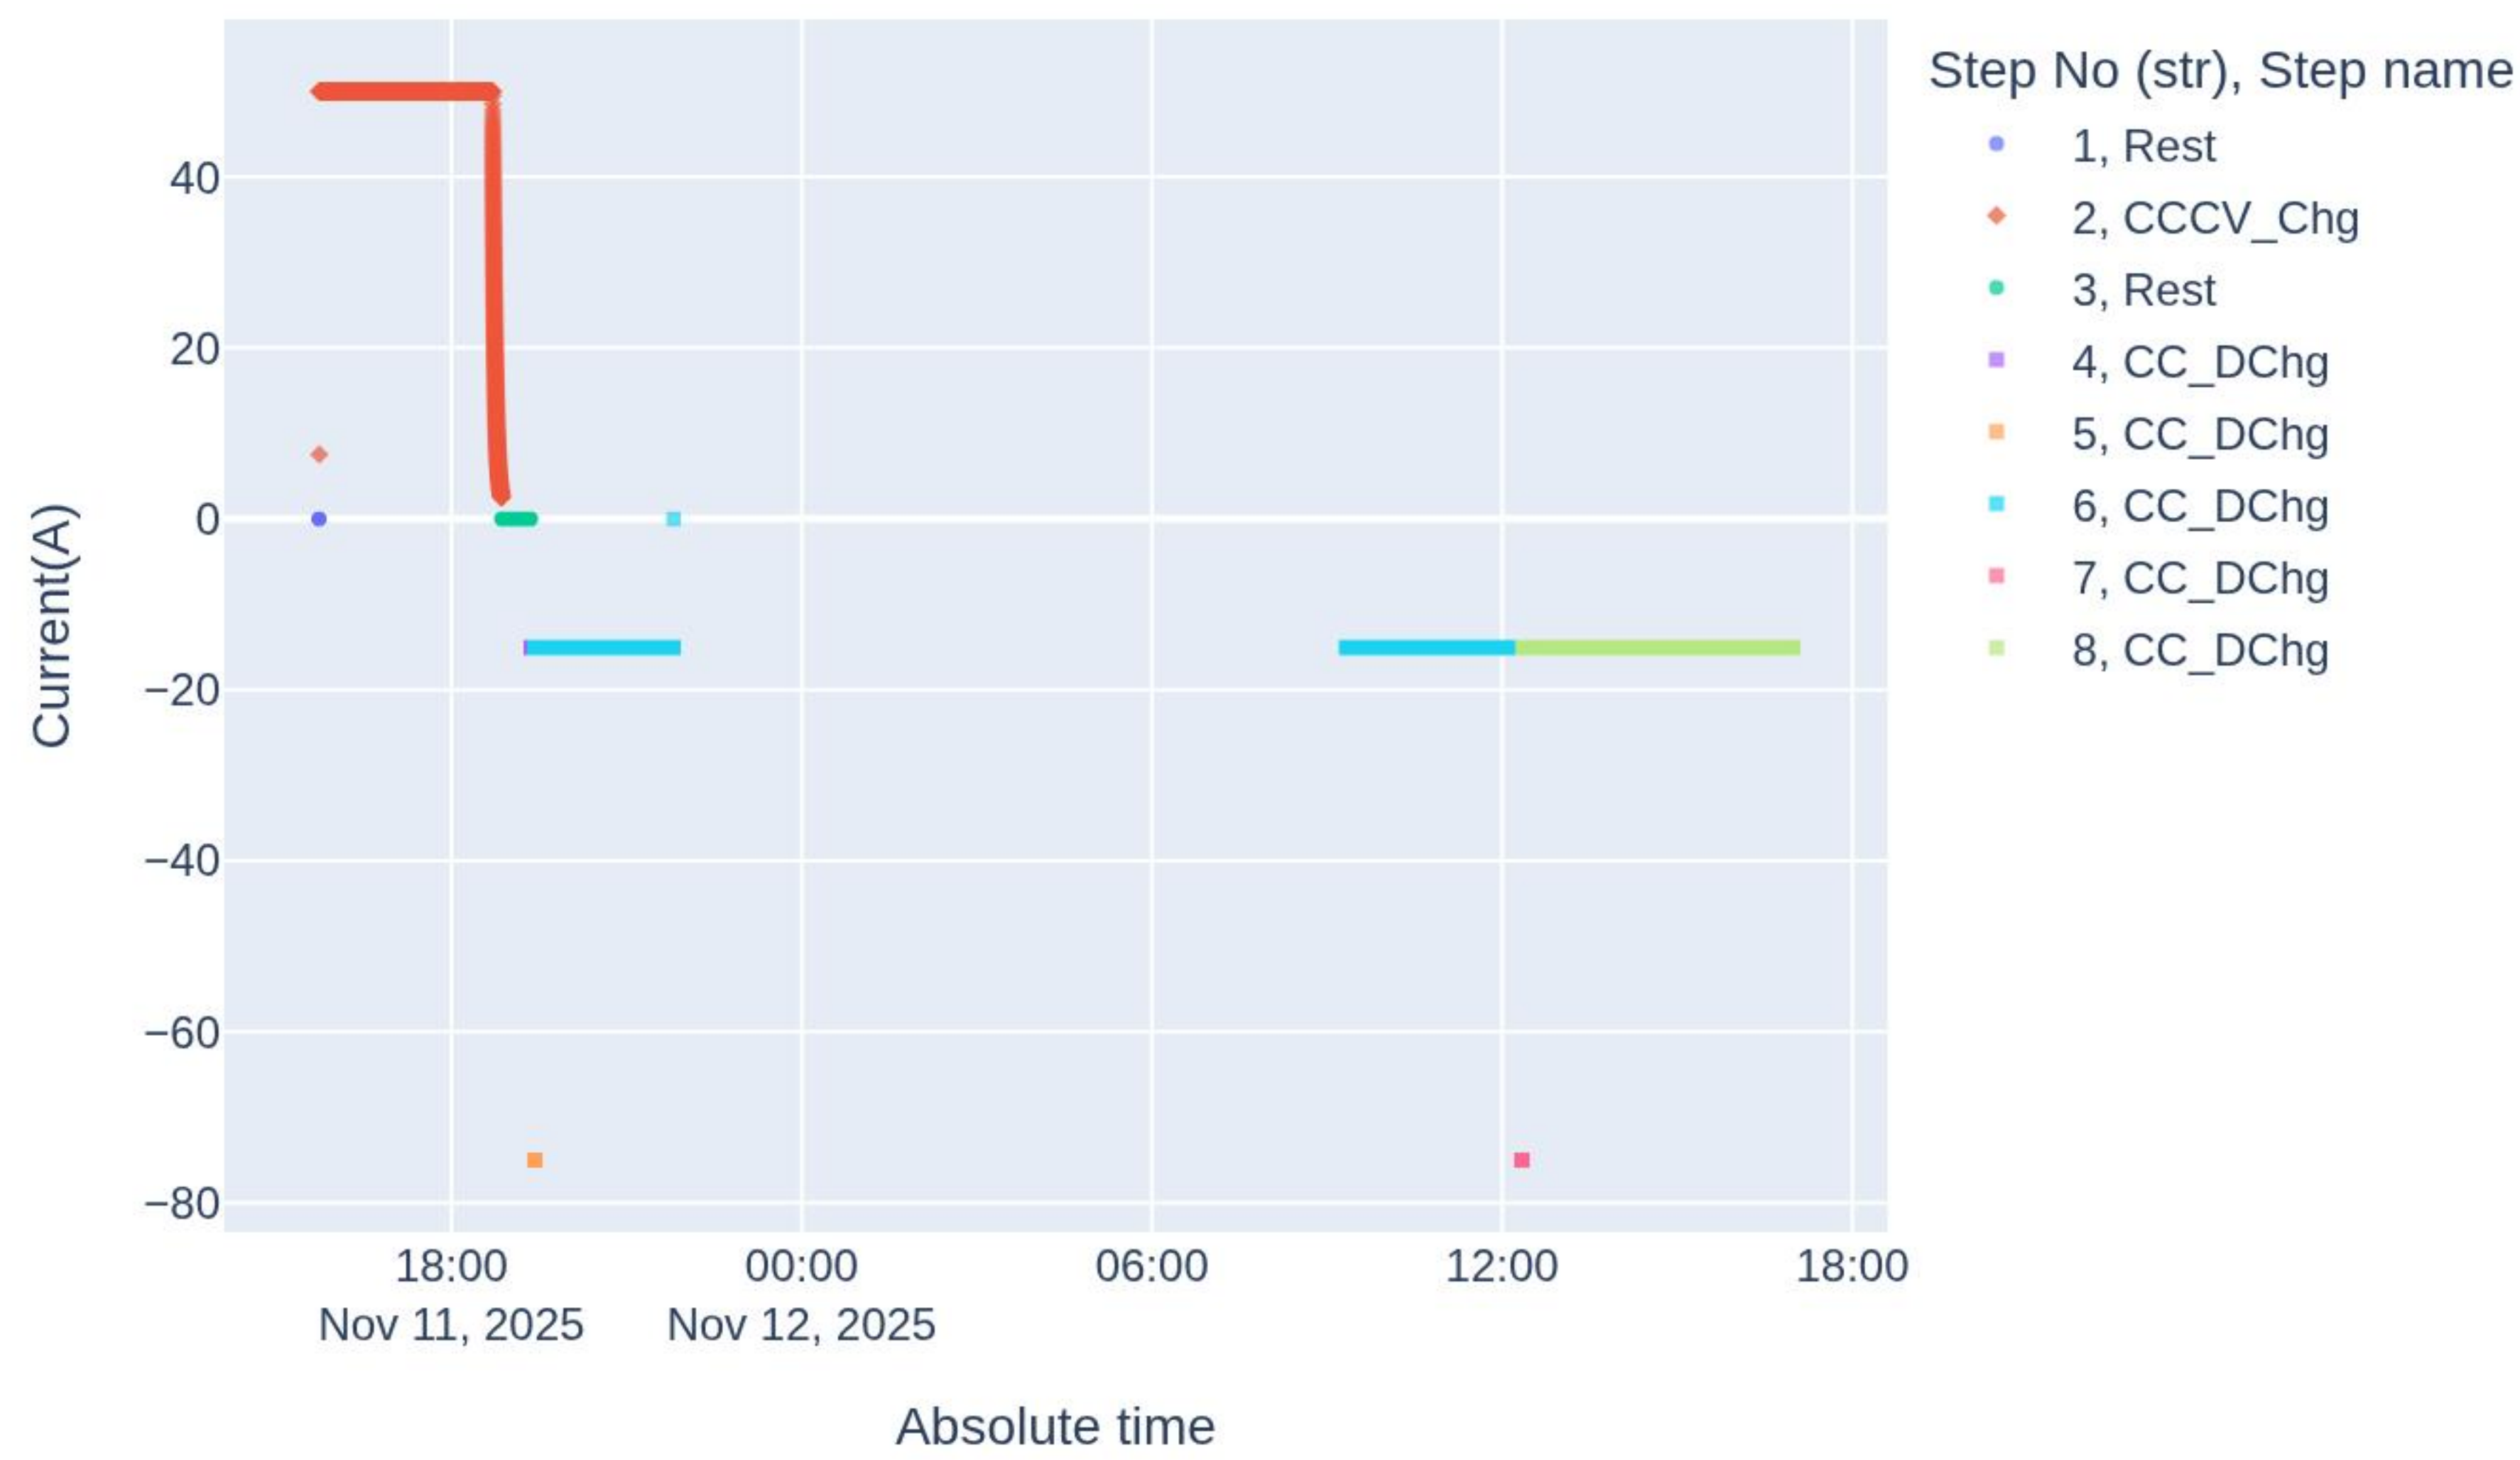


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0313_0_100.csv

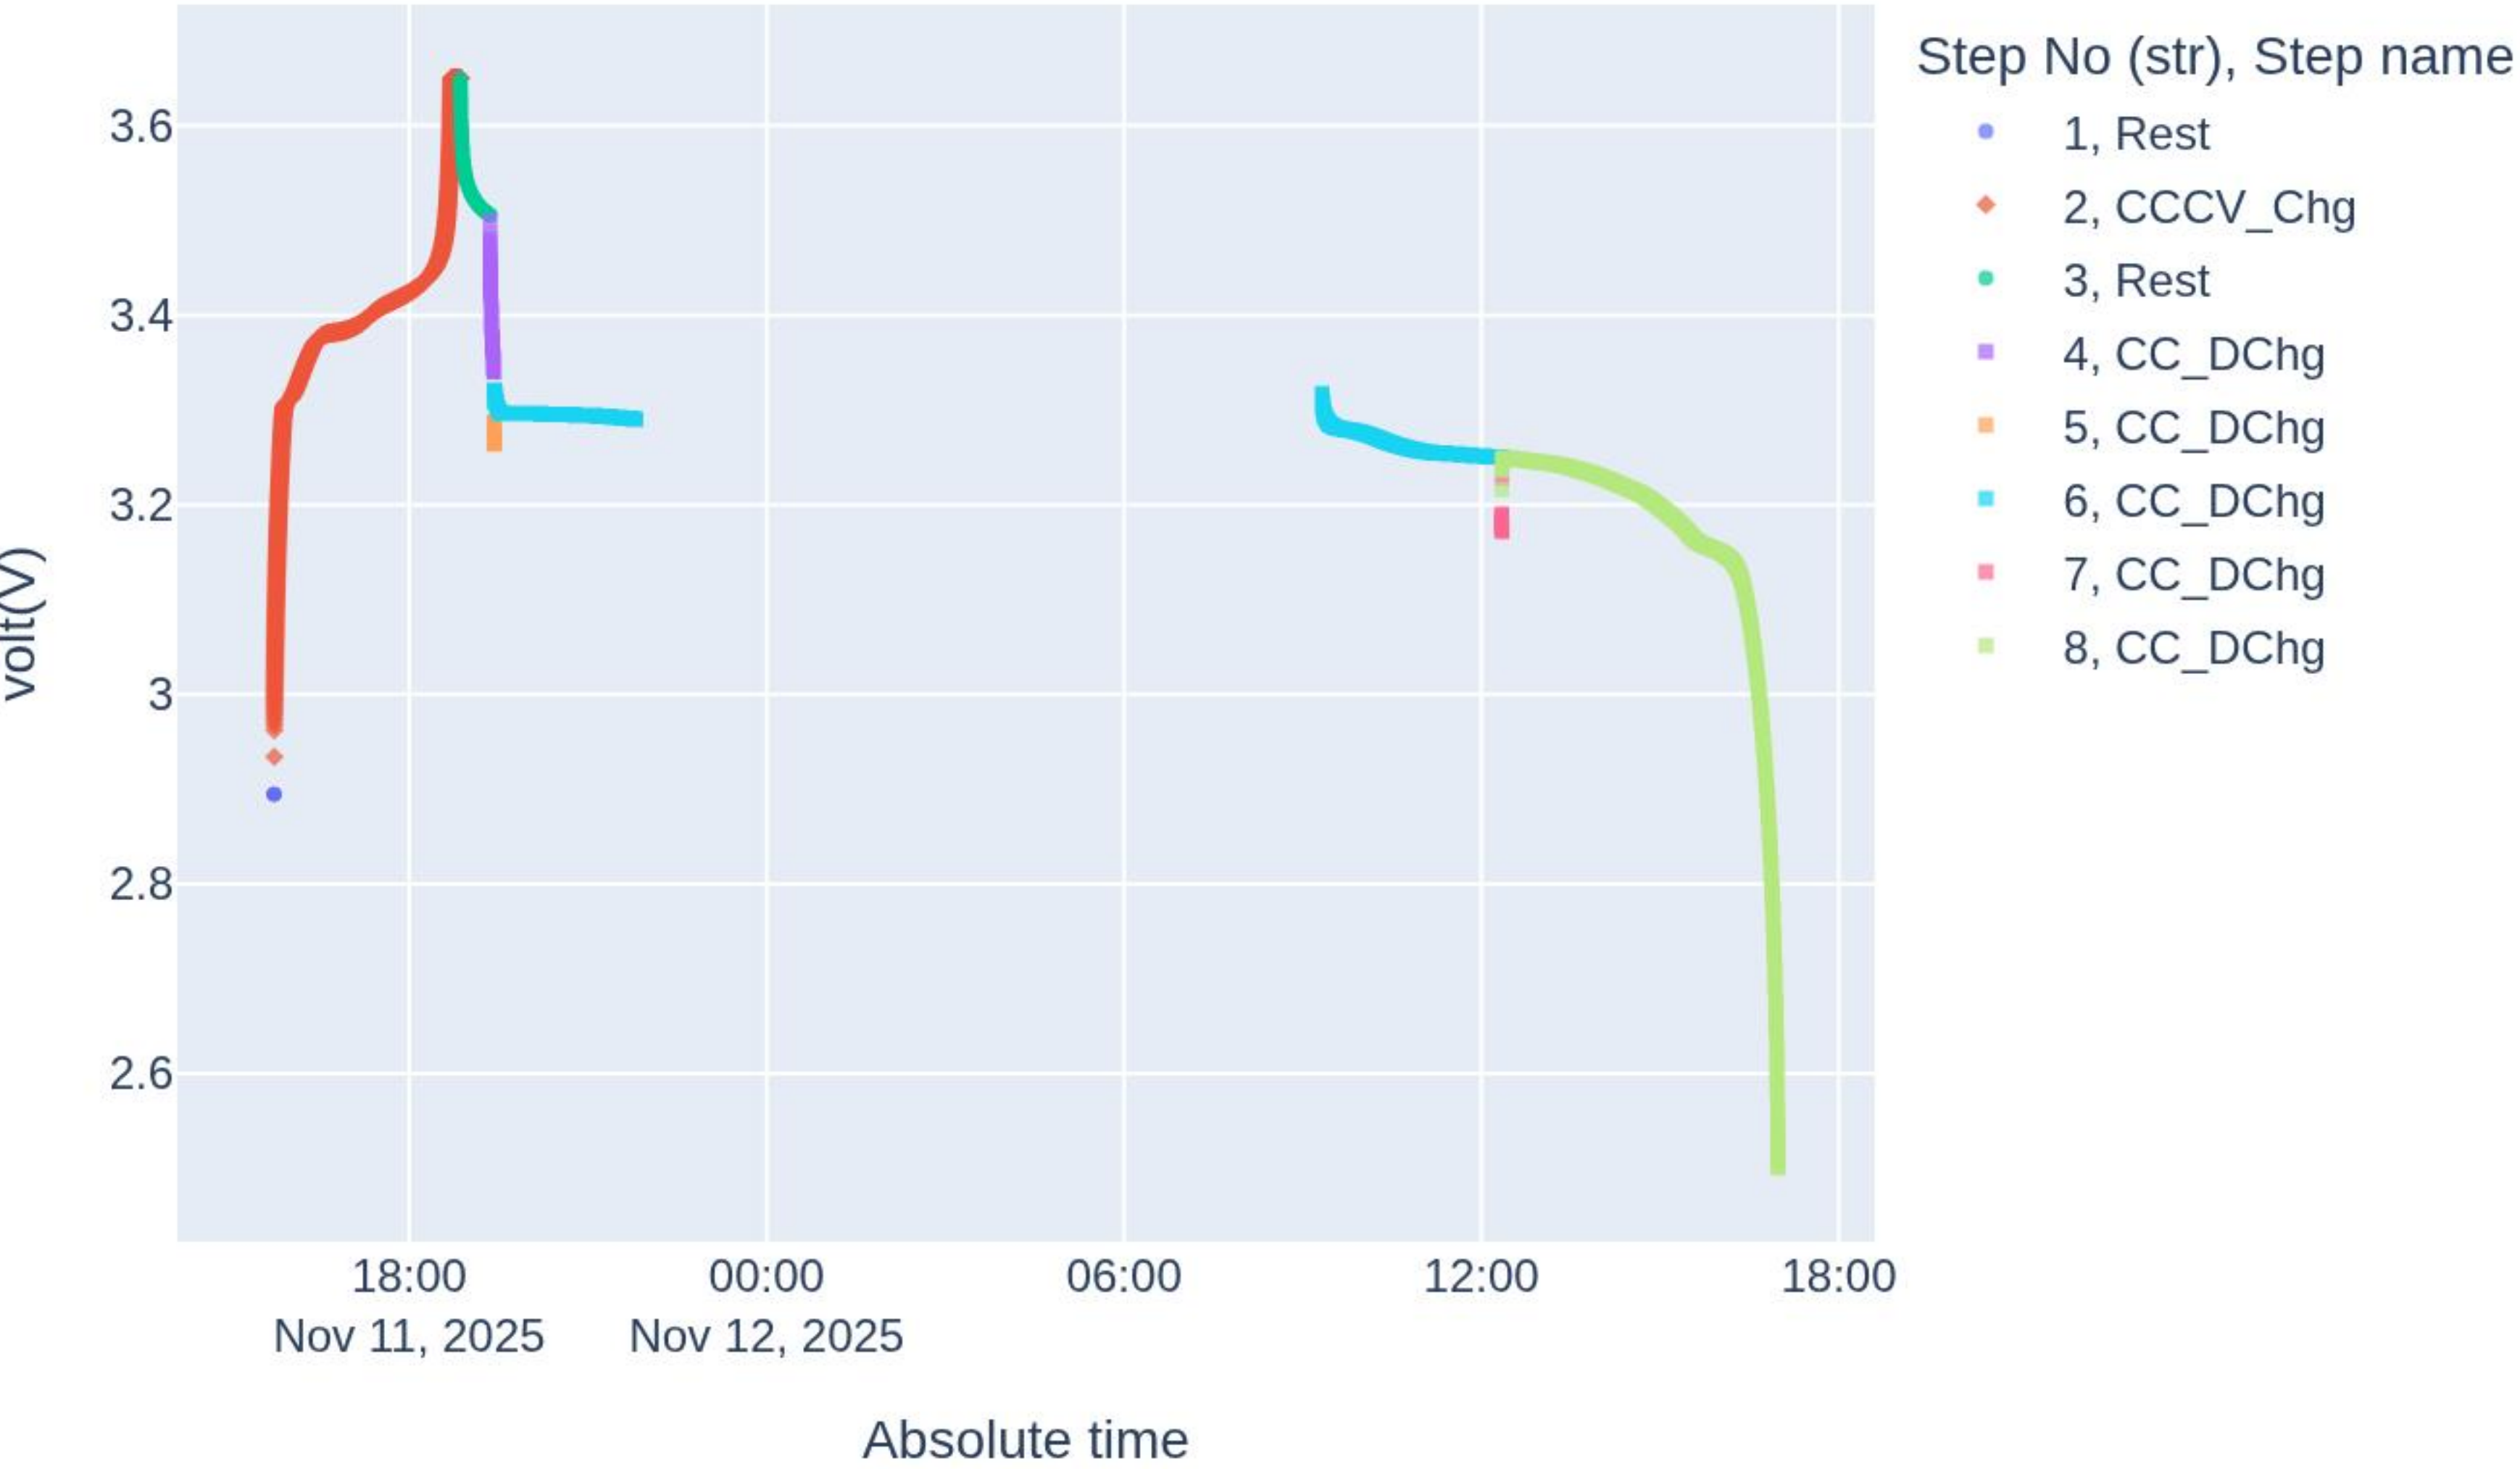


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0314_0_100.csv

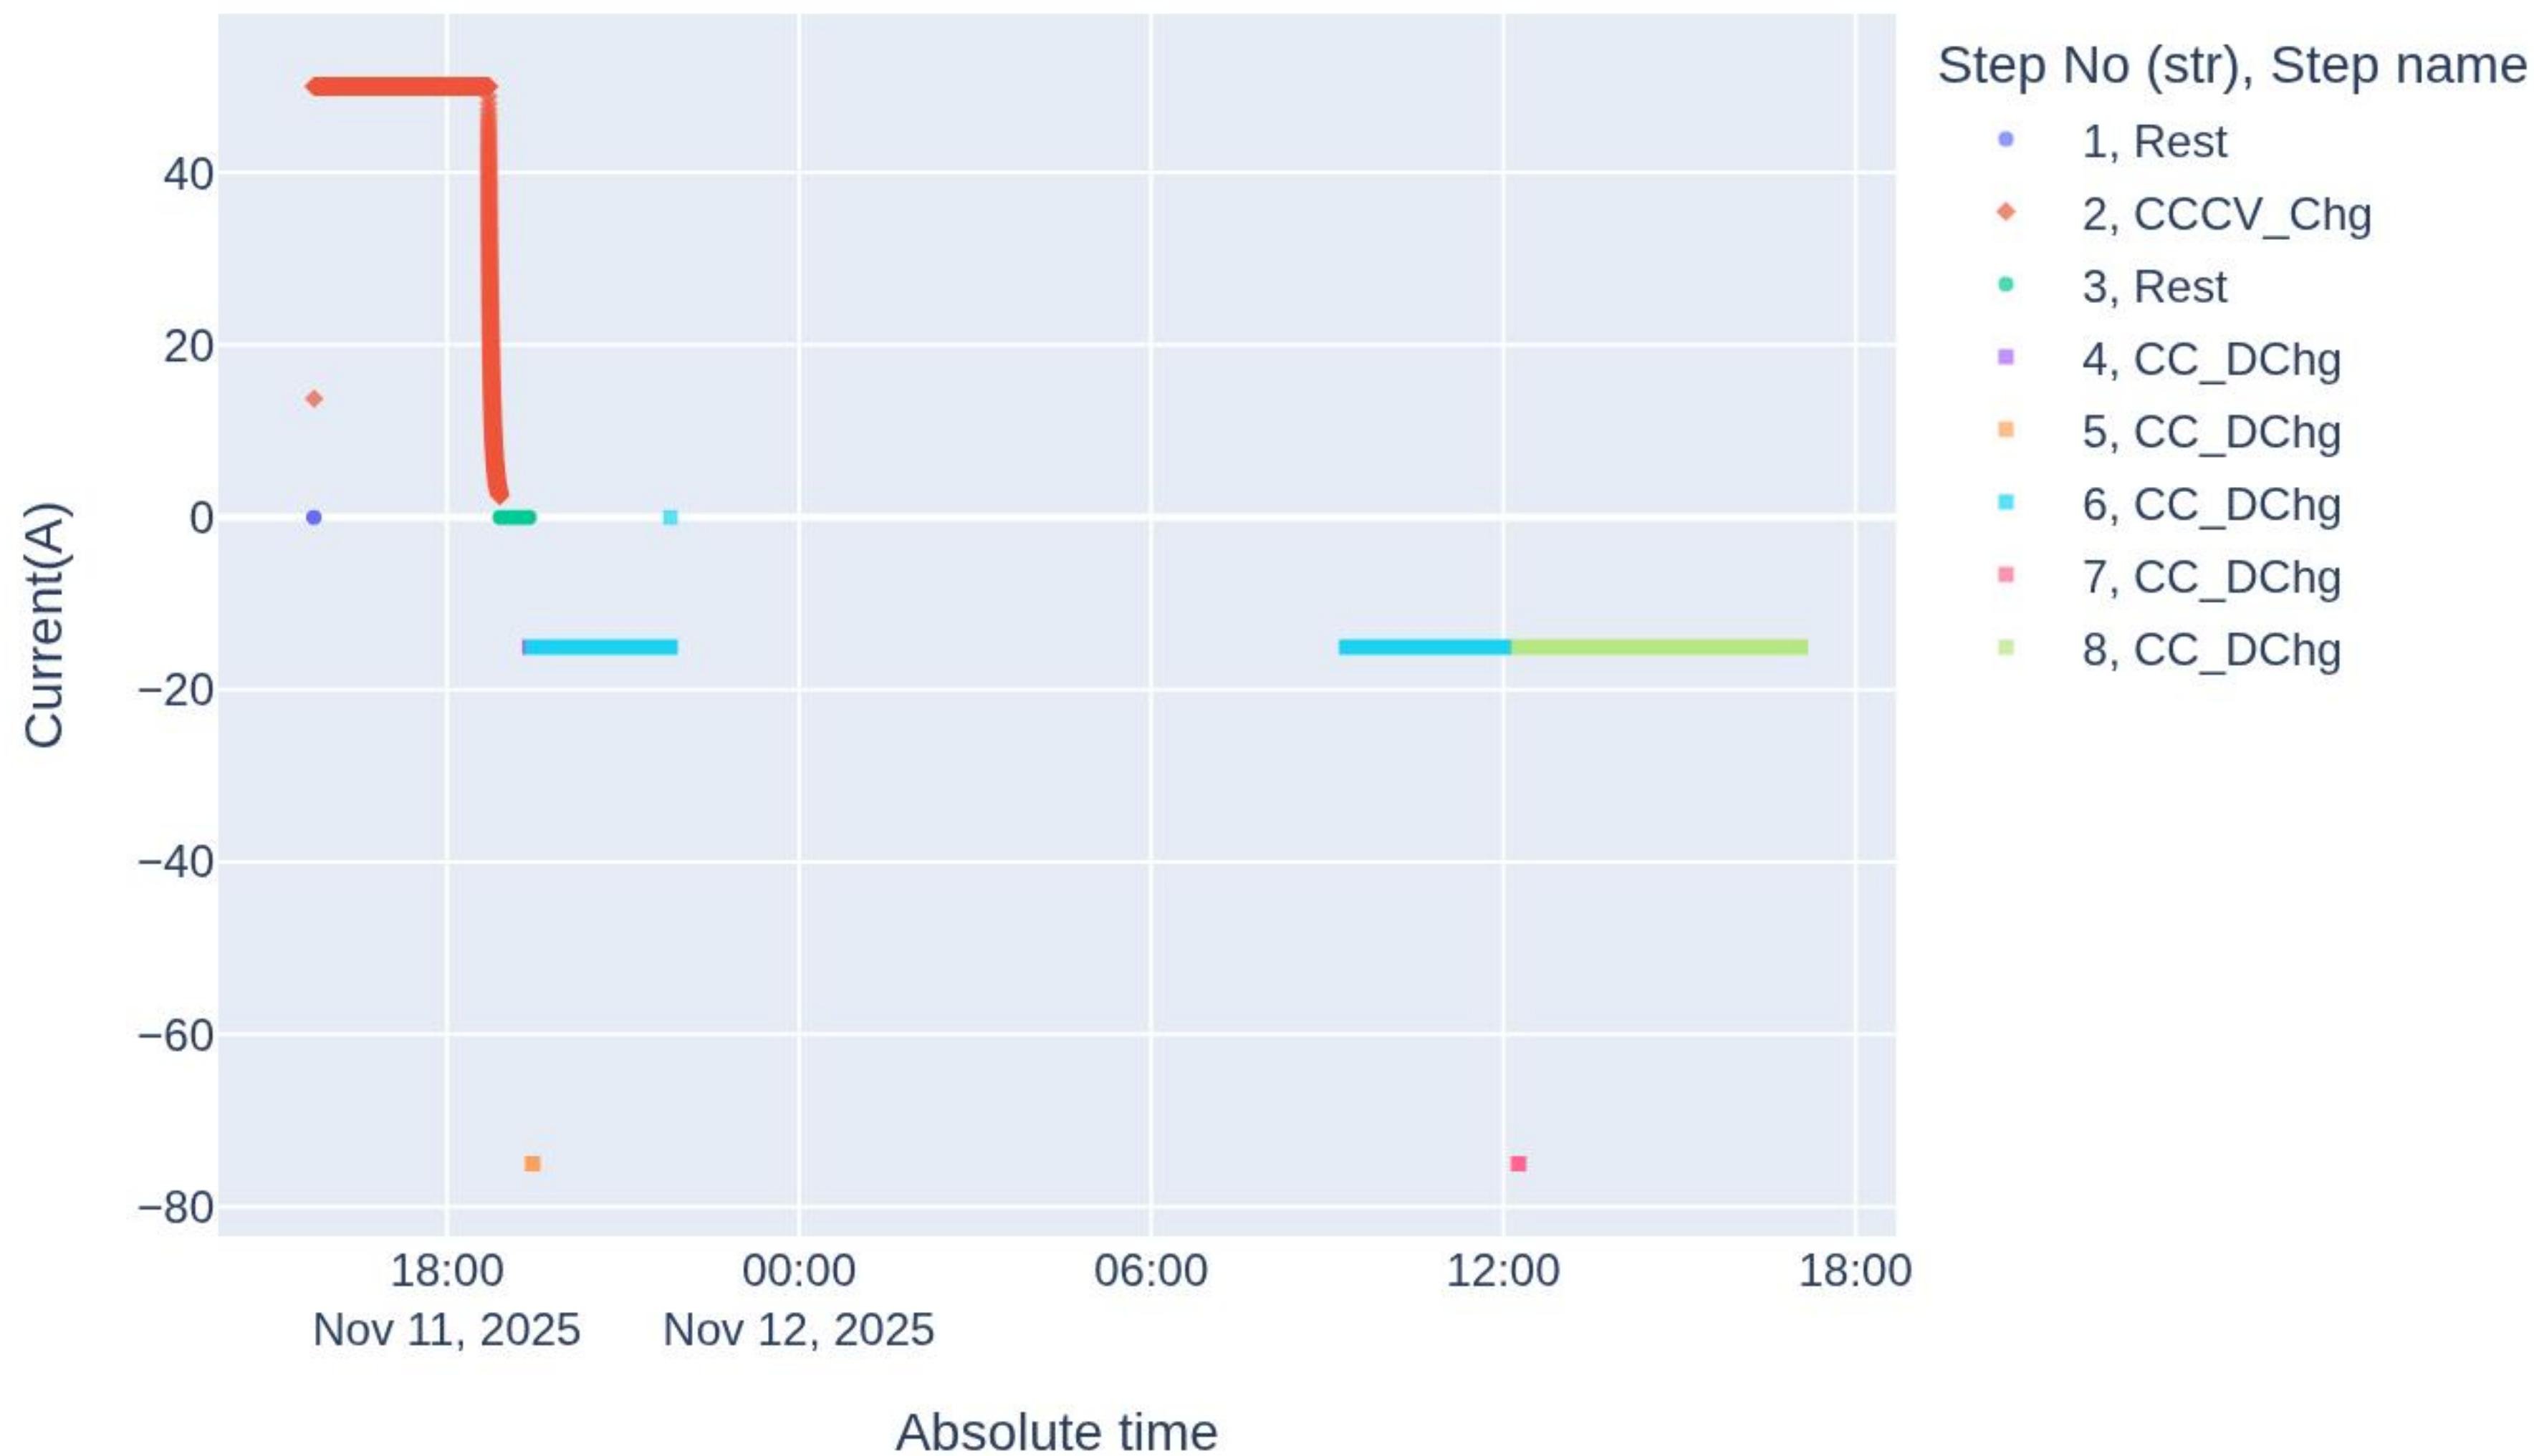


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0314_0_100.csv

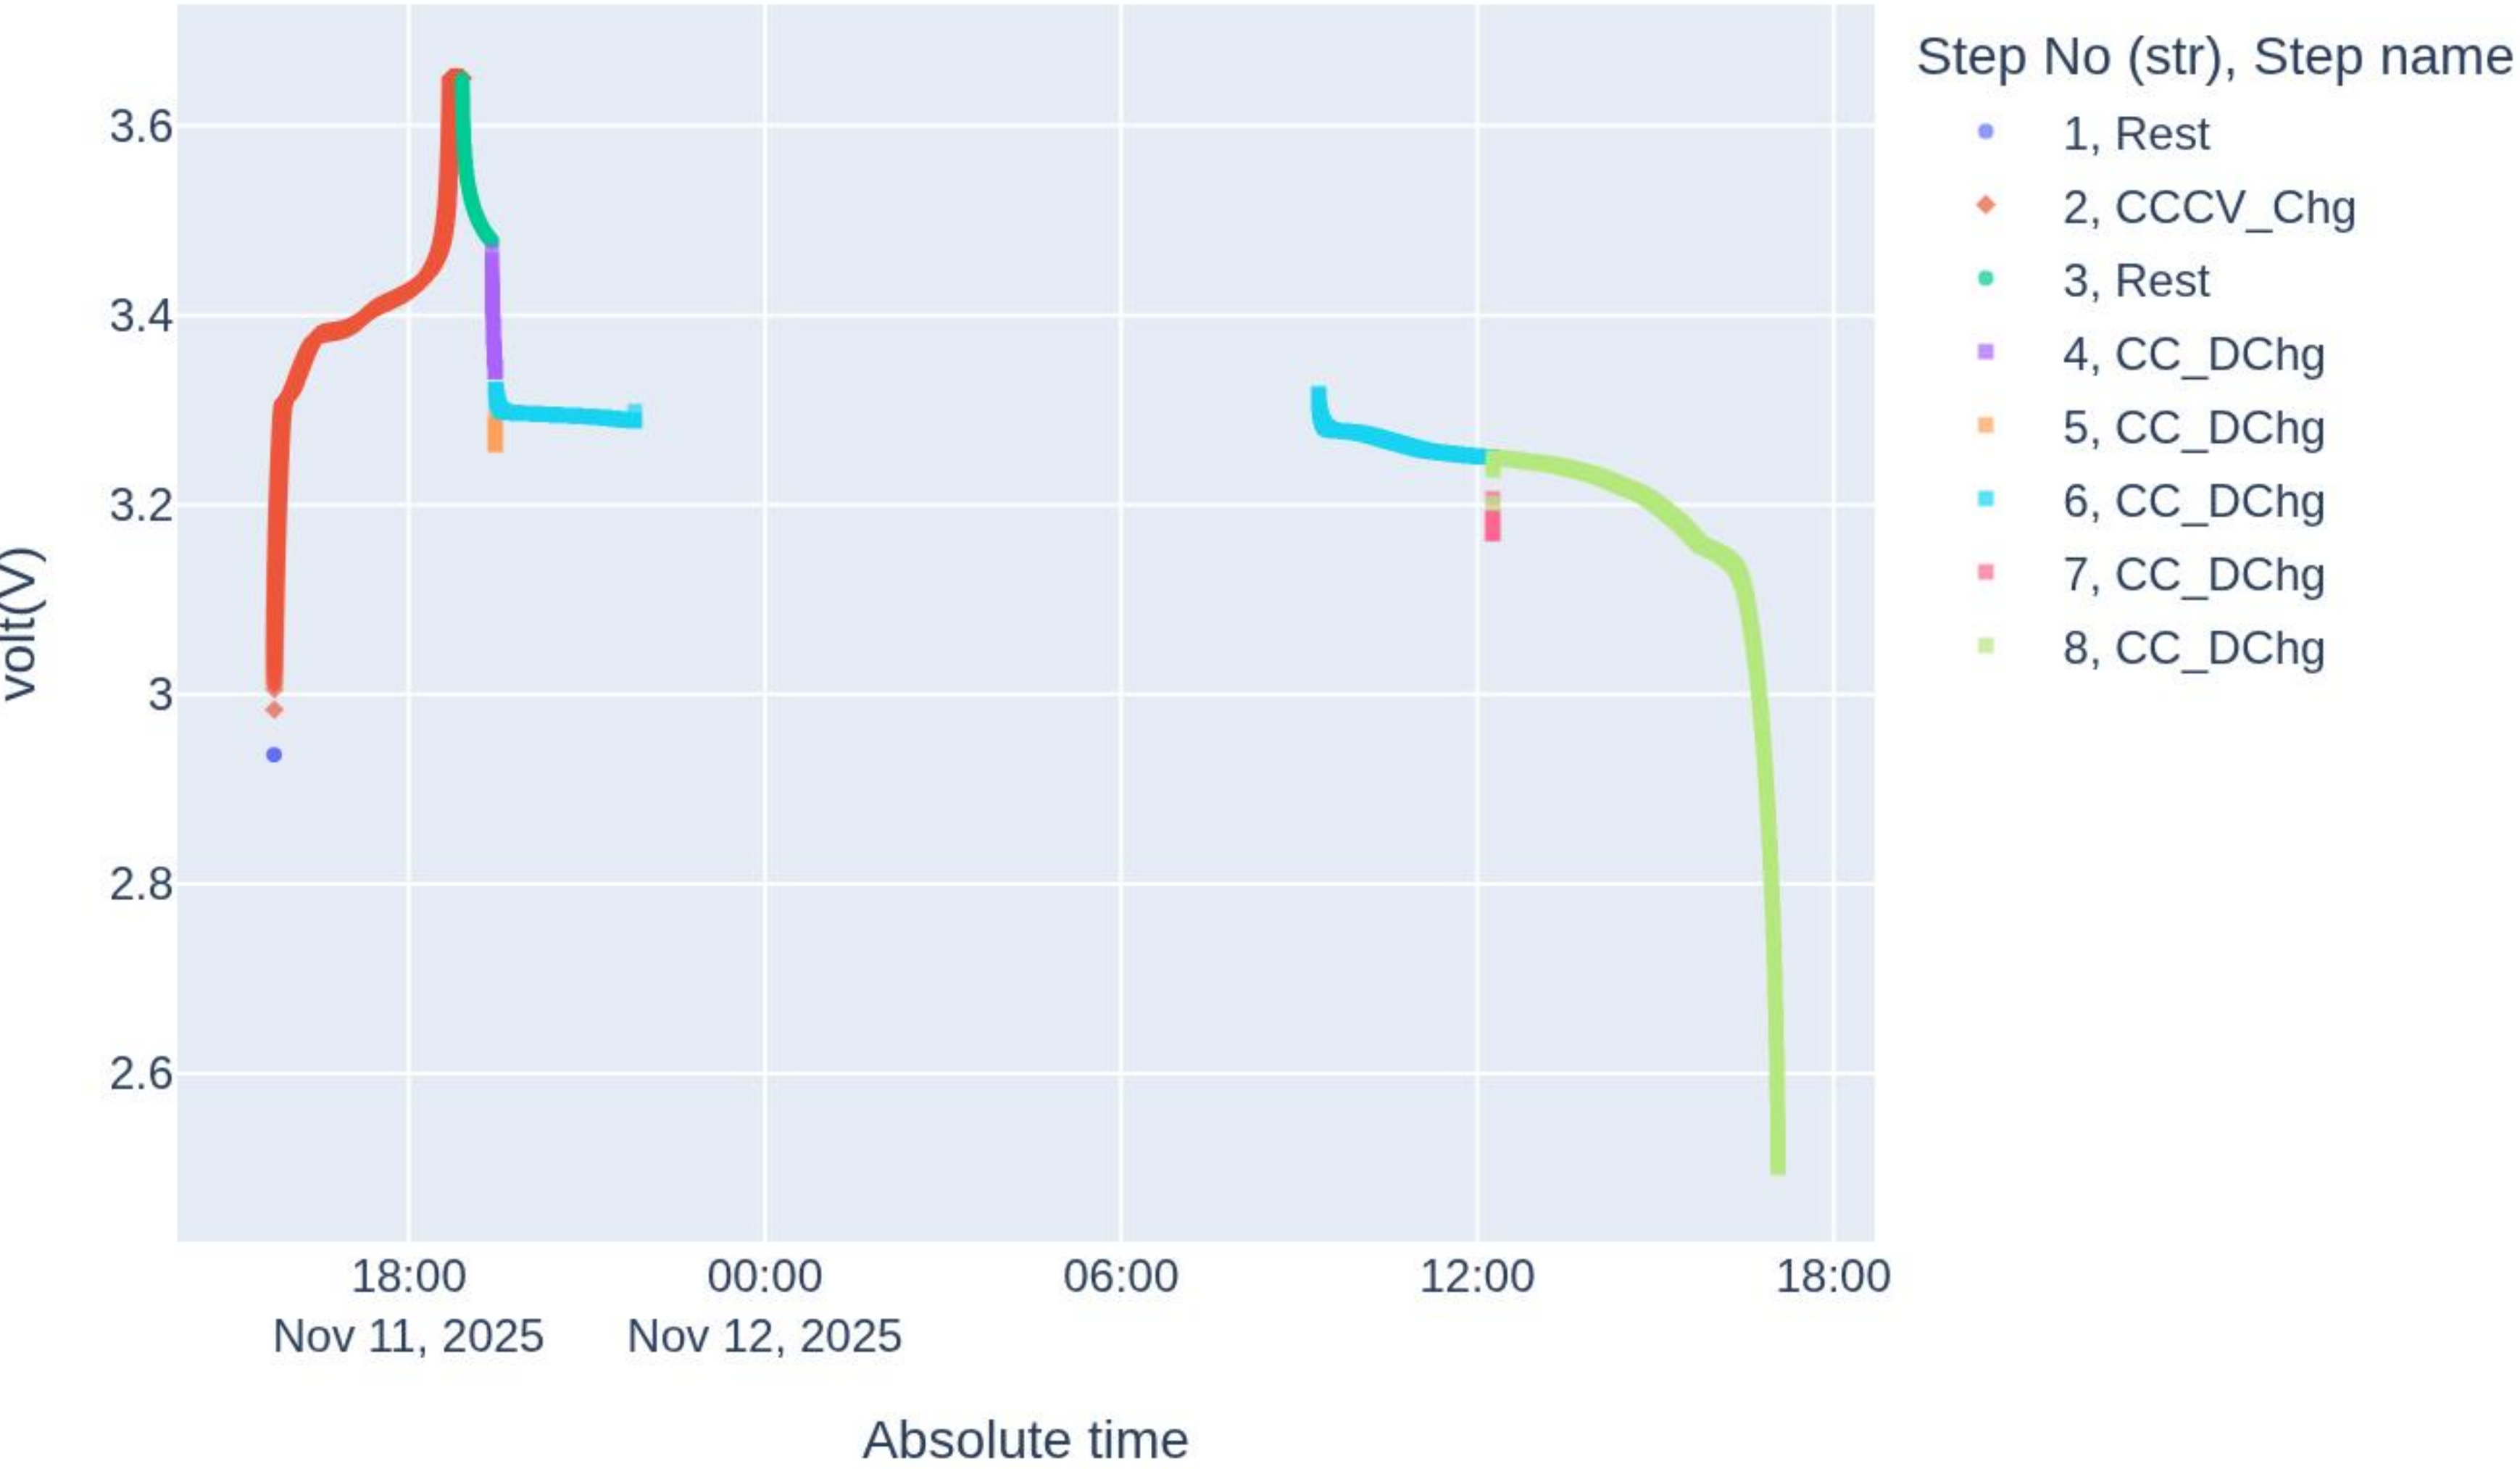


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0315_0_100.csv

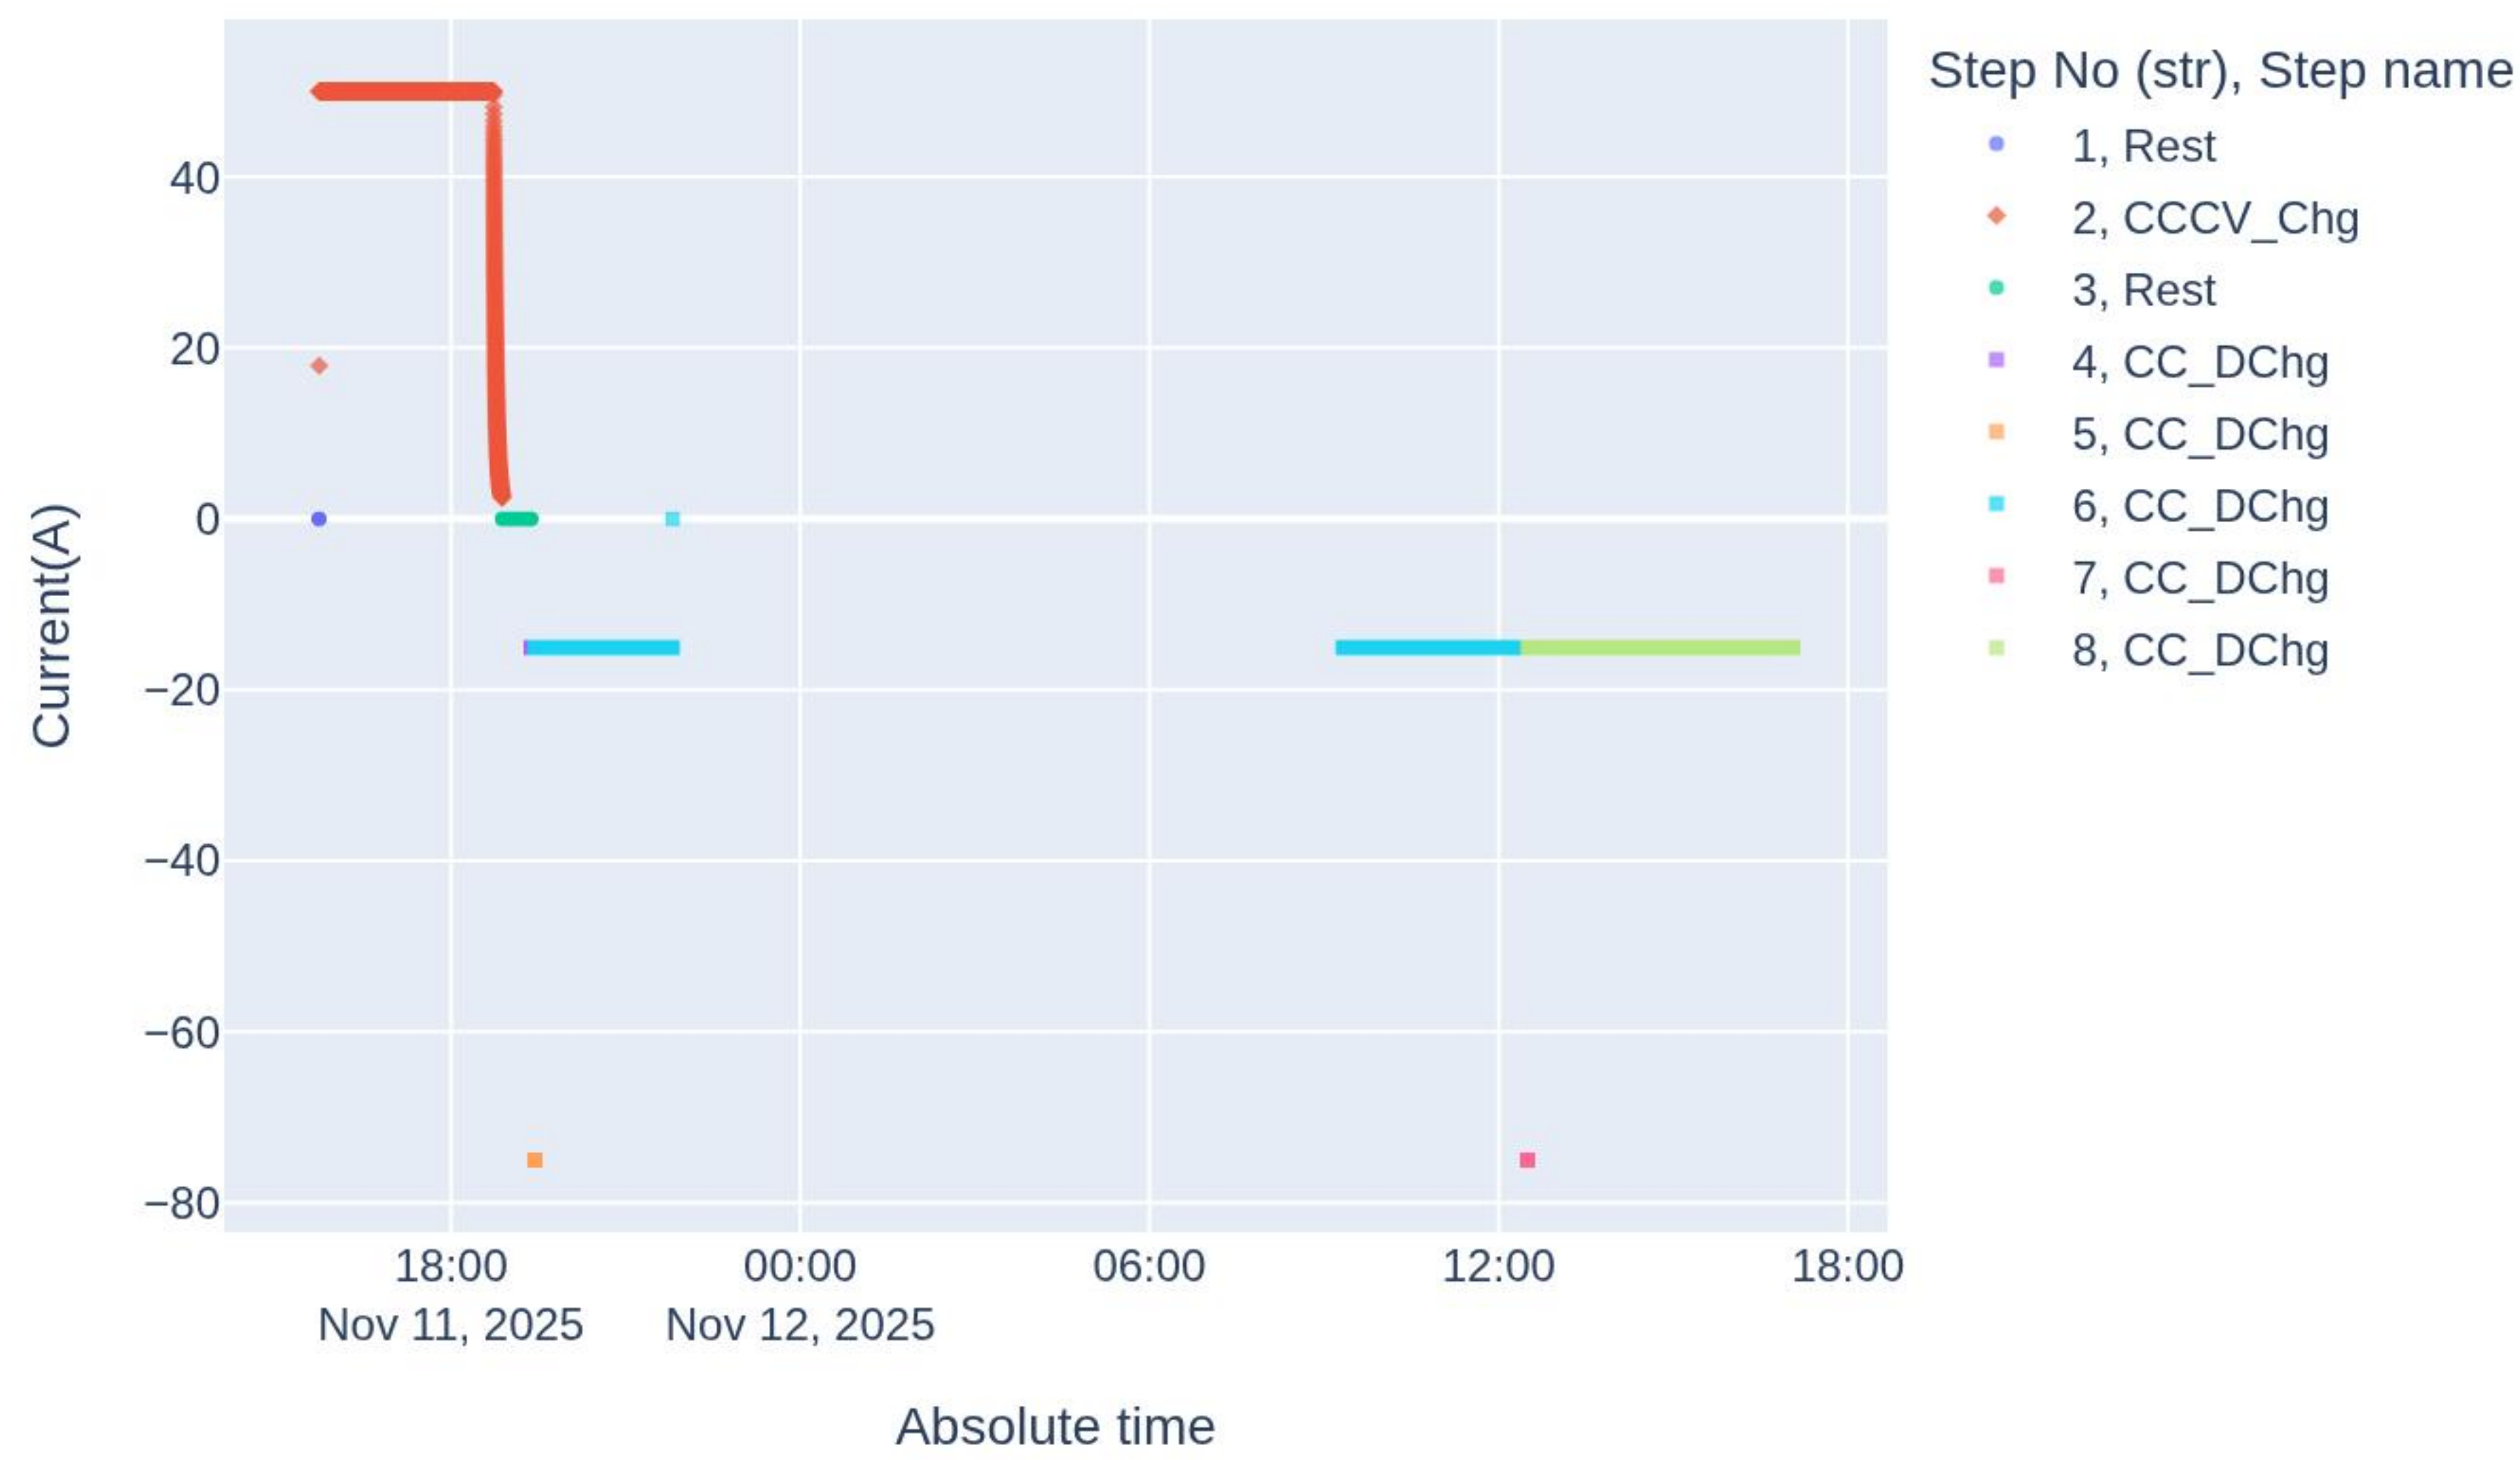


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0315_0_100.csv

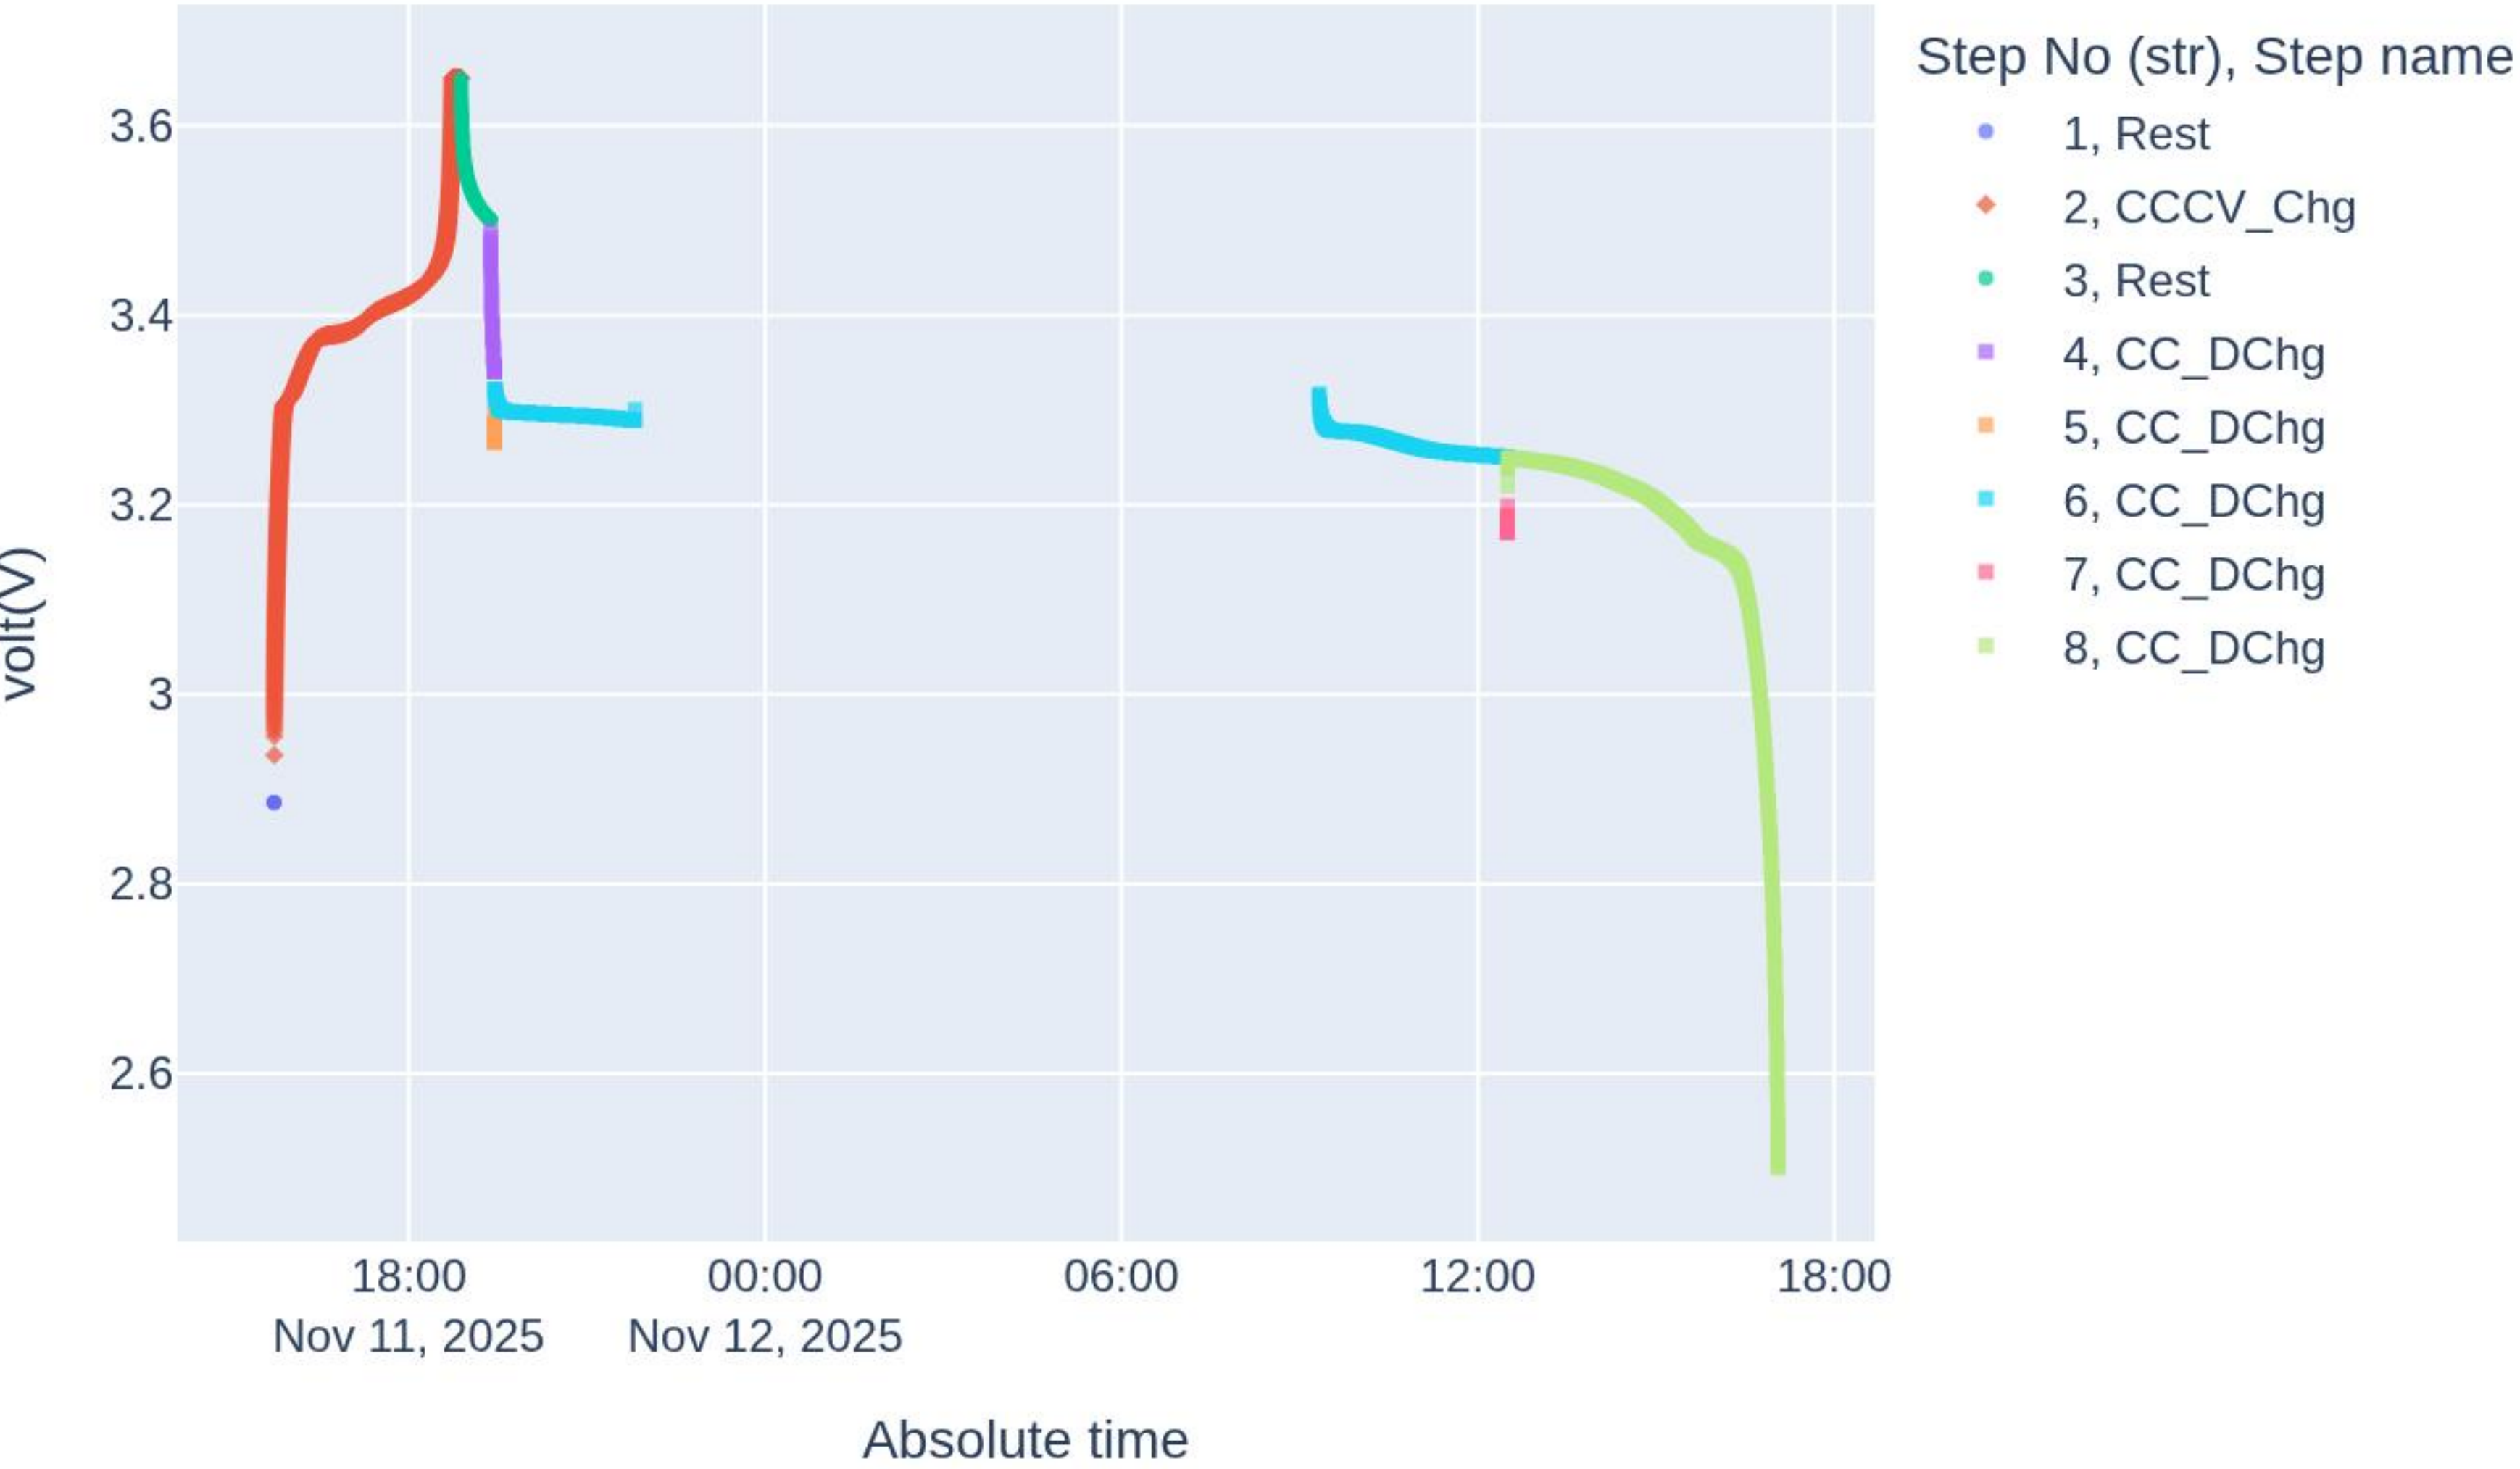


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0316_0_100.csv

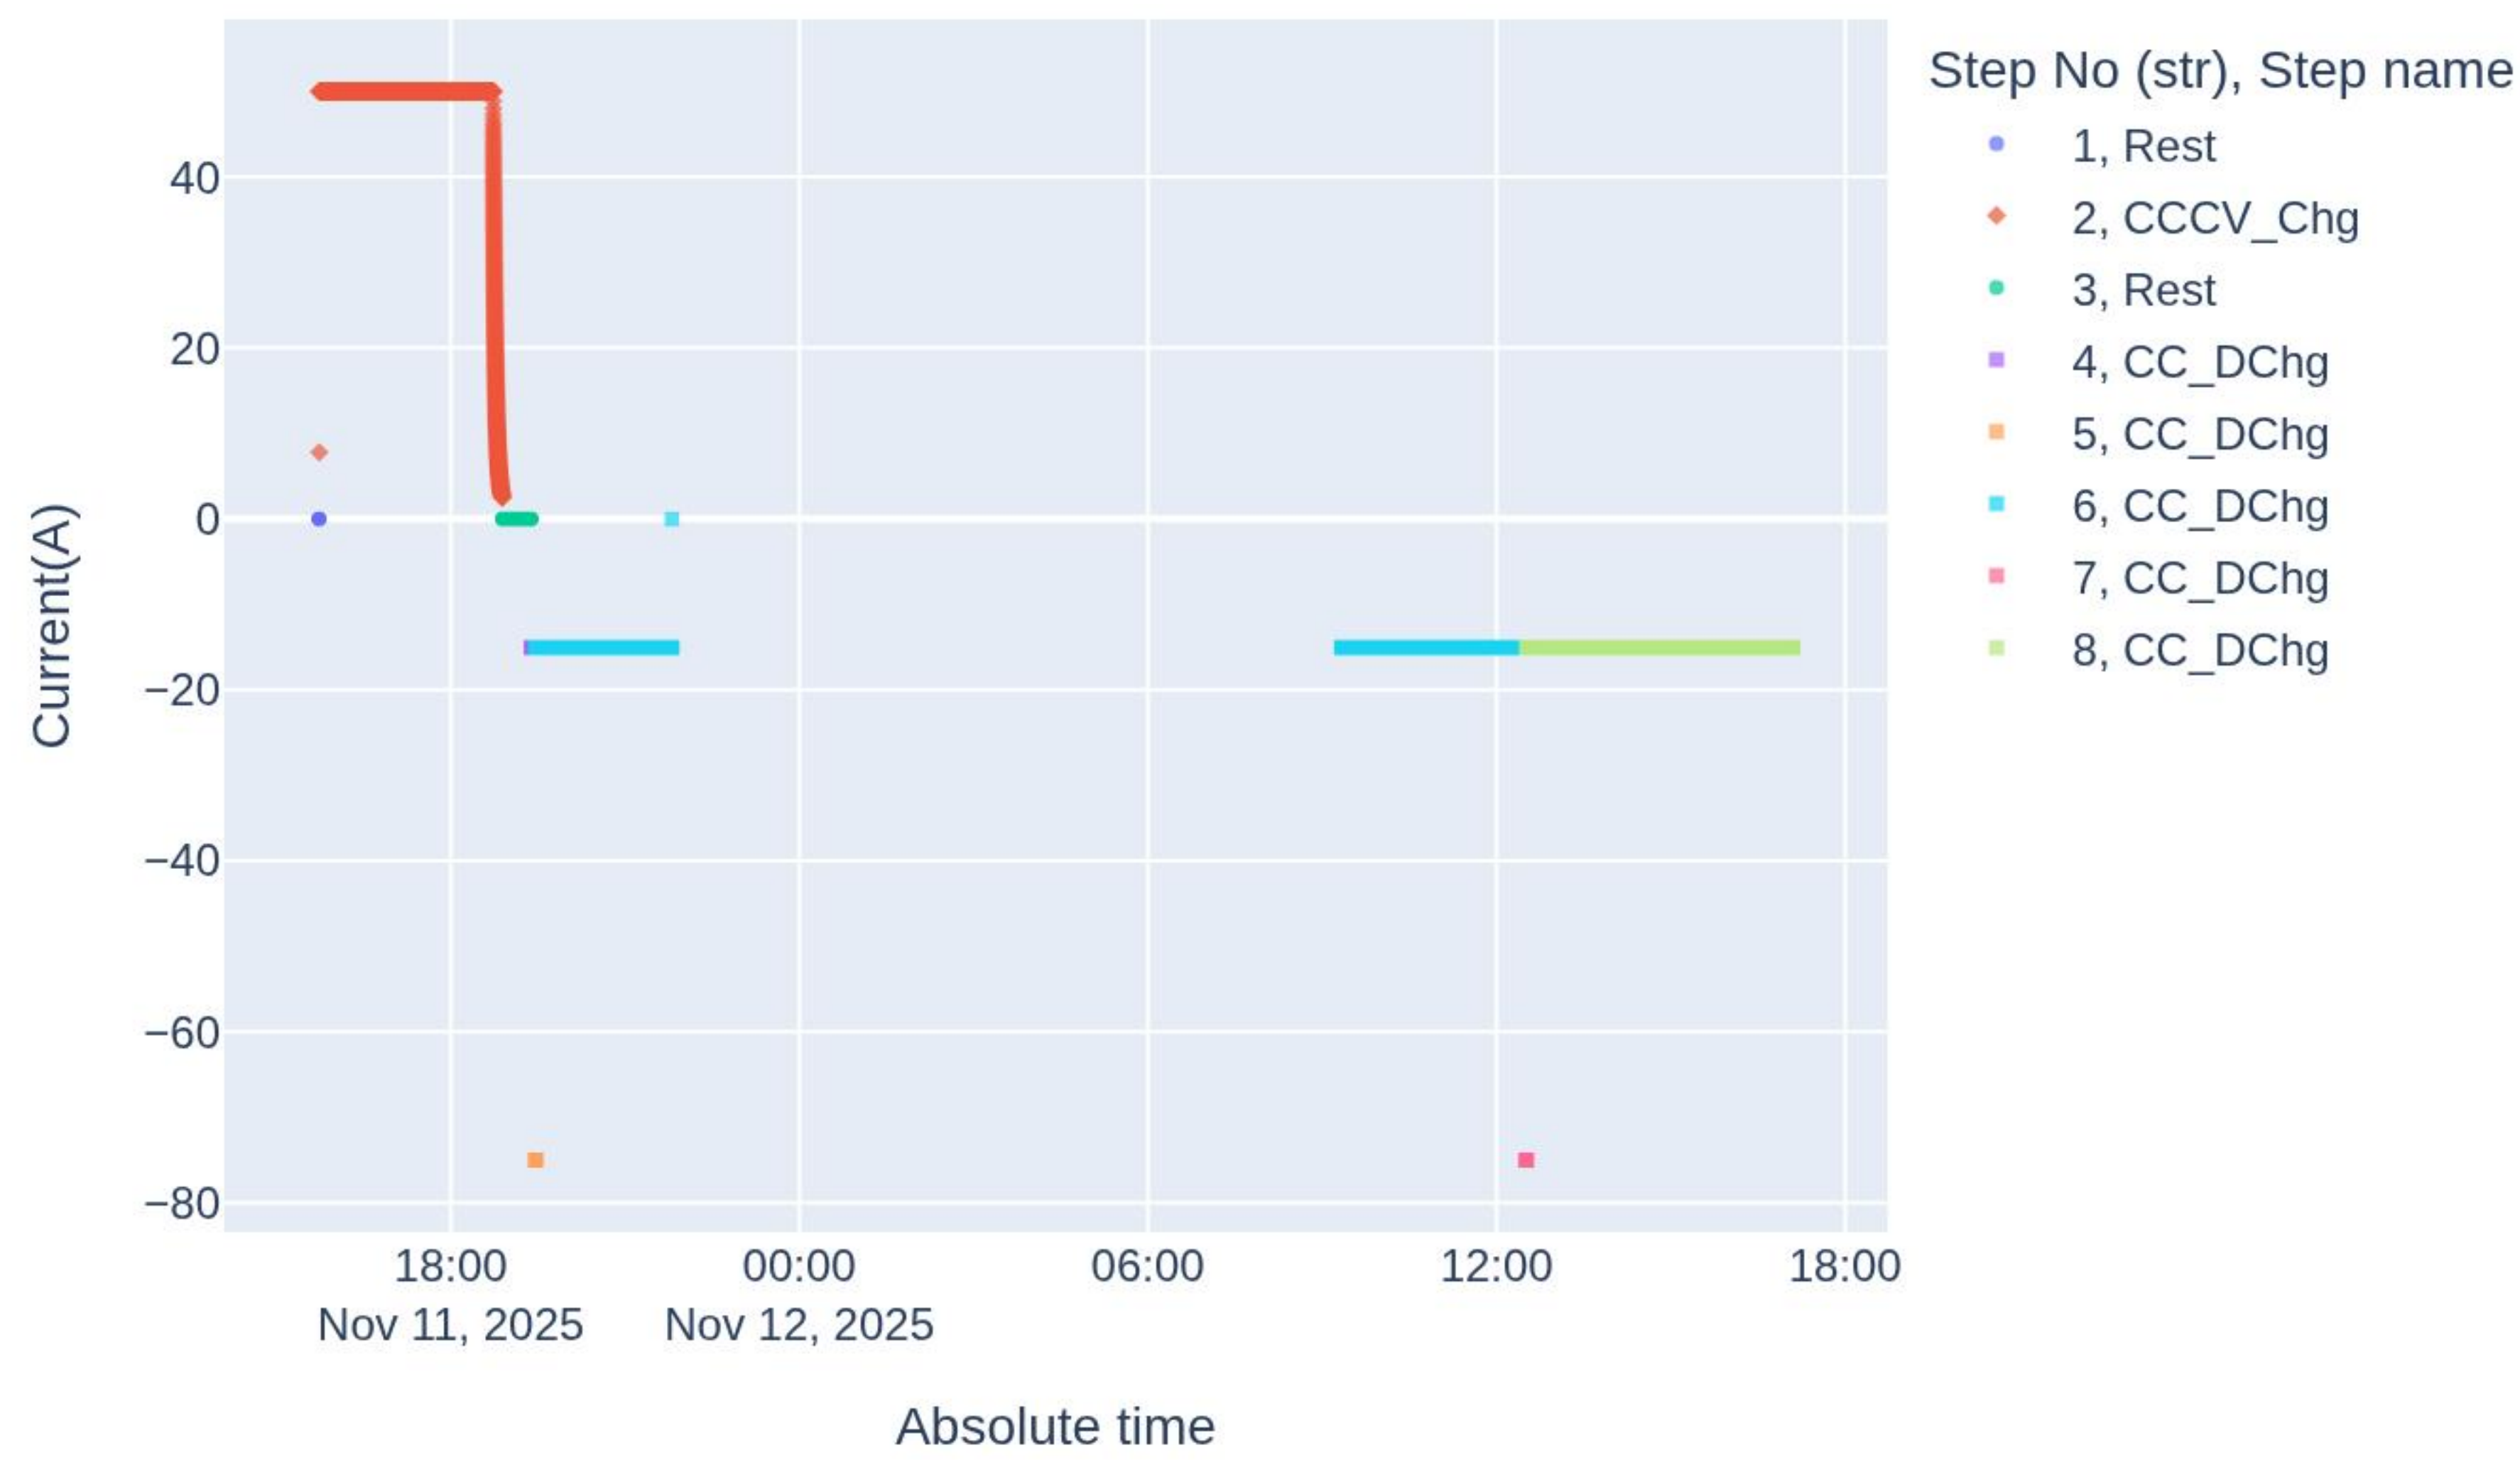


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0316_0_100.csv

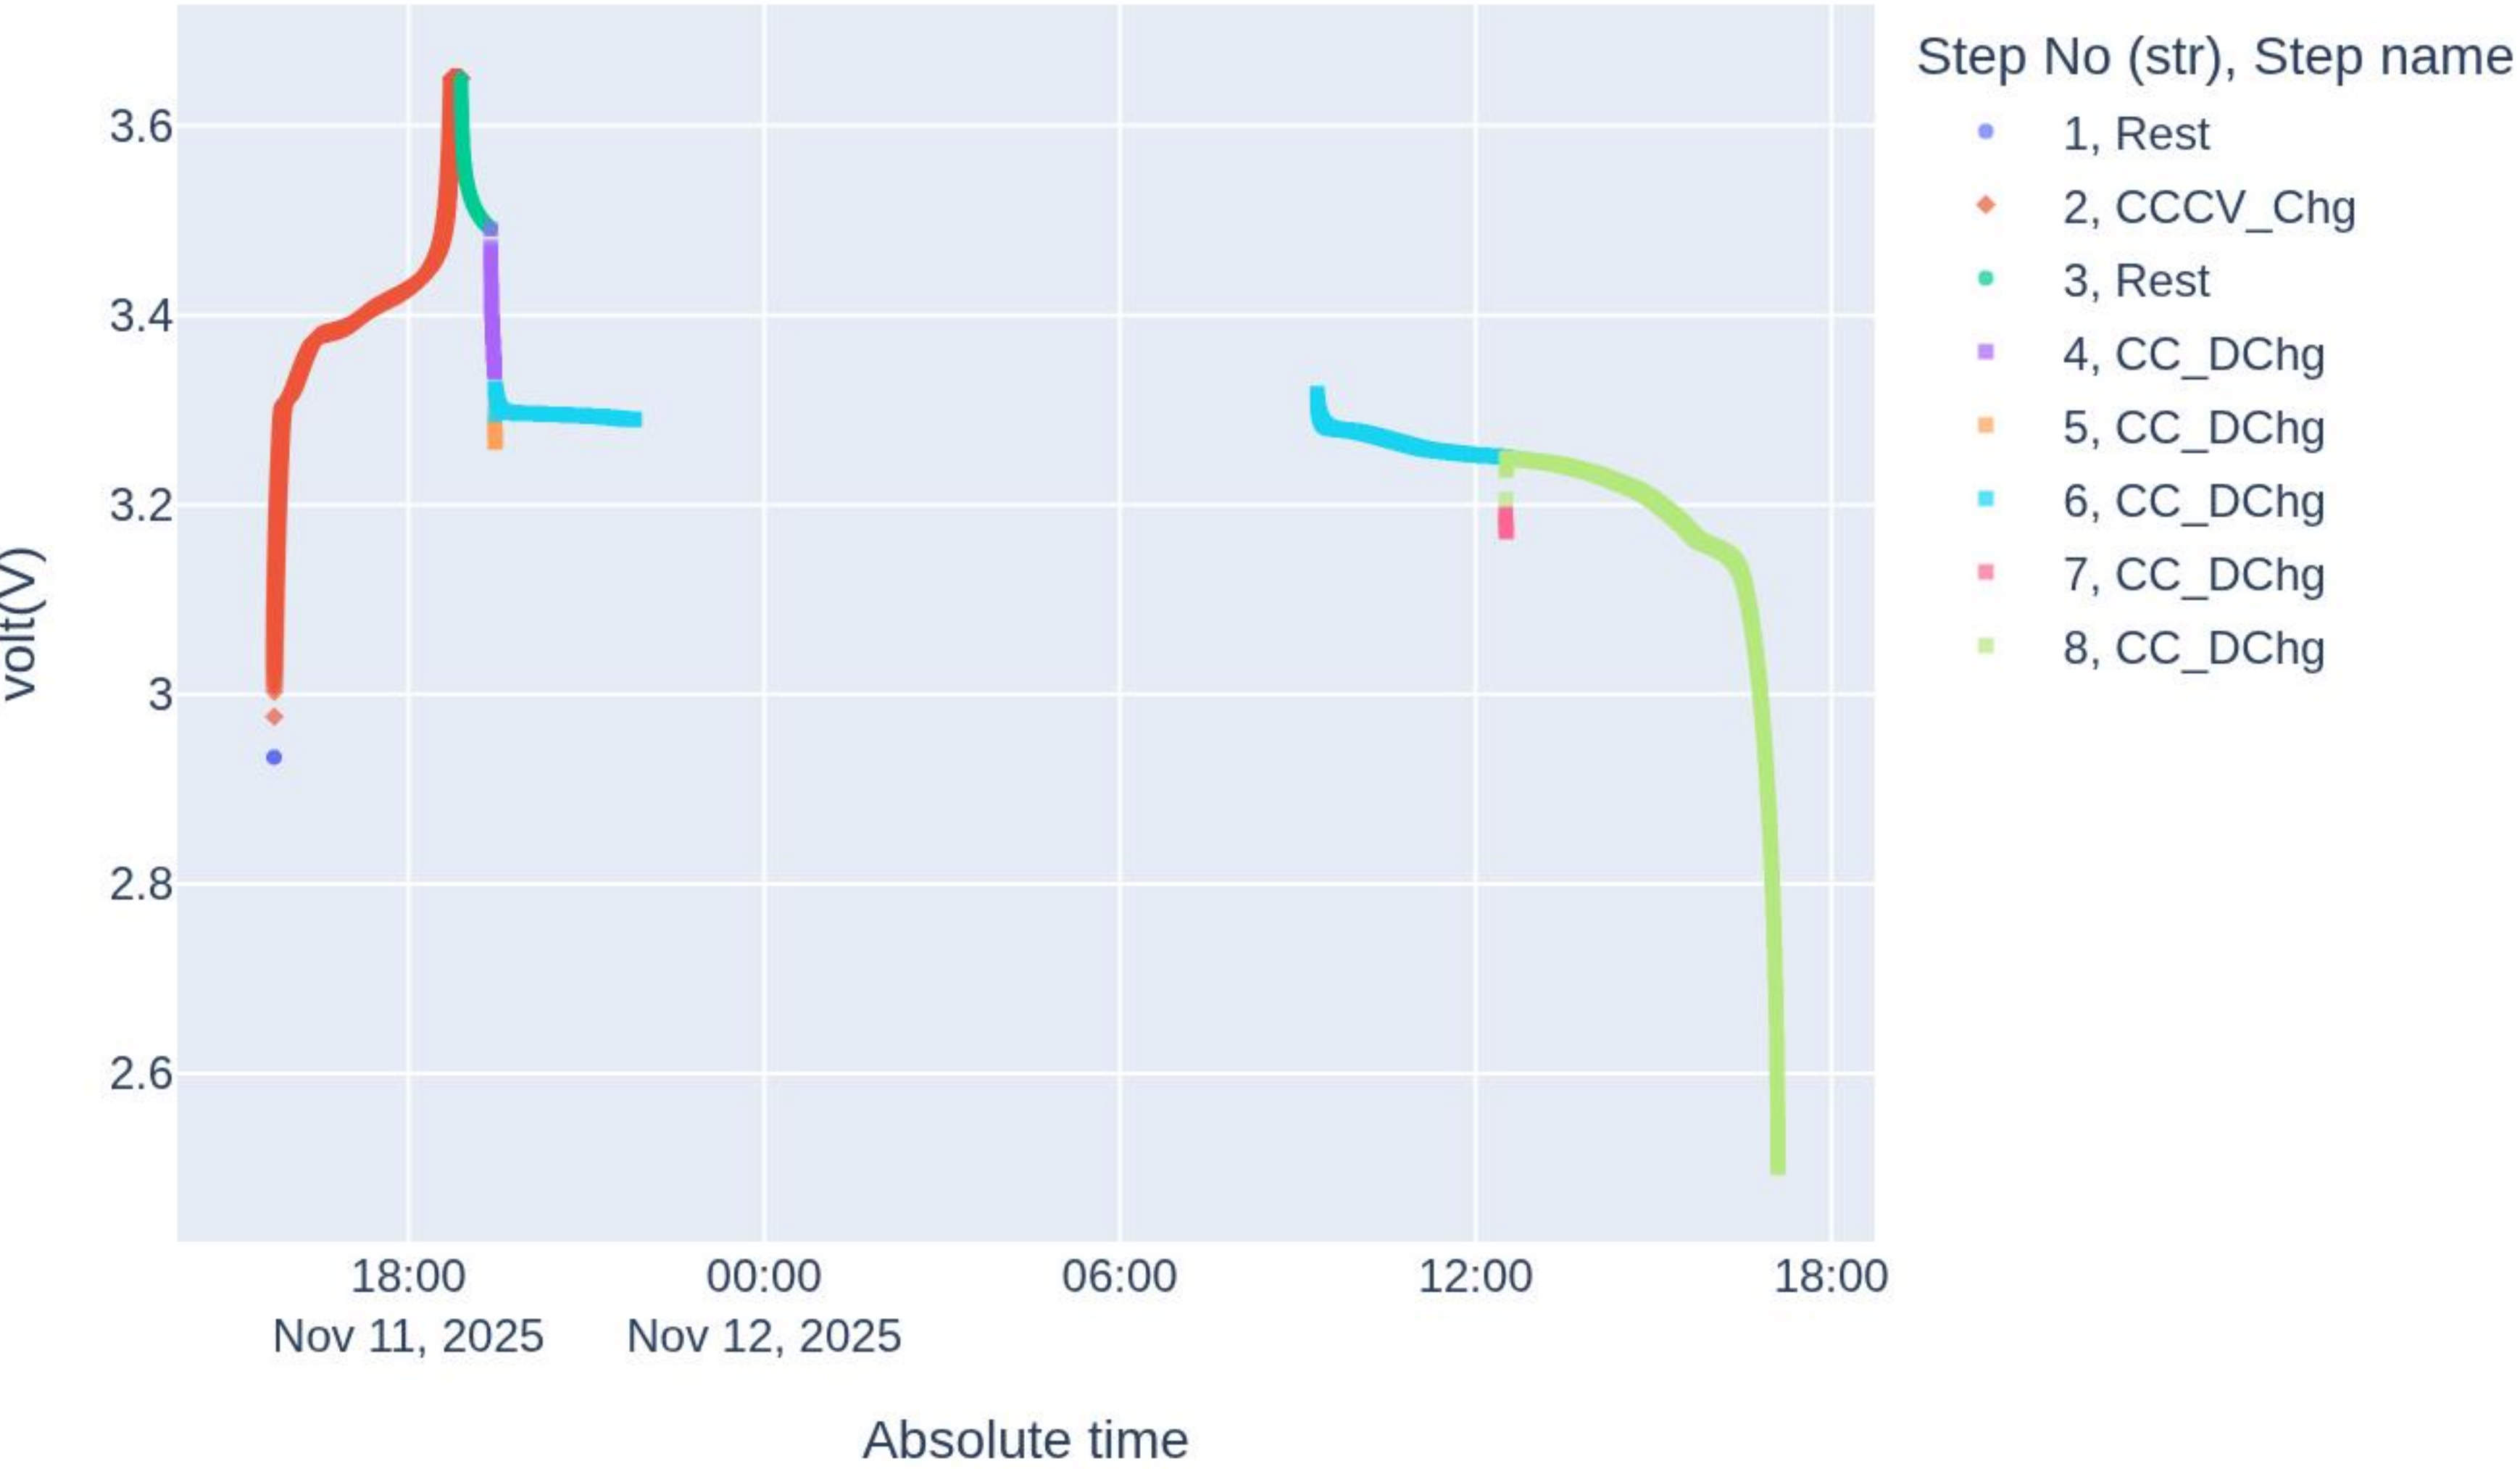


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0317_0_100.csv

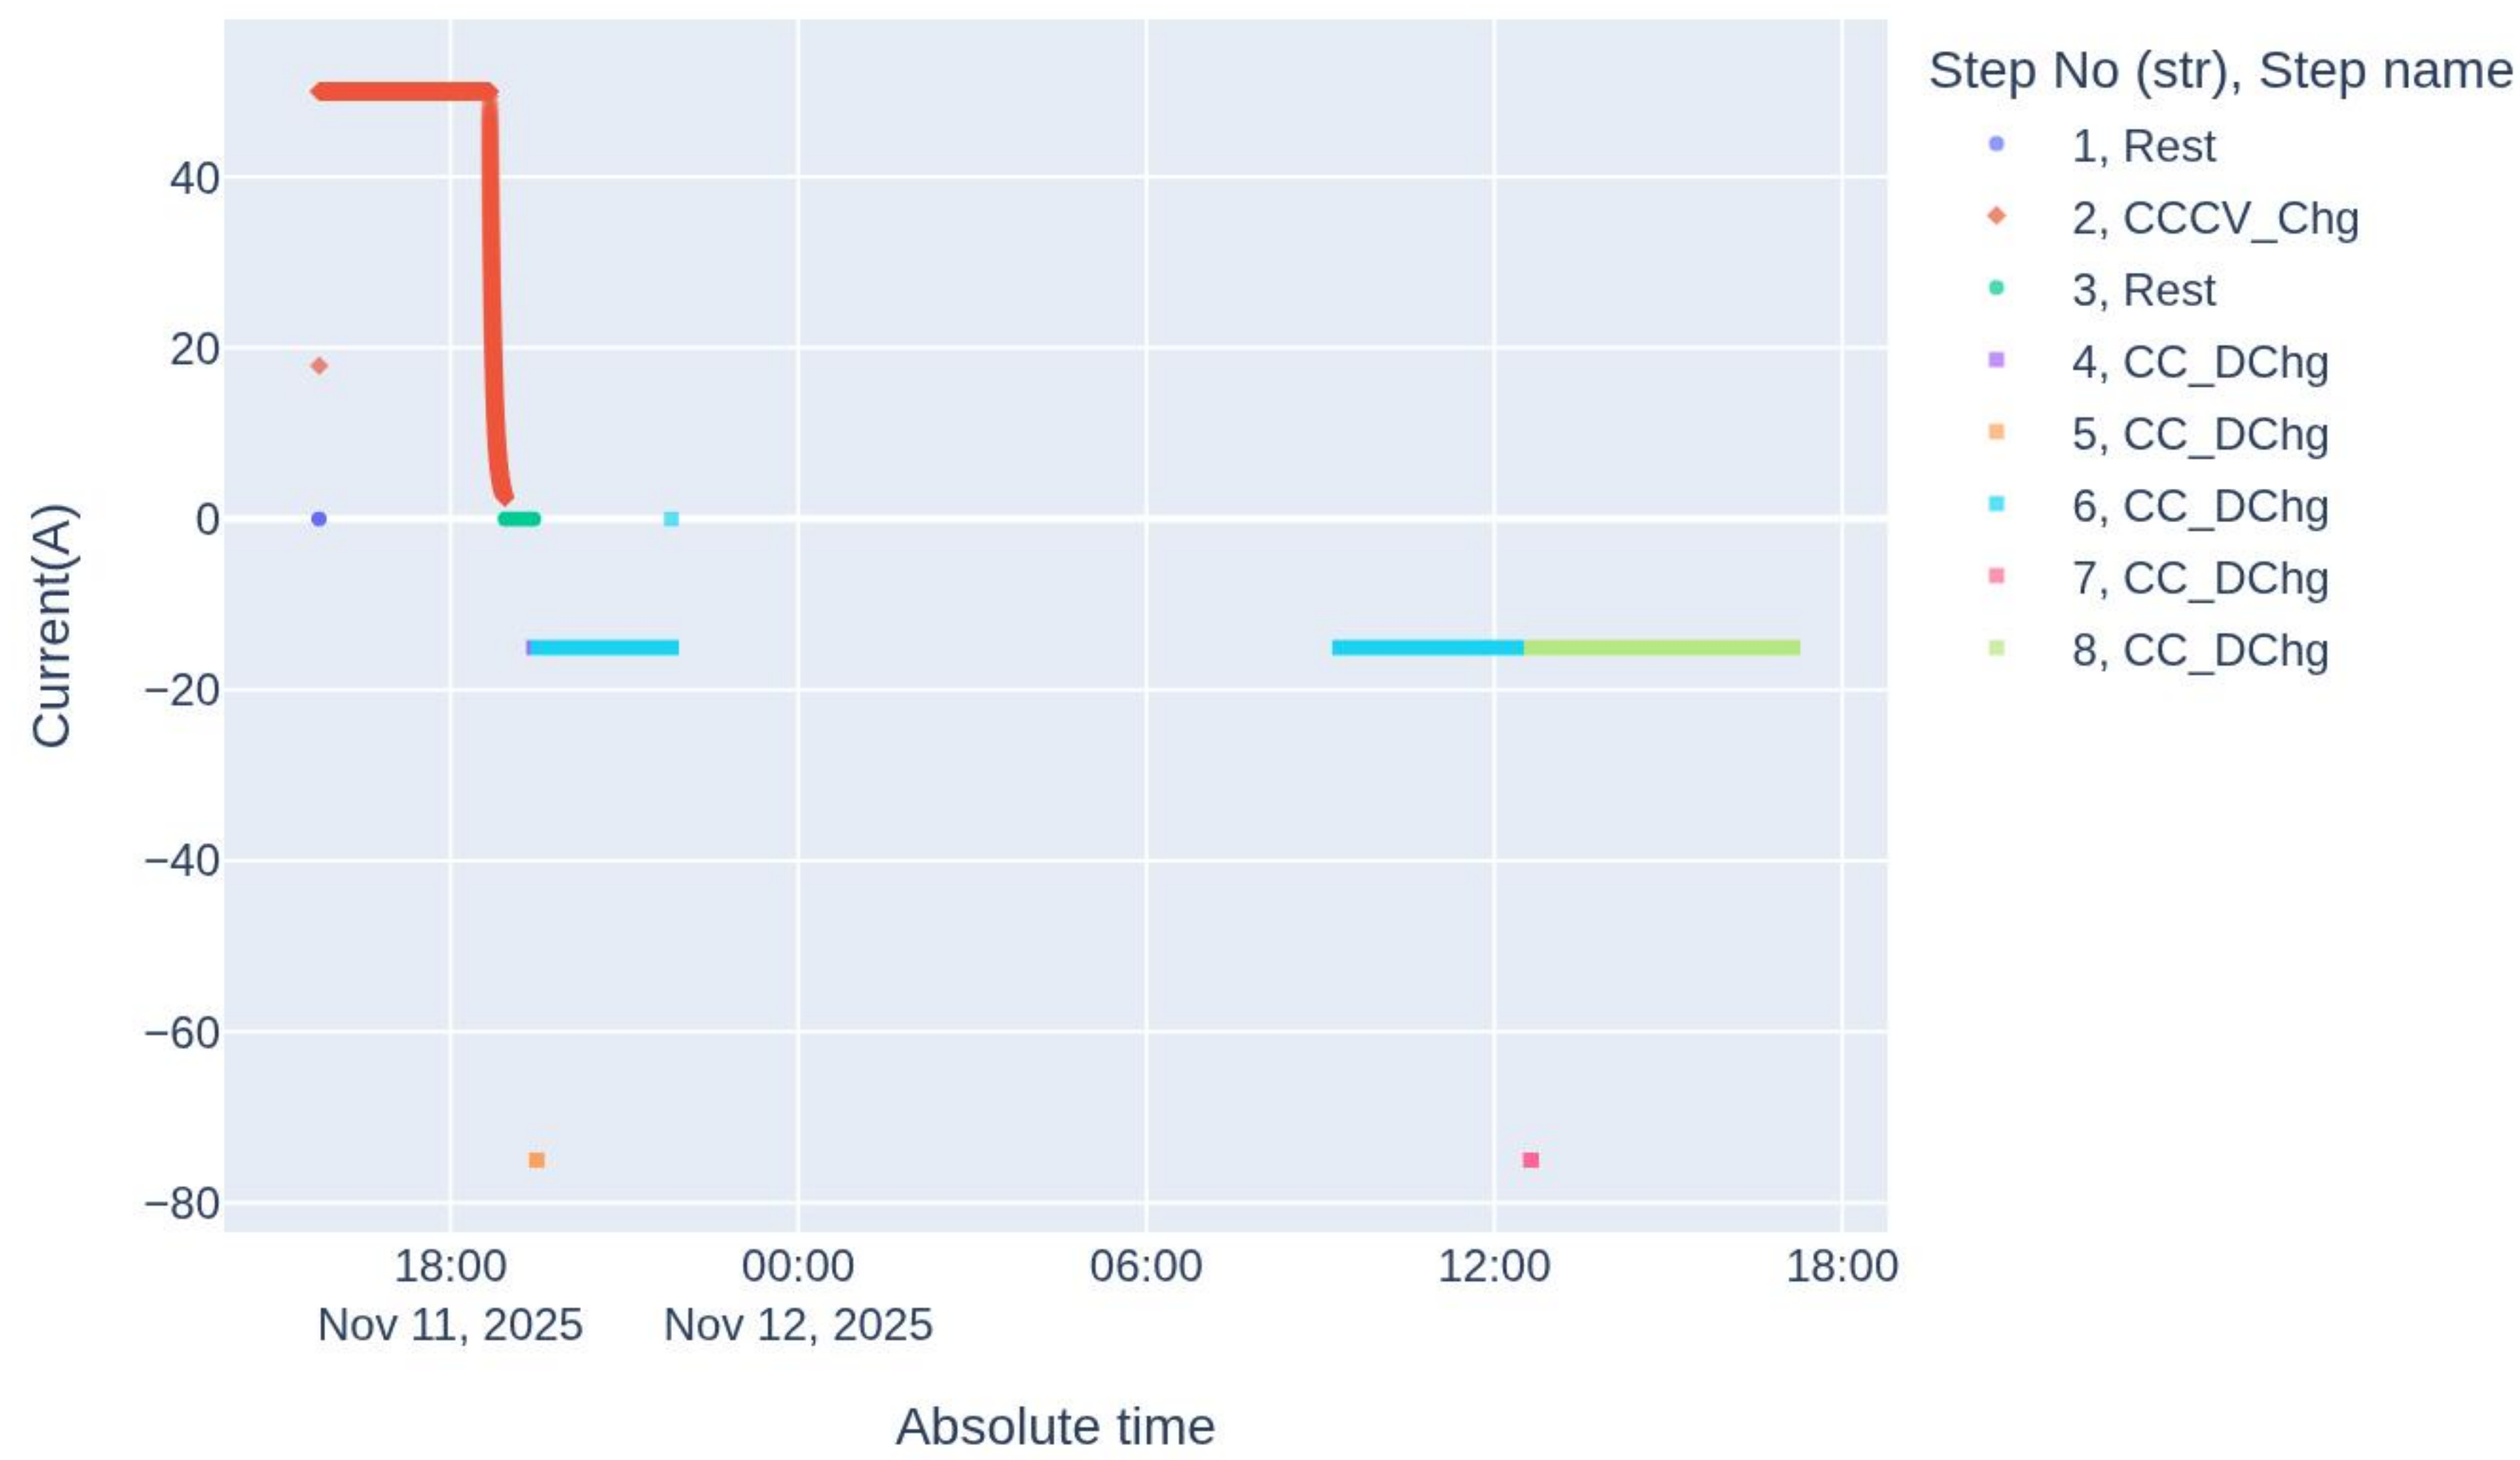


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0317_0_100.csv

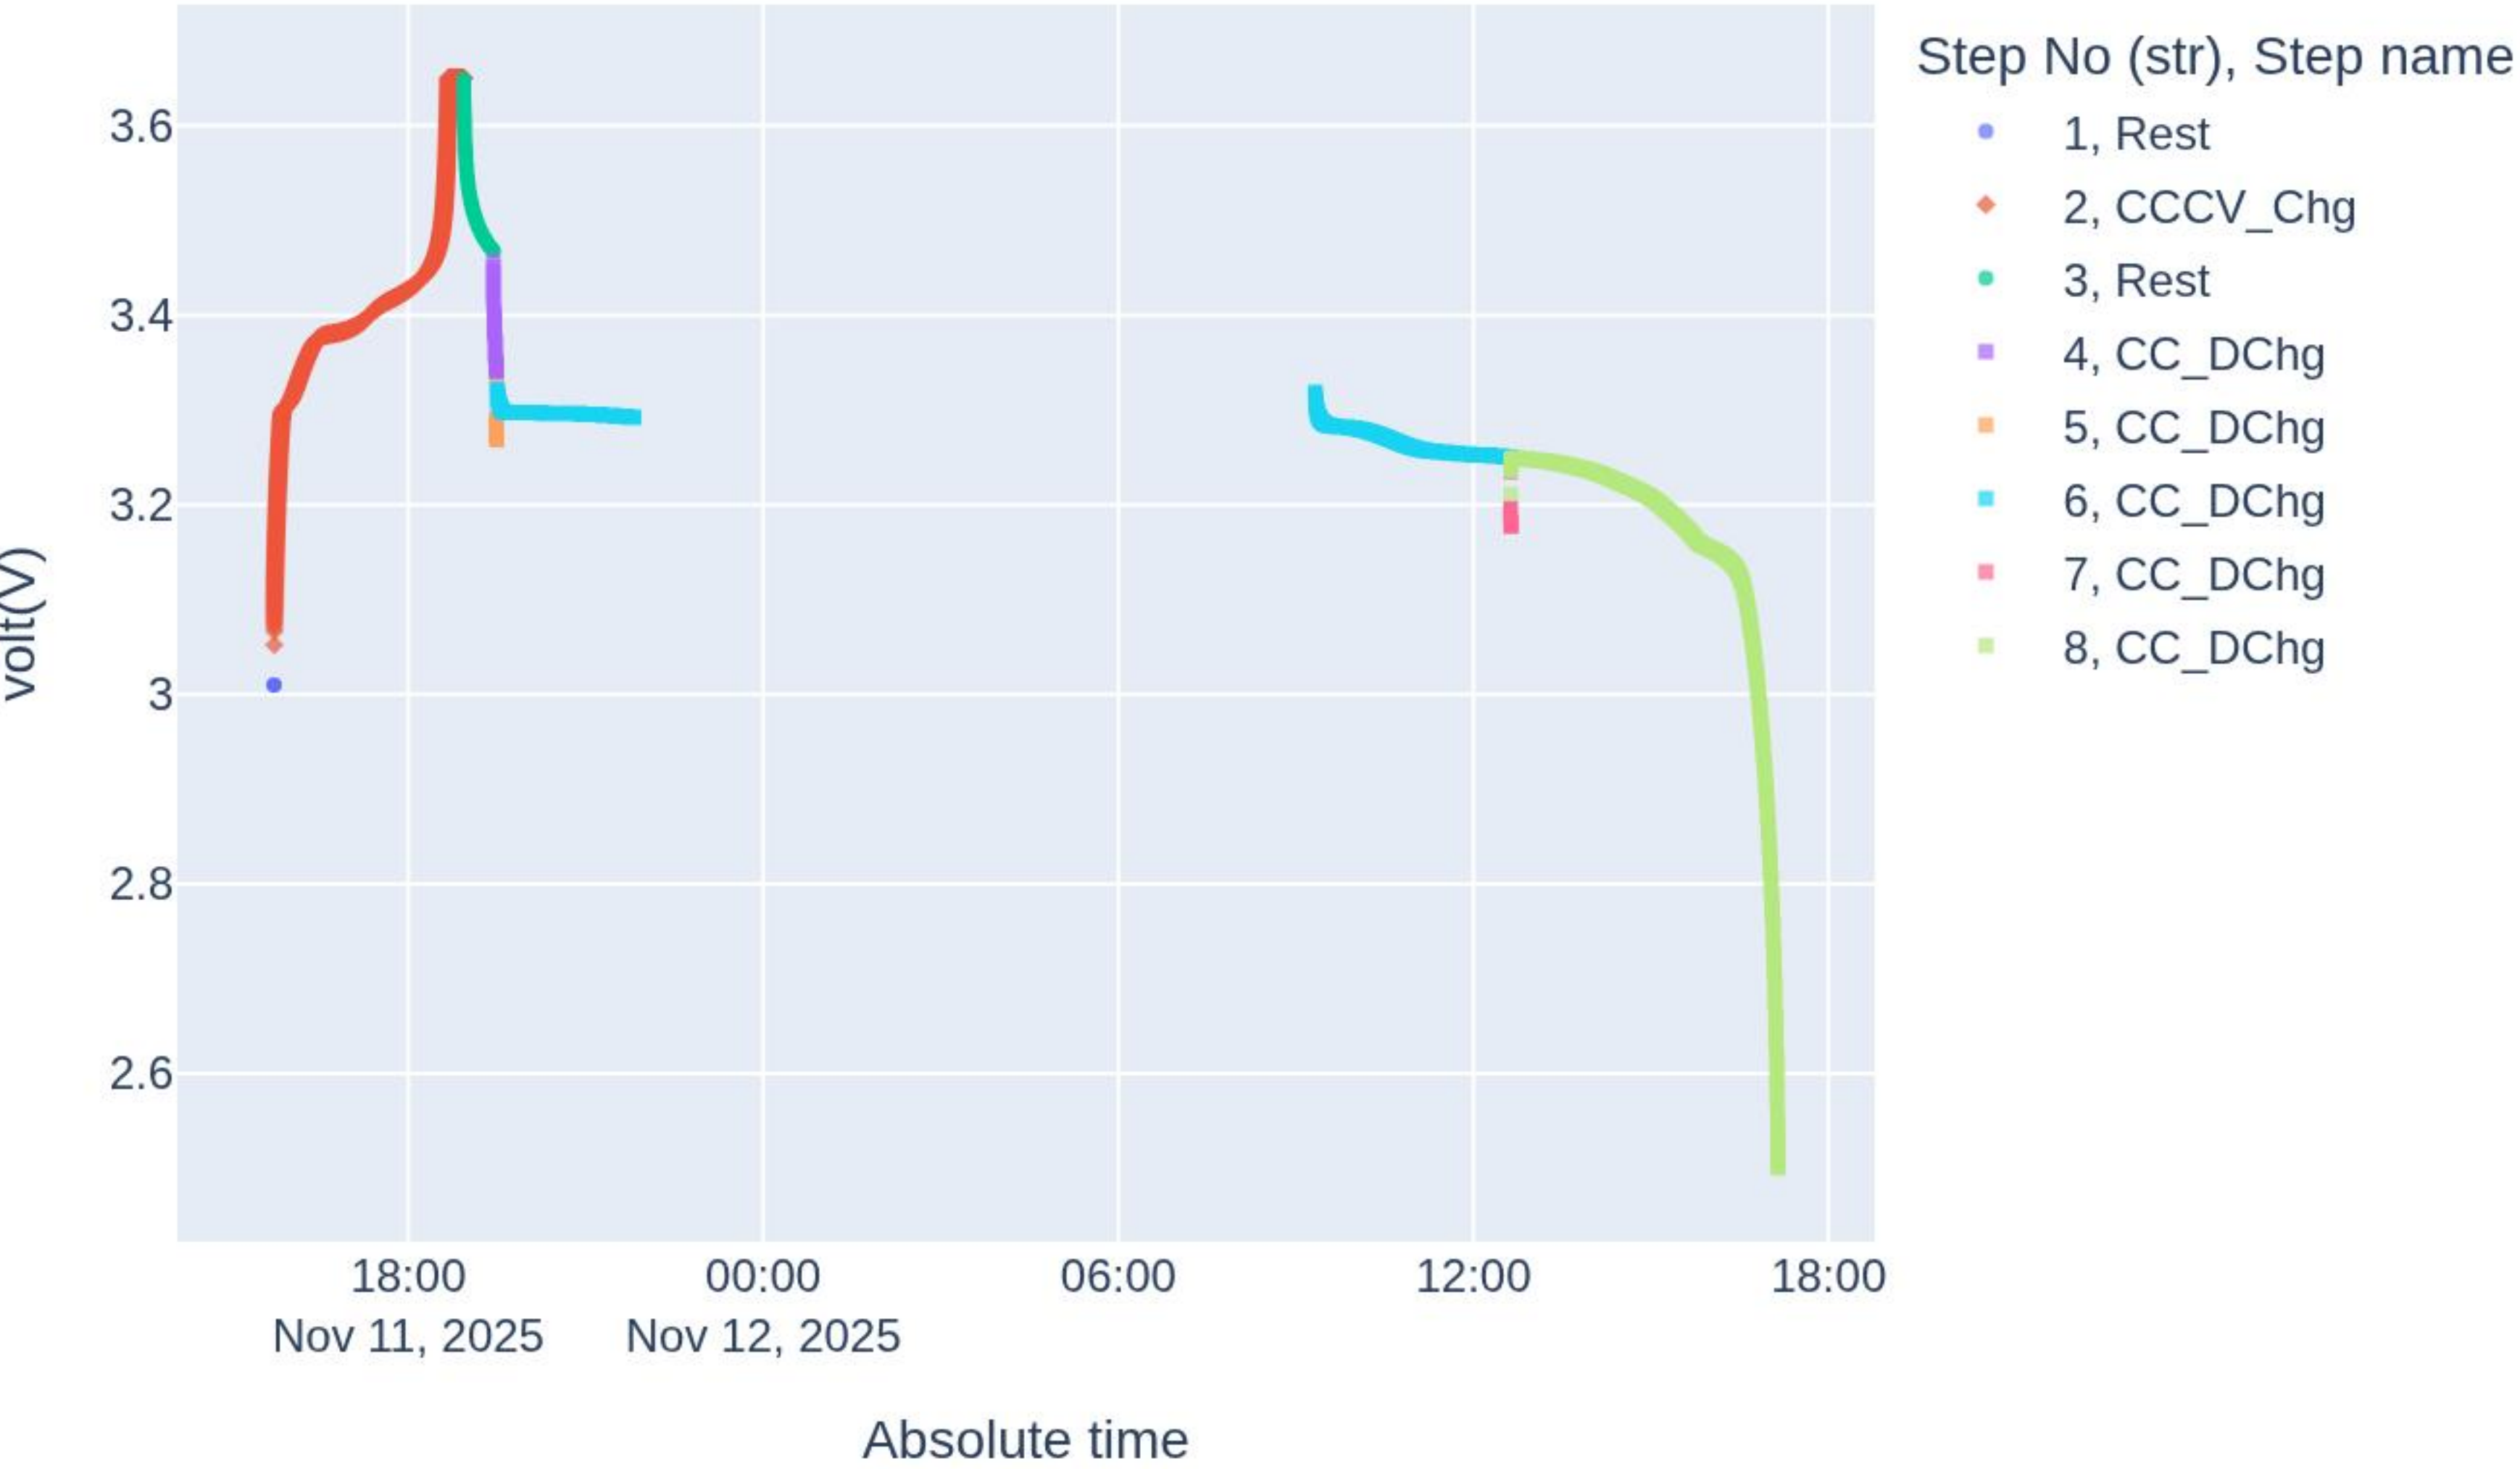


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0318_0_100.csv

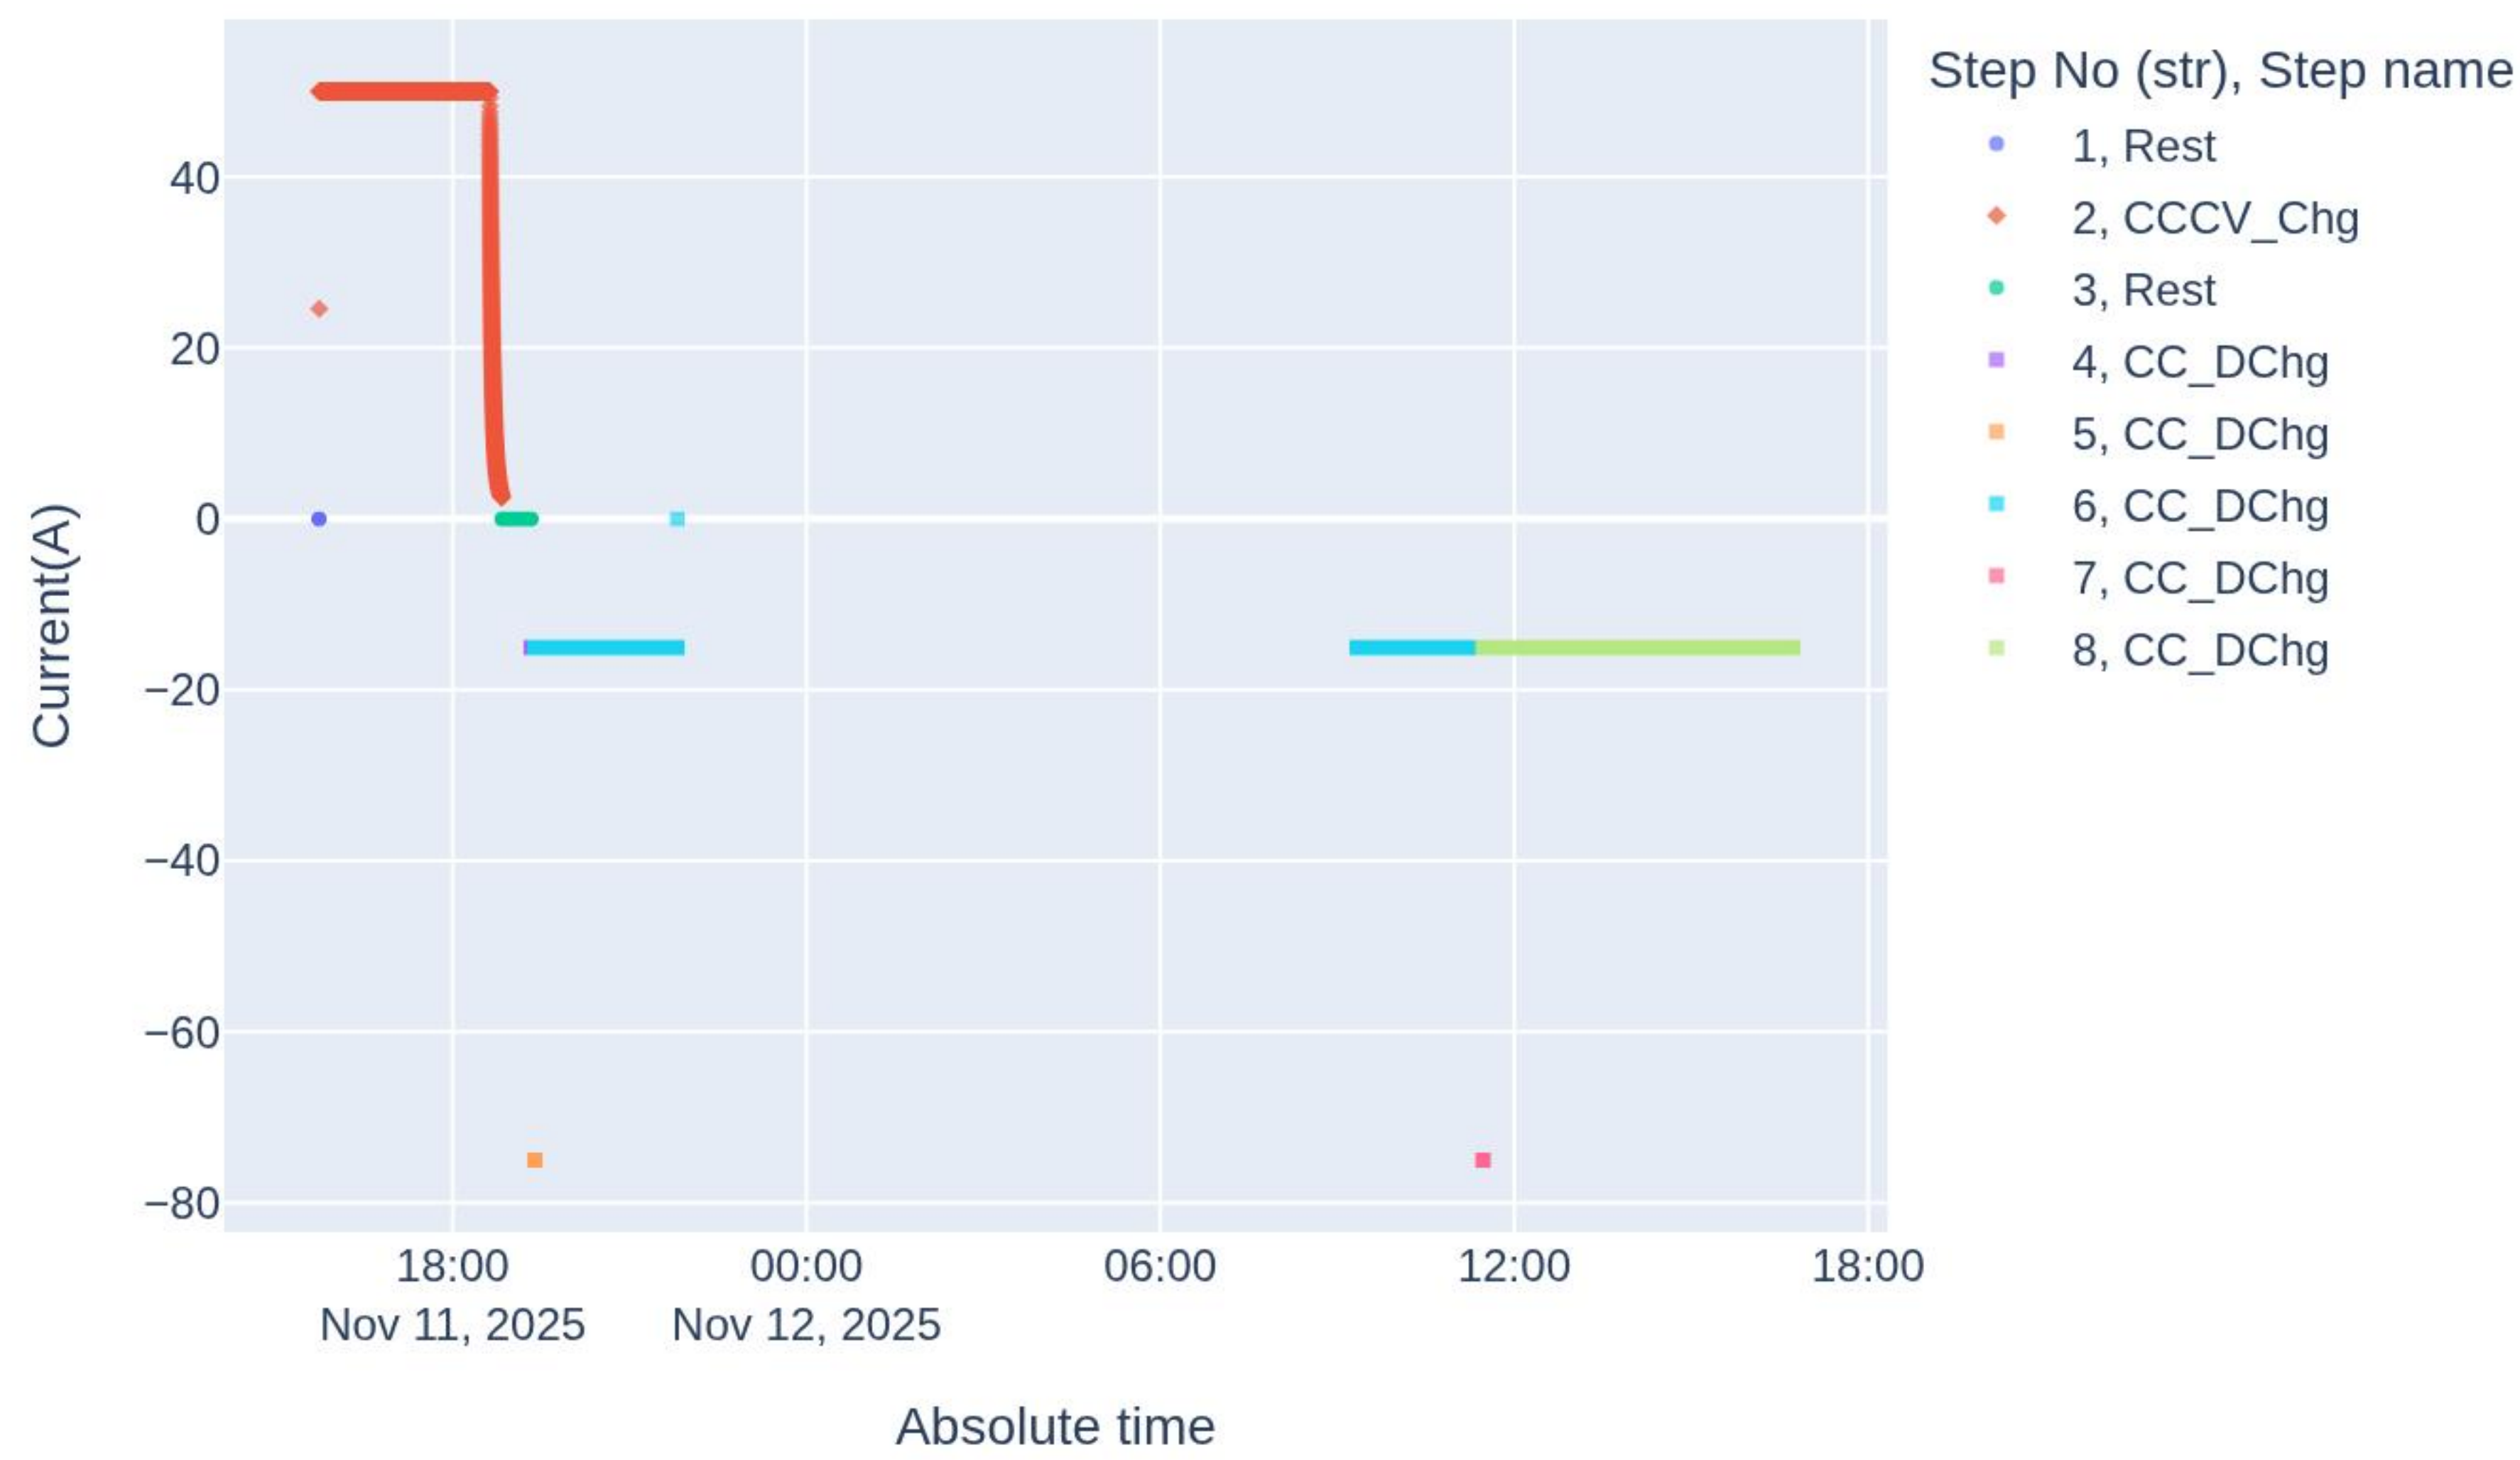


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0318_0_100.csv

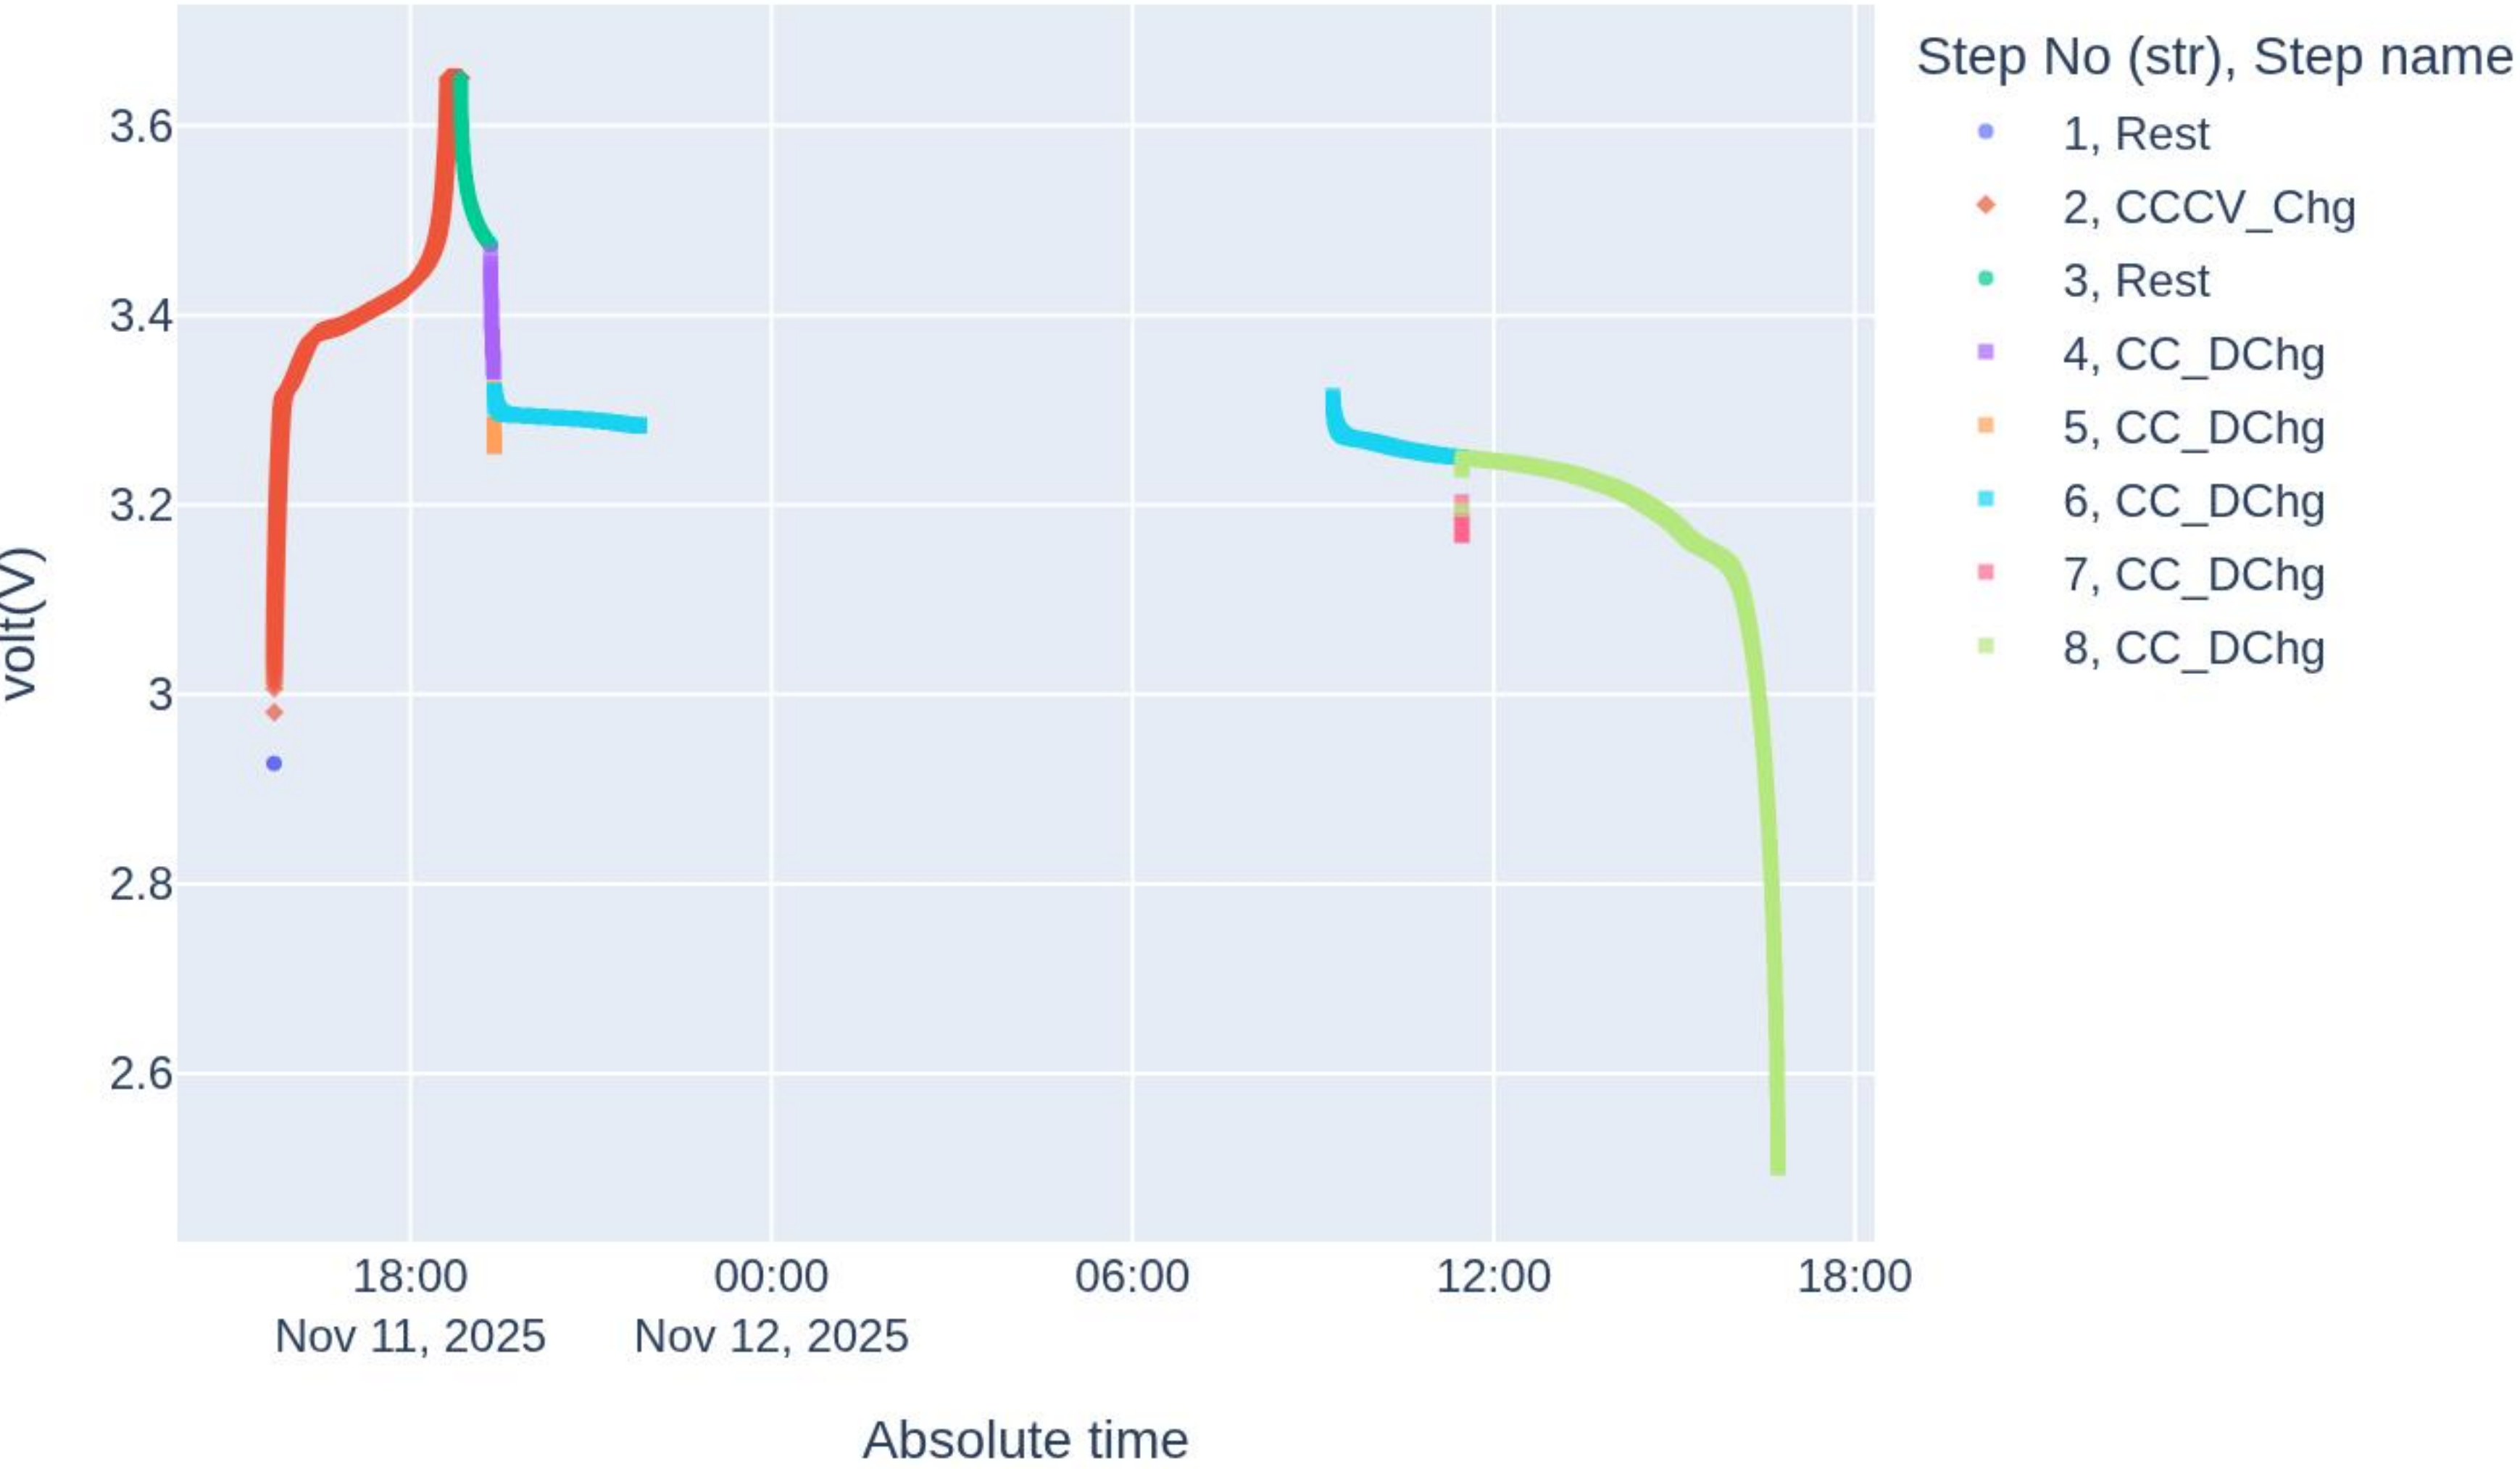


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0319_0_100.csv

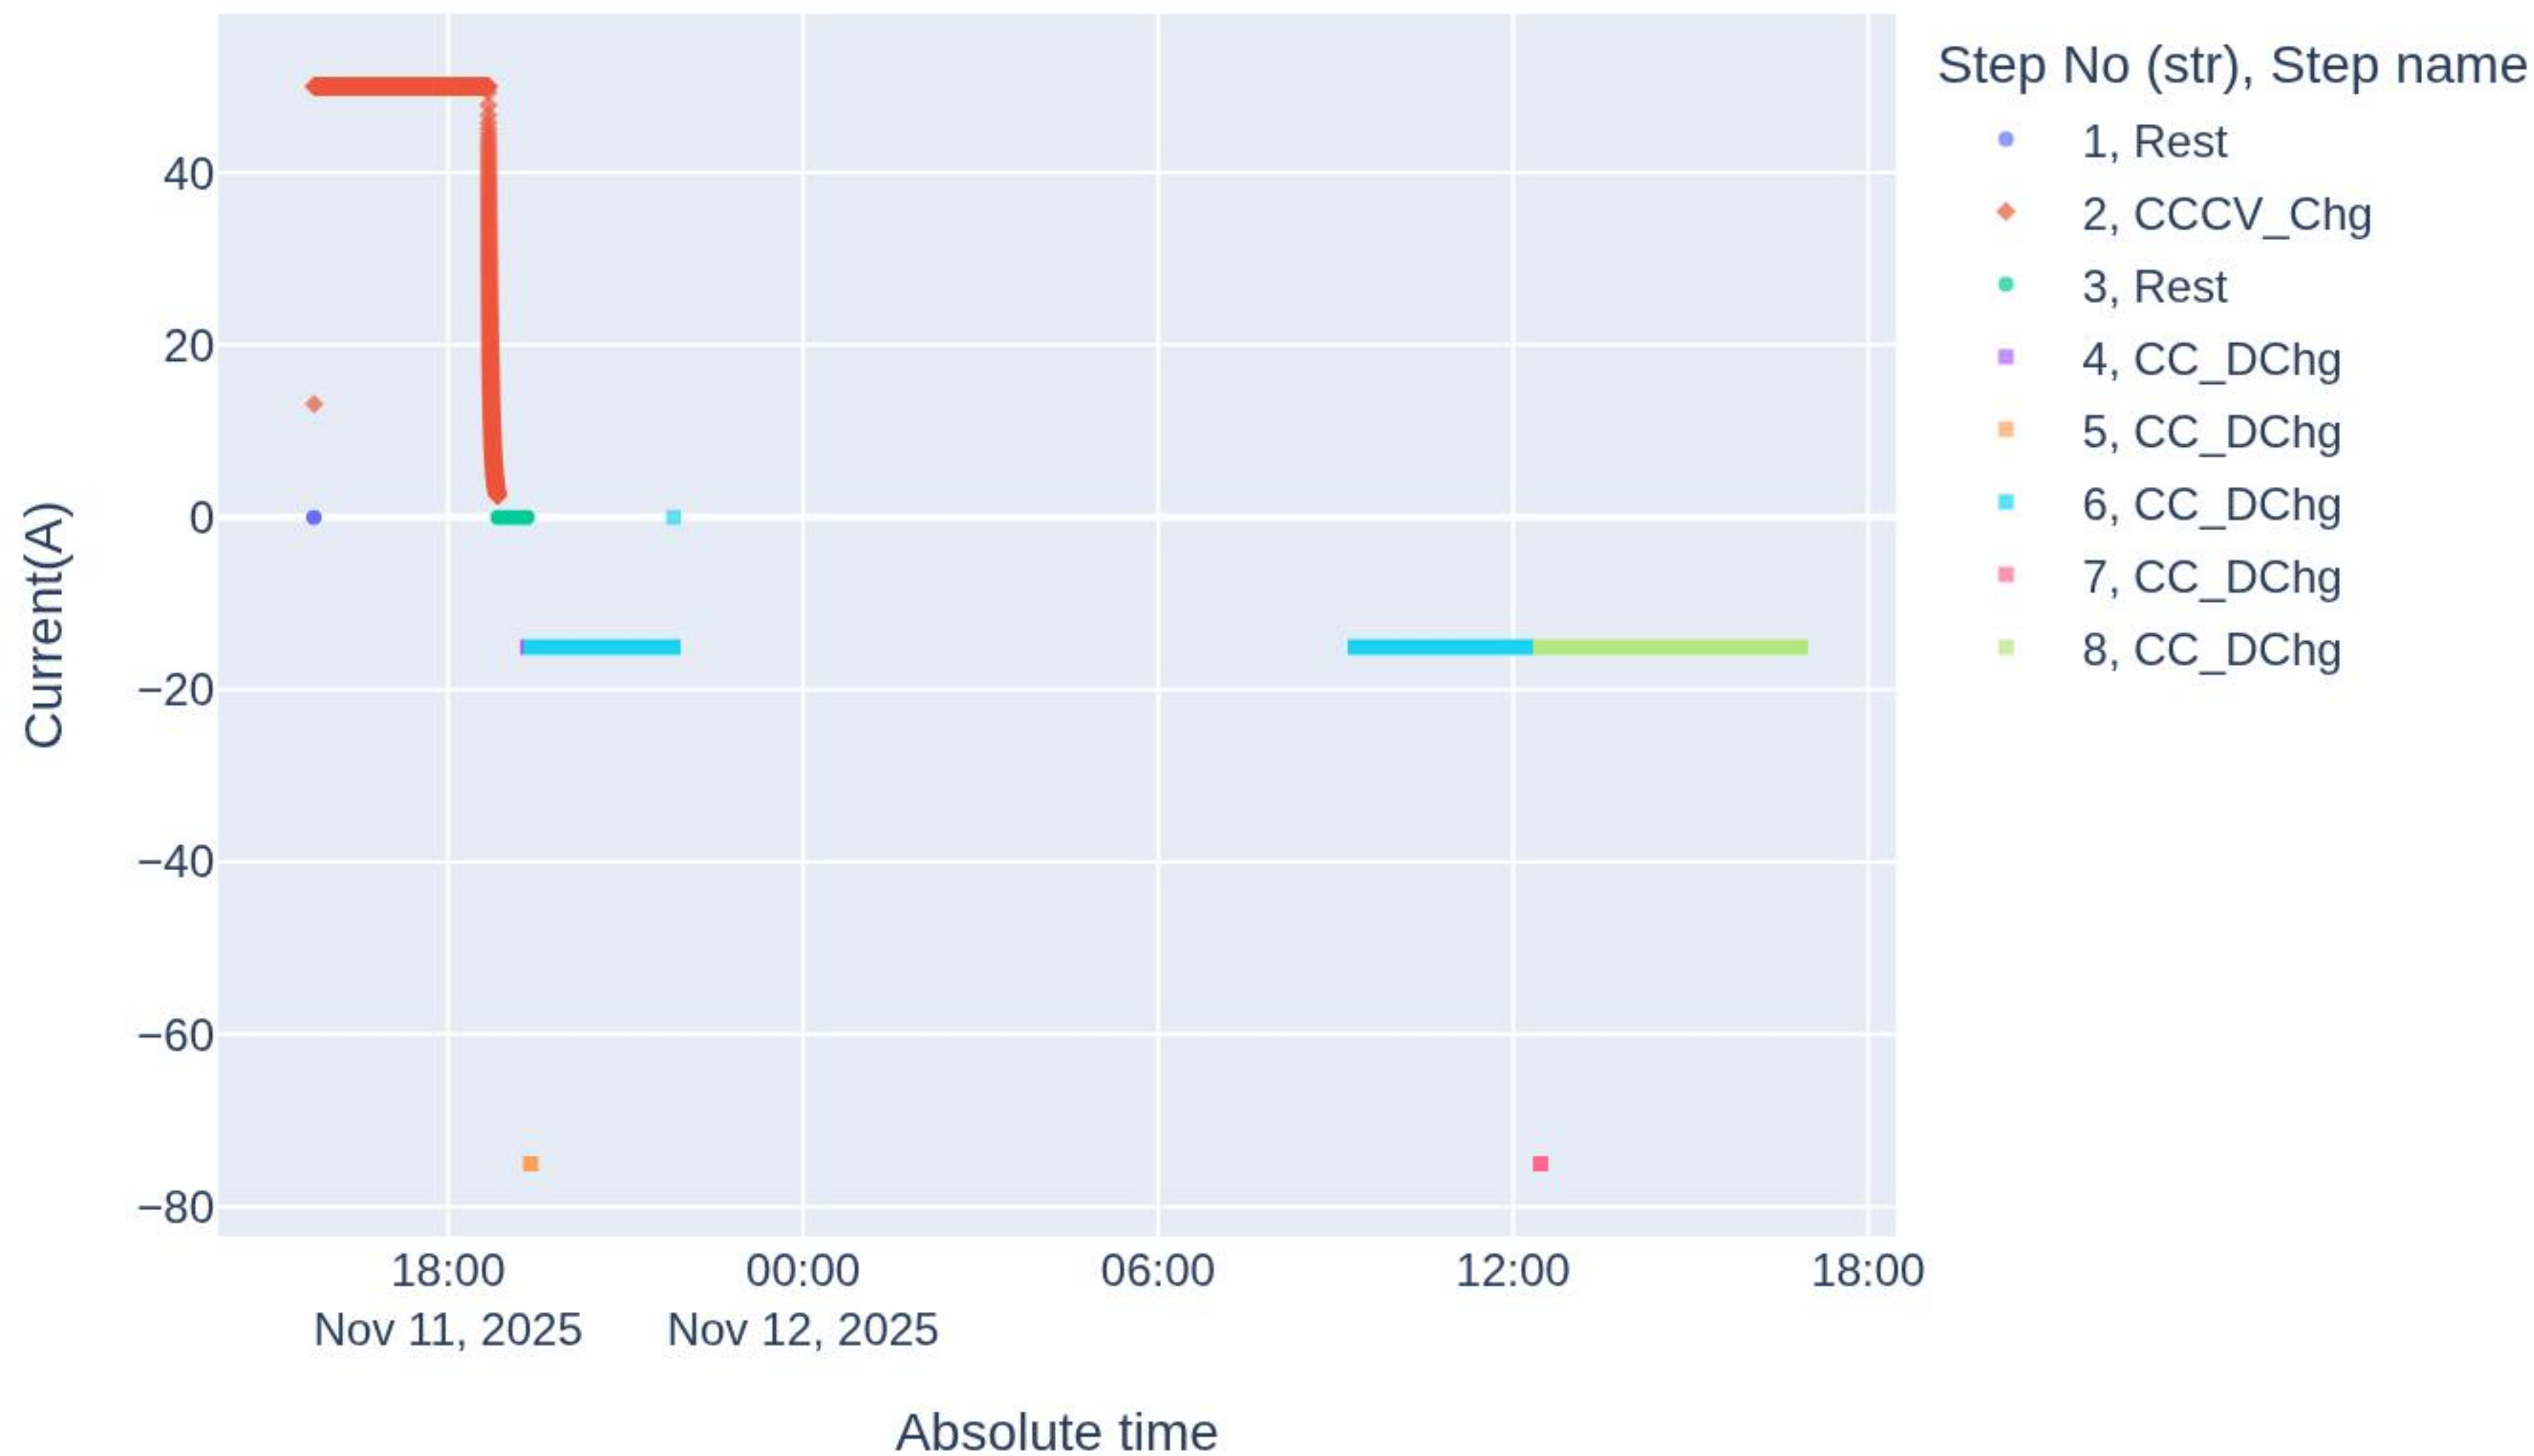


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0319_0_100.csv

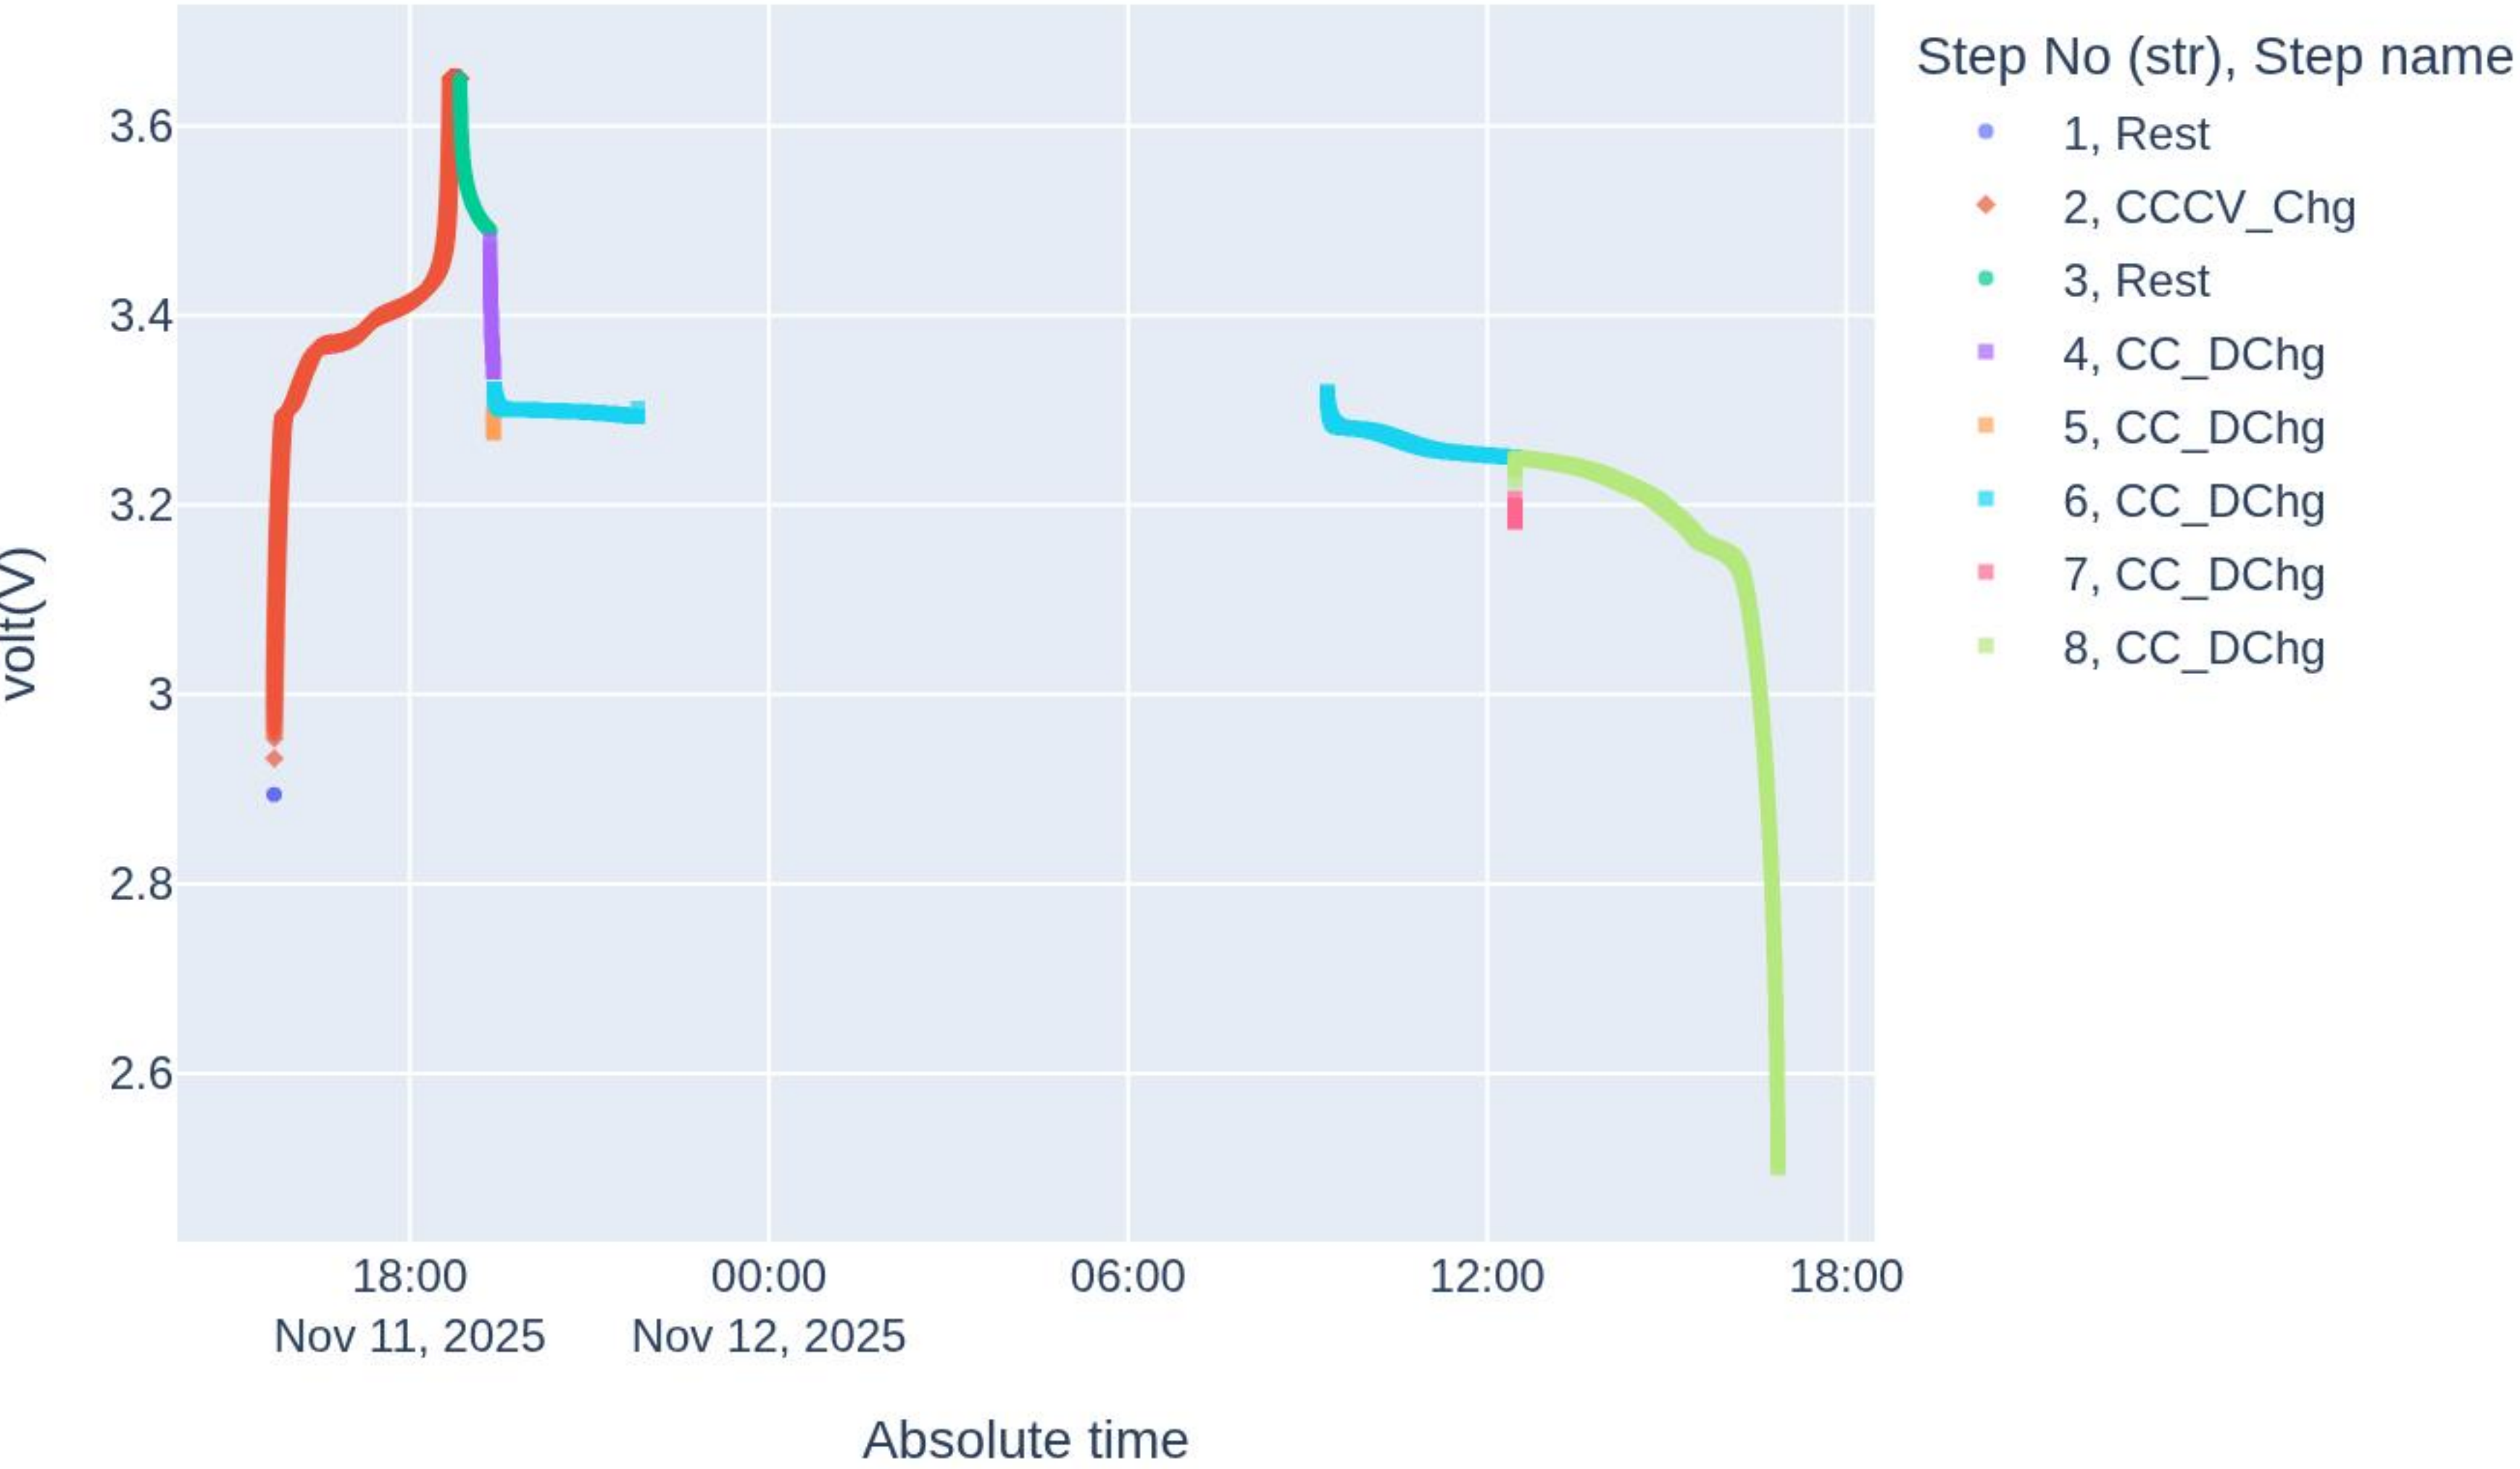


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0320_0_100.csv

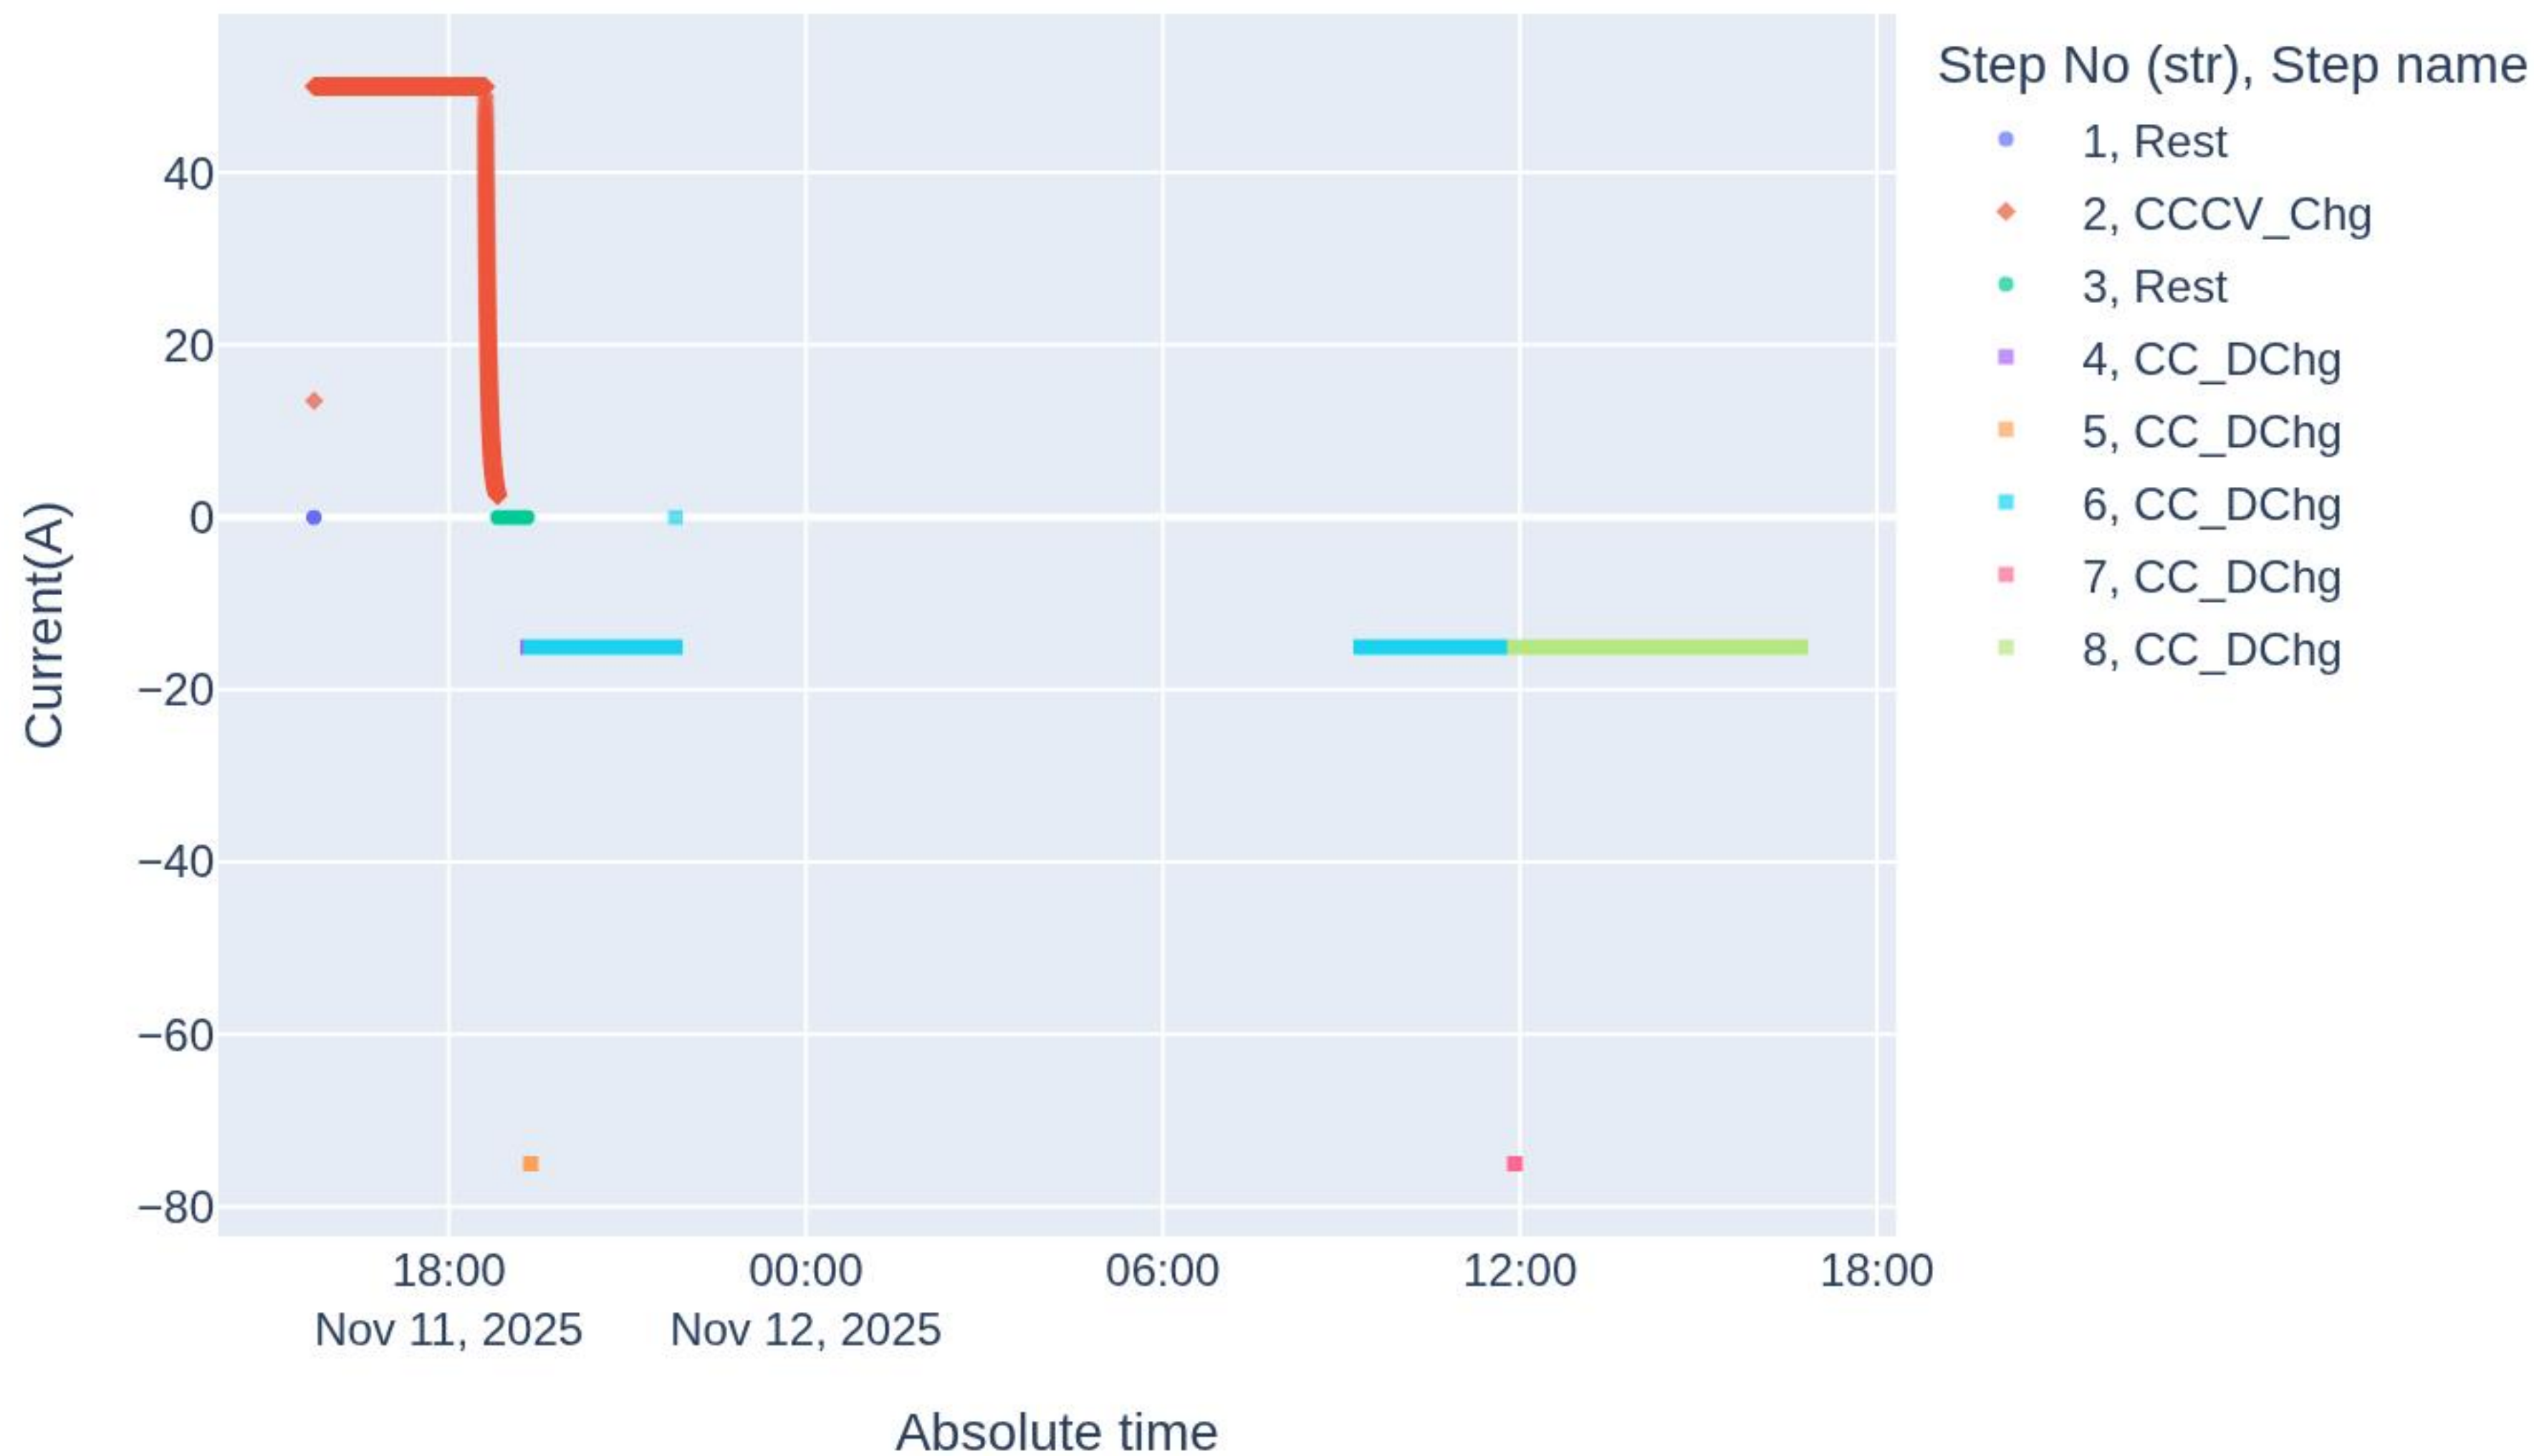


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0320_0_100.csv

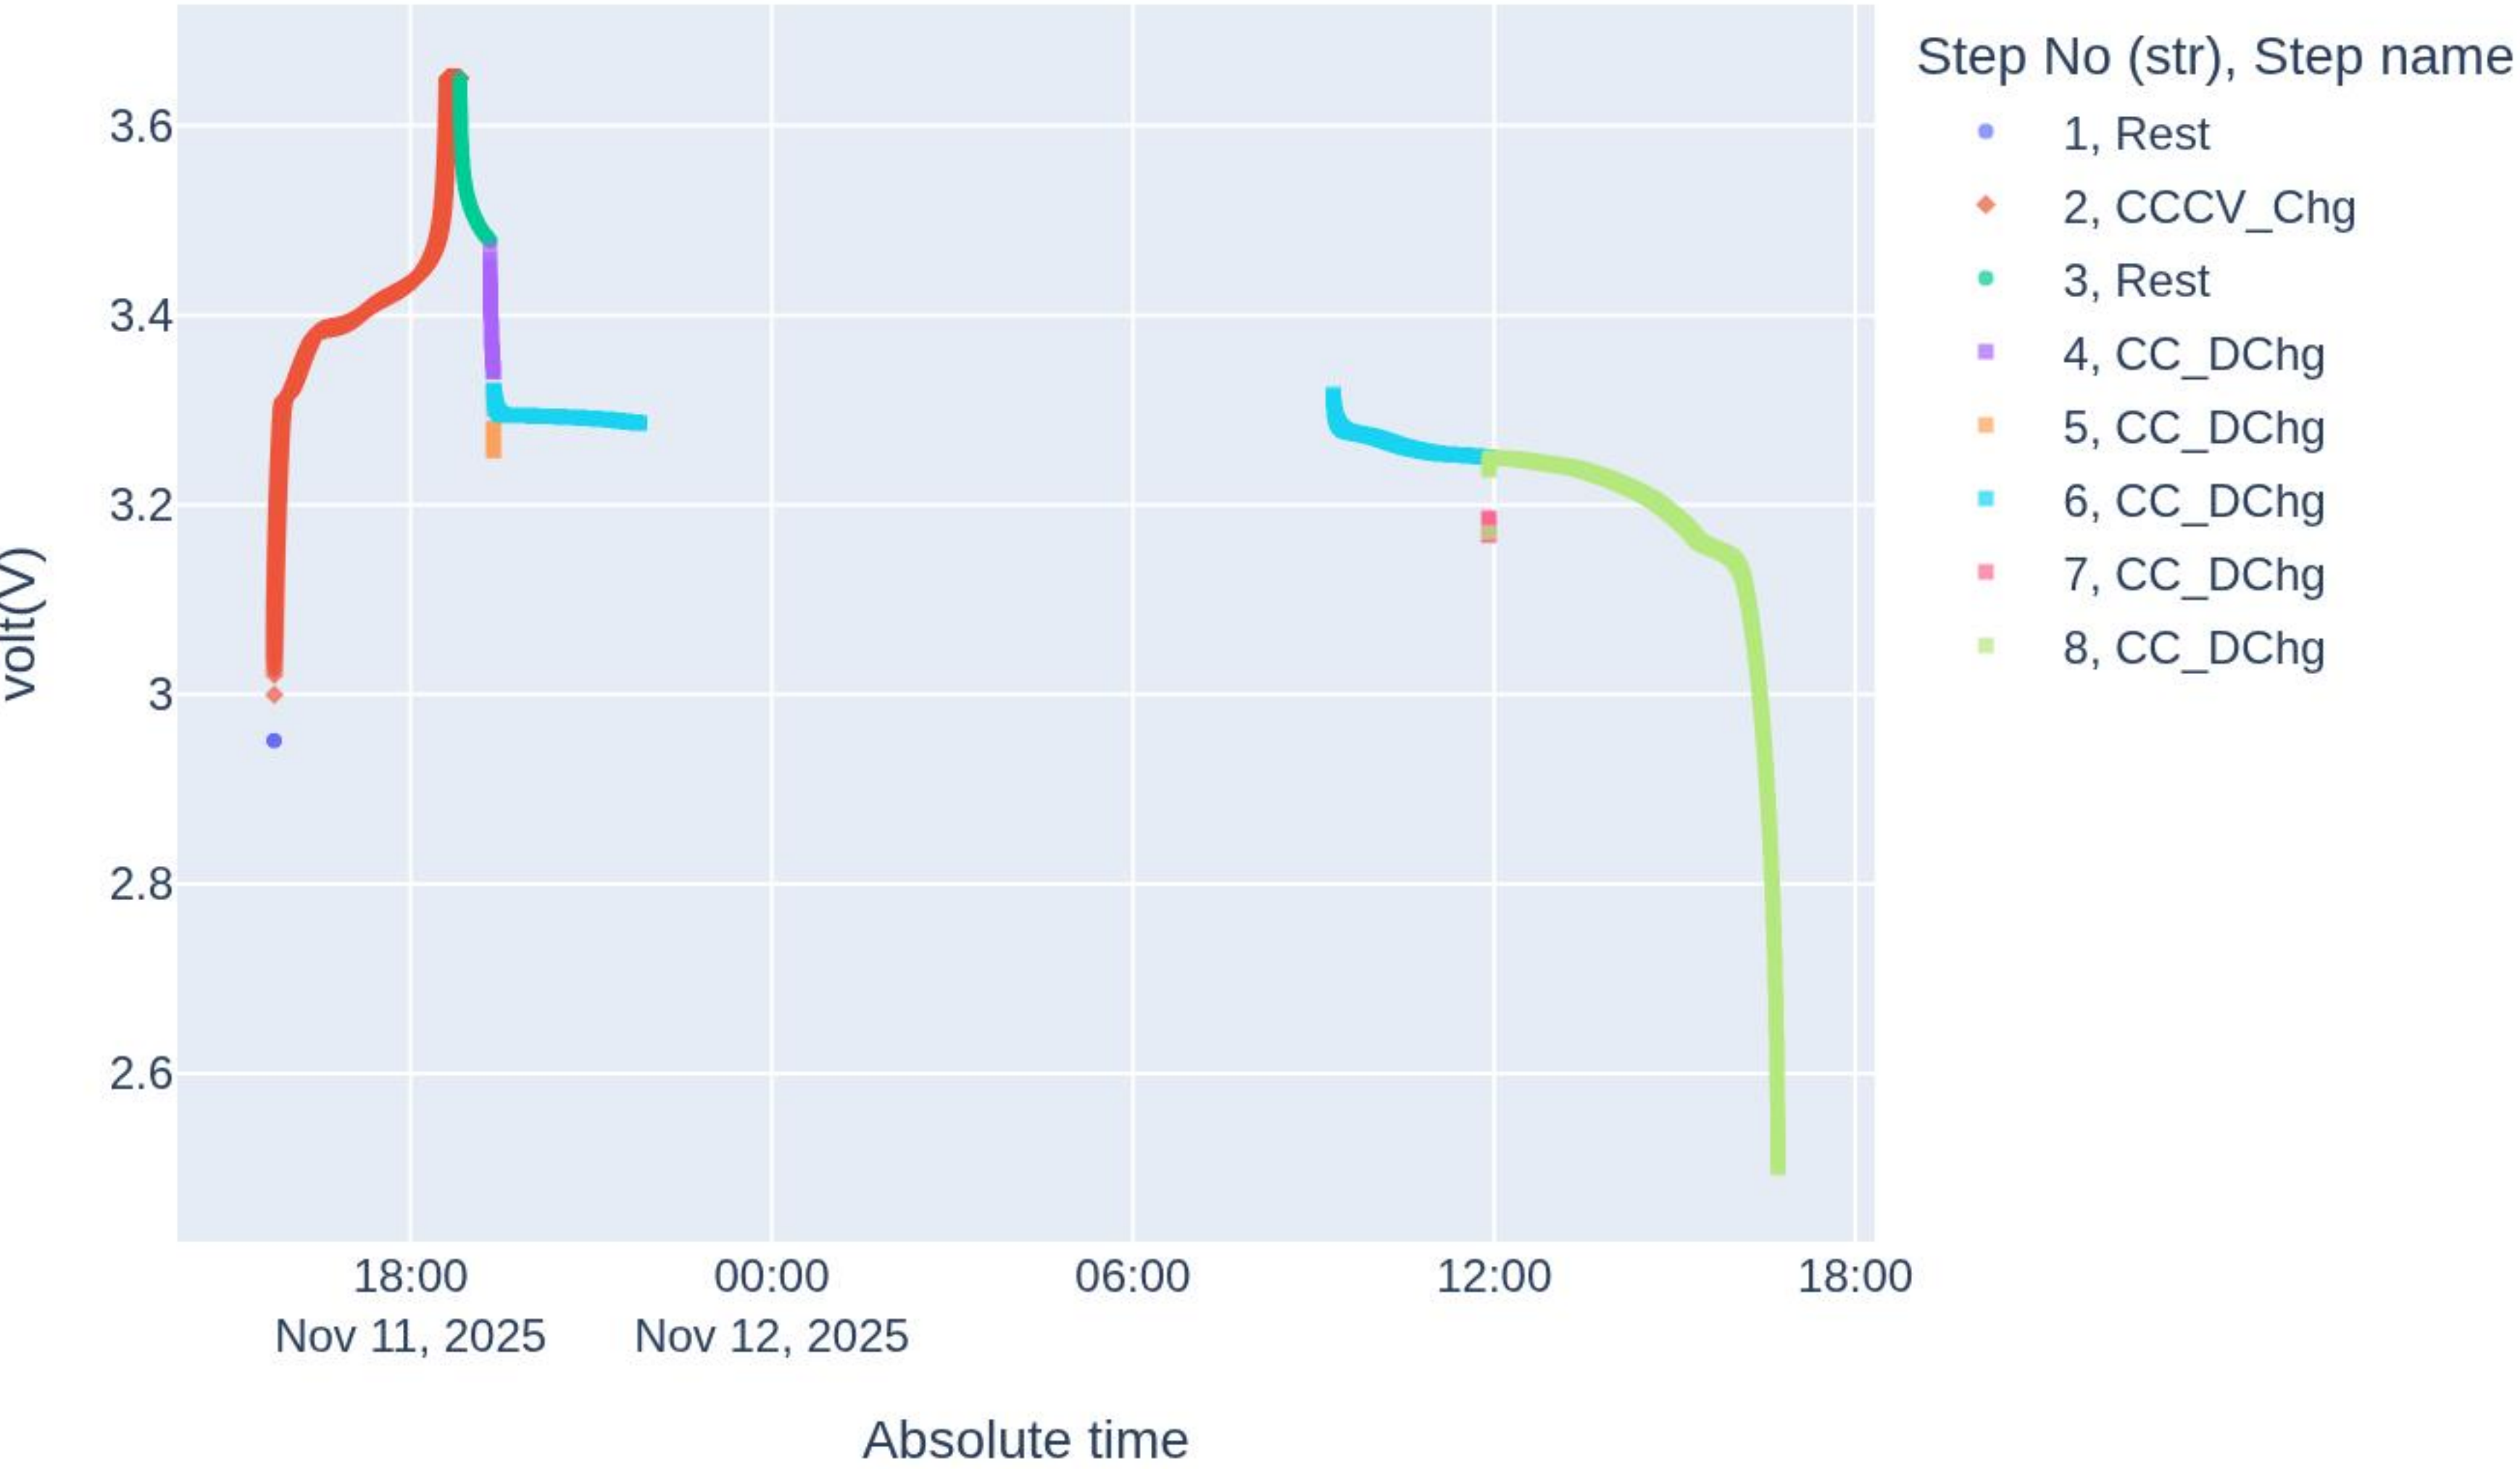


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0321_0_100.csv

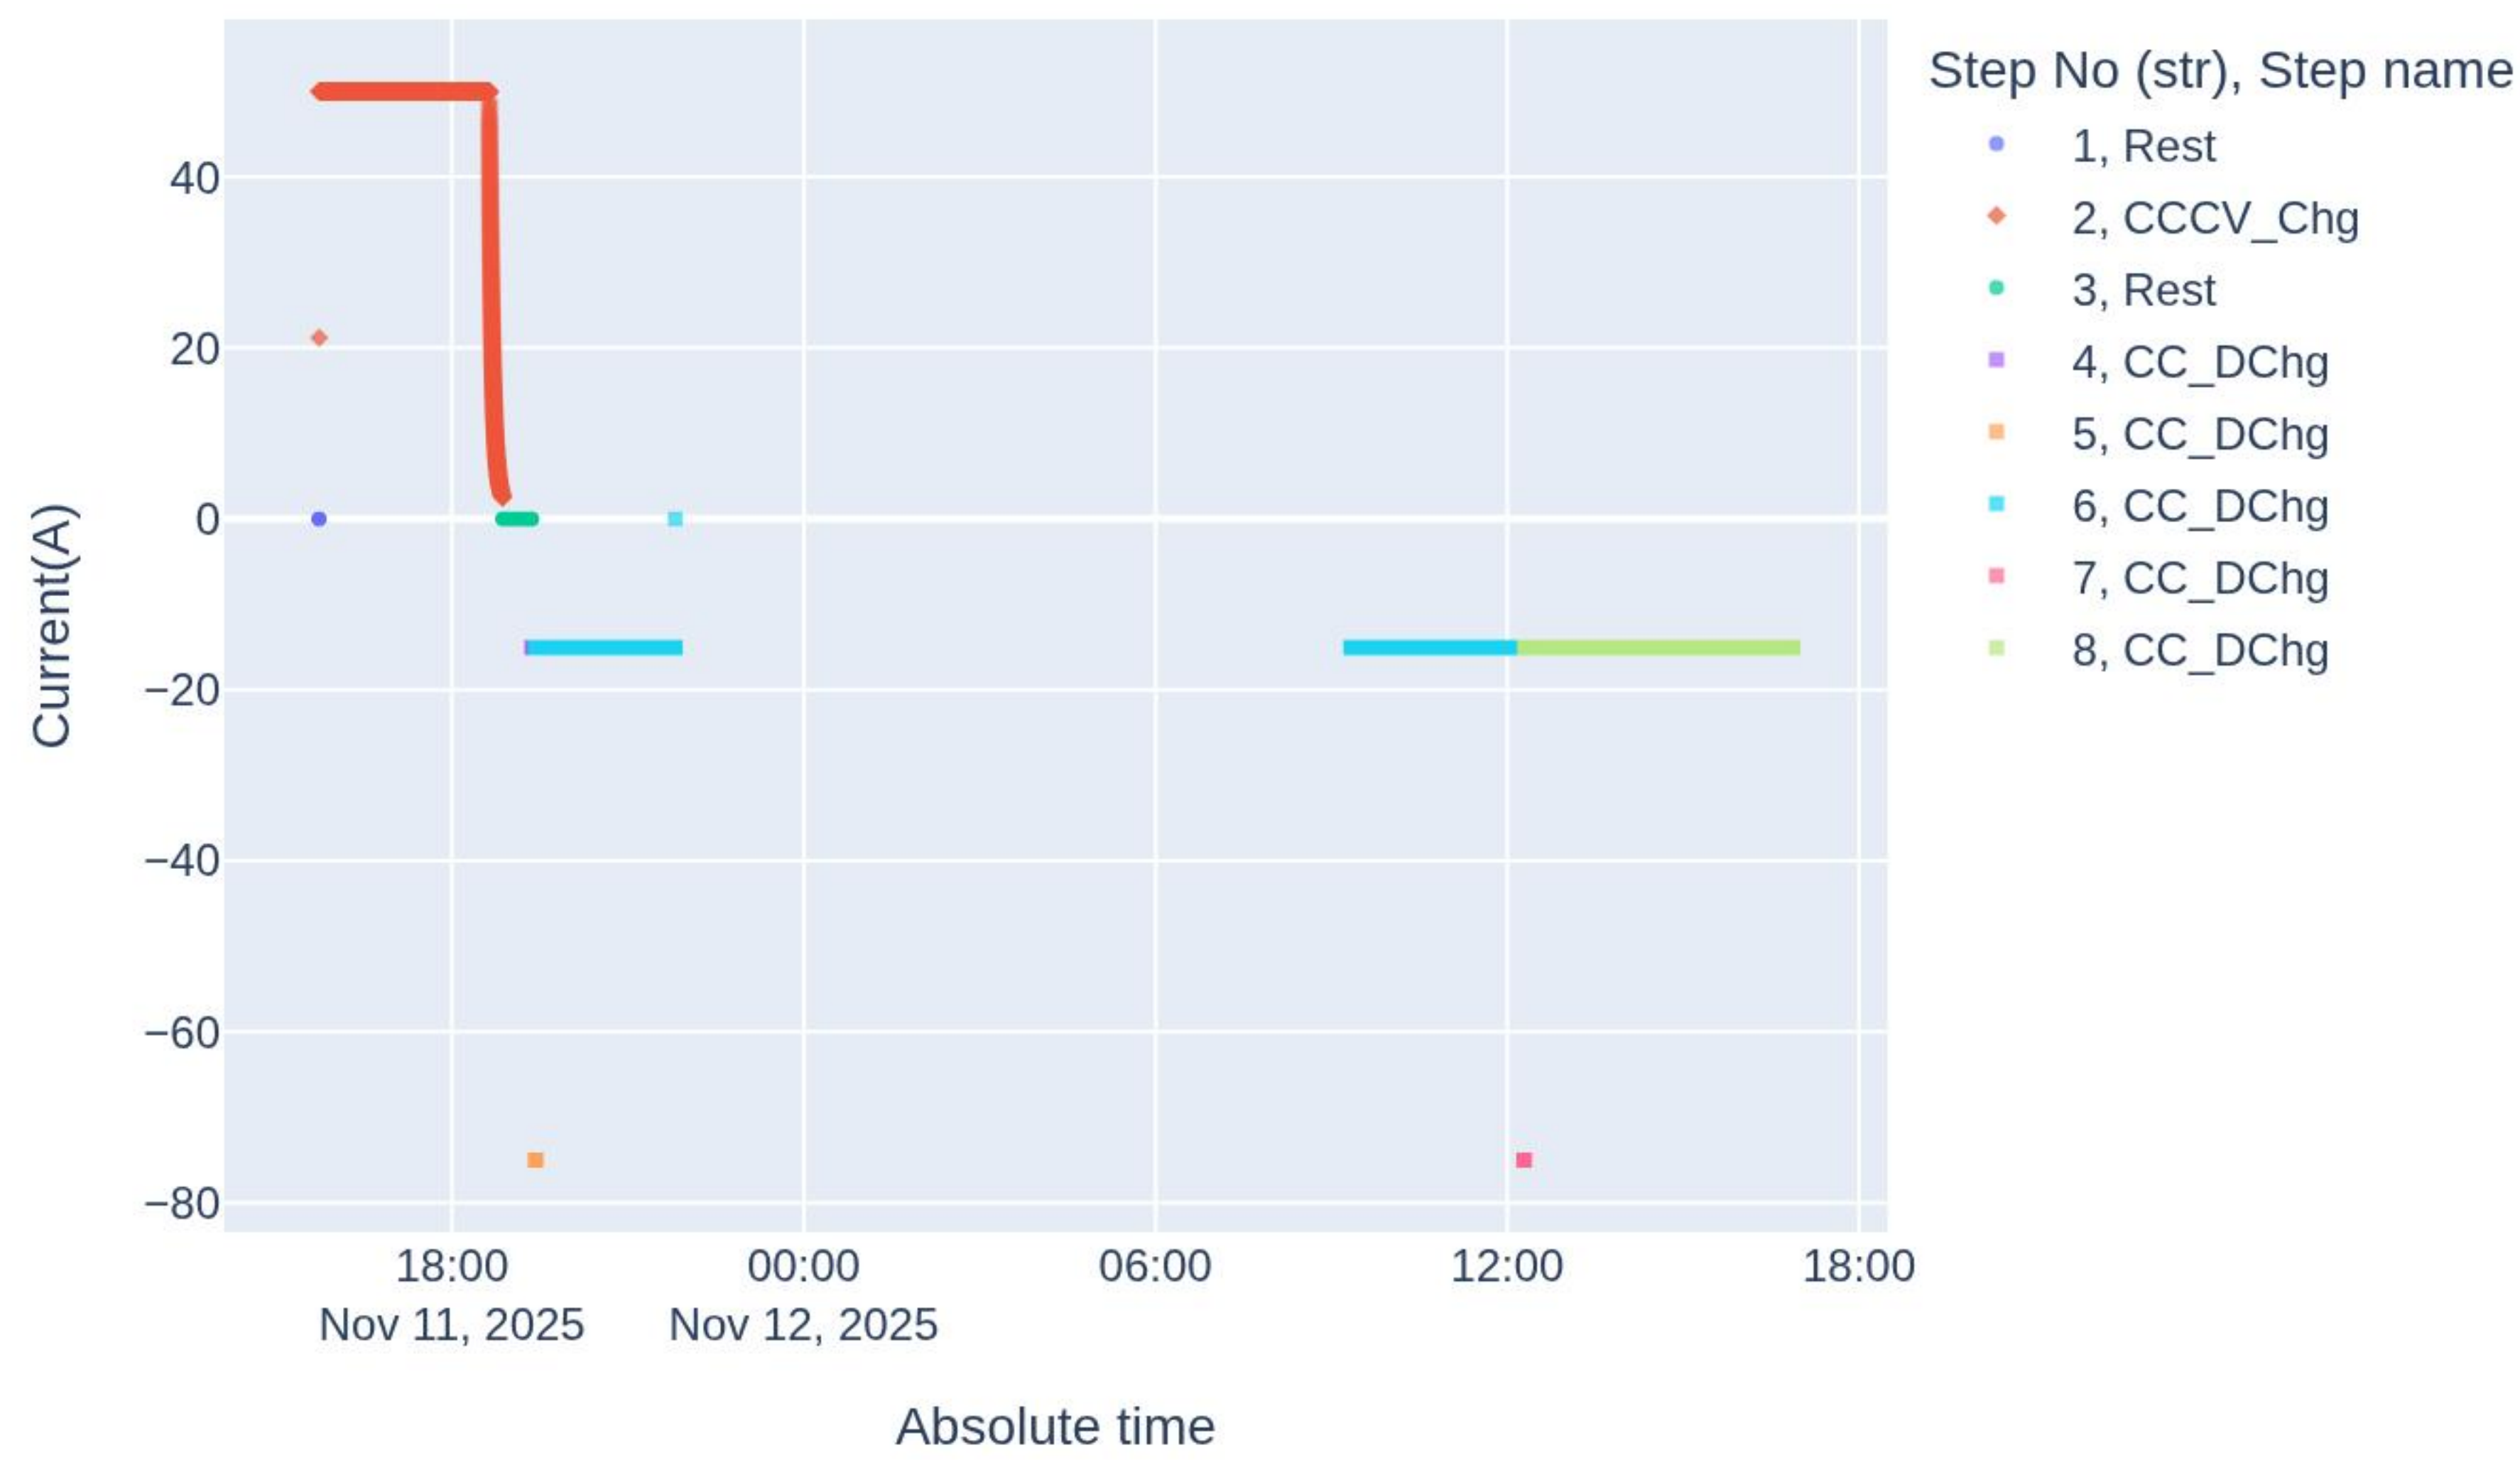


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0321_0_100.csv

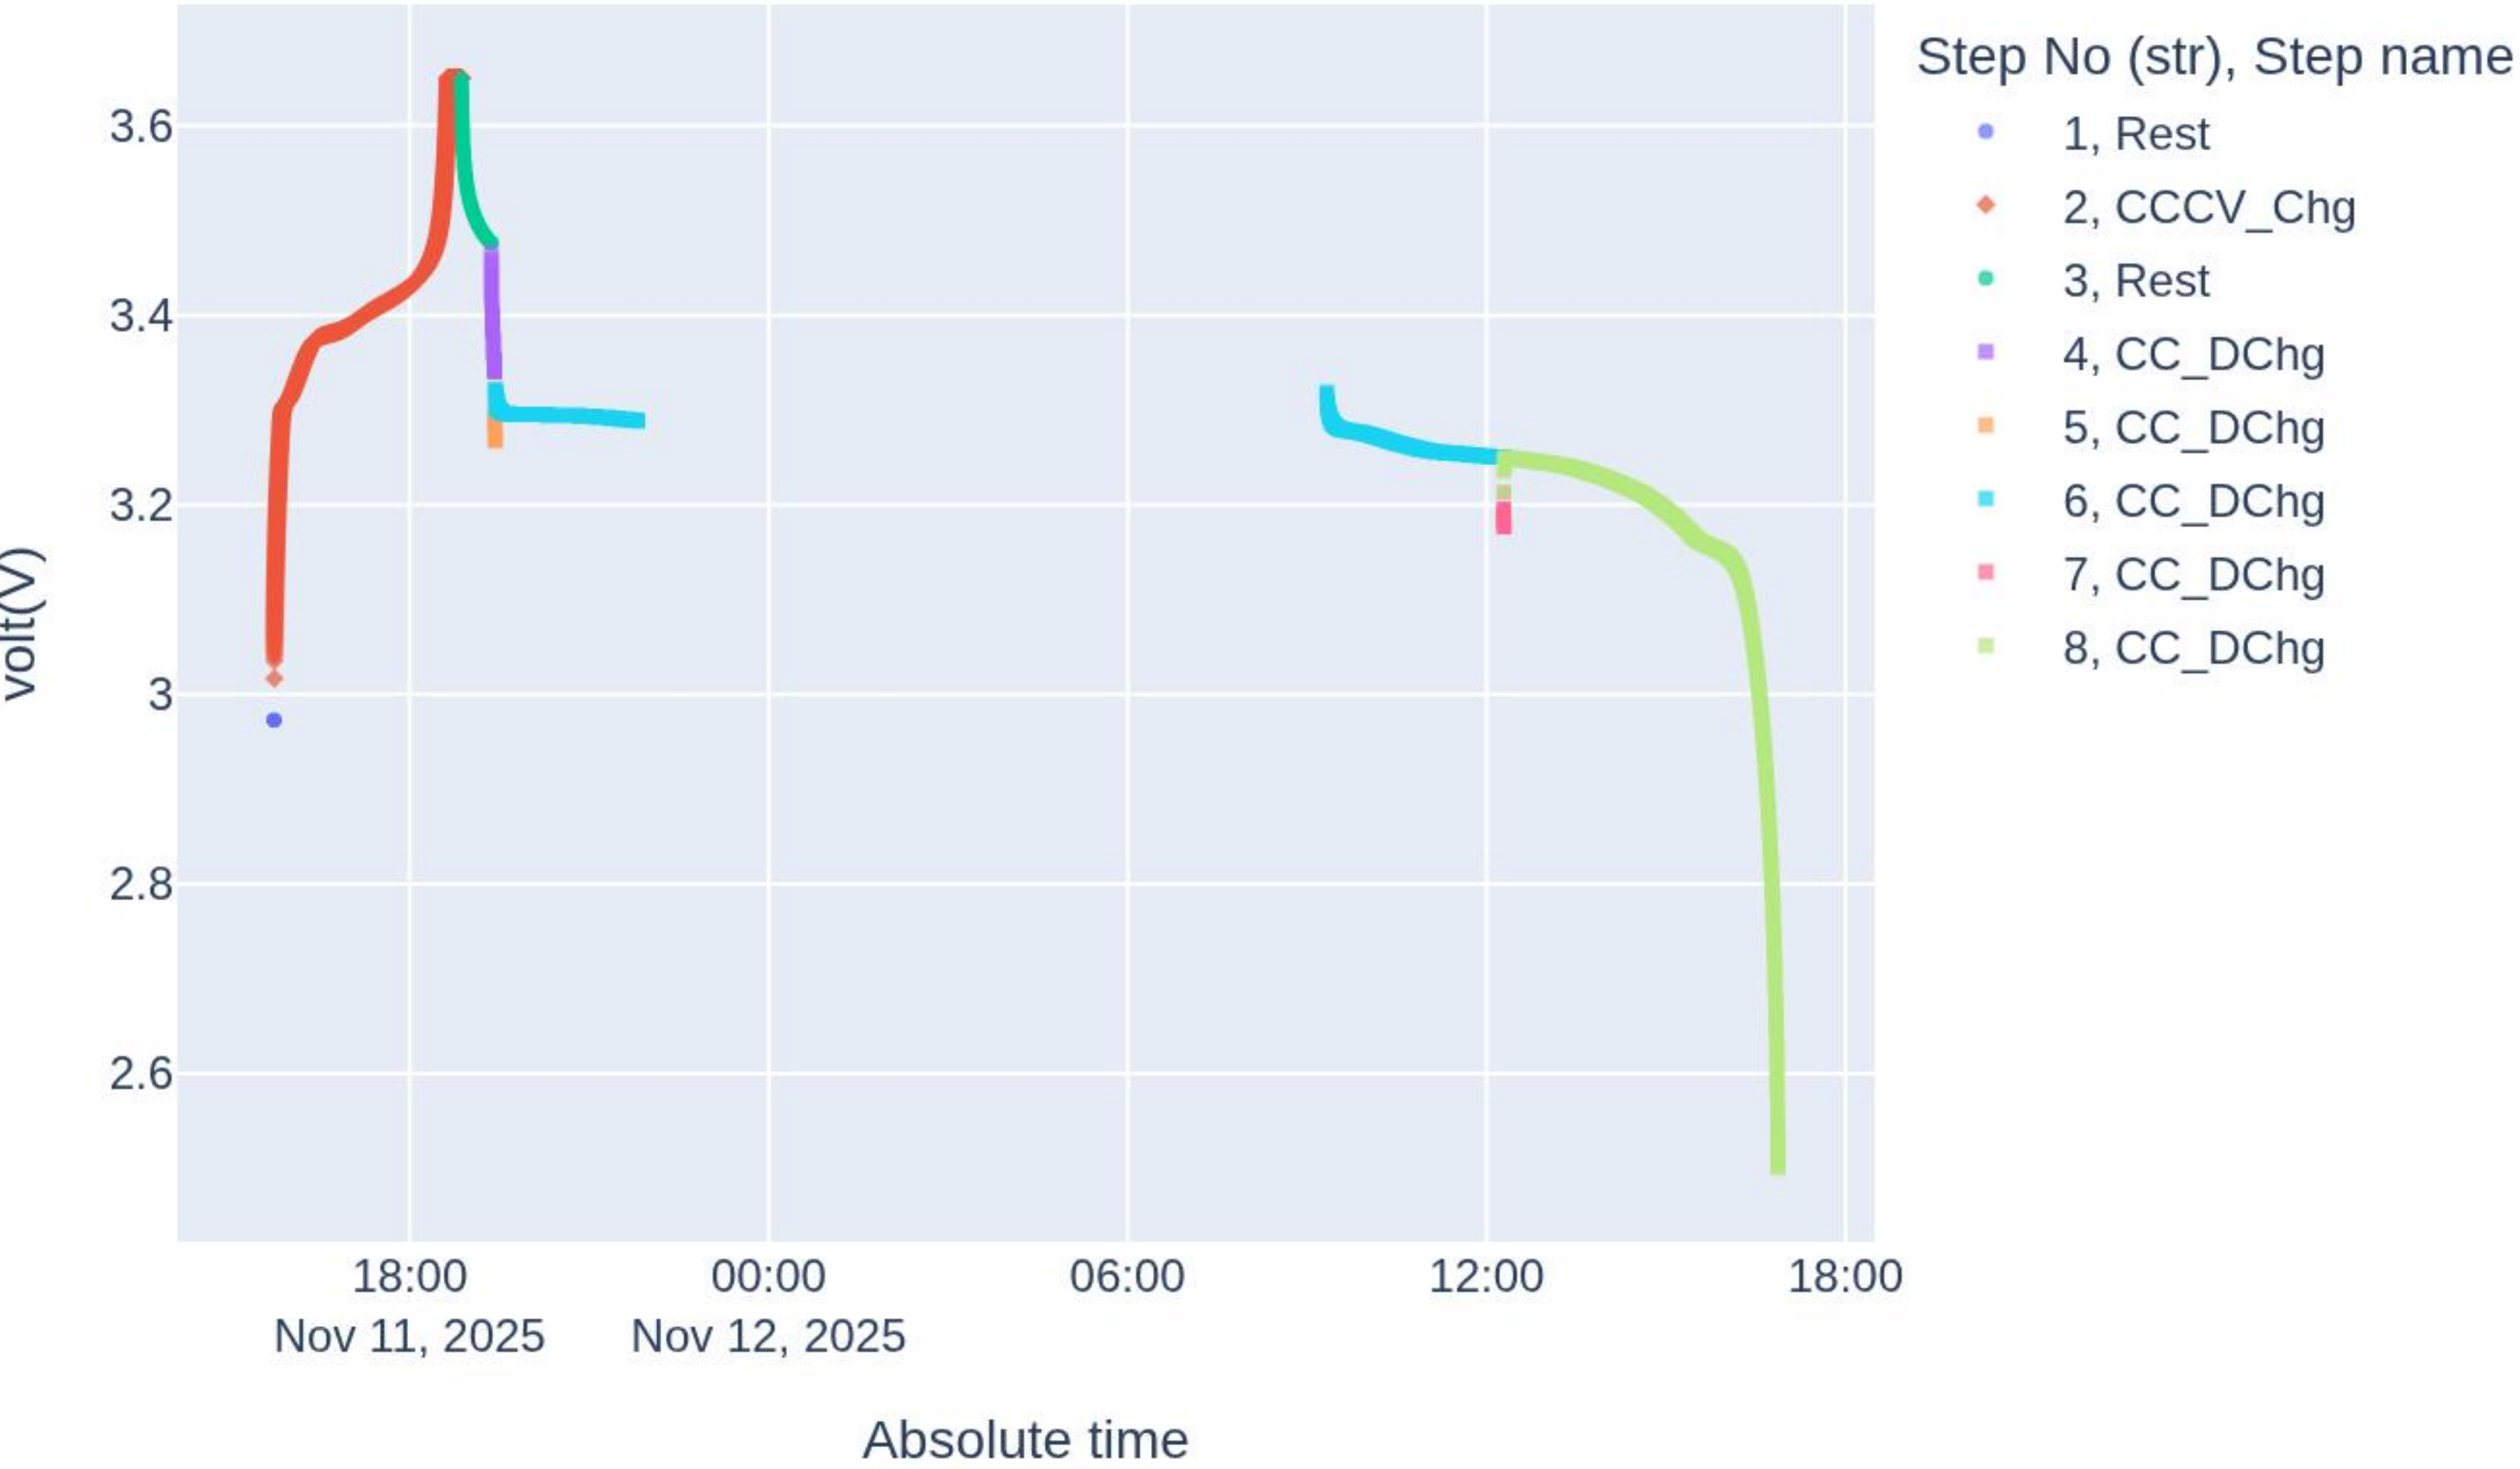


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0322_0_100.csv

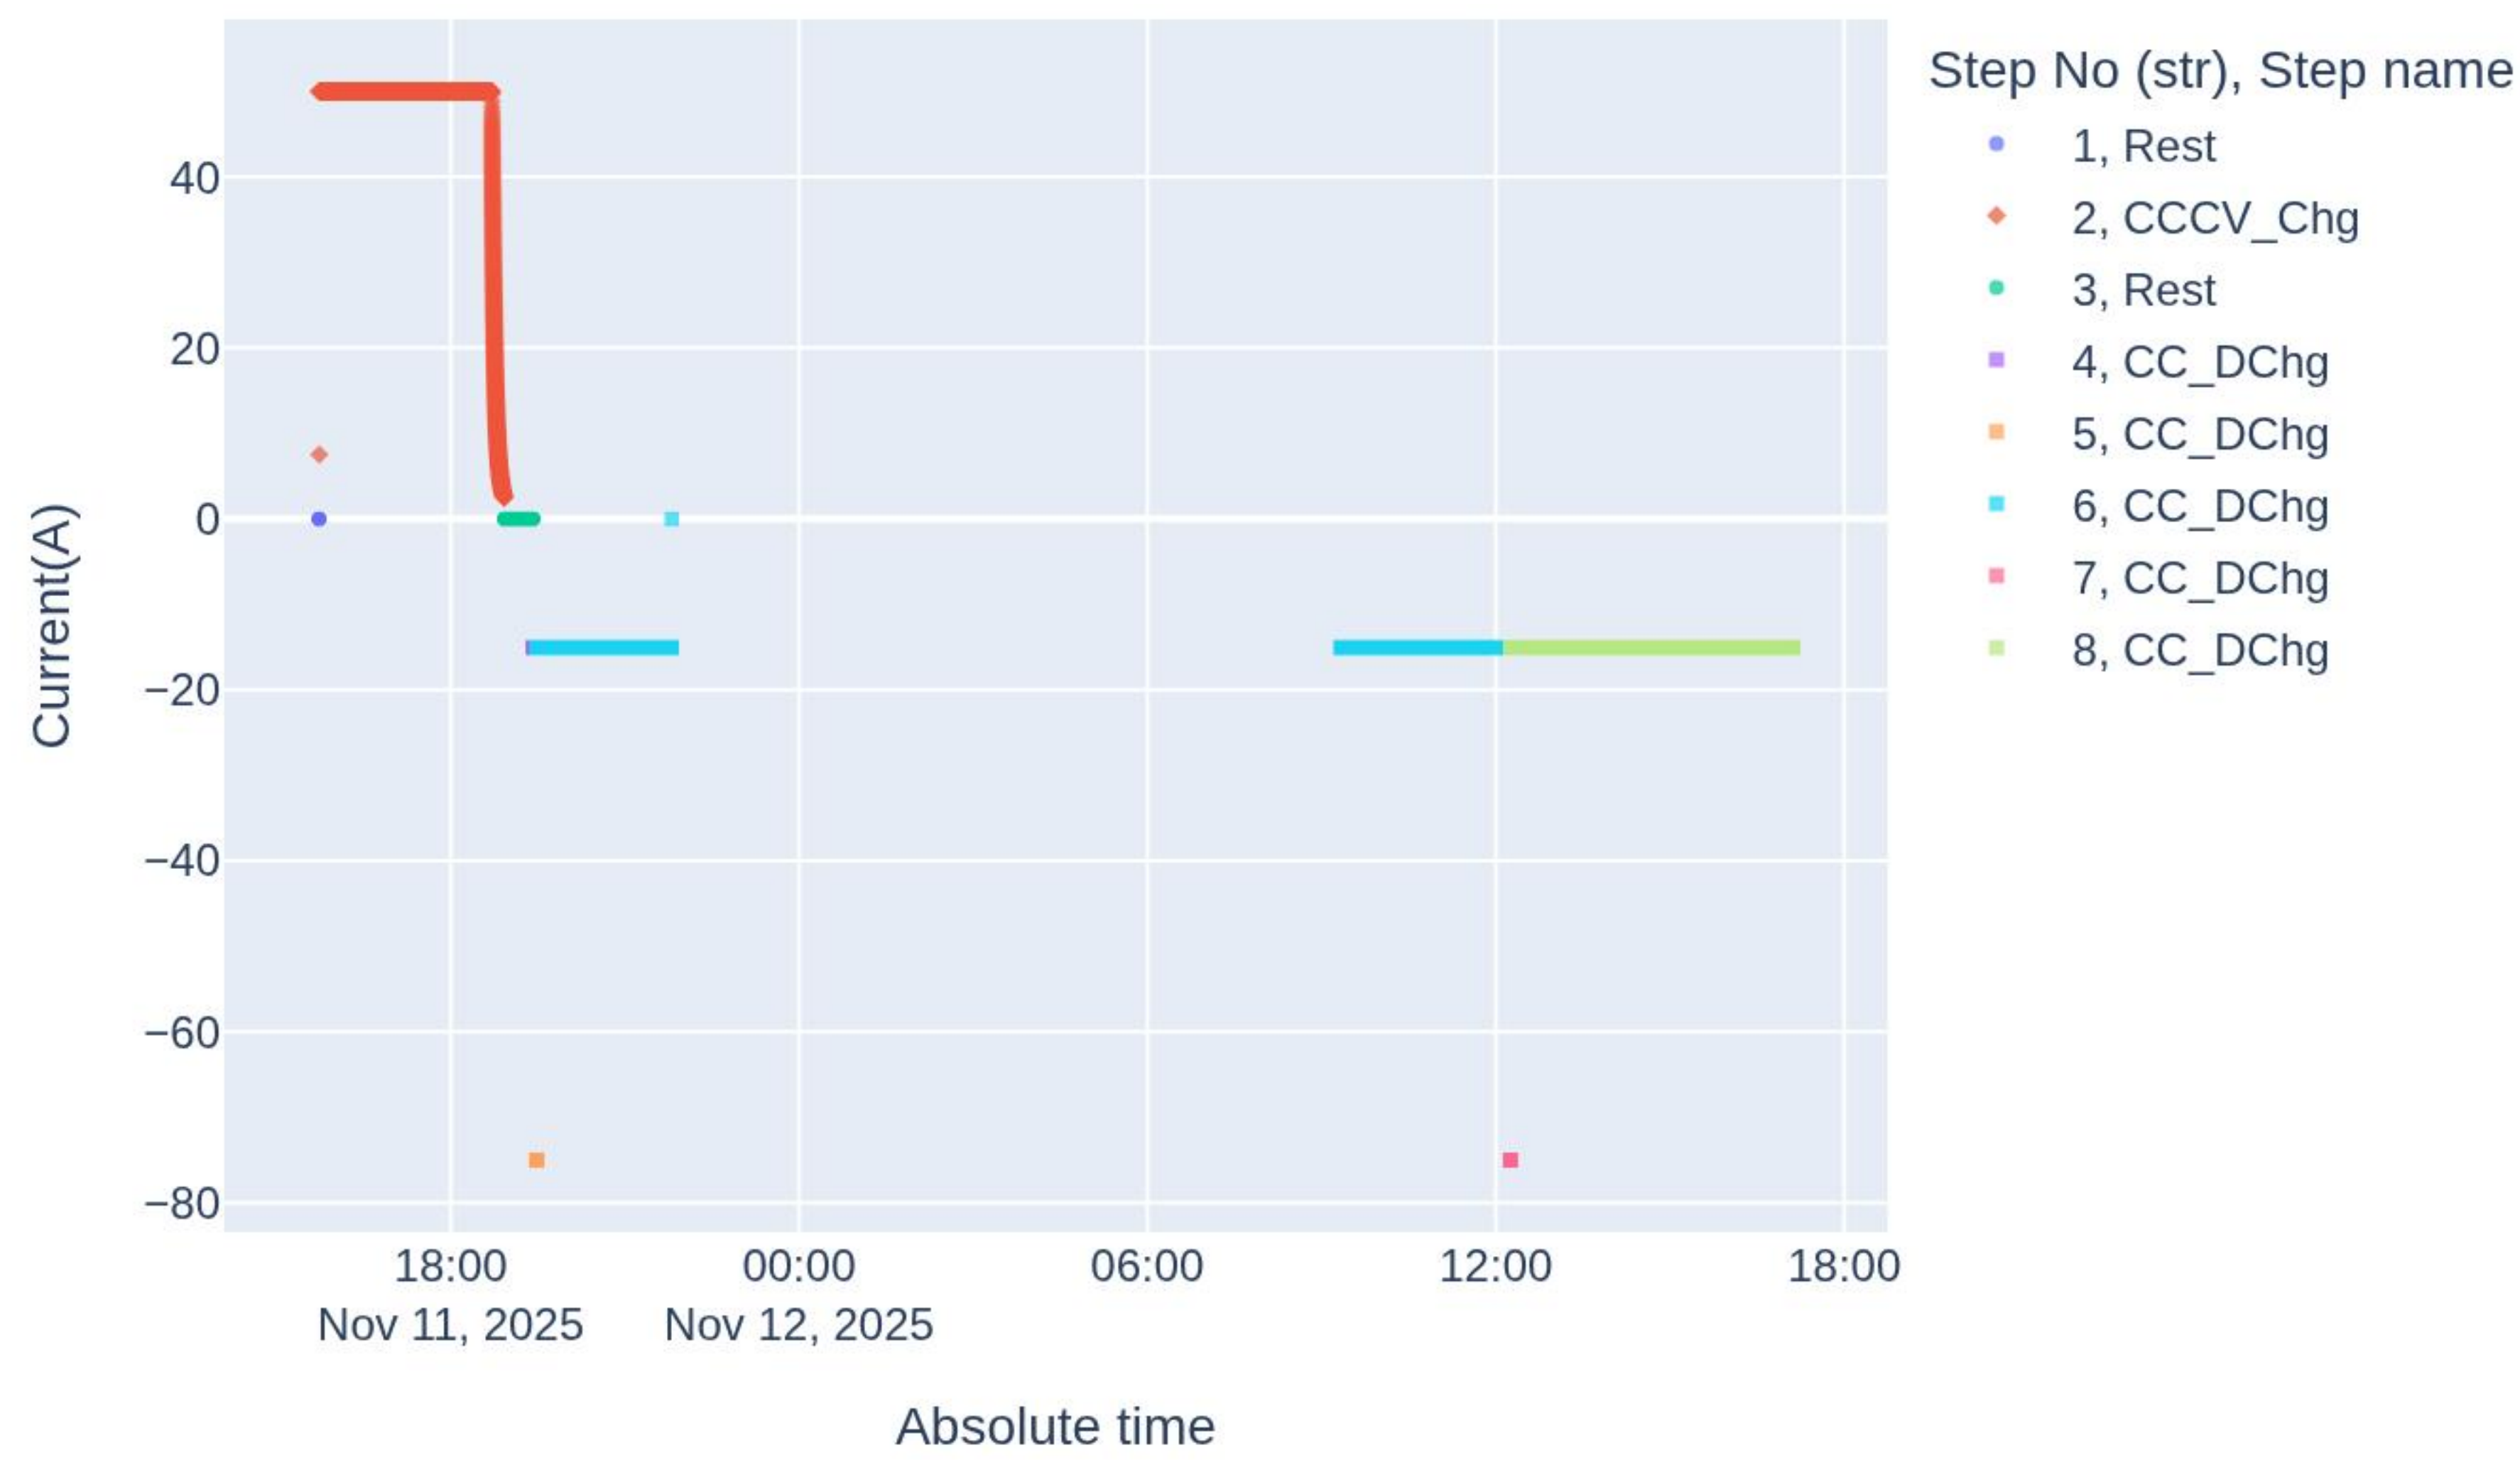


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0322_0_100.csv

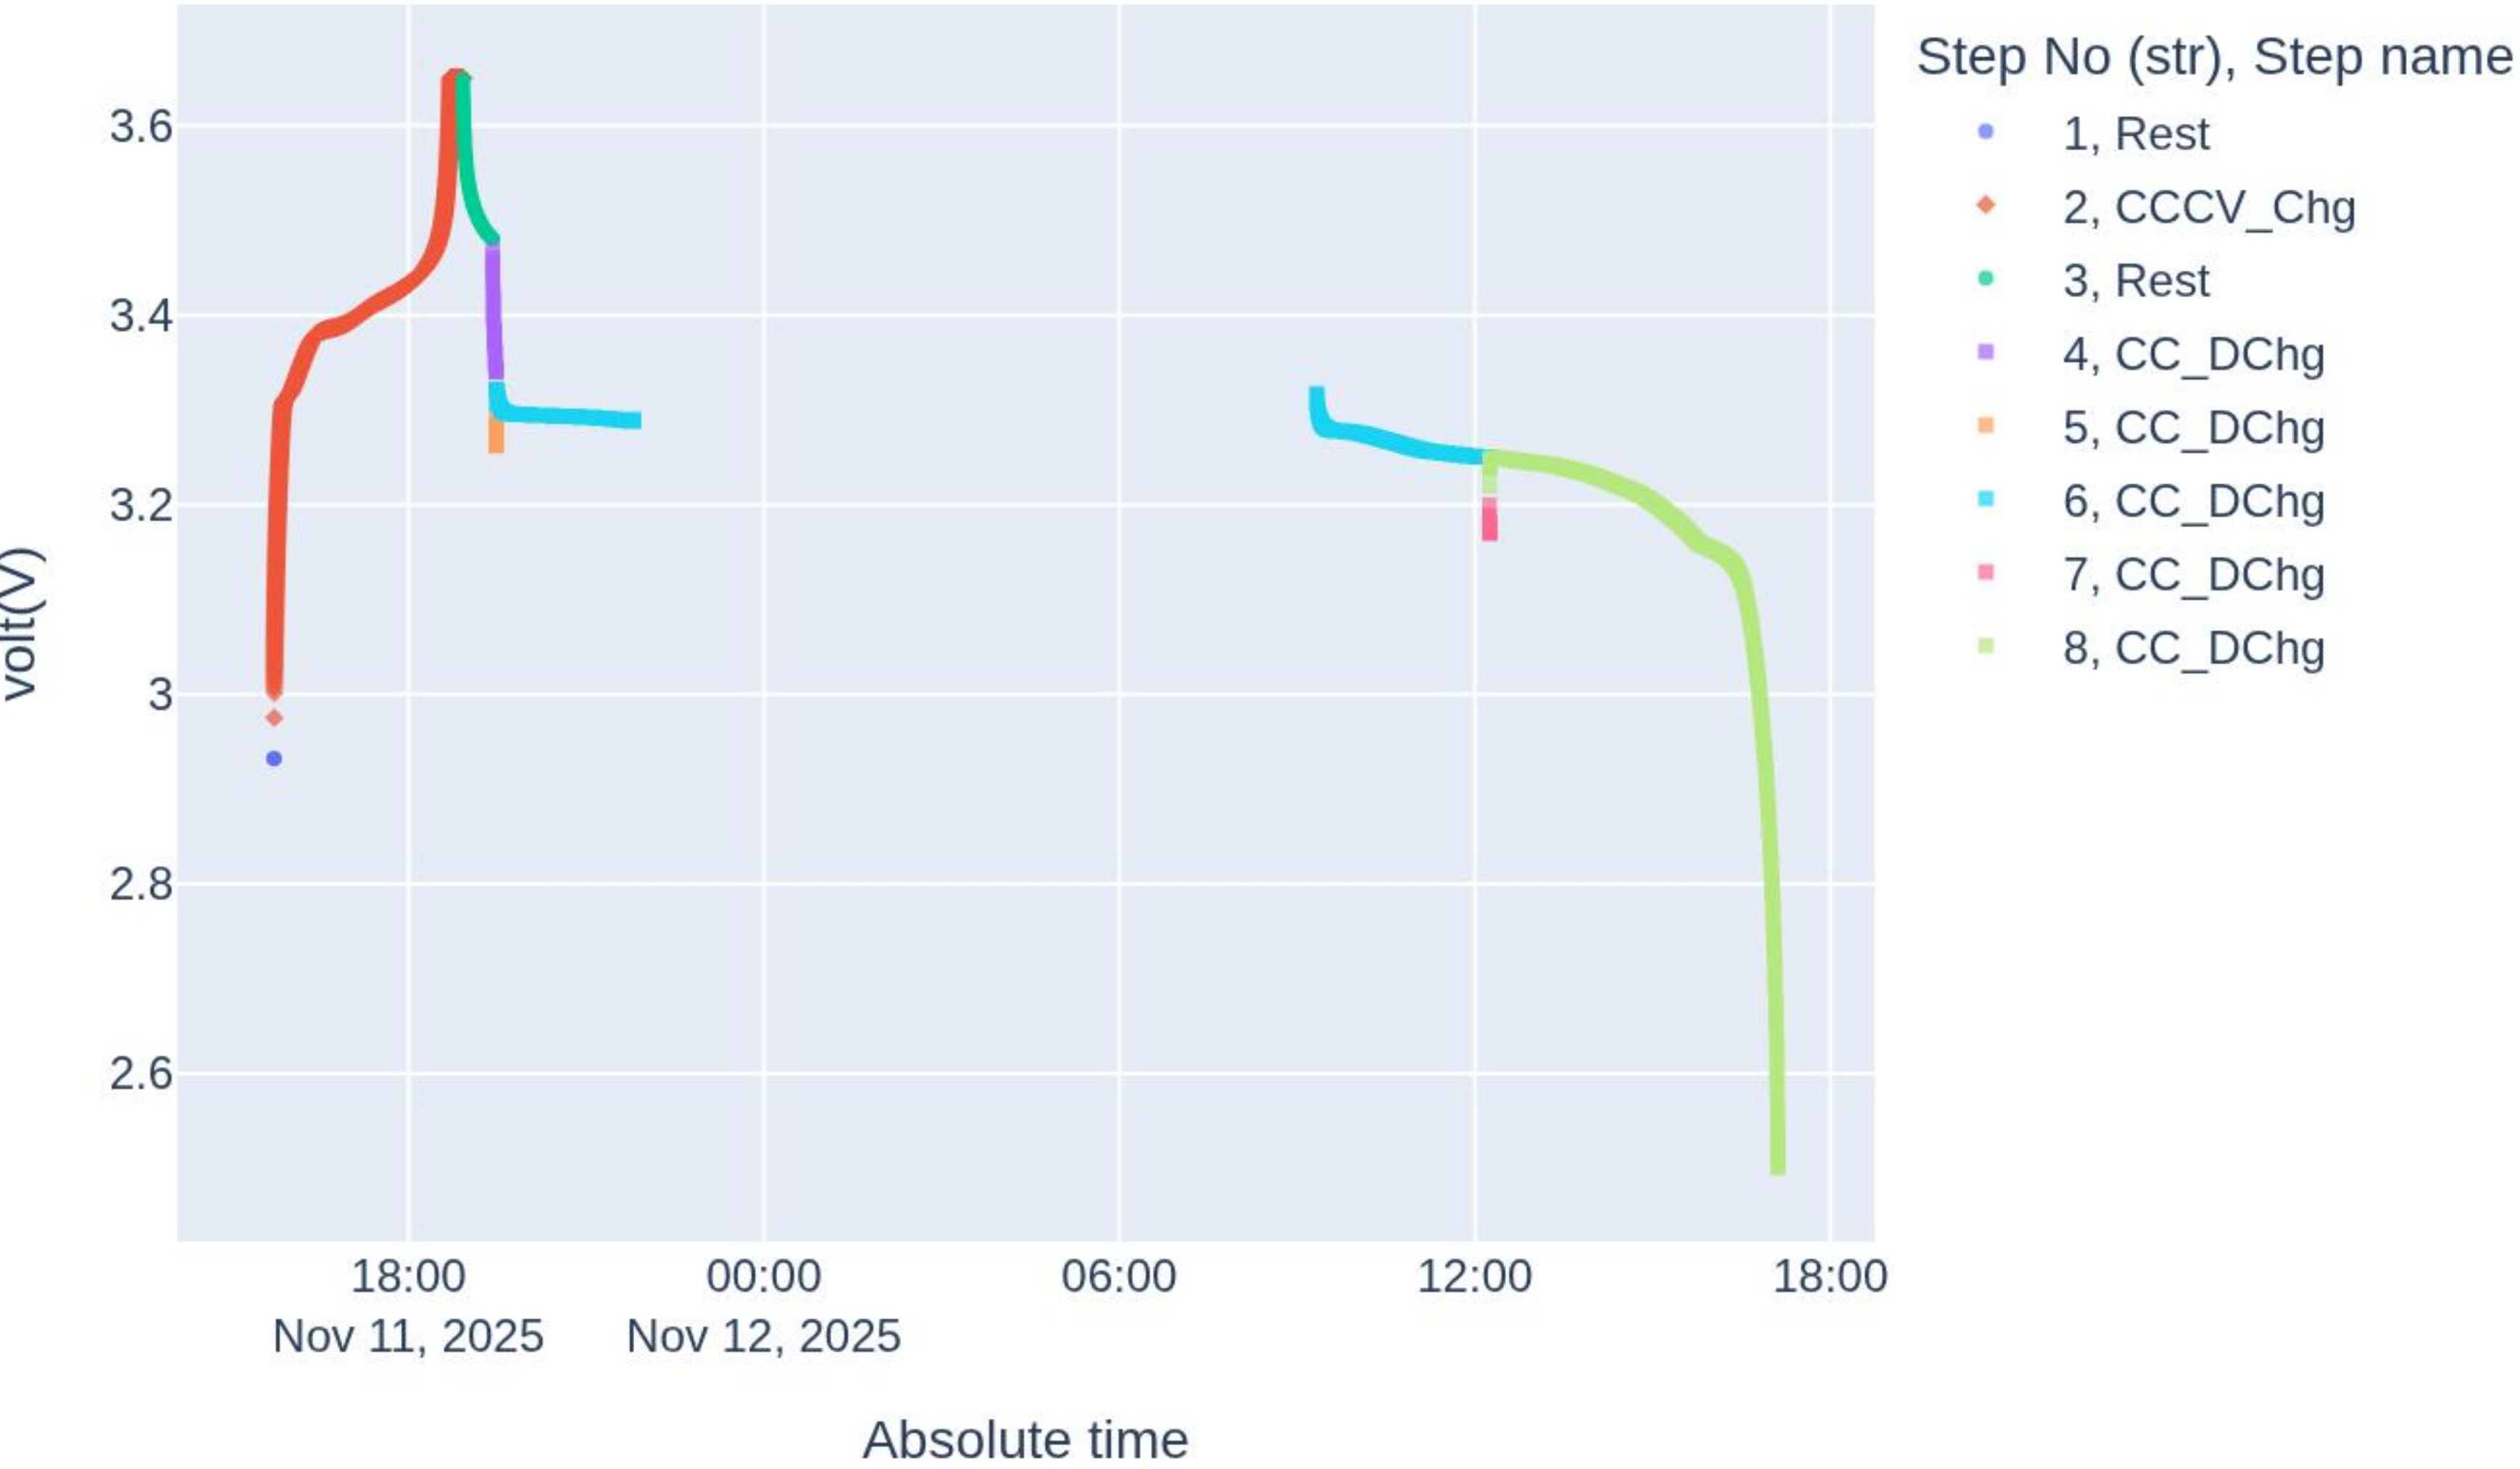


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0323_0_100.csv

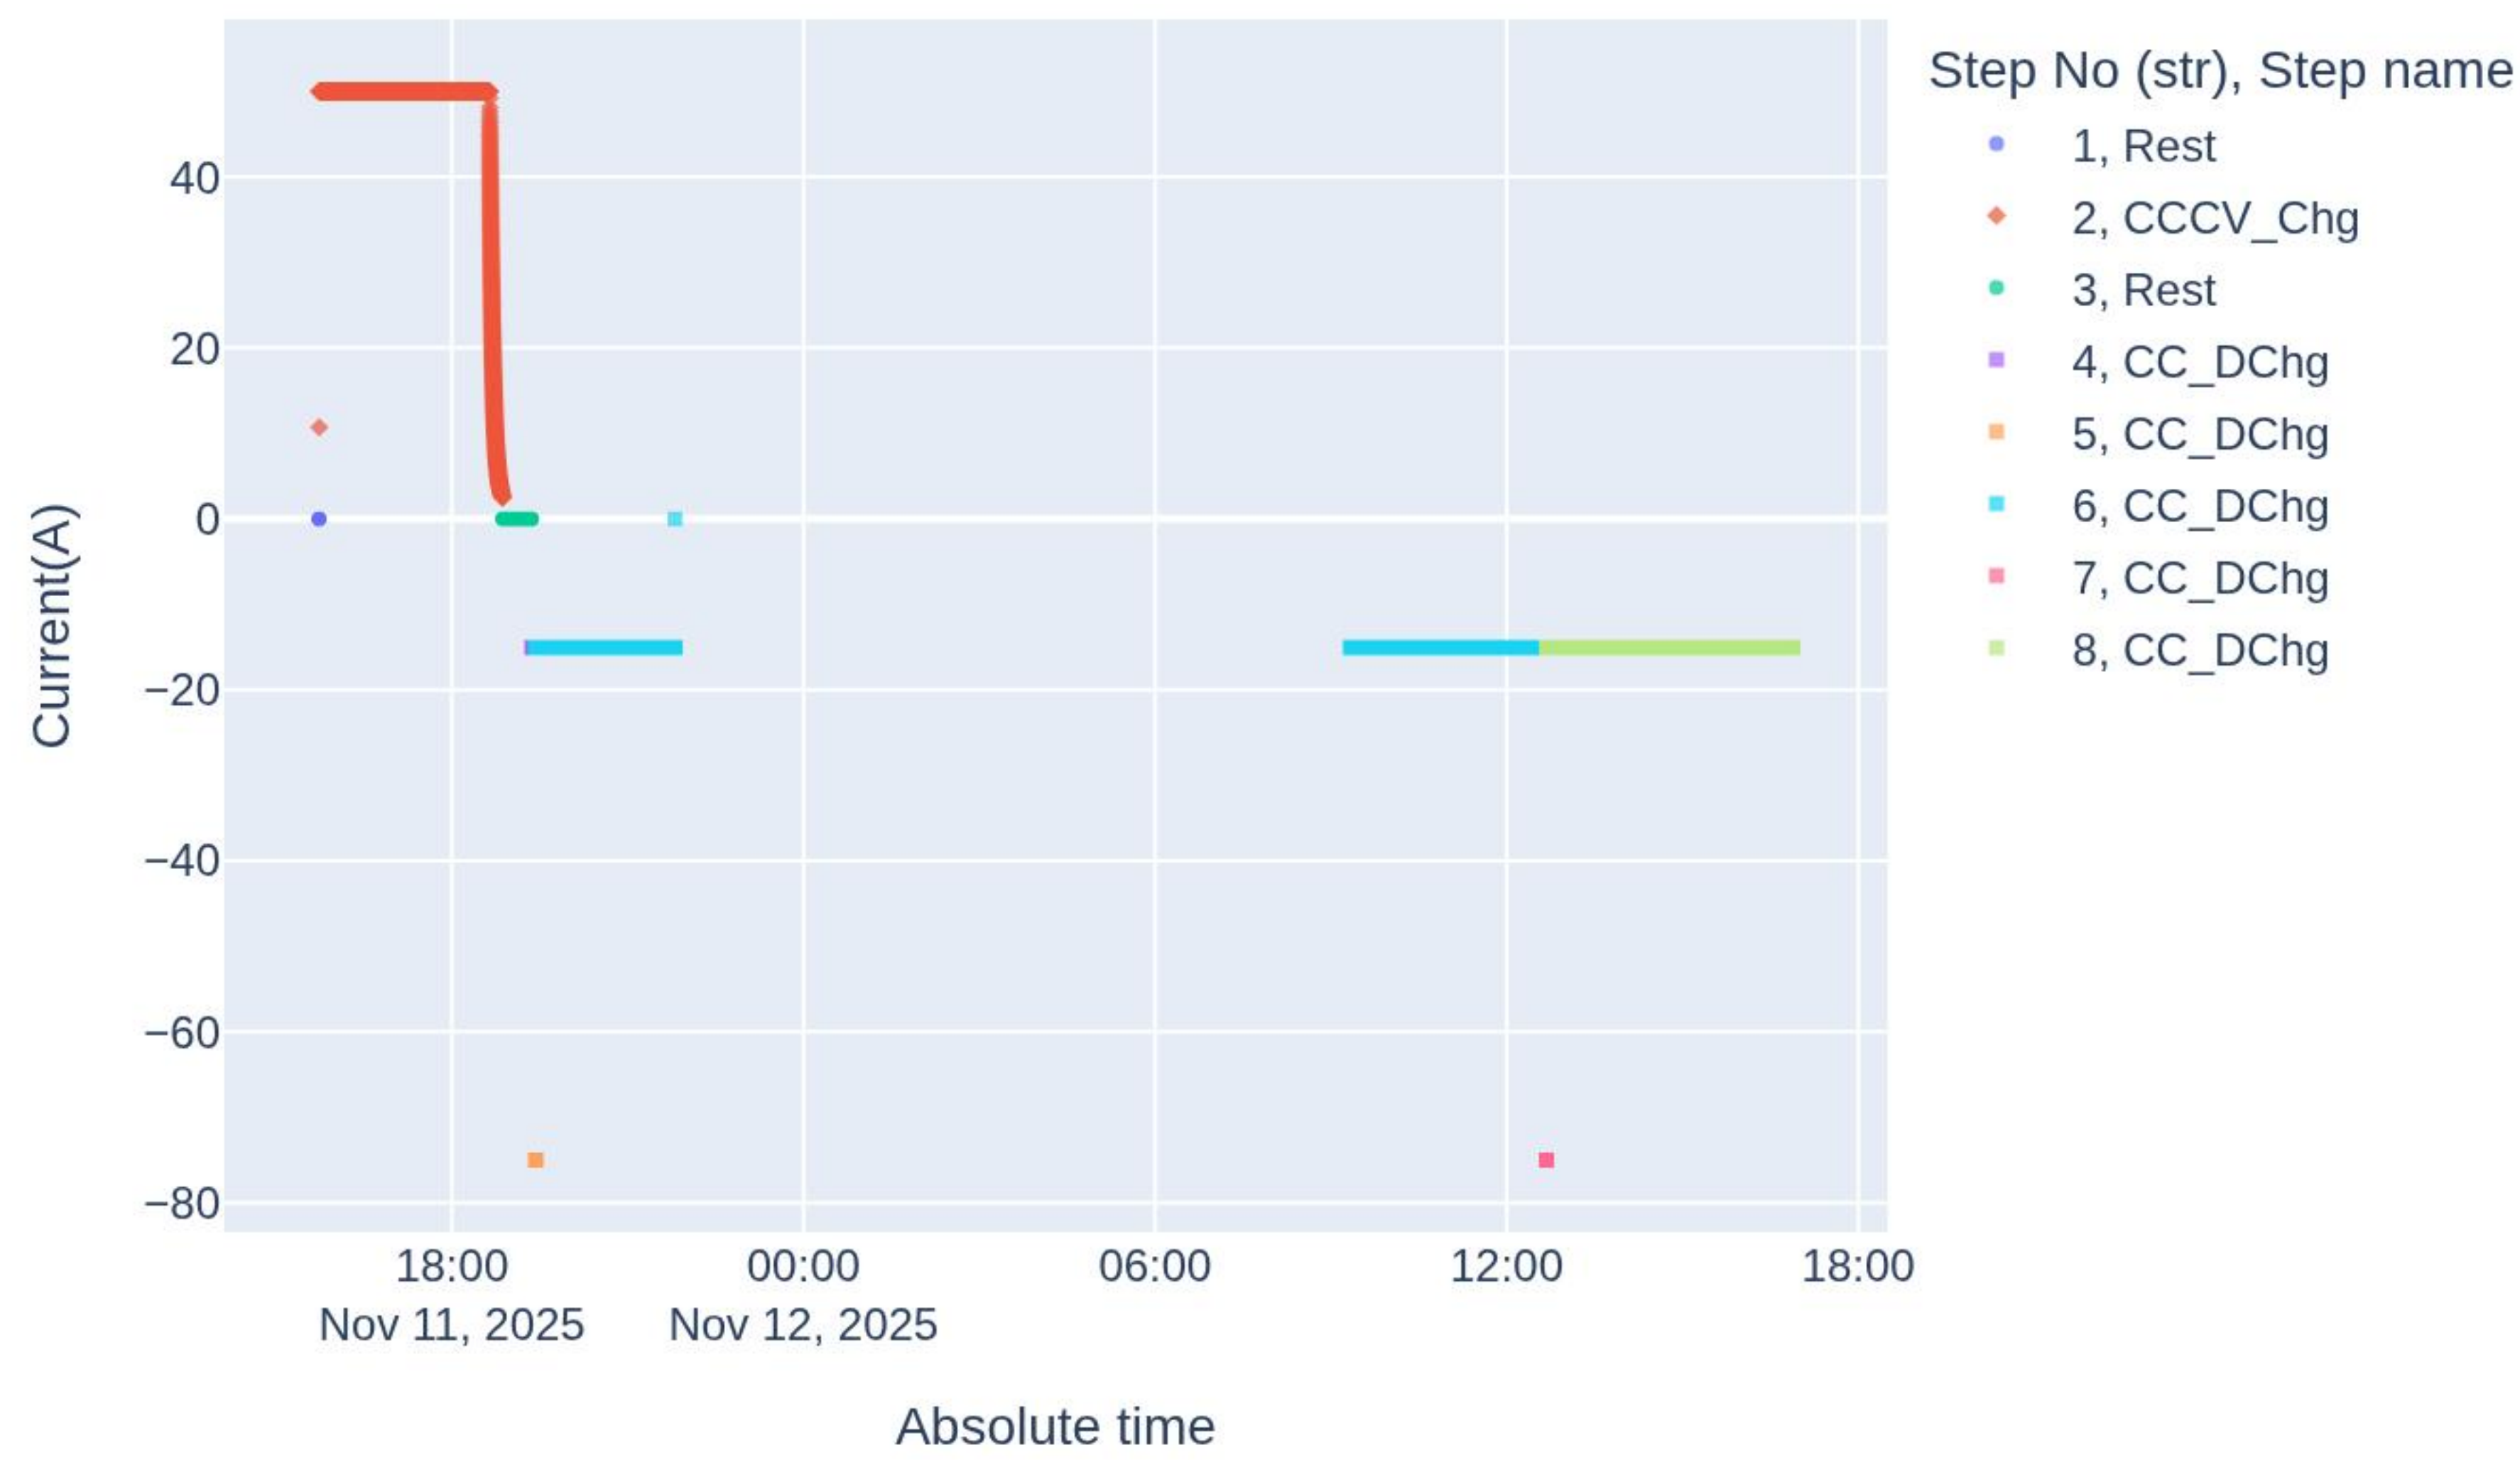


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0323_0_100.csv

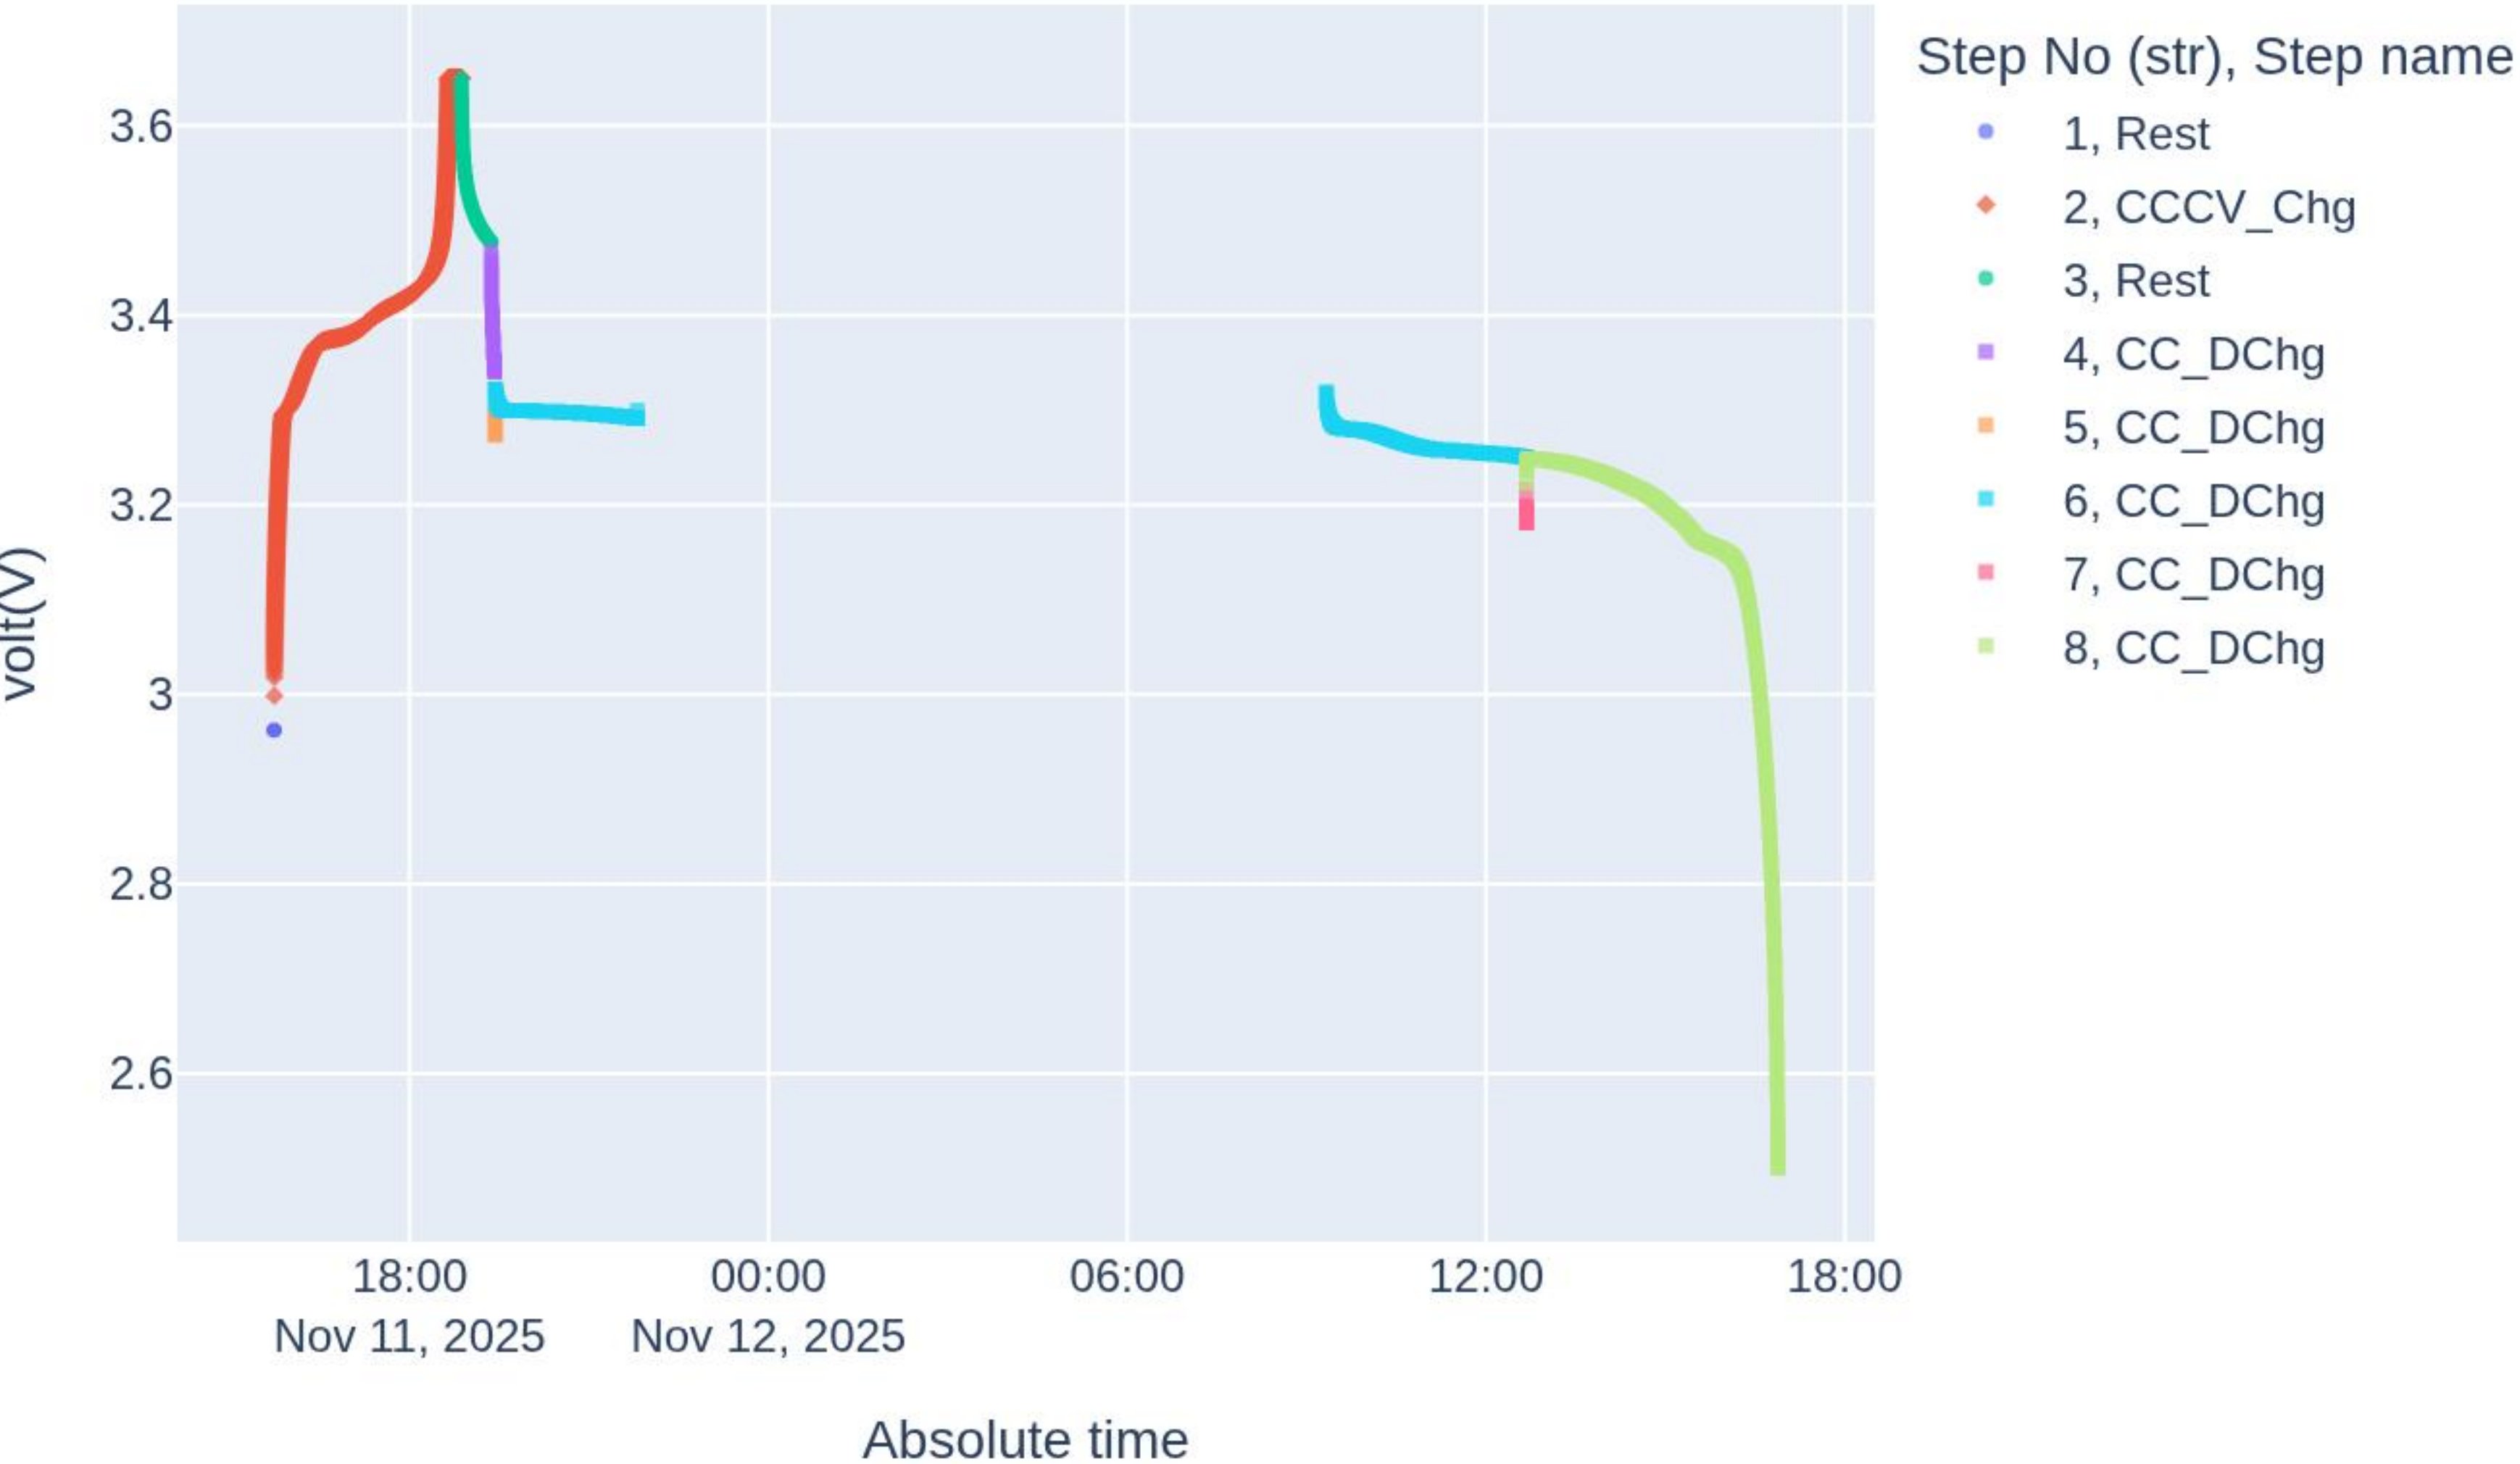


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0324_0_100.csv

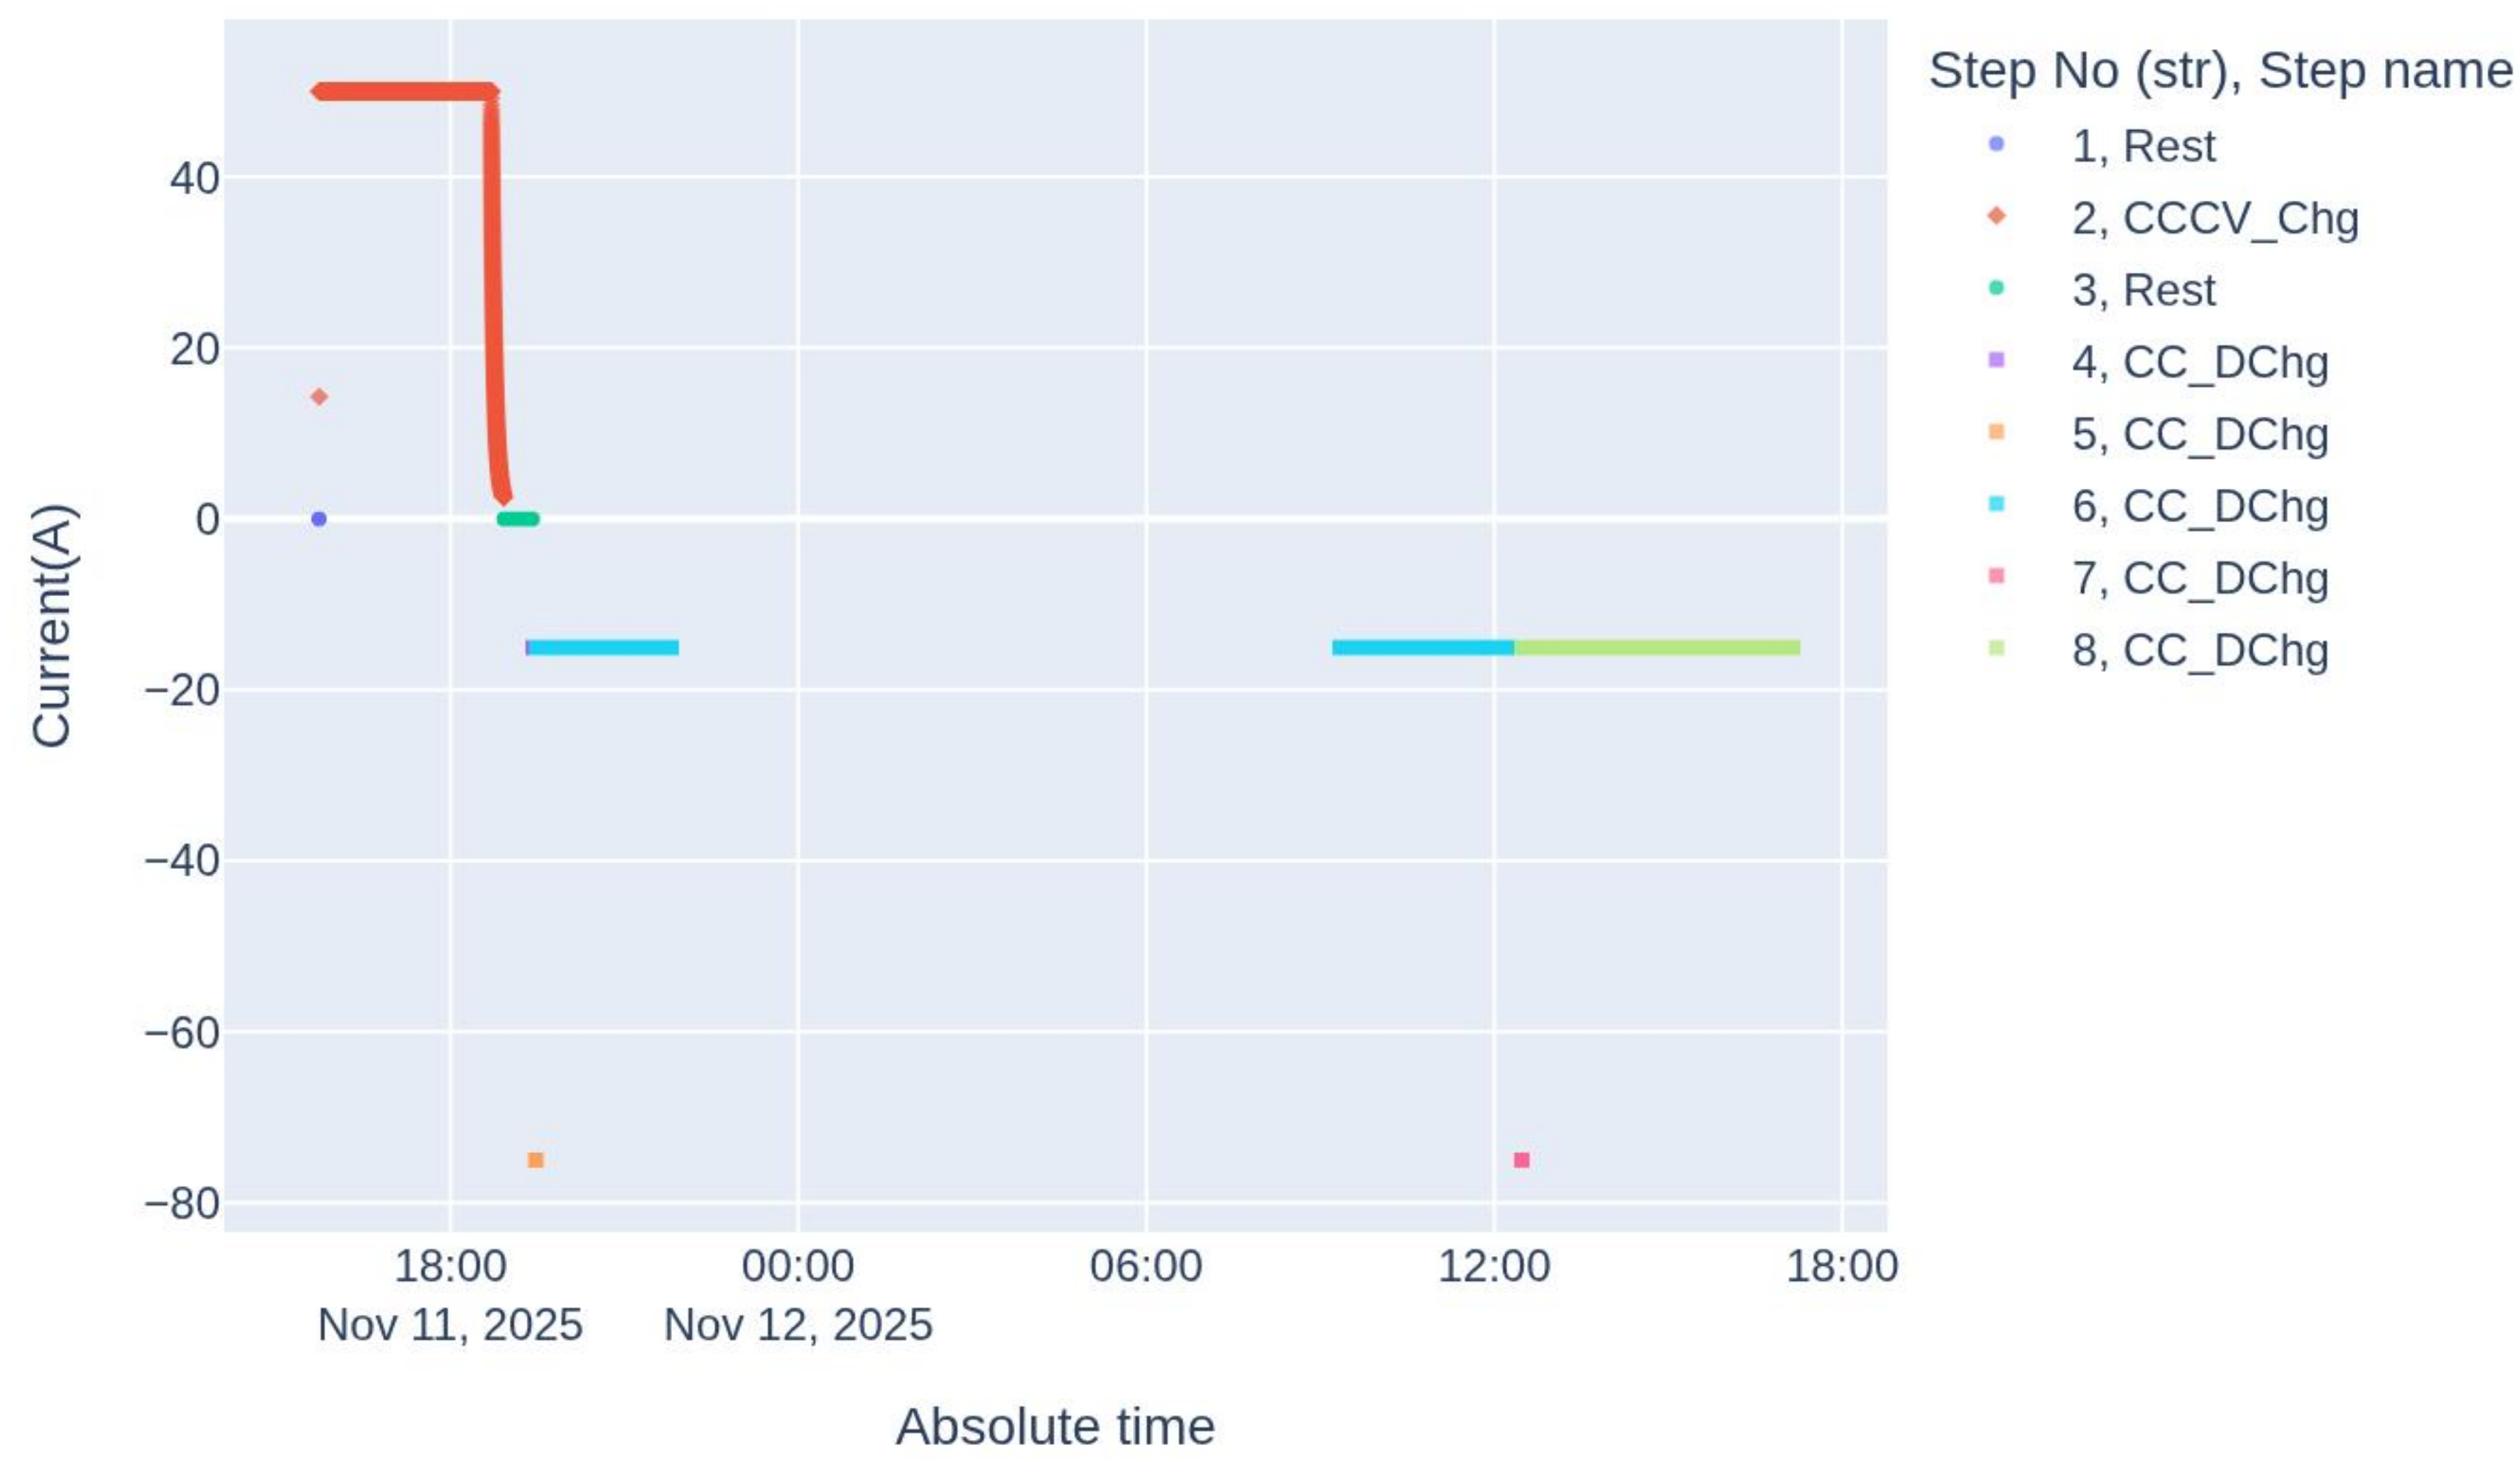


Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0324_0_100.csv

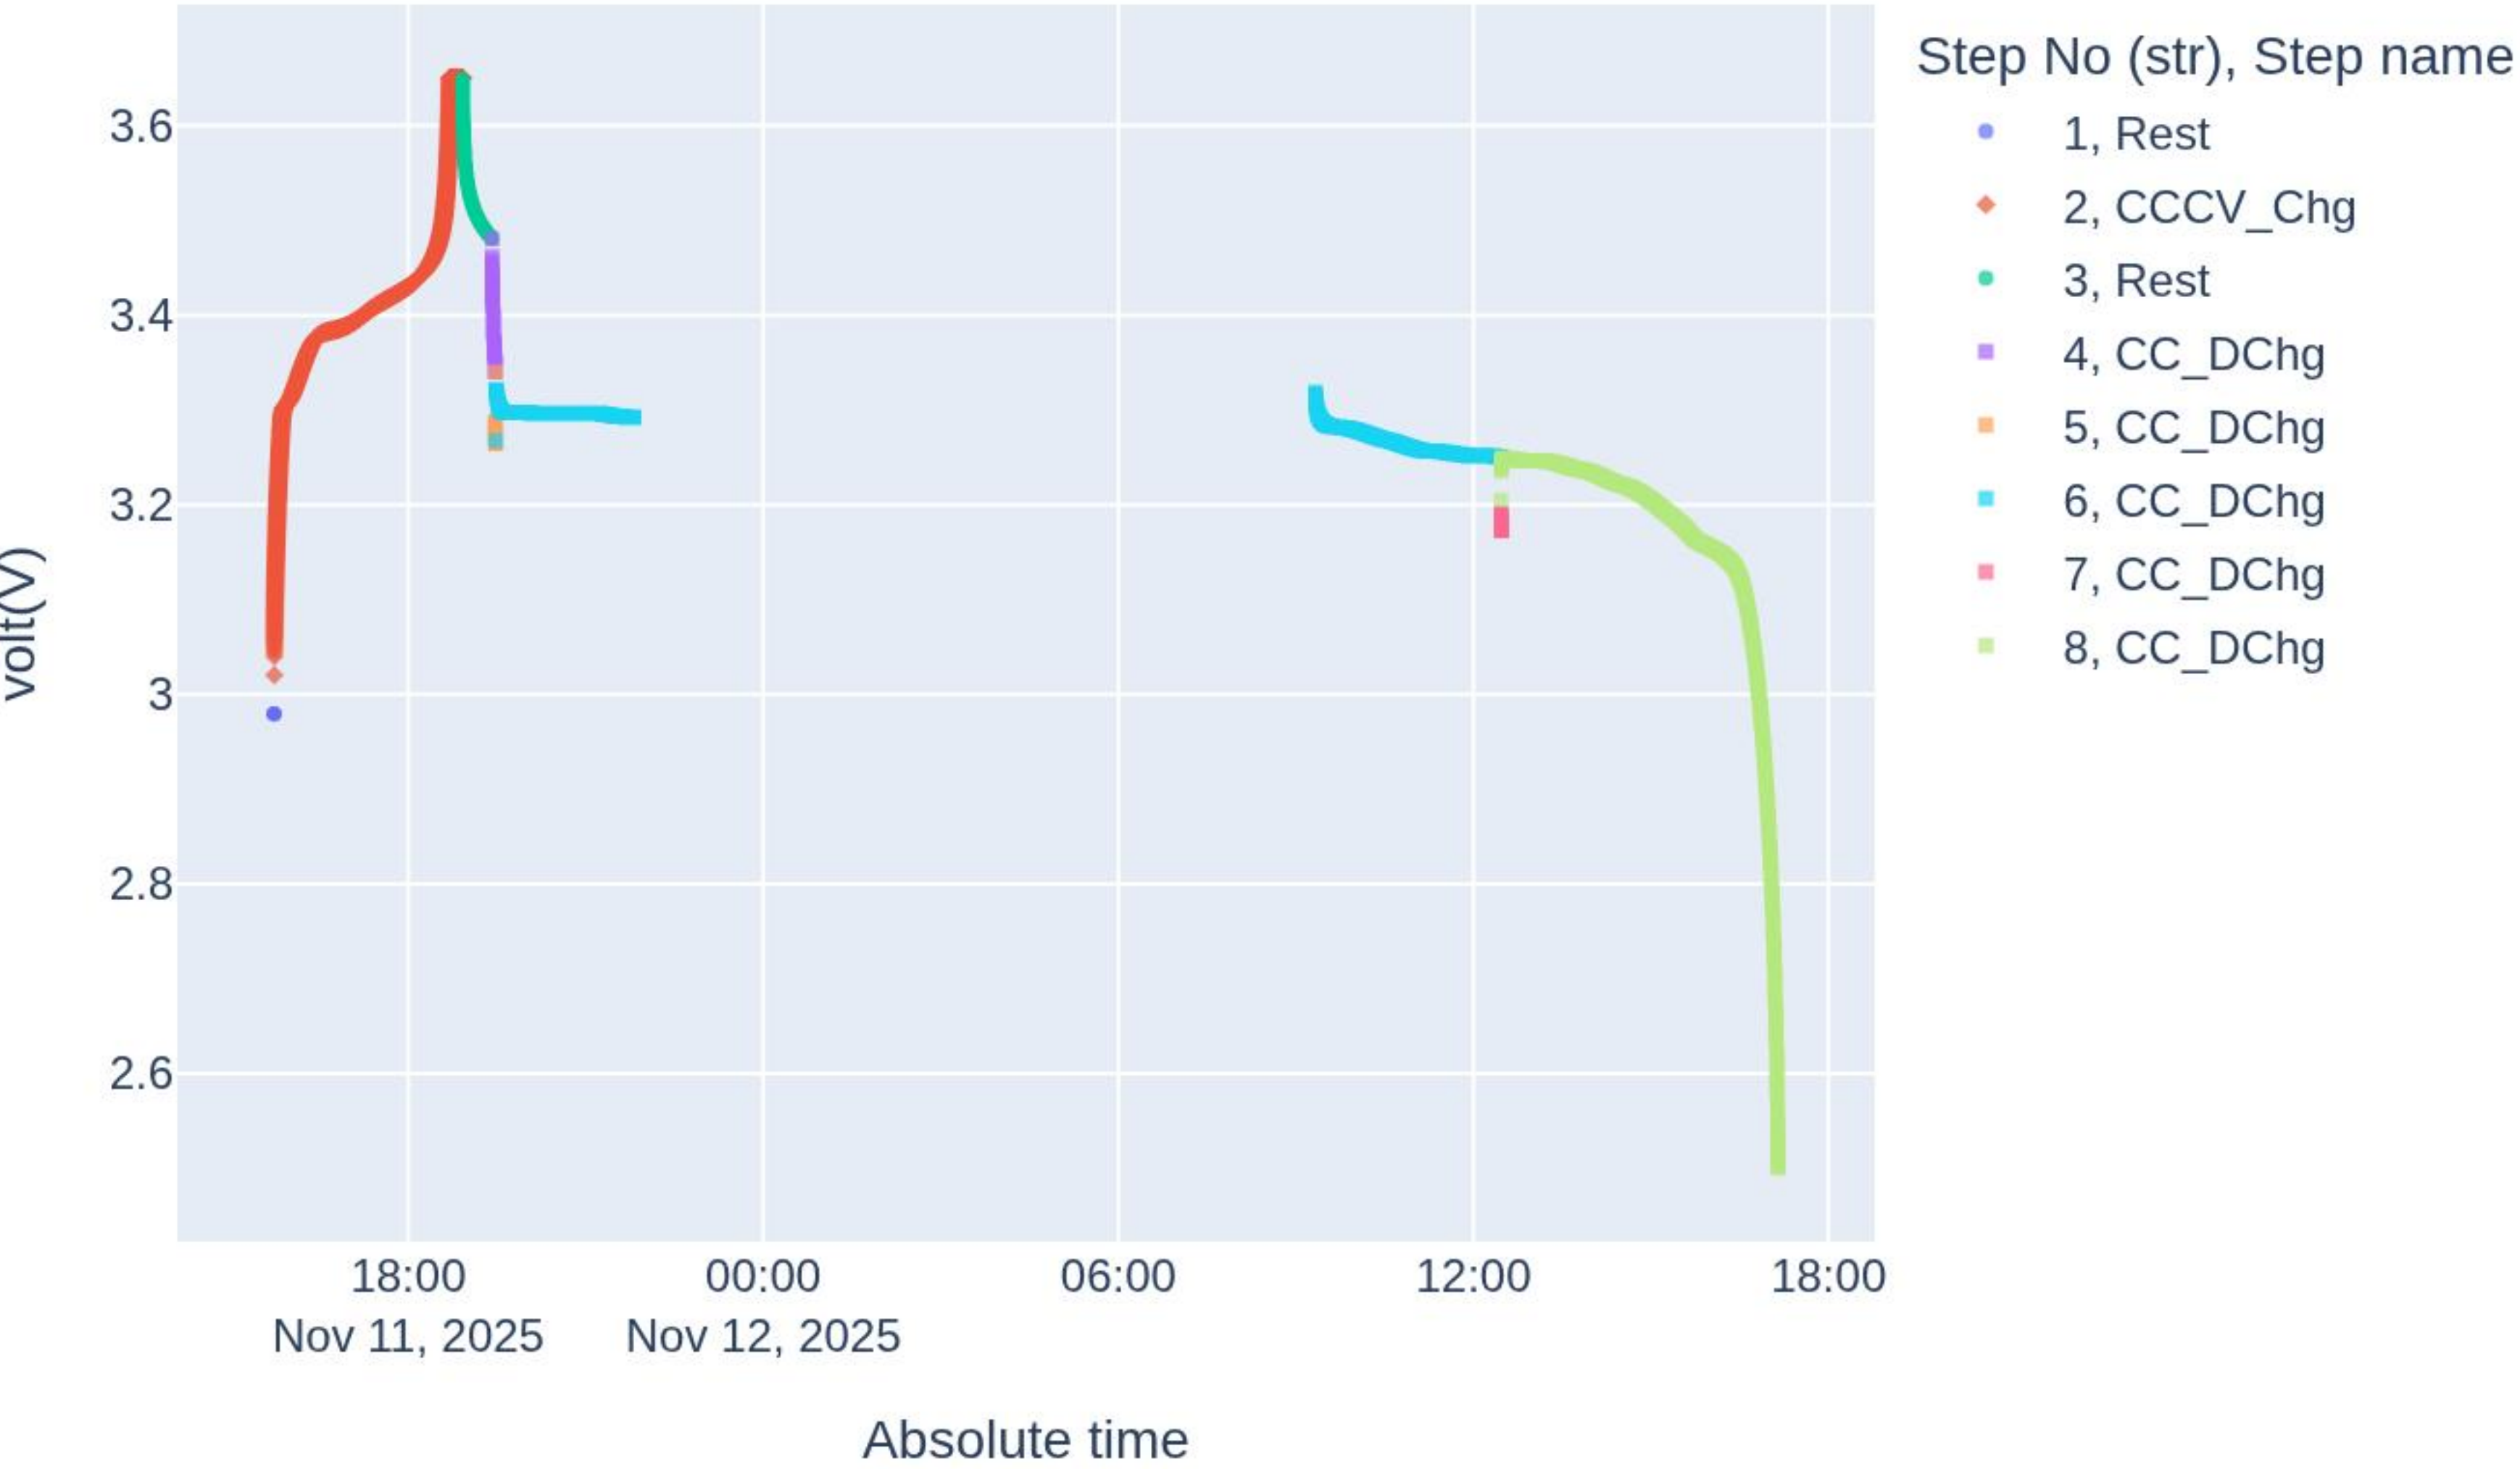


Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0325_0_100.csv

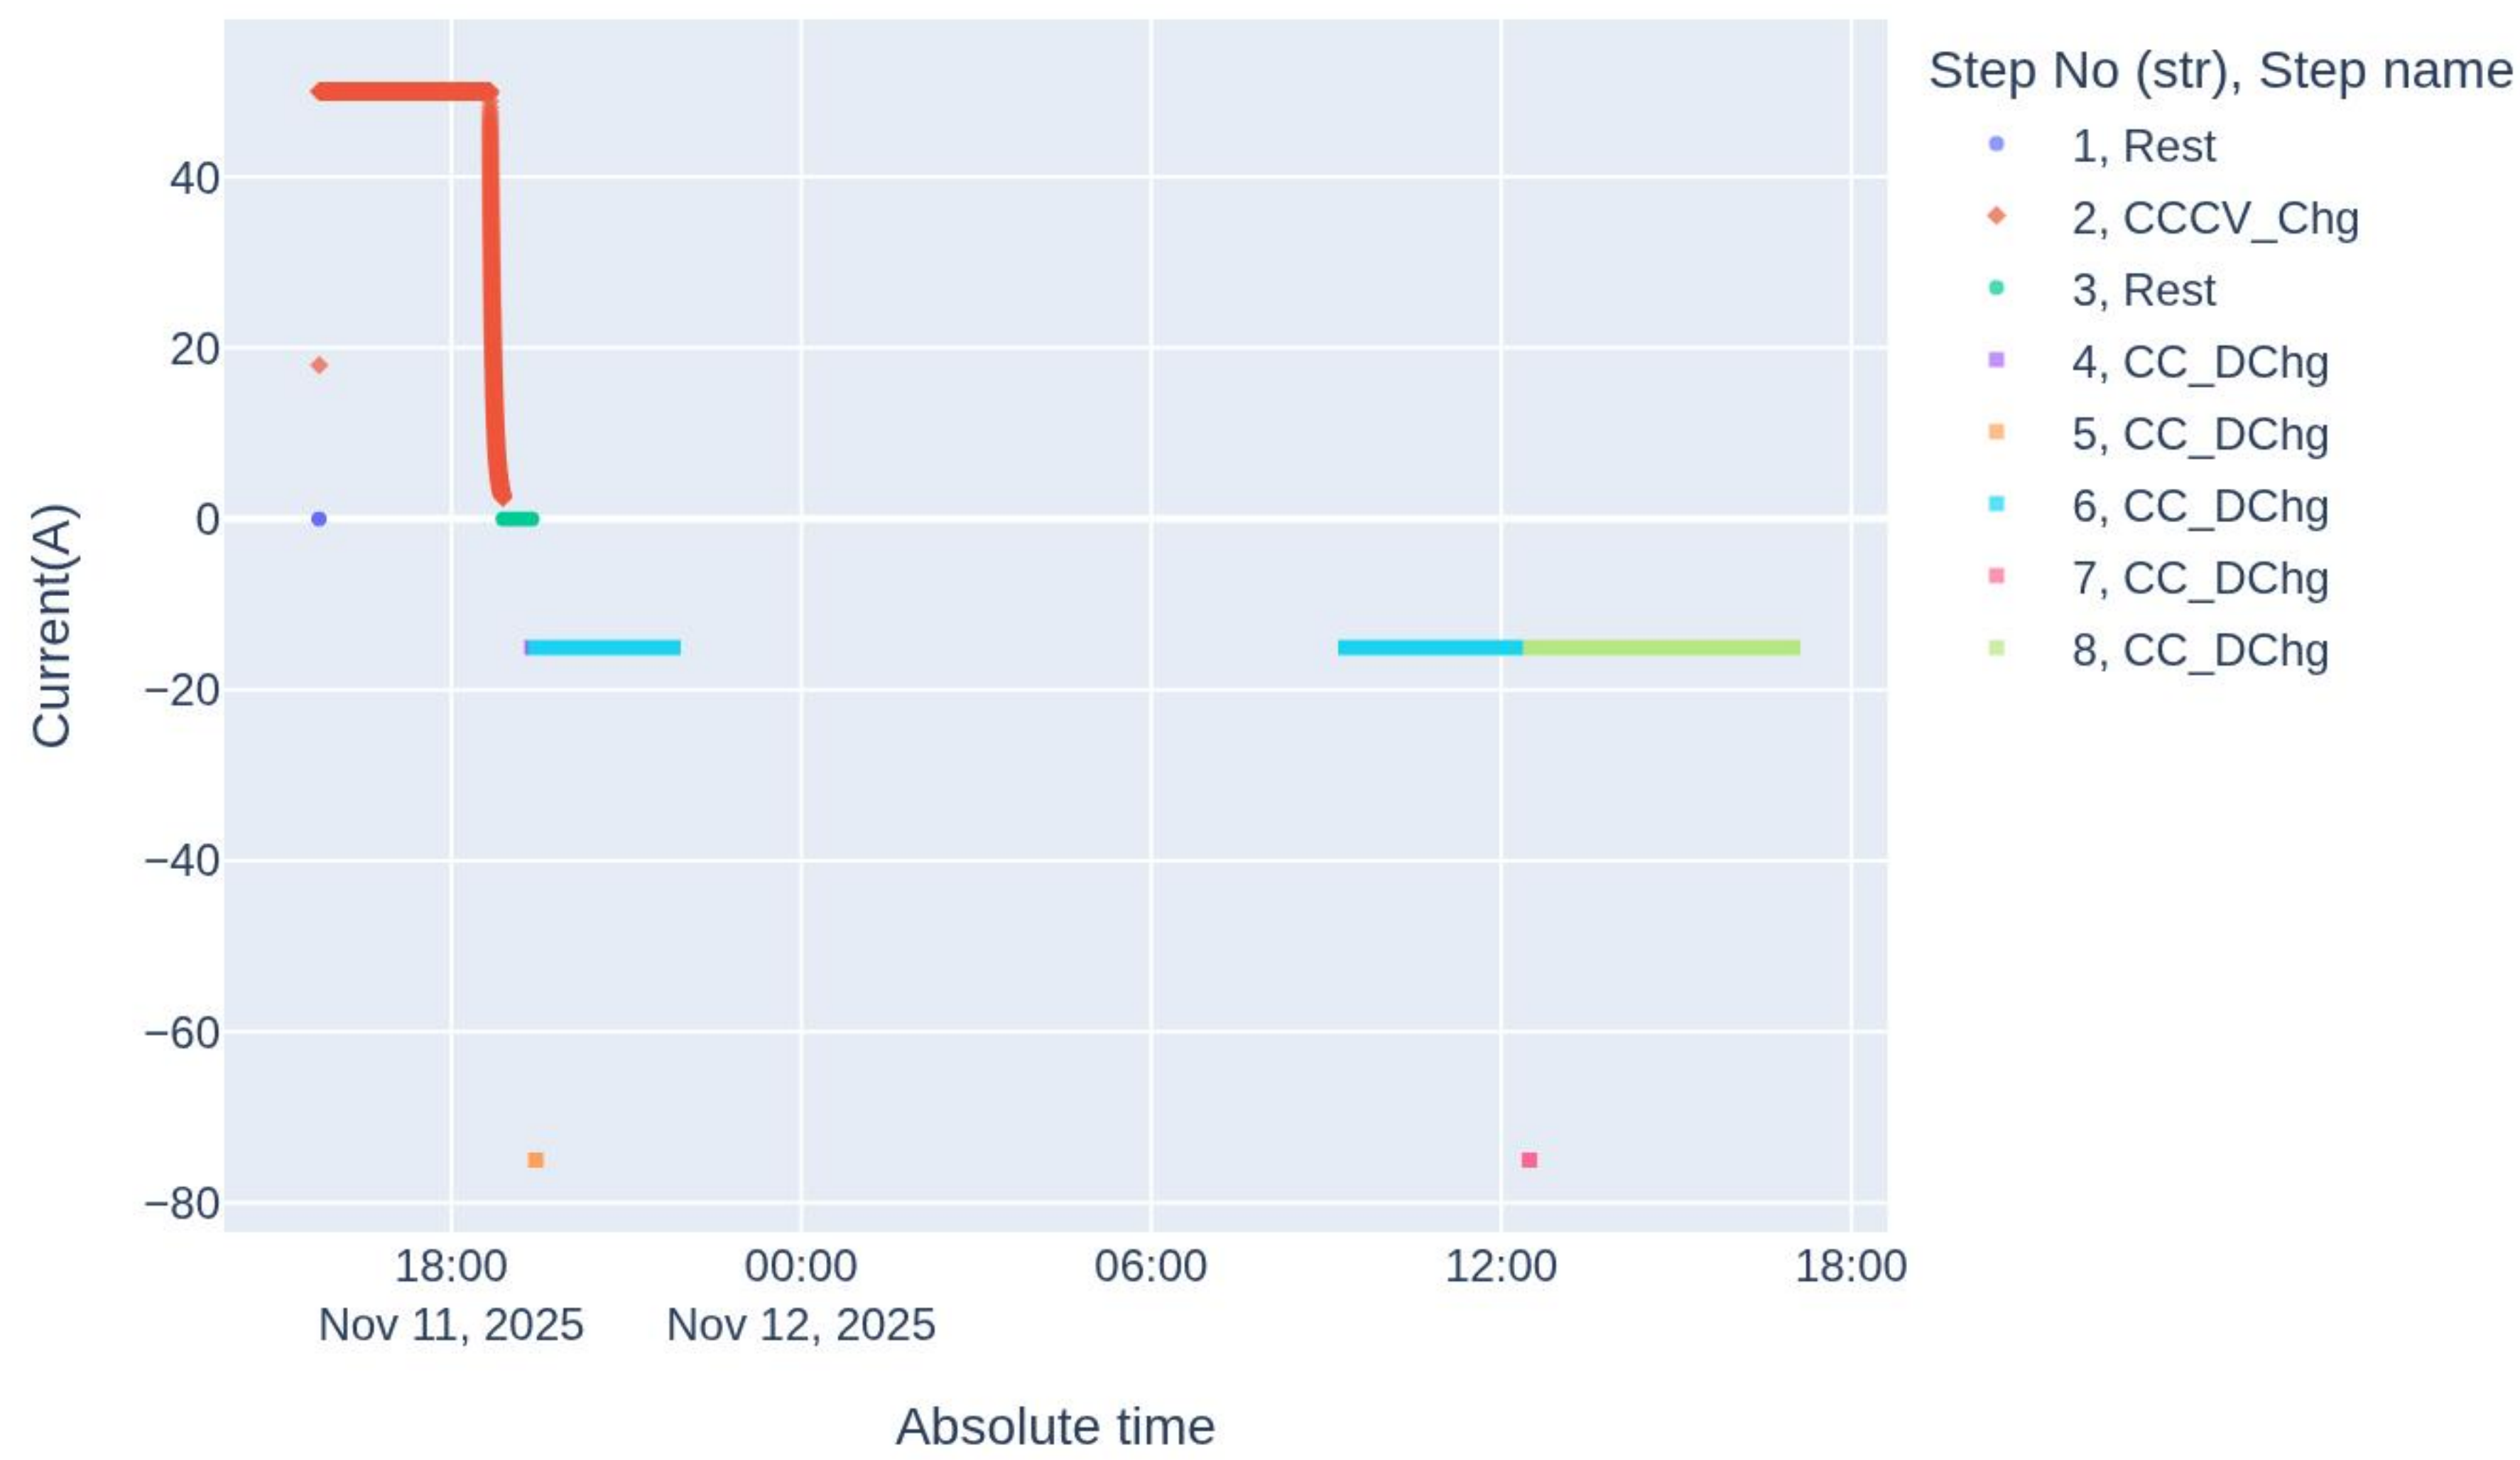

Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0325_0_100.csv

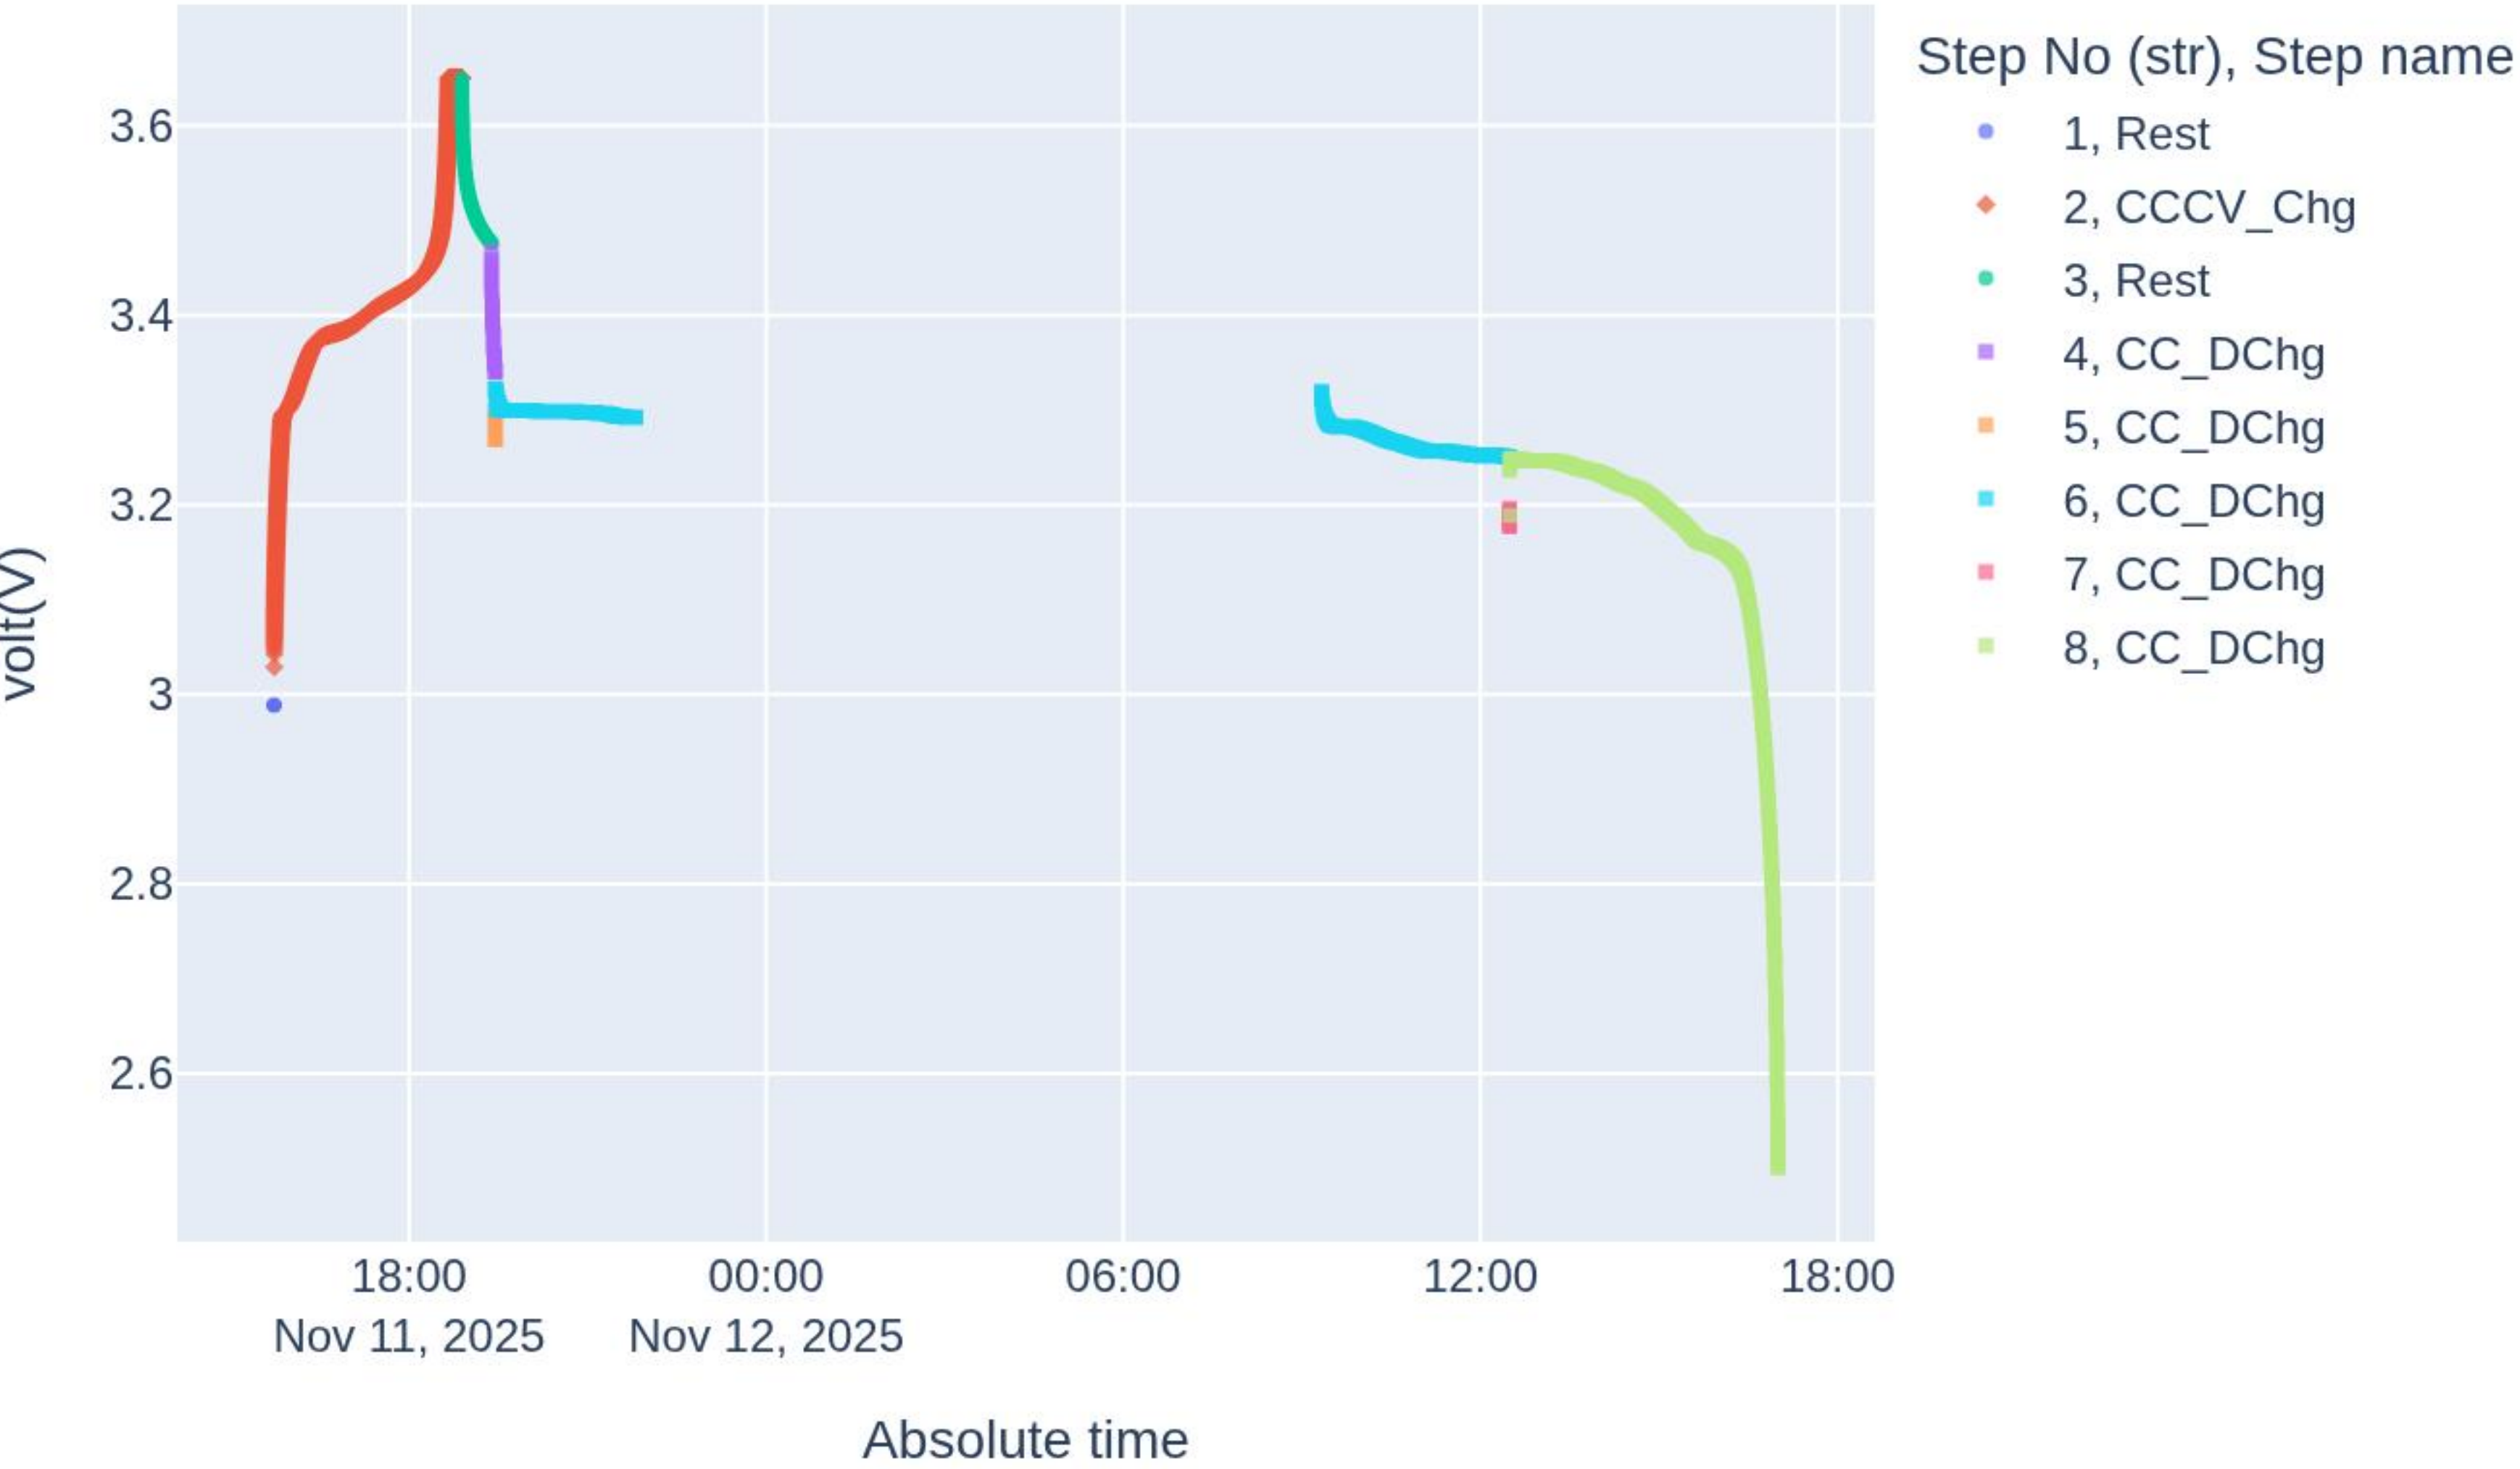

Current vs Absolute Time — PR_LFP_DCIR_REPT_150_0326_0_100.csv

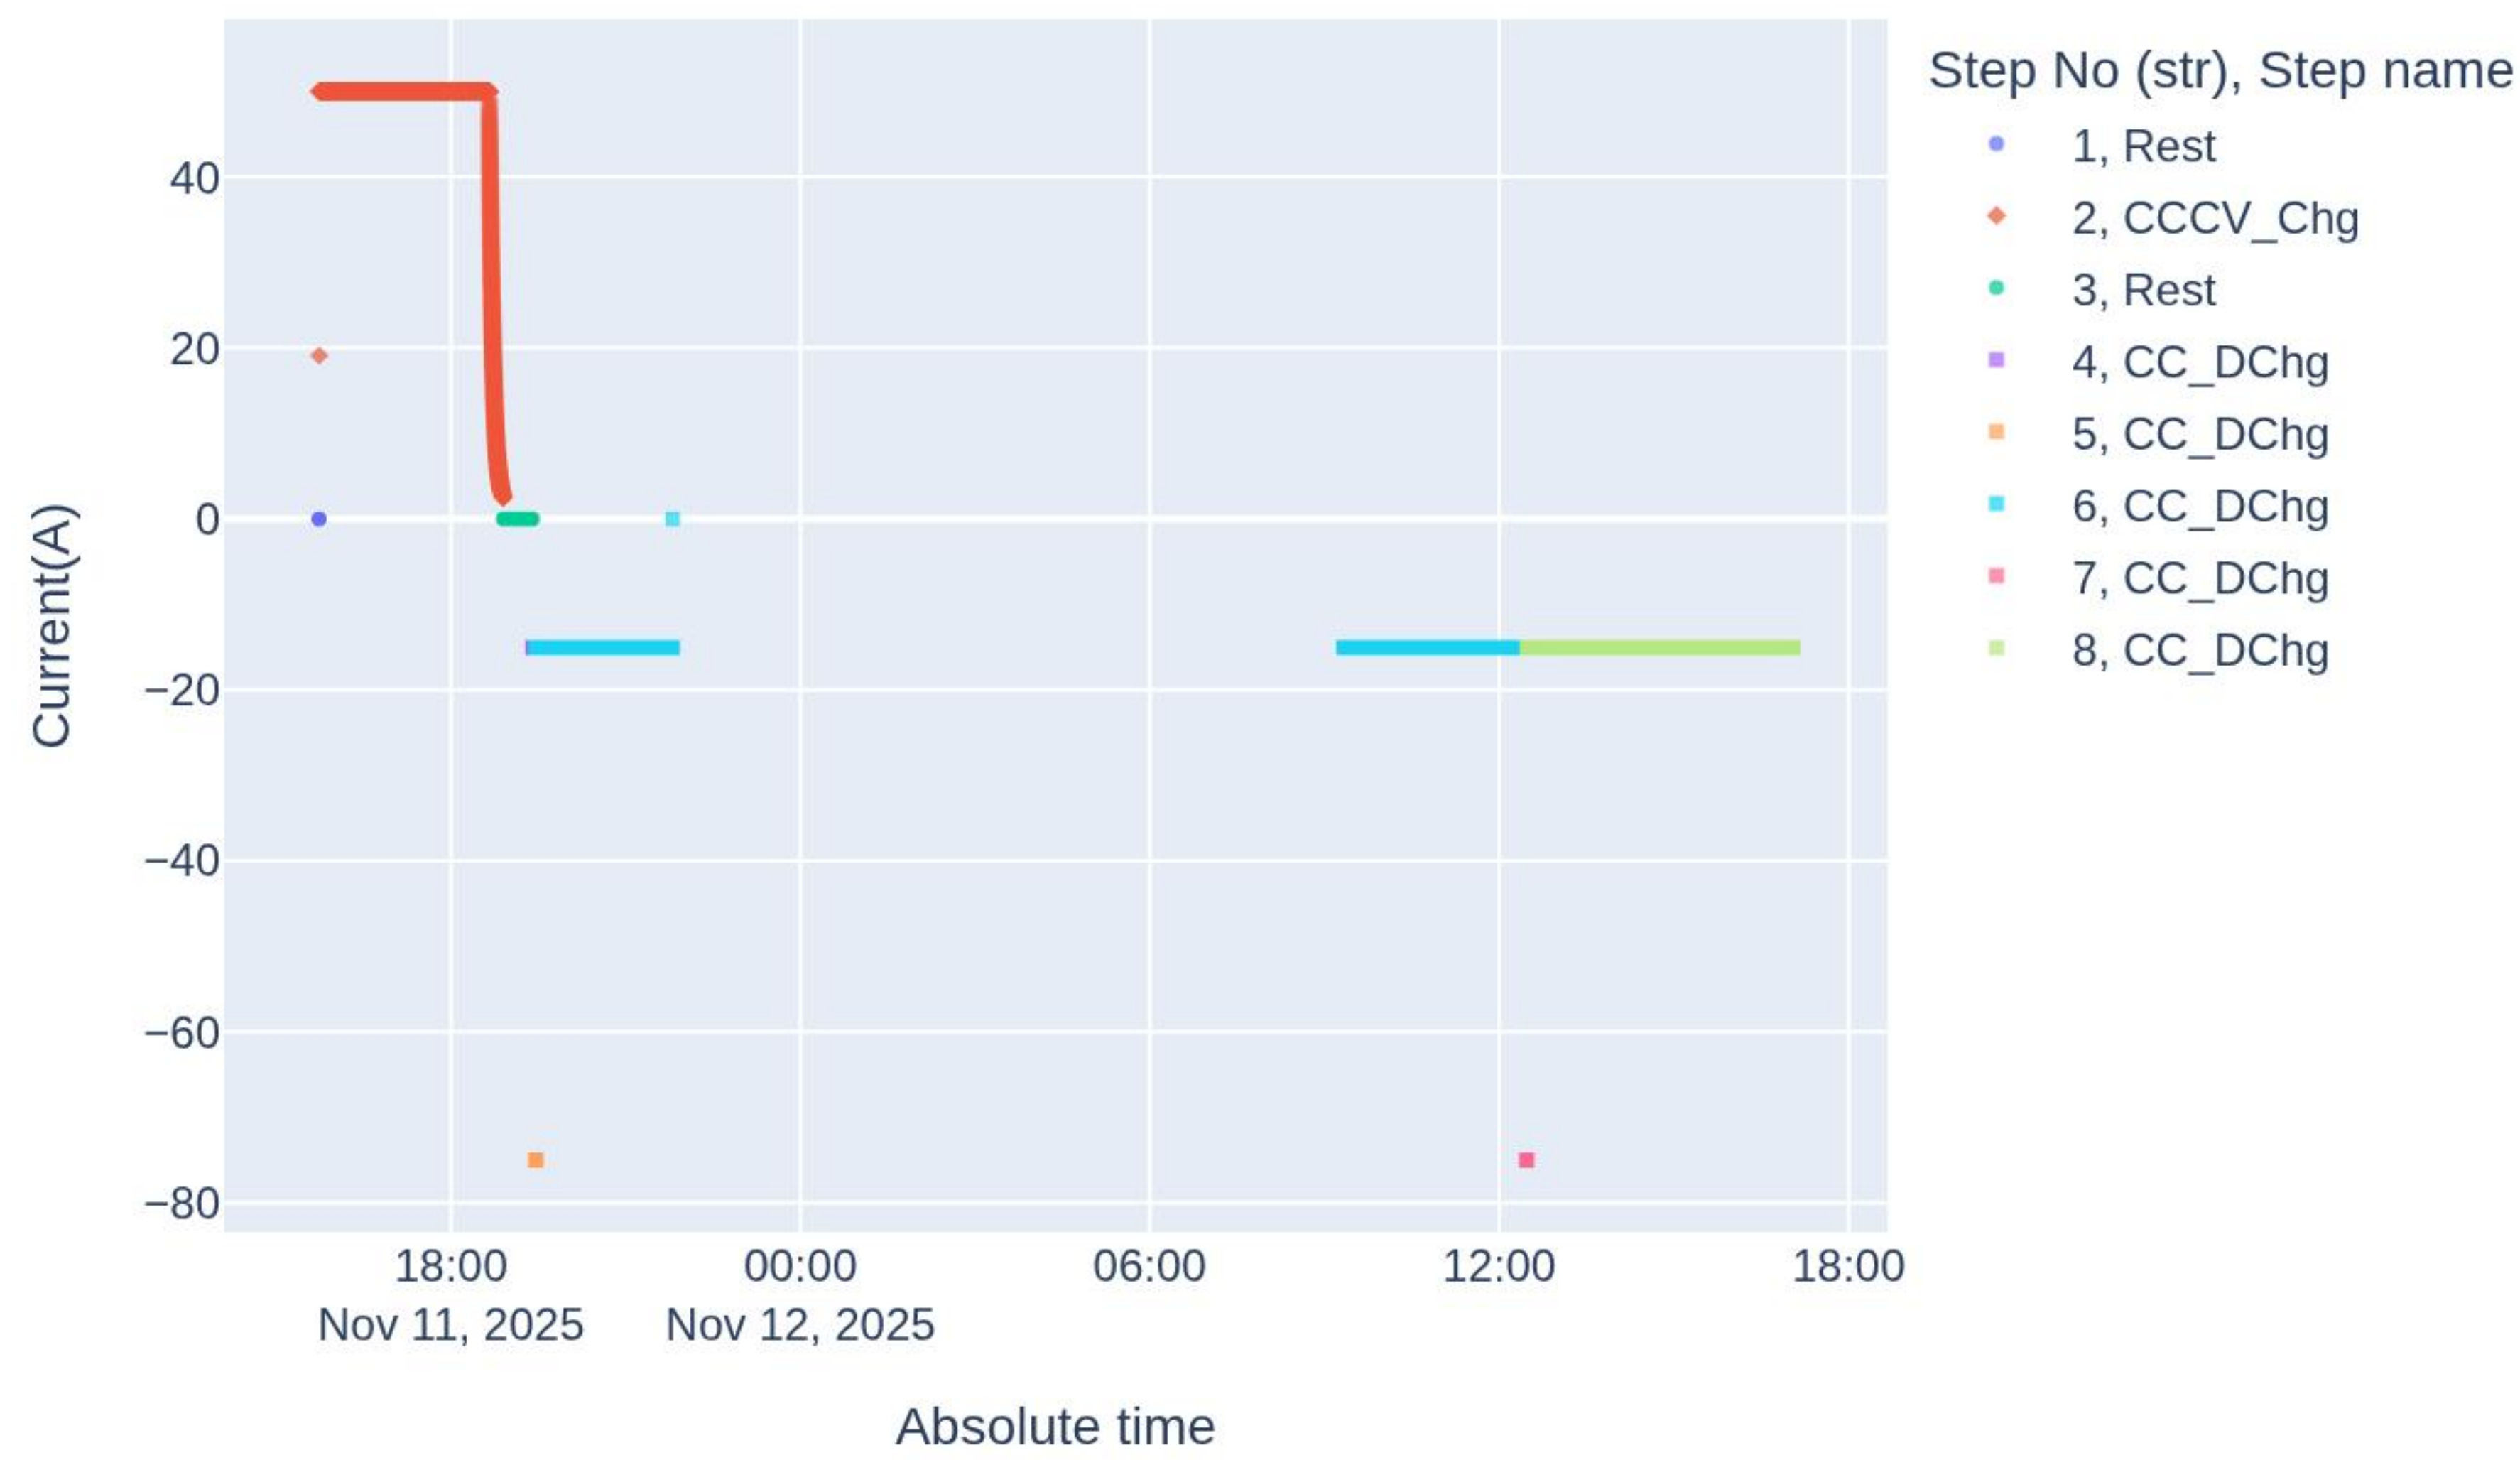

Voltage vs Absolute Time — PR_LFP_DCIR_REPT_150_0326_0_100.csv

