




NOTES:

1. MAXIMUM 15% SLOPE IN UNDISTURBED SOIL OR FILL WITH 90% COMPACTION. NOTIFY STRUCTURAL ENGINEER OF RECORD IF CONDITIONS ARE NOT MET.
2. CHRISTY N16 PULL BOX W/ LOCKING CONCRETE COVER MARKED "STREET LIGHTING." SET ON 4" OF GRAVEL. PROVIDE INLINE FUSE HOLDER, SINGLE OR DOUBLE AS REQUIRE IN PULL BOX, NOT IN POLE. USE #6, THWN, STRANDED COPPER WIRE FOR MAIN RUNS AND #12 TO POLE. MAKE SPLICES IN CHRISTY BOXES WITH CALTRANS STYLE C-CRIMP, TAPED, AND PAINTED. CONNECT EQUIPMENT GROUNDING CONDUCTOR TO POLE GROUNDING STUD WITH CRIMP BARREL RING TERMINAL.
3. REFER TO DRAWING ES-02-00 FOR DETAILED MANUF., MODEL, AND SPECIFICATION INFORMATION, INCLUDING RETROFIT KIT FOR EXISTING LIGHTS. REFER TO FDG GENERAL DESIGN DOCUMENT: EXTERIOR LIGHTING GUIDELINES FOR ADDITIONAL INFORMATION ON STANFORD STANDARDS.

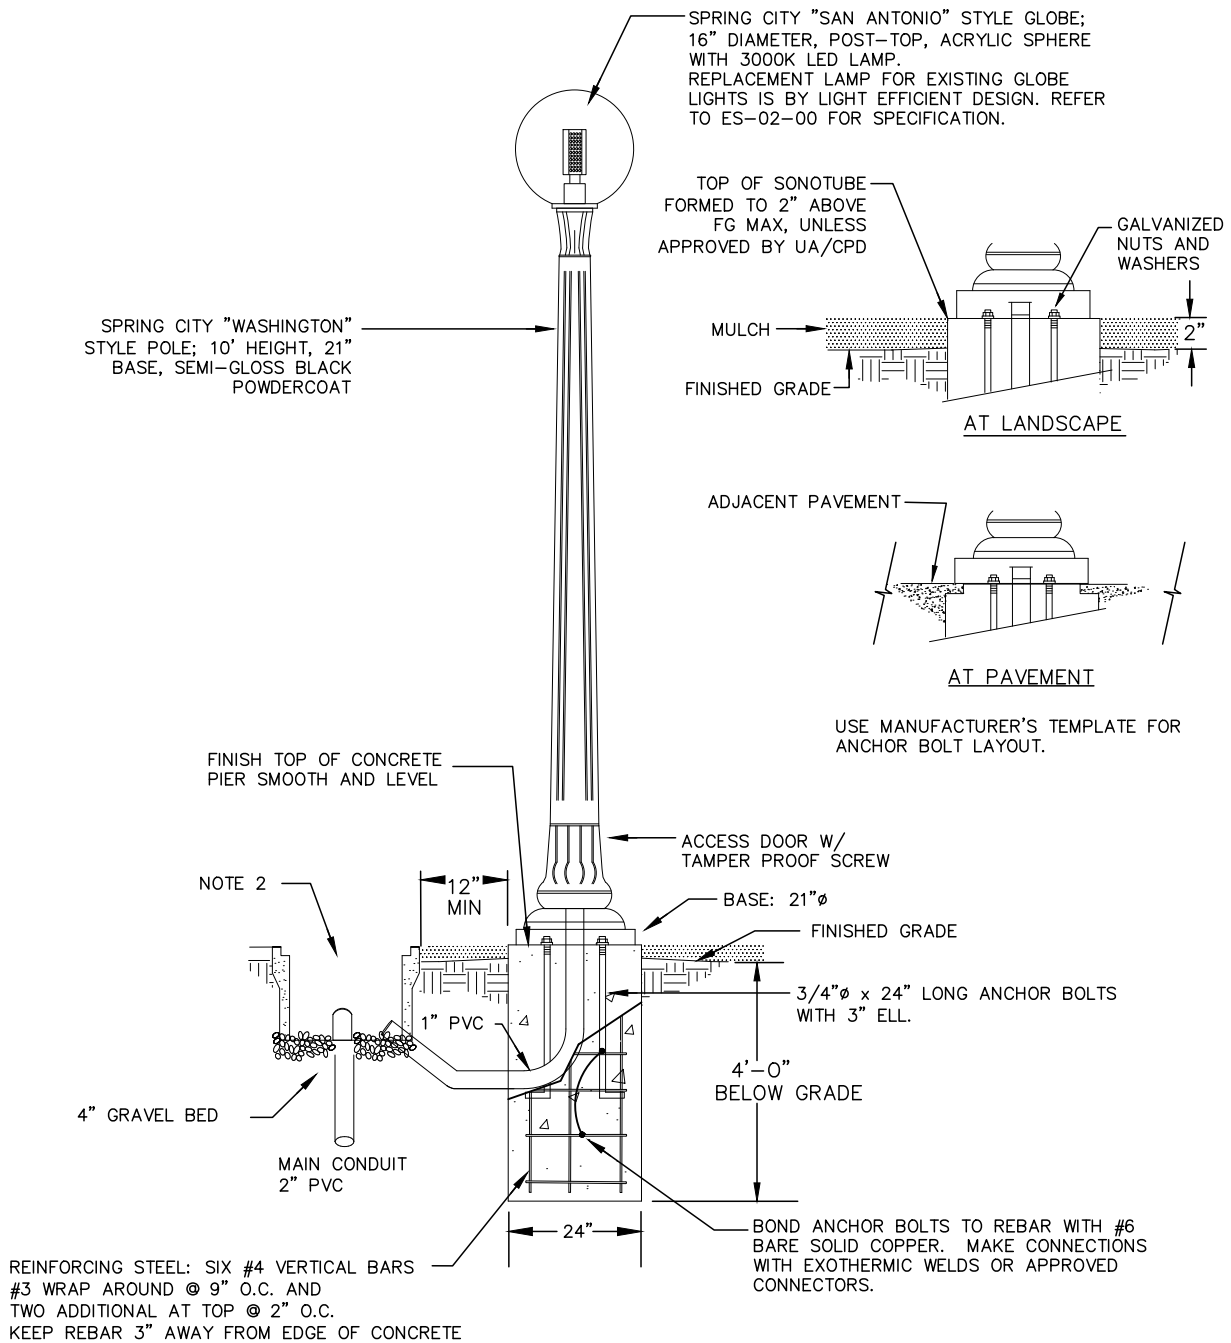

STANFORD UNIVERSITY FACILITY OPERATIONS

Drawing Title: GLOBE LIGHT (FORMERLY SU-I)

Scale: NTS

Check: D. BROWN

Rev. By: DB

Rev. Date: 02/15/24

DWG.

ES-02-02