REVUB: User Manual

Sebastian Sterl

Vrije Universiteit Brussel (VUB), Brussels, Belgium
Contact: sebastian.sterl@vub.be
Last updated: November 9, 2023

Contents

The REVUB model ("Renewable Electricity Variability, Upscaling and Balancing") was developed specifically to address the challenge of optimising hydro-solar-wind complementarity through smart hydropower operation and smart choice of solar-wind portfolios. We first explain the general principles of the REVUB model (Note 1), based on which the different modules of the model are explained one by one: hydropower plant classification (Note 2); simulation of hydropower generation and reservoir dynamics (Note 3); and simulation and optimisation of joint hydro-solar-wind operation (Note 3 to Note 5). An optional, additional assessment of pumped-storage potential with REVUB is described in Note 6. Some notes on spinning reserve requirements are summarised in Note 7. An overview table of terms and symbols used in the model description is given in Note 8.

The most recent version of the REVUB code was written for Python environments and can be accessed via `https://github.com/VUB-HYDR/REVUB` and used under the MIT license. All equations given in this document are referenced in the code wherever relevant/used. The ways to prepare input, run the code, and interpret output are given in Note 9, Note 10 and Note 11. Examples of REVUB use in literature are enumerated in Note 12.

Note 1   Principles of REVUB

The basic idea of REVUB is to assess the potential of reservoir hydropower to assist in the grid integration of variable power generation, e.g. from solar PV and wind power. Since reservoir hydropower can be flexibly dispatched, the premise is that every hydropower plant can help compensate for part of the variability of the pooled solar/wind resources on the same grid[1,2]. This requires adaptations, down to hourly resolution, of the conventional reservoir rule curves applied to keep reservoir water levels within acceptable ranges on seasonal and multiannual time scales.

REVUB calculates the adapted rule curves required for balancing a given solar/wind mix, and optimises the amount of solar/wind power whose variability each hydropower plant can compensate, based on three criteria: (i) reservoir lake levels and emptying-refilling must remain comparable under the new rule curves to those under conventional reservoir operation, on seasonal and multiannual time scales; (ii) the resulting hydro-solar-wind power mix must be reliable, i.e. capable of consistently meeting a certain load from hour to hour, month to month and year to year without failure (unless, in rare cases, extreme droughts force hydropower curtailment); and (iii) downstream stable (e.g. environmental and/or minimum loading) flow constraints are never to be violated. An overview of the calculation steps performed by REVUB is given in Fig. S1. The steps outlined in this chart are described in more detail in the next sections, as indicated.

Note 2   Hydropower plant categorisation

In REVUB, hydropower plants are categorised into two groups, based on whether the average natural inflow would take more or less than one year to fill the reservoir; in other words, whether the reservoir is "large" or "small" compared to the inflow. For plants in the "large" category, rule curves can be designed to ensure outflow and power output are relatively stable from month to month[3,4], enabling the plant to serve as baseload provider. Such rule curves typically boil down to parameterisations of required outflow as a function of lake level[5]. For hydropower plants in the "small" category, rule curves should additionally take into account that during the wet season(s), certain fractions of the received water need to be directly released from the reservoir without being stored, as reservoir capacity would be insufficient for this[6]. Small hydropower plants thus operate partly as run-of-river plants.

In mathematical terms, the classification of hydropower plants as "large" or "small" is done by calculating the dimensionless filling time τ_{fill}:

$$\tau_{fill} = \frac{V_{max}/T_{year}}{Q_{in,nat}(t)}, \tag{S1}$$

where V_{max} is the reservoir volume (in m^3), T_{year} is the number of seconds in a year, and $Q_{in,nat}(t)$ denotes natural reservoir inflow (in m^3/s). By default, hydropower plants are classified by REVUB

Hydropower

Step 1 **[user]** Obtain river discharge into reservoir, precipitation & evaporation flux on reservoir;

Step 2 **[model]** Categorize hydropower plant to determine conventional rule curves **(Note 2)**;

Step 3 **[model]** Model hydropower generation & reservoir dynamics under conventional rules **(Notes 3.1, 5)**;

Solar & wind integration

Step 1 **[user]** Obtain hourly (potential) solar and wind power generation;

Step 2 **[model]** Set target load to be met by joint hydro-solar-wind operation **(SN 3.2)**;

Step 3 **[model]** Adapt conventional rule curves to enable load-following hydro-solar-wind mix **(Notes 3.2, 4)**;

Optimisation & output

Step 1 **[model]** Iterate to find optimal target load to be met by hydro-solar-wind operation:
(i) Lake level drawdown cycles comparable to regular operation **(Note 3.2)**;
(ii) Reliability of hydro-solar-wind mix in consistent load-following **(Notes 3.2, 4)**;
(iii) Minimum outflow requirements met at all times **(Notes 3.2, 4)**;

Step 2 **[model]** Calculate hydro-solar-wind ELCC supportable by hydropower **(Note 3.2)**;

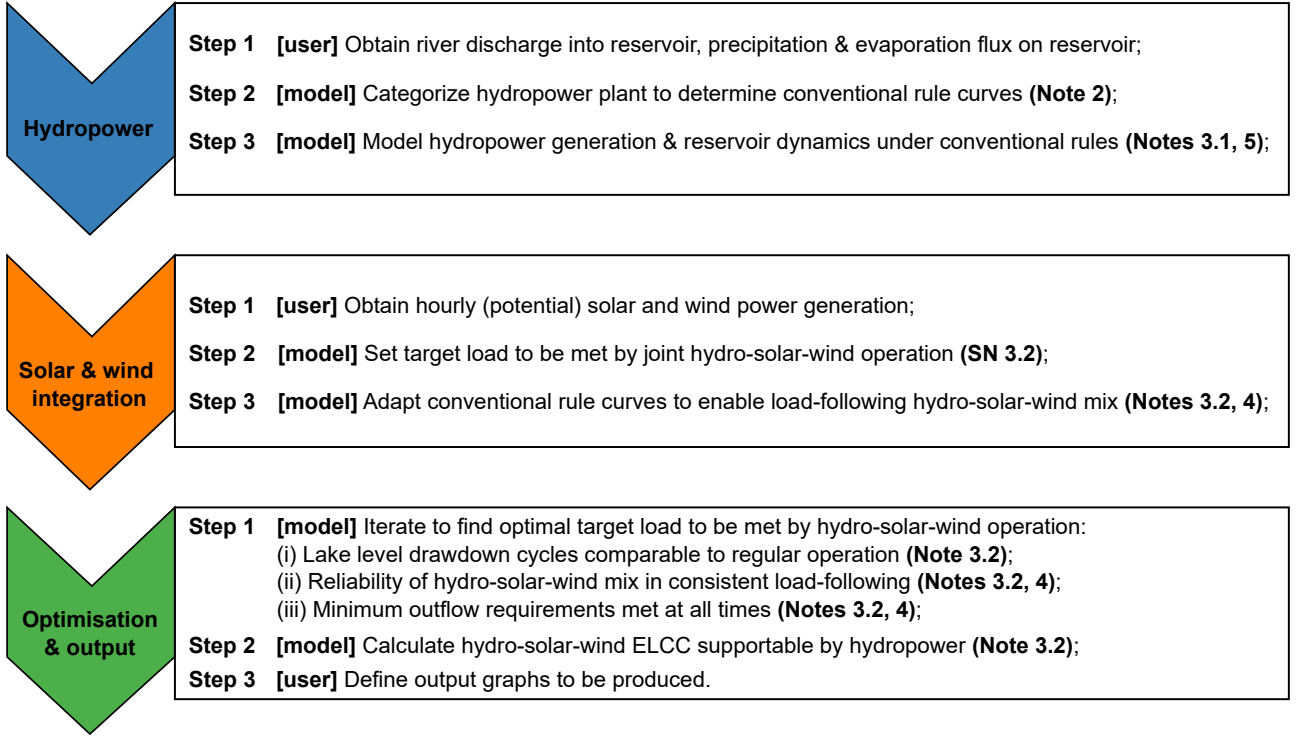**Step 3** **[user]** Define output graphs to be produced.

Figure S1: **Flowchart of the REVUB model approach**, explaining the steps taken in modelling hydro, solar and wind power and their integration. ELCC = Effective Load Carrying Capability. See also Note 9, Note 10 and Note 11 for the ways to prepare input, run the code, and interpret output.

as large or small based on whether their τ_{fill} is larger or smaller than unity, respectively; but this can be changed by the user.

Regardless of whether a plant is classified as large or small, it could be operated according to alternative rule curves with similar seasonal to multiannual outcomes as those resulting from conventional operation, but with additional patterns in water release from sub-daily to seasonal timescales, designed for balancing supply with demand in a power mix with a high share of variable renewable electricity (RE). This would mean allocating a portion of the inflowing water for flexible use and releasing it to generate extra power whenever needed to meet a certain load, such as during evening and night hours when solar PV output is low or zero.

Even for large hydropower plants, only part of the water intake can be allocated for flexible use, as a minimum stable outflow usually has to be guaranteed for at least four reasons (two technical reasons and two environmental reasons): (i) ensuring that turbines run in their high-efficiency range, which requires a certain minimum loading [*technical*]; (ii) safeguarding power system stability, since requirements for inertia impose having some synchronous capacity, such as from hydroturbine-driven generators, dispatched at all times[7] [*technical*]; (iii) safeguarding downstream ecological integrity through a minimum environmental outflow[8] [*environmental*]; and (iv) supplying irrigation water demand downstream [*environmental*].

Thus, regulated reservoir outflow must have a stable and a flexible component, which are denoted respectively $Q_{stable}(t)$ and $Q_{flexible}(t)$ (both in m^3/s). $Q_{stable}(t)$ can be further split up into a technical component $Q_{stable}^{tech}(t)$ and its environmental/irrigation component $Q_{stable}^{env/irr}(t)$. These components are not mutually exclusive, as one can contribute to the other; thus, in general, $Q_{stable}(t)$ is not the sum of both components, but simply the maximum value of both (the one that takes precedence over the other, thereby automatically fully covering the other).

Overall flexibility can be increased by reducing $Q_{stable}(t)$ in favour of $Q_{flexible}(t)$. Essentially, to allocate a certain amount of water for flexible use, the stable outflow will have to be reduced by a comparable amount such that the overall water budget remains unchanged. Since $Q_{stable}^{env/irr}(t)$ is usually
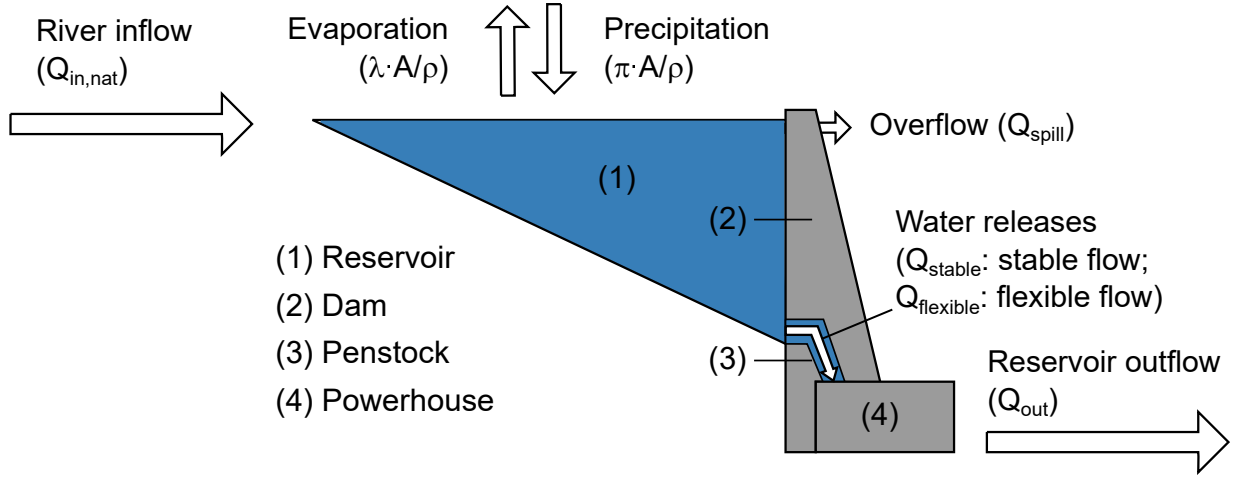
Figure S2: **Flowchart of the water gains and losses of a large hydropower plant as modelled in REVUB.** Gains consist of river discharge and lake surface precipitation; losses consist of reservoir outflows and lake surface evaporation.

prescribed externally, in practice, this means that allocating more water to flexibility implies reducing $Q_{stable}^{tech}(t)$.

Total reservoir outflow may have two other components: a seasonal ("run-of-river") component, denoted $Q_{RoR}(t)$, for small hydropower plants; and an overflow-prevention component[5] $Q_{spill}(t)$, representing the release of water via spillways when filling levels approach critical values, e.g. during extremely wet periods. Thus, total reservoir outflow $Q_{out}(t)$ is, in general, given by

$$
\begin{aligned}
Q_{out}(t) &= Q_{stable}(t) + Q_{flexible}(t) + Q_{RoR}(t) + Q_{spill}(t) \\
&= \max\left[Q_{stable}^{tech}(t), Q_{stable}^{env/irr}(t)\right] + Q_{flexible}(t) + Q_{RoR}(t) + Q_{spill}(t).
\end{aligned} \tag{S2}
$$

for both large and small hydropower plants. Correspondingly, hydropower generation consists of components $P_{stable}^{hydro}(t)$, $P_{flexible}^{hydro}(t)$ and $P_{RoR}^{hydro}(t)$ (in MW) [i].

In the next sections, the simulations in REVUB of flexibility provision by large and small hydropower plants are discussed in detail. Note 3 and Note 4 deal with large plants (which are the exception rather than the rule; but starting with these is informative as the mathematics are somewhat simpler); Note 5 extends the principles to small plants.

Note 3   Reservoir simulation for large hydropower plants

The volume of water $V(t)$ contained in a large hydropower plant's reservoir is given by the recursive relation

$$
V(t + \Delta t) = V(t) + \left[Q_{in,nat}(t) - Q_{stable}(t) - Q_{flexible}(t) - Q_{spill}(t) + [\pi(t) - \lambda(t)]\frac{A(t)}{\rho}\right]\Delta t, \tag{S3}
$$

where $\pi(t)$ and $\lambda(t)$ are respectively precipitation and evaporation flux (kg/m^2/s; see Methods); $A(t)$ is the surface area of the reservoir lake (m^2); ρ the density of water (taken to be 1000 kg/m^3); and Δt is the simulation time step (one hour is the default in REVUB). Seepage losses, which are usually very small in reservoirs[6,9], are neglected in the REVUB code (but could be included e.g. via a correction factor to total inflow). A schematic diagram of the involved water fluxes is given in Fig. S2.

Note 3.1 explains how $Q_{stable}(t)$ and the corresponding power generation $P_{stable}^{hydro}(t)$ are modelled for conventional, baseload-oriented operation, in which the flexible components are zero. Simulating conventional operation is necessary to have a reference time series of long-term lake volume fluctuations, based on which the balancing-oriented operation can be calibrated. Subsequently, Note 3.2 explains

---

[i]It is assumed that overflow prevention releases are never used for power generation, to avoid damaging turbine equipment and because such high flows would normally exceed turbine capacity anyway.

96 how $Q_{stable}(t)$ and $Q_{flexible}(t)$, and the corresponding power generation components $P_{stable}^{hydro}(t)$ and
97 $P_{flexible}^{hydro}(t)$, are modelled for balancing-oriented operation.

Note 3.1 Conventional (baseload-oriented) operation

99 We denote conventional, baseload-oriented operational rules with the abbreviation "CONV". By defi-
100 nition, $Q_{flexible,CONV}(t)$ and $P_{flexible,CONV}^{hydro}(t)$ are zero. The default way of modelling $Q_{stable,CONV}(t)$
101 in REVUB is based on logarithmic-exponential release rules[4,10], which works well in case conven-
102 tional operational rules are unknown, and can be determined on the basis of long-term average inflow.
103 Under the assumption that environmental/irrigation outflow $Q_{stable}^{env/irr}(t)$ is prescribed at all times,
104 approximate rules suggested for REVUB are:

$$Q_{stable,CONV}^{tech}(t) = \left\{ \begin{array}{ll} \overline{Q_{in,nat}(t)} \left[d_{min} + \ln \left(\kappa \left[\frac{V_{CONV}(t)}{V_{max}} \right]^{\phi} + 1 \right) \right], & \text{for } V_{CONV}(t)/V_{max} < f_{opt} \\ \overline{Q_{in,nat}(t)} \left[\exp \left(\gamma \left[\frac{V_{CONV}(t)}{V_{max}} - f_{opt} \right]^2 \right) \right], & \text{for } V_{CONV}(t)/V_{max} \geq f_{opt} \end{array} \right\}, \quad \text{(S4)}$$

105 where d_{min} is the fraction of yearly average inflow required as minimum stable outflow; V_{max} is the
106 maximum reservoir storage capacity; f_{opt} is the optimal filling fraction; and κ, ϕ and γ are constants.
107 κ and ϕ are given[4] by

$$\kappa = f_{opt}^{-\phi} \left[\exp \left(1 - d_{min} \right) - 1 \right], \quad \text{(S5)}$$

108 and

$$\phi = \alpha \tau_{fill}^{1/2}. \quad \text{(S6)}$$

109 Recommended default values are $f_{opt} = 80\%$, $\alpha = 2/3$, and $\gamma = 10$ based on generalised reservoir
110 operation rules[4,10]; for d_{min}, values may be chosen based on requirements for minimum turbined
111 flow to prevent turbines running at low efficiency, and/or generalised environmental flow rules[8] (the
112 former will usually take precedence over the latter). It is possible (and arguably desirable when
113 running scenarios for the first time) for the user to not specify a value for d_{min}, and instead provide a
114 value of minimum required load f_{min} on one single turbine (expressed as fraction of maximum turbine
115 throughflow), reflecting the lower bound of the turbine's operating range, based on which REVUB
116 will calculate and work with a default value of d_{min}.[ii]
117 The overflow prevention component $Q_{spill,CONV}$ is modelled as

$$Q_{spill,CONV}(t) = \left\{ \begin{array}{ll} 0, & \text{for } V_{CONV}(t)/V_{max} < f_{spill} \\ \max \left[0, \left(Q_{in,nat}(t) + [\pi(t) - \lambda(t)] \frac{A_{CONV}(t)}{\rho} \right) (1 + \mu) - Q_{stable,CONV}(t) \right], & \text{for } V_{CONV}(t)/V_{max} \geq f_{spill} \end{array} \right\}, \quad \text{(S7)}$$

118 where f_{spill} is the filling fraction at which the overflow prevention starts[iii], and μ represents a small
119 fraction such that lake levels are brought below critical levels $f_{spill}V_{max}$ as quickly as possible without
120 releasing unnaturally high flows downstream; default values are $f_{spill} = 95\%$ and $\mu = 0.1$, but these
121 can be changed by the user.
122 To simulate minimum drawdown levels when facing drought-like situations, one further rule is added
123 to equation (S4): outflow, and with it hydropower production, is automatically curtailed[5,11] if the
124 volume levels $V_{CONV}(t)$ dip below critical levels $f_{stop}V_{max}$, and only restarted once volumes have
125 recovered to $f_{restart}V_{max}$. The values $f_{stop} = 10\%$[11] and $f_{restart} = 20\%$ are defaults in REVUB, but
126 can be changed by the user.
127 The corresponding stable power output $P_{stable,CONV}^{hydro}(t)$ can then be calculated as

$$P_{stable,CONV}^{hydro}(t) = \min \left[Q_{stable,CONV}(t); Q_{turb}^{max} \right] \eta_{turb} \rho g h_{CONV}(t), \quad \text{(S8)}$$

[ii]The calculation is as follows: $\overline{d_{min}^{default}} = (f_{min} Q_{turb}^{max}/N_{turbines})/\overline{Q_{in,nat}(t)}$, where $N_{turbines}$ is the number of turbines (units) of the plant. The term $f_{min} Q_{turb}^{max}/N_{turbines}$ represents the minimum flow in m³/s required to keep one turbine running within its operating range.

[iii]Note that every hydropower plant has a certain safety level, i.e. the dam is always somewhat higher than the maximum water level[5], to mitigate flood risk. Because of this safety level, should the overflow procedure fail for any reason, the dam would not immediately overflow. However, flooding would occur along the shores of the lake, which is why it is always prudent to prevent straining the safety level.

where η_{turb} is the turbine efficiency (%), g the gravitational acceleration (9.81 m/s^2), and $h(t)$ the hydraulic head (m), i.e. the difference in water level between the headwater behind the dam and the tailwater at the turbines. The efficiency of η_{turb} should be user-defined[iv]. The calculation of $h(t)$ is explained in Note 3.3. Q_{turb}^{max} is the maximum turbine throughput (at which the power generating capacity of the turbine is fully used), which is approximated with $Q_{turb}^{max} \approx P_{turb}^r/(\eta_{turb}\rho g h_{max})$, where P_{turb}^r is the rated power capacity of the hydropower plant and h_{max} is the maximum hydraulic head. With these rules, results are mostly independent of arbitrary initial conditions (convergence to the same time series happens typically within 2 simulation months). The initial condition $V_{CONV}(0) = f_{opt}V_{max}$ (and the corresponding lake area and water level; see Note 3.3) are defaults in REVUB, but can be changed by the user.

We note that, in case the user wishes to include their own conventional reservoir rules, this is possible by correspondingly adapting the default REVUB code by adapting the lines referring to the above equations.

Note 3.2   Balancing-oriented operation

Reservoir operation oriented towards balancing solar and wind power variability is denoted with the abbreviation "BAL". For reservoirs of large hydropower plants, BAL operation is modelled as follows. First, the needs for sub-daily to seasonal dispatching patterns must be established. The load difference $P_d(t)$ between total inflexible power generation (stable hydropower, solar power, and wind power) and power demand is calculated as:

$$
\begin{aligned}
P_d(t) &= P_{stable,BAL}^{hydro}(t) + c_{solar} \cdot CF_{solar}(t) + c_{wind} \cdot CF_{wind}(t) - L(t) \\
&= P_{inflexible}(t) - L(t).
\end{aligned} \tag{S9}
$$

Here, c_{solar} and c_{wind} represent a certain amount of solar PV and wind power capacity, respectively (in MW), whose value is to be optimised by REVUB; $CF_{solar}(t)$ and $CF_{wind}(t)$ represent the solar and wind capacity factor for each time step, respectively; and $L(t)$ represents a certain target load profile that is to be followed[v].

The time series $L(t)$, by default, is set as follows:

$$
L(t) = P_{load}L_{norm}(t), \tag{S10}
$$

with P_{load} a constant determining the average load to be followed and reflecting the constraints on overproduction, and $L_{norm}(t)$ the normalized ($\overline{L_{norm}(t)} = 1$) hour-to-hour load profile. P_{load} is calculated as

$$
P_{load} = p_i(P_{inflexible}(t)), \tag{S11}
$$

where $p_i(x)$ denotes the i^{th} percentile of a variable x. Here, i thus represents the percentile of $P_{inflexible}$ not exceeding P_{load}; in other words, the percentage of time during which RE generation should not exceed the average load to be followed. Generally, the lower i, the higher the amount of allowed excess production (overproduction) as compared to $L(t)$.

In REVUB, the time series $CF_{solar}(t)$ and $CF_{wind}(t)$ must be provided as model input by the user. These could represent power generation from single locations, or weighted averages across the locations for on-grid solar or wind power selected for the region under scrutiny, to simulate the feed-in of solar and wind power from various locations into the same power grid. In case of the latter, we recommend assuming that the total capacity is distributed across locations within the region according to site-

---

[iv]The efficiency of hydroturbines depends on the effective turbined flow at each moment, but is typically above 80% in realistic ranges of the latter[12,13]. As explained above, the value d_{min} should at least reflect the fact that at any given moment, at least one of the $N_{turbines}$ turbines of a given plant must be active and running at a certain minimum partial load to allow consistent operation at high efficiency.

[v]Note that for the terms in equation (S9), MW and MWh are interchangeable units, due to the hourly time step employed in REVUB. Similarly, CF could be interpreted both as actual power generation divided by maximum potential generation in each hour (dimensionless fraction), or as power generation per unit of capacity (in hours).

164   specific weight factors w_{solar}^n and w_{wind}^n. Then, $CF_{solar}(t)$ and $CF_{wind}(t)$ would be given by

$$CF_{solar}(t) = \frac{\sum\limits_{n=1}^{N_{solar}} CF_{solar}^n(t)w_{solar}^n}{\sum\limits_{n=1}^{N_{solar}} w_{solar}^n}; \; CF_{wind}(t) = \frac{\sum\limits_{n=1}^{N_{wind}} CF_{wind}^n(t)w_{wind}^n}{\sum\limits_{n=1}^{N_{wind}} w_{wind}^n}, \tag{S12}$$

165   with $CF_{solar}^n(t)$ and $CF_{wind}^n(t)$ the capacity factors of solar PV or wind power for each time step,
166   respectively, at each individual site with index n; and N_{solar} and N_{wind} the number of sites for solar PV
167   or wind power generation, respectively. The weight factors w_{solar}^n and w_{wind}^n represent preferences for
168   certain sites over others for the development of solar PV and wind parks. Given that sites with a
169   higher yield would typically tend to be preferred, a simple approach would be to take a site's weight
170   factor to be equal to the multi-year average capacity factor for solar PV or wind power at that site:

$$w_{solar}^n = \overline{CF_{solar}^n(t)}; \; w_{wind}^n = \overline{CF_{wind}^n(t)}. \tag{S13}$$

171   The capacity ratio $c_{solar} : c_{wind}$ should also be user-defined; it represents the relative share of solar
172   and wind capacity to be deployed by the model. Sensitivity tests to find an optimal ratio can then be
173   performed by running the model for several values of the capacity ratio.
174   Second, in BAL operation, $Q_{stable}(t)$ is reduced in favour of $Q_{flexible}(t)$ such that $L(t)$ can be met
175   by the combination of stable hydropower, flexible hydropower, solar power and wind power. In the
176   REVUB code, the default approach (which can be adapted by the user) is to take $Q_{stable,BAL}^{tech}(t)$ as a
177   fraction of the average inflow net of environmental/irrigation outflow:

$$Q_{stable,BAL}^{tech}(t) = (1 - C_{OR})\overline{Q_{in,nat}(t)}. \tag{S14}$$

178   Here, the fraction C_{OR} denotes the "operating reserve coefficient"[14], and determines the amount of
179   water available for flexible use. Theoretically, as $C_{OR} \to 1$, the hydropower plant in question would
180   operate near-completely flexibly and provide almost no minimum stable load, beyond the "coinci-
181   dental" one from the environmental and irrigation outflow. This would also imply that the outflow
182   of the dam could become extremely low for prolonged periods; for instance, when solar/wind power
183   generation is high and/or demand is low. Such operation would likely violate inertia requirements
184   and minimum load constraints of the plant. As default, REVUB therefore uses an upper bound of
185    $C_{OR}^{max} = 1 - d_{min}$, such that the minimum outflow under BAL is always consistent with that under
186   CONV. The selection of the optimal C_{OR} for each hydropower plant is explained in Note 4.
187    $P_{stable,BAL}^{hydro}(t)$ is calculated analogously to $P_{stable,CONV}^{hydro}(t)$ in equation (S8):

$$P_{stable,BAL}^{hydro}(t) = \min\left[Q_{stable,BAL}(t); Q_{turb}^{max}\right]\eta_{turb}\rho g h_{BAL}(t). \tag{S15}$$

188   Third, the necessary amount of flexible outflow $Q_{flexible,BAL}(t)$ and corresponding flexibly produced
189   power $P_{flexible,BAL}^{hydro}(t)$ are determined for the instances when $P_{inflexible}(t)$ cannot meet $L(t)$, i.e. when
190    $P_d(t) < 0$. The following rule then applies for $P_{flexible,BAL}^{hydro}(t)$ to maximize the followed load under
191   peak capacity constraints and ramping constraints[15]:

$$P_{flexible,BAL}^{hydro}(t) = \left\{ \begin{array}{ll} 0, & \text{for } P_d(t) \geq 0 \\ \min\left[Q_{turb,flexible}^{pot}(t)\eta_{turb}\rho g h_{BAL}(t); \min\left[|P_d(t)|; P_{flexible,BAL}^{hydro}(t-1) + \Delta P_{turb}^{ramp}\right]\right], & \text{for } P_d(t) < 0 \;\&\; \Delta P_d(t) < 0 \\ \min\left[Q_{turb,flexible}^{pot}(t)\eta_{turb}\rho g h_{BAL}(t); \max\left[|P_d(t)|; P_{flexible,BAL}^{hydro}(t-1) - \Delta P_{turb}^{ramp}\right]\right], & \text{for } P_d(t) < 0 \;\&\; \Delta P_d(t) \geq 0 \end{array} \right\},$$
$$\tag{S16}$$

192   where $\Delta P_d(t) = P_d(t) - P_d(t-1)$ determines whether the hydropower plant should ramp up ($\Delta P_d(t) <$
193   0) or down ($\Delta P_d(t) \geq 0$); ΔP_{turb}^{ramp} is the maximum ramp rate of the plant (in MW per time step);
194   and

$$Q_{turb,flexible}^{pot}(t) = \max\left[0; Q_{turb}^{max} - Q_{stable,BAL}(t)\right]. \tag{S17}$$

195   This gives a flexible outflow

$$Q_{flexible,BAL}(t) = \frac{P_{flexible,BAL}^{hydro}(t)}{\eta_{turb}\rho g h_{BAL}(t)}. \tag{S18}$$

196   Fourth, the overflow prevention component $Q_{spill,BAL}(t)$ is calculated analogously to equation (S7):

$$Q_{spill,BAL}(t) = \left\{ \begin{array}{ll} 0, & \text{for } V_{BAL}(t)/V_{max} < f_{spill} \\ \max\left[0, \left(Q_{in,nat}(t) + [\pi(t) - \lambda(t)]\frac{A_{BAL}(t)}{\rho}\right)(1+\mu) - Q_{stable,BAL}(t) - Q_{flexible,BAL}(t)\right], & \text{for } V_{BAL}(t)/V_{max} \geq f_{spill} \end{array} \right\}.$$
$$\tag{S19}$$

197 As in CONV, to ensure that lake levels do not dip precariously low, $Q_{stable,BAL}$ and $Q_{flexible,BAL}$ are
198 reduced to zero when $V_{BAL}(t) < f_{stop}V_{max}$ and restarted once $V_{BAL}(t) \geq f_{restart}V_{max}$ [vi].
199 Since one needs the hydraulic head $h_{BAL}(t)$ to calculate $P^{hydro}_{stable,BAL}(t)$ from equation (S15), but $h_{BAL}(t)$
200 follows only from the overall operation, which requires knowledge of $P^{hydro}_{stable,BAL}(t)$ to calculate $P_d(t)$
201 according to equation (S9), this problem is solved iteratively by REVUB with an initial guess of
202 $P^{hydro}_{stable,BAL}(t) = (1 - C_{OR})P^{hydro}_{stable,CONV}(t)$, repeated until convergence (typically, 3-6 iterations suffice).
203 The calculation of $h(t)$ is the same as for CONV and is explained in Note 3.3.
204 At given C_{OR} and given ratio $c_{solar} : c_{wind}$, REVUB optimises the above operation by identifying the
205 time series $L(t) = L_{opt}(t)$, and the corresponding optimal $c_{solar} = c^{opt}_{solar}$ and $c_{wind} = c^{opt}_{wind}$, for which
206 the resulting lake level time series is most comparable to what it would be under CONV operation.
207 This optimisation is performed by finding the minimum of the relative deviation Ψ between the CONV
208 and BAL lake levels across all time steps of an entire simulation period, as a function of c_{solar} and c_{wind}:

$$\Psi(c_{solar}, c_{wind}) = \frac{\overline{|(V_{BAL}(t) - V_{CONV}(t)|}}{\overline{V_{CONV}(t)}}; \tag{S20}$$

209 where

$$\min(\Psi) = \Psi(c^{opt}_{solar}, c^{opt}_{wind}). \tag{S21}$$

210 Note that the code could also be adapted to optimise lake levels compared to a certain mathematical
211 rule curve, instead of to the outcome of "conventional" operational rules (Note 3.1). This would
212 simply require exchanging $V_{CONV}(t)$ in equation (S20) by the corresponding rule curve of lake volume.
213 Note furthermore that even when doing this, it is still useful to calculate the outcomes (hydropower
214 generation and lake levels) resulting from conventional reservoir management, to verify (i) how well the
215 rule curve can be followed *in general* under the given hydroclimate and occurrence of wet/dry years,
216 and (ii) the extent to which the outcomes of flexible operation would differ from baseload-oriented
217 operation.
218 REVUB assures that power droughts resulting from $V(t)$ dipping lower than $f_{stop}V_{max}$ can never be
219 more severe under BAL operation than under CONV, by automatically discarding any solutions to
220 equation (S21) where this would be the case.
221 Once the optimal solution is found, the Effective Load Carrying Capability (ELCC) of the hydro-solar-
222 wind mix is calculated as follows. The maximum followable load $L_{followed}(t) = P_{followed}L_{norm}(t)$,
223 which the hydro-solar-wind mix can meet without any load loss, is identified: this is the load at which
224 the residual load ($L_{res}(t)$; the load minus the generation) has a maximum of zero. Thus, $P_{followed}$ is
225 the value for which $\max[L_{res}(t)] = 0$, with $L_{res}(t)$ defined as:

$$L_{res}(t) = P_{followed}L_{norm}(t) - \left[P^{hydro}_{stable,BAL}(t) + P^{hydro}_{flexible,BAL}(t) + c^{opt}_{solar} \cdot CF_{solar}(t) + c^{opt}_{wind} \cdot CF_{wind}(t)\right]. \tag{S22}$$

226 The ELCC is then defined as the integral of $L_{followed}(t)$ over all time steps in a simulation year:

$$\text{ELCC} = \int_{year} L_{followed}(t)dt. \tag{S23}$$

227 The ELCC thus represents the total yearly load followed by each hydropower plant in combination with
228 the solar and wind power whose variability it can compensate, under the optimal solution. The aggre-
229 gate of ELCC across all hydropower plants represents the total followable load when all hydropower
230 plants optimally contribute to compensating solar-wind variability; it is abbreviated ELCC_{tot} here-
231 after.
232 Ideally, $L_{followed}(t)$ should be equal to $L_{opt}(t)$ (and it usually is), but due to peaking constraints of
233 hydropower plants (eq. (S17)), this is not guaranteed in every case. When $L_{followed}(t) < L_{opt}(t)$, the
234 power plant's peaking capabilities are insufficient to meet all required peaks in $L_{opt}(t)$ together with

---

[vi]The length of periods when hydropower production is forced to stop, is important for due diligence planning and reflects in parameters such as the $P^{90}_{guaranteed}$ power (MW), i.e. the power that is guaranteed 90% of the time. Integration of VRE will generally improve such parameters, since VRE can continue producing even when hydropower is temporarily stopped and despite the fact that the flexibility from hydropower is lost in those periods. REVUB calculates $P^{xx}_{guaranteed}$ for a user-defined percentile xx for both CONV and BAL scenarios to showcase this.

solar and wind power. In such cases, the hydropower plant should run at somewhat lower flexibility, i.e. lower C_{OR}, at which a lower $L_{opt}(t)$ will apply that would put less strain on the plant's peaking capabilities, ensuring that $L_{followed}(t) \approx L_{opt}(t)$. This resimulation is done automatically by the REVUB code (Note 4).

The total contributions of hydro, solar and wind power to yearly electricity generation, denoted respectively $E_{reservoir}^{hydro}$, E_{solar} and E_{wind}, are obtained by integrating their respective power output across all time steps in a simulation year. First, $E_{reservoir}^{hydro}$ is equal to

$$E_{reservoir}^{hydro} = E_{stable}^{hydro} + E_{flexible}^{hydro} = \int_{year} \left(P_{stable}^{hydro}(t) + P_{flexible}^{hydro}(t) \right) dt. \tag{S24}$$

Second, E_{solar} and E_{wind} are obtained by multiplying c_{solar}^{opt} and c_{wind}^{opt} by $CF_{solar}(t)$ and $CF_{wind}(t)$, respectively, and integrating:

$$
\begin{aligned}
E_{solar} + E_{wind} &= \int_{year} \left(P_{solar}(t) + P_{wind}(t) \right) dt \\
&= \int_{year} \left(c_{solar}^{opt} \cdot CF_{solar}(t) + c_{wind}^{opt} \cdot CF_{wind}(t) \right) dt. \tag{S25}
\end{aligned}
$$

Note 3.3   Head-volume-area relationships

Calculating the hydraulic head $h(t)$ for each time step requires knowing the bathymetry and volume-area-depth relationship of each reservoir. Typical curves approximating such relationships need to be calibrated on a reservoir-to-reservoir basis. The user should provide bathymetric curves as input to each simulation. In case these are not available, we recommend using an archetypal reservoir shape function [16,17], modelling reservoirs' area-volume relationships with the equation

$$A(t) = A_{max} \left[\frac{V(t)}{V_{max}} \right]^{(1 - C_{reservoir})}, \tag{S26}$$

where $C_{reservoir} = V_{max}/(A_{max} z_{max})$ is the "reservoir coefficient", and A_{max} and z_{max} represent the maximum reservoir lake area and depth, respectively.

For any $V(t + \Delta t)$ calculated using equation (S3), the corresponding $A(t + \Delta t)$ can then be calculated using equation (S26). To obtain the hydraulic head $h(t + \Delta t)$ at each time step, the incremental change $\Delta h(t)$ is added to the head $h(t)$ of the previous time step, using the first-order approximation

$$\Delta h(t) \approx \frac{V(t + 1) - V(t)}{A(t)}. \tag{S27}$$

When using equation (S26), before any simulation according to CONV or BAL in REVUB, a dummy simulation spanning all possible values of V, and thus of A and h, should be run to obtain a calibration (h, V) curve. In CONV and BAL simulations, the head $h(t + \Delta t)$ can then always be obtained from this calibration curve after $V(t + \Delta t)$ has been determined from equation (S3).

Note 4   Peaking suitability of large hydropower plants

Since hydropower plants differ in terms of peaking capabilities, operational strategies must be selected with care. If hydropower plants are operated at a too high C_{OR}, the corresponding peaks in flexible water release may exceed the maximum turbine throughput on a structural basis (cf. equation (S17)), meaning that the plant will be structurally unable to meet peak demand as well as leading to loss of spinning reserves (see Note 7). Typically, this would first occur in the seasons with highest peak demand and/or when water levels are at their lowest. Therefore, each hydropower plant's operation should happen at an optimised value $C_{OR} = C_{OR}^{opt}$ that ensures this is not the case, while maintaining adequate levels of flexibility. In REVUB, the default procedure (which can be changed by the user) is to define the turbine utilisation rate $k_{turb}(t)$ at each time step:

$$k_{turb}(t) = \frac{Q_{stable}(t) + Q_{flexible}(t)}{Q_{turb}^{max}}, \tag{S28}$$

269 and define hydropower plant operation (at given C_{OR}) as unsuitable for peaking purposes when
270 $p_{99}(k_{turb})$, i.e. the 99^{th} percentile of k_{turb}, is unity (in other words, when turbine capacity is fully
271 exhausted in at least one out of every 100 hours).
272 As default for each hydropower plant, REVUB uses $C_{OR}^{opt} = C_{OR}^{max}$, the maximum allowed operational
273 flexibility. If operation is found to be unsuitable for peaking purposes at C_{OR}^{max}, the REVUB code
274 automatically resimulates with incrementally reduced C_{OR}, until a value C_{OR}^{opt} is identified for which
275 $p_{99}(k_{turb}) < 1$.

Note 5   Reservoir simulation for small hydropower plants

277 To assess the balancing potential of small hydropower plants (those with less than a year of storage),
278 which are in reality much more ubiquitous than large hydropower plants, we define the alternative
279 filling time $\tau_{fill,frac}$ corresponding to the amount of years it would take for a fixed fraction of the
280 incoming flow, denoted $Q_{in,frac}(t)$, to fill the reservoir:

$$\tau_{fill,frac} = \frac{V_{max}/T_{year}}{Q_{in,frac}(t)}, \tag{S29}$$

281 where $Q_{in,frac}(t)$ is defined as

$$Q_{in,frac}(t) = f_{reg}Q_{in,nat}(t), \tag{S30}$$

282 with f_{reg} a suitable fraction, representing the fraction of incoming water available for storage and,
283 therefore, flexible use. This fraction can be input in REVUB by the user. In case the user is unsure
284 of a pertinent value, it can be left empty and REVUB defaults to a standard value determined by
285 solving $\tau_{fill,frac} = 1$; that is, f_{reg} then represents the fraction of the incoming water that would take
286 one year to fill the reservoir on average. Note that this default is very realistic for hydropower plants
287 on rivers with extremely seasonal, unimodal discharge, but not necessarily as useful in bimodal-rainfall
288 climates or in situations with relatively flat inflow profiles (e.g. in cases where a regulating dam is
289 already present upstream).
290 Note that f_{reg} would normally be unity for the large (more-than-a-year storage) plants described in
291 the previous sections; nevertheless, the user is free to specify a value smaller than unity for such plants
292 when running REVUB. This could, for instance, reflect a requirement for a seasonal environmental
293 flow, or a safeguard against extremely dry years to prevent regular operating rules from overdrawing
294 the reservoir. In such a case, the operation of those plants, too, will follow what is described below,
295 rather than what is described in the previous sections.
296 Once f_{reg} chosen, the fraction $Q_{in,frac}(t)$ is then assumed to be "storable" and, after accounting for the
297 imposed environmental and irrigation outflow $Q_{stable}^{env/irr}(t)$, usable for balancing. REVUB assumes that
298 the remainder of the flow, given by $Q_{in,nat}(t) - Q_{in,frac}(t) = (1 - f_{reg})Q_{in,nat}(t)$, passes through the
299 reservoir without being stored, thus representing the seasonal "run-of-river" component $Q_{RoR}(t)$. Since
300 f_{reg} can be calculated based on long-term average flow, such operation can be readily implemented as
301 long as accurate measurements of inflow are available.
302 For $f_{reg} < 1$, d_{min} no longer represents the fraction of yearly average inflow required as minimum
303 stable outflow, but the fraction of yearly average *storable* flow required as minimum stable outflow.
304 The user must take this into account when specifying d_{min}. REVUB does this automatically when
305 calculating a default d_{min} in case the user does not wish to prescribe a value[vii].
306 The term Q_{RoR} is appended in equation (S3) (and would be an additional entry under the "water

---

[vii]The calculation of this default, in a more generalised form for any f_{reg}, is as follows: $d_{min}^{default} = (f_{min}Q_{turb}^{max}/N_{turbines} - (1 - f_{reg})\min[Q_{in,nat}(t)])/(f_{reg}\overline{Q_{in,nat}(t)})$. The term $(1 - f_{reg})\min[Q_{in,nat}(t)]$ represents the fact that the run-of-river component can contribute to the minimum load of the first turbine provided that it has a nonzero minimum throughout the year. For $f_{reg} = 1$, which is the case for "large" hydropower plants, this equation reduces to $d_{min}^{default} = (f_{min}Q_{turb}^{max}/N_{turbines})/\overline{Q_{in,nat}(t)}$ as given earlier.

releases" arrows in Fig. S2):

$$
\begin{aligned}
V(t + \Delta t) &= V(t) + \left[Q_{in,nat}(t) - Q_{RoR}(t) - Q_{stable}(t) - Q_{flexible}(t) - Q_{spill}(t) + [\pi(t) - \lambda(t)] \frac{A(t)}{\rho} \right] \Delta t \\
&= V(t) + \left[Q_{in,frac}(t) - Q_{stable}(t) - Q_{flexible}(t) - Q_{spill}(t) + [\pi(t) - \lambda(t)] \frac{A(t)}{\rho} \right] \Delta t, \qquad \text{(S31)}
\end{aligned}
$$

and the corresponding seasonal power generation is then equal to

$$
P_{RoR}^{hydro}(t) = \min \left[Q_{RoR}(t); \max \left[0; Q_{turb}^{max} - Q_{stable}(t) - Q_{flexible}(t) \right] \right] \eta_{turb} \rho g h(t). \qquad \text{(S32)}
$$

Electricity generation from the hydropower component, denoted E_{RoR}^{hydro}, is then equal to

$$
E_{RoR}^{hydro} = \int_{year} P_{RoR}^{hydro}(t) \, dt. \qquad \text{(S33)}
$$

Dispatching such as described for large hydropower plants in the previous sections is done similarly for small hydropower plants, with the following adaptations: (i) the component $Q_{in,frac}(t)$ is used as reference flow instead of $Q_{in,nat}(t)$ in equation (S4); (ii) the rule is added that, as soon as reservoir levels drop precariously low (in this case, below $f_{restart} V_{max}$), the seasonal outflow (if nonzero) is temporarily stopped and the operation reverts to that of large hydropower plants, using the full inflow to stabilise water levels; and (iii) the seasonal power generation $P_{RoR}^{hydro}(t)$ is not included in equation (S9) as it is not expected to take part in the hour-to-hour load-following. Note, however, that if river discharge would be regulated by other reservoirs upstream in a cascade-like configuration, even $P_{RoR}^{hydro}(t)$ could become relatively stable throughout the year.

Note 6 Optional pumped-storage assessment

The REVUB code can also be used to assess the potential for increasing load-following potential by refurbishing large hydropower plants to pumped-storage schemes[15], such that excess production (typically of solar PV during mid-day) can be used to pump water back up into the reservoir, enabling the energy to be stored for use at a later stage. This would involve (i) building a downstream reservoir with volume $V_{lower,max} \ll V_{max}$ to store part of the released water, from which it can be pumped back up into the reservoir, and (ii) ensuring the turbines can be operated in reverse mode and/or pumps are installed.

The hydrological balance components then change as follows. First, since environmental flow constraints still have to be met, only the component $Q_{flexible}(t)$ can be used for filling the lower reservoir while the component $Q_{stable}(t)$ has to be directly discharged downstream. The water balance of the lower reservoir is then given by

$$
V_{lower}(t + \Delta t) = V_{lower}(t) + [Q_{flexible}(t) - Q_{pump}(t) - Q_{spill,lower}(t)] \Delta t, \qquad \text{(S34)}
$$

where $Q_{pump}(t)$ is the water pumped back up to the large reservoir for storage, and $Q_{spill,lower}(t)$ is the overflow component of the lower reservoir. The precipitation and evaporation terms are neglected here as the lower reservoir is assumed to have a much smaller surface area than the upper reservoir. The water balance of the large reservoir is then given (cf. equation (S3)) by

$$
V(t + \Delta t) = V(t) + \left[Q_{in,nat}(t) - Q_{stable}(t) - Q_{flexible}(t) + Q_{pump}(t) - Q_{spill}(t) + [\pi(t) - \lambda(t)] \frac{A(t)}{\rho} \right] \Delta t, \quad \text{(S35)}
$$

and the net outflow of the pumped-storage plant is given (cf. equation (S2)) by

$$
Q_{out}(t) = Q_{stable}(t) + Q_{spill}(t) + Q_{spill,lower}(t). \qquad \text{(S36)}
$$

A schematic of this operation is shown in Fig. S3 (cf. Fig. S2). Note that pumped-storage operation is only useful for large hydropower plants, as small plants have to continuously discharge during large parts of the year to prevent spillage, and pumping water back up would thus not serve a purpose.
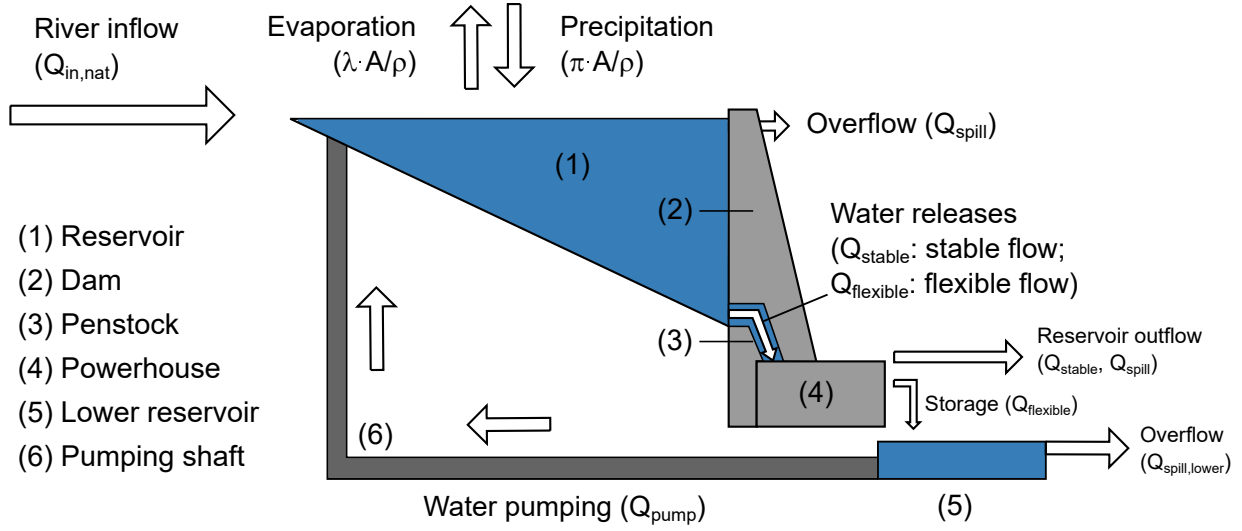
Figure S3: **Flowchart of the water gains and losses of a large hydropower plant, including pumped storage.** Water gains and losses of a hydropower plant modelled as pumped-storage plant, with an additional lower reservoir and a flow of water in the upstream direction for temporary energy storage.

339 The component $Q_{pump}(t)$ is calculated as follows. The power stored by pumping is given by

$$P_{pump}(t) = \begin{cases} 0, & \text{for } P_d(t) < 0 \\ \min\left[Q_{pump}^{pot}(t)\eta_{pump}^{-1}\rho g h(t); \min\left[P_d(t); P_{pump}(t-1) + \Delta P_{pump}^{ramp}\right]\right], & \text{for } P_d(t) \geq 0 \ \& \ \Delta P_d(t) \geq 0 \\ \min\left[Q_{pump}^{pot}(t)\eta_{pump}^{-1}\rho g h(t); \max\left[P_d(t); P_{pump}(t-1) - \Delta P_{pump}^{ramp}\right]\right], & \text{for } P_d(t) \geq 0 \ \& \ \Delta P_d(t) < 0 \end{cases}, \quad \text{(S37)}$$

340 where ΔP_{pump}^{ramp} is the maximum ramp rate for pumping, η_{pump} is the pumping efficiency, and

$$Q_{pump}^{pot}(t) = \min\left[\frac{V_{lower}(t)}{\Delta t}; Q_{pump}^{max}\right] \quad \text{(S38)}$$

341 with Q_{pump}^{max} the maximum pump throughput. The flow pumped back into the reservoir then equals

$$Q_{pump}(t) = \frac{P_{pump}(t)}{\eta_{pump}^{-1}\rho g h(t)}. \quad \text{(S39)}$$

342 Finally, the overflow component of the lower reservoir is calculated as

$$Q_{spill,lower}(t) = \begin{cases} 0, & \text{for } (V_{lower,max} - V_{lower}(t))/\Delta t \geq Q_{flexible}(t) \\ Q_{flexible}(t) - (V_{lower,max} - V_{lower}(t))/\Delta t, & \text{for } (V_{lower,max} - V_{lower}(t))/\Delta t < Q_{flexible}(t) \end{cases}. \quad \text{(S40)}$$

343 Since the pumping allows a certain fraction of the water to be recycled for power generation, the values
344 c_{solar}^{opt} and c_{wind}^{opt} resulting from the optimisation described in Note 3.2 will end up higher as compared
345 to a situation without pumping component. In this way, pumped storage can help increase the load
346 that can be carried by the hydro-solar-wind combination.
347 The REVUB code includes an optional section to perform the above operations and the required
348 optimisation (this scenario is named "STOR" in the code, as opposed to "CONV" and "BAL").

Note 7   Meeting spinning reserve requirements

350 In electricity networks, a certain reserve capacity, to be utilised in case of disruptions of supply, must
351 always be available. The reserve capacity that is already online is denoted the spinning reserve,
352 of which hydropower plants with reservoirs are typical providers. However, the flexible hydropower
353 operation modeled by REVUB requires hydropower output to be increased during certain intervals to
354 compensate for reductions in solar and/or wind power; thus, the remaining spinning reserves available
355 to manage contingencies will consistently reach minimum values during those times.

12

The question is thus whether the hydropower plants could still respond to contingency events (e.g. failure of a transmission line leading to a solar power park temporarily being disconnected), despite being operated by flexible rule curves that lead to regular minima in the available spinning reserves. The spinning reserves $P_{spin}(t)$ from all hydropower plants within a certain geography can be calculated as

$$P_{spin}(t) = \sum_{\substack{\text{all hydro} \\ \text{plants}}} [1 - CF_{hydro}(t)]\, P_{turb}^r \Gamma(t), \tag{S41}$$

where $\Gamma(t)$ equals zero if the hydropower plant has temporarily undergone a drought-related shutdown, and unity otherwise; and $CF_{hydro}(t)$ is the capacity factor of each hydropower plant, calculated as

$$CF_{hydro}(t) = \frac{P_{stable}^{hydro}(t) + P_{flexible}^{hydro}(t) + P_{RoR}^{hydro}(t)}{P_{turb}^r}. \tag{S42}$$

To test the ability of hydropower to respond to supply disruptions of the added solar and wind power, the user should (ex-post) calculate the ratio (denoted ν) of $P_{spin}(t)$ to the total solar and wind power generation assumed to feed into the same grid. Typical benchmarks of spinning reserve needs for high-RE systems are in the order of $\nu \sim 10 - 20\%$[18].

Note 8   Glossary

The table below provides an overview of all described parameters used in the REVUB model and its inputs and outputs. The symbol of each parameter is provided alongside its unit, a description of what it represents in the model, its data type (constant, variable, time series), its use in the model (as input, output, intermediate result, or used for preparing input), and its applicability across various components of the model. Here, "scenario" denotes a certain simulation setting: different scenarios may have different solar/wind mixes, different constraints on overproduction, different pools of hydropower plants contributing to flexibility, etc.

Symbol	Unit	Description	Type	Used as/for	Applicable to
$A(t)$	m^2	Reservoir lake surface area	Time series	Output	each hydropower plant & each scenario
A_{max}	m^2	Maximum reservoir lake surface area (reached at maximum filling level V_{max})	Constant	Input	each hydropower plant
C_{OR}	-	Operating reserve coefficient: Fraction of yearly reservoir inflow available for flexible use	Variable	-	each hydropower plant
C_{OR}^{max}	-	Maximum allowed operating reserve coefficient taking into account environmental flow needs	Constant	Input	each hydropower plant
C_{OR}^{opt}	-	Optimal operating reserve coefficient	Constant	Output	each hydropower plant & each scenario
c_{solar}	MW	Installed capacity of solar panels	Constant	Output	each hydropower plant & each scenario
c_{solar}^{opt}	MW	Optimal installed solar power capacity needed to follow optimal load $L_{opt}(t)$	Constant	Output	each hydropower plant & each scenario
c_{wind}	MW	Installed capacity of wind turbines	Constant	Output	each hydropower plant & each scenario
c_{wind}^{opt}	MW	Optimal installed wind power capacity needed to follow optimal load $L_{opt}(t)$	Constant	Output	each hydropower plant & each scenario
$CF_{hydro}(t)$	-	Capacity factor of hydropower plants	Time series	Output	each hydropower plant & each scenario
$CF_{solar}(t)$	-	Weighted average capacity factor of solar panels across locations	Time series	Input	each scenario
$CF_{solar}^n(t)$	-	Capacity factor of solar panels in each location with index n	Time series	Input	each solar power site
$CF_{wind}(t)$	-	Weighted average capacity factor of wind turbines across locations	Time series	Input	each scenario
$CF_{wind}^n(t)$	-	Capacity factor of wind turbines in each location with index n	Time series	Input	each wind power site
d_{min}	-	Fraction of average storable reservoir inflow required as minimum outflow	Constant	Input	each hydropower plant
$d_{min}^{default}$	-	Default value of d_{min} used by REVUB in case of non-specification by user	Constant	Input	each hydropower plant
ΔP_{turb}^{ramp}	MW/min	Maximum ramp rate of hydropower plant	Constant	Input	each hydropower plant
ΔP_{pump}^{ramp}	MW/min	When simulating pumped-storage potential: Maximum ramp rate of pumps	Constant	Input	each large hydropower plant

13

Symbol	Unit	Description	Type	Used as/for	Applicable to
$E_{reservoir}^{hydro}$	GWh/year	Total yearly hydropower generation	Yearly total	Output	each hydropower plant & each scenario
E_{stable}^{hydro}	GWh/year	Total yearly hydropower generation from stable reservoir outflow component	Yearly total	Output	each hydropower plant & each scenario
$E_{flexible}^{hydro}$	GWh/year	Total yearly hydropower generation from flexible reservoir outflow component	Yearly total	Output	each hydropower plant & each scenario
E_{RoR}^{hydro}	GWh/year	Total yearly hydropower generation from seasonal run-of-river outflow component	Yearly total	Output	each small hydropower plant & each scenario
E_{solar}	GWh/year	Total yearly solar power generation	Yearly total	Output	each hydropower plant & each scenario
E_{wind}	GWh/year	Total yearly wind power generation	Yearly total	Output	each hydropower plant & each scenario
ELCC	GWh/year	Effective Load Carrying Capability. Total yearly load followed by hydro-solar-wind without loss of load, ensuring long-term lake level stability, and meeting environmental flow requirements. Integral of $L_{followed}(t)$ over all time steps in a year.	Yearly total	Output	each hydropower plant & each scenario
$ELCC_{tot}$	GWh/year	Aggregate of ELCC across all power plants. Also called "total load-following potential" of hydro-solar-wind.	Yearly total	Output	each scenario
η_{turb}	-	Hydroturbine conversion efficiency	Constant	Input	each hydropower plant
η_{pump}	-	When simulating pumped-storage potential: Pumping efficiency	Constant	Input	each hydropower plant
f_{opt}	-	Optimal filling fraction of hydropower reservoir	Constant	Input	each hydropower plant
f_{spill}	-	Reservoir filling fraction at which overflow prevention via spillways is initiated	Constant	Input	each hydropower plant
f_{stop}	-	Low reservoir filling fraction at which hydropower generation is curtailed	Constant	Input	each hydropower plant
$f_{restart}$	-	Reservoir filling fraction at which hydropower generation is restarted after curtailment	Constant	Input	each hydropower plant
f_{reg}	-	Fraction of yearly average natural inflow allocated to flexible use	Constant	Input	each hydropower plant
g	m/s^2	Gravitational acceleration	Constant	Input	general
γ	-	Conventional reservoir rule parameter	Constant	Input	each hydropower plant
$\Gamma(t)$	-	Binary function indicating whether hydropower plant is operating (1) or not (0)	Time series	Output	each hydropower plant & each scenario
$h(t)$	m	Hydraulic head: Difference in water level between headwater (behind the dam) and tailwater (at the turbines)	Time series	Output	each hydropower plant & each scenario
h_{max}	m	Maximum hydraulic head of hydropower scheme (reached at maximum filling level V_{max})	Constant	Input	each hydropower plant
$k_{turb}(t)$	-	Hydroturbine utilisation rate	Time series	Output	each hydropower plant & each scenario
κ	-	Conventional reservoir rule parameter	Constant	Input	each hydropower plant
$L(t)$	MW	Load to be followed	Time series	Intermediate	each scenario
$L_{opt}(t)$	MW	Optimal load to be followed by hydro-solar-wind mix, ensuring long-term reservoir lake level stability	Time series	Output	each hydropower plant & each scenario
$L_{followed}(t)$	MW	Actual followed load under optimal solution at zero loss of load (ideally equal to $L_{opt}(t)$)	Time series	Output	each hydropower plant & each scenario
$L_{res}(t)$	MW	Residual load: Difference between actual followed load and total hydro-solar-wind power generation	Time series	Intermediate	each hydropower plant & each scenario
$L_{norm}(t)$	-	Normalised load curve shape	Time series	Input	each scenario
$\lambda(t)$	kg/m^2/s	Evaporation flux on reservoir lake surface	Time series	Input	each hydropower plant
μ	-	Constant used in modelling overflow prevention via spillways	Constant	Input	each hydropower plant
n	-	Index for different locations of solar and wind power generation	Index	-	solar power and wind power sites
N_{solar}	-	Total number of solar power generation sites connected to the same power grid	Constant	Pre-input	each scenario
N_{wind}	-	Total number of wind power generation sites connected to the same power grid	Constant	Pre-input	each scenario
$N_{turbines}$	-	Total number of turbines (units) of a single hydropower plant	Constant	Pre-input	each hydropower plant
$\nu(t)$	-	Ratio of spinning reserves to total solar and wind power generation	Time series	Output	each hydropower plant & each scenario
P_{turb}^r	MW	Rated hydroturbine capacity	Constant	Input	each hydropower plant
$P_{stable}^{hydro}(t)$	MW	Power generated by stable component of reservoir outflow	Time series	Output	each hydropower plant & each scenario
$P_{flexible}^{hydro}(t)$	MW	Power generated by flexible component of reservoir outflow	Time series	Output	each hydropower plant & each scenario

Symbol	Unit	Description	Type	Used as/for	Applicable to
$P_{RoR}^{hydro}(t)$	MW	Power generated by seasonal run-of-river component of reservoir outflow	Time series	Output	each small hydropower plant & each scenario
$P_{inflexible}(t)$	MW	Inflexible power generation (stable hydro + solar + wind)	Time series	Intermediate	each hydropower plant & each scenario
$P_{solar}(t)$	MW	Solar power generation	Time series	Output	each hydropower plant & each scenario
$P_{wind}(t)$	MW	Wind power generation	Time series	Output	each hydropower plant & each scenario
$P_{followed}$	MW	Average actual followed load under optimal solution	Constant	Output	each hydropower plant & each scenario
$P_{guaranteed}^{xx}$	MW	Guaranteed power (based on user-defined exceedance percentile xx) across simulation horizon	Constant	Output	each hydropower plant & each scenario
P_{load}	MW	Average load to be followed	Constant	Intermediate	each hydropower plant & each scenario
$P_{spin}(t)$	MW	Spinning reserves available from all hydropower plants	Time series	Output	each hydropower plant & each scenario
$P_{pump}(t)$	MW	When simulating pumped-storage potential: Power used for pumping	Time series	Output	each large hydropower plant & each scenario
$P_d(t)$	MW	Difference between total inflexible power generation (stable hydro + solar + wind) and to-be-followed load	Time series	Output	each hydropower plant & each scenario
ϕ	-	Conventional reservoir rule parameter	Constant	Input	each hydropower plant
$\pi(t)$	kg/m^2/s	Precipitation flux on reservoir lake surface	Time series	Input	each hydropower plant
Ψ	-	Relative deviation between simulated lake levels under balancing-oriented and conventional operation, respectively	Function of c_{solar}, c_{wind}	Intermediate	each hydropower plant & each scenario
$Q_{in,frac}(t)$	m^3/s	Part of natural inflow assumed to be storable, equal to f_{reg} times the natural inflow	Time series	Intermediate	each small hydropower plant
$Q_{in,nat}(t)$	m^3/s	Natural river discharge into reservoir	Time series	Input	each hydropower plant
$Q_{out}(t)$	m^3/s	Total reservoir outflow, consisting of stable, flexible, run-of-river and spilling components	Time series	Output	each hydropower plant & each scenario
$Q_{stable}(t)$	m^3/s	Stable component of reservoir outflow	Time series	Output	each hydropower plant & each scenario
$Q_{stable}^{tech}(t)$	m^3/s	Technologically required part (related to minimum stable turbine load and need for active synchronous capacity) of stable component of reservoir outflow	Time series	Output	each hydropower plant & each scenario
$Q_{stable}^{env/irr}(t)$	m^3/s	Environmentally/irrigation-wise required part of stable component of reservoir outflow	Time series	Output	each hydropower plant & each scenario
$Q_{flexible}(t)$	m^3/s	Flexible component of reservoir outflow	Time series	Output	each hydropower plant & each scenario
$Q_{RoR}(t)$	m^3/s	Seasonal run-of-river component of reservoir outflow (zero for large hydropower plants)	Time series	Output	each small hydropower plant
$Q_{spill}(t)$	m^3/s	Spilling component of reservoir outflow	Time series	Output	each hydropower plant & each scenario
Q_{turb}^{max}	m^3/s	Maximum hydroturbine throughput	Constant	Input	each hydropower plant
$Q_{turb,flexible}^{pot}(t)$	m^3/s	Maximum potential outflow available for flexible hydropower generation, before accounting for needs and ramping constraints	Time series	Intermediate	each hydropower plant & each scenario
$Q_{pump}(t)$	m^3/s	When simulating pumped-storage potential: Pumped flow	Time series	Output	each large hydropower plant & each scenario
Q_{pump}^{max}	m^3/s	When simulating pumped-storage potential: Maximum pumping throughput	Constant	Input	each large hydropower plant
ρ	kg/m^3	Density of water	Constant	Input	general
t	hours	Time	Variable	-	general
T_{year}	seconds	Number of seconds in a year	Constant	Input	general
τ_{fill}	-	Filling time: number of years it takes (on average) to fill reservoir with natural inflow	Constant	Intermediate	each hydropower plant
$\tau_{fill,frac}$	-	Filling time: number of years it takes (on average) to fill reservoir with fraction f_{reg} of natural inflow	Constant	Intermediate	each small hydropower plant
$V(t)$	m^3	Volume of water in reservoir	Time series	Output	each hydropower plant & each scenario
V_{max}	m^3	Maximum reservoir volume	Constant	Input	each hydropower plant
$V_{lower}(t)$	m^3	When simulating pumped-storage potential: Volume of lower reservoir	Time series	Output	each large hydropower plant & each scenario
$V_{lower,max}$	m^3	When simulating pumped-storage potential: Maximum volume of lower reservoir	Constant	Input	each large hydropower plant
w_{solar}^n	-	Weight factor for capacity in each solar power site	Constant	Pre-input	each solar power site
w_{wind}^n	-	Weight factor for capacity in each wind power site	Constant	Pre-input	each wind power site
z_{max}	m	Maximal reservoir depth	Constant	Pre-input	each hydropower plant

Note 9   Running the model: Input (A)

The initialisation of the REVUB simulation is done through the file `A_REVUB_initialise_minimum_example`. In the code, all parameters that should be defined by the user (through accompanying Excel files) are indicated by `[Set by user]`. This includes various types of data:

- *General modelling parameters* referring to the length of the time series to simulate, and to physical, invariant quantities used in the hydropower modelling, according to the equations introduced in this Manual. These quantities are set in the worksheet "`General parameters`" of the Excel file `parameters_simulation.xlsx`.

- *Hydropower-plant specific parameters*, which are constants specific to each hydropower plant, and thus to be entered as 1-dimensional arrays with length equal to the number of hydropower plants for which to run a simulation, with each element representing the corresponding value for the corresponding hydropower plant. These quantities are set in the worksheet "`Hydropower plant parameters`" of the Excel file `parameters_simulation.xlsx`. In this worksheet, it is also possible to turn on/off individual hydropower plants for simulation inclusion; thus, the worksheet can serve as overall database to collect hydropower plant data.

- *Bathymetric relationship* for the modelled hydropower plants. These values should be read in by the code as an array with three columns and a user-determined number of rows; the first column should represent reservoir volume, and the second and third column the corresponding area and hydraulic head values. The relationships are set in the Excel file `data_bathymetry.xlsx`.

- *Time series* of important parameters whose value needs to be known for each time step before a simulation can be performed, namely reservoir inflow, evaporation, precipitation, solar/wind power capacity factor, and the shape of the electricity demand profile. These values should be read in by the code as two-dimensional matrices for each hydropower plant, with the following dimensions[viii]: *[number of time slices (default: hours) per year; number of years covered by the simulation]*.[ix] These quantities are set in the other Excel files `data_xxx.xlsx`.

  It should be noted that hydrological time series (inflow, precipitation, evaporation) are often only available at monthly timescale, not hourly, as opposed to solar/wind capacity factors and load. The REVUB repository contains a monthly-to-hourly data converter code (`rearrange_data_monthly_to_hourly`, under "*data/auxiliary scripts*") that parses user-specified monthly time series (to be entered in columns in the file `rearrange_data_template.xlsx`) into the required matrix format required for REVUB. Running the converter code provides a matrix named `output_hourly_byyear` that can be copy-pasted into the relevant `data_xxx.xlsx` files.

Note 10   Running the model: Core code (B)

The actual core code of REVUB is contained in the file `B_REVUB_main_code`. Once the input data has been loaded using the file `A_REVUB_initialise_minimum_example`, the user can principally run this core code directly. The first lines of this code contain parameters related to accuracy and speed of computation denoted `[Set by user]`, which can be tuned through the worksheet named "`Simulation accuracy`" of the accompanying Excel file `parameters_simulation.xlsx`:

[viii]Note that these technically refer to minimum dimensions. The user can, for instance, enter data for a higher amount of columns (years) than there are years in the simulation as specified by the time-related parameters above; REVUB will ignore those extra columns. This feature may be used to run initial tests using a limited number of years to speed up simulation time, before running with all years once satisfied with simulations settings.

[ix]Note that the REVUB code is designed to take into account the extra days occurring in leap years; for the purposes of preparing these data sets, if the simulation period contains leap years, the number of elements along the first dimension of these matrices should thus reflect the number of time slices (hours) in a leap year, and the data for non-leap years should be appended with *nan* values to reach the same length.

- N_ELCC determines the accuracy (the number of discrete steps between zero and maximum power generation) with which the zero-crossing of L_{res} in equation (S22) is determined.

- f_init_BAL_start, f_init_BAL_step and f_init_BAL_end determine the range (start, step size, and end) of $E_{solar} + E_{wind}$ (cf. equation (S25)), expressed as a fraction of $E_{reservoir,CONV}^{hydro}$ (cf. equation (S24)), i.e. the solution space in which the REVUB code starts searching for the solution to equation (S21). Note that the code gives a warning message to the user in case this range turns out to be inadequate (i.e. if no global minimum in Ψ is found). The same ranges should also be given for STOR scenarios (f_init_STOR_start, f_init_STOR_step and f_init_STOR_end) in case the user wishes to model these.

- N_refine_BAL determines the accuracy with which the solution to equation (S21) is determined. After the initial search for this minimum in the range [f_init_BAL_start : f_init_BAL_step : f_init_BAL_end] (see previous point), the REVUB model can zoom in to the range around this minimum to identify its value with increased accuracy, using a step size reduced by a factor of ten. The number of times with which this is done is determined by N_refine_BAL. Thus, N_refine_BAL = 1 means that the initial search is deemed accurate enough, whereas each +1 in N_refine_BAL increases the accuracy of identification of the minimum in Ψ by one digit. Accordingly, each +1 also increases computation time proportionally. For users wishing to model STOR scenarios, the same principle applies to N_refine_STOR.

- psi_min_threshold is zero by default, but can be set higher to speed up computation time in case the search for the minimum in Ψ takes too long. This parameter ensures that the zooming-in to higher accuracies (see previous point) is stopped as soon as $\min(\Psi)$ ends up below psi_min_threshold. It can thus be a compromise for users wishing to have high accuracy of determining $\min(\Psi)$ (i.e. setting N_refine_BAL/STOR > 1) but not at a high cost of computational speed.

- X_max_BAL determines the amount of iterative loops employed by the model to get a converged estimate of $P_{stable,BAL}^{hydro}$ (cf. equation (S9) and the explanation below equation (S19)). Each +1 also increases computation time proportionally. For users wishing to model STOR scenarios, the same principle applies to X_max_STOR.

Note 11 Running the model: Output graphics (C)

The results of the REVUB simulation are post-processed with two separate files, named C_REVUB_plotting and C_REVUB_plotting_multiple, which generate several standardised figures based on the input and output of the model. The two files serve a somewhat different purpose:

- The file C_REVUB_plotting_individual is used to plot simulation results pertaining to a single (user-selected) hydropower plant.

- The file C_REVUB_plotting_multiple is used to aggregate simulation results pertaining to (a user-selected set of) all hydropower plants. Based on a user-defined total electricity demand, it shows how much of this total demand can be met by hydro-solar-wind power on all involved timescales, and how much would remain to be met by other power sources.

Note 11.1 Results for individual power plants

The figures generated by the file C_REVUB_plotting_individual are described below.

- Figure 1 shows (a) the (h, V) and (b) the (A, V) bathymetric calibration curves used as input to the model.

17

- Figure 2 shows (a) the full time series of hydraulic head $h(t)$ under CONV, BAL and (if modelled) STOR, (b) the frequency spectrum of these hydraulic head curves such that e.g. specific temporal signatures, such as diurnal dispatch in solar-heavy systems, can be discerned, and (c) the monthly median and interquartile ranges of natural inflow $Q_{in,nat}(t)$ and outflow $Q_{out}(t)$ (equation (S2)) under CONV, BAL and (if modelled) STOR.

- Figure 3 shows (a) the full time series of lake volume $V(t)$ under CONV, BAL and (if modelled) STOR, and (b) the monthly average time series of natural inflow $Q_{in,nat}(t)$ and outflow $Q_{out}(t)$ under CONV, BAL and (if modelled) STOR.

- Figure 4 shows the monthly average composition of the hydro-solar-wind mix supported by the selected hydropower plant, under the BAL scenario and for a user-defined year (see below). The figure indicates hydropower generation (by stable, flexible and RoR components) and the optimal solar and wind power contribution identified by REVUB. The achieved ELCC, whose profile reflects that of $L_{norm}(t)$, is also indicated. In case a STOR scenario was simulated, a corresponding extra figure will be produced for that scenario, additionally indicating the pump-stored part of solar/wind power generation.

- Figure 5 is analogous to Figure 4, but at yearly resolution and reflecting the entire simulated time series.

- Figure 6 is analogous to Figure 4, but at hourly (full) resolution for a user-defined time slice (see below).

- Figure 7 shows approximated reservoir release rules in the BAL scenario for a user-defined hour of the day during a user-defined month. The plot shows the median and interquartile range of needed reservoir release (minus the RoR and spill components, i.e. $Q_{stable} + Q_{flexible}$) versus the median hydraulic head, with each data point denoting results from one simulation year. A linear fit to these data points is also shown.

- Figure 8 shows statistics of turbine use over the simulated period. Based on the number of units installed (part of the input in the worksheet "Hydropower plant parameters" of the Excel file parameters_simulation.xlsx; see above), the amount of time in which a specific number of those is active is extracted from the hourly profiles of power generation and plotted in a bar chart.

At the beginning of the code, a few parameters denoted [Set by user] in the code are loaded from an Excel file: worksheets "Plot power output (single HPP)" and "Plot release rules (single HPP)" of the file plotting_settings.xlsx, where they can be changed to adapt the data to be plotted. These are as follows:

- plot_HPP is the index of the hydropower plant for which to plot results in all Figures.

- plot_year is the index of the simulation year for which to plot results in Figures 4 and 6.

- plot_month is the month in which to start the time slice in Figure 6.

- plot_day_month is the day of the month defined by plot_month on which to start the time slice in Figure 6.

- plot_num_days is the number of days for which to plot results in Figure 6.

- plot_rules_month is the month(s) of the year for which to plot results in Figure 7. This can be an array, e.g. [1, 4] would denote that the curves in Figure 7 are plotted both for January and for April.

- plot_rules_hr is the hour(s) of day during the month defined by plot_rules_month for which to plot results in Figure 7. This can be an array, e.g. [8, 20] would denote that the curves in Figure 7 are plotted both for 8 a.m. and 8 p.m.

Note 11.2 Results for multiple power plants

The file `C_REVUB_plotting_multiple` serves to show to what extent the investigated hydropower, solar power and wind power plants could contribute to the overall power mix of a given territory. The principle of this file is as follows:

- To run the file, the user must first define an overall electricity demand curve, denoted `P_total_hourly` (see below).

- The file then plots the aggregate power generation from all investigated hydro, solar and wind plants under BAL and STOR, and compares it to `P_total_hourly`.

- Any shortfalls in renewable power generation are then assumed to be filled up by thermal power plants. This reflects the assumption of a priority of dispatch for renewables.

- When renewable power generation exceeds `P_total_hourly` by a certain amount, this amount is assumed to be curtailed.

In this way, the file allows to calculate the total power mix (hydro/solar/wind/thermal) suggested by the streamlined hydro-solar-wind operation as simulated by REVUB.
The figures produced by the file are described below.

- Figure 1 shows the monthly average composition of the hydro-solar-wind mix under the BAL scenario for a user-defined year (see below). The figure indicates the total power demand `P_total_hourly`, and how this power demand is met by the aggregate hydropower generation (by stable, flexible and RoR components) from all hydropower plants, the aggregate of all solar and wind power, and the necessary other (thermal) power generation. Any curtailed solar/wind power is shown as such. The curve representing ELCC_{tot} is also included. In case a STOR scenario was simulated, a corresponding extra figure will be produced for that scenario, additionally indicating the pump-stored part of solar/wind power generation. (In this case, small hydropower plants for which no STOR scenario is available (cf. section Note 6) are included according to their BAL results.)

- Figure 2 is analogous to Figure 1, but at yearly resolution and reflecting the entire simulated time series.

- Figure 3 is analogous to Figure 1, but at hourly (full) resolution for a user-defined time slice (see below).

At the beginning of the code, a few parameters denoted `[Set by user]` in the code are loaded from an Excel file: worksheet "`Plot power output (multi HPP)`" of the file `plotting_settings.xlsx`, where they can be changed to adapt the data to be plotted. These are as follows:

- `plot_HPP_multiple` is an array containing the indices of the hydropower plants whose results are to be aggregated in the Figures. The user can thus select all, or a selection of, the simulated hydropower plants.

- `plot_year_multiple` is the index of the simulation year for which to plot results in Figures 1 and 3.

- `plot_month_multiple` is the month in which to start the time slice in Figure 3.

- `plot_day_month_multiple` is the day of the month defined by `plot_month` on which to start the time slice in Figure 3.

- `plot_num_days_multiple` is the number of days for which to plot results in Figure 3.

- `P_total_hourly` is the total power demand (for all time steps of the simulation) against which the hydro-solar-wind power generation is compared. We recommend that this is taken to be equal to $P_{total}^{av} L_{norm}(t)$ (cf. equation (S10)), with P_{total}^{av} the average total power demand (in MW), to be specified by the user.

19

Note 12   Examples of model use

The REVUB model has so far been used in, and/or inspired the methods of, the following publications/documents:

- S. Sterl, I. Vanderkelen, C.J. Chawanda, D. Russo, R.J. Brecha, A. van Griensven, N.P.M. van Lipzig, and W. Thiery. Smart renewable electricity portfolios in West Africa. *Nature Sustainability* **3**, 710–719 (2020). `https://doi.org/10.1038/s41893-020-0539-0`.

- S. Sterl, P. Donk, P. Willems, and W. Thiery. Turbines of the Caribbean: Decarbonising Suriname's electricity mix through hydro-supported integration of wind power. *Renewable and Sustainable Energy Reviews* **134** (2020) 110352. `https://doi.org/10.1016/j.rser.2020.110352`.

- P. Donk, S. Sterl, W. Thiery, and P. Willems. REVUB-Light: A parsimonious model to assess power system balancing and flexibility for optimal intermittent renewable energy integration— A study of Suriname. *Renewable Energy* **173**, 57–75 (2021). `https://doi.org/10.1016/j.renene.2021.03.117`.

- S. Sterl, D. Fadly, S. Liersch, H. Koch, and W. Thiery. Linking solar and wind power in eastern Africa with operation of the Grand Ethiopian Renaissance Dam. *Nature Energy* **6**, 407–418 (2021). `https://doi.org/10.1038/s41560-021-00799-5`.

- S. Sterl, A. Devillers, C.J. Chawanda, A. van Griensven, W. Thiery, and D. Russo. A spatiotemporal atlas of hydropower in Africa for energy modelling purposes. *Open Research Europe* **1**, 29 (2021). `https://doi.org/10.12688/openreseurope.13392.3`.

- S. Sterl and W. Thiery. La faisabilité du solaire PV pour remplacer la centrale hydroélectrique de Koukoutamba en Guinée: Étude quantitative. Vrije Universiteit Brussel, Brussels, Belgium (2022). `http://dx.doi.org/10.13140/RG.2.2.26548.83848`.

- P. Donk, S. Sterl, W. Thiery, and P. Willems. A policy framework for power system planning towards optimized integration of renewables under potential climate change – The Small Island Developing States perspective. *Energy Policy* **177** (2023). `https://doi.org/10.1016/j.enpol.2023.113526`.

- H. Hoff, M. Ogeya, D. de Condappa, R.J. Brecha, M.A.D. Larsen, K. Halsnæs, S. Salack, S. Sanfo, S. Sterl, and S. Liersch. Stakeholder-guided, model-based scenarios for a climate- and water-smart electricity transition in Ghana and Burkina Faso. *Energy Strategy Reviews* **49** (2023). `https://doi.org/10.1016/j.esr.2023.101149`.

References

[1] Yang, Z. *et al.* Deriving operating rules for a large-scale hydro-photovoltaic power system using implicit stochastic optimization. *Journal of Cleaner Production* **195**, 562 – 572 (2018).

[2] Ming, B., Liu, P., Guo, S., Cheng, L. & Zhang, J. Hydropower reservoir reoperation to adapt to large-scale photovoltaic power generation. *Energy* **179**, 268 – 279 (2019).

[3] Liersch, S. *et al.* Vulnerability of rice production in the Inner Niger Delta to water resources management under climate variability and change. *Environmental Science and Policy* **34**, 18 – 33 (2013).

[4] Oyerinde, G. T. *et al.* Quantifying uncertainties in modeling climate change impacts on hydropower production. *Climate* **4** (2016).

[5] Vanderkelen, I., van Lipzig, N. P. M. & Thiery, W. Modelling the water balance of Lake Victoria (East Africa) - Part 1: Observational analysis. *Hydrology and Earth System Sciences* **22**, 5509–5525 (2018).

[6] Liersch, S. *et al.* Water resources planning in the Upper Niger River basin: Are there gaps between water demand and supply? *Journal of Hydrology: Regional Studies* **21**, 176 – 194 (2019).

[7] IRENA. Power System Flexibility for the Energy Transition, Part 1: Overview for Policy Makers (2018). URL https://www.irena.org/publications/2018/Nov/Power-system-flexibility-for-the-energy-transition. International Renewable Energy Agency, Abu Dhabi.

[8] Jägermeyr, J., Pastor, A., Biemans, H. & Gerten, D. Reconciling irrigated food production with environmental flows for Sustainable Development Goals implementation. *Nature Communications* **8**, 15900 (2017).

[9] Bakken, T. H., Killingtveit, Å., Engeland, K., Alfredsen, K. & Harby, A. Water consumption from hydropower plants - review of published estimates and an assessment of the concept. *Hydrology and Earth System Sciences* **17**, 3983–4000 (2013).

[10] Proussevitch, A. *et al.* Log-exponential reservoir operating rules for global and regional hydrological modeling (2013). URL https://scholars.unh.edu/earthsci_facpub/383/. Abstract GC21B-0827 presented at 2013 Fall Meeting, AGU, San Francisco, 9-13 December 2013.

[11] Yassin, F. *et al.* Representation and improved parameterization of reservoir operation in hydrological and land-surface models. *Hydrology and Earth System Sciences* **23**, 3735–3764 (2019).

[12] Engeland, K. *et al.* Space-time variability of climate variables and intermittent renewable electricity production - A review. *Renewable and Sustainable Energy Reviews* **79**, 600 – 617 (2017).

[13] Yang, W. *et al.* Burden on hydropower units for short-term balancing of renewable power systems. *Nature Communications* **9**, 2633 (2018).

[14] Homer Energy. HOMER Pro 3.11 - operating reserve (n.d.). URL https://www.homerenergy.com/products/pro/docs/3.11/operating_reserve.html.

[15] Jurasz, J., Mikulik, J., Krzywda, M., Ciapała, B. & Janowski, M. Integrating a wind- and solar-powered hybrid to the power system by coupling it with a hydroelectric power station with pumping installation. *Energy* **144**, 549 – 563 (2018).

[16] Kaveh, K., Hosseinjanzadeh, H. & Hosseini, K. A new equation for calculation of reservoir's area-capacity curves. *KSCE Journal of Civil Engineering* **17**, 1149–1156 (2013).

[17] Turner, S. W., Ng, J. Y. & Galelli, S. Examining global electricity supply vulnerability to climate change using a high-fidelity hydropower dam model. *Science of The Total Environment* **590-591**, 663 – 675 (2017).

[18] Ortega-Vazquez, M. A. & Kirschen, D. M. Estimating the Spinning Reserve Requirements in Systems With Significant Wind Power Generation Penetration. *IEEE Transactions on Power Systems* **24**, 114–124 (2009).