Thu Dec 02 17:14:44 CET 1999

Battery Capacity ▼   Utility Voltage ▼   UPS Load ▼

```
Monitoring: matou.sibbald.com
 UPS Model: SMART-UPS 1000
  UPS Name: UPS_IDEN
   APCUPSD: Version 3.7.0-beta-1
    Status: ONLINE
```
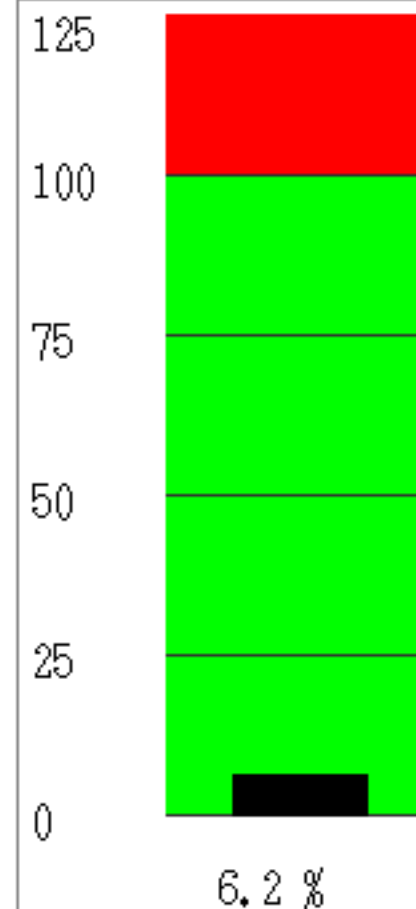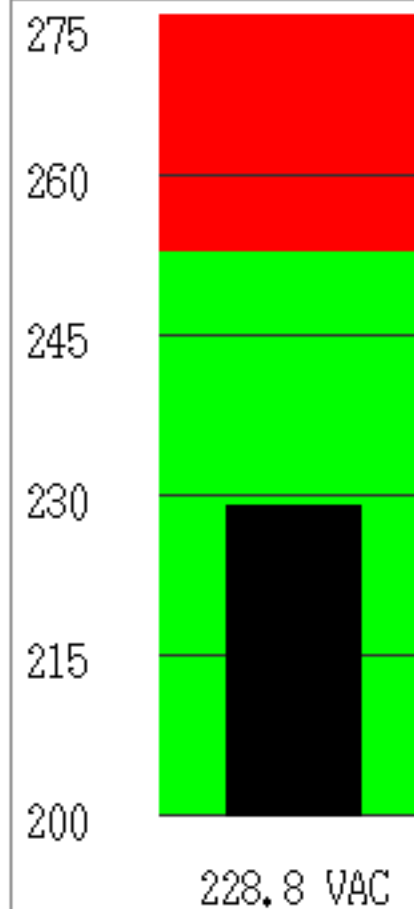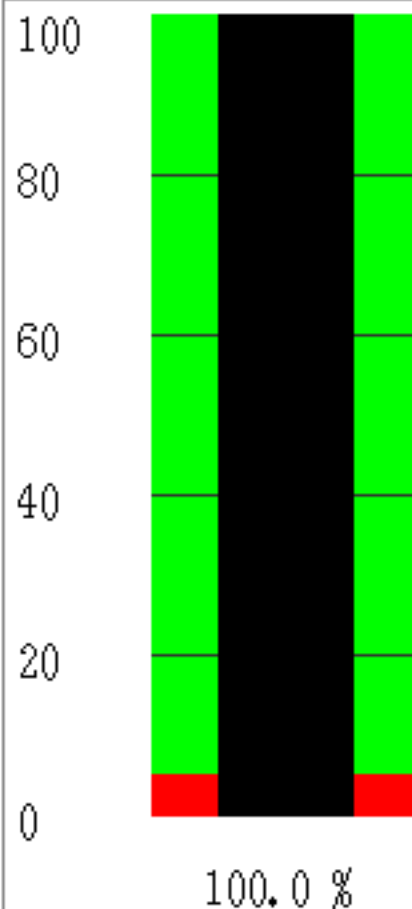
```
Last UPS Self Test: NO
   Last Test Date: N/A
```

```
Utility Voltage: 228.8 VAC
   Line Minimum: 227.5 VAC
   Line Maximum: 232.7 VAC
    Output Freq: 50.0 Hz

    UPS Temp: 35.1 °C ▼
```

100.0 %

228.8 VAC

6.2 %

Most recent events:

```
Thu Dec 02 08:10:18 CET 1999    apcupsd 3.6.3 startup succeeded
Thu Dec 02 08:16:30 CET 1999    apcupsd exiting, signal 15
Thu Dec 02 08:16:30 CET 1999    apcupsd shutdown succeeded
Thu Dec 02 08:16:53 CET 1999    apcserver startup succeeded
Thu Dec 02 08:16:53 CET 1999    apcupsd 3.7.0-beta-1 startup succeeded
```