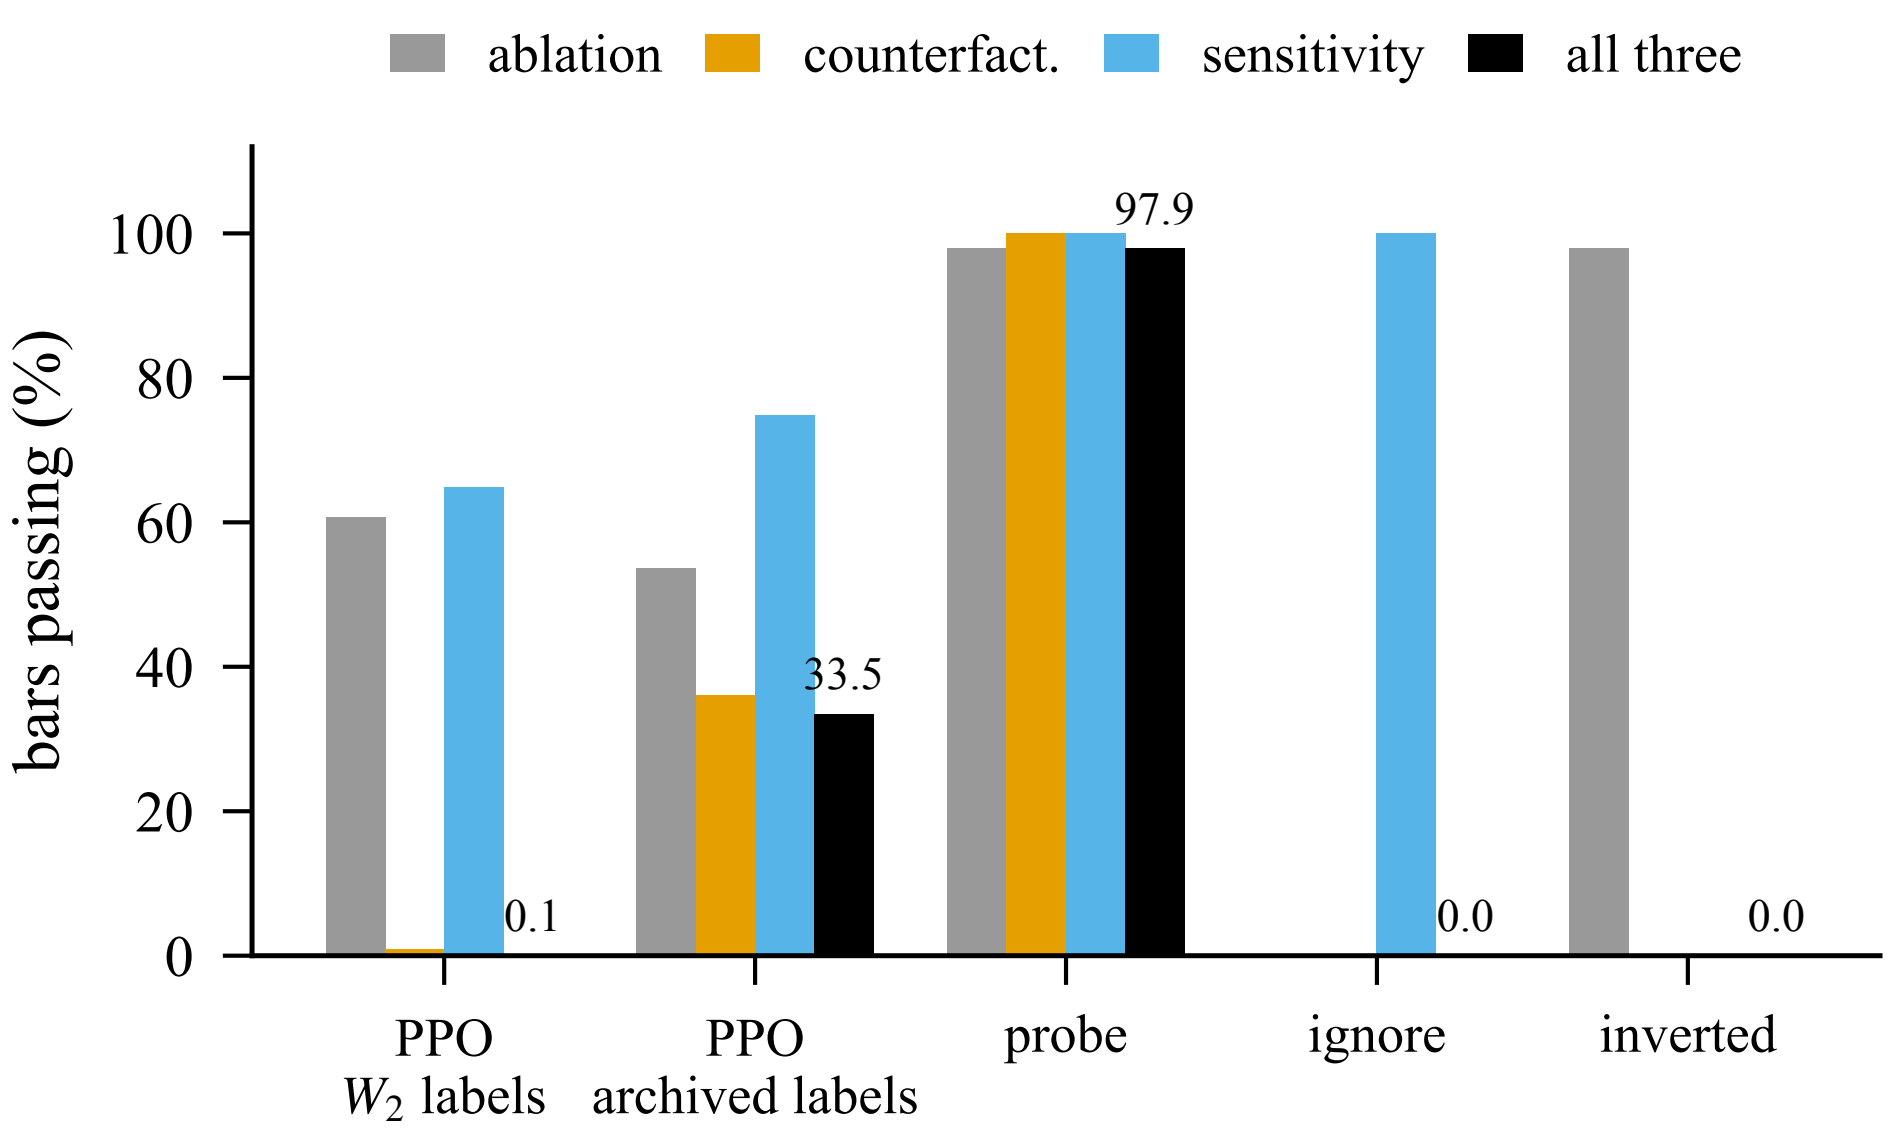
ablation
counterfact.
sensitivity
all three
bars passing (%)
100
80
60
40
20
0
97.9
33.5
0.1
0.0
0.0
PPO
W_2 labels
PPO
archived labels
probe
ignore
inverted