# Customer readiness test
# Lahoun Solar Plant

One-time browser test · 2026-11-12T23:21:06.221161+00:00 UTC
https://main.d3o3iryvy33gj9.amplifyapp.com/portfolio

| 23/23 | 16 | 3 | 4 |
|---|---|---|---|
| Questions attempted | Passed functional checks | Failed checks | Review / blocked |

## Key findings

- Latest rerun: November 12, 2026, 23:21-23:31 UTC (November 13, 10:21-10:31 Sydney). All 23 questions completed: 16 functional/retrieval passes, three failures, four informational/unverified results.
- P1 API/tool failures persist: Q27 July clipping failed on DNS resolution for all six inverters; Q18 technical/contractual availability calculation failed despite other performance values returning.
- P2 context failure persists: Q7 used Inverter 3 at five-minute resolution for November 12 instead of the first plot's three-day hourly Inverter 2 MPPT scope.
- Changed outcomes: Q4 now reports nothing to plot instead of substituting aggregate PR; Q15 requests missing required fields instead of claiming saving is unsupported. Both are review results, not full feature passes.
- Q10 BOM-source attribution remains unverified; Q14 found no November cleaning logs. Missing data is informational unless accompanied by an explicit API/tool failure.
- Three monthly PDFs validated for plant/month: October 2026 (13 pages), December 2025 (12 pages), September 2026 (13 pages). Retrieval does not establish numerical accuracy; December PDF contains an uninvestigated negative historical June energy entry.
- Four customer UI areas and six selected existing job-card details checked. No cleaning record saved, card status changed or team-chat message sent.
- Read-only S3 snapshot at 23:21:36 UTC: api_error=false; last modified 23:01:46 UTC. This upstream update flag does not prove healthy chat analytics or fresh data.
- Compared with the previous run: Q4: failed → review; Q15: failed → review

> API/tool errors are highest priority, followed by failed application responses. Missing data is reported separately. An answer or HTTP 200 alone is not a functional pass. Numerical results have not been independently recomputed. This test did not change daily schedules or run the upstream pipeline.

## Single-plant pipeline snapshot

**Abdali_Mall_Lahoun.json** · api_error: **false**

S3 last modified: 2026-11-12T23:01:46.000Z

Checked: 2026-11-12T23:21:36.358Z

## Question results

| ID | Test question | Result | Finding |
|---|---|---|---|
| Q9 | I have a COMMUNICATION_FAULT what do I do to my inverters? | **PASSED** | Manual troubleshooting guidance, diagram references and manufacturer PDF returned. Retrieval/response pass only; no equipment actions performed and safety instructions not independently certified. |
| Q27 | Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026 | **FAILED** | P1 API/tool failure: July clipping_loss_via_requests explicitly failed for all six inverters and all July chunks because ipv-api.ndtensor.ai could not be resolved. No requested clipping result. |
| Q1 | Please generate last months report | **PASSED** | October 2026 Lahoun PDF downloaded successfully and validated as readable, 13 pages, correct plant/month. Retrieval only; not fresh recomputation or numerical validation. |
| Q12 | Was there any 0 production days in the last 7 days? | **PASSED** | Returned seven nonzero production values for November 6-12, with November 12 coverage disclosed through 23:25 and missing final 30 minutes. Numerical values not independently recomputed. |
| Q16 | Please generate December 2025 performance report | **PASSED** | December 2025 Lahoun PDF retrieved and validated as readable, 12 pages, correct plant/month. Retrieval only: historical table includes a negative June energy entry, not independently investigated or certified as correct. |
| Q17 | How is my data quality for POA and power? How many of them show missing data during daytime or mismatches with satellite prediction? | **PASSED** | Returned November 12 coverage of 282 points through 23:25, zero missing daytime POA/power points, 75 POA mismatches and eight power mismatches, with definitions and incomplete-day disclosure. Data-quality findings are not API failures; calculations not independently recomputed. |
| Q3 | Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2 | **PASSED** | Hourly Inverter 2 MPPT PR chart returned with 12 traces and 72 hourly timestamps per trace for November 10-12. |

| ID | Test question | Result | Finding |
|---|---|---|---|
| Q4 | Please plot last 3 days hourly performance ratio for my Strings for inverter 2 | **REVIEW** | Informational/no data: the string-level PR request returned 'There was nothing to plot' and no chart. Not a successful string-level test, but no explicit API error. Unlike the prior run, no substitute aggregate chart was supplied. |
| Q5 | Please plot the last 4 days hourly performance ratio for all my inverters | **PASSED** | Hourly all-inverter PR chart returned with six traces and 96 timestamps each for the requested four-day window. |
| Q11 | Please figure out how much clipping loss was found in the last 6 months broken by inverters, list them down and plot it as well | **PASSED** | Returned numerical six-month clipping totals for all six inverters and a populated six-trace monthly chart. Functional output pass; does not prove every named tool succeeded or values are independently correct. |
| Q18 | How did my plant perform yesterday? | **FAILED** | P1 tool failure: yesterday's energy (3,834.68 kWh), yield, PR and operational analysis returned, but technical/contractual availability was explicitly unavailable because the calculation tool failed. Partial response, not a full pass. |
| Q20 | Is there shading happening with my plant? Please analyze the pyranometer and check for frequent dips at certain times | **PASSED** | Quantified 30-day pyranometer dip analysis returned recurring morning/afternoon times, frequencies and ratios, with calibration/orientation/obstruction caveats. Physical shading not confirmed on site and calculations not independently recomputed. |
| Q2 | Based on pvsyst report, what is the rated power of this plant and array configuration | **PASSED** | Retrieved two plant-specific PVsyst report sections covering system summary and array characteristics, with source image references. Source-retrieval pass only; rated power/configuration not extracted into prose. |
| Q6 | Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3 | **PASSED** | Inverter 3 current/voltage chart returned eight populated traces at raw five-minute resolution for November 12. |
| Q10 | When was the last time the BOM data showed up | **REVIEW** | Claims latest BOM record at November 12 23:25 but supporting fields are source=0.0 and pyranometer_1=0.0. No verified BOM source mapping or BOM-specific record was exposed; timestamp/source attribution remains unverified. |

| ID | Test question | Result | Finding |
|---|---|---|---|
| Q19 | Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt | **PASSED** | Returned 12-month daily POA median, mean and kurtosis with Wh/m² units, 313 daily totals, missing-day disclosure and latest timestamp November 12 23:25. Numerical integration/statistics not independently recomputed. |
| Q14 | Pull up the latest cleaning log | **REVIEW** | Informational/no records: no November cleaning logs found. This does not establish whether an older latest cleaning log exists. |
| Q15 | Jim cleaned the pyranometer today, can you add it to the cleaning log? | **REVIEW** | Requests required Fault Cause, Action Taken and Status before adding the cleaning log. No values invented, no confirmation submitted and no record saved. Clarification stage only; save capability remains untested. |
| Q8 | How can I shut down my inverters? | **PASSED** | Manufacturer shutdown guidance, diagram references and manual PDF returned. Retrieval/response pass only; no shutdown or other equipment action performed and safety instructions not independently certified. |
| Q13 | Please change to dark mode | **PASSED** | Dark-mode action returned; fresh browser screenshot visibly confirms dark interface. |
| Q21 | Please figure out how much clipping loss was found in the last 2 months broken by inverters, list them down and plot it as well | **PASSED** | Returned six per-inverter two-month clipping totals and populated six-trace daily chart, with November 12 23:25 data cutoff disclosed. Values not independently recomputed. |
| Q7 | Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test) | **FAILED** | P2 conversation-memory failure: first plotting question was Inverter 2 MPPT PR, hourly over three days. Follow-up instead plotted Inverter 3 specific yield and energy at five-minute resolution for November 12, matching the later current/voltage scope rather than the first plot. Two populated traces do not satisfy the original requested scope. |
| Q46 | Can you generate report for moth of september 2026 | **PASSED** | September 2026 Lahoun PDF downloaded and validated as readable, 13 pages, correct plant/month. Retrieval only; no independent numerical validation. |

## Application UI checks

| Area | Result | Finding |
| --- | --- | --- |
| AI_brain_UI | passed | Customer AI Brain feed, diagnostic/time disclosures and heatmap rendered. Legacy fullscreen/layout parity not exhaustively asserted. |
| Maintenance_UI | passed | Task/filter/calendar interface rendered and previous/next controls showed October then November. Site explicitly states once-a-year maintenance; legacy scheduling controls absent by design. |
| Job_cards_UI | passed | Six selected existing open job-card details inspected and captured; these are not the entire board inventory. No create/resolve/reassign actions; viewing may mark cards as read. |
| Teams_UI | passed | Customer Team Chat participants, message history and composer rendered. No message sent; not a Microsoft Teams integration test. |

Customer navigation differs from the legacy daily-test site. Unavailable legacy tabs are not counted as passes.

# Q9 · passed

### I have a COMMUNICATION_FAULT what do I do to my inverters?

Duration: 29.5 seconds · Manual troubleshooting guidance, diagram references and manufacturer PDF returned. Retrieval/response pass only; no equipment actions performed and safety instructions not independently certified.

## Observed answer

Troubleshooting Steps for COMMUNICATION_FAULT (according to manufacturer manual):

Access the user interface to check the communication status and inverter error messages. Visual reference for device monitoring:
If "communication failure" appears frequently, contact Service directly.
If Service instructs you to check internal components, carefully open the inverter cover by following steps shown in this diagram:
If a hardware reset is needed, locate the four toggle switches on the bottom of the device. Reset using the positions indicated here:
Inspect all communication cables and ensure every connection matches those shown in this diagram:

Important: If the problem persists or you are unsure about the checks, contact Service. Do not perform advanced repairs unless authorized.

Manual reference (PDF): https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

STP_110-60_Manual.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Technical details
Answered by Manual Agent
· 13.5s

## Browser evidence

PT


I have a COMMUNICATION FA...

Ask the agents anything about Lahoun Solar Plant.

I have a COMMUNICATION_FAULT what do I do to my inverters?


Troubleshooting Steps for COMMUNICATION_FAULT (according to manufacturer manual):

1. Access the user interface to check the communication status and inverter error messages. Visual reference for device monitoring:

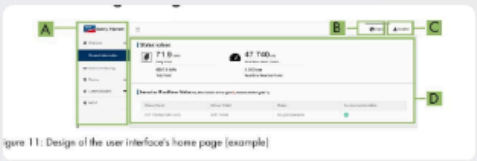



igure 11: Design of the user interface's home page (example)

2. If "communication failure" appears frequently, contact Service directly.
3. If Service instructs you to check internal components, carefully open the inverter cover by following steps shown in this diagram:

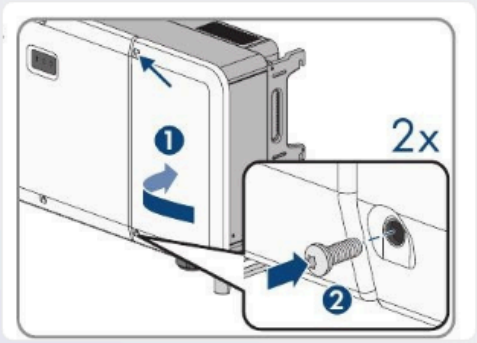


4. If a hardware reset is needed, locate the four toggle switches on the bottom of the device. Reset using the positions indicated here:

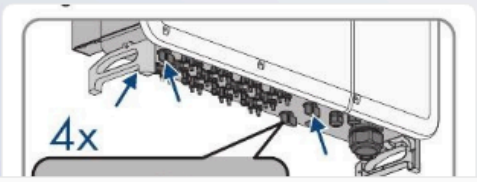


Ask about Lahoun Solar Plant

# Q27 · failed

### Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026

Duration: 20.7 seconds · P1 API/tool failure: July clipping_loss_via_requests explicitly failed for all six inverters and all July chunks because ipv-api.ndtensor.ai could not be resolved. No requested clipping result.

## Observed answer

I used clipping_loss_via_requests for 2026-07-01 to 2026-07-31, but it did not return clipping-loss values because the external analytics API failed for all 6 inverters in every chunk due to a DNS/name-resolution error (ipv-api.ndtensor.ai could not be resolved).

So, I cannot determine from this tool whether there was clipping loss in July 2026.

Result from the requested tool:

Status: Failed
Cause: external API request failure for inverter1 through inverter6 across all July chunks

Because you specifically asked me to use clipping_loss_via_requests, I’m limiting the answer to that tool’s outcome.

How this was worked out
Technical details
Answered by Data Agent
· 8.7s

## Browser evidence

PT

I have a COMMUNICATION FA...



Important: If the problem persists or you are unsure about the checks, contact Service. Do not perform advanced repairs unless authorized.

Manual reference (PDF): https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

**STP_110-60_Manual.pdf**
PDF report

Preview | Open in a new tab

> How this was worked out

> Technical details

Answered by Manual Agent · 13.5s

Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026

I used `clipping_loss_via_requests` for 2026-07-01 to 2026-07-31, but it did not return clipping-loss values because the external analytics API failed for all 6 inverters in every chunk due to a DNS/name-resolution error ( `ipv-api.ndtensor.ai` could not be resolved).

So, I cannot determine from this tool whether there was clipping loss in July 2026.

Result from the requested tool:

- Status: Failed
- Cause: external API request failure for inverter1 through inverter6 across all July chunks

Because you specifically asked me to use `clipping_loss_via_requests`, I'm limiting the answer to that tool's outcome.

> How this was worked out

> Technical details

Answered by Data Agent · 8.7s

Ask about Lahoun Solar Plant

# Q1 · passed

### Please generate last months report


Duration: 15.2 seconds · October 2026 Lahoun PDF downloaded successfully and validated as readable, 13 pages, correct plant/month. Retrieval only; not fresh recomputation or numerical validation.

## Observed answer

I've generated the plant performance report for October 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_October_2026_external_report.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent
· 3.9s

## Browser evidence

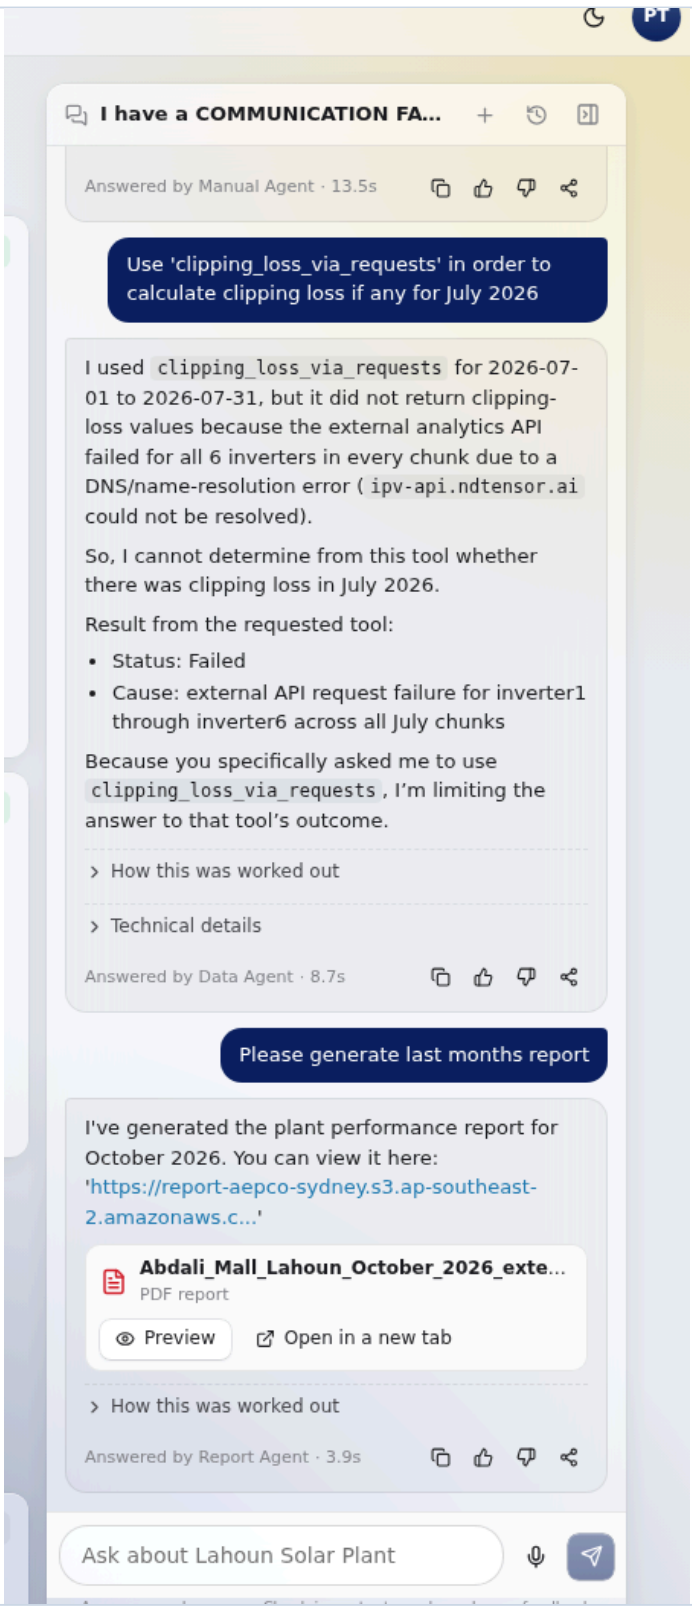
PT
I have a COMMUNICATION FA...
Answered by Manual Agent · 13.5s
Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026
I used clipping_loss_via_requests for 2026-07-01 to 2026-07-31, but it did not return clipping-loss values because the external analytics API failed for all 6 inverters in every chunk due to a DNS/name-resolution error ( ipv-api.ndtensor.ai could not be resolved).
So, I cannot determine from this tool whether there was clipping loss in July 2026.
Result from the requested tool:
Status: Failed
Cause: external API request failure for inverter1 through inverter6 across all July chunks
Because you specifically asked me to use clipping_loss_via_requests , I'm limiting the answer to that tool's outcome.
How this was worked out
Technical details
Answered by Data Agent · 8.7s
Please generate last months report
I've generated the plant performance report for October 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_October_2026_exte...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 3.9s
Ask about Lahoun Solar Plant

# Q12 · passed

### Was there any 0 production days in the last 7 days?

Duration: 22.3 seconds · Returned seven nonzero production values for November 6-12, with November 12 coverage disclosed through 23:25 and missing final 30 minutes. Numerical values not independently recomputed.

## Observed answer

No. There were no zero-production days in the last 7 days.


Daily production:

2026-11-06: 3054.89 kWh
2026-11-07: 2424.63 kWh
2026-11-08: 3207.16 kWh
2026-11-09: 4152.37 kWh
2026-11-10: 4009.04 kWh
2026-11-11: 4002.97 kWh
2026-11-12: 3834.68 kWh

Note: the latest day ends at 2026-11-12 23:25, so the final 30 minutes are missing, but production is clearly not zero.

How this was worked out
Technical details
Answered by Data Agent
· 9.1s

## Browser evidence

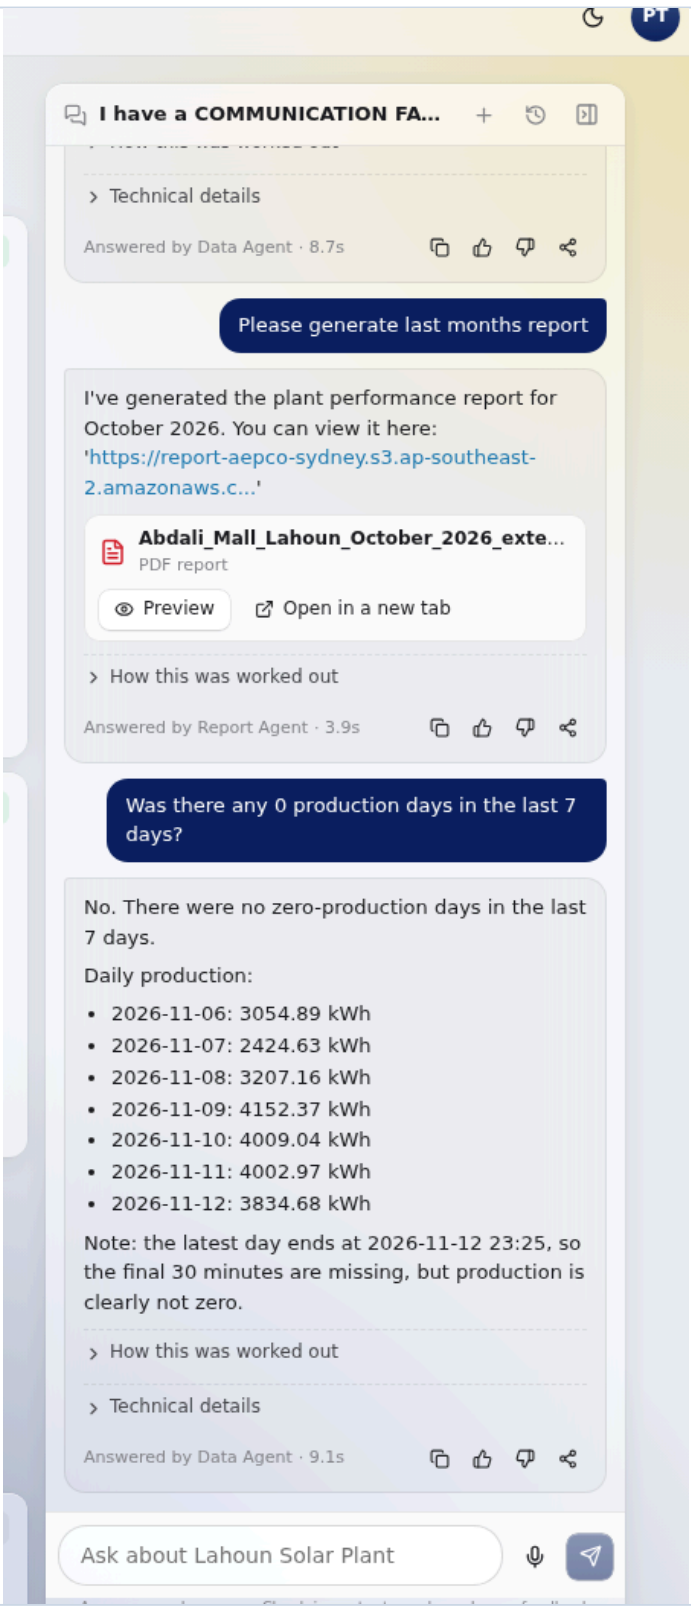
PT
I have a COMMUNICATION FA...
Technical details
Answered by Data Agent · 8.7s
Please generate last months report
I've generated the plant performance report for October 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_October_2026_exte...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 3.9s
Was there any 0 production days in the last 7 days?
No. There were no zero-production days in the last 7 days.
Daily production:
2026-11-06: 3054.89 kWh
2026-11-07: 2424.63 kWh
2026-11-08: 3207.16 kWh
2026-11-09: 4152.37 kWh
2026-11-10: 4009.04 kWh
2026-11-11: 4002.97 kWh
2026-11-12: 3834.68 kWh
Note: the latest day ends at 2026-11-12 23:25, so the final 30 minutes are missing, but production is clearly not zero.
How this was worked out
Technical details
Answered by Data Agent · 9.1s
Ask about Lahoun Solar Plant

# Q16 · passed

### Please generate December 2025 performance report


Duration: 17.2 seconds · December 2025 Lahoun PDF retrieved and validated as readable, 12 pages, correct plant/month. Retrieval only: historical table includes a negative June energy entry, not independently investigated or certified as correct.

## Observed answer

I've generated the plant performance report for December 2025. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_December_2025_external_report.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent
· 4s

## Browser evidence

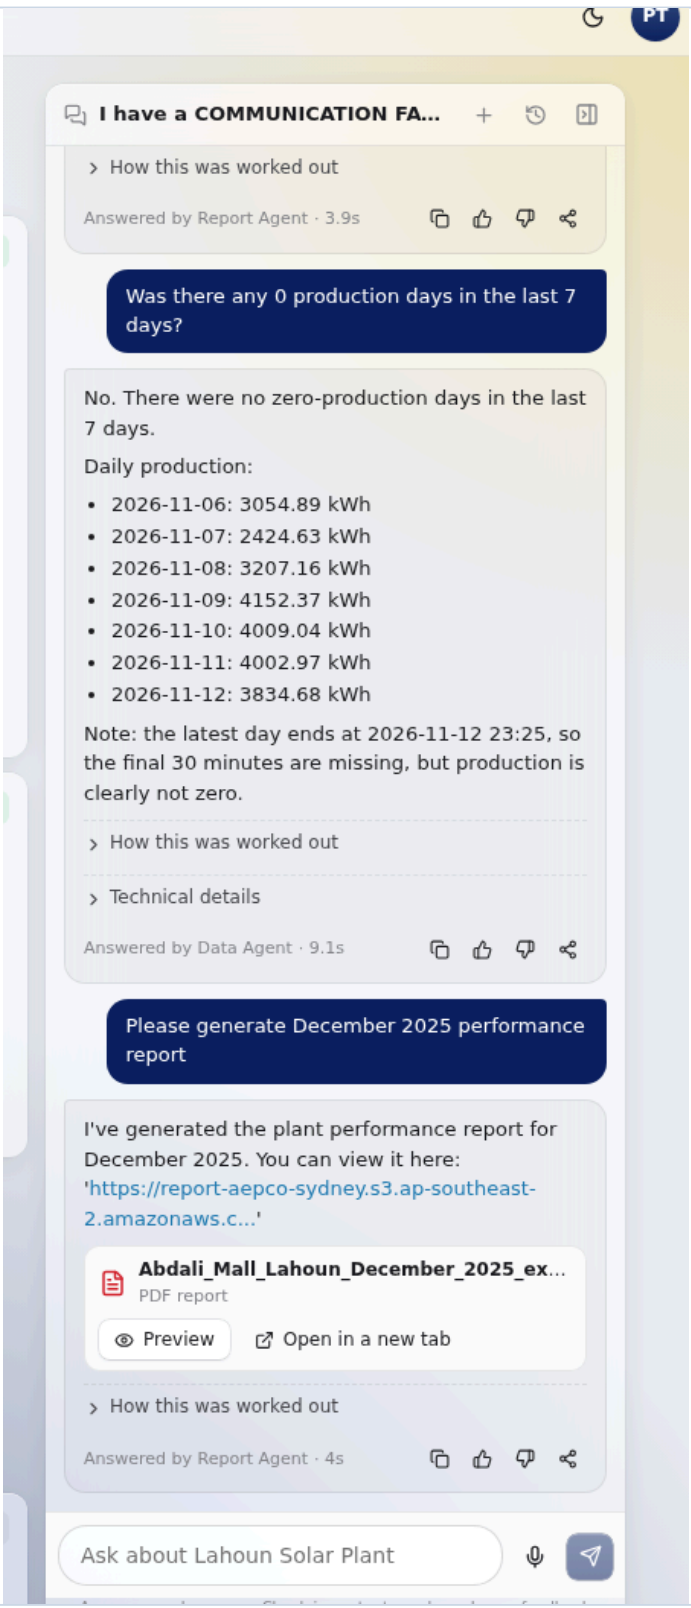
PT
I have a COMMUNICATION FA...
How this was worked out
Answered by Report Agent · 3.9s
Was there any 0 production days in the last 7 days?
No. There were no zero-production days in the last 7 days.
Daily production:
2026-11-06: 3054.89 kWh
2026-11-07: 2424.63 kWh
2026-11-08: 3207.16 kWh
2026-11-09: 4152.37 kWh
2026-11-10: 4009.04 kWh
2026-11-11: 4002.97 kWh
2026-11-12: 3834.68 kWh
Note: the latest day ends at 2026-11-12 23:25, so the final 30 minutes are missing, but production is clearly not zero.
How this was worked out
Technical details
Answered by Data Agent · 9.1s
Please generate December 2025 performance report
I've generated the plant performance report for December 2025. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_December_2025_ex...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 4s
Ask about Lahoun Solar Plant

# Q17 · passed

### How is my data quality for POA and power? How many of them show missing data during daytime or mismatches with satellite prediction?

Duration: 31.9 seconds · Returned November 12 coverage of 282 points through 23:25, zero missing daytime POA/power points, 75 POA mismatches and eight power mismatches, with definitions and incomplete-day disclosure. Data-quality findings are not API failures; calculations not independently recomputed.

## Observed answer

For 2026-11-12, using daytime based on modelled POA >= 50 W/m²:


POA missing during daytime: 0
Power missing during daytime: 0
POA mismatches vs satellite/modelled prediction: 75
Power mismatches vs satellite/modelled prediction: 8

Data analyzed covered 2026-11-12 00:00 to 23:25 with 282 points.

Notes:

POA mismatch was counted where |pyranometer_1 - modelled_poa_1| / modelled_poa_1 > 25% during daytime.
Power mismatch was counted where either:
modelled POA >= 200 W/m² and plant active_power <= 50 W, or
modelled POA < 50 W/m² and plant active_power > 1000 W.
The day is slightly incomplete: data ends at 23:25, not 23:55.
How this was worked out
Technical details
Answered by Data Agent
· 16.6s

## Browser evidence

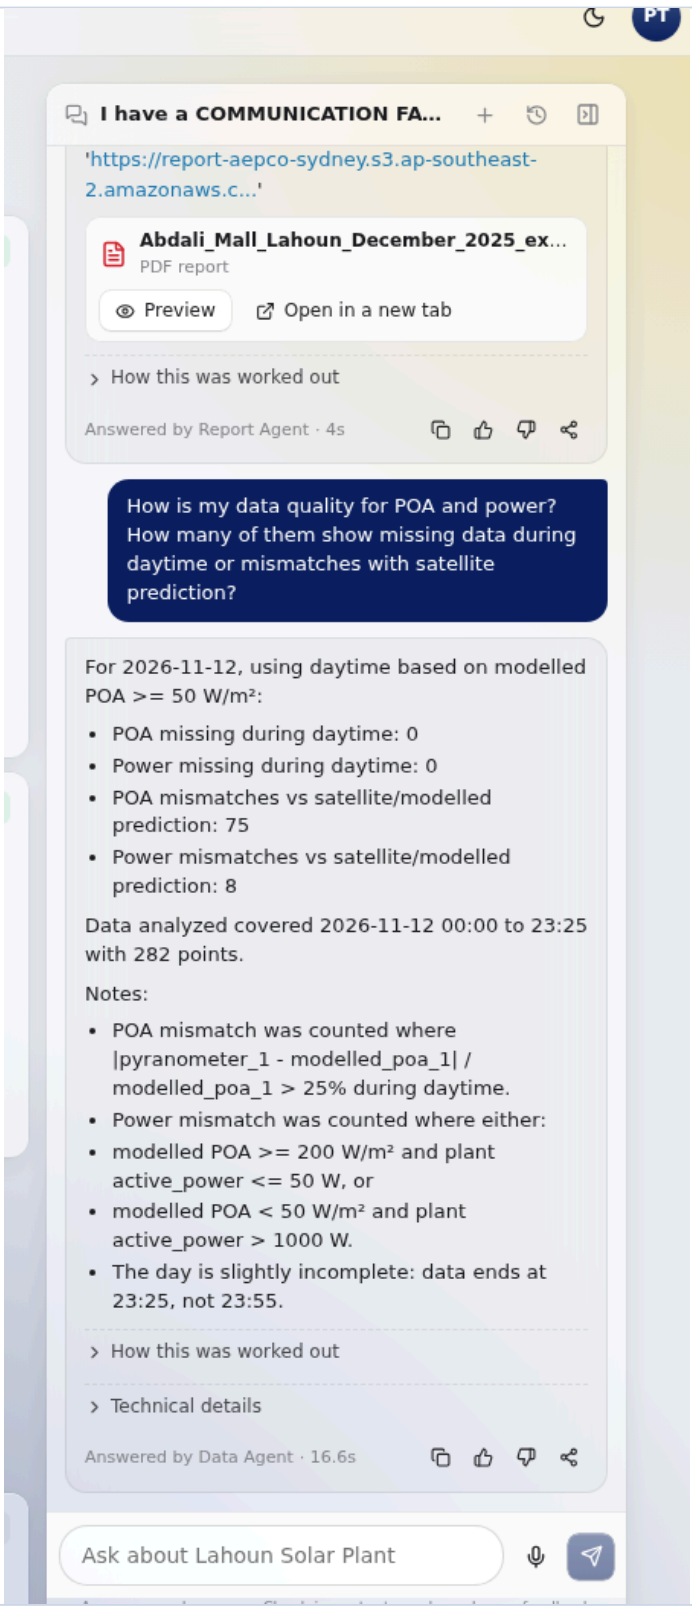
PT
I have a COMMUNICATION FA...
'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_December_2025_ex...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 4s
How is my data quality for POA and power? How many of them show missing data during daytime or mismatches with satellite prediction?
For 2026-11-12, using daytime based on modelled POA >= 50 W/m²:
POA missing during daytime: 0
Power missing during daytime: 0
POA mismatches vs satellite/modelled prediction: 75
Power mismatches vs satellite/modelled prediction: 8
Data analyzed covered 2026-11-12 00:00 to 23:25 with 282 points.
Notes:
POA mismatch was counted where |pyranometer_1 - modelled_poa_1| / modelled_poa_1 > 25% during daytime.
Power mismatch was counted where either:
modelled POA >= 200 W/m² and plant active_power <= 50 W, or
modelled POA < 50 W/m² and plant active_power > 1000 W.
The day is slightly incomplete: data ends at 23:25, not 23:55.
How this was worked out
Technical details
Answered by Data Agent · 16.6s
Ask about Lahoun Solar Plant

# Q3 · passed

### Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2

Duration: 29.6 seconds · Hourly Inverter 2 MPPT PR chart returned with 12 traces and 72 hourly timestamps per trace for November 10-12.

## Observed answer

I've created the visualization for you.

Hourly Performance Ratio for Inverter 2 MPPTs - Last 3 Days
Pin
How this was worked out
Answered by Graph Agent
· 15s

## Browser evidence

PT

I have a COMMUNICATION FA...

with 282 points.

Notes:

- POA mismatch was counted where |pyranometer_1 - modelled_poa_1| / modelled_poa_1 > 25% during daytime.
- Power mismatch was counted where either:
- modelled POA >= 200 W/m² and plant active_power <= 50 W, or
- modelled POA < 50 W/m² and plant active_power > 1000 W.
- The day is slightly incomplete: data ends at 23:25, not 23:55.

> How this was worked out


> Technical details

Answered by Data Agent · 16.6s

Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2

I've created the visualization for you.

**Hourly Performance Ratio for I...** Pin

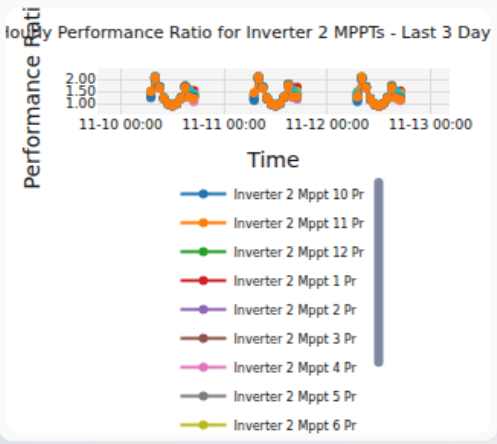


> How this was worked out

Answered by Graph Agent · 15s

Ask about Lahoun Solar Plant

# Q4 · review

### Please plot last 3 days hourly performance ratio for my Strings for inverter 2

Duration: 15.7 seconds · Informational/no data: the string-level PR request returned 'There was nothing to plot' and no chart. Not a successful string-level test, but no explicit API error. Unlike the prior run, no substitute aggregate chart was supplied.

## Observed answer

I've created the visualization for you.

There was nothing to plot for this question. Try another date range or measure.

How this was worked out
Answered by Graph Agent
· 5.3s

## Browser evidence

I have a COMMUNICATION FA...

23:25, not 23:55.

> How this was worked out


> Technical details

Answered by Data Agent · 16.6s

Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2

I've created the visualization for you.

**Hourly Performance Ratio for I...** Pin

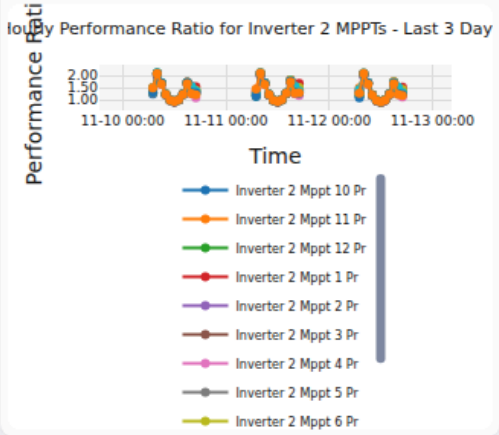


> How this was worked out

Answered by Graph Agent · 15s

Please plot last 3 days hourly performance ratio for my Strings for inverter 2

I've created the visualization for you.

There was nothing to plot for this question. Try another date range or measure.

> How this was worked out

Answered by Graph Agent · 5.3s

Ask about Lahoun Solar Plant

# Q5 · passed

### Please plot the last 4 days hourly performance ratio for all my inverters

Duration: 23.3 seconds · Hourly all-inverter PR chart returned with six traces and 96 timestamps each for the requested four-day window.

## Observed answer

I've created the visualization for you.

Hourly Performance Ratio for All Inverters (Last 4 Days)
Pin
How this was worked out
Answered by Graph Agent
· 12.9s

## Browser evidence

I have a COMMUNICATION FA...

Inverter 2 Mppt 4 Pr
Inverter 2 Mppt 5 Pr
Inverter 2 Mppt 6 Pr

› How this was worked out

Answered by Graph Agent · 15s

Please plot last 3 days hourly performance ratio for my Strings for inverter 2

I've created the visualization for you.

There was nothing to plot for this question. Try another date range or measure.


› How this was worked out

Answered by Graph Agent · 5.3s

Please plot the last 4 days hourly performance ratio for all my inverters

I've created the visualization for you.

**Hourly Performance Ratio for A...** Pin

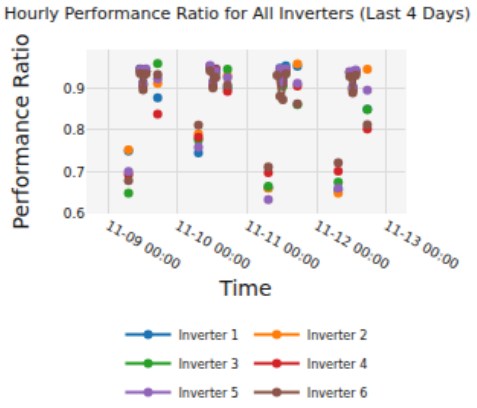


› How this was worked out

Answered by Graph Agent · 12.9s

Ask about Lahoun Solar Plant

# Q11 · passed

### Please figure out how much clipping loss was found in the last 6 months broken by inverters, list them down and plot it as well

Duration: 36.9 seconds · Returned numerical six-month clipping totals for all six inverters and a populated six-trace monthly chart. Functional output pass; does not prove every named tool succeeded or values are independently correct.

## Observed answer

Clipping loss by inverter — last 6 months
Inverter 1: 30,271.43 kWh
Inverter 2: 17,538.32 kWh
Inverter 3: 28,916.66 kWh
Inverter 4: 20,862.85 kWh
Inverter 5: 17,972.58 kWh
Inverter 6: 11,467.66 kWh

Data status: Good.

The chart showing monthly clipping loss by inverter has been prepared.

Monthly Clipping Loss by Inverter (Last 6 Months)
Pin
How this was worked out
Technical details
Answered by Data Agent, Graph Agent
· 27.1s

## Browser evidence

PT

I have a COMMUNICATION FA...

› How this was worked out

Answered by Graph Agent · 12.9s

Please figure out how much clipping loss was found in the last 6 months broken by inverters, list them down and plot it as well


**Clipping loss by inverter — last 6 months**

- Inverter 1: **30,271.43 kWh**
- Inverter 2: **17,538.32 kWh**
- Inverter 3: **28,916.66 kWh**
- Inverter 4: **20,862.85 kWh**
- Inverter 5: **17,972.58 kWh**
- Inverter 6: **11,467.66 kWh**

Data status: **Good**.

The chart showing monthly clipping loss by inverter has been prepared.

**Monthly Clipping Loss by Invert...** Pin

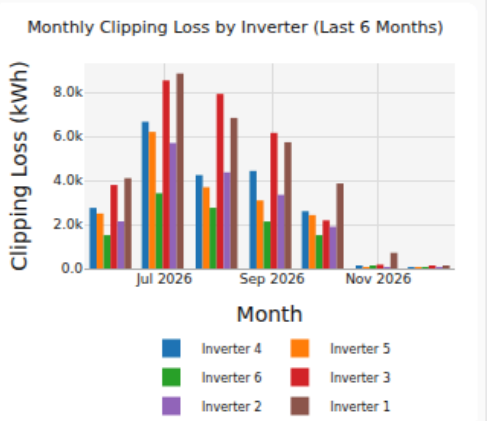


› How this was worked out

› Technical details

Answered by Data Agent, Graph Agent · 27.1s

Ask about Lahoun Solar Plant

# Q18 · failed

### How did my plant perform yesterday?

Duration: 24.8 seconds · P1 tool failure: yesterday's energy (3,834.68 kWh), yield, PR and operational analysis returned, but technical/contractual availability was explicitly unavailable because the calculation tool failed. Partial response, not a full pass.

## Observed answer

Yesterday (2026-11-12), your plant delivered 3,834.68 kWh.

Summary of measured performance:

Total energy: 3,834.68 kWh
Specific yield: 4.879 kWh/kWp
Performance ratio (PR): 0.916

Operational picture:

Production started around 06:00 and tapered off by about 18:00.
Peak hourly average plant power was around 496.7 kW at 09:00.
Irradiance peaked around 625.8 W/m² at 12:00.
Output tracked irradiance well through the day, which is consistent with the strong PR.

Data note:

The dataset for yesterday ends at 23:25 rather than 23:55. Since this is after sunset, it should not materially affect the day’s performance summary.
I could not report technical/contractual availability because that calculation tool failed on this request.
How this was worked out
Technical details
Answered by Data Agent
· 13.7s

## Browser evidence

PT

I have a COMMUNICATION FA...




› How this was worked out

› Technical details

Answered by Data Agent, Graph Agent · 27.1s

How did my plant perform yesterday?

Yesterday (2026-11-12), your plant delivered 3,834.68 kWh.

Summary of measured performance:

- Total energy: 3,834.68 kWh
- Specific yield: 4.879 kWh/kWp
- Performance ratio (PR): 0.916

Operational picture:

- Production started around 06:00 and tapered off by about 18:00.
- Peak hourly average plant power was around 496.7 kW at 09:00.
- Irradiance peaked around 625.8 W/m² at 12:00.
- Output tracked irradiance well through the day, which is consistent with the strong PR.

Data note:

- The dataset for yesterday ends at 23:25 rather than 23:55. Since this is after sunset, it should not materially affect the day's performance summary.
- I could not report technical/contractual availability because that calculation tool failed on this request.

› How this was worked out

› Technical details

Answered by Data Agent · 13.7s

Ask about Lahoun Solar Plant

# Q20 · passed

### Is there shading happening with my plant? Please analyze the pyranometer and check for frequent dips at certain times

Duration: 33.9 seconds · Quantified 30-day pyranometer dip analysis returned recurring morning/afternoon times, frequencies and ratios, with calibration/orientation/obstruction caveats. Physical shading not confirmed on site and calculations not independently recomputed.

## Observed answer

I checked the last 30 days of measured pyranometer data against modelled POA and looked for repeated depressions at the same clock times.

Findings:

There is a strong recurring dip pattern.
The most affected times are in two clusters:
Morning: 07:40, 07:45, 07:50, 07:55, 08:00, 08:05, 08:10
Afternoon: 16:25, 16:30, 16:35, 16:40, 16:55
These dips are frequent, appearing on roughly 25–29 days in the analysis window at each listed time.
At those times, the normalized measured/modelled POA ratio is only about 0.32–0.36, versus an overall daytime median normalized ratio of 0.675.
The affected periods occur under meaningful irradiance conditions too, with median modelled POA around 300–570 W/m², so this is not just low-light noise.

Assessment:

Yes, the pattern is consistent with shading or a repeatable sensor obstruction.
The symmetry of morning and late-afternoon dip windows is especially suggestive of horizon/nearby-object shading on the pyranometer, rather than random weather.
Because the recurring issue is seen in the irradiance sensor comparison itself, this points more toward pyranometer shading/obstruction than plant-wide irradiance variability.

Caveat:

The measured pyranometer also seems systematically lower than modelled POA overall, so there may be an additional calibration, tilt/orientation mismatch, or persistent obstruction issue beyond the recurring dip windows.

Data note:


Available data in the requested window ends at 2026-11-12 23:25.

Called tools: extract_timeseries_data_ag, execute_custom_code

How this was worked out
Technical details

Answered by Data Agent
· 24.1s

## Browser evidence

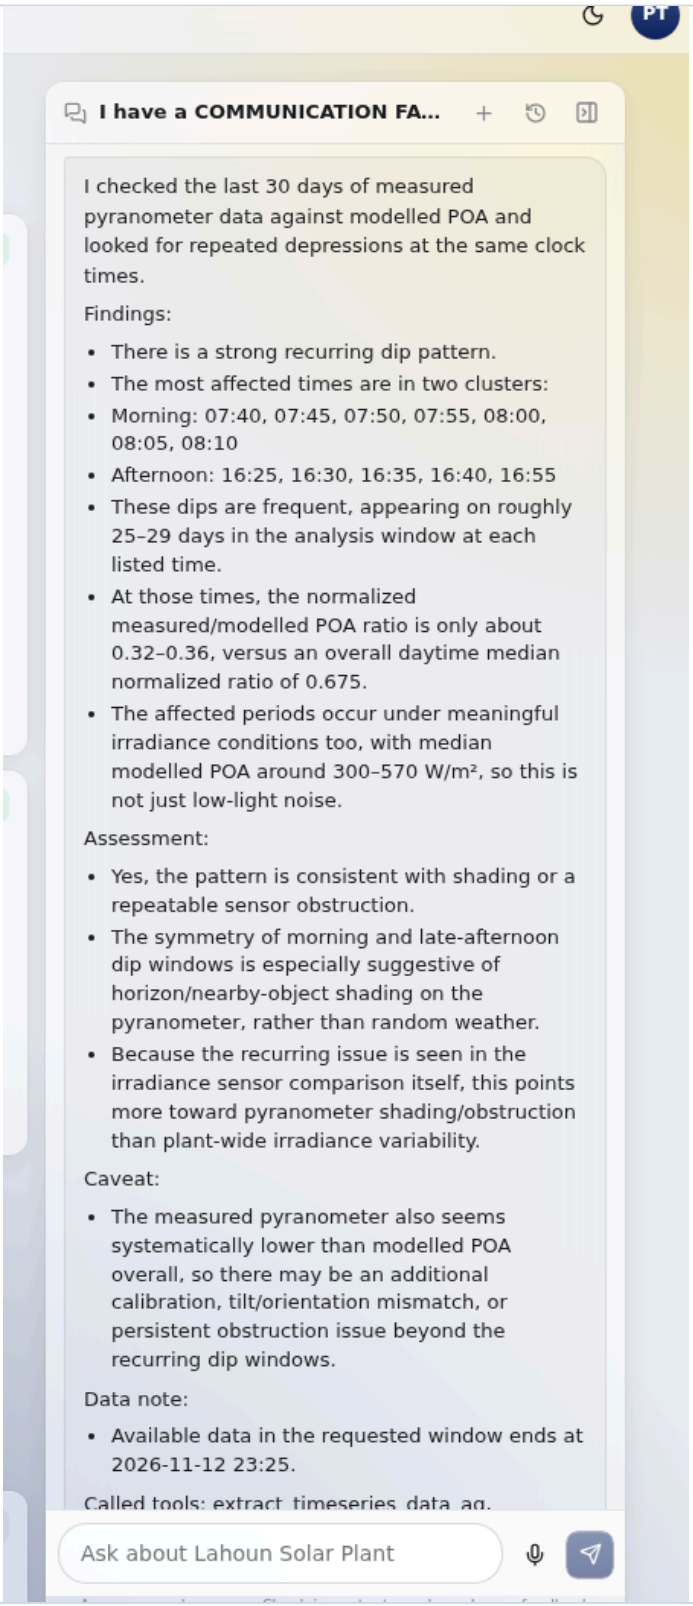

# Q2 · passed

### Based on pvsyst report, what is the rated power of this plant and array configuration

Duration: 18.7 seconds · Retrieved two plant-specific PVsyst report sections covering system summary and array characteristics, with source image references. Source-retrieval pass only; rated power/configuration not extracted into prose.

## Observed answer

Found relevant PVsyst report sections:

[Abdali_Mall_Lahoun] System Summary (Page 2, Table 2)
[Abdali_Mall_Lahoun] PV Array Characteristics, including Array #1 and Array #2 configurations (Page 3, Table 2)

Please access the URLs to view the report sections.

How this was worked out
Technical details
Answered by PVsyst Agent
· 8.7s

## Browser evidence

PT

I have a COMMUNICATION FA...

dip windows is especially suggestive of horizon/nearby-object shading on the pyranometer, rather than random weather.

- Because the recurring issue is seen in the irradiance sensor comparison itself, this points more toward pyranometer shading/obstruction than plant-wide irradiance variability.

Caveat:

- The measured pyranometer also seems systematically lower than modelled POA overall, so there may be an additional calibration, tilt/orientation mismatch, or persistent obstruction issue beyond the recurring dip windows.

Data note:

- Available data in the requested window ends at 2026-11-12 23:25.

Called tools: extract_timeseries_data_ag, execute_custom_code

› How this was worked out

› Technical details

Answered by Data Agent · 24.1s


Based on pvsyst report, what is the rated power of this plant and array configuration

Found relevant PVsyst report sections:

1. [Abdali_Mall_Lahoun] System Summary (Page 2, Table 2)
2. [Abdali_Mall_Lahoun] PV Array Characteristics, including Array #1 and Array #2 configurations (Page 3, Table 2)

Please access the URLs to view the report sections.





› How this was worked out

Ask about Lahoun Solar Plant

# Q6 · passed

### Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3

Duration: 24.8 seconds · Inverter 3 current/voltage chart returned eight populated traces at raw five-minute resolution for November 12.

## Observed answer

I've created the visualization for you.

Inverter 3 Current and Voltage at Raw 5-Min Resolution
Pin
How this was worked out
Answered by Graph Agent
· 14.6s

## Browser evidence


I have a COMMUNICATION FA...

2, Table 2)

2. [Abdali_Mall_Lahoun] PV Array Characteristics, including Array #1 and Array #2 configurations (Page 3, Table 2)

Please access the URLs to view the report sections.





› How this was worked out


› Technical details

Answered by PVsyst Agent · 8.7s

Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3

I've created the visualization for you.

**Inverter 3 Current and Voltage ...** Pin

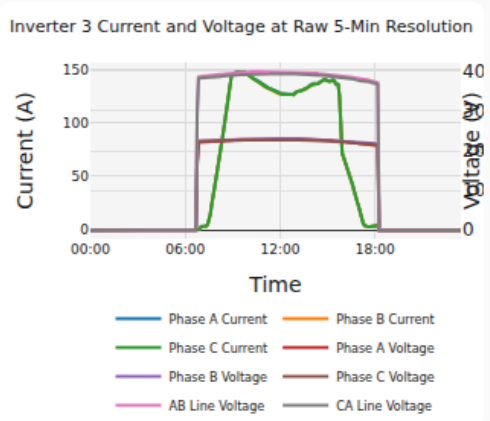


› How this was worked out

Answered by Graph Agent · 14.6s

Ask about Lahoun Solar Plant

# Q10 · review

### When was the last time the BOM data showed up

Duration: 21.8 seconds · Claims latest BOM record at November 12 23:25 but supporting fields are source=0.0 and pyranometer_1=0.0. No verified BOM source mapping or BOM-specific record was exposed; timestamp/source attribution remains unverified.

## Observed answer

The latest available BOM data record is at 2026-11-12 23:25:00.

I checked the latest available timestamp in the BOM-related data and the extracted data ends at 2026-11-12 23:25:00. The last row at that timestamp has source = 0.0 and pyranometer_1 = 0.0.

How this was worked out
Technical details
Answered by Data Agent
· 10.6s


## Browser evidence

I have a COMMUNICATION FA...

Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3

I've created the visualization for you.

**Inverter 3 Current and Voltage ...** Pin

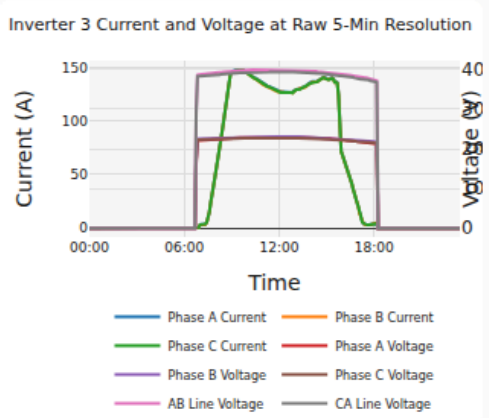


› How this was worked out

Answered by Graph Agent · 14.6s

When was the last time the BOM data showed up

The latest available BOM data record is at 2026-11-12 23:25:00.

I checked the latest available timestamp in the BOM-related data and the extracted data ends at 2026-11-12 23:25:00. The last row at that timestamp has source = 0.0 and pyranometer_1 = 0.0.

› How this was worked out

› Technical details

Answered by Data Agent · 10.6s

Ask about Lahoun Solar Plant

# Q19 · passed

### Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt

Duration: 23.4 seconds · Returned 12-month daily POA median, mean and kurtosis with Wh/m² units, 313 daily totals, missing-day disclosure and latest timestamp November 12 23:25. Numerical integration/statistics not independently recomputed.

## Observed answer

Using pyranometer_1 over the last 12 months (2025-11-13 to 2026-11-12 available data), I summed the 5-minute POA irradiance values into daily POA totals in Wh/m².


Results for the daily totals:

Median: 5665.492 Wh/m²
Mean: 5683.845 Wh/m²
Kurtosis: -0.286
Number of daily totals used: 313

Note: the extracted dataset does not extend through 2026-11-13; the latest available timestamp is 2026-11-12 23:25:00. Also, only 313 daily totals were present in the returned data, so there are gaps/missing days within the 12-month window.

How this was worked out
Technical details
Answered by Data Agent
· 13.2s

## Browser evidence

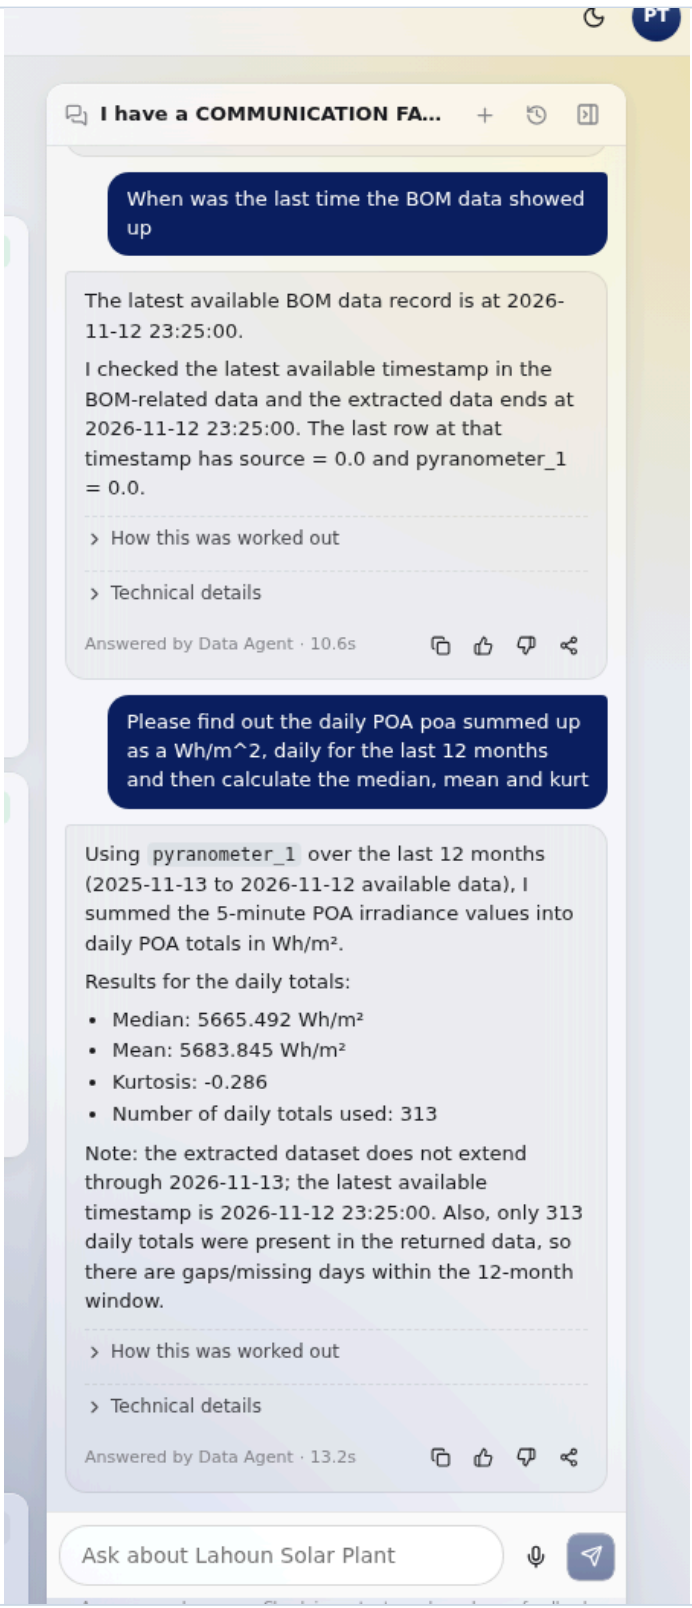
PT
I have a COMMUNICATION FA...
When was the last time the BOM data showed up
The latest available BOM data record is at 2026-11-12 23:25:00.
I checked the latest available timestamp in the BOM-related data and the extracted data ends at 2026-11-12 23:25:00. The last row at that timestamp has source = 0.0 and pyranometer_1 = 0.0.
How this was worked out
Technical details
Answered by Data Agent · 10.6s
Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt
Using pyranometer_1 over the last 12 months (2025-11-13 to 2026-11-12 available data), I summed the 5-minute POA irradiance values into daily POA totals in Wh/m².
Results for the daily totals:
Median: 5665.492 Wh/m²
Mean: 5683.845 Wh/m²
Kurtosis: -0.286
Number of daily totals used: 313
Note: the extracted dataset does not extend through 2026-11-13; the latest available timestamp is 2026-11-12 23:25:00. Also, only 313 daily totals were present in the returned data, so there are gaps/missing days within the 12-month window.
How this was worked out
Technical details
Answered by Data Agent · 13.2s
Ask about Lahoun Solar Plant

# Q14 · review

### Pull up the latest cleaning log


Duration: 15.8 seconds · Informational/no records: no November cleaning logs found. This does not establish whether an older latest cleaning log exists.

## Observed answer

There are no cleaning activity logs for Abdali_Mall_Lahoun in November 2026.

Technical details
Answered by Data Entry Agent
· 5.8s

## Browser evidence

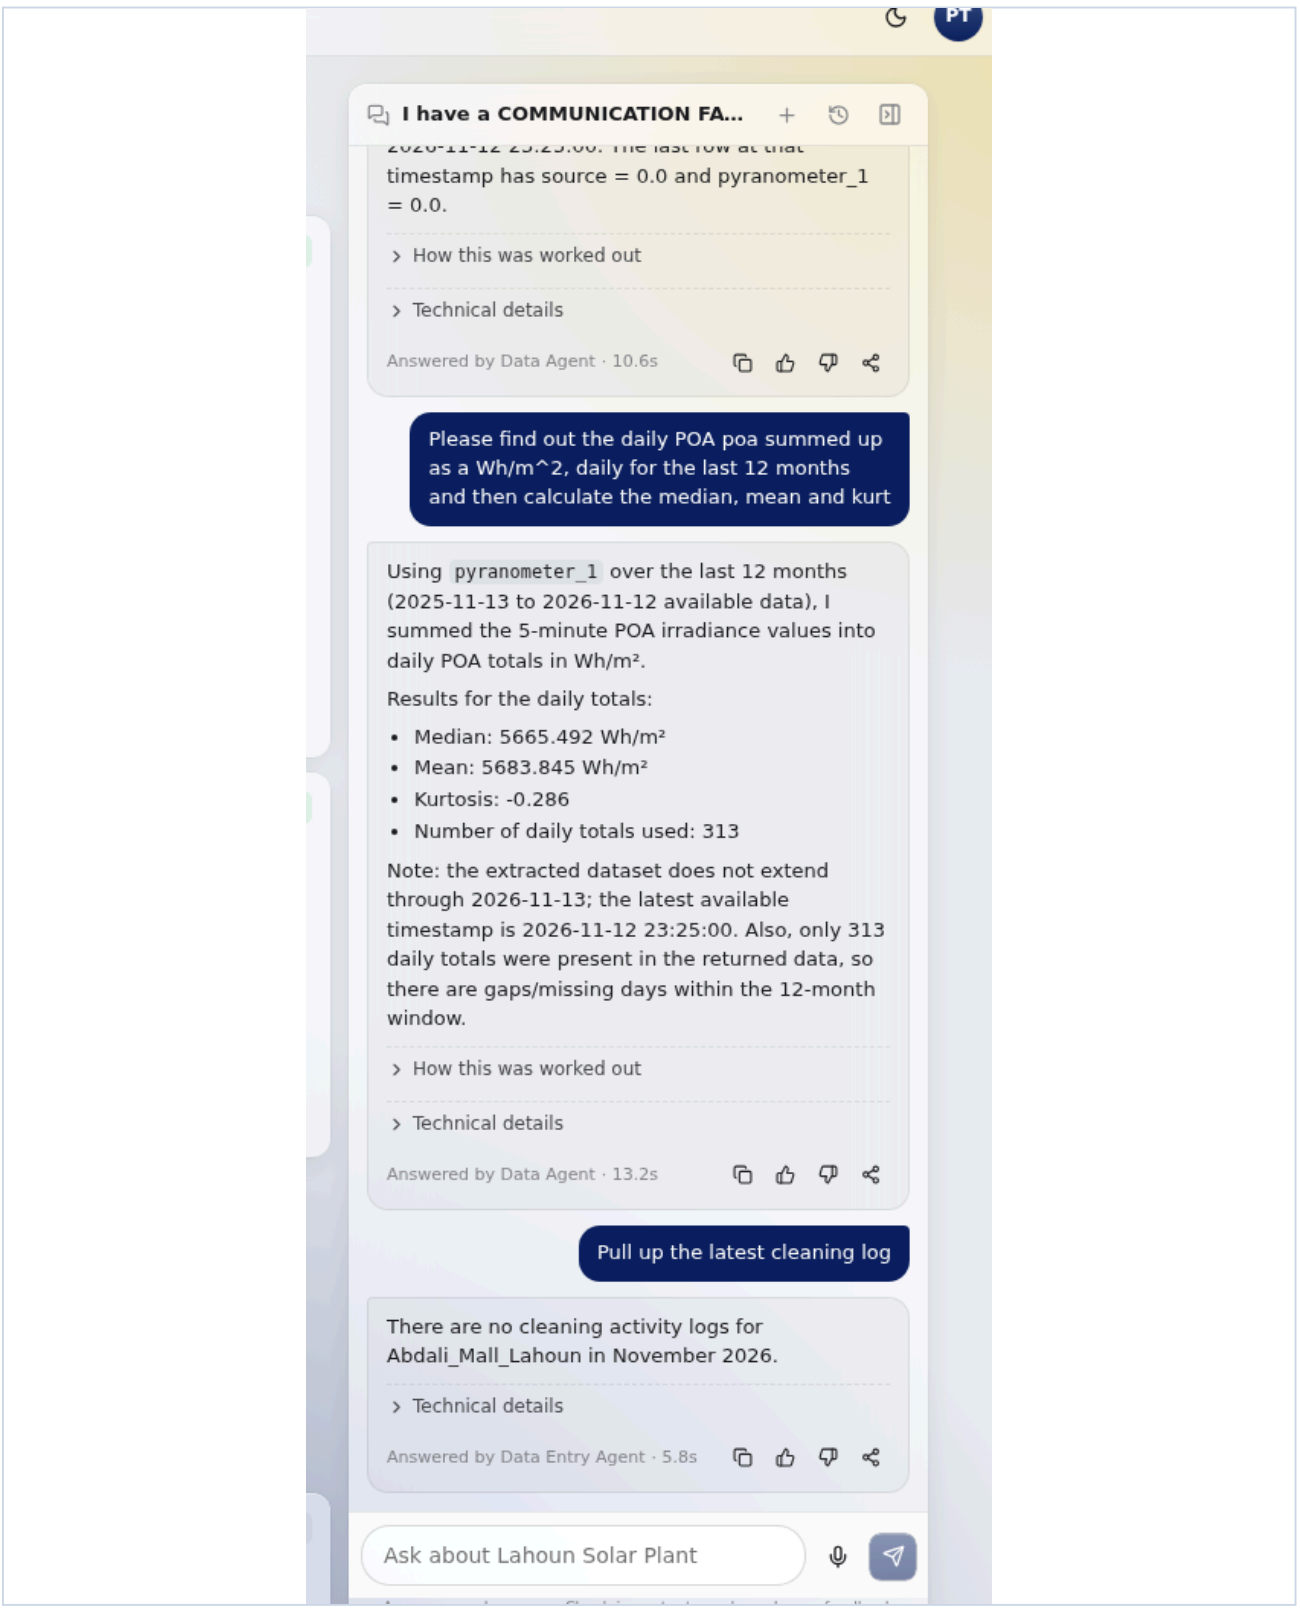
PT
I have a COMMUNICATION FA...
timestamp has source = 0.0 and pyranometer_1 = 0.0.
How this was worked out
Technical details
Answered by Data Agent · 10.6s
Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt
Using pyranometer_1 over the last 12 months (2025-11-13 to 2026-11-12 available data), I summed the 5-minute POA irradiance values into daily POA totals in Wh/m².
Results for the daily totals:
Median: 5665.492 Wh/m²
Mean: 5683.845 Wh/m²
Kurtosis: -0.286
Number of daily totals used: 313
Note: the extracted dataset does not extend through 2026-11-13; the latest available timestamp is 2026-11-12 23:25:00. Also, only 313 daily totals were present in the returned data, so there are gaps/missing days within the 12-month window.
How this was worked out
Technical details
Answered by Data Agent · 13.2s
Pull up the latest cleaning log
There are no cleaning activity logs for Abdali_Mall_Lahoun in November 2026.
Technical details
Answered by Data Entry Agent · 5.8s
Ask about Lahoun Solar Plant

# Q15 · review

### Jim cleaned the pyranometer today, can you add it to the cleaning log?

Duration: 14.3 seconds · Requests required Fault Cause, Action Taken and Status before adding the cleaning log. No values invented, no confirmation submitted and no record saved. Clarification stage only; save capability remains untested.

## Observed answer

To add a cleaning log entry, please provide the following required details:


Fault Cause
Action Taken
Status

Site will be set automatically from the connected plant.

Optional fields you can also provide, but they are not required:

Activity Type (Inspection, Cleaning, HSE Incident, Spare Parts Usage, General Site Activity)
Priority
Responsibility
Estimated Duration
Start Work Time
End Work Time
Spare Part Use
Number Of Staff
Images
Notes
Technical details
Answered by Data Entry Agent
· 4.3s

## Browser evidence

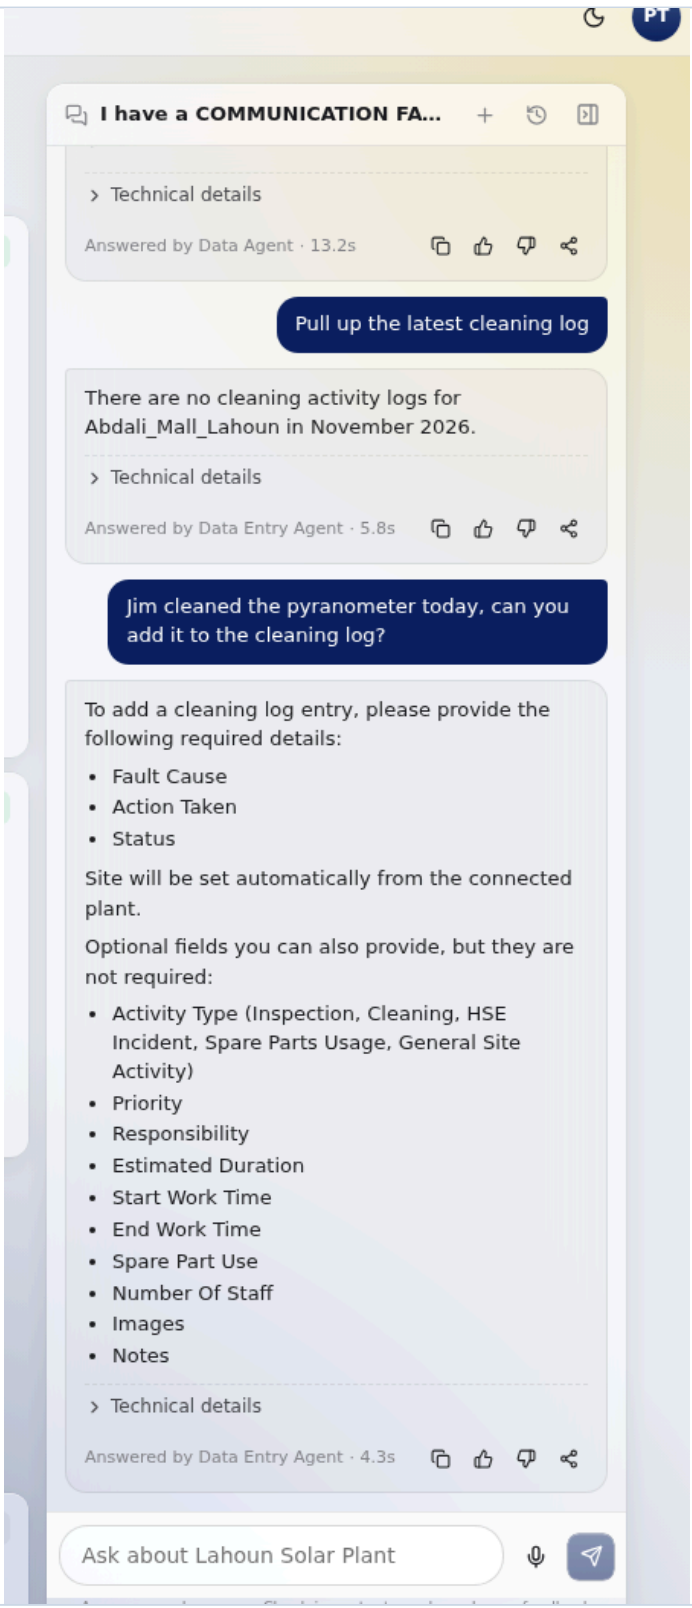
PT
I have a COMMUNICATION FA...
Technical details
Answered by Data Agent · 13.2s
Pull up the latest cleaning log
There are no cleaning activity logs for Abdali_Mall_Lahoun in November 2026.
Technical details
Answered by Data Entry Agent · 5.8s
Jim cleaned the pyranometer today, can you add it to the cleaning log?
To add a cleaning log entry, please provide the following required details:
Fault Cause
Action Taken
Status
Site will be set automatically from the connected plant.
Optional fields you can also provide, but they are not required:
Activity Type (Inspection, Cleaning, HSE Incident, Spare Parts Usage, General Site Activity)
Priority
Responsibility
Estimated Duration
Start Work Time
End Work Time
Spare Part Use
Number Of Staff
Images
Notes
Technical details
Answered by Data Entry Agent · 4.3s
Ask about Lahoun Solar Plant

# Q8 · passed

### How can I shut down my inverters?

Duration: 23.4 seconds · Manufacturer shutdown guidance, diagram references and manual PDF returned. Retrieval/response pass only; no shutdown or other equipment action performed and safety instructions not independently certified.

## Observed answer

To safely shut down your STP 110-60 inverters, please follow the manufacturer's step-by-step shutdown procedure below. This ensures the device is fully disconnected from all voltage sources, preventing electric shock or damage.

Shutdown Procedure:

Disconnect the AC miniature circuit breaker and secure it against reconnection. You can see the location of the AC connection and the ON/OFF toggle in this diagram:
Switch off all 4 DC load-break switches of the inverter and secure them against reconnection. The key positions for these switches are highlighted in the same diagram:
Wait until all LEDs on the inverter are off, confirming the inverter is no longer powered.
Use a current clamp to confirm no current remains in the DC cables. Safe handling of connectors is visually referenced here:
Note the DC connector position on the inverter (see above diagram) and verify all connections are fully disengaged:

Important: Only use measuring devices with a DC input voltage range of 1100 V or above. Always follow the steps in this order for complete safety.

Manual reference (PDF): https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

STP_110-60_Manual.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Technical details
Answered by Manual Agent
· 13.5s

## Browser evidence

PT

I have a COMMUNICATION FA...


Answered by Data Entry Agent · 4.3s

How can I shut down my inverters?


To safely shut down your STP 110-60 inverters, please follow the manufacturer's step-by-step shutdown procedure below. This ensures the device is fully disconnected from all voltage sources, preventing electric shock or damage.

Shutdown Procedure:

1. Disconnect the AC miniature circuit breaker and secure it against reconnection. You can see the location of the AC connection and the ON/OFF toggle in this diagram:

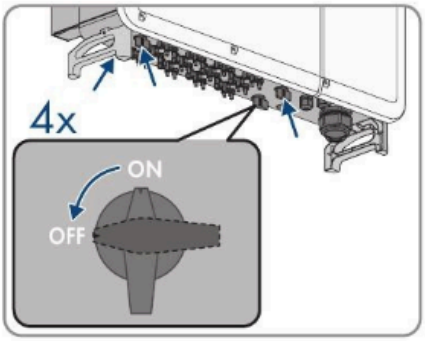


2. Switch off all 4 DC load-break switches of the inverter and secure them against reconnection. The key positions for these switches are highlighted in the same diagram:

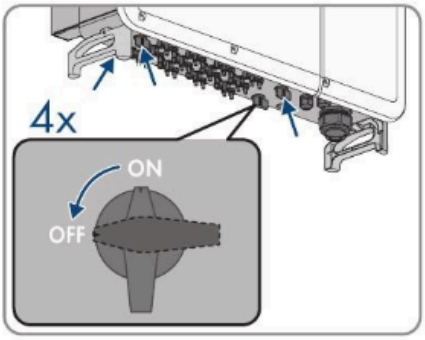


3. Wait until all LEDs on the inverter are off, confirming the inverter is no longer powered.

Ask about Lahoun Solar Plant

# Q13 · passed

### Please change to dark mode

Duration: 12.7 seconds · Dark-mode action returned; fresh browser screenshot visibly confirms dark interface.

## Observed answer


Sure, I will turn on dark mode

Answered by UI Agent
· 2.2s


## Browser evidence

PT

I have a COMMUNICATION FA...

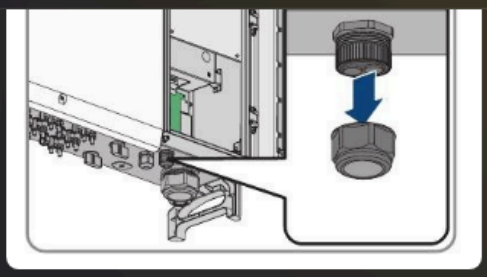

5. Note the DC connector position on the inverter (see above diagram) and verify all connections are fully disengaged:

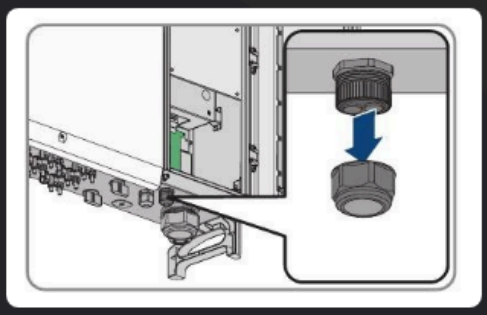

Important: Only use measuring devices with a DC input voltage range of 1100 V or above. Always follow the steps in this order for complete safety.

Manual reference (PDF): https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

**STP_110-60_Manual.pdf**
PDF report

Preview | Open in a new tab

› How this was worked out

› Technical details

Answered by Manual Agent · 13.5s

Please change to dark mode

Sure, I will turn on dark mode

Answered by UI Agent · 2.2s

Ask about Lahoun Solar Plant

# Q21 · passed

### Please figure out how much clipping loss was found in the last 2 months broken by inverters, list them down and plot it as well

Duration: 35.5 seconds · Returned six per-inverter two-month clipping totals and populated six-trace daily chart, with November 12 23:25 data cutoff disclosed. Values not independently recomputed.

## Observed answer

Clipping loss by inverter

For 2026-09-13 to 2026-11-13:

Inverter 1: 2,577.84 kWh
Inverter 2: 2,711.89 kWh
Inverter 3: 1,119.82 kWh
Inverter 4: 1,161.78 kWh
Inverter 5: 973.95 kWh
Inverter 6: 821.76 kWh

The chart showing daily clipping loss by inverter has been prepared.

Data note: Available data ends at 2026-11-12 23:25, so the remainder of 2026-11-13 is not included.

Daily Clipping Loss by Inverter - Last 2 Months
Pin
How this was worked out
Technical details
Answered by Data Agent, Graph Agent
· 24.6s

## Browser evidence

I have a COMMUNICATION FA...

Please figure out how much clipping loss was found in the last 2 months broken by inverters, list them down and plot it as well

**Clipping loss by inverter**


For 2026-09-13 to 2026-11-13:

- Inverter 1: 2,577.84 kWh
- Inverter 2: 2,711.89 kWh
- Inverter 3: 1,119.82 kWh
- Inverter 4: 1,161.78 kWh
- Inverter 5: 973.95 kWh
- Inverter 6: 821.76 kWh

The chart showing daily clipping loss by inverter has been prepared.

**Data note:** Available data ends at 2026-11-12 23:25, so the remainder of 2026-11-13 is not included.

**Daily Clipping Loss by Inverter ...** Pin

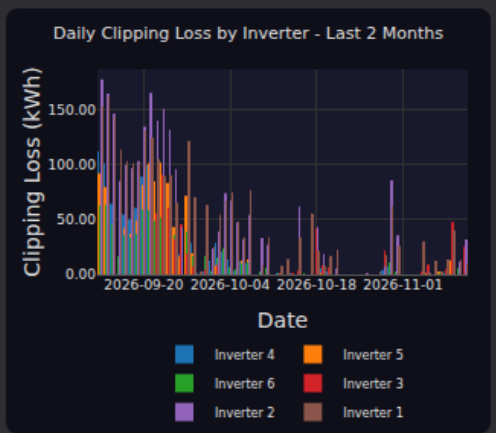


› How this was worked out

› Technical details

Answered by Data Agent, Graph Agent
· 24.6s

Ask about Lahoun Solar Plant

# Q7 · failed

### Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)

Duration: 29.5 seconds · P2 conversation-memory failure: first plotting question was Inverter 2 MPPT PR, hourly over three days. Follow-up instead plotted Inverter 3 specific yield and energy at five-minute resolution for November 12, matching the later current/voltage scope rather than the first plot. Two populated traces do not satisfy the original requested scope.

## Observed answer


I've created the visualization for you.

Inverter 3 Specific Yield and Energy Production (5-min granularity)
Pin
How this was worked out
Answered by Graph Agent
· 19.7s

## Browser evidence

PT

I have a COMMUNICATION FA...

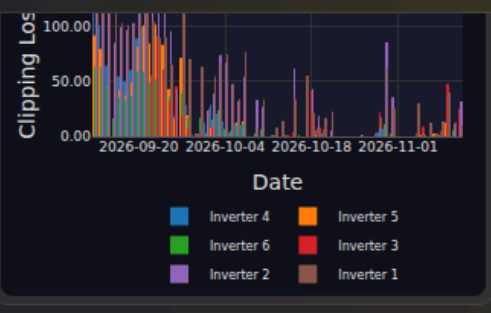


› How this was worked out


› Technical details

Answered by Data Agent, Graph Agent
· 24.6s

Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)

I've created the visualization for you.

**Inverter 3 Specific Yield and En...** Pin

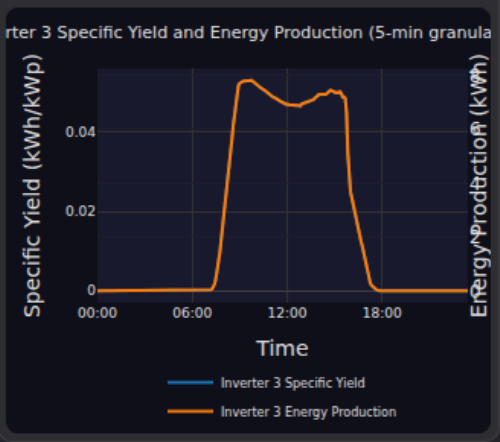


› How this was worked out

Answered by Graph Agent · 19.7s

Ask about Lahoun Solar Plant

# Q46 · passed

### Can you generate report for moth of september 2026

Duration: 14.3 seconds · September 2026 Lahoun PDF downloaded and validated as readable, 13 pages, correct plant/month. Retrieval only; no independent numerical validation.

## Observed answer

I've generated the plant performance report for September 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_September_2026_external_report.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent
· 4s

## Browser evidence


PT

I have a COMMUNICATION FA...

Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)

I've created the visualization for you.

**Inverter 3 Specific Yield and En...** Pin

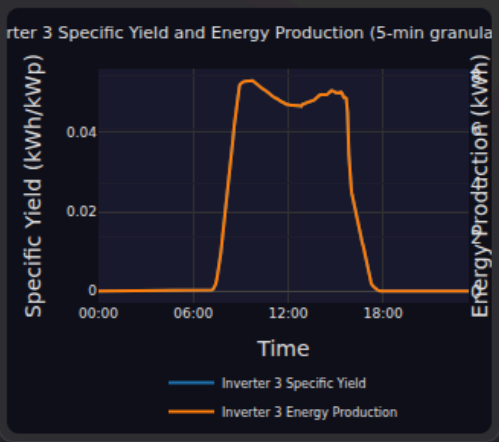


› How this was worked out

Answered by Graph Agent · 19.7s

Can you generate report for moth of september 2026

I've generated the plant performance report for September 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

**Abdali_Mall_Lahoun_September_2026_e...**
PDF report


Preview Open in a new tab

› How this was worked out


Answered by Report Agent · 4s

Ask about Lahoun Solar Plant


# AI_brain_UI

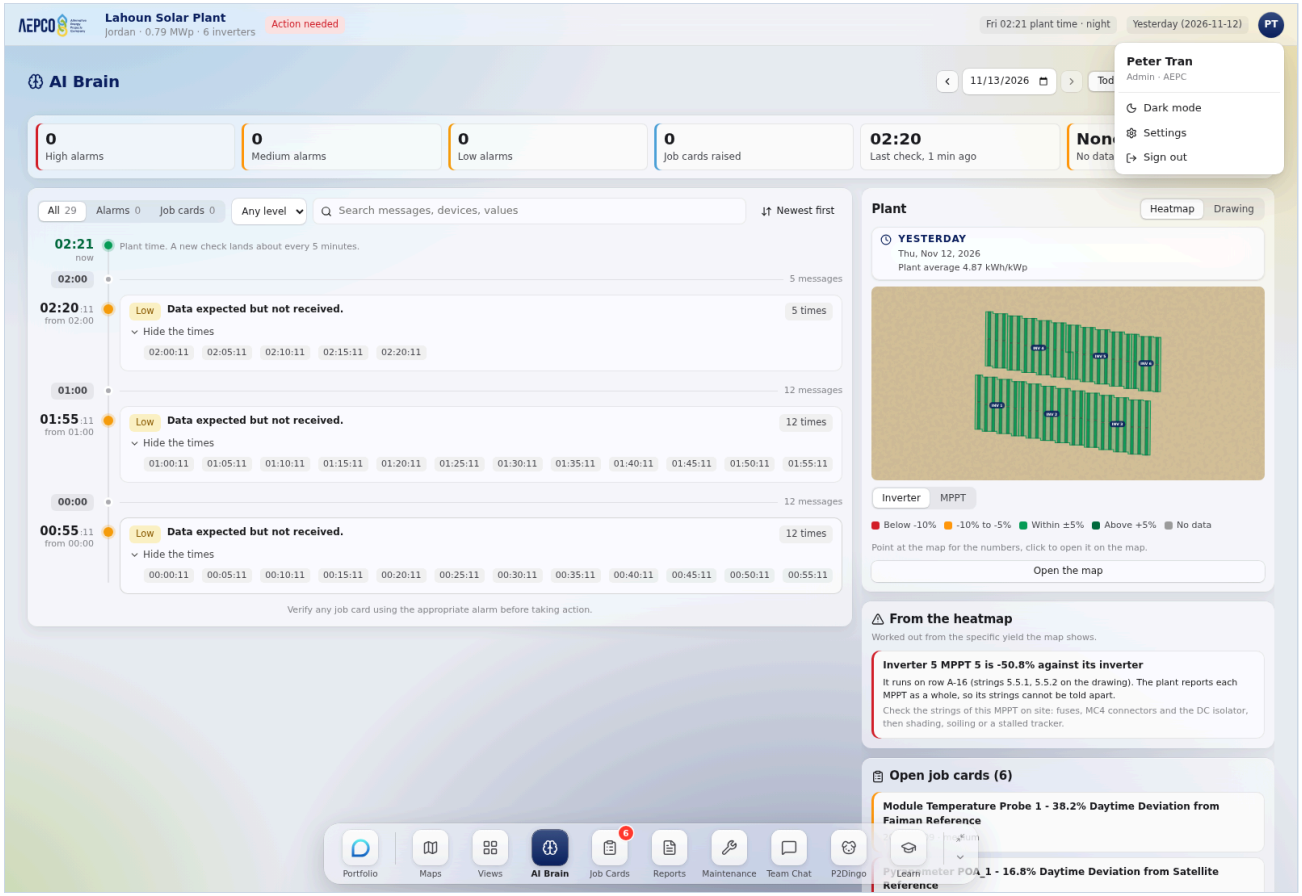
Lahoun Solar Plant
Jordan · 0.79 MWp · 6 inverters
Action needed
Fri 02:21 plant time · night
Yesterday (2026-11-12)
PT
Peter Tran
Admin · AEPC
Dark mode
Settings
Sign out
AI Brain
11/13/2026
0
High alarms
0
Medium alarms
0
Low alarms
0
Job cards raised
02:20
Last check, 1 min ago
All 29
Alarms 0
Job cards 0
Any level
Search messages, devices, values
Newest first
02:21
now
Plant time. A new check lands about every 5 minutes.
02:00
5 messages
02:20 ·11
from 02:00
Low
Data expected but not received.
5 times
Hide the times
02:00:11
02:05:11
02:10:11
02:15:11
02:20:11
01:00
12 messages
01:55 ·11
from 01:00
Low
Data expected but not received.
12 times
Hide the times
01:00:11
01:05:11
01:10:11
01:15:11
01:20:11
01:25:11
01:30:11
01:35:11
01:40:11
01:45:11
01:50:11
01:55:11
00:00
12 messages
00:55 ·11
from 00:00
Low
Data expected but not received.
12 times
Hide the times
00:00:11
00:05:11
00:10:11
00:15:11
00:20:11
00:25:11
00:30:11
00:35:11
00:40:11
00:45:11
00:50:11
00:55:11
Verify any job card using the appropriate alarm before taking action.
Plant
Heatmap
Drawing
YESTERDAY
Thu, Nov 12, 2026
Plant average 4.87 kWh/kWp
Inverter
MPPT
Below -10%
-10% to -5%
Within ±5%
Above +5%
No data
Point at the map for the numbers, click to open it on the map.
Open the map
From the heatmap
Worked out from the specific yield the map shows.
Inverter 5 MPPT 5 is -50.8% against its inverter
It runs on row A-16 (strings 5.5.1, 5.5.2 on the drawing). The plant reports each MPPT as a whole, so its strings cannot be told apart.
Check the strings of this MPPT on site: fuses, MC4 connectors and the DC isolator, then shading, soiling or a stalled tracker.
Open job cards (6)
Module Temperature Probe 1 - 38.2% Daytime Deviation from Faiman Reference
Pyranometer POA_1 - 16.8% Daytime Deviation from Satellite Reference
Portfolio
Maps
Views
AI Brain
Job Cards
6
Reports
Maintenance
Team Chat
P2Dingo
Learn

# Maintenance_UI

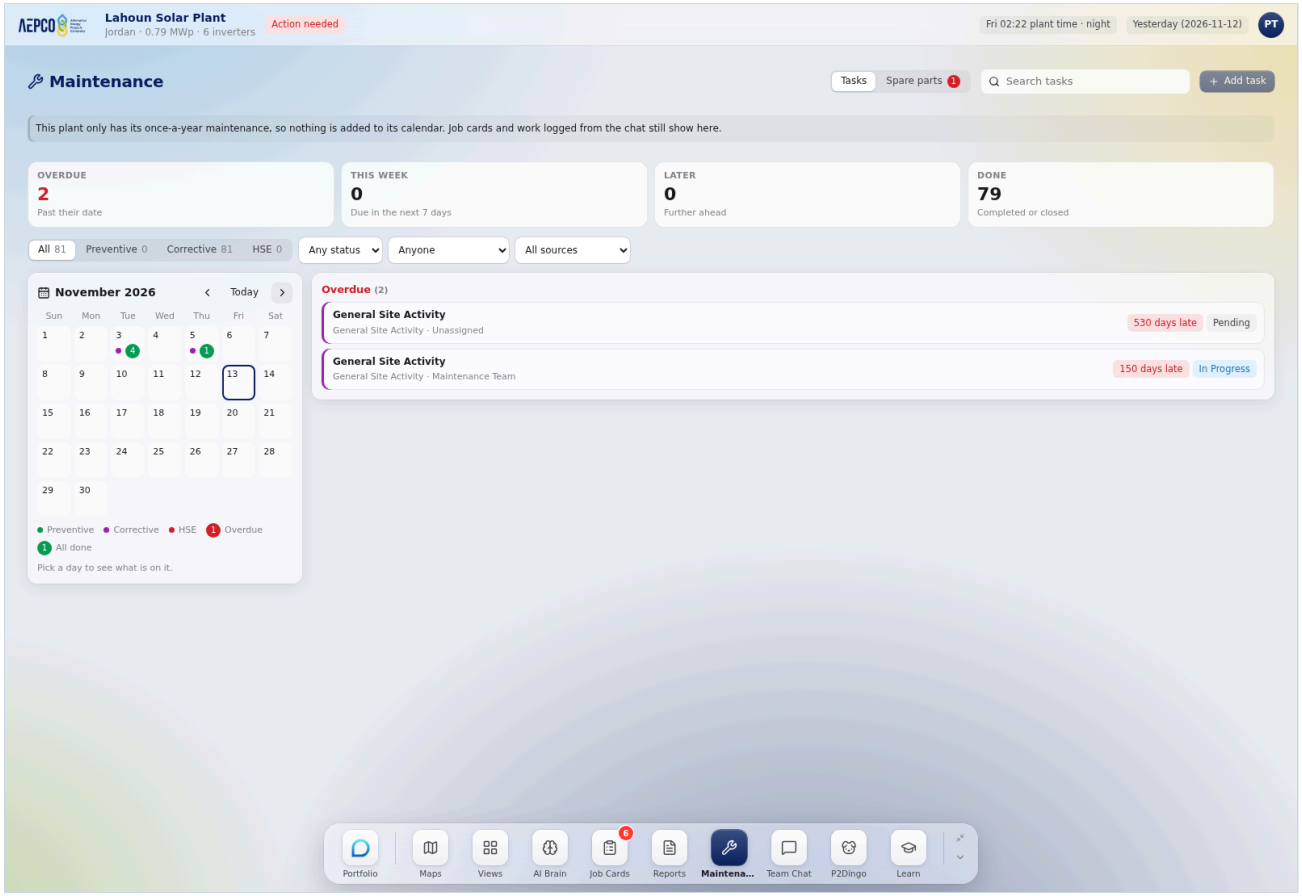


# Job_cards_UI

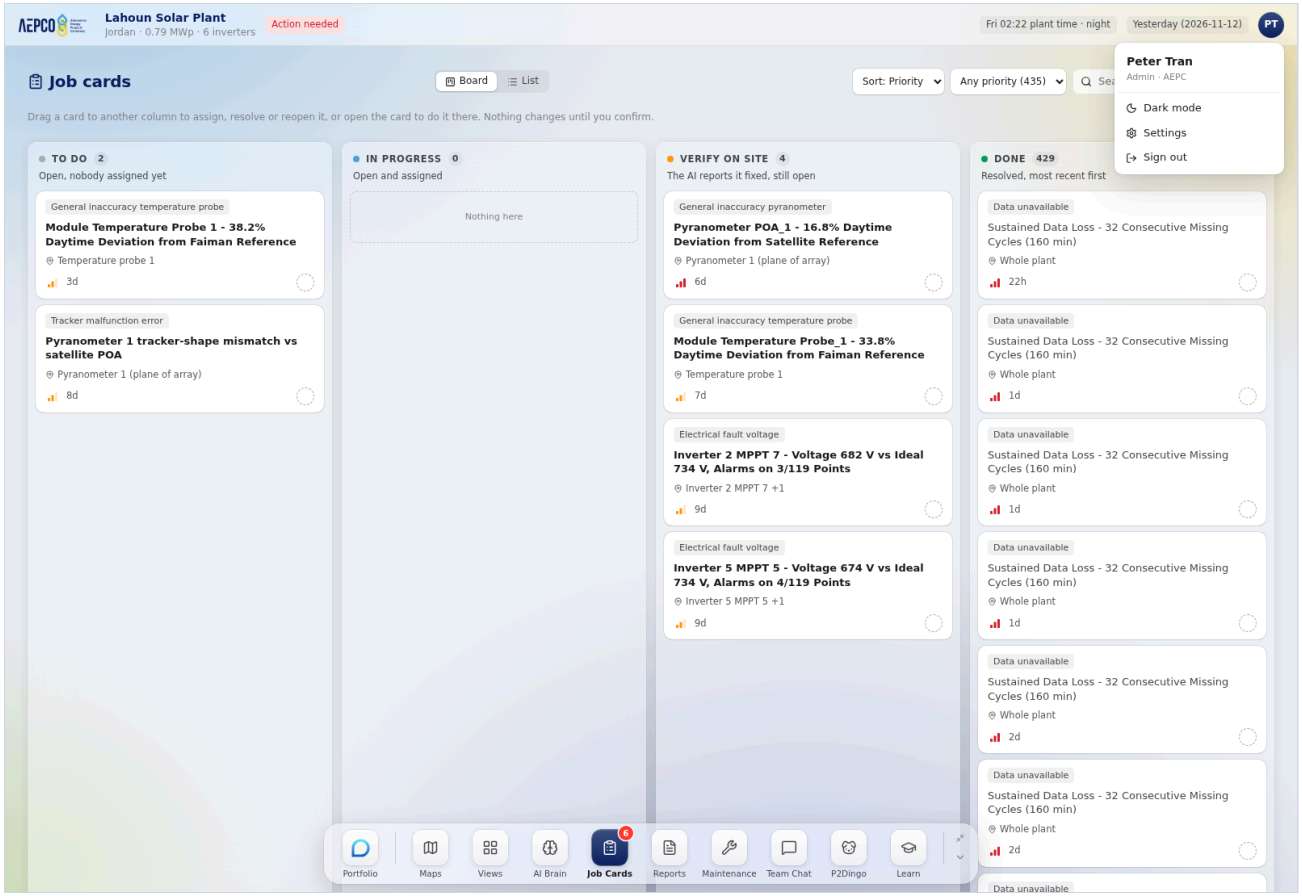
AEPCO
Lahoun Solar Plant
Jordan · 0.79 MWp · 6 inverters
Action needed
Fri 02:22 plant time · night
Yesterday (2026-11-12)
PT
Peter Tran
Admin · AEPC
Dark mode
Settings
Sign out
Job cards
Board
List
Sort: Priority
Any priority (435)
Drag a card to another column to assign, resolve or reopen it, or open the card to do it there. Nothing changes until you confirm.
TO DO 2
Open, nobody assigned yet
General inaccuracy temperature probe
Module Temperature Probe 1 - 38.2% Daytime Deviation from Faiman Reference
Temperature probe 1
3d
Tracker malfunction error
Pyranometer 1 tracker-shape mismatch vs satellite POA
Pyranometer 1 (plane of array)
8d
IN PROGRESS 0
Open and assigned
Nothing here
VERIFY ON SITE 4
The AI reports it fixed, still open
General inaccuracy pyranometer
Pyranometer POA_1 - 16.8% Daytime Deviation from Satellite Reference
Pyranometer 1 (plane of array)
6d
General inaccuracy temperature probe
Module Temperature Probe_1 - 33.8% Daytime Deviation from Faiman Reference
Temperature probe 1
7d
Electrical fault voltage
Inverter 2 MPPT 7 - Voltage 682 V vs Ideal 734 V, Alarms on 3/119 Points
Inverter 2 MPPT 7 +1
9d
Electrical fault voltage
Inverter 5 MPPT 5 - Voltage 674 V vs Ideal 734 V, Alarms on 4/119 Points
Inverter 5 MPPT 5 +1
9d
DONE 429
Resolved, most recent first
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
22h
1d
1d
1d
2d
2d
Portfolio
Maps
Views
AI Brain
Job Cards
6
Reports
Maintenance
Team Chat
P2Dingo
Learn


# Job card evidence

## Pyranometer POA_1 - 16.8% Daytime Deviation from Satellite Reference

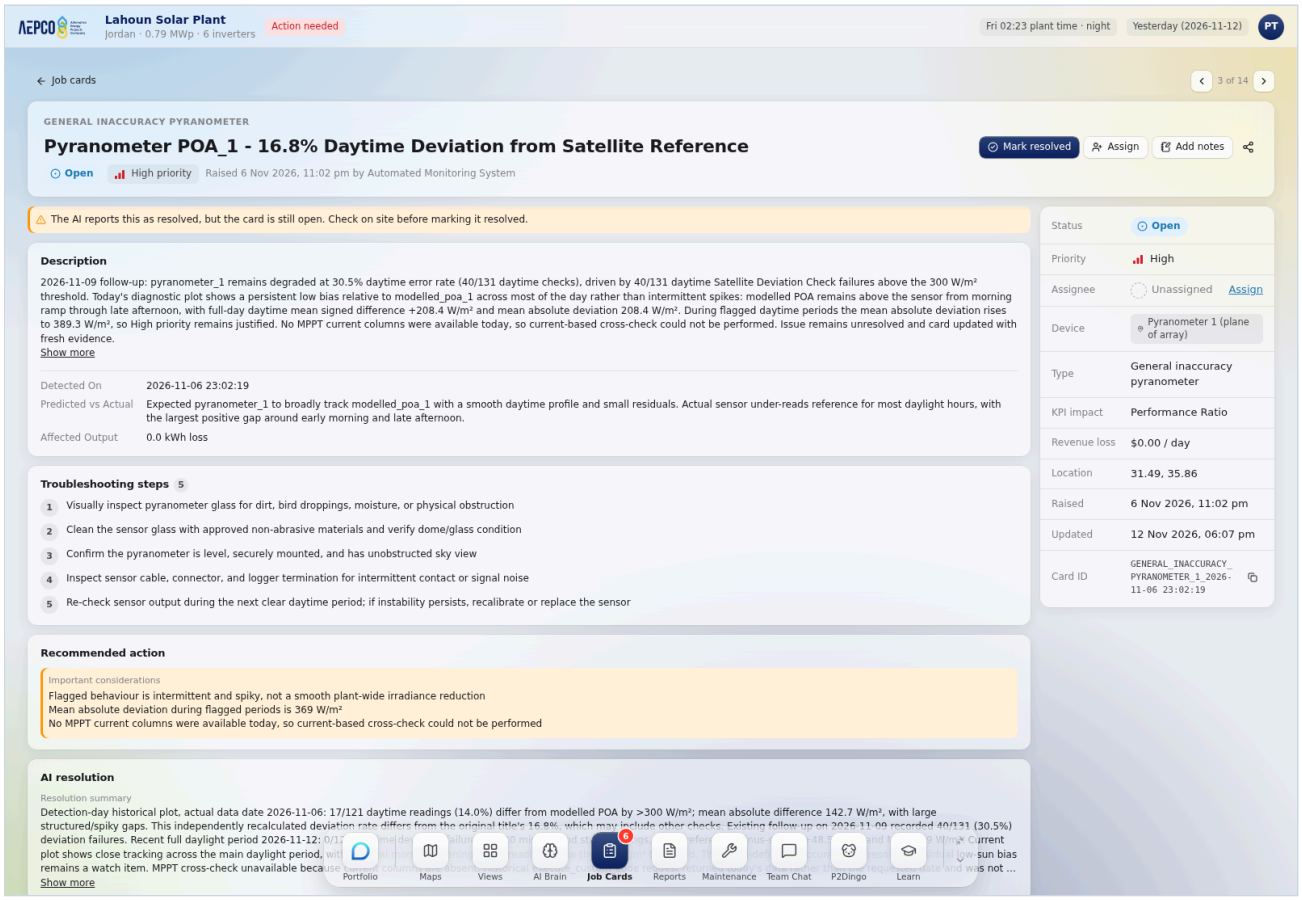


# Job card evidence

## Module Temperature Probe 1 - 38.2% Daytime Deviation from Faiman Reference

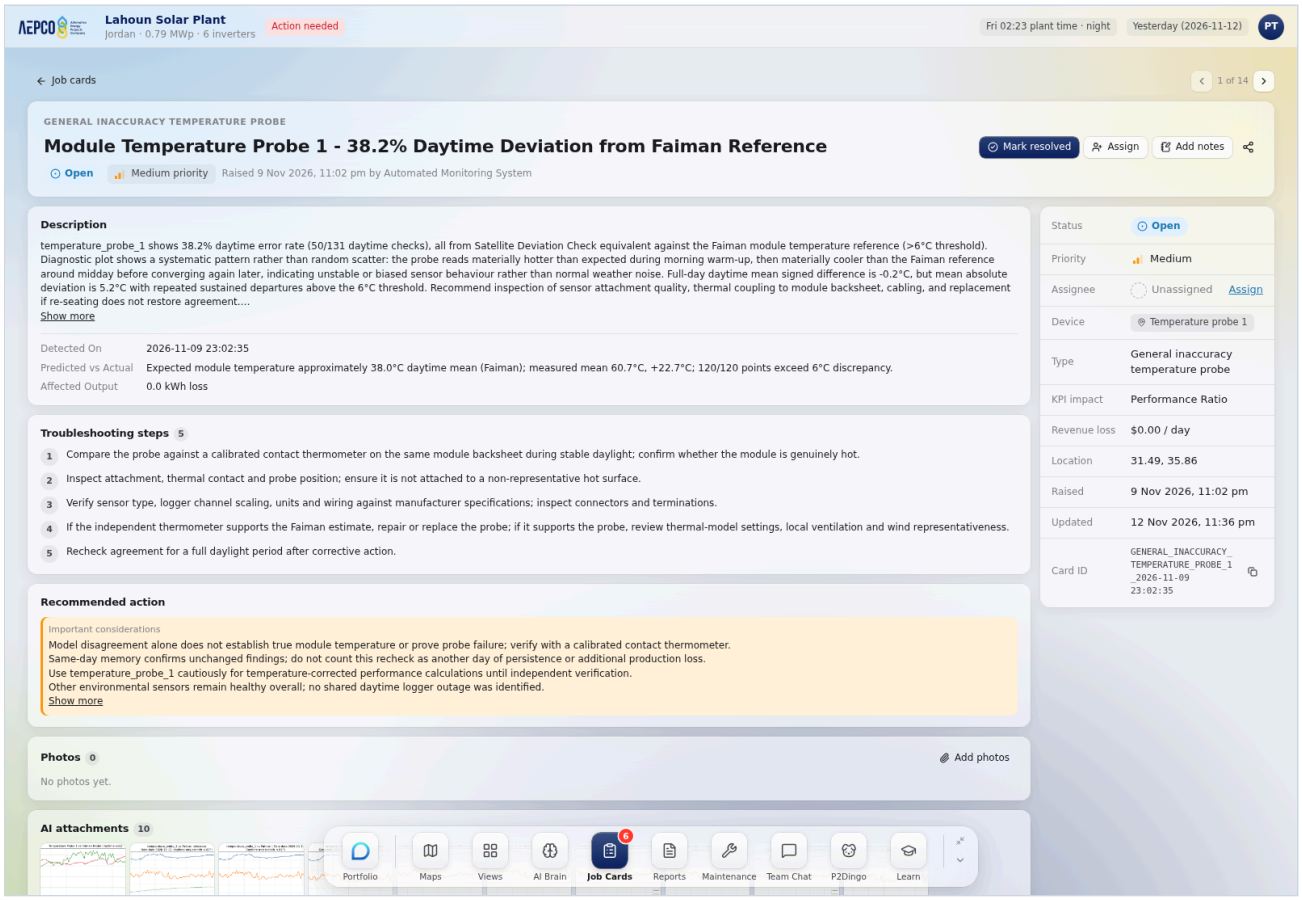


# Job card evidence

## Pyranometer 1 tracker-shape mismatch vs satellite POA

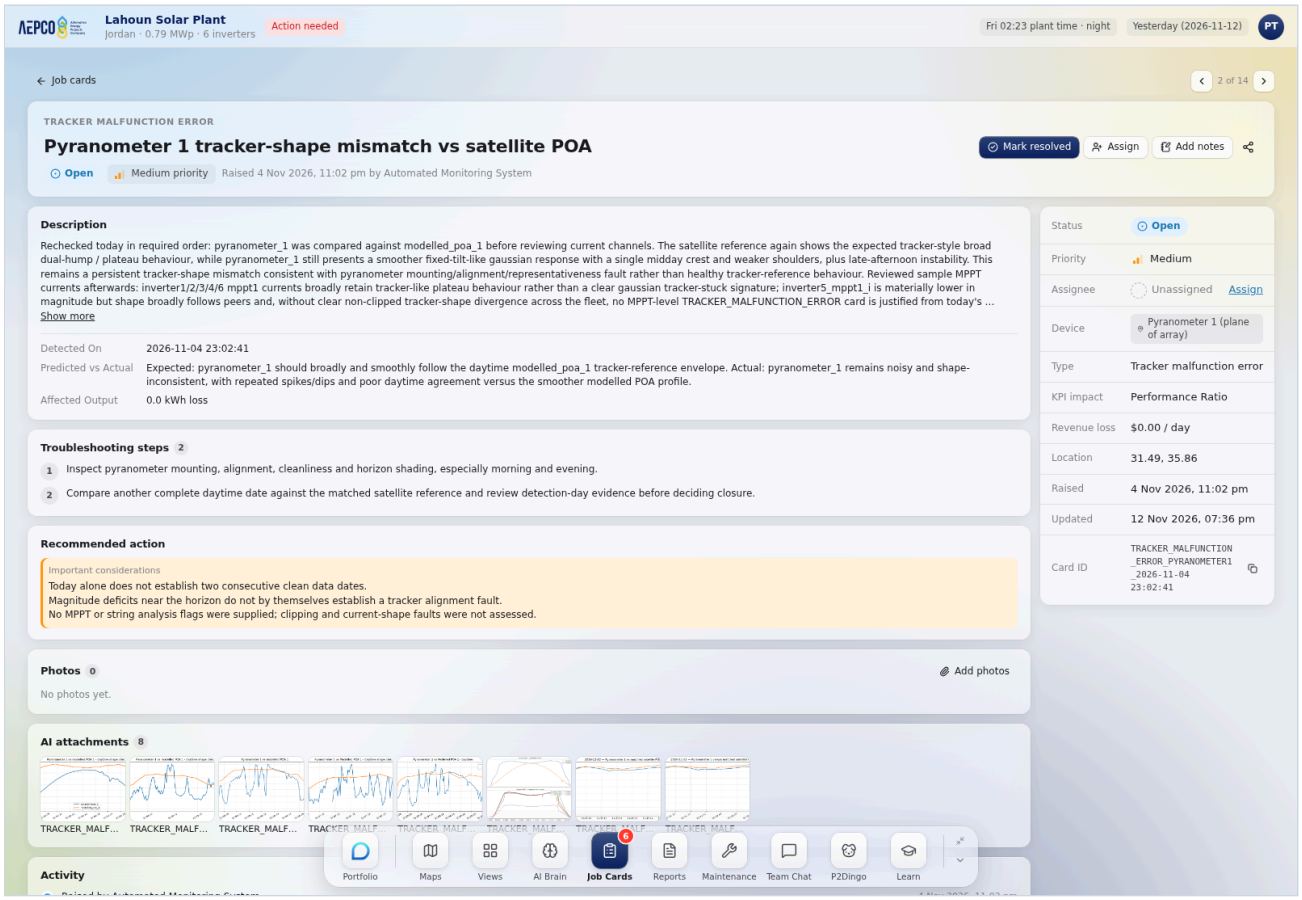


# Job card evidence

## Module Temperature Probe_1 - 33.8% Daytime Deviation from Faiman Reference

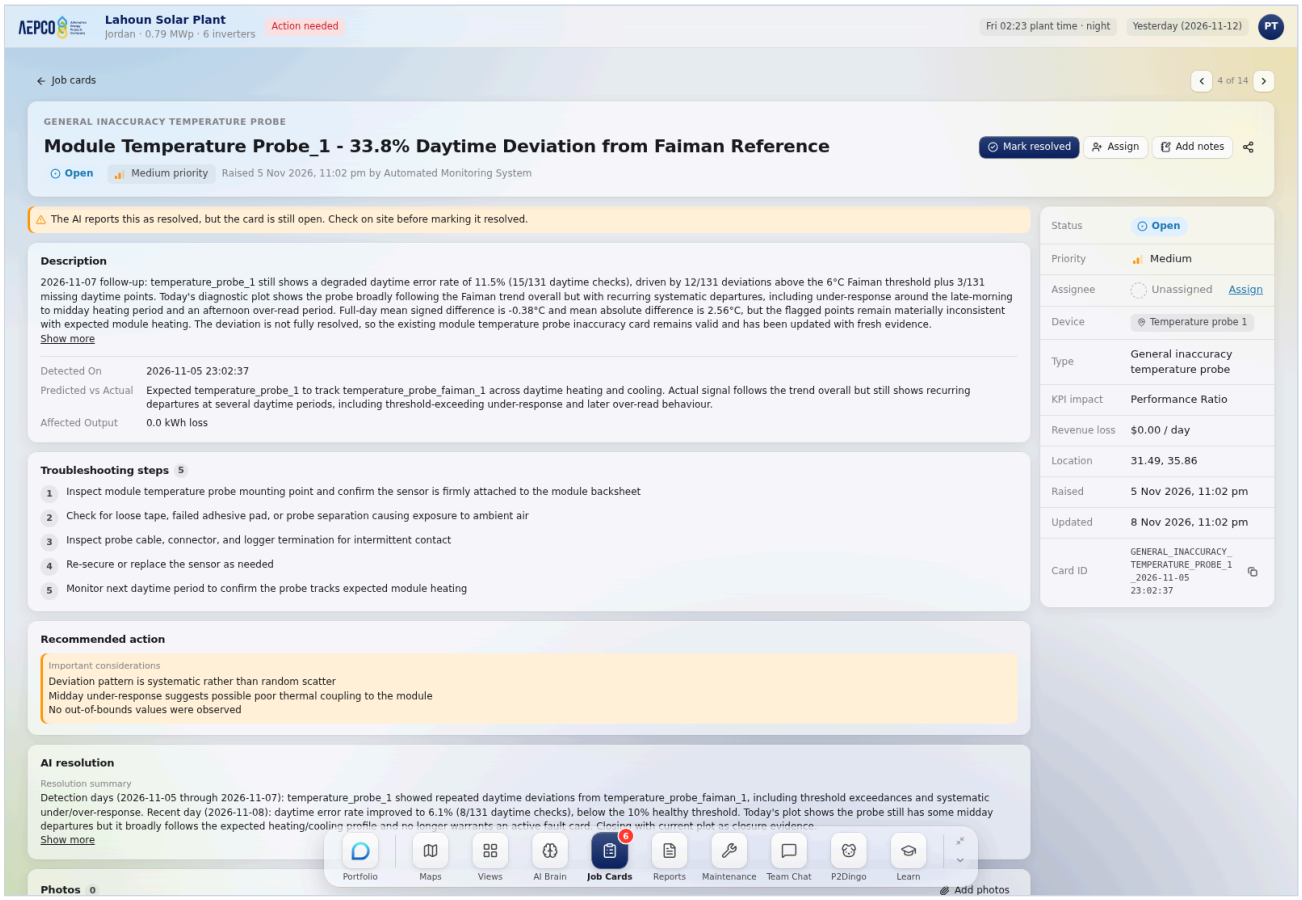


# Job card evidence

## Inverter 2 MPPT 7 - Voltage 682 V vs Ideal 734 V, Alarms on 3/119 Points

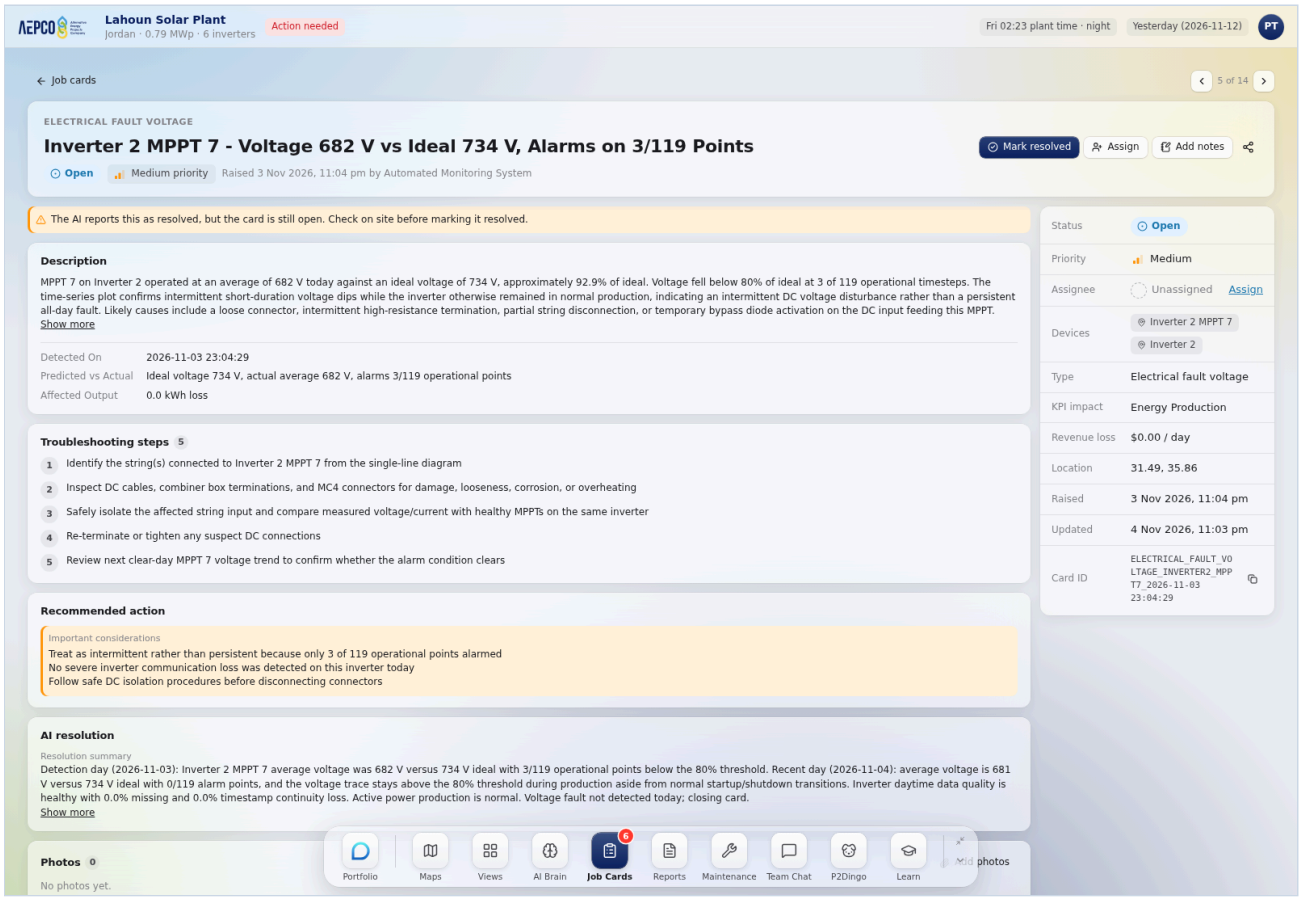


# Job card evidence

## Inverter 5 MPPT 5 - Voltage 674 V vs Ideal 734 V, Alarms on 4/119 Points

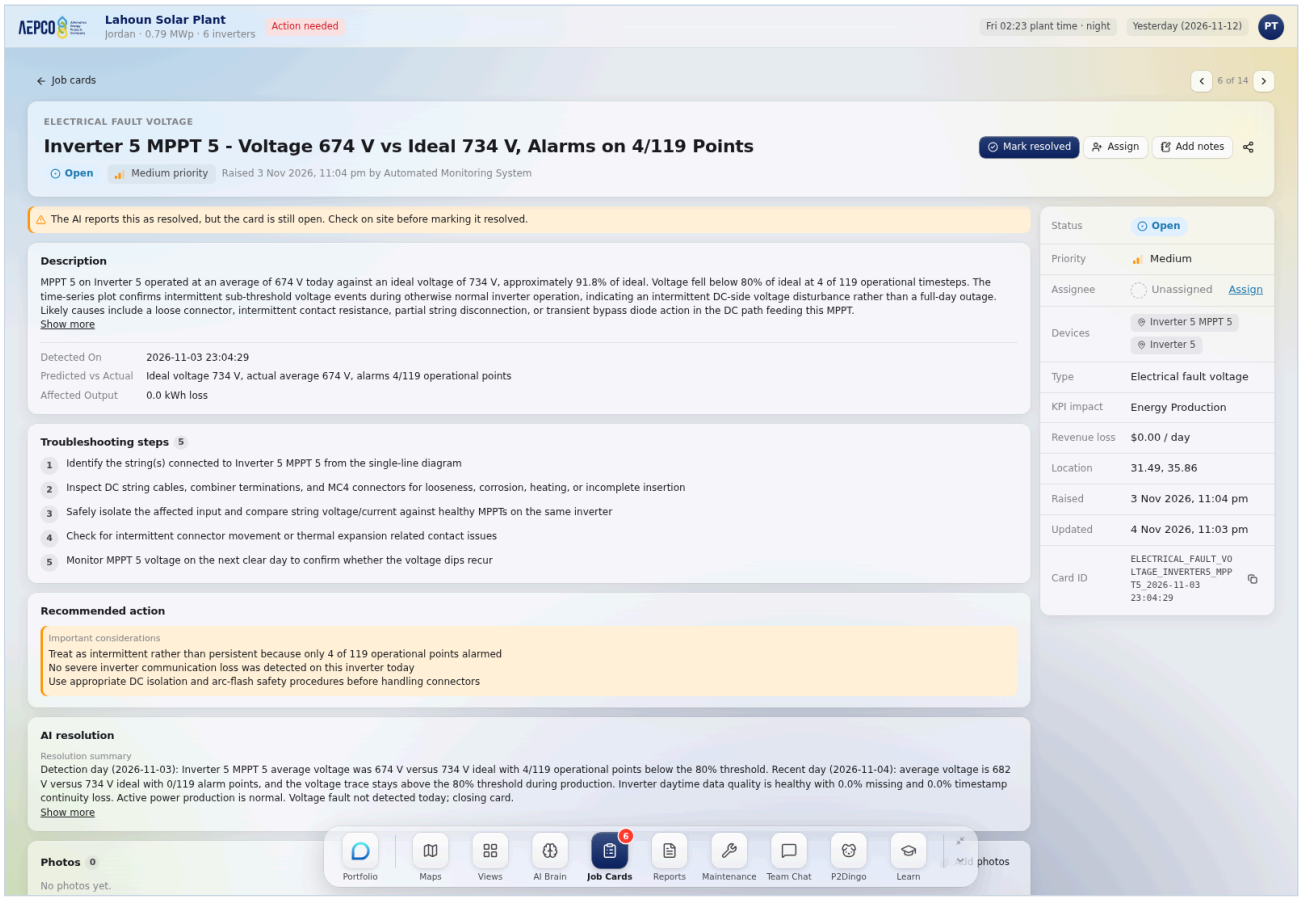

# Teams_UI

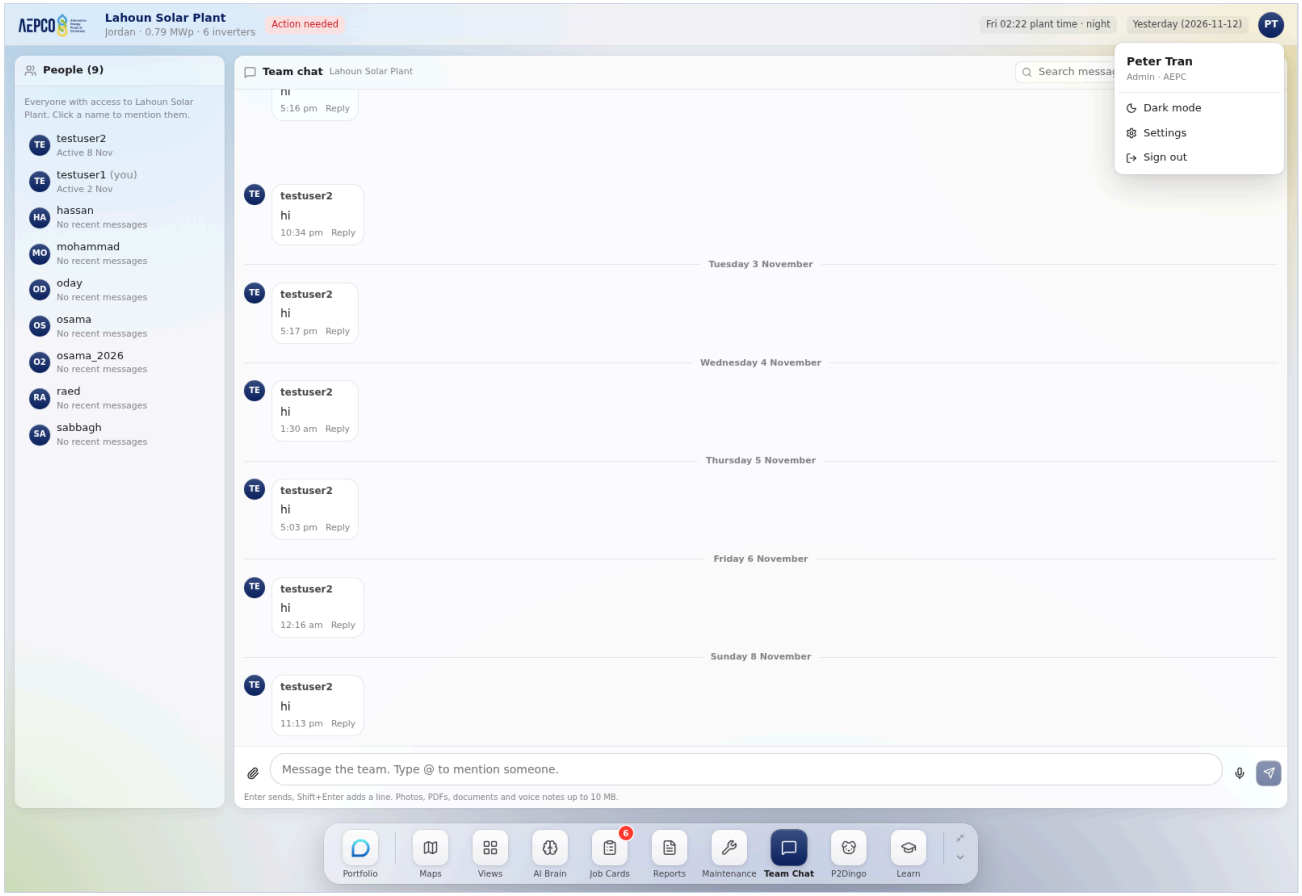
Lahoun Solar Plant
Jordan · 0.79 MWp · 6 inverters
Action needed
Fri 02:22 plant time · night
Yesterday (2026-11-12)
PT
Peter Tran
Admin · AEPC
Dark mode
Settings
Sign out
People (9)
Everyone with access to Lahoun Solar Plant. Click a name to mention them.
testuser2
Active 8 Nov
testuser1 (you)
Active 2 Nov
hassan
No recent messages
mohammad
No recent messages
oday
No recent messages
osama
No recent messages
osama_2026
No recent messages
raed
No recent messages
sabbagh
No recent messages
Team chat
Lahoun Solar Plant
Search messages
hi
5:16 pm Reply
testuser2
hi
10:34 pm Reply
Tuesday 3 November
testuser2
hi
5:17 pm Reply
Wednesday 4 November
testuser2
hi
1:30 am Reply
Thursday 5 November
testuser2
hi
5:03 pm Reply
Friday 6 November
testuser2
hi
12:16 am Reply
Sunday 8 November
testuser2
hi
11:13 pm Reply
Message the team. Type @ to mention someone.
Enter sends, Shift+Enter adds a line. Photos, PDFs, documents and voice notes up to 10 MB.
Portfolio
Maps
Views
AI Brain
Job Cards
Reports
Maintenance
Team Chat
P2Dingo
Learn

## Scope and limitations

- One-time standalone test; daily schedules and application source unchanged.
- Credentials and browser authentication state are not saved.
- Enabled suite texts and dates preserved; no independent calculation verification.
- A new standalone repeat run; previous evidence files were preserved.
- Functional review used current answers and artifact payloads, not earlier verdicts.
- No alert email, Teams message, GitHub upload, upstream pipeline invocation or S3 write was performed.
- Opening existing job cards may mark them as read; no cards created, resolved or reassigned.
- No independent numerical recalculation, security audit or load test was performed.