Customer readiness test
Lahoun Solar Plant

One-time browser test · 2026-11-14T03:42:48.293155+00:00 UTC
https://main.d3o3iryvy33gj9.amplifyapp.com/portfolio

23/23	11	4	8
Questions attempted	Passed functional checks	Failed checks	Review / blocked

Key findings

- November 14, 2026, 03:42-03:52 UTC (14:42-14:52 Sydney): all 23 questions completed; 11 functional/retrieval passes, four failed checks, eight partial/informational/unverified results. UI results are separate.
- P1: the external clipping API remains unavailable in Q27, Q11 and Q21. These are three affected questions, not three distinct service outages. Labelled fallback estimates do not prove API recovery.
- Output improvement: Q11 and Q21 now include requested written per-inverter totals as well as six-trace charts. They remain failed API-health checks because the external-service failure is explicitly disclosed.
- P2: Q7 retains Inverter 2, hourly granularity and dual axes but still loses the original MPPT breakdown, returning only two aggregate traces.
- Missing data is low-priority/informational: latest returned measurements stop at November 12 23:25. Q18 yesterday and Q17 quality checks have no November 13 data; Q6 is an empty chart and Q12 covers only five days.
- Three report PDFs downloaded and validated for readability and plant/month: October 2026 (13 pages), December 2025 (12), September 2026 (13). Retrieval passes do not validate numerical accuracy; December report contains anomalous negative June generation requiring content review.
- Q9 now explicitly mentions power-off/lockout for cable work. Manual answers remain unvalidated operational advice; no equipment actions were performed.
- Maintenance, Team Chat and six selected job-card details verified. AI Brain navigation was blocked by the test helper and is not counted as verified or as a confirmed app failure.
- Read-only S3 snapshot: api_error=false, checked 03:43:25 UTC, status last updated 03:31:46 UTC. This latest exception flag is not proof of fresh data or healthy chat analytics.
- No application code or schedules changed; no cleaning-log save, job-card status change, email, Teams message, GitHub upload, S3 write or upstream pipeline invocation performed.
- Compared with the previous run: Q11: review → failed; Q18: passed → review; Q21: review → failed

> API/tool errors are highest priority, followed by failed application responses. Missing data is reported separately. An answer or HTTP 200 alone is not a functional pass. Numerical results have not been independently recomputed. This test did not change daily schedules or run the upstream pipeline.

Single-plant pipeline snapshot

Abdali_Mall_Lahoun.json · api_error: **false**

S3 last modified: 2026-11-14T03:31:46.000Z

Checked: 2026-11-14T03:43:25.745Z

Question results

ID	Test question	Result	Finding
Q9	I have a COMMUNICATION_FAULT what do I do to my inverters?	**PASSED**	Manual answer, diagrams and manufacturer PDF returned; source-retrieval pass only. Improved safety wording explicitly requires power-off/lockout for communication cable work. Internal-access instructions remain unvalidated engineering advice; no equipment actions performed.
Q27	Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026	**FAILED**	P1: requested clipping_loss_via_requests explicitly failed because the external clipping service was unreachable. Labelled fallback returns six inverter estimates totalling 33,349.24 kWh for July. Fallback output does not establish recovery of the requested API.
Q1	Please generate last months report	**PASSED**	October 2026 Lahoun report downloaded and readable, 13 pages, matching plant/month. Retrieval pass only; numerical accuracy and fresh recomputation not established.
Q12	Was there any 0 production days in the last 7 days?	**REVIEW**	Only five available days, November 8-12, returned for the seven-day request. No zero production among those five days. November 13-14 explicitly unavailable; latest timestamp November 12 23:25. Incomplete coverage is informational, not an API failure.

ID	Test question	Result	Finding
Q16	Please generate December 2025 performance report	**PASSED**	December 2025 Lahoun report downloaded and readable, 12 pages, matching plant/month. Retrieval only: the report contains a negative June energy figure (-901,836.11 kWh) in its generation table, which warrants data/content review. Numerical correctness is not a pass.
Q17	How is my data quality for POA and power? How many of them show missing data during daytime or mismatches with satellite prediction?	**REVIEW**	Explicit no-data response for November 13-14; daytime missing-data and POA/power mismatch counts cannot be computed. Informational coverage limitation, not evidence of an API outage or a successful quality assessment.
Q3	Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2	**PASSED**	Chart payload contains 12 populated Inverter 2 MPPT PR traces at hourly granularity. Available coverage is only 24 hours on November 12 within the requested three-day window; November 13-14 absent. Functional chart pass with coverage caveat, not numerical verification.
Q4	Please plot last 3 days hourly performance ratio for my Strings for inverter 2	**REVIEW**	Assistant states this plant does not record string-level data and recommends MPPT instead. No requested string chart delivered. Underlying schema/capability claim not independently verified; not an explicit API failure.
Q5	Please plot the last 4 days hourly performance ratio for all my inverters	**PASSED**	Six populated hourly inverter PR traces returned, covering 48 hours on November 11-12 within the requested four-day window. Missing November 13-14 reported separately; numerical values not independently recomputed.
Q11	Please figure out how much clipping loss was found in the last 6 months broken by inverters, list them down and plot it as well	**FAILED**	P1 underlying API issue disclosed: external clipping analytics service unavailable. Output improved: six written inverter totals and a six-trace monthly fallback chart now supplied for May 14-November 14. Fallback is usable but does not make the failed external API healthy; not a new distinct service outage.

ID	Test question	Result	Finding
Q18	How did my plant perform yesterday?	**REVIEW**	Yesterday is now November 13 and every requested performance measure returns empty data: energy, yield, PR, availability and hourly signals. Assistant explicitly identifies missing data rather than claiming performance. Not an explicit API/calculation failure.
Q20	Is there shading happening with my plant? Please analyze the pyranometer and check for frequent dips at certain times	**PASSED**	Quantified shading analysis supplied over 2,899 available daylight points, with morning/late-afternoon dip frequencies, sun-angle sectors and inverter-power comparisons. Latest data cutoff November 12 23:25 disclosed. Response-level pass only; shading cause and statistical calculations not independently confirmed.
Q2	Based on pvsyst report, what is the rated power of this plant and array configuration	**PASSED**	Two plant-specific PVsyst source sections retrieved: system summary and PV array characteristics. Source-retrieval pass only; requested rated power/configuration not extracted into a complete written answer.
Q6	Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3	**REVIEW**	Current/voltage visualization explicitly titled DataFrame Empty, with zero traces. No actual requested measurement plot available. Missing current data, not an observed API outage.
Q10	When was the last time the BOM data showed up	**REVIEW**	Claims latest BOM timestamp November 12 23:25 based on latest source data. BOM-specific field mapping and validity were not independently verified; a generic latest timestamp alone does not establish BOM freshness.
Q19	Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt	**PASSED**	Returns daily POA integration method and aggregate statistics over 312 available days: mean 5,686.16, median 5,672.78 Wh/m² and kurtosis -0.2895. Missing days and November 12 cutoff disclosed. Functional analytical response only; full daily list absent and calculations not independently recomputed.

ID	Test question	Result	Finding
Q14	Pull up the latest cleaning log	**REVIEW**	No November 2026 cleaning logs returned. Does not establish whether an older latest cleaning log exists. Informational no-record result, not an API failure.
Q15	Jim cleaned the pyranometer today, can you add it to the cleaning log?	**REVIEW**	Requested required Date, Fault Cause, Action Taken and Status before saving. No extra fields or confirmation supplied, and no cleaning log saved. Record-creation capability intentionally untested.
Q8	How can I shut down my inverters?	**PASSED**	Manufacturer shutdown guidance, diagrams and PDF source returned. Retrieval/response pass only; instructions include electrical switching/disconnection and are not independently safety-certified. No hardware actions performed.
Q13	Please change to dark mode	**PASSED**	UI agent returned dark-mode action and current screenshot visually confirms dark interface.
Q21	Please figure out how much clipping loss was found in the last 2 months broken by inverters, list them down and plot it as well	**FAILED**	P1 underlying API issue disclosed: external clipping analytics service unavailable. Output improved to six written inverter estimates, total 8,709.86 kWh, and six populated daily chart traces. Fallback output does not establish API recovery; same service issue as Q27/Q11, not three distinct outages.
Q7	Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)	**FAILED**	P2 memory/scope failure persists: correct Inverter 2, hourly period and dual y axes, but follow-up has only two aggregate inverter traces rather than the first plot's 12 MPPT-level traces. Available data covers November 12 only; loss of MPPT scope is separate from missing days.
Q46	Can you generate report for moth of september 2026	**PASSED**	September 2026 Lahoun report downloaded and readable, 13 pages, matching plant/month. Retrieval verified, not correctness of numerical report tables.

Application UI checks

Area	Result	Finding
AI_brain_UI	blocked	Dedicated AI Brain navigation was not verified: the helper encountered a navigation/selector error before opening it. Legacy probe remained on Maps, so is not accepted as evidence of a working AI Brain page. Test limitation, not a confirmed application failure.
Maintenance_UI	passed	Tasks, filters and calendar rendered. Previous/next navigation displayed October then November. Customer site states once-yearly maintenance; legacy preventive scheduling controls absent by design.
Job_cards_UI	passed	Board and six selected existing job-card detail panels inspected and captured, not the full inventory. No create, resolve or reassign action; viewing may mark cards read.
Teams_UI	passed	Customer Team Chat participant list, message history and composer rendered. No message sent. Not a Microsoft Teams integration test.

Customer navigation differs from the legacy daily-test site. Unavailable legacy tabs are not counted as passes.

Q9 · passed

I have a COMMUNICATION_FAULT what do I do to my inverters?

Duration: 34.7 seconds · Manual answer, diagrams and manufacturer PDF returned; source-retrieval pass only. Improved safety wording explicitly requires power-off/lockout for communication cable work. Internal-access instructions remain unvalidated engineering advice; no equipment actions performed.

Observed answer

To troubleshoot and resolve the COMMUNICATION_FAULT on your inverter, follow these step-by-step actions strictly according to the manual:

Safety Precaution: Do not disconnect connectors under load to avoid damage or safety incidents. Only work on the communication or network cable when the inverter is powered off and locked out as shown in the manual.
Access the inverter's internal components:
Rotate the cover in the direction indicated by arrow 1, then secure it with two screws per step 2 in this diagram:

Locate the four critical points (marked with arrows) and ensure the toggle switch is in the correct ON or OFF position for troubleshooting. Refer to:

Inspect the communication cable assembly:
Follow these steps: insert the top component (step 1), secure the middle piece (step 2), then connect/fasten the cable at the bottom (step 3).
View the assembly diagram here:

Ensure the network/communication cable is firmly and correctly connected to the device port. Position the connector as illustrated:

Check the cable routing: Compare your setup to the diagram – the right side with the green checkmark illustrates correct routing; avoid setups like the left side (red X):

Use the monitoring system interface to check inverter communication status and review error/warning codes. Interface navigation is shown here:

Refer to the manual for further details:
PDF manual: https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

STP_110-60_Manual.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Technical details
Answered by Manual Agent
· 18.8s

Browser evidence


PT

I have a COMMUNICATION FA...


To troubleshoot and resolve the COMMUNICATION_FAULT on your inverter, follow these step-by-step actions strictly according to the manual:

1. Safety Precaution: Do not disconnect connectors under load to avoid damage or safety incidents. Only work on the communication or network cable when the inverter is powered off and locked out as shown in the manual.

1. Access the inverter's internal components:
2. Rotate the cover in the direction indicated by arrow 1, then secure it with two screws per step 2 in this diagram:

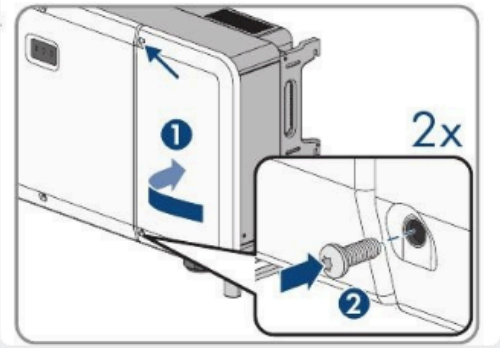

1. Locate the four critical points (marked with arrows) and ensure the toggle switch is in the correct ON or OFF position for troubleshooting. Refer to:

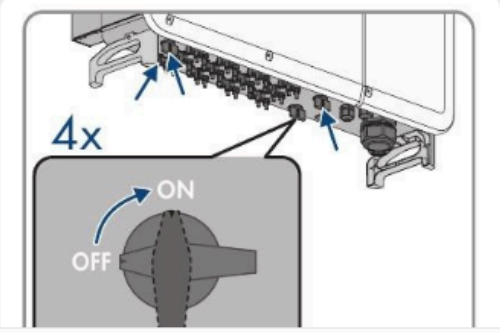

Ask about Lahoun Solar Plant

Q27 · failed

Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026

Duration: 38.9 seconds · P1: requested clipping_loss_via_requests explicitly failed because the external clipping service was unreachable. Labelled fallback returns six inverter estimates totalling 33,349.24 kWh for July. Fallback output does not establish recovery of the requested API.

Observed answer

I tried clipping_loss_via_requests for 2026-07-01 to 2026-07-31, but it failed because the external clipping analytics service was unreachable. That failure does not mean zero clipping.

Using the fallback estimator calculate_clipping_or_curtailment_losses_ag on the plant data, there was estimated clipping loss in July 2026 for all six inverters:

inverter1: 6791.51 kWh
inverter2: 8166.85 kWh
inverter3: 7798.30 kWh
inverter4: 4130.33 kWh
inverter5: 3688.40 kWh
inverter6: 2773.85 kWh

Total estimated clipping loss across the plant: 33349.24 kWh.

So yes — there was clipping loss in July 2026.

How this was worked out
Technical details
Answered by Data Agent
· 20.8s

Browser evidence

PT

I have a COMMUNICATION FA...



Refer to the manual for further details:
PDF manual: https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

STP_110-60_Manual.pdf
PDF report

Preview | Open in a new tab

› How this was worked out

› Technical details

Answered by Manual Agent · 18.8s

Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026

I tried `clipping_loss_via_requests` for 2026-07-01 to 2026-07-31, but it failed because the external clipping analytics service was unreachable. That failure does not mean zero clipping.

Using the fallback estimator `calculate_clipping_or_curtailment_losses_ag` on the plant data, there was estimated clipping loss in July 2026 for all six inverters:

- inverter1: 6791.51 kWh
- inverter2: 8166.85 kWh
- inverter3: 7798.30 kWh
- inverter4: 4130.33 kWh
- inverter5: 3688.40 kWh
- inverter6: 2773.85 kWh

Total estimated clipping loss across the plant: 33349.24 kWh.

So yes — there was clipping loss in July 2026.

› How this was worked out

› Technical details

Answered by Data Agent · 20.8s

Ask about Lahoun Solar Plant

Q1 · passed

Please generate last months report


Duration: 14.4 seconds · October 2026 Lahoun report downloaded and readable, 13 pages, matching plant/month. Retrieval pass only; numerical accuracy and fresh recomputation not established.

Observed answer

I've generated the external report for October 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_October_2026_external_report.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent
· 3.5s

Browser evidence

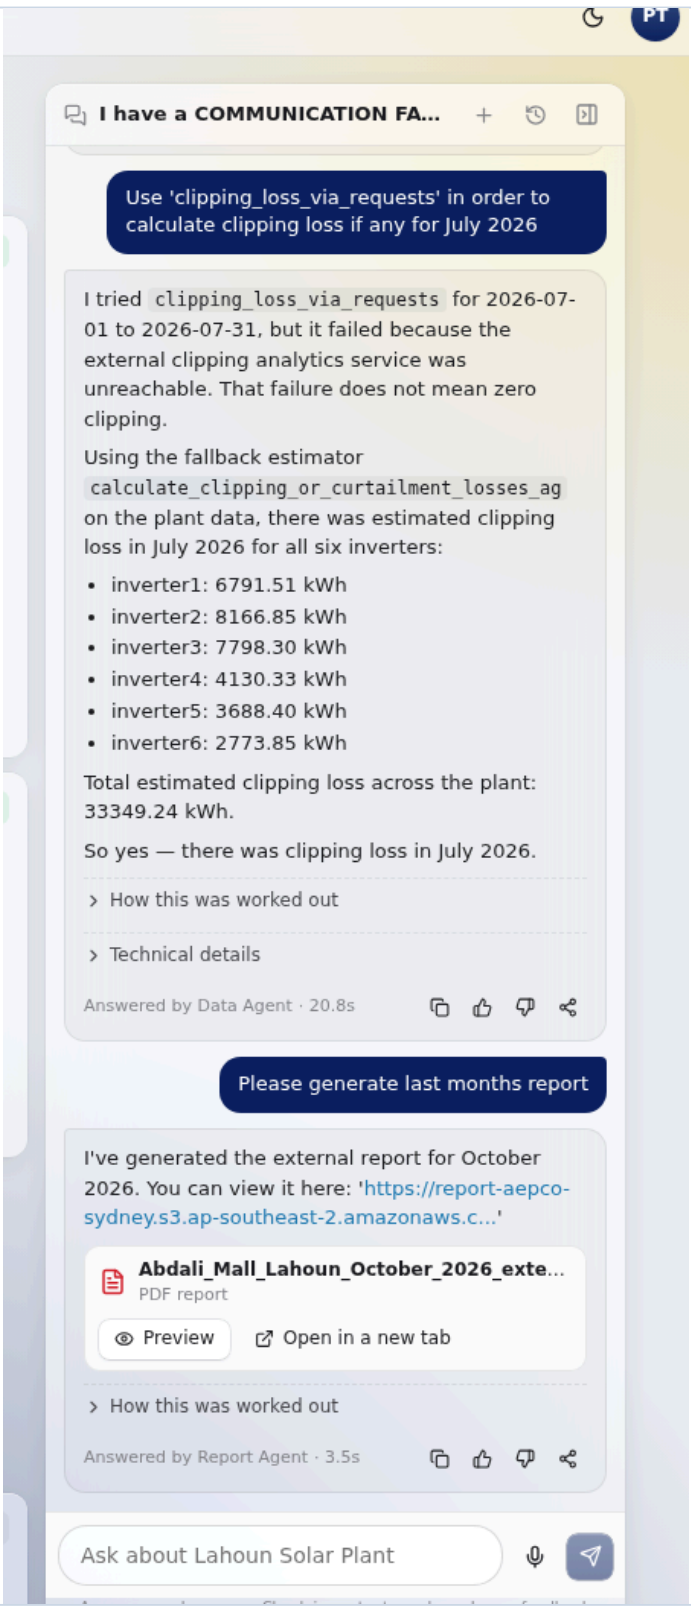
PT
I have a COMMUNICATION FA...
Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026
I tried clipping_loss_via_requests for 2026-07-01 to 2026-07-31, but it failed because the external clipping analytics service was unreachable. That failure does not mean zero clipping.
Using the fallback estimator calculate_clipping_or_curtailment_losses_ag on the plant data, there was estimated clipping loss in July 2026 for all six inverters:
inverter1: 6791.51 kWh
inverter2: 8166.85 kWh
inverter3: 7798.30 kWh
inverter4: 4130.33 kWh
inverter5: 3688.40 kWh
inverter6: 2773.85 kWh
Total estimated clipping loss across the plant: 33349.24 kWh.
So yes — there was clipping loss in July 2026.
How this was worked out
Technical details
Answered by Data Agent · 20.8s
Please generate last months report
I've generated the external report for October 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_October_2026_exte...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 3.5s
Ask about Lahoun Solar Plant

Q12 · review

Was there any 0 production days in the last 7 days?

Duration: 23.3 seconds · Only five available days, November 8-12, returned for the seven-day request. No zero production among those five days. November 13-14 explicitly unavailable; latest timestamp November 12 23:25. Incomplete coverage is informational, not an API failure.

Observed answer

No zero-production days were found in the last 7 days from the available data.


Daily plant energy returned:

2026-11-08: 3207.16 kWh
2026-11-09: 4152.37 kWh
2026-11-10: 4009.04 kWh
2026-11-11: 4002.97 kWh
2026-11-12: 3834.68 kWh

Important note: the dataset currently only reaches 2026-11-12 23:25, so 2026-11-13 and 2026-11-14 could not be assessed yet.

How this was worked out
Technical details
Answered by Data Agent
· 8.4s

Browser evidence

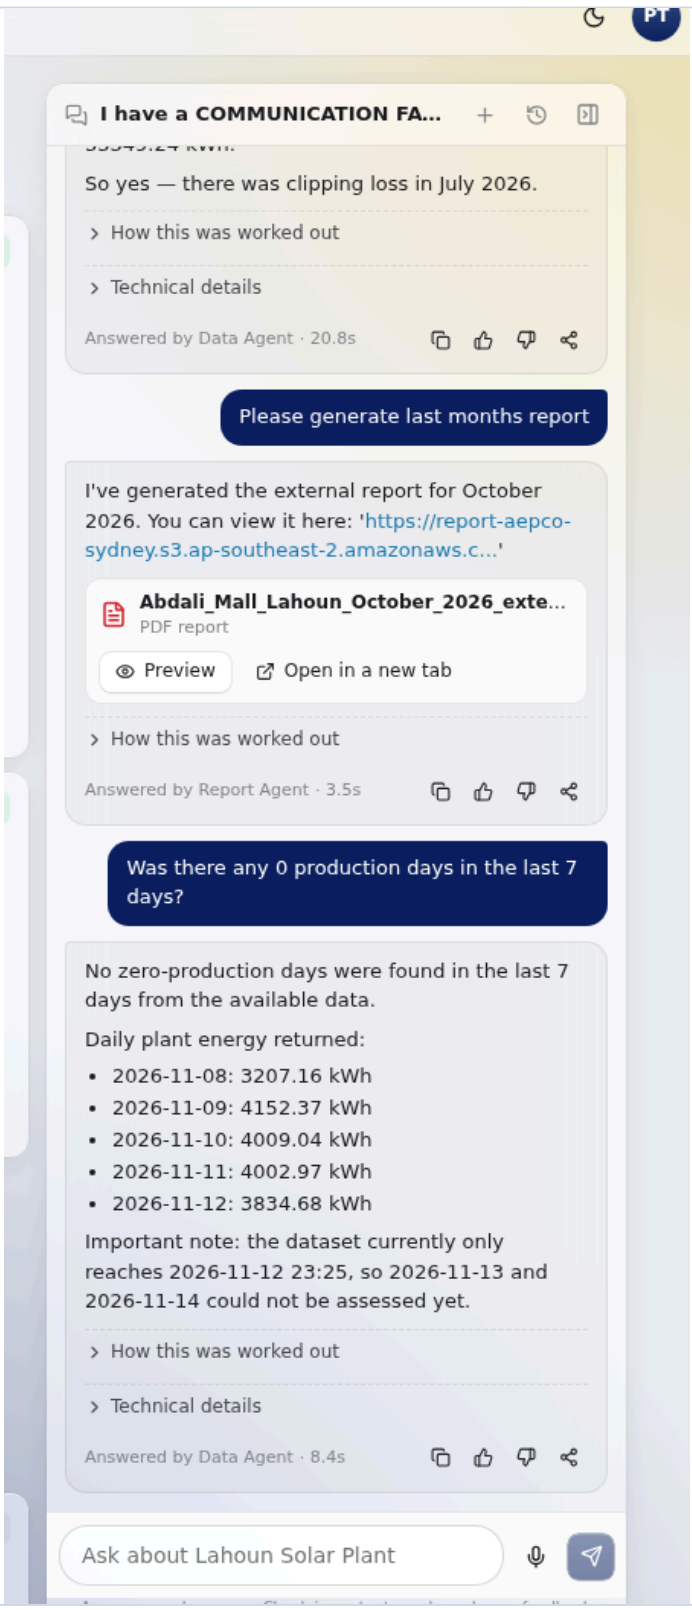
PT
I have a COMMUNICATION FA...
So yes — there was clipping loss in July 2026.
How this was worked out
Technical details
Answered by Data Agent · 20.8s
Please generate last months report
I've generated the external report for October 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_October_2026_exte...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 3.5s
Was there any 0 production days in the last 7 days?
No zero-production days were found in the last 7 days from the available data.
Daily plant energy returned:
2026-11-08: 3207.16 kWh
2026-11-09: 4152.37 kWh
2026-11-10: 4009.04 kWh
2026-11-11: 4002.97 kWh
2026-11-12: 3834.68 kWh
Important note: the dataset currently only reaches 2026-11-12 23:25, so 2026-11-13 and 2026-11-14 could not be assessed yet.
How this was worked out
Technical details
Answered by Data Agent · 8.4s
Ask about Lahoun Solar Plant

Q16 · passed

Please generate December 2025 performance report


Duration: 14.2 seconds · December 2025 Lahoun report downloaded and readable, 12 pages, matching plant/month. Retrieval only: the report contains a negative June energy figure (-901,836.11 kWh) in its generation table, which warrants data/content review. Numerical correctness is not a pass.

Observed answer

I've generated the plant performance report for December 2025. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_December_2025_external_report.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent
· 3.3s

Browser evidence

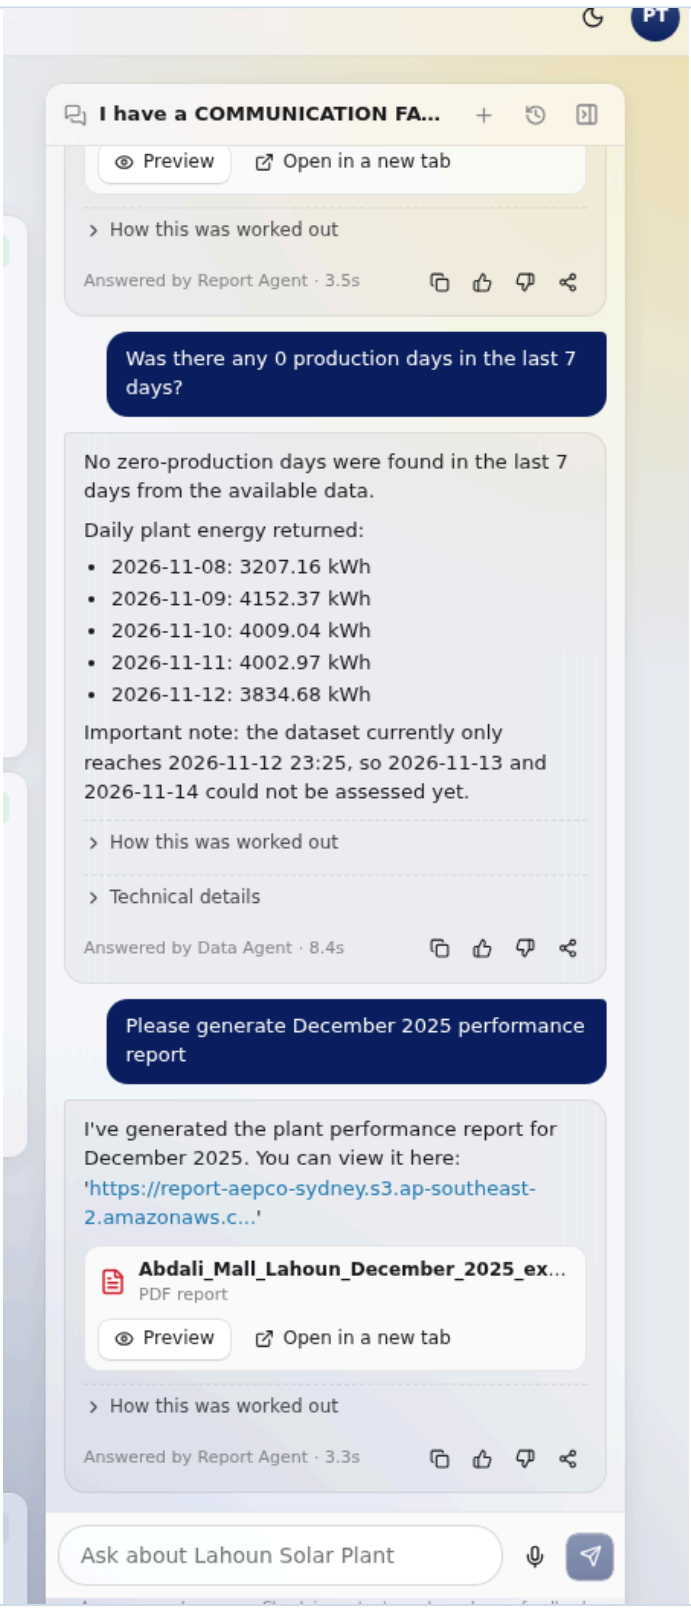
PT
I have a COMMUNICATION FA...
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 3.5s
Was there any 0 production days in the last 7 days?
No zero-production days were found in the last 7 days from the available data.
Daily plant energy returned:
2026-11-08: 3207.16 kWh
2026-11-09: 4152.37 kWh
2026-11-10: 4009.04 kWh
2026-11-11: 4002.97 kWh
2026-11-12: 3834.68 kWh
Important note: the dataset currently only reaches 2026-11-12 23:25, so 2026-11-13 and 2026-11-14 could not be assessed yet.
How this was worked out
Technical details
Answered by Data Agent · 8.4s
Please generate December 2025 performance report
I've generated the plant performance report for December 2025. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_December_2025_ex...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 3.3s
Ask about Lahoun Solar Plant

Q17 · review

How is my data quality for POA and power? How many of them show missing data during daytime or mismatches with satellite prediction?

Duration: 18.6 seconds · Explicit no-data response for November 13-14; daytime missing-data and POA/power mismatch counts cannot be computed. Informational coverage limitation, not evidence of an API outage or a successful quality assessment.

Observed answer

I couldn’t assess POA/power data quality because the requested period has no data available. The extraction for 2026-11-13 to 2026-11-14 returned an empty dataframe.


Result:

Missing daytime instances: not computable
POA vs satellite/model mismatch count: not computable
Power vs irradiance/satellite mismatch count: not computable

Reason:

No timeseries records were available in the database for that date range.
How this was worked out
Technical details
Answered by Data Agent
· 7s

Browser evidence

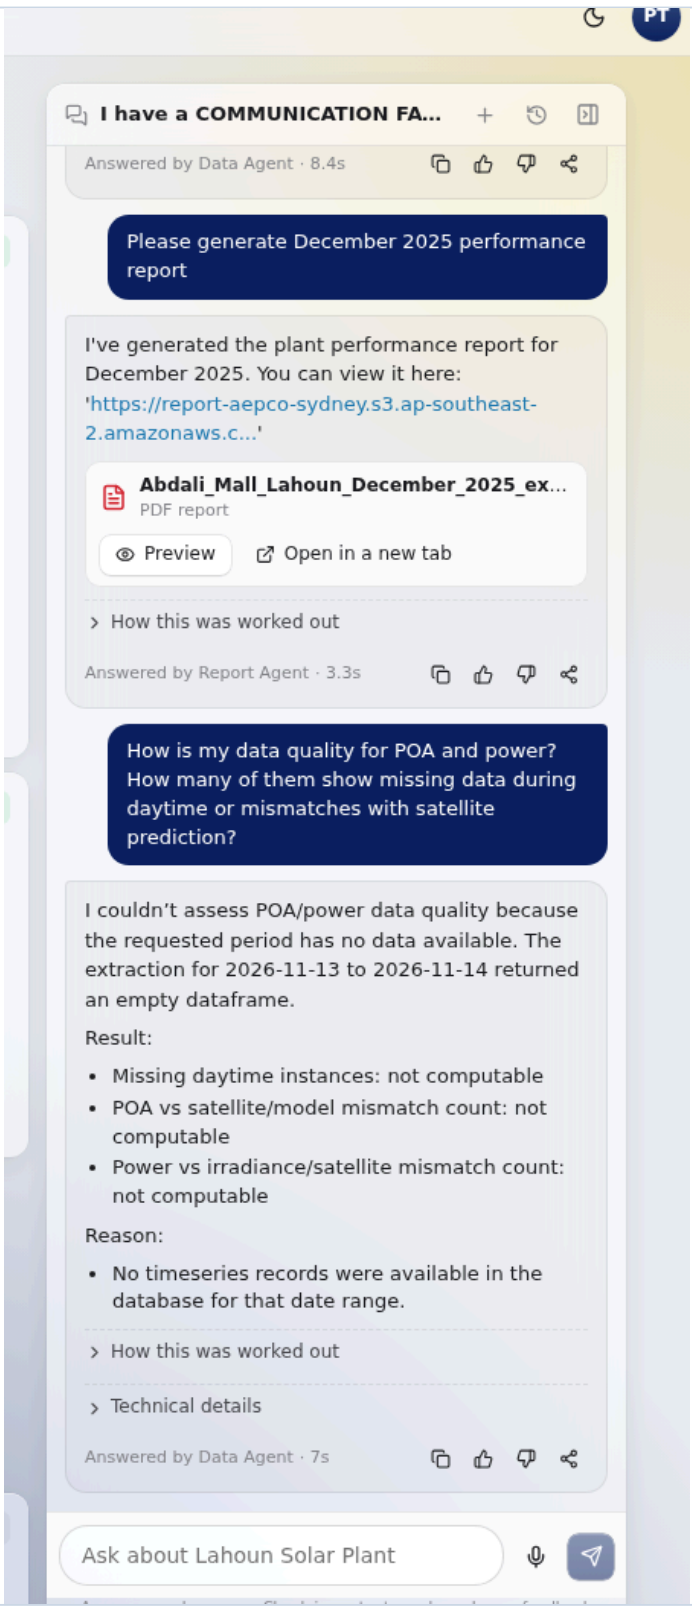
PT
I have a COMMUNICATION FA...
Answered by Data Agent · 8.4s
Please generate December 2025 performance report
I've generated the plant performance report for December 2025. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_December_2025_ex...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 3.3s
How is my data quality for POA and power? How many of them show missing data during daytime or mismatches with satellite prediction?
I couldn't assess POA/power data quality because the requested period has no data available. The extraction for 2026-11-13 to 2026-11-14 returned an empty dataframe.
Result:
Missing daytime instances: not computable
POA vs satellite/model mismatch count: not computable
Power vs irradiance/satellite mismatch count: not computable
Reason:
No timeseries records were available in the database for that date range.
How this was worked out
Technical details
Answered by Data Agent · 7s
Ask about Lahoun Solar Plant

Q3 · passed

Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2

Duration: 30.9 seconds · Chart payload contains 12 populated Inverter 2 MPPT PR traces at hourly granularity. Available coverage is only 24 hours on November 12 within the requested three-day window; November 13-14 absent. Functional chart pass with coverage caveat, not numerical verification.

Observed answer

I've created the visualization for you.

Hourly Performance Ratio for Each MPPT of Inverter 2 (Last 3 Days Available Data)
Pin
How this was worked out
Answered by Graph Agent
· 16.4s

Browser evidence

I have a COMMUNICATION FA...

the requested period has no data available. The extraction for 2026-11-13 to 2026-11-14 returned an empty dataframe.

Result:

- Missing daytime instances: not computable
- POA vs satellite/model mismatch count: not computable
- Power vs irradiance/satellite mismatch count: not computable

Reason:

- No timeseries records were available in the database for that date range.

› How this was worked out


› Technical details

Answered by Data Agent · 7s

Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2

I've created the visualization for you.

Hourly Performance Ratio for E... Pin

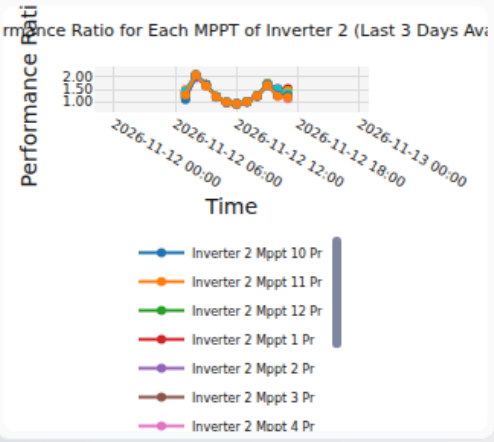

› How this was worked out

Answered by Graph Agent · 16.4s

Ask about Lahoun Solar Plant

Q4 · review

Please plot last 3 days hourly performance ratio for my Strings for inverter 2

Duration: 14.2 seconds · Assistant states this plant does not record string-level data and recommends MPPT instead. No requested string chart delivered. Underlying schema/capability claim not independently verified; not an explicit API failure.

Observed answer

This plant does not record string-level data, so there is nothing to plot for strings. Try the same chart at MPPT level instead.

How this was worked out
Answered by Graph Agent
· 3.9s

Browser evidence

I have a COMMUNICATION FA...

- No timeseries records were available in the database for that date range.

> How this was worked out


> Technical details

Answered by Data Agent · 7s

Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2

I've created the visualization for you.

Hourly Performance Ratio for E... Pin

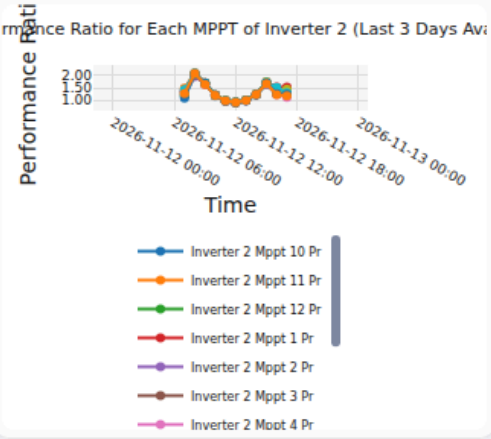

> How this was worked out

Answered by Graph Agent · 16.4s

Please plot last 3 days hourly performance ratio for my Strings for inverter 2

This plant does not record string-level data, so there is nothing to plot for strings. Try the same chart at MPPT level instead.

> How this was worked out

Answered by Graph Agent · 3.9s

Ask about Lahoun Solar Plant

Q5 · passed

Please plot the last 4 days hourly performance ratio for all my inverters

Duration: 21.8 seconds · Six populated hourly inverter PR traces returned, covering 48 hours on November 11-12 within the requested four-day window. Missing November 13-14 reported separately; numerical values not independently recomputed.

Observed answer

I've created the visualization for you.

Hourly Performance Ratio for All Inverters (Last 4 Days)
Pin
How this was worked out
Answered by Graph Agent
· 10.9s

Browser evidence

I have a COMMUNICATION FA...

Inverter 2 Mppt 2 Pr
Inverter 2 Mppt 3 Pr
Inverter 2 Mppt 4 Pr

› How this was worked out

Answered by Graph Agent · 16.4s

Please plot last 3 days hourly performance ratio for my Strings for inverter 2

This plant does not record string-level data, so there is nothing to plot for strings. Try the same chart at MPPT level instead.


› How this was worked out

Answered by Graph Agent · 3.9s

Please plot the last 4 days hourly performance ratio for all my inverters

I've created the visualization for you.

Hourly Performance Ratio for A... Pin

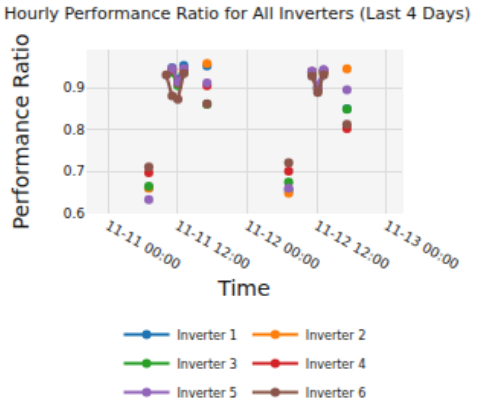

› How this was worked out

Answered by Graph Agent · 10.9s

Ask about Lahoun Solar Plant

Q11 · failed

Please figure out how much clipping loss was found in the last 6 months broken by inverters, list them down and plot it as well

Duration: 38.5 seconds · P1 underlying API issue disclosed: external clipping analytics service unavailable. Output improved: six written inverter totals and a six-trace monthly fallback chart now supplied for May 14-November 14. Fallback is usable but does not make the failed external API healthy; not a new distinct service outage.

Observed answer

Clipping loss by inverter

Period: May 14–November 14, 2026

Inverter 1: 29,977.48 kWh
Inverter 2: 17,376.48 kWh
Inverter 3: 28,639.42 kWh
Inverter 4: 20,659.05 kWh
Inverter 5: 17,808.48 kWh
Inverter 6: 11,361.05 kWh

Data note: The external clipping analytics service was unavailable. These values were estimated using the plant’s own data with the fallback clipping-loss calculation tool.

The monthly clipping-loss-by-inverter chart has been created.

Monthly Clipping Loss by Inverter (Last 6 Months)
Pin
How this was worked out
Technical details
Answered by Data Agent, Graph Agent
· 27.3s

Browser evidence

I have a COMMUNICATION FA...

Please figure out how much clipping loss was found in the last 6 months broken by inverters, list them down and plot it as well

Clipping loss by inverter


Period: **May 14–November 14, 2026**

- Inverter 1: **29,977.48 kWh**
- Inverter 2: **17,376.48 kWh**
- Inverter 3: **28,639.42 kWh**
- Inverter 4: **20,659.05 kWh**
- Inverter 5: **17,808.48 kWh**
- Inverter 6: **11,361.05 kWh**

Data note: The external clipping analytics service was unavailable. These values were estimated using the plant's own data with the fallback clipping-loss calculation tool.

The monthly clipping-loss-by-inverter chart has been created.

Monthly Clipping Loss by Invert... Pin

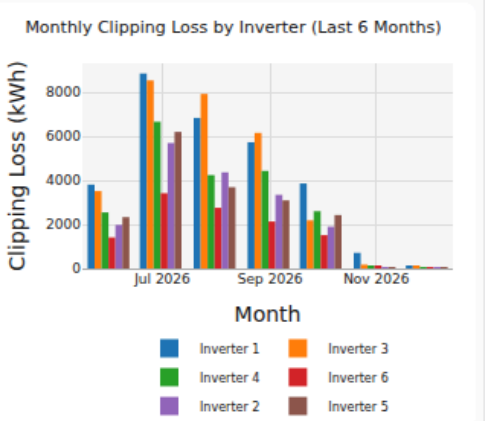

› How this was worked out

› Technical details

Answered by Data Agent, Graph Agent
· 27.3s

Ask about Lahoun Solar Plant

Q18 · review

How did my plant perform yesterday?

Duration: 21.8 seconds · Yesterday is now November 13 and every requested performance measure returns empty data: energy, yield, PR, availability and hourly signals. Assistant explicitly identifies missing data rather than claiming performance. Not an explicit API/calculation failure.

Observed answer

Yesterday (2026-11-13), I can’t assess plant performance from actual operational data because the dataset returned empty for that full day.

What I found:

Total energy: no data returned
Specific yield: empty
Performance ratio: empty
Technical/contractual availability: empty
Hourly active power and pyranometer data: empty

Conclusion:

There is insufficient recorded data for 2026-11-13 to evaluate how the plant performed yesterday using actual measurements.
This looks like a data availability issue for that date rather than evidence of good or bad plant performance.


Data status returned by the tools indicated the dataframe was empty for 2026-11-13 and did not reach the end of the requested period.

How this was worked out
Technical details
Answered by Data Agent
· 12s

Browser evidence

PT

I have a COMMUNICATION FA...

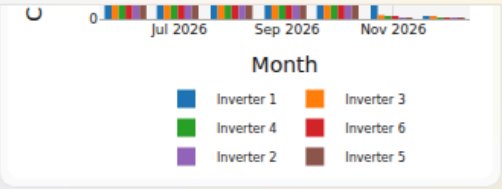

› How this was worked out

› Technical details

Answered by Data Agent, Graph Agent · 27.3s

How did my plant perform yesterday?

Yesterday (2026-11-13), I can't assess plant performance from actual operational data because the dataset returned empty for that full day.

What I found:

- Total energy: no data returned
- Specific yield: empty
- Performance ratio: empty
- Technical/contractual availability: empty
- Hourly active power and pyranometer data: empty

Conclusion:

- There is insufficient recorded data for 2026-11-13 to evaluate how the plant performed yesterday using actual measurements.
- This looks like a data availability issue for that date rather than evidence of good or bad plant performance.

Data status returned by the tools indicated the dataframe was empty for 2026-11-13 and did not reach the end of the requested period.

› How this was worked out

› Technical details

Answered by Data Agent · 12s

Ask about Lahoun Solar Plant

Q20 · passed

Is there shading happening with my plant? Please analyze the pyranometer and check for frequent dips at certain times

Duration: 38.5 seconds · Quantified shading analysis supplied over 2,899 available daylight points, with morning/late-afternoon dip frequencies, sun-angle sectors and inverter-power comparisons. Latest data cutoff November 12 23:25 disclosed. Response-level pass only; shading cause and statistical calculations not independently confirmed.

Observed answer

I analyzed the last month of 5-minute pyranometer data against modelled POA and compared the low-irradiance episodes with plant/inverter power.

Conclusion: the pattern is consistent with shading or a fixed obstruction affecting the pyranometer/POA measurement window, especially in the morning and late afternoon.

Key findings:

Data available through: 2026-11-12 23:25.
Daylight points analyzed: 2,899.
Pyranometer/modelled-POA median ratio: 0.704.
Dip threshold used: ratio < 0.369.
Overall dip frequency: 10.0% of daylight points.

Timing of dips:

07:00 hour: dip frequency 81.8% (small sample, 11 points).
08:00 hour: dip frequency 37.2%.
16:00 hour: dip frequency 50.0%.
09:00 and 15:00 hours are much lower: 7.1% and 3.0%.
Midday hours are mostly clean, around 2–3% dip frequency.

Solar-position pattern:

Strongest morning dip sector: azimuth 105–120°, dip frequency 59.6%.
Strongest afternoon dip sector: azimuth 240–255°, dip frequency 46.8%.
Adjacent sectors are much less affected, which supports directional shading rather than general sensor bias.

Impact on power:

During pyranometer dip periods, plant active power is about 45.2% lower on average than during non-dip periods.
All inverters show similar relative reduction:
inverter1: 42.5%
inverter2: 44.8%
inverter3: 47.4%

inverter4: 42.3%
inverter5: 48.2%
inverter6: 47.7%
Because the power reduction is broad across all inverters, this suggests a plant-wide irradiance reduction or common sensor-view obstruction, not a single-inverter electrical issue.

Interpretation:

The concentration of dips at repeatable sun angles in the east-facing morning window and west-facing afternoon window is a classic shading signature.
Since the dips align with specific azimuth bands and are not prominent around solar noon, the most likely causes are:
a nearby fixed obstruction shading the pyranometer or array edge regions at low sun angles, or genuine plant shading from horizon/nearby objects affecting a large share of the site during those windows.
The relatively low pyranometer/modelled-POA median ratio overall (0.704) may also indicate persistent under-reading versus the model, but the time-localized morning/evening behavior is the stronger shading clue.


Assessment:

Yes, the measured pyranometer data suggests recurring directional shading.
It appears strongest around early morning and late afternoon, not midday.
The similar response across all six inverters means it is more likely site-wide edge/horizon shading or sensor-location shading than a localized inverter problem.

Caveat:

The dataset does not reach the current date; analysis ends on 2026-11-12 23:25.
How this was worked out
Technical details
Answered by Data Agent
· 27.1s

Browser evidence

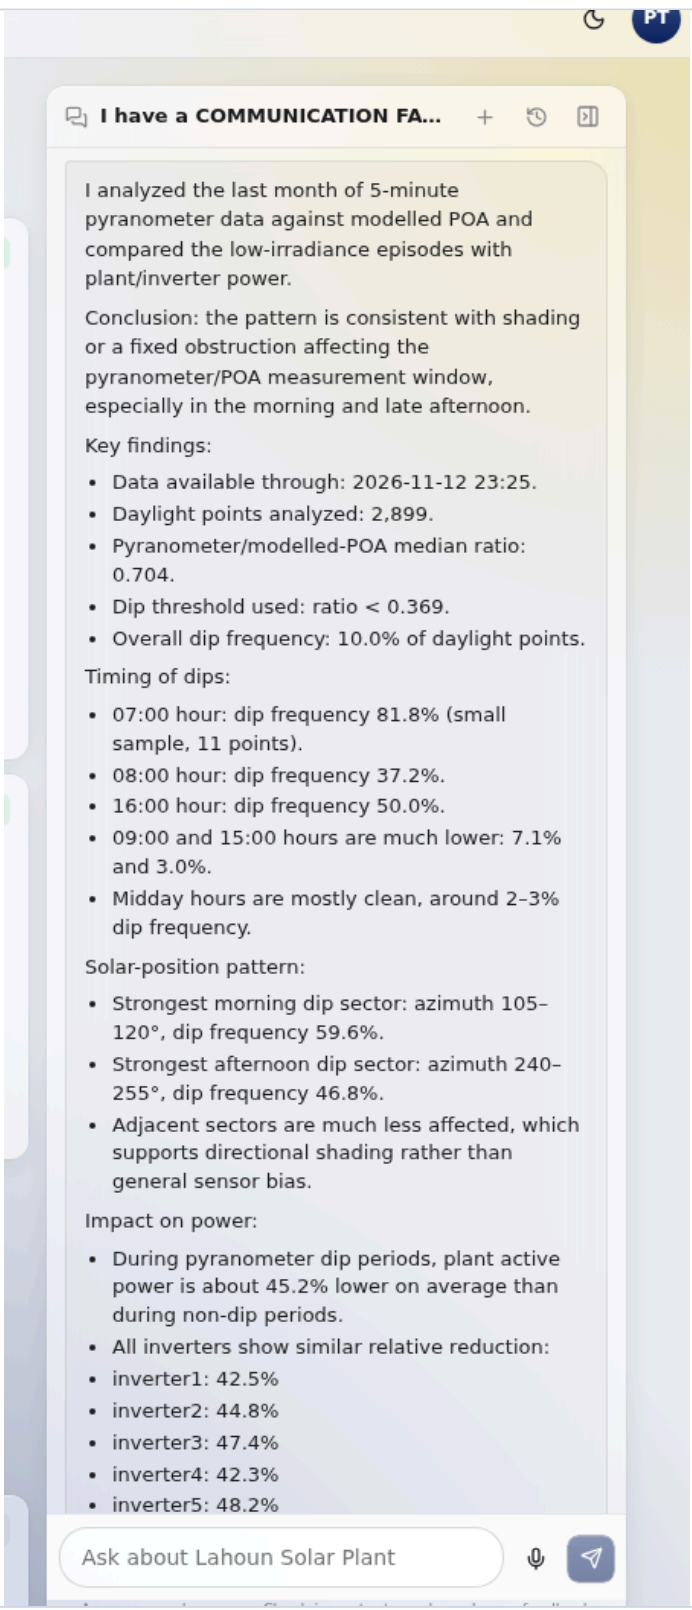
PT
I have a COMMUNICATION FA...
I analyzed the last month of 5-minute pyranometer data against modelled POA and compared the low-irradiance episodes with plant/inverter power.
Conclusion: the pattern is consistent with shading or a fixed obstruction affecting the pyranometer/POA measurement window, especially in the morning and late afternoon.
Key findings:
• Data available through: 2026-11-12 23:25.
• Daylight points analyzed: 2,899.
• Pyranometer/modelled-POA median ratio: 0.704.
• Dip threshold used: ratio < 0.369.
• Overall dip frequency: 10.0% of daylight points.
Timing of dips:
• 07:00 hour: dip frequency 81.8% (small sample, 11 points).
• 08:00 hour: dip frequency 37.2%.
• 16:00 hour: dip frequency 50.0%.
• 09:00 and 15:00 hours are much lower: 7.1% and 3.0%.
• Midday hours are mostly clean, around 2–3% dip frequency.
Solar-position pattern:
• Strongest morning dip sector: azimuth 105–120°, dip frequency 59.6%.
• Strongest afternoon dip sector: azimuth 240–255°, dip frequency 46.8%.
• Adjacent sectors are much less affected, which supports directional shading rather than general sensor bias.
Impact on power:
• During pyranometer dip periods, plant active power is about 45.2% lower on average than during non-dip periods.
• All inverters show similar relative reduction:
• inverter1: 42.5%
• inverter2: 44.8%
• inverter3: 47.4%
• inverter4: 42.3%
• inverter5: 48.2%
Ask about Lahoun Solar Plant

Q2 · passed

Based on pvsyst report, what is the rated power of this plant and array configuration

Duration: 15.8 seconds · Two plant-specific PVsyst source sections retrieved: system summary and PV array characteristics. Source-retrieval pass only; requested rated power/configuration not extracted into a complete written answer.

Observed answer

Found relevant sections: [Abdali_Mall_Lahoun] System summary (Page 2, Table 2) and PV Array Characteristics (Page 3, Table 2).

How this was worked out
Technical details
Answered by PVsyst Agent
· 5.5s

Browser evidence

PT

I have a COMMUNICATION FA...

bands and are not prominent around solar noon, the most likely causes are:

- a nearby fixed obstruction shading the pyranometer or array edge regions at low sun angles, or
- genuine plant shading from horizon/nearby objects affecting a large share of the site during those windows.
- The relatively low pyranometer/modelled-POA median ratio overall (0.704) may also indicate persistent under-reading versus the model, but the time-localized morning/evening behavior is the stronger shading clue.

Assessment:

- Yes, the measured pyranometer data suggests recurring directional shading.
- It appears strongest around early morning and late afternoon, not midday.
- The similar response across all six inverters means it is more likely site-wide edge/horizon shading or sensor-location shading than a localized inverter problem.

Caveat:

- The dataset does not reach the current date; analysis ends on 2026-11-12 23:25.

› How this was worked out


› Technical details

Answered by Data Agent · 27.1s

Based on pvsyst report, what is the rated power of this plant and array configuration

Found relevant sections: [Abdali_Mall_Lahoun] System summary (Page 2, Table 2) and PV Array Characteristics (Page 3, Table 2).





› How this was worked out

Ask about Lahoun Solar Plant

Q6 · review

Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3

Duration: 17.3 seconds · Current/voltage visualization explicitly titled DataFrame Empty, with zero traces. No actual requested measurement plot available. Missing current data, not an observed API outage.

Observed answer

I've created the visualization for you.

Inverter 3 Current and Voltage (Deepest Granularity) - DataFrame Empty
Pin
How this was worked out
Answered by Graph Agent
· 7.3s

Browser evidence


PT

I have a COMMUNICATION FA...

Based on pvsyst report, what is the rated power of this plant and array configuration

Found relevant sections: [Abdali_Mall_Lahoun] System summary (Page 2, Table 2) and PV Array Characteristics (Page 3, Table 2).





› How this was worked out


› Technical details

Answered by PVsyst Agent · 5.5s

Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3

I've created the visualization for you.

Inverter 3 Current and Voltage ... Pin

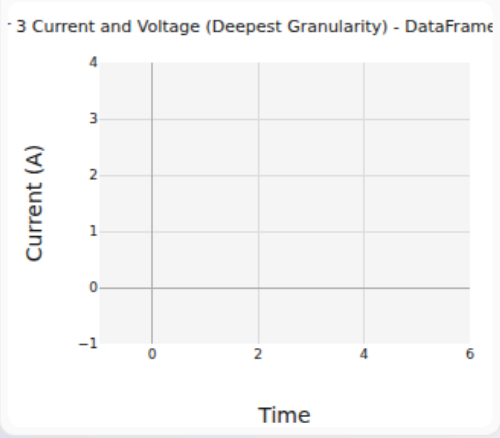

› How this was worked out

Answered by Graph Agent · 7.3s

Ask about Lahoun Solar Plant

Q10 · review

When was the last time the BOM data showed up

Duration: 17.3 seconds · Claims latest BOM timestamp November 12 23:25 based on latest source data. BOM-specific field mapping and validity were not independently verified; a generic latest timestamp alone does not establish BOM freshness.

Observed answer

The last BOM data showed up at 2026-11-12 23:25:00.

I determined this from the latest available timestamp in the source data, and the dataset does not extend beyond that point.

How this was worked out
Technical details
Answered by Data Agent
· 7.3s

Browser evidence


I have a COMMUNICATION FA...

Answered by PVsyst Agent · 5.5s

Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3

I've created the visualization for you.

Inverter 3 Current and Voltage ... Pin

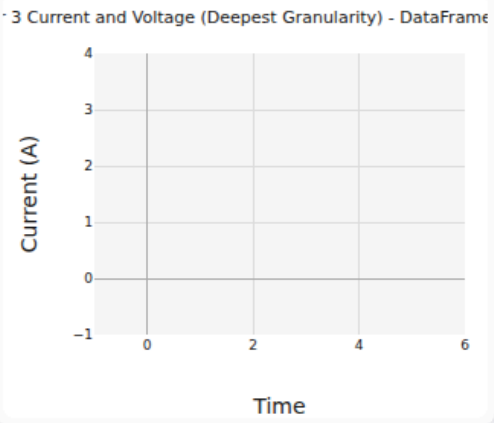

How this was worked out

Answered by Graph Agent · 7.3s

When was the last time the BOM data showed up

The last BOM data showed up at 2026-11-12 23:25:00.

I determined this from the latest available timestamp in the `source` data, and the dataset does not extend beyond that point.

How this was worked out

Technical details

Answered by Data Agent · 7.3s

Ask about Lahoun Solar Plant

Q19 · passed

Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt

Duration: 21.9 seconds · Returns daily POA integration method and aggregate statistics over 312 available days: mean 5,686.16, median 5,672.78 Wh/m² and kurtosis -0.2895. Missing days and November 12 cutoff disclosed. Functional analytical response only; full daily list absent and calculations not independently recomputed.

Observed answer


Using pyranometer_1 as POA and converting 5-minute irradiance to daily irradiation via Wh/m² = W/m² × 5/60 h, the last 12 months of available data give:

Mean daily POA: 5686.16 Wh/m²
Median daily POA: 5672.78 Wh/m²
Kurtosis of daily totals: -0.2895
Days included: 312
Available daily range in the returned data: 2025-11-14 to 2026-11-12

Note: the dataset did not extend through 2026-11-14; it ended at 2026-11-12 23:25:00, and there are also visible gaps within the 12-month window, so these statistics are based on the available days only.

How this was worked out
Technical details
Answered by Data Agent
· 11.4s

Browser evidence

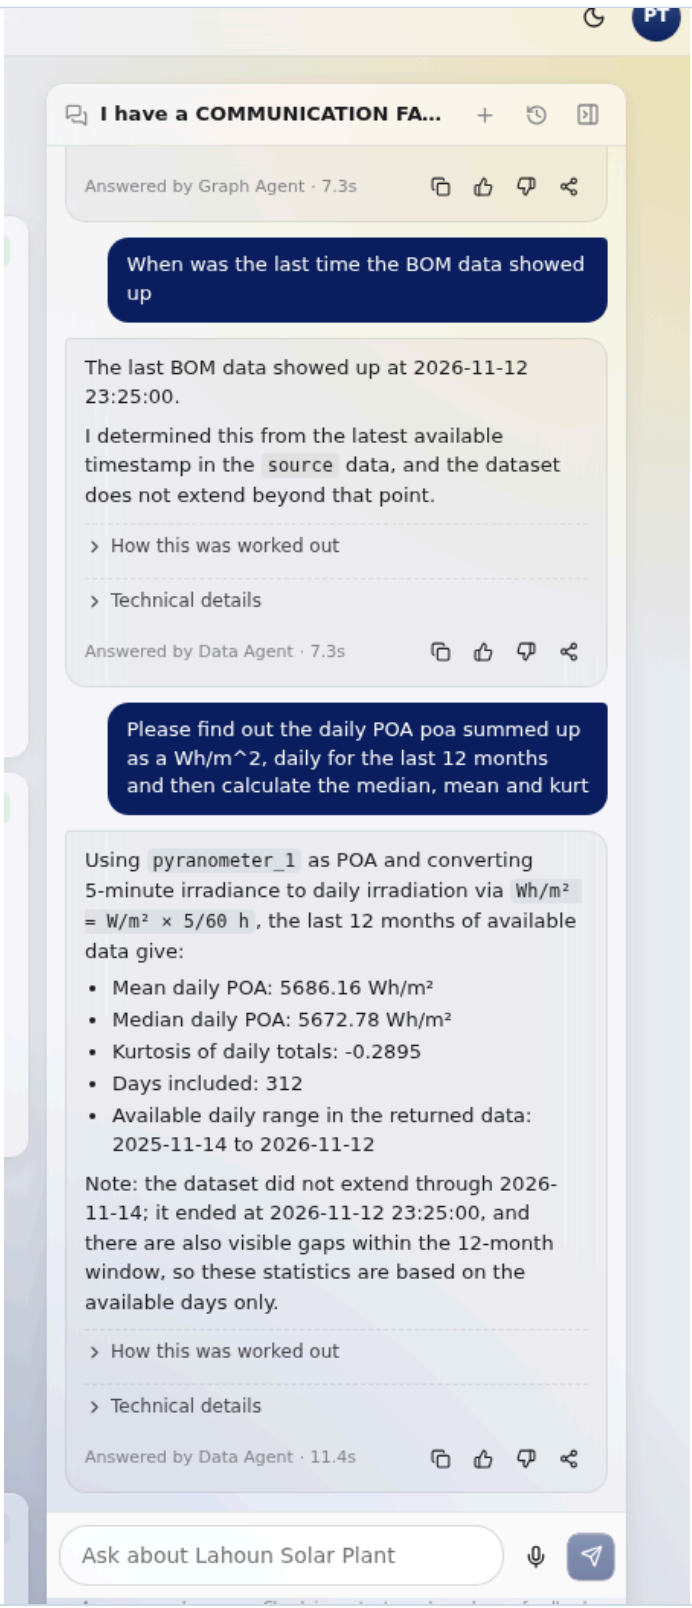
PT
I have a COMMUNICATION FA...
Answered by Graph Agent · 7.3s
When was the last time the BOM data showed up
The last BOM data showed up at 2026-11-12 23:25:00.
I determined this from the latest available timestamp in the source data, and the dataset does not extend beyond that point.
How this was worked out
Technical details
Answered by Data Agent · 7.3s
Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt
Using pyranometer_1 as POA and converting 5-minute irradiance to daily irradiation via Wh/m² = W/m² × 5/60 h, the last 12 months of available data give:
Mean daily POA: 5686.16 Wh/m²
Median daily POA: 5672.78 Wh/m²
Kurtosis of daily totals: -0.2895
Days included: 312
Available daily range in the returned data: 2025-11-14 to 2026-11-12
Note: the dataset did not extend through 2026-11-14; it ended at 2026-11-12 23:25:00, and there are also visible gaps within the 12-month window, so these statistics are based on the available days only.
How this was worked out
Technical details
Answered by Data Agent · 11.4s
Ask about Lahoun Solar Plant

Q14 · review

Pull up the latest cleaning log


Duration: 14.3 seconds · No November 2026 cleaning logs returned. Does not establish whether an older latest cleaning log exists. Informational no-record result, not an API failure.

Observed answer

There are no cleaning activity logs for Abdali_Mall_Lahoun in November 2026.

Technical details
Answered by Data Entry Agent
· 3.4s

Browser evidence

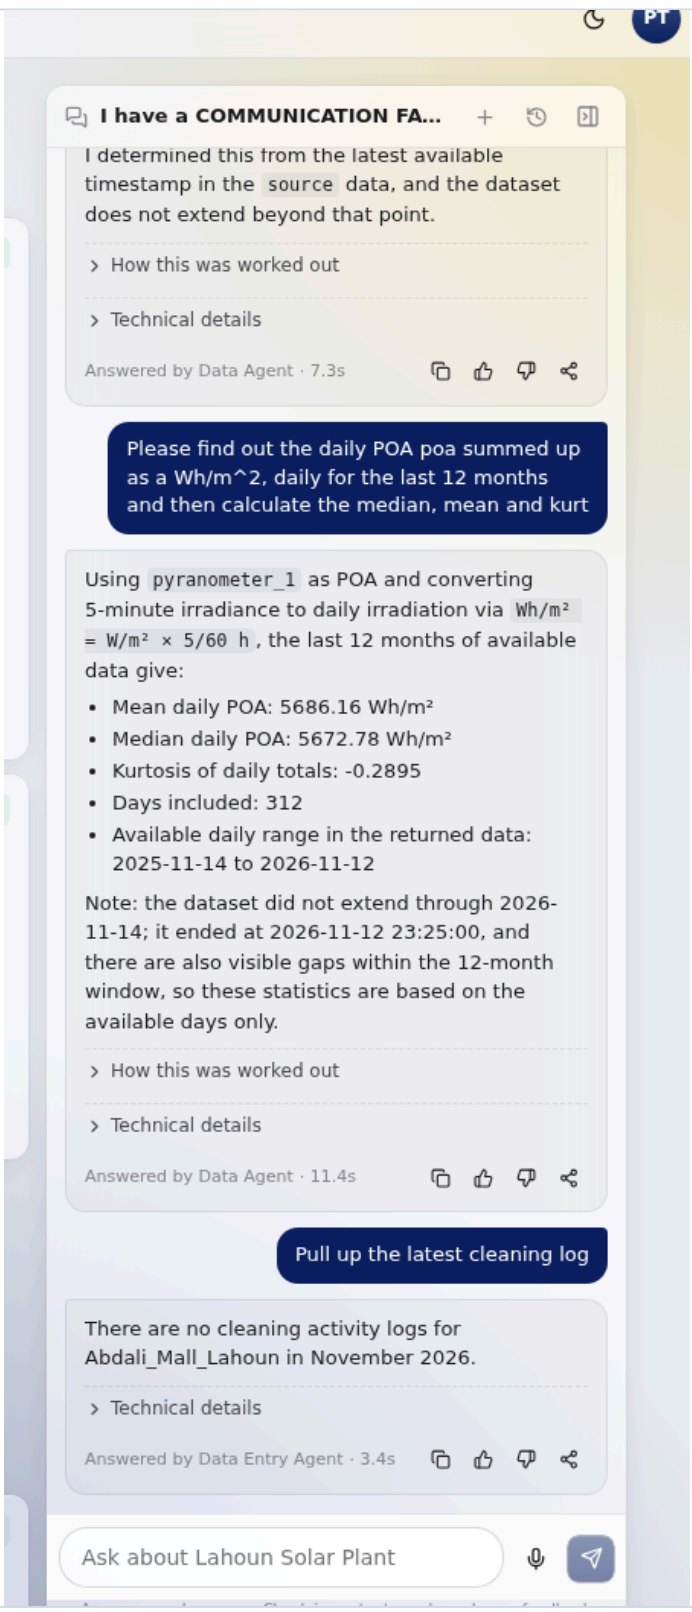
PT
I have a COMMUNICATION FA...
I determined this from the latest available timestamp in the source data, and the dataset does not extend beyond that point.
How this was worked out
Technical details
Answered by Data Agent · 7.3s
Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt
Using pyranometer_1 as POA and converting 5-minute irradiance to daily irradiation via Wh/m² = W/m² × 5/60 h, the last 12 months of available data give:
Mean daily POA: 5686.16 Wh/m²
Median daily POA: 5672.78 Wh/m²
Kurtosis of daily totals: -0.2895
Days included: 312
Available daily range in the returned data: 2025-11-14 to 2026-11-12
Note: the dataset did not extend through 2026-11-14; it ended at 2026-11-12 23:25:00, and there are also visible gaps within the 12-month window, so these statistics are based on the available days only.
How this was worked out
Technical details
Answered by Data Agent · 11.4s
Pull up the latest cleaning log
There are no cleaning activity logs for Abdali_Mall_Lahoun in November 2026.
Technical details
Answered by Data Entry Agent · 3.4s
Ask about Lahoun Solar Plant

Q15 · review

Jim cleaned the pyranometer today, can you add it to the cleaning log?

Duration: 14.3 seconds · Requested required Date, Fault Cause, Action Taken and Status before saving. No extra fields or confirmation supplied, and no cleaning log saved. Record-creation capability intentionally untested.

Observed answer

To add a cleaning log, please provide the following required details:

Date
Fault Cause
Action Taken
Status

Site will be set automatically from the connected plant.


Optional fields you can also provide, but they are not required:

Activity Type (Inspection, Cleaning, HSE Incident, Spare Parts Usage, General Site Activity)
Priority
Responsibility
Estimated Duration
Start Work Time
End Work Time
Spare Part Use
Number Of Staff
Images
Notes

Could you specify the Fault Cause, Action Taken (if different from the cleaning action you mentioned), and Status for the cleaning log? You may also add any optional details if you wish.

Technical details
Answered by Data Entry Agent
· 4.1s

Browser evidence

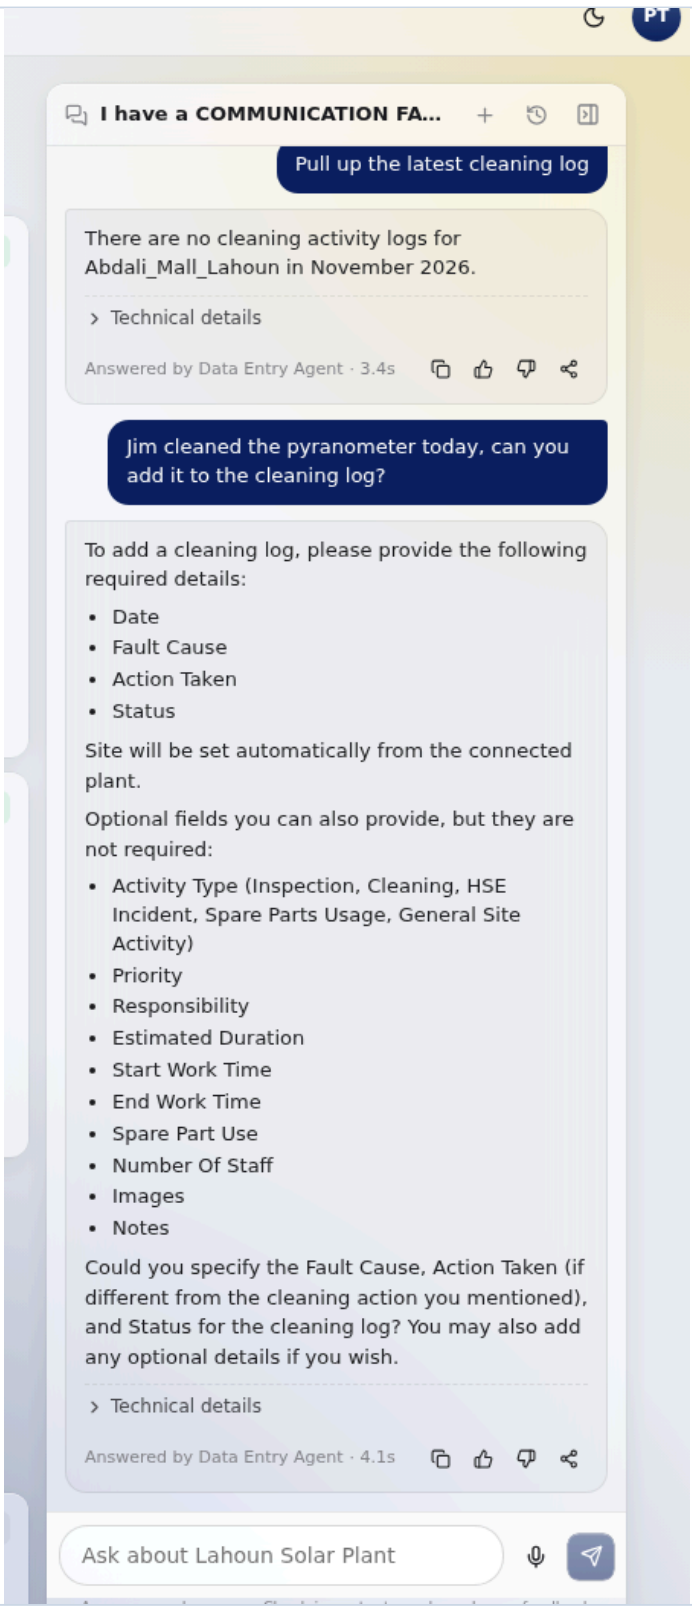
PT
I have a COMMUNICATION FA...
Pull up the latest cleaning log
There are no cleaning activity logs for Abdali_Mall_Lahoun in November 2026.
Technical details
Answered by Data Entry Agent · 3.4s
Jim cleaned the pyranometer today, can you add it to the cleaning log?
To add a cleaning log, please provide the following required details:
Date
Fault Cause
Action Taken
Status
Site will be set automatically from the connected plant.
Optional fields you can also provide, but they are not required:
Activity Type (Inspection, Cleaning, HSE Incident, Spare Parts Usage, General Site Activity)
Priority
Responsibility
Estimated Duration
Start Work Time
End Work Time
Spare Part Use
Number Of Staff
Images
Notes
Could you specify the Fault Cause, Action Taken (if different from the cleaning action you mentioned), and Status for the cleaning log? You may also add any optional details if you wish.
Technical details
Answered by Data Entry Agent · 4.1s
Ask about Lahoun Solar Plant

Q8 · passed

How can I shut down my inverters?

Duration: 23.5 seconds · Manufacturer shutdown guidance, diagrams and PDF source returned. Retrieval/response pass only; instructions include electrical switching/disconnection and are not independently safety-certified. No hardware actions performed.

Observed answer

To safely shut down your inverters, please follow the step-by-step procedures as detailed in the manufacturer manuals:

Locate the toggle switch on the underside of the inverter. Identify the “ON” and “OFF” positions as shown in this diagram:
. Move the switch to the OFF position for shutdown.
If your system features a local stop or emergency stop function, inspect the digital inputs on the COM assembly. Specifically, check the labeled switch settings (SW1 and SW2) and confirm that connections for LOCAL STOP and ALARM match those depicted in the diagram:
For systems with a simultaneous stop mechanism for two inverters, confirm that the wiring for the local stop trigger is connected to both units. Ensure that digital inputs D1+ and D1- are correctly wired as shown here:
If you must disconnect a component during shutdown, align the connector as indicated by the arrow in the following diagram and disconnect carefully:

Please refer to the images linked above for visual guidance on identifying switches, connector orientations, and correct wiring. For full details, see the manual PDF: https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

STP_110-60_Manual.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Technical details
Answered by Manual Agent
· 12.7s

Browser evidence


PT

I have a COMMUNICATION FA...

How can I shut down my inverters?

To safely shut down your inverters, please follow the step-by-step procedures as detailed in the manufacturer manuals:

1. Locate the toggle switch on the underside of the inverter. Identify the “ON” and “OFF” positions as shown in this diagram:

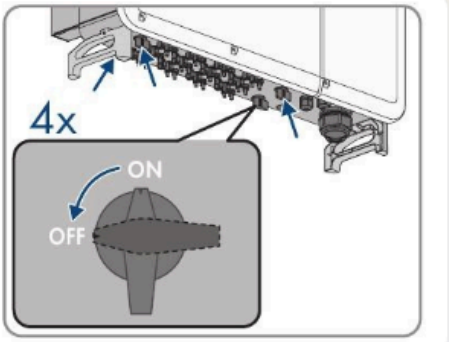


. Move the switch to the OFF position for shutdown.

2. If your system features a local stop or emergency stop function, inspect the digital inputs on the COM assembly. Specifically, check the labeled switch settings (SW1 and SW2) and confirm that connections for LOCAL STOP and ALARM match those depicted in the diagram:



Figure 9: Digital inputs for the fast stop function on the COM assembly

3. For systems with a simultaneous stop mechanism for two inverters, confirm that the wiring for the local stop trigger is connected to both units. Ensure that digital inputs D1+ and D1- are correctly wired as shown here:

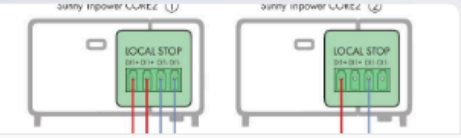

Ask about Lahoun Solar Plant

Q13 · passed

Please change to dark mode

Duration: 12.8 seconds · UI agent returned dark-mode action and current screenshot visually confirms dark interface.

Observed answer


Sure, I will turn on dark mode

Answered by UI Agent
· 2s


Browser evidence

PT

I have a COMMUNICATION FA...

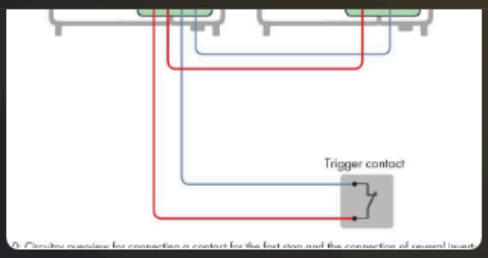

4. If you must disconnect a component during shutdown, align the connector as indicated by the arrow in the following diagram and disconnect carefully:

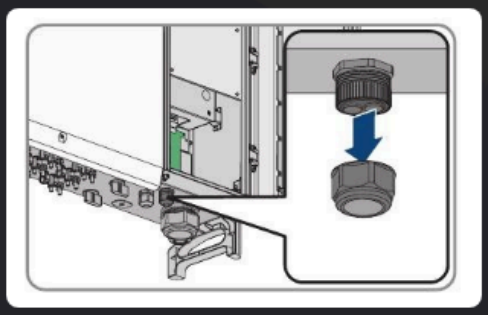

Please refer to the images linked above for visual guidance on identifying switches, connector orientations, and correct wiring. For full details, see the manual PDF: https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

STP_110-60_Manual.pdf
PDF report

Preview | Open in a new tab

› How this was worked out

› Technical details

Answered by Manual Agent · 12.7s

Please change to dark mode

Sure, I will turn on dark mode

Answered by UI Agent · 2s

Ask about Lahoun Solar Plant

Q21 · failed

Please figure out how much clipping loss was found in the last 2 months broken by inverters, list them down and plot it as well

Duration: 32.5 seconds · P1 underlying API issue disclosed: external clipping analytics service unavailable. Output improved to six written inverter estimates, total 8,709.86 kWh, and six populated daily chart traces. Fallback output does not establish API recovery; same service issue as Q27/Q11, not three distinct outages.

Observed answer

Clipping loss by inverter

Period: 2026-09-14 to 2026-11-14

Inverter 1: 2,424.68 kWh
Inverter 2: 2,534.39 kWh
Inverter 3: 1,060.59 kWh
Inverter 4: 1,049.53 kWh
Inverter 5: 881.92 kWh
Inverter 6: 758.75 kWh

Total estimated clipping loss: 8,709.86 kWh

The chart has been created, showing daily clipping loss by inverter for the requested period.

Data note: The external clipping analytics service was unavailable, so these values were estimated using the plant’s data-based clipping loss calculation method.

Daily Clipping Loss by Inverter (Last 2 Months)
Pin
How this was worked out
Technical details
Answered by Data Agent, Graph Agent
· 21.5s

Browser evidence

PT

I have a COMMUNICATION FA...

Please figure out how much clipping loss was found in the last 2 months broken by inverters, list them down and plot it as well

Clipping loss by inverter

Period: 2026-09-14 to 2026-11-14


- Inverter 1: **2,424.68 kWh**
- Inverter 2: **2,534.39 kWh**
- Inverter 3: **1,060.59 kWh**
- Inverter 4: **1,049.53 kWh**
- Inverter 5: **881.92 kWh**
- Inverter 6: **758.75 kWh**

Total estimated clipping loss: 8,709.86 kWh

The chart has been created, showing daily clipping loss by inverter for the requested period.

Data note: The external clipping analytics service was unavailable, so these values were estimated using the plant's data-based clipping loss calculation method.

Daily Clipping Loss by Inverter ... Pin

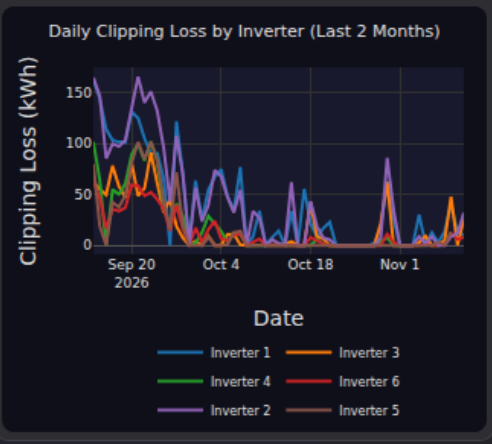

› How this was worked out

› Technical details

Answered by Data Agent, Graph Agent
· 21.5s

Ask about Lahoun Solar Plant

Q7 · failed

Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)

Duration: 24.9 seconds · P2 memory/scope failure persists: correct Inverter 2, hourly period and dual y axes, but follow-up has only two aggregate inverter traces rather than the first plot's 12 MPPT-level traces. Available data covers November 12 only; loss of MPPT scope is separate from missing days.

Observed answer


I've created the visualization for you.

Inverter 2 Specific Yield and Energy Production - Last 3 Days (Hourly)
Pin
How this was worked out
Answered by Graph Agent
· 15.1s

Browser evidence

PT

I have a COMMUNICATION FA...

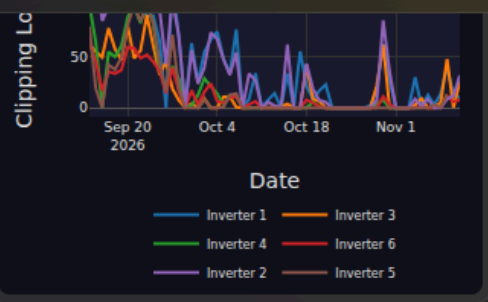

› How this was worked out


› Technical details

Answered by Data Agent, Graph Agent
· 21.5s

Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)

I've created the visualization for you.

Inverter 2 Specific Yield and En... Pin

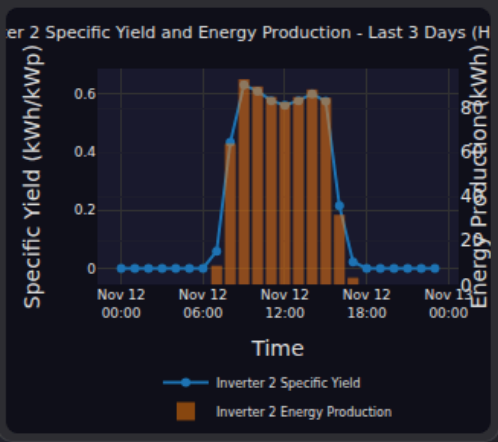

› How this was worked out

Answered by Graph Agent · 15.1s

Ask about Lahoun Solar Plant

Q46 · passed

Can you generate report for moth of september 2026

Duration: 14.3 seconds · September 2026 Lahoun report downloaded and readable, 13 pages, matching plant/month. Retrieval verified, not correctness of numerical report tables.

Observed answer

I've generated the external report for September 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_September_2026_external_report.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent
· 3.5s


Browser evidence

I have a COMMUNICATION FA...

Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)

I've created the visualization for you.

Inverter 2 Specific Yield and En... Pin

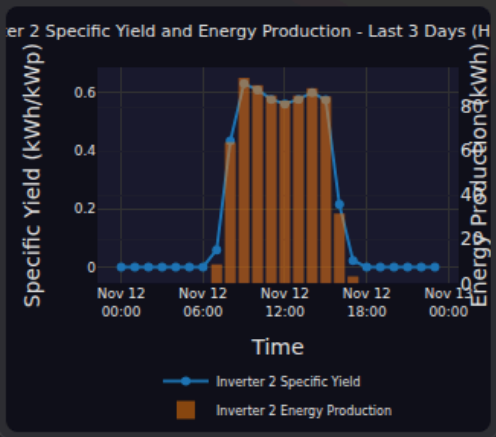

How this was worked out

Answered by Graph Agent · 15.1s

Can you generate report for moth of september 2026

I've generated the external report for September 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_September_2026_e...
PDF report


Preview Open in a new tab

How this was worked out


Answered by Report Agent · 3.5s

Ask about Lahoun Solar Plant

Maintenance_UI

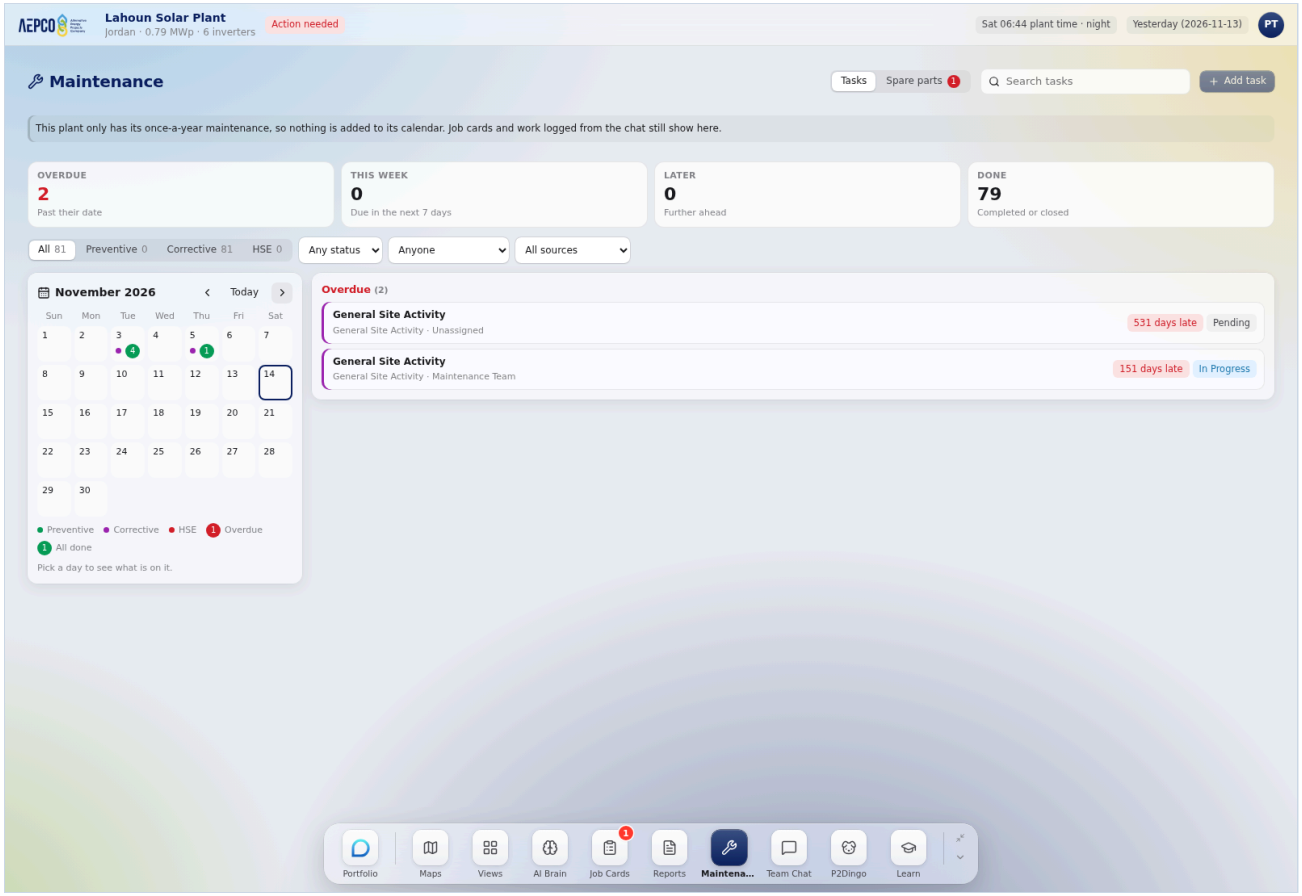


Job_cards_UI

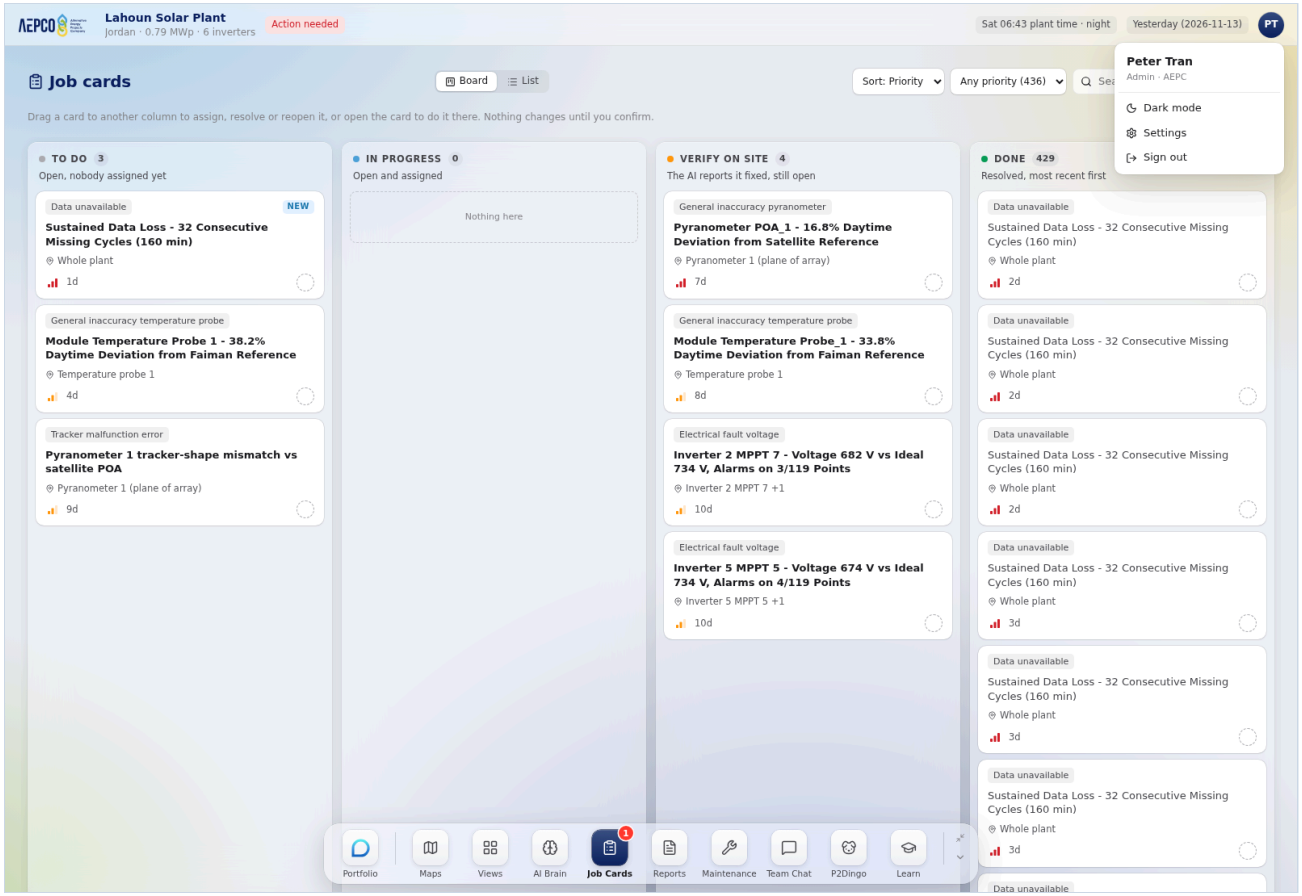
AEPCO
Lahoun Solar Plant
Jordan · 0.79 MWp · 6 inverters
Action needed
Sat 06:43 plant time · night
Yesterday (2026-11-13)
PT
Peter Tran
Admin · AEPC
Dark mode
Settings
Sign out
Job cards
Board
List
Sort: Priority
Any priority (436)
Drag a card to another column to assign, resolve or reopen it, or open the card to do it there. Nothing changes until you confirm.
TO DO 3
Open, nobody assigned yet
Data unavailable
NEW
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
1d
General inaccuracy temperature probe
Module Temperature Probe 1 - 38.2% Daytime Deviation from Faiman Reference
Temperature probe 1
4d
Tracker malfunction error
Pyranometer 1 tracker-shape mismatch vs satellite POA
Pyranometer 1 (plane of array)
9d
IN PROGRESS 0
Open and assigned
Nothing here
VERIFY ON SITE 4
The AI reports it fixed, still open
General inaccuracy pyranometer
Pyranometer POA_1 - 16.8% Daytime Deviation from Satellite Reference
Pyranometer 1 (plane of array)
7d
General inaccuracy temperature probe
Module Temperature Probe_1 - 33.8% Daytime Deviation from Faiman Reference
Temperature probe 1
8d
Electrical fault voltage
Inverter 2 MPPT 7 - Voltage 682 V vs Ideal 734 V, Alarms on 3/119 Points
Inverter 2 MPPT 7 +1
10d
Electrical fault voltage
Inverter 5 MPPT 5 - Voltage 674 V vs Ideal 734 V, Alarms on 4/119 Points
Inverter 5 MPPT 5 +1
10d
DONE 429
Resolved, most recent first
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
2d
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
2d
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
2d
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
3d
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
3d
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
3d
Data unavailable
Portfolio
Maps
Views
AI Brain
Job Cards
Reports
Maintenance
Team Chat
P2Dingo
Learn


Job card evidence

Pyranometer POA_1 - 16.8% Daytime Deviation from Satellite Reference

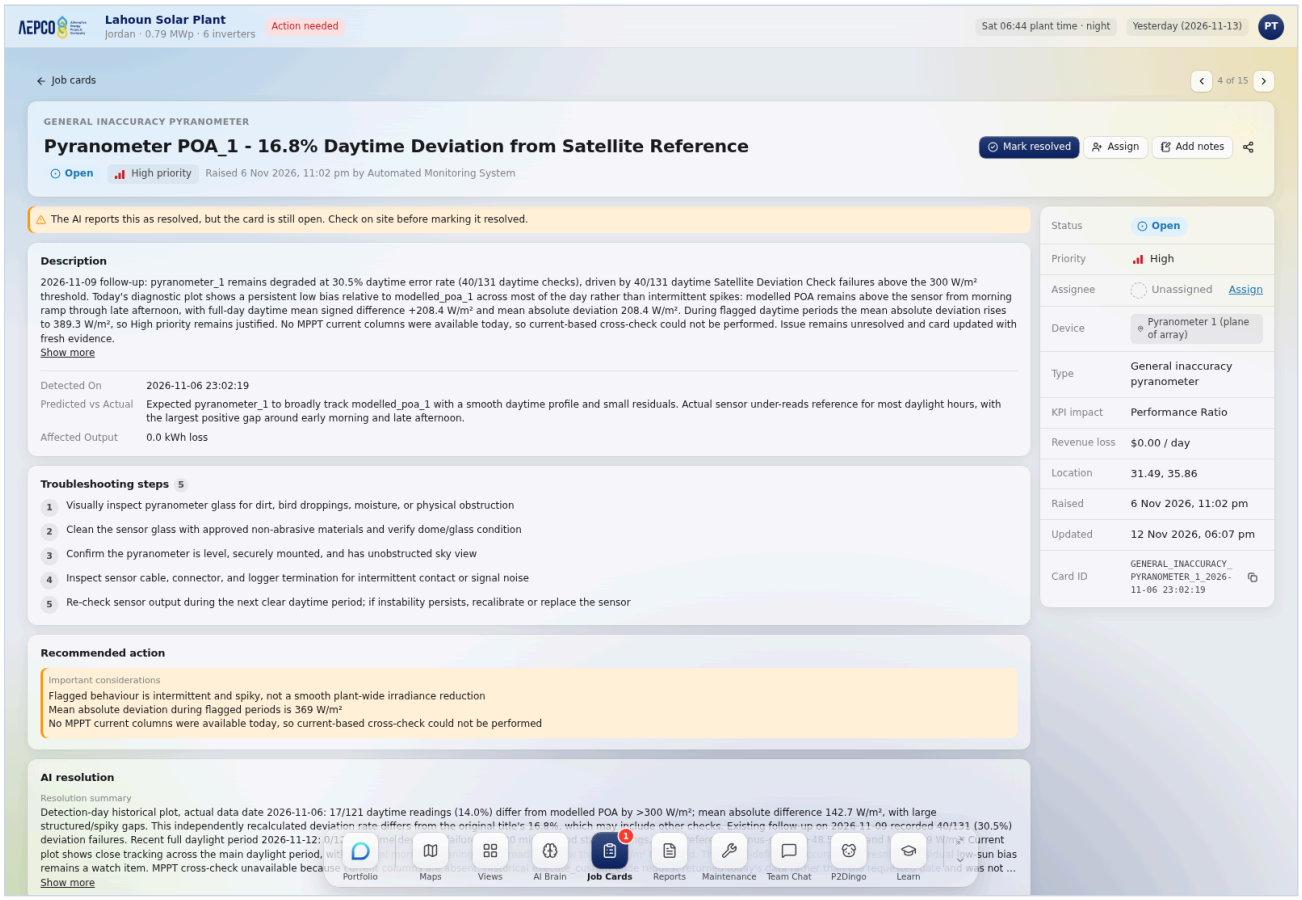


Job card evidence

Module Temperature Probe 1 - 38.2% Daytime Deviation from Faiman Reference

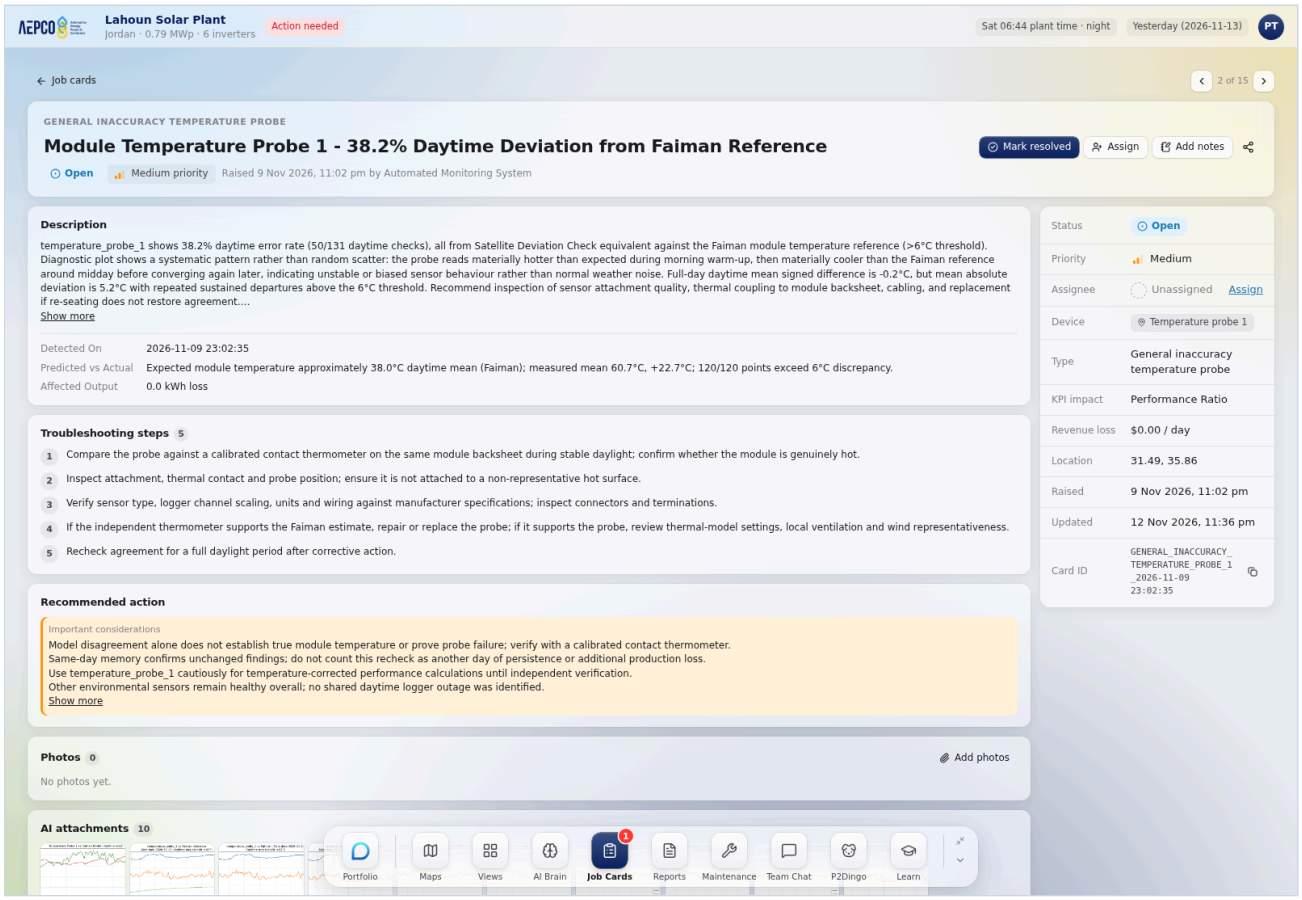


Job card evidence

Pyranometer 1 tracker-shape mismatch vs satellite POA

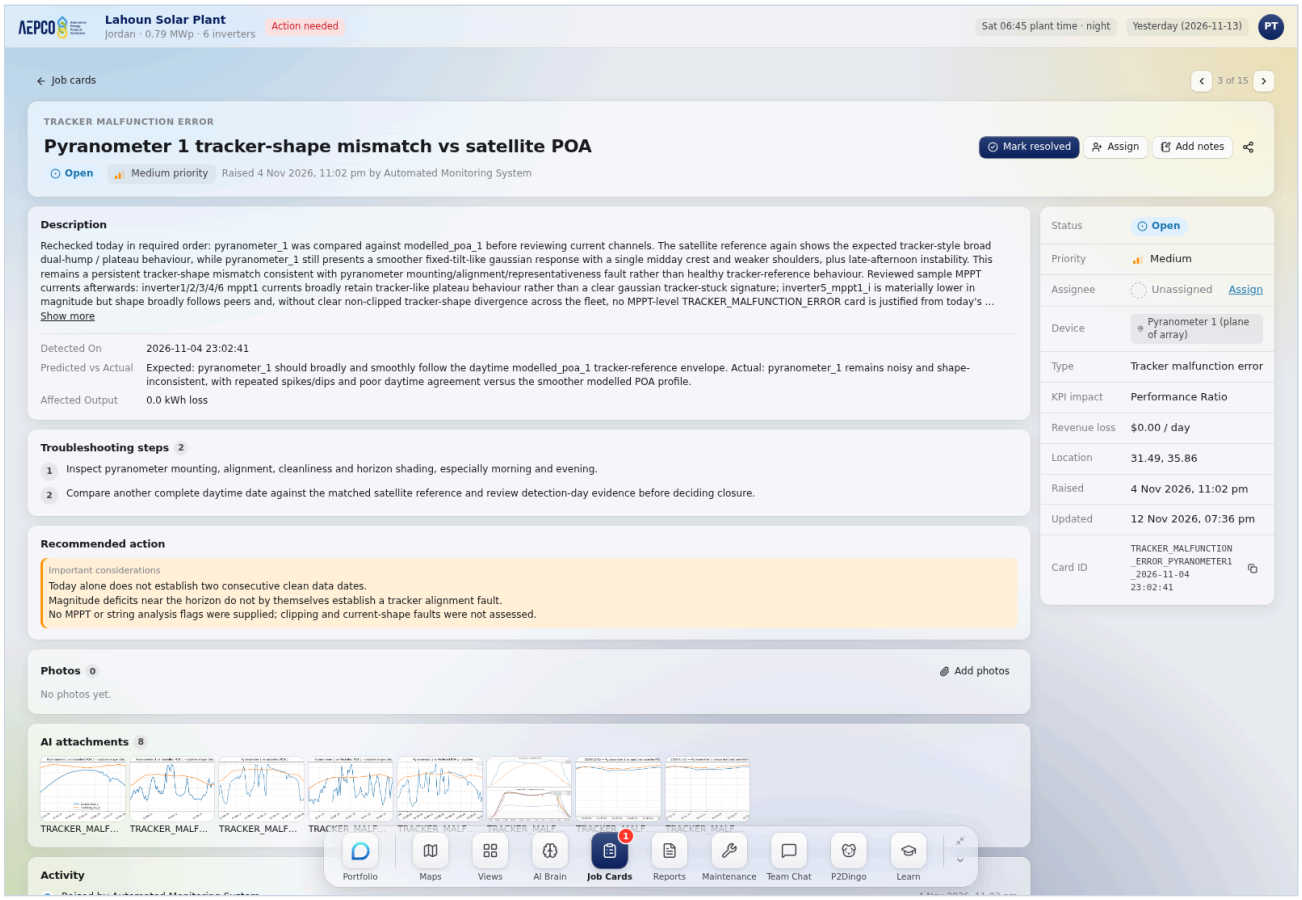


Job card evidence

Module Temperature Probe_1 - 33.8% Daytime Deviation from Faiman Reference

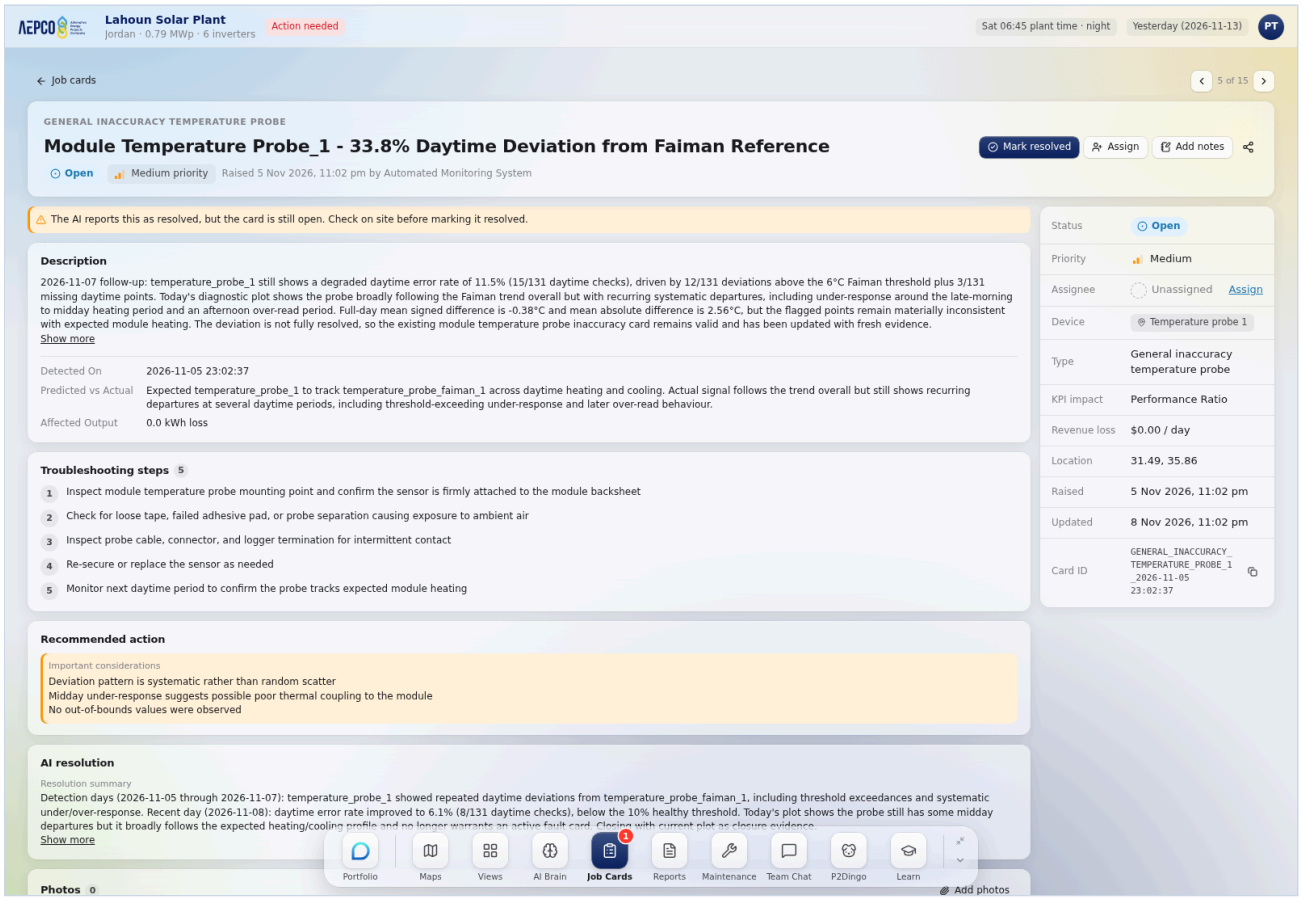


Job card evidence

Inverter 2 MPPT 7 - Voltage 682 V vs Ideal 734 V, Alarms on 3/119 Points

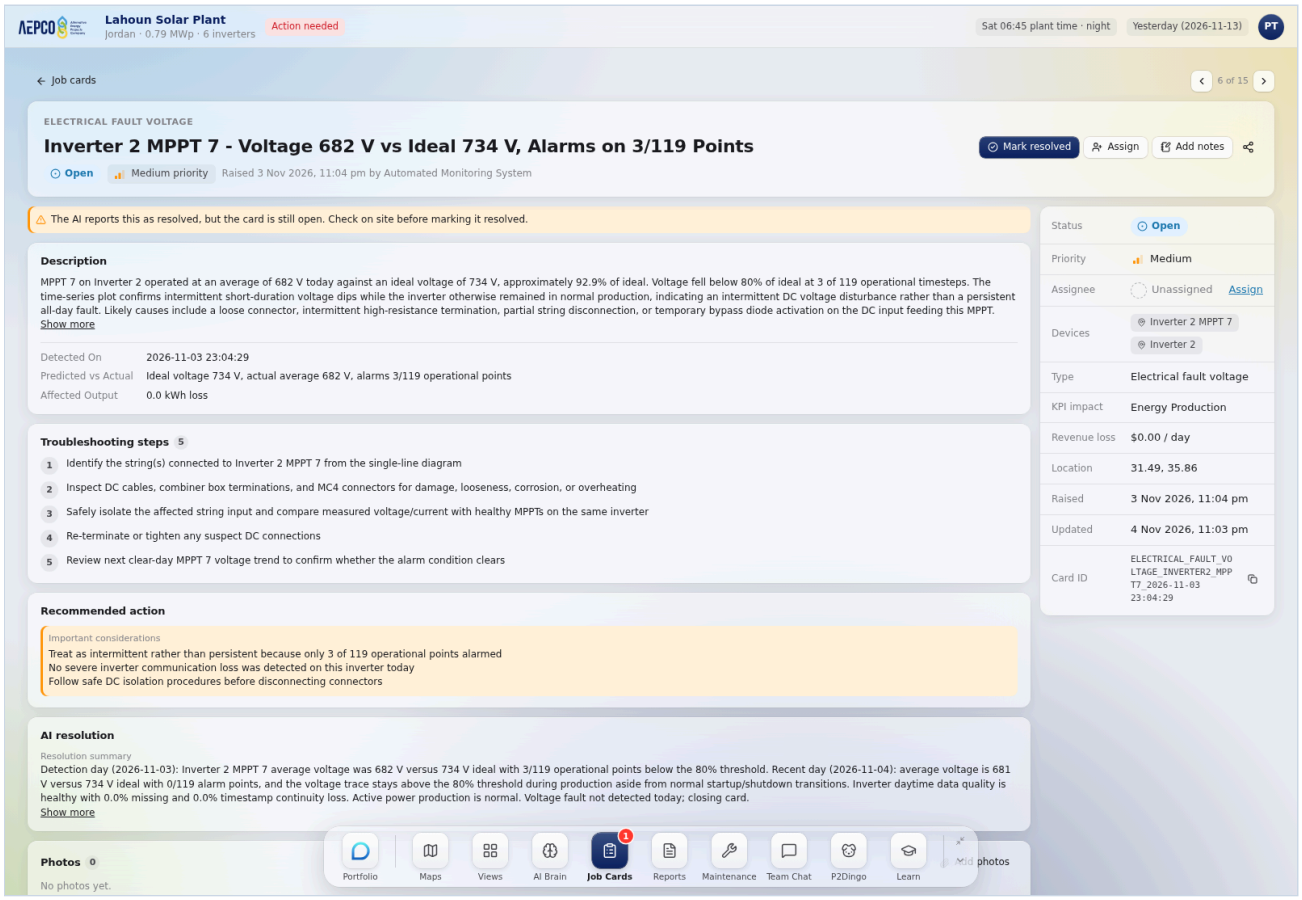


Job card evidence

Inverter 5 MPPT 5 - Voltage 674 V vs Ideal 734 V, Alarms on 4/119 Points

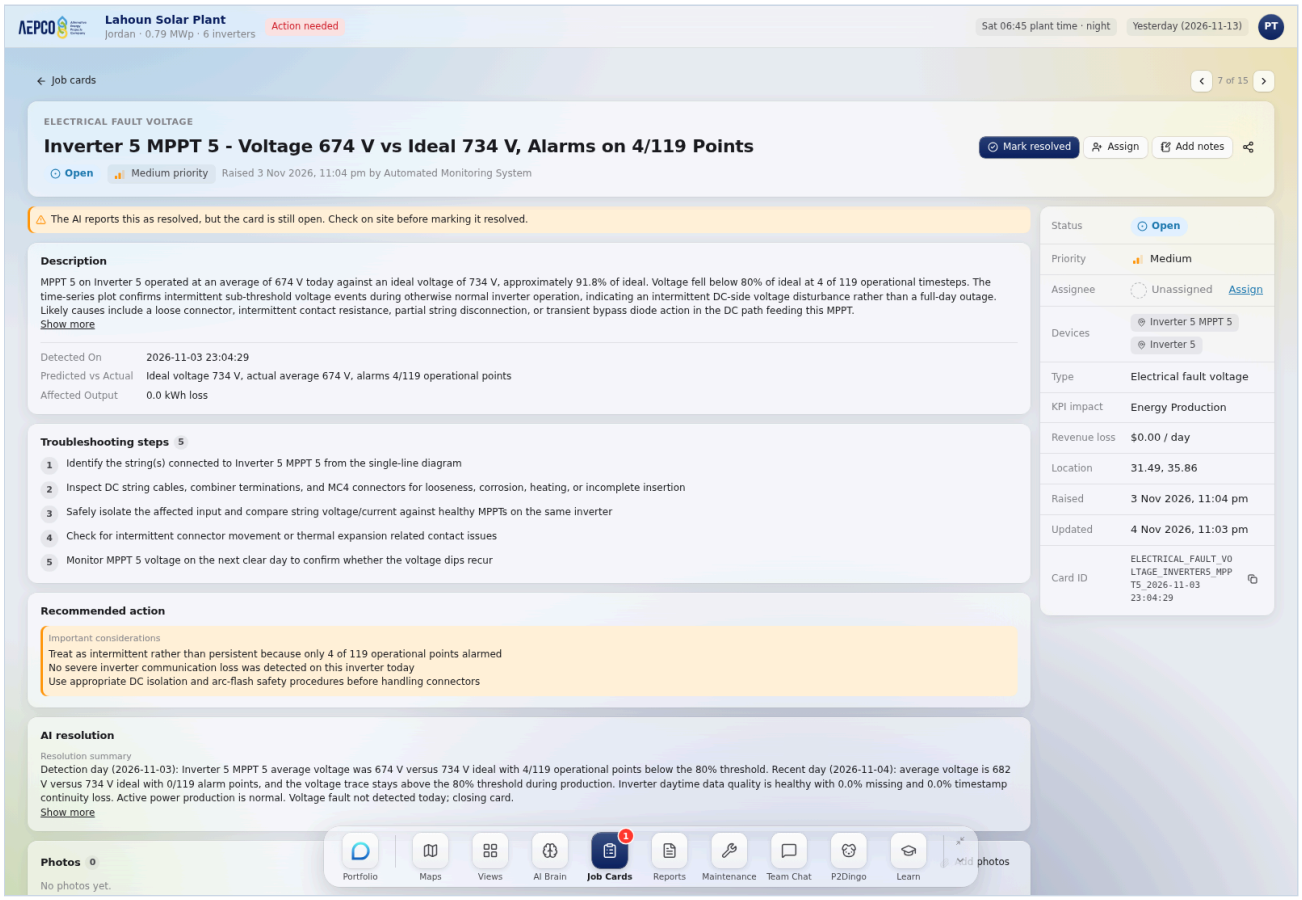

Teams_UI

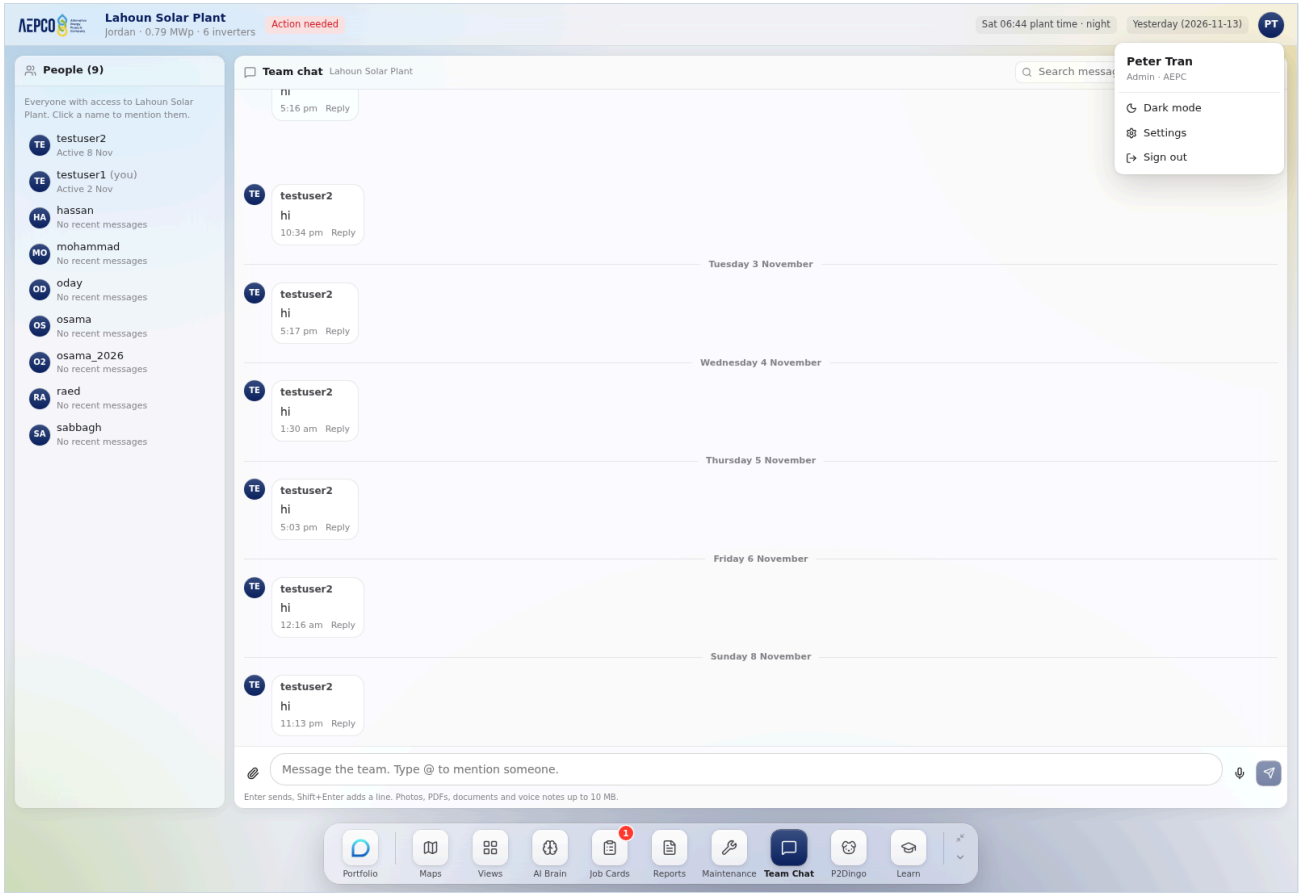
Lahoun Solar Plant
Jordan · 0.79 MWp · 6 inverters
Action needed
Sat 06:44 plant time · night
Yesterday (2026-11-13)
PT
People (9)
Everyone with access to Lahoun Solar Plant. Click a name to mention them.
testuser2
Active 8 Nov
testuser1 (you)
Active 2 Nov
hassan
No recent messages
mohammad
No recent messages
oday
No recent messages
osama
No recent messages
osama_2026
No recent messages
raed
No recent messages
sabbagh
No recent messages
Team chat
Lahoun Solar Plant
Search messag
Peter Tran
Admin · AEPC
Dark mode
Settings
Sign out
hi
5:16 pm Reply
testuser2
hi
10:34 pm Reply
Tuesday 3 November
testuser2
hi
5:17 pm Reply
Wednesday 4 November
testuser2
hi
1:30 am Reply
Thursday 5 November
testuser2
hi
5:03 pm Reply
Friday 6 November
testuser2
hi
12:16 am Reply
Sunday 8 November
testuser2
hi
11:13 pm Reply
Message the team. Type @ to mention someone.
Enter sends, Shift+Enter adds a line. Photos, PDFs, documents and voice notes up to 10 MB.
Portfolio
Maps
Views
AI Brain
Job Cards
Reports
Maintenance
Team Chat
P2Dingo
Learn

Scope and limitations

- One-time standalone test; daily schedules and application source unchanged.
- Credentials and browser authentication state are not saved.
- Enabled suite texts and dates preserved; no independent calculation verification.
- A new standalone repeat run; previous evidence files were preserved.
- Functional review used current answers and artifact payloads, not earlier verdicts.
- No alert email, Teams message, GitHub upload, upstream pipeline invocation or S3 write was performed.
- Opening existing job cards may mark them as read; no cards created, resolved or reassigned.
- No independent numerical recalculation, security audit or load test was performed.