# Customer readiness test
# Lahoun Solar Plant

One-time browser test · 2026-11-11T04:35:32.920869+00:00 UTC
https://main.d3o3iryvy33gj9.amplifyapp.com/portfolio

| 23/23 | 15 | 3 | 5 |
|---|---|---|---|
| Questions attempted | Passed functional checks | Failed checks | Review / blocked |

## Key findings

- Repeat run, November 11, 2026, 04:35–04:46 UTC: all 23 questions completed; 15 functional/retrieval passes, 3 failures and 5 informational/partial/unverified outcomes.
- P1 API failure persists — Q27: July clipping endpoint DNS/name resolution failed for all six inverters; no clipping calculation result.
- P1 API/tool failure persists — Q18: yesterday-performance answer omitted availability because its calculation tool failed internally.
- P2 context failure persists — Q7: first-plot memory changed from hourly Inverter 2 MPPTs over three days to daily all-inverter data over two months.
- Q11 returned a working six-inverter clipping chart but no requested written totals. Q10 now claims a BOM timestamp, but its BOM-specific source identity remains unverified.
- Three monthly report PDFs downloaded and validated for plant/month: October 2026 (13 pages), December 2025 (12 pages), September 2026 (13 pages). This verifies retrieval, not calculation accuracy or fresh recomputation.
- Four customer UI areas completed, including maintenance-calendar navigation and all six existing open job-card details. No new cards, cleaning records or chat messages created.
- Single-plant S3 check at 04:35:53 UTC recorded api_error=false; object last modified 04:31:47 UTC. It is an upstream update flag, not proof that chat APIs or data freshness are healthy.
- Compared with the previous run: Q11: passed → review

> API/tool errors are highest priority, followed by failed application responses. Missing data is reported separately. An answer or HTTP 200 alone is not a functional pass. Numerical results have not been independently recomputed. This test did not change daily schedules or run the upstream pipeline.

## Single-plant pipeline snapshot

**Abdali_Mall_Lahoun.json** · api_error: **false**

S3 last modified: 2026-11-11T04:31:47.000Z

Checked: 2026-11-11T04:35:53.678Z

## Question results

| ID | Test question | Result | Finding |
|---|---|---|---|
| Q9 | I have a COMMUNICATION_FAULT what do I do to my inverters? | **PASSED** | Manual troubleshooting guidance, diagrams and manufacturer PDF reference returned. No physical or inverter-control actions performed; safety instructions were not independently certified. |
| Q27 | Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026 | **FAILED** | P1 API/tool failure persists: clipping_loss_via_requests reported DNS/name-resolution failure for ipv-api.ndtensor.ai for all six inverters and every July chunk. No July clipping result was returned. |
| Q1 | Please generate last months report | **PASSED** | October 2026 report link downloaded successfully as a readable 13-page PDF for Lahoun. Retrieval and reporting month verified, not independent numerical accuracy or fresh recomputation. |
| Q12 | Was there any 0 production days in the last 7 days? | **PASSED** | Returned seven daily energy values for November 4–10, all greater than zero, covering seven completed days. Numerical values were not independently recalculated. |
| Q16 | Please generate December 2025 performance report | **PASSED** | December 2025 report link downloaded successfully as a readable 12-page Lahoun PDF with the correct reporting month. This is a retrieval pass, not certification of the report's calculations. |
| Q17 | How is my data quality for POA and power? How many of them show missing data during daytime or mismatches with satellite prediction? | **PASSED** | Returned 124 daytime points, zero missing POA/power points, 43 POA mismatches and zero power mismatches, with thresholds and the November 11 07:25 cutoff disclosed. Data-quality findings are not API errors. |

| ID | Test question | Result | Finding |
|---|---|---|---|
| Q3 | Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2 | **PASSED** | Hourly Inverter 2 MPPT performance-ratio chart returned with 12 populated time-series traces for the requested recent period. |
| Q4 | Please plot last 3 days hourly performance ratio for my Strings for inverter 2 | **REVIEW** | Informational/no-data: no string-level chart was available. The answer still says visualization created before stating there was nothing to plot. Not classified as an API outage. |
| Q5 | Please plot the last 4 days hourly performance ratio for all my inverters | **PASSED** | Four-day hourly performance-ratio chart returned with six inverter traces and populated timestamps. |
| Q11 | Please figure out how much clipping loss was found in the last 6 months broken by inverters, list them down and plot it as well | **REVIEW** | Partial fulfilment: a populated six-inverter monthly clipping chart was returned, but the answer did not list the requested numerical per-inverter loss totals. Chart/tool output worked; the requested written breakdown was absent. |
| Q18 | How did my plant perform yesterday? | **FAILED** | P1 API/tool failure persists: yesterday's energy, yield, PR and reference yield were returned, but technical/contractual availability could not be reported because its calculation tool failed internally. Partial answer is not a full functional pass. |
| Q20 | Is there shading happening with my plant? Please analyze the pyranometer and check for frequent dips at certain times | **PASSED** | Returned 30-day pyranometer dip analysis with 388 points, recurring morning/afternoon windows, solar-azimuth patterns, method and alternative sensor/model/weather explanations. Findings were not independently recalculated or confirmed on site. |
| Q2 | Based on pvsyst report, what is the rated power of this plant and array configuration | **PASSED** | PVsyst retrieval returned two relevant plant-specific source sections and table-image references. Pass is limited to source retrieval: rated power and array configuration were not extracted into a direct prose answer. |
| Q6 | Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3 | **PASSED** | Inverter 3 current/voltage visualization returned eight traces at raw five-minute granularity. No independent sensor-value accuracy check performed. |

| ID | Test question | Result | Finding |
|---|---|---|---|
| Q10 | When was the last time the BOM data showed up | **REVIEW** | The answer now states a last-BOM timestamp of November 11 07:25, unlike the previous no-BOM answer. Captured response does not expose underlying BOM-specific rows/column mapping, so source identity and timestamp correctness remain unverified. |
| Q19 | Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt | **PASSED** | Returned daily-POA median, mean and kurtosis over 314 non-NaN daily totals, with missing-day and incomplete-current-day caveats. Full daily series was not listed; numerical results were not independently recalculated. |
| Q14 | Pull up the latest cleaning log | **REVIEW** | Informational/no records: no November 2026 cleaning logs returned. The query does not establish whether an older latest cleaning entry exists. |
| Q15 | Jim cleaned the pyranometer today, can you add it to the cleaning log? | **REVIEW** | Clarification required: assistant asked for Fault Cause, Action Taken and Status. No missing fields invented, no follow-up submitted and no cleaning log saved or save/retrieval verified. |
| Q8 | How can I shut down my inverters? | **PASSED** | Manufacturer shutdown guidance, diagrams and manual PDF reference returned. No equipment shutdown or physical procedure performed; instructions were not independently safety-certified. |
| Q13 | Please change to dark mode | **PASSED** | Dark-mode action returned and the fresh browser screenshot visibly confirms the dark theme. |
| Q21 | Please figure out how much clipping loss was found in the last 2 months broken by inverters, list them down and plot it as well | **PASSED** | Returned six per-inverter clipping totals and a six-trace daily chart for September 11–November 11, with partial-end-date caveat. Numerical values and success of every named underlying tool were not independently verified. |

| ID | Test question | Result | Finding |
|---|---|---|---|
| Q7 | Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test) | **FAILED** | P2 memory/context failure persists: original first plot was hourly Inverter 2 MPPT PR for the last three days; follow-up instead used all six inverters and daily aggregation over two months. Twelve traces and dual axes were rendered, but original scope was lost. |
| Q46 | Can you generate report for moth of september 2026 | **PASSED** | September 2026 report downloaded as a readable 13-page Lahoun PDF for the correct period. Retrieval verified, not independent numerical accuracy. |

## Application UI checks

| Area | Result | Finding |
|---|---|---|
| AI_brain_UI | passed | Customer AI Brain feed, diagnostic/time disclosures and plant heatmap rendered. Operational alarms are plant findings, not necessarily interface failures. Legacy fullscreen/layout parity was not exhaustively tested. |
| Maintenance_UI | passed | Task/filter/calendar interface rendered and previous/next-month navigation showed October then returned to November. Customer site explicitly states once-a-year maintenance; legacy scheduling dropdowns are absent by design. |
| Job_cards_UI | passed | Board and all six existing open job-card detail pages were opened and captured. No cards created, resolved or reassigned; viewing can mark cards as read. |
| Teams_UI | passed | Customer Team Chat people list, existing history and message composer rendered. No message or notification sent; this is not a Microsoft Teams integration test. |

Customer navigation differs from the legacy daily-test site. Unavailable legacy tabs are not counted as passes.

# Q9 · passed

### I have a COMMUNICATION_FAULT what do I do to my inverters?

Duration: 38.2 seconds · Manual troubleshooting guidance, diagrams and manufacturer PDF reference returned. No physical or inverter-control actions performed; safety instructions were not independently certified.

## Observed answer

To troubleshoot a COMMUNICATION_FAULT on your inverter, follow these steps:

Inspect the inverter communication status on the user interface (monitoring system diagram) to get real-time communication data. View here:
Check the inverter's bottom panel of openings and switches labeled A, B, C, and D. Confirm the communication ports are securely connected and correctly used. Diagram:
Inspect internal terminal points for communication (A, B, C, D) for tight, clean connections. Reference:
Examine the toggle switch position and connection points in the maintenance diagram to confirm the switch is ON and all points are properly connected:
Review the solar system architecture and trace data lines between inverter, Data Manager, and network to confirm no cable interruptions. See:
Confirm all four toggle switches at the device's bottom are appropriately set (ON/OFF) as per manual guidance:
Check setup diagram showing 48 cable connections for any loose/disconnected cables:

Always refer to diagram labels and component locations as shown in each linked image for accurate troubleshooting steps.

Manual reference (PDF): https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

STP_110-60_Manual.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Technical details
Answered by Manual Agent
· 20.4s

## Browser evidence

PT

I have a COMMUNICATION FA...


To troubleshoot a COMMUNICATION_FAULT on your inverter, follow these steps:

1. Inspect the inverter communication status on the user interface (monitoring system diagram) to get real-time communication data. View here:





igure 11: Design of the user interface's home page (example)

2. Check the inverter's bottom panel of openings and switches labeled A, B, C, and D. Confirm the communication ports are securely connected and correctly used. Diagram:

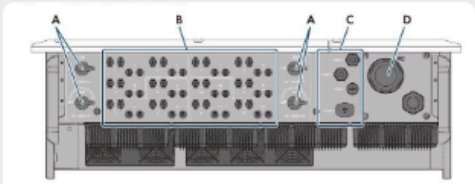



igure 6: Enclosure openings at the bottom of the inverter

3. Inspect internal terminal points for communication (A, B, C, D) for tight, clean connections. Reference:

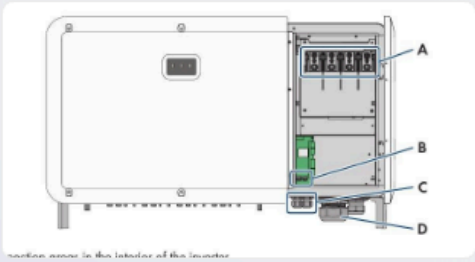


4. Examine the toggle switch position and connection points in the maintenance diagram to confirm the switch is ON and all points are properly connected:

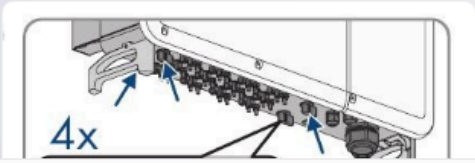


Ask about Lahoun Solar Plant

# Q27 · failed

### Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026

Duration: 20.7 seconds · P1 API/tool failure persists: clipping_loss_via_requests reported DNS/name-resolution failure for ipv-api.ndtensor.ai for all six inverters and every July chunk. No July clipping result was returned.

## Observed answer

I used clipping_loss_via_requests for 2026-07-01 to 2026-07-31, but it failed for all six inverters because the external analytics API host could not be resolved (ipv-api.ndtensor.ai).

So, I cannot determine from that tool whether there was clipping loss in July 2026.

Result from the requested tool:

Status: Failed
inverter1: no result returned
inverter2: no result returned
inverter3: no result returned
inverter4: no result returned
inverter5: no result returned
inverter6: no result returned


Cause:

Every chunked request for each inverter failed with a DNS/name-resolution error to the external endpoint.

Called tool:

clipping_loss_via_requests(time_start='2026-07-01', time_end='2026-07-31')
How this was worked out
Technical details
Answered by Data Agent
· 9.5s

## Browser evidence

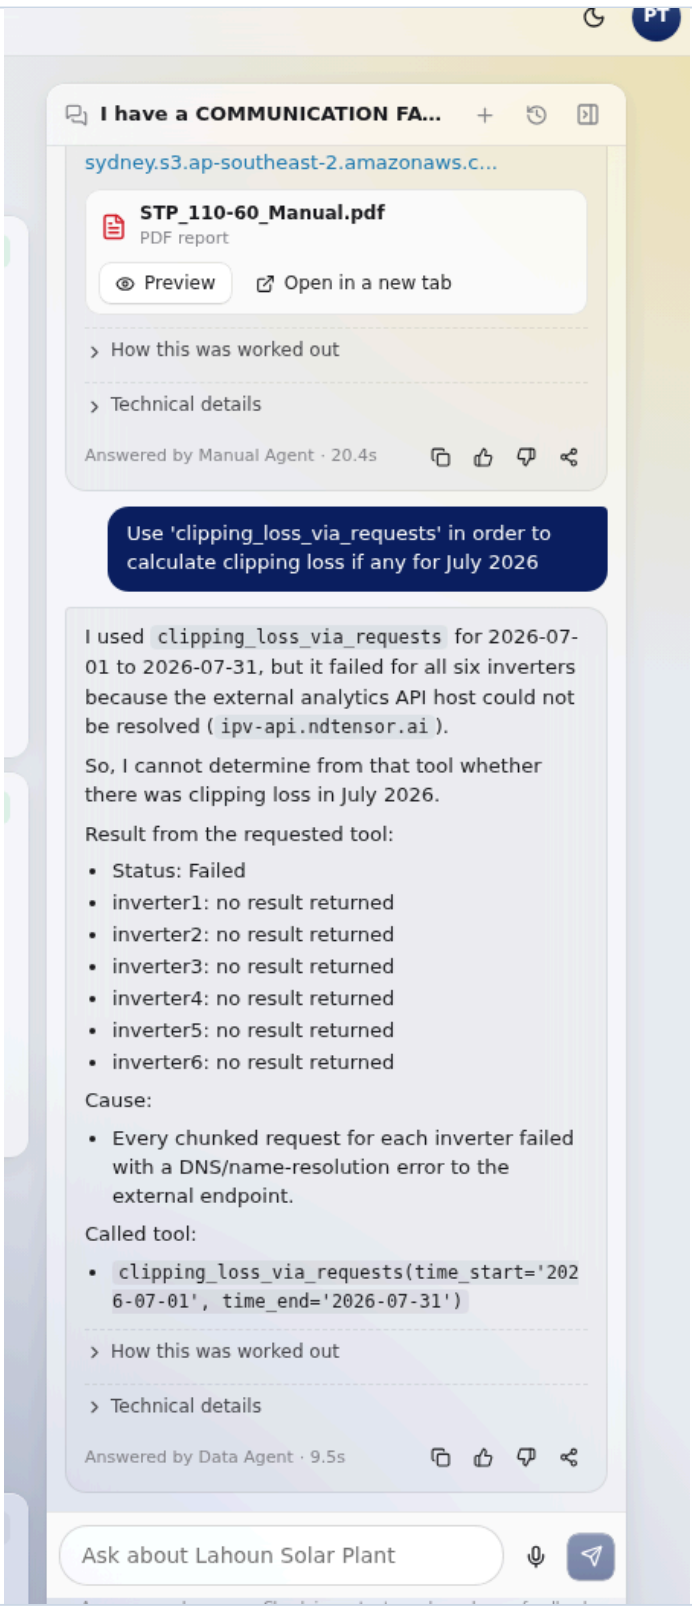
PT
I have a COMMUNICATION FA...
sydney.s3.ap-southeast-2.amazonaws.c...
STP_110-60_Manual.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Technical details
Answered by Manual Agent · 20.4s
Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026
I used clipping_loss_via_requests for 2026-07-01 to 2026-07-31, but it failed for all six inverters because the external analytics API host could not be resolved ( ipv-api.ndtensor.ai ).
So, I cannot determine from that tool whether there was clipping loss in July 2026.
Result from the requested tool:
Status: Failed
inverter1: no result returned
inverter2: no result returned
inverter3: no result returned
inverter4: no result returned
inverter5: no result returned
inverter6: no result returned
Cause:
Every chunked request for each inverter failed with a DNS/name-resolution error to the external endpoint.
Called tool:
clipping_loss_via_requests(time_start='2026-07-01', time_end='2026-07-31')
How this was worked out
Technical details
Answered by Data Agent · 9.5s
Ask about Lahoun Solar Plant

# Q1 · passed

### Please generate last months report


Duration: 14.3 seconds · October 2026 report link downloaded successfully as a readable 13-page PDF for Lahoun. Retrieval and reporting month verified, not independent numerical accuracy or fresh recomputation.

## Observed answer

I've generated the external report for October 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_October_2026_external_report.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent
· 4s

## Browser evidence

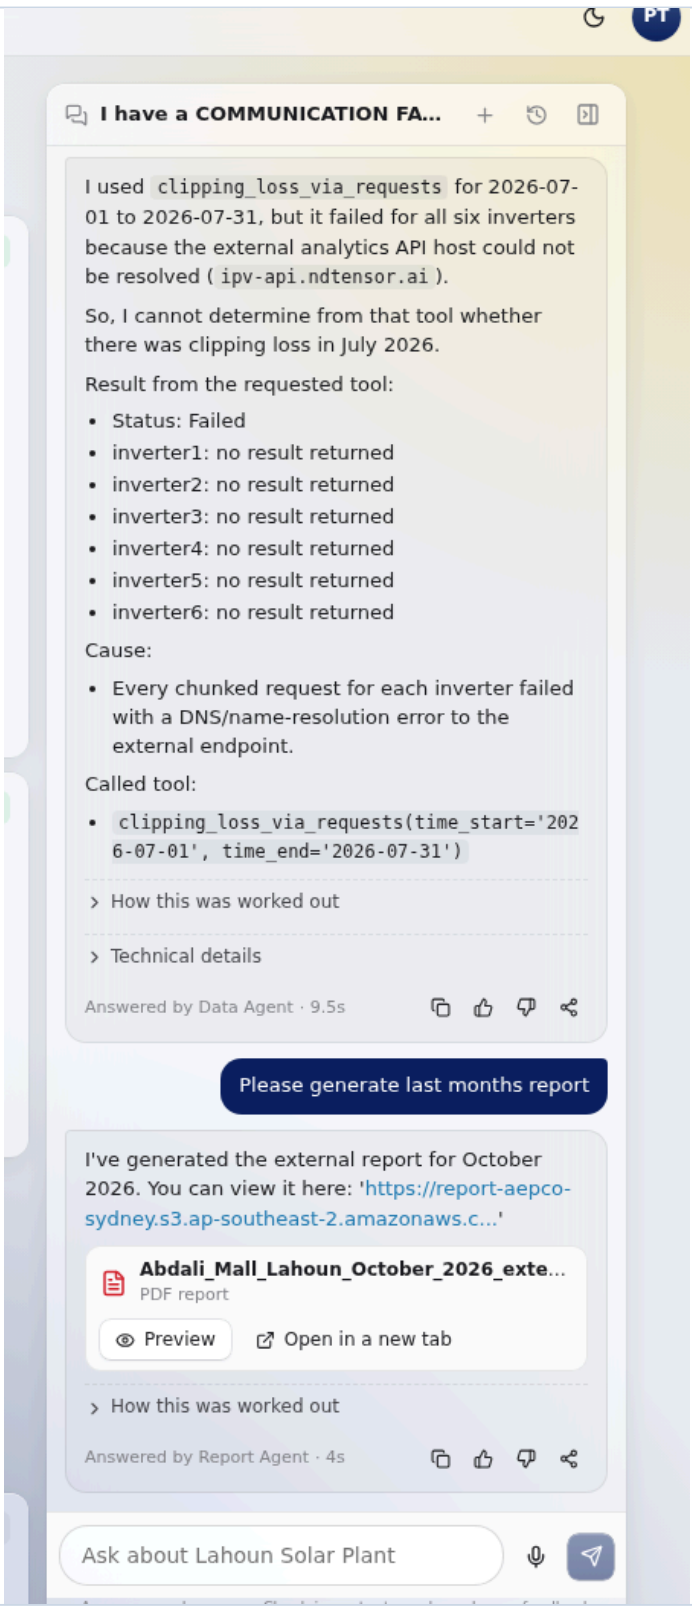
PT
I have a COMMUNICATION FA...
I used clipping_loss_via_requests for 2026-07-01 to 2026-07-31, but it failed for all six inverters because the external analytics API host could not be resolved ( ipv-api.ndtensor.ai ).
So, I cannot determine from that tool whether there was clipping loss in July 2026.
Result from the requested tool:
Status: Failed
inverter1: no result returned
inverter2: no result returned
inverter3: no result returned
inverter4: no result returned
inverter5: no result returned
inverter6: no result returned
Cause:
Every chunked request for each inverter failed with a DNS/name-resolution error to the external endpoint.
Called tool:
clipping_loss_via_requests(time_start='2026-07-01', time_end='2026-07-31')
How this was worked out
Technical details
Answered by Data Agent · 9.5s
Please generate last months report
I've generated the external report for October 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_October_2026_exte...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 4s
Ask about Lahoun Solar Plant

# Q12 · passed

### Was there any 0 production days in the last 7 days?

Duration: 22.3 seconds · Returned seven daily energy values for November 4–10, all greater than zero, covering seven completed days. Numerical values were not independently recalculated.


## Observed answer

No. There were no 0-production days in the last 7 days.

Daily plant energy for 2026-11-04 to 2026-11-10:

2026-11-04: 3994.27 kWh
2026-11-05: 2693.48 kWh
2026-11-06: 3054.89 kWh
2026-11-07: 2424.63 kWh
2026-11-08: 3207.16 kWh
2026-11-09: 4152.37 kWh
2026-11-10: 4009.04 kWh
How this was worked out
Technical details
Answered by Data Agent
· 9.2s

## Browser evidence

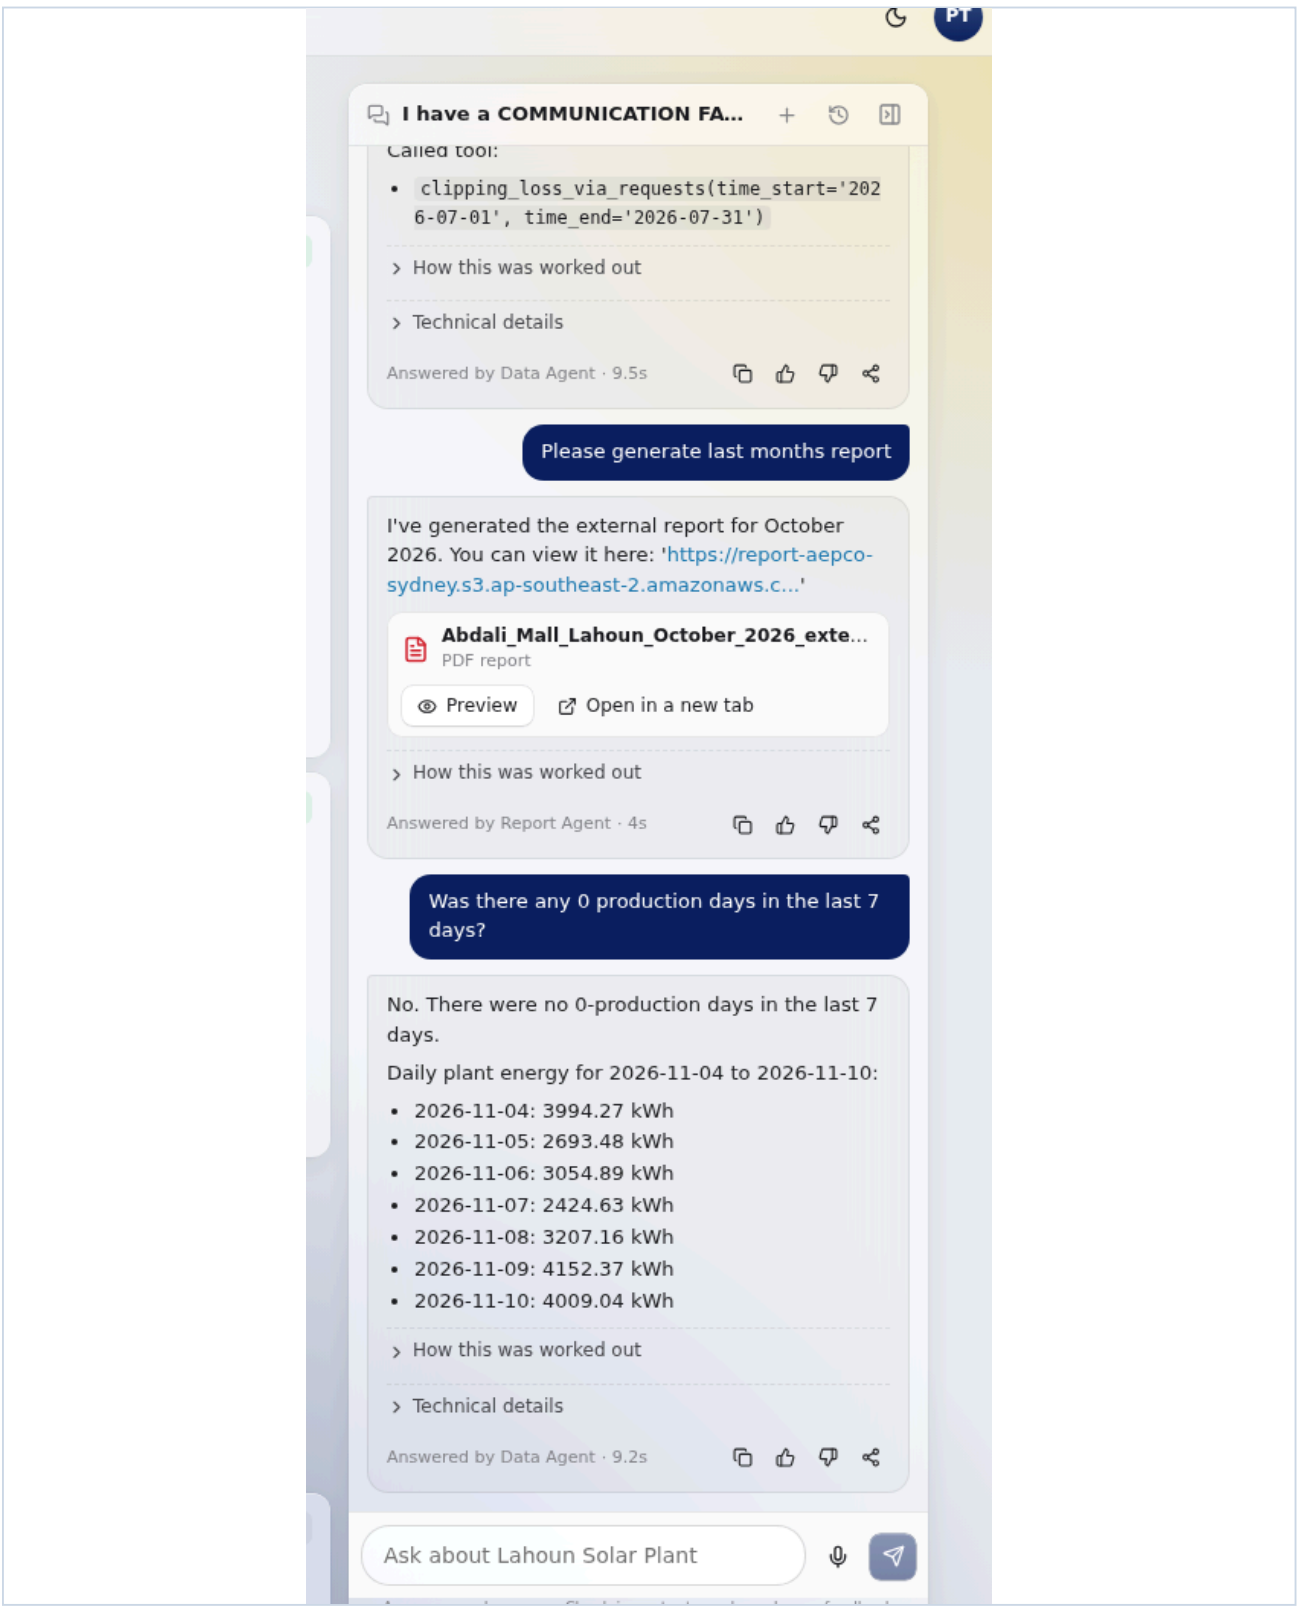
PT
I have a COMMUNICATION FA...
Called tool:
clipping_loss_via_requests(time_start='2026-07-01', time_end='2026-07-31')
How this was worked out
Technical details
Answered by Data Agent · 9.5s
Please generate last months report
I've generated the external report for October 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_October_2026_exte...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 4s
Was there any 0 production days in the last 7 days?
No. There were no 0-production days in the last 7 days.
Daily plant energy for 2026-11-04 to 2026-11-10:
2026-11-04: 3994.27 kWh
2026-11-05: 2693.48 kWh
2026-11-06: 3054.89 kWh
2026-11-07: 2424.63 kWh
2026-11-08: 3207.16 kWh
2026-11-09: 4152.37 kWh
2026-11-10: 4009.04 kWh
How this was worked out
Technical details
Answered by Data Agent · 9.2s
Ask about Lahoun Solar Plant

# Q16 · passed

### Please generate December 2025 performance report


Duration: 52.1 seconds · December 2025 report link downloaded successfully as a readable 12-page Lahoun PDF with the correct reporting month. This is a retrieval pass, not certification of the report's calculations.

## Observed answer

I've generated the plant performance report for December 2025. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_December_2025_external_report.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent
· 4.9s

## Browser evidence

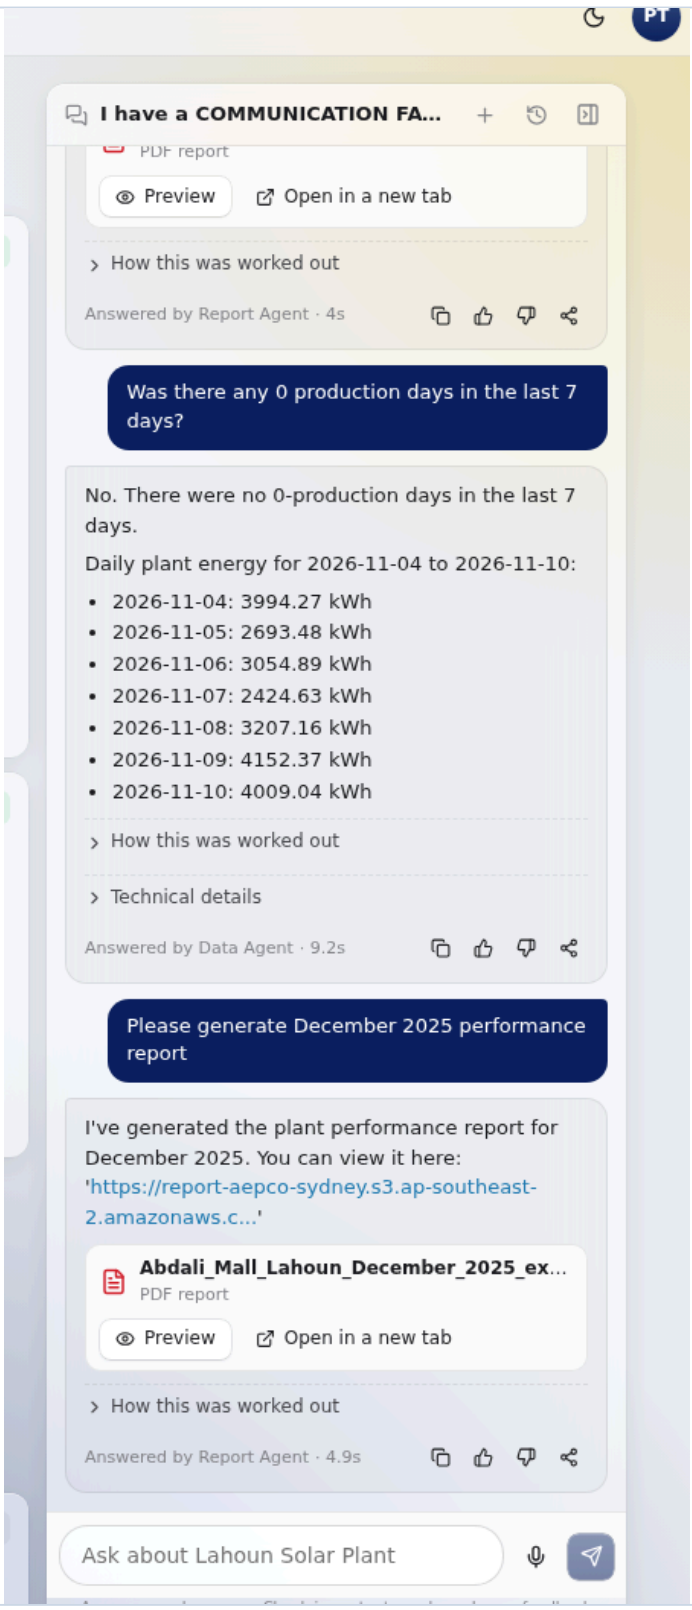
PT
I have a COMMUNICATION FA...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 4s
Was there any 0 production days in the last 7 days?
No. There were no 0-production days in the last 7 days.
Daily plant energy for 2026-11-04 to 2026-11-10:
2026-11-04: 3994.27 kWh
2026-11-05: 2693.48 kWh
2026-11-06: 3054.89 kWh
2026-11-07: 2424.63 kWh
2026-11-08: 3207.16 kWh
2026-11-09: 4152.37 kWh
2026-11-10: 4009.04 kWh
How this was worked out
Technical details
Answered by Data Agent · 9.2s
Please generate December 2025 performance report
I've generated the plant performance report for December 2025. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_December_2025_ex...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 4.9s
Ask about Lahoun Solar Plant

# Q17 · passed

### How is my data quality for POA and power? How many of them show missing data during daytime or mismatches with satellite prediction?

Duration: 38.0 seconds · Returned 124 daytime points, zero missing POA/power points, 43 POA mismatches and zero power mismatches, with thresholds and the November 11 07:25 cutoff disclosed. Data-quality findings are not API errors.

## Observed answer

Using the available data from 2026-11-10 through 2026-11-11 07:25, I assessed daytime quality with daytime defined as modelled POA > 50 W/m².


Results:

Daytime points checked: 124
Missing POA during daytime: 0 instances
Missing plant active power during daytime: 0 instances
POA mismatches vs satellite/modelled prediction: 43 instances
Power mismatches vs irradiance expectation: 0 instances

Notes:

The data does not yet extend to the full current day; the latest record available is 2026-11-11 07:25:00.
I used modelled_poa_1 as the prediction reference for mismatch screening.
The POA mismatch count reflects daytime points where modelled POA was >200 W/m² and measured pyranometer POA differed by more than 50% from the prediction.
How this was worked out
Technical details
Answered by Data Agent
· 21s

## Browser evidence

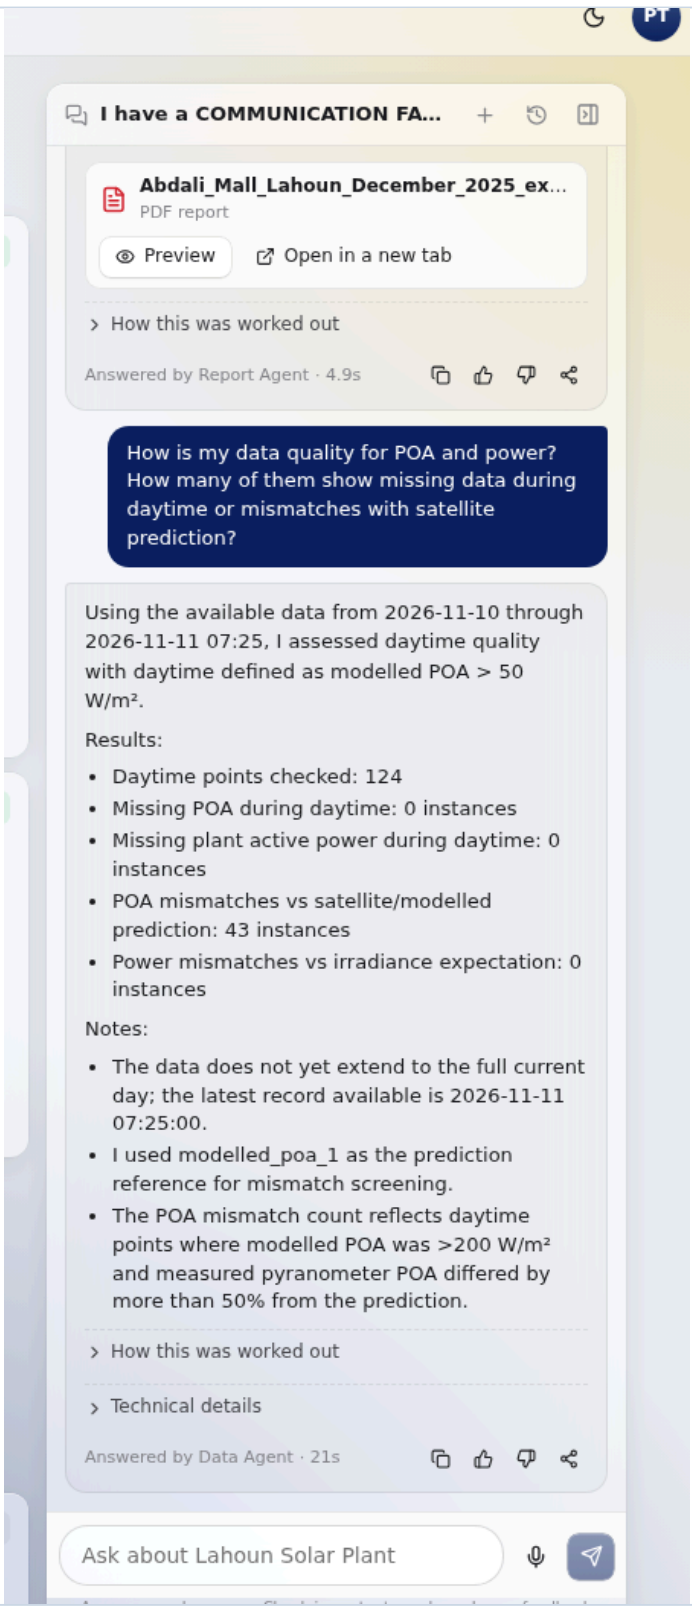
PT
I have a COMMUNICATION FA...
Abdali_Mall_Lahoun_December_2025_ex...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 4.9s
How is my data quality for POA and power? How many of them show missing data during daytime or mismatches with satellite prediction?
Using the available data from 2026-11-10 through 2026-11-11 07:25, I assessed daytime quality with daytime defined as modelled POA > 50 W/m².
Results:
Daytime points checked: 124
Missing POA during daytime: 0 instances
Missing plant active power during daytime: 0 instances
POA mismatches vs satellite/modelled prediction: 43 instances
Power mismatches vs irradiance expectation: 0 instances
Notes:
The data does not yet extend to the full current day; the latest record available is 2026-11-11 07:25:00.
I used modelled_poa_1 as the prediction reference for mismatch screening.
The POA mismatch count reflects daytime points where modelled POA was >200 W/m² and measured pyranometer POA differed by more than 50% from the prediction.
How this was worked out
Technical details
Answered by Data Agent · 21s
Ask about Lahoun Solar Plant

# Q3 · passed

### Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2

Duration: 24.9 seconds · Hourly Inverter 2 MPPT performance-ratio chart returned with 12 populated time-series traces for the requested recent period.

## Observed answer

I've created the visualization for you.

Hourly Performance Ratio for Inverter 2 MPPTs (Last 3 Days)
Pin
How this was worked out
Answered by Graph Agent
· 13.9s

## Browser evidence

PT

I have a COMMUNICATION FA...

- Power mismatches vs irradiance expectation: 0 instances

Notes:

- The data does not yet extend to the full current day; the latest record available is 2026-11-11 07:25:00.
- I used modelled_poa_1 as the prediction reference for mismatch screening.
- The POA mismatch count reflects daytime points where modelled POA was >200 W/m² and measured pyranometer POA differed by more than 50% from the prediction.

› How this was worked out


› Technical details

Answered by Data Agent · 21s

Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2

I've created the visualization for you.

**Hourly Performance Ratio for I...** Pin

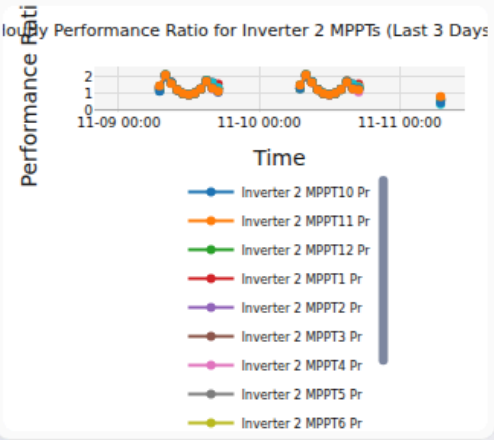


› How this was worked out

Answered by Graph Agent · 13.9s

Ask about Lahoun Solar Plant

# Q4 · review

### Please plot last 3 days hourly performance ratio for my Strings for inverter 2

Duration: 15.8 seconds · Informational/no-data: no string-level chart was available. The answer still says visualization created before stating there was nothing to plot. Not classified as an API outage.

## Observed answer

I've created the visualization for you.

There was nothing to plot for this question. Try another date range or measure.

How this was worked out
Answered by Graph Agent
· 5s

## Browser evidence

I have a COMMUNICATION FA...

more than 50% from the prediction.

› How this was worked out


› Technical details

Answered by Data Agent · 21s

Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2

I've created the visualization for you.

**Hourly Performance Ratio for I...** Pin

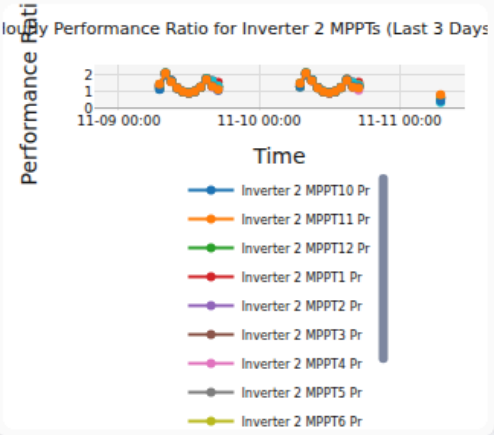


› How this was worked out

Answered by Graph Agent · 13.9s

Please plot last 3 days hourly performance ratio for my Strings for inverter 2

I've created the visualization for you.

There was nothing to plot for this question. Try another date range or measure.

› How this was worked out

Answered by Graph Agent · 5s

Ask about Lahoun Solar Plant

# Q5 · passed

### Please plot the last 4 days hourly performance ratio for all my inverters

Duration: 24.8 seconds · Four-day hourly performance-ratio chart returned with six inverter traces and populated timestamps.

## Observed answer

I've created the visualization for you.

Hourly Performance Ratio for All Inverters (Last 4 Days)
Pin
How this was worked out
Answered by Graph Agent
· 14.1s

## Browser evidence

PT

I have a COMMUNICATION FA...

Inverter 2 MPPT5 Pr

Inverter 2 MPPT6 Pr

› How this was worked out

Answered by Graph Agent · 13.9s

Please plot last 3 days hourly performance ratio for my Strings for inverter 2

I've created the visualization for you.

There was nothing to plot for this question. Try another date range or measure.


› How this was worked out

Answered by Graph Agent · 5s

Please plot the last 4 days hourly performance ratio for all my inverters

I've created the visualization for you.

**Hourly Performance Ratio for A...** Pin

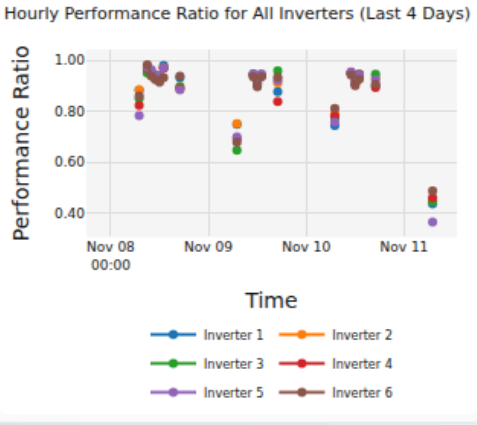


› How this was worked out

Answered by Graph Agent · 14.1s

Ask about Lahoun Solar Plant

# Q11 · review

### Please figure out how much clipping loss was found in the last 6 months broken by inverters, list them down and plot it as well

Duration: 38.5 seconds · Partial fulfilment: a populated six-inverter monthly clipping chart was returned, but the answer did not list the requested numerical per-inverter loss totals. Chart/tool output worked; the requested written breakdown was absent.

## Observed answer


I've created the visualization for you.

Monthly Clipping Loss by Inverter (Last 6 Months)
Pin
How this was worked out
Answered by Graph Agent
· 27.1s

## Browser evidence

PT

I have a COMMUNICATION FA...

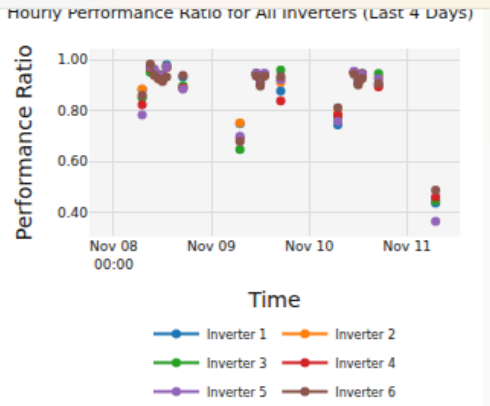



› How this was worked out

Answered by Graph Agent · 14.1s

Please figure out how much clipping loss was found in the last 6 months broken by inverters, list them down and plot it as well

I've created the visualization for you.

**Monthly Clipping Loss by Invert...** Pin

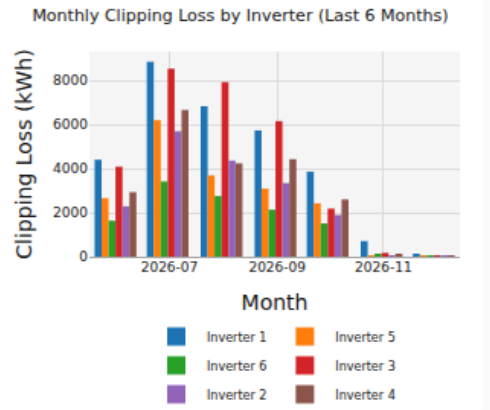


› How this was worked out

Answered by Graph Agent · 27.1s

Ask about Lahoun Solar Plant

# Q18 · failed

### How did my plant perform yesterday?

Duration: 28.0 seconds · P1 API/tool failure persists: yesterday's energy, yield, PR and reference yield were returned, but technical/contractual availability could not be reported because its calculation tool failed internally. Partial answer is not a full functional pass.

## Observed answer

Yesterday (2026-11-10), your plant performed well based on measured data.

Total energy: 4,009.04 kWh
Specific yield: 5.10 kWh/kWp
Performance ratio (PR): 0.928
Reference yield (Yr): 4.14 kWh/kWp

Assessment:

A PR of 0.928 is strong and indicates the plant converted available irradiance into energy efficiently.
Comparing specific yield (5.10 kWh/kWp) with reference yield (4.14 kWh/kWp) also points to a solid production day.
The hourly profile looks normal: generation ramped up after 07:00, stayed strongest from roughly 09:00 to 15:00, and tapered off by 17:00, closely following the irradiance trend from the pyranometer.
Peak hourly average plant power occurred around 09:00 at 515.79 kW, with similarly strong output through midday.


Notes:

I could not report technical/contractual availability because that calculation tool failed internally for this query.
No soiling assessment is available here because soiling functions are not implemented.

Overall: this was a healthy, efficient operating day with a normal solar production shape and strong measured performance.

How this was worked out
Technical details
Answered by Data Agent
· 17.3s

## Browser evidence

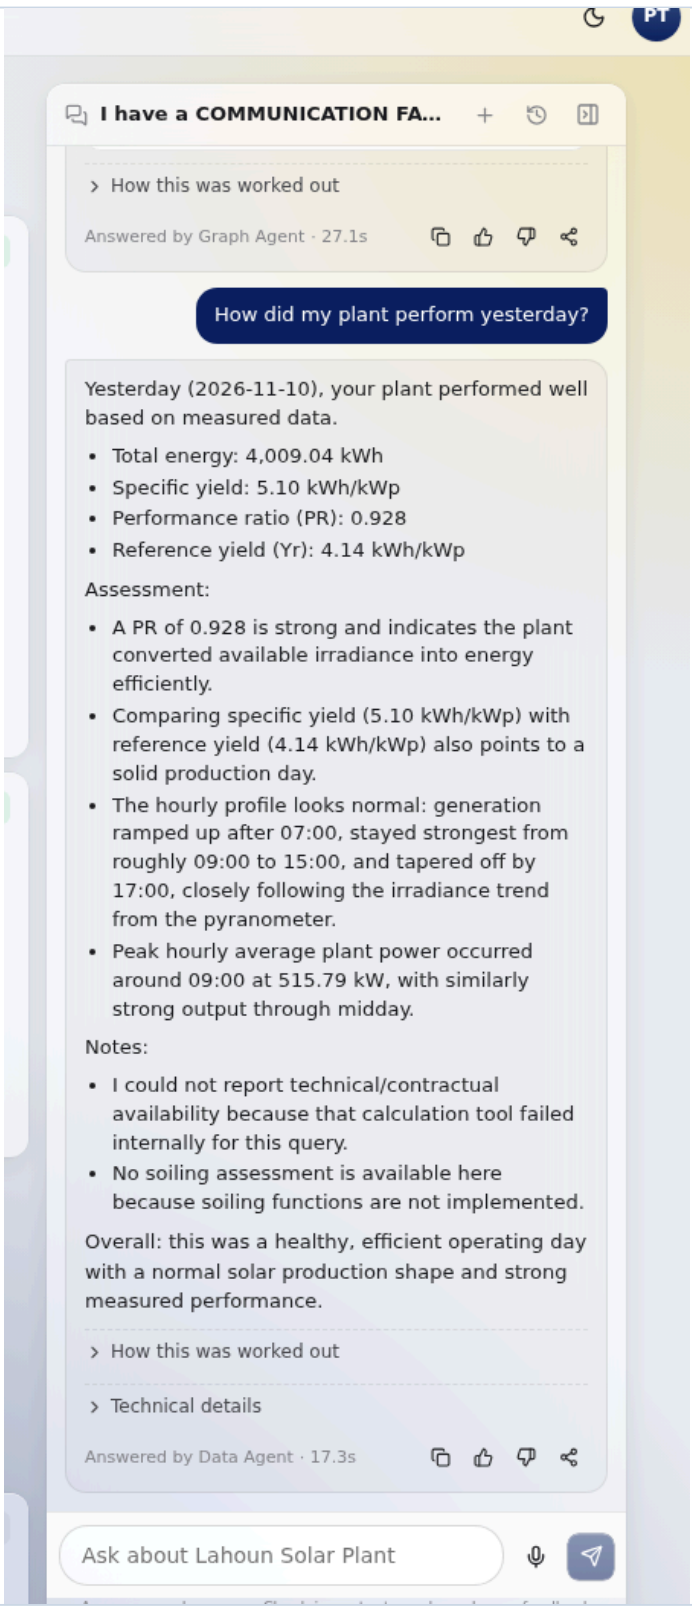
PT
I have a COMMUNICATION FA...
How this was worked out
Answered by Graph Agent · 27.1s
How did my plant perform yesterday?
Yesterday (2026-11-10), your plant performed well based on measured data.
• Total energy: 4,009.04 kWh
• Specific yield: 5.10 kWh/kWp
• Performance ratio (PR): 0.928
• Reference yield (Yr): 4.14 kWh/kWp
Assessment:
• A PR of 0.928 is strong and indicates the plant converted available irradiance into energy efficiently.
• Comparing specific yield (5.10 kWh/kWp) with reference yield (4.14 kWh/kWp) also points to a solid production day.
• The hourly profile looks normal: generation ramped up after 07:00, stayed strongest from roughly 09:00 to 15:00, and tapered off by 17:00, closely following the irradiance trend from the pyranometer.
• Peak hourly average plant power occurred around 09:00 at 515.79 kW, with similarly strong output through midday.
Notes:
• I could not report technical/contractual availability because that calculation tool failed internally for this query.
• No soiling assessment is available here because soiling functions are not implemented.
Overall: this was a healthy, efficient operating day with a normal solar production shape and strong measured performance.
How this was worked out
Technical details
Answered by Data Agent · 17.3s
Ask about Lahoun Solar Plant

# Q20 · passed

### Is there shading happening with my plant? Please analyze the pyranometer and check for frequent dips at certain times

Duration: 40.1 seconds · Returned 30-day pyranometer dip analysis with 388 points, recurring morning/afternoon windows, solar-azimuth patterns, method and alternative sensor/model/weather explanations. Findings were not independently recalculated or confirmed on site.

## Observed answer

I analyzed the last 30 days of available pyranometer data (2026-10-12 to 2026-11-10/11 morning) against modelled POA and looked for recurring intraday dips.

Findings:

There are frequent recurring daytime dips, which is consistent with possible shading or another repeatable obstruction pattern.
I found 388 dip points across 30 days.
The strongest recurrence is in the late afternoon:
16:30 bin: 40 dip points across 21 days, median dip about 20.2%
16:00 bin: 26 dip points across 16 days, median dip about 21.7%
There is also a recurring morning feature:
07:30 bin: 25 dip points across 13 days, median dip about 21.2%
07:00 bin: 22 dip points across 13 days, median dip about 20.6%

Azimuth pattern:

The most frequent dip direction is around azimuth 240–249° (west-southwest / late afternoon):
azimuth bin 240°: 70 dip points across 26 days
A second recurring direction is around azimuth 110–119° (east-southeast / morning):
azimuth bin 110°: 38 dip points across 19 days

Interpretation:

The recurrence at similar times and solar azimuths strongly suggests fixed-object shading is plausible.
The strongest candidate window is late afternoon, around 16:00–16:30, with the sun near azimuth 240–246°.
A secondary candidate window is early morning, around 07:00–07:30, with the sun near azimuth ~111°.
Because the measured/modelled daytime ratio is generally low overall (median 0.633), some of the deficit may also reflect sensor bias, tilt/model mismatch, dirt, or weather effects rather than shading alone. I can assess shading-like recurrence from the pyranometer pattern, but I can’t evaluate soiling specifically.

Method used:


Compared measured pyranometer_1 to modelled_poa_1.

Considered daytime points only (zenith < 85°, modelled POA > 200 W/m²).
Flagged dips where measured/modelled POA fell at least 12% below a 1-hour centered rolling median baseline.

Bottom line:

Yes, the pyranometer data shows recurring dips at particular times, especially around 07:00–07:30 and 16:00–16:30, which is consistent with possible shading from fixed obstacles.
How this was worked out
Technical details
Answered by Data Agent
· 29.4s

## Browser evidence

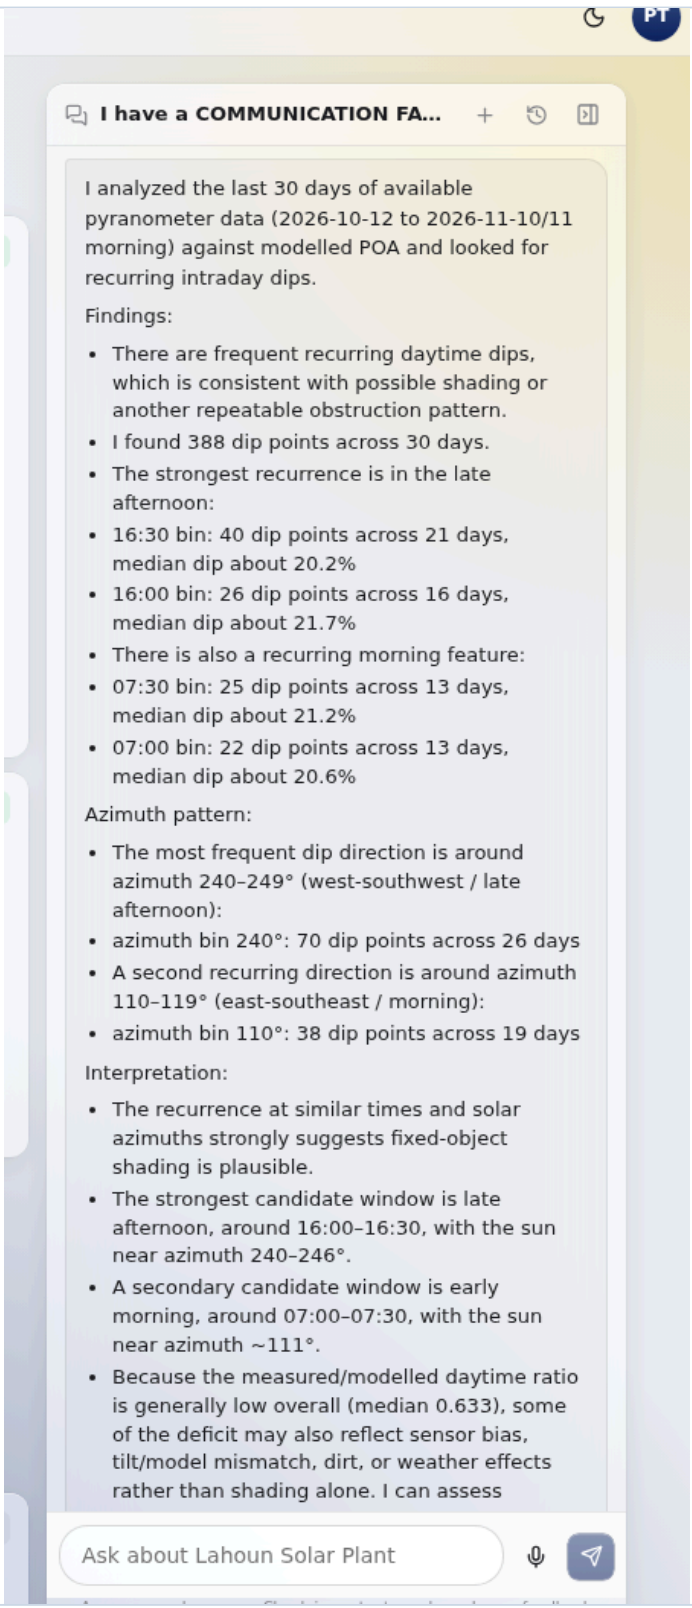
PT
I have a COMMUNICATION FA...
I analyzed the last 30 days of available pyranometer data (2026-10-12 to 2026-11-10/11 morning) against modelled POA and looked for recurring intraday dips.
Findings:
• There are frequent recurring daytime dips, which is consistent with possible shading or another repeatable obstruction pattern.
• I found 388 dip points across 30 days.
• The strongest recurrence is in the late afternoon:
• 16:30 bin: 40 dip points across 21 days, median dip about 20.2%
• 16:00 bin: 26 dip points across 16 days, median dip about 21.7%
• There is also a recurring morning feature:
• 07:30 bin: 25 dip points across 13 days, median dip about 21.2%
• 07:00 bin: 22 dip points across 13 days, median dip about 20.6%
Azimuth pattern:
• The most frequent dip direction is around azimuth 240–249° (west-southwest / late afternoon):
• azimuth bin 240°: 70 dip points across 26 days
• A second recurring direction is around azimuth 110–119° (east-southeast / morning):
• azimuth bin 110°: 38 dip points across 19 days
Interpretation:
• The recurrence at similar times and solar azimuths strongly suggests fixed-object shading is plausible.
• The strongest candidate window is late afternoon, around 16:00–16:30, with the sun near azimuth 240–246°.
• A secondary candidate window is early morning, around 07:00–07:30, with the sun near azimuth ~111°.
• Because the measured/modelled daytime ratio is generally low overall (median 0.633), some of the deficit may also reflect sensor bias, tilt/model mismatch, dirt, or weather effects rather than shading alone. I can assess
Ask about Lahoun Solar Plant

# Q2 · passed

### Based on pvsyst report, what is the rated power of this plant and array configuration

Duration: 17.3 seconds · PVsyst retrieval returned two relevant plant-specific source sections and table-image references. Pass is limited to source retrieval: rated power and array configuration were not extracted into a direct prose answer.

## Observed answer

Found 2 relevant PVsyst report sections:

[Abdali_Mall_Lahoun] System summary (Page 2, Table 2)
[Abdali_Mall_Lahoun] PV Array Characteristics (Page 3, Table 2)

Please access the URLs to view the requested information.

How this was worked out
Technical details
Answered by PVsyst Agent
· 6.6s

## Browser evidence

PT

I have a COMMUNICATION FA...

- Because the measured/modelled daytime ratio is generally low overall (median 0.633), some of the deficit may also reflect sensor bias, tilt/model mismatch, dirt, or weather effects rather than shading alone. I can assess shading-like recurrence from the pyranometer pattern, but I can't evaluate soiling specifically.

Method used:

- Compared measured pyranometer_1 to modelled_poa_1.
- Considered daytime points only (zenith < 85°, modelled POA > 200 W/m²).
- Flagged dips where measured/modelled POA fell at least 12% below a 1-hour centered rolling median baseline.

Bottom line:

- Yes, the pyranometer data shows recurring dips at particular times, especially around 07:00–07:30 and 16:00–16:30, which is consistent with possible shading from fixed obstacles.

› How this was worked out

› Technical details

Answered by Data Agent · 29.4s


Based on pvsyst report, what is the rated power of this plant and array configuration

Found 2 relevant PVsyst report sections:

1. [Abdali_Mall_Lahoun] System summary (Page 2, Table 2)
2. [Abdali_Mall_Lahoun] PV Array Characteristics (Page 3, Table 2)

Please access the URLs to view the requested information.





› How this was worked out

Ask about Lahoun Solar Plant

# Q6 · passed

### Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3

Duration: 23.4 seconds · Inverter 3 current/voltage visualization returned eight traces at raw five-minute granularity. No independent sensor-value accuracy check performed.

## Observed answer

I've created the visualization for you.

Inverter 3 Current and Voltage (Raw 5-Min Data)
Pin
How this was worked out
Answered by Graph Agent
· 12.9s

## Browser evidence


PT

I have a COMMUNICATION FA...

1. [Abdali_Mall_Lahoun] System summary (Page 2, Table 2)
2. [Abdali_Mall_Lahoun] PV Array Characteristics (Page 3, Table 2)

Please access the URLs to view the requested information.





› How this was worked out


› Technical details

Answered by PVsyst Agent · 6.6s

Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3

I've created the visualization for you.

**Inverter 3 Current and Voltage ...** Pin

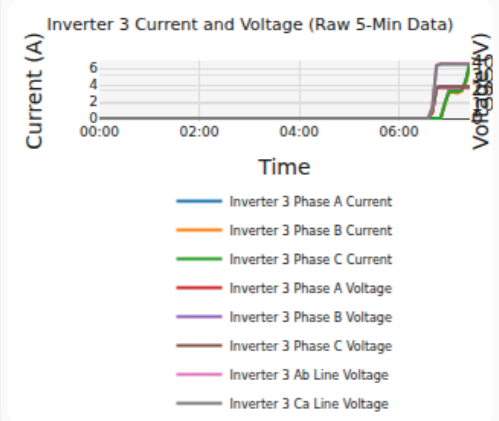


› How this was worked out

Answered by Graph Agent · 12.9s

Ask about Lahoun Solar Plant

# Q10 · review

### When was the last time the BOM data showed up

Duration: 20.4 seconds · The answer now states a last-BOM timestamp of November 11 07:25, unlike the previous no-BOM answer. Captured response does not expose underlying BOM-specific rows/column mapping, so source identity and timestamp correctness remain unverified.

## Observed answer

The most recent timestamp where the BOM data was present is 2026-11-11 07:25:00.

This is also the latest timestamp available in the returned dataset before the normal API refresh cutoff.

How this was worked out
Technical details
Answered by Data Agent
· 9.4s

## Browser evidence


I have a COMMUNICATION FA...

Answered by PVsyst Agent · 6.6s

Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3

I've created the visualization for you.

**Inverter 3 Current and Voltage ...** Pin

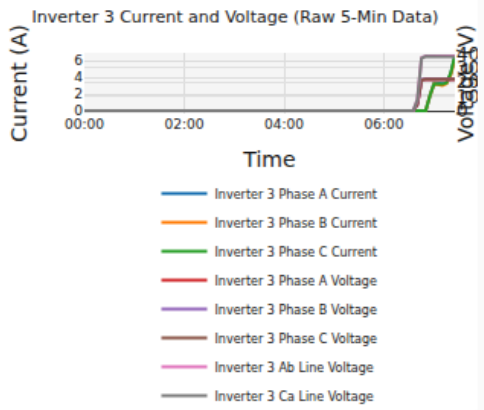


› How this was worked out

Answered by Graph Agent · 12.9s

When was the last time the BOM data showed up

The most recent timestamp where the BOM data was present is 2026-11-11 07:25:00.

This is also the latest timestamp available in the returned dataset before the normal API refresh cutoff.

› How this was worked out

› Technical details

Answered by Data Agent · 9.4s

Ask about Lahoun Solar Plant

# Q19 · passed

### Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt

Duration: 21.9 seconds · Returned daily-POA median, mean and kurtosis over 314 non-NaN daily totals, with missing-day and incomplete-current-day caveats. Full daily series was not listed; numerical results were not independently recalculated.

## Observed answer


For the last 12 months (2025-11-11 to 2026-11-11), using daily POA totals derived from pyranometer_1, the statistics of the daily summed POA are:

Median daily POA: 5716.27 Wh/m²
Mean daily POA: 5734.01 Wh/m²
Kurtosis: -0.2249
Non-NaN daily totals used: 314 days

Notes:

The latest day, 2026-11-11, is incomplete because data only extends to 07:25.
There are multiple missing days in the 12-month window, so the stats were computed on available non-NaN daily totals only.
How this was worked out
Technical details
Answered by Data Agent
· 11.5s

## Browser evidence

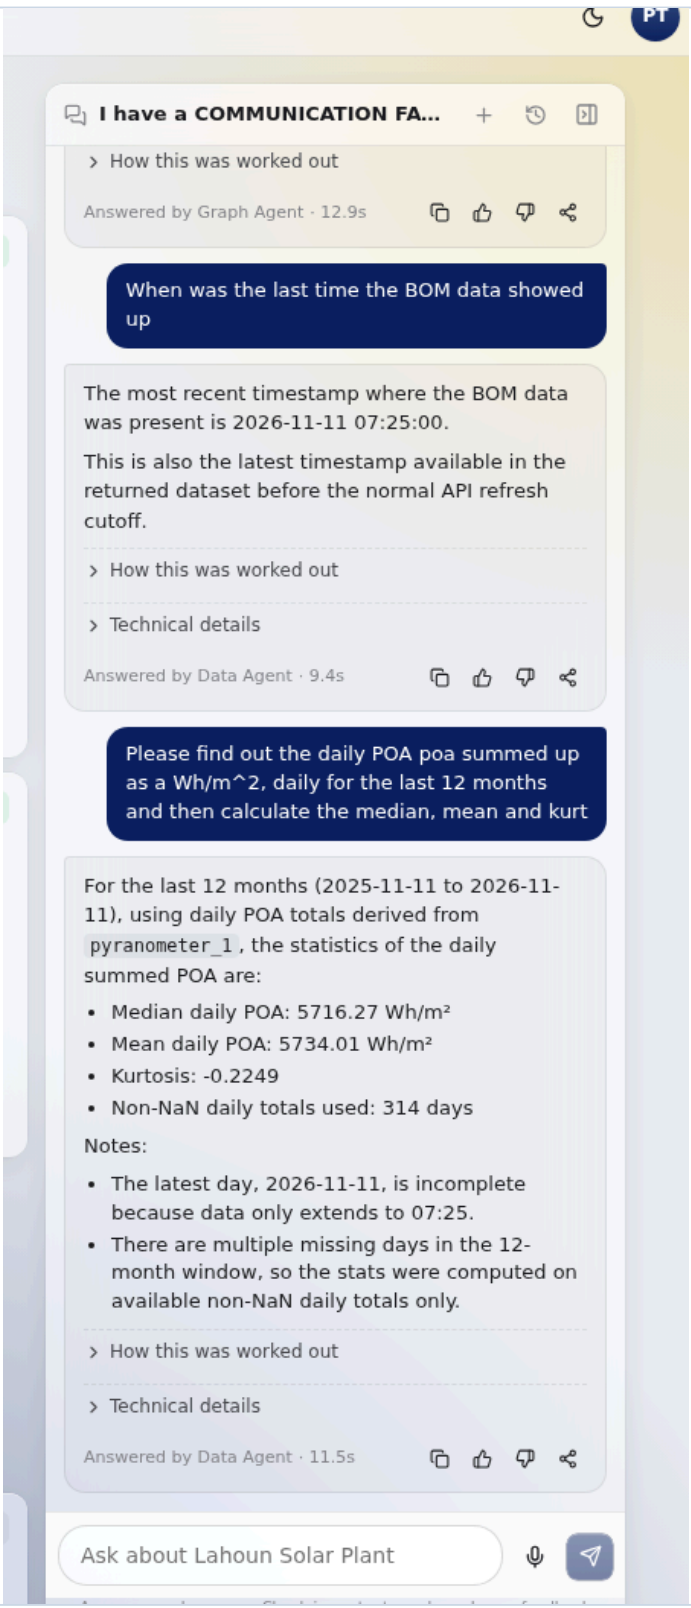
PT
I have a COMMUNICATION FA...
How this was worked out
Answered by Graph Agent · 12.9s
When was the last time the BOM data showed up
The most recent timestamp where the BOM data was present is 2026-11-11 07:25:00.
This is also the latest timestamp available in the returned dataset before the normal API refresh cutoff.
How this was worked out
Technical details
Answered by Data Agent · 9.4s
Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt
For the last 12 months (2025-11-11 to 2026-11-11), using daily POA totals derived from pyranometer_1, the statistics of the daily summed POA are:
Median daily POA: 5716.27 Wh/m²
Mean daily POA: 5734.01 Wh/m²
Kurtosis: -0.2249
Non-NaN daily totals used: 314 days
Notes:
The latest day, 2026-11-11, is incomplete because data only extends to 07:25.
There are multiple missing days in the 12-month window, so the stats were computed on available non-NaN daily totals only.
How this was worked out
Technical details
Answered by Data Agent · 11.5s
Ask about Lahoun Solar Plant

# Q14 · review

### Pull up the latest cleaning log

Duration: 14.3 seconds · Informational/no records: no November 2026 cleaning logs returned. The query does not establish whether an older latest cleaning entry exists.

## Observed answer

There are no cleaning logs for Abdali_Mall_Lahoun so far in November 2026.

Technical details
Answered by Data Entry Agent
· 3.5s

## Browser evidence


PT
I have a COMMUNICATION FA...
This is also the latest timestamp available in the returned dataset before the normal API refresh cutoff.
How this was worked out
Technical details
Answered by Data Agent · 9.4s
Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt
For the last 12 months (2025-11-11 to 2026-11-11), using daily POA totals derived from pyranometer_1, the statistics of the daily summed POA are:
Median daily POA: 5716.27 Wh/m²
Mean daily POA: 5734.01 Wh/m²
Kurtosis: -0.2249
Non-NaN daily totals used: 314 days
Notes:
The latest day, 2026-11-11, is incomplete because data only extends to 07:25.
There are multiple missing days in the 12-month window, so the stats were computed on available non-NaN daily totals only.
How this was worked out
Technical details
Answered by Data Agent · 11.5s
Pull up the latest cleaning log
There are no cleaning logs for Abdali_Mall_Lahoun so far in November 2026.
Technical details
Answered by Data Entry Agent · 3.5s
Ask about Lahoun Solar Plant

# Q15 · review

### Jim cleaned the pyranometer today, can you add it to the cleaning log?

Duration: 12.7 seconds · Clarification required: assistant asked for Fault Cause, Action Taken and Status. No missing fields invented, no follow-up submitted and no cleaning log saved or save/retrieval verified.

## Observed answer

To add a cleaning log entry, please provide the following required details:


Fault Cause
Action Taken
Status

Site will be set automatically from the connected plant.

Optional fields you can also provide, but they are not required:

Activity Type (Inspection, Cleaning, HSE Incident, Spare Parts Usage, General Site Activity)
Priority
Responsibility
Estimated Duration
Start Work Time
End Work Time
Spare Part Use
Number Of Staff
Images
Notes
Technical details
Answered by Data Entry Agent
· 2.7s

## Browser evidence

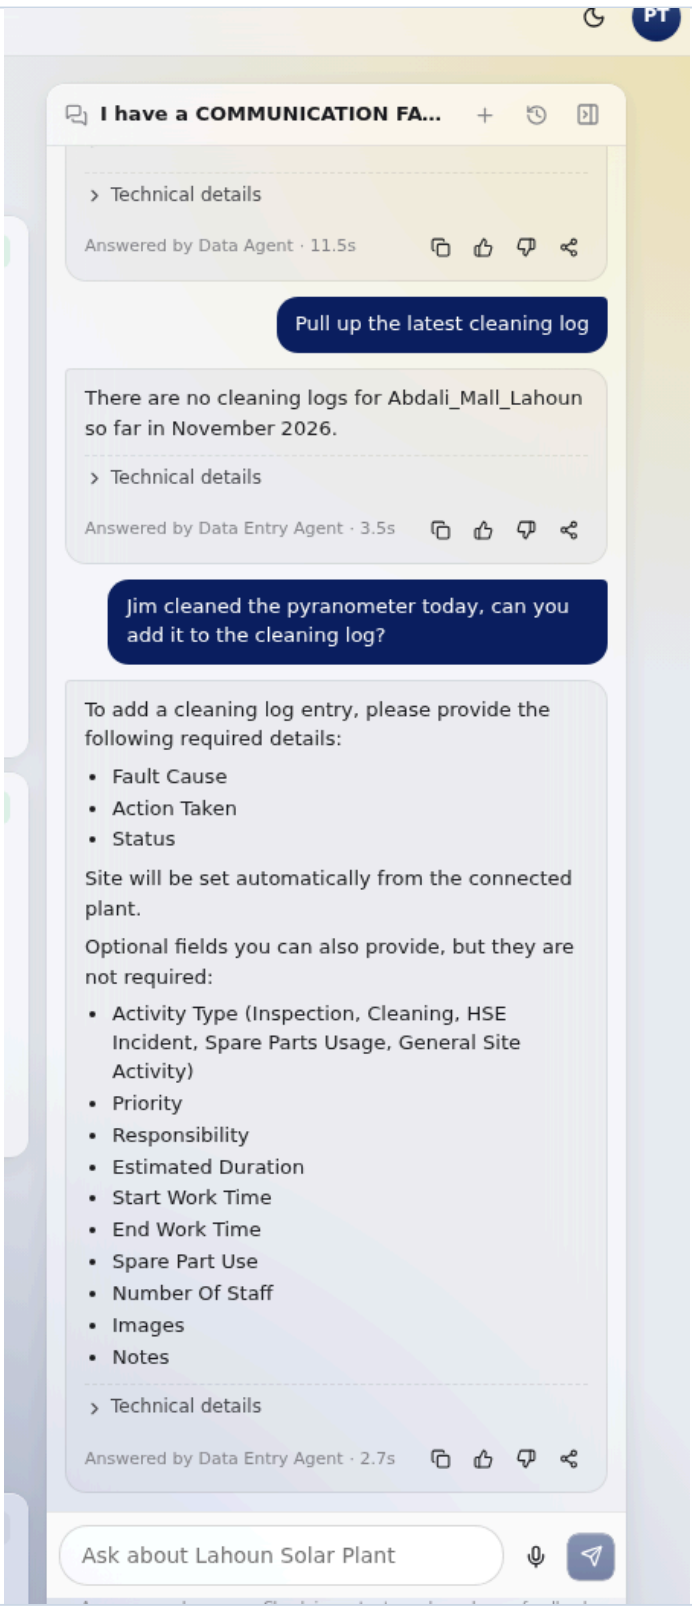
PT
I have a COMMUNICATION FA...
Technical details
Answered by Data Agent · 11.5s
Pull up the latest cleaning log
There are no cleaning logs for Abdali_Mall_Lahoun so far in November 2026.
Technical details
Answered by Data Entry Agent · 3.5s
Jim cleaned the pyranometer today, can you add it to the cleaning log?
To add a cleaning log entry, please provide the following required details:
Fault Cause
Action Taken
Status
Site will be set automatically from the connected plant.
Optional fields you can also provide, but they are not required:
Activity Type (Inspection, Cleaning, HSE Incident, Spare Parts Usage, General Site Activity)
Priority
Responsibility
Estimated Duration
Start Work Time
End Work Time
Spare Part Use
Number Of Staff
Images
Notes
Technical details
Answered by Data Entry Agent · 2.7s
Ask about Lahoun Solar Plant

# Q8 · passed

### How can I shut down my inverters?

Duration: 21.9 seconds · Manufacturer shutdown guidance, diagrams and manual PDF reference returned. No equipment shutdown or physical procedure performed; instructions were not independently safety-certified.

## Observed answer

The safe shutdown procedure for your inverter (STP 110-60) from the manufacturer manual is as follows:

Disconnect the AC miniature circuit breaker and secure it against reconnection.
Switch off all four DC load-break switches on the inverter, securing them against reconnection.
Reference layout diagram for DC load-break switches:
Wait until all LEDs on the inverter are off before proceeding.
Use a current clamp to verify there is no current present in the DC cables.
DC cable current check:
Note and record the position of each DC connector for correct reassembly, using the following diagram for reference:
DC connector position:

Important: Only use measuring devices with a DC input voltage range of 1100 V or higher for verification. Follow the shutdown sequence exactly and ensure all circuit breakers and switches are secured against accidental reconnection.

Manual reference (PDF): https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

STP_110-60_Manual.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Technical details
Answered by Manual Agent
· 11.2s

## Browser evidence

PT


I have a COMMUNICATION FA...

Answered by Data Entry Agent · 2.7s


How can I shut down my inverters?

The safe shutdown procedure for your inverter (STP 110-60) from the manufacturer manual is as follows:


1. Disconnect the AC miniature circuit breaker and secure it against reconnection.
2. Switch off all four DC load-break switches on the inverter, securing them against reconnection.
3. Reference layout diagram for DC load-break switches:

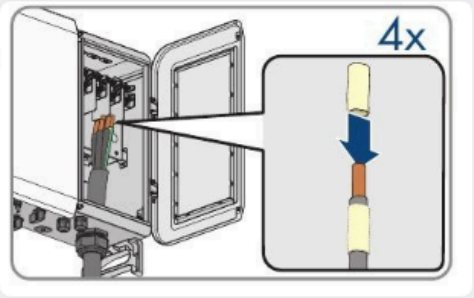


4. Wait until all LEDs on the inverter are off before proceeding.
5. Use a current clamp to verify there is no current present in the DC cables.
6. DC cable current check:

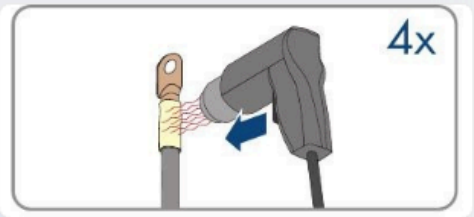


7. Note and record the position of each DC connector for correct reassembly, using the following diagram for reference:
8. DC connector position:



Ask about Lahoun Solar Plant

# Q13 · passed

### Please change to dark mode

Duration: 19.2 seconds · Dark-mode action returned and the fresh browser screenshot visibly confirms the dark theme.

## Observed answer


Sure, I will turn on dark mode

Answered by UI Agent
· 2.4s


## Browser evidence

PT

I have a COMMUNICATION FA...

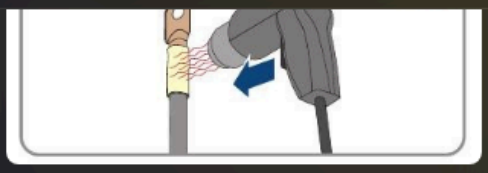

7. Note and record the position of each DC connector for correct reassembly, using the following diagram for reference:
8. DC connector position:

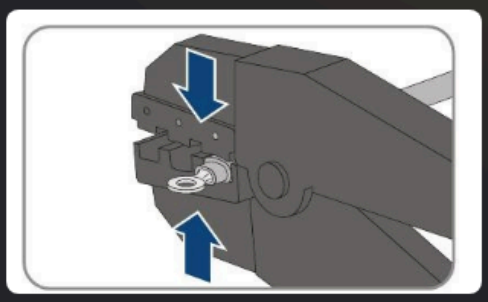

Important: Only use measuring devices with a DC input voltage range of 1100 V or higher for verification. Follow the shutdown sequence exactly and ensure all circuit breakers and switches are secured against accidental reconnection.

Manual reference (PDF): https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

**STP_110-60_Manual.pdf**
PDF report

Preview | Open in a new tab

› How this was worked out

› Technical details

Answered by Manual Agent · 11.2s

Please change to dark mode

Sure, I will turn on dark mode

Answered by UI Agent · 2.4s

Ask about Lahoun Solar Plant

# Q21 · passed

### Please figure out how much clipping loss was found in the last 2 months broken by inverters, list them down and plot it as well

Duration: 35.7 seconds · Returned six per-inverter clipping totals and a six-trace daily chart for September 11–November 11, with partial-end-date caveat. Numerical values and success of every named underlying tool were not independently verified.

## Observed answer

Clipping loss by inverter for the last two months (2026-09-11 to 2026-11-11):

Inverter 1: 2,973.27 kWh
Inverter 2: 3,084.91 kWh
Inverter 3: 1,281.78 kWh
Inverter 4: 1,421.36 kWh
Inverter 5: 1,181.84 kWh
Inverter 6: 964.79 kWh

A chart showing daily clipping loss by inverter has been created.

Data note: The dataset ends at 2026-11-11 07:25, so that date is only partially covered.

Daily Clipping Loss by Inverter - Last 2 Months
Pin
How this was worked out
Technical details
Answered by Data Agent, Graph Agent
· 25.2s

## Browser evidence

I have a COMMUNICATION FA...

Answered by UI Agent · 2.4s

Please figure out how much clipping loss was found in the last 2 months broken by inverters, list them down and plot it as well


Clipping loss by inverter for the last two months (2026-09-11 to 2026-11-11):

- Inverter 1: 2,973.27 kWh
- Inverter 2: 3,084.91 kWh
- Inverter 3: 1,281.78 kWh
- Inverter 4: 1,421.36 kWh
- Inverter 5: 1,181.84 kWh
- Inverter 6: 964.79 kWh

A chart showing daily clipping loss by inverter has been created.

Data note: The dataset ends at 2026-11-11 07:25, so that date is only partially covered.

**Daily Clipping Loss by Inverter ...** Pin

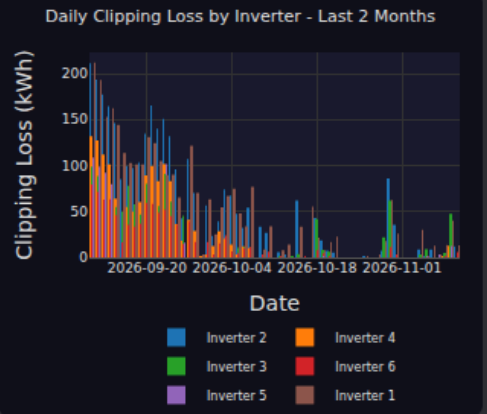


› How this was worked out

› Technical details

Answered by Data Agent, Graph Agent · 25.2s

Ask about Lahoun Solar Plant

# Q7 · failed

### Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)

Duration: 26.4 seconds · P2 memory/context failure persists: original first plot was hourly Inverter 2 MPPT PR for the last three days; follow-up instead used all six inverters and daily aggregation over two months. Twelve traces and dual axes were rendered, but original scope was lost.

## Observed answer


I've created the visualization for you.

Daily Specific Yield and Energy Production by Inverter - Last 2 Months
Pin
How this was worked out
Answered by Graph Agent
· 15.6s

## Browser evidence

PT

I have a COMMUNICATION FA...

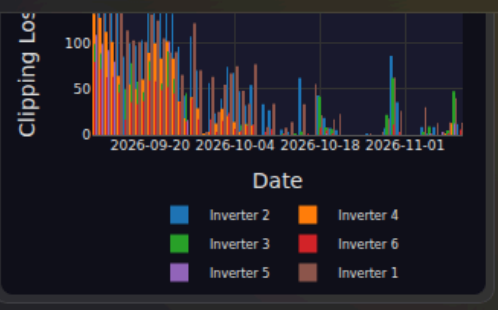


› How this was worked out


› Technical details

Answered by Data Agent, Graph Agent
· 25.2s

Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)

I've created the visualization for you.

**Daily Specific Yield and Energy ...** Pin

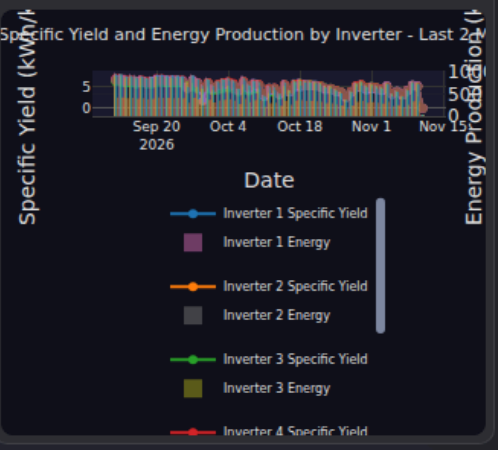


› How this was worked out

Answered by Graph Agent · 15.6s

Ask about Lahoun Solar Plant

# Q46 · passed

### Can you generate report for moth of september 2026

Duration: 14.3 seconds · September 2026 report downloaded as a readable 13-page Lahoun PDF for the correct period. Retrieval verified, not independent numerical accuracy.

## Observed answer

I've generated the external plant performance report for September 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_September_2026_external_report.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent
· 3.9s

## Browser evidence


PT

I have a COMMUNICATION FA...

Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)

I've created the visualization for you.

**Daily Specific Yield and Energy ...** Pin

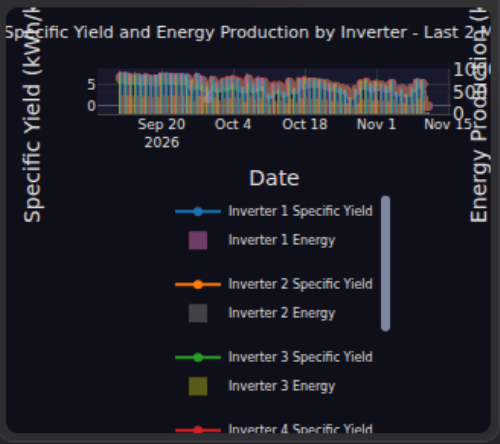


› How this was worked out

Answered by Graph Agent · 15.6s

Can you generate report for moth of september 2026

I've generated the external plant performance report for September 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

**Abdali_Mall_Lahoun_September_2026_e...**
PDF report


Preview Open in a new tab

› How this was worked out


Answered by Report Agent · 3.9s

Ask about Lahoun Solar Plant


# AI_brain_UI

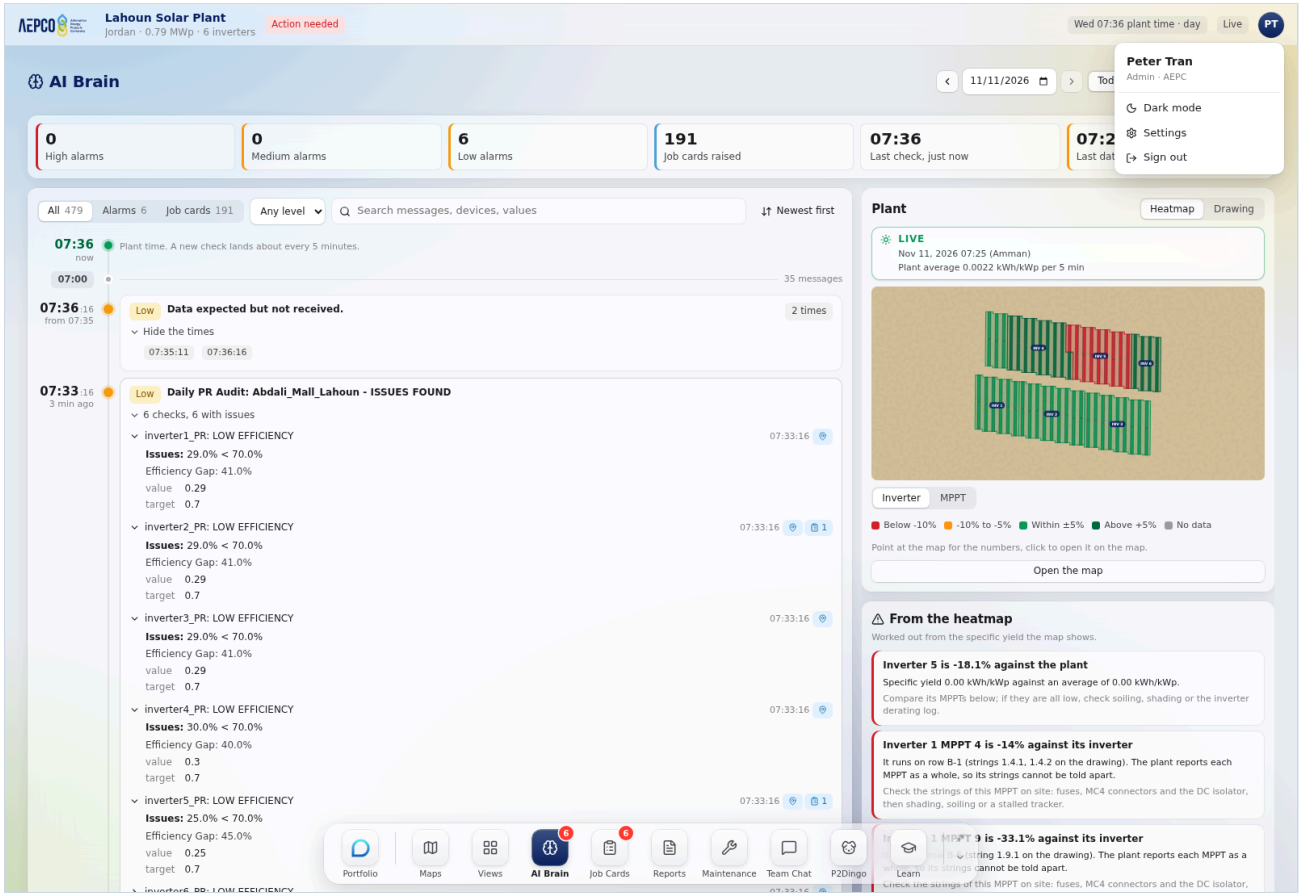
Lahoun Solar Plant
Jordan · 0.79 MWp · 6 inverters
Action needed
Wed 07:36 plant time · day
Live
PT
AI Brain
11/11/2026
Peter Tran
Admin · AEPC
Dark mode
Settings
Sign out
0
High alarms
0
Medium alarms
6
Low alarms
191
Job cards raised
07:36
Last check, just now
All 479
Alarms 6
Job cards 191
Any level
Search messages, devices, values
Newest first
07:36 now
Plant time. A new check lands about every 5 minutes.
07:00
35 messages
07:36:16 from 07:35
Low
Data expected but not received.
2 times
Hide the times
07:35:11
07:36:16
07:33:16 3 min ago
Low
Daily PR Audit: Abdali_Mall_Lahoun - ISSUES FOUND
6 checks, 6 with issues
inverter1_PR: LOW EFFICIENCY
07:33:16
Issues: 29.0% < 70.0%
Efficiency Gap: 41.0%
value 0.29
target 0.7
inverter2_PR: LOW EFFICIENCY
07:33:16
Issues: 29.0% < 70.0%
Efficiency Gap: 41.0%
value 0.29
target 0.7
inverter3_PR: LOW EFFICIENCY
07:33:16
Issues: 29.0% < 70.0%
Efficiency Gap: 41.0%
value 0.29
target 0.7
inverter4_PR: LOW EFFICIENCY
07:33:16
Issues: 30.0% < 70.0%
Efficiency Gap: 40.0%
value 0.3
target 0.7
inverter5_PR: LOW EFFICIENCY
07:33:16
Issues: 25.0% < 70.0%
Efficiency Gap: 45.0%
value 0.25
target 0.7
Plant
Heatmap
Drawing
LIVE
Nov 11, 2026 07:25 (Amman)
Plant average 0.0022 kWh/kWp per 5 min
Inverter
MPPT
Below -10%
-10% to -5%
Within ±5%
Above +5%
No data
Point at the map for the numbers, click to open it on the map.
Open the map
From the heatmap
Worked out from the specific yield the map shows.
Inverter 5 is -18.1% against the plant
Specific yield 0.00 kWh/kWp against an average of 0.00 kWh/kWp.
Compare its MPPTs below; if they are all low, check soiling, shading or the inverter derating log.
Inverter 1 MPPT 4 is -14% against its inverter
It runs on row B-1 (strings 1.4.1, 1.4.2 on the drawing). The plant reports each MPPT as a whole, so its strings cannot be told apart.
Check the strings of this MPPT on site: fuses, MC4 connectors and the DC isolator, then shading, soiling or a stalled tracker.
Portfolio
Maps
Views
AI Brain
Job Cards
Reports
Maintenance
Team Chat
P2Dingo
Learn

# Maintenance_UI

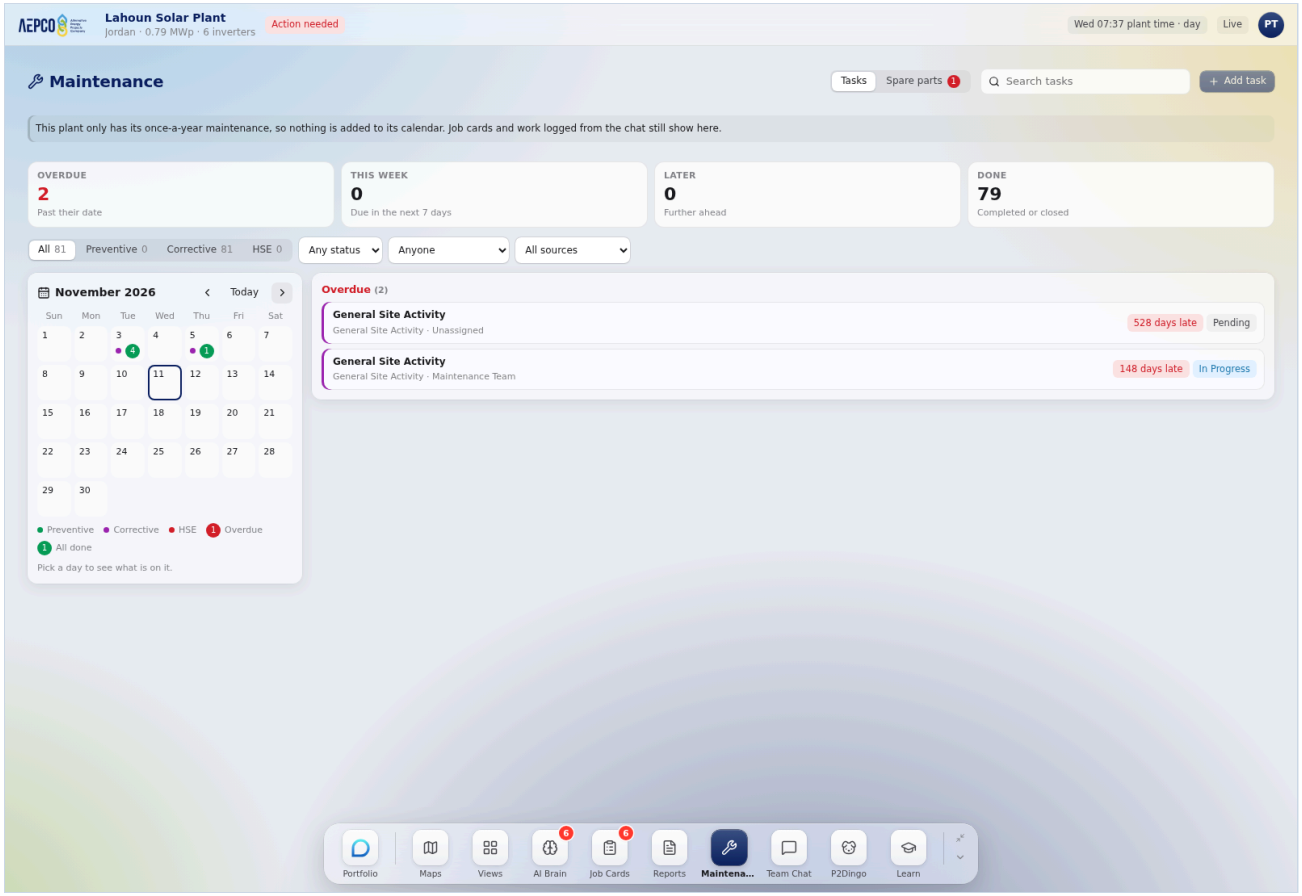


# Job_cards_UI

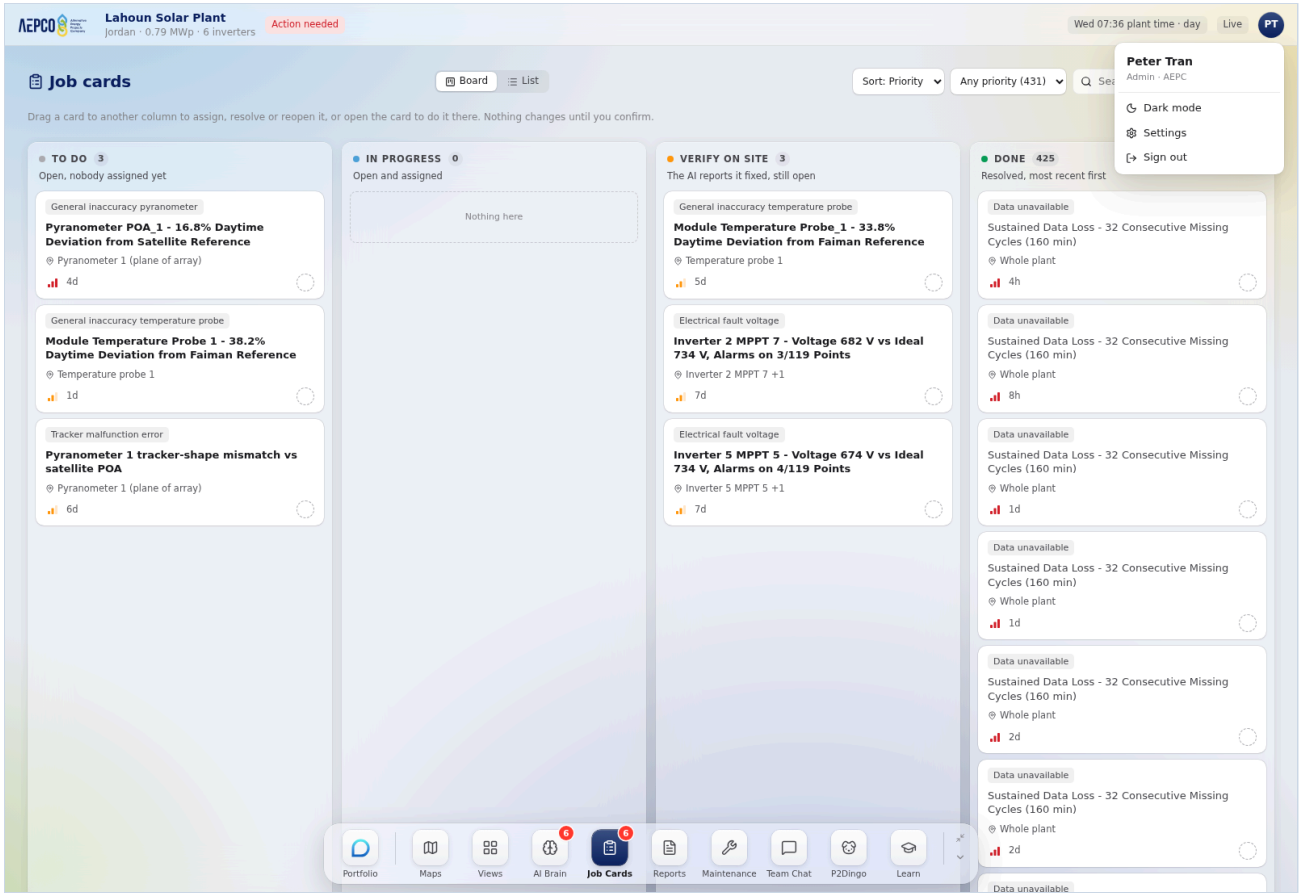
Lahoun Solar Plant
Jordan · 0.79 MWp · 6 inverters
Action needed
Wed 07:36 plant time · day
Live
PT
Peter Tran
Admin · AEPC
Dark mode
Settings
Sign out
Job cards
Board
List
Sort: Priority
Any priority (431)
Drag a card to another column to assign, resolve or reopen it, or open the card to do it there. Nothing changes until you confirm.
TO DO 3
Open, nobody assigned yet
General inaccuracy pyranometer
Pyranometer POA_1 - 16.8% Daytime Deviation from Satellite Reference
Pyranometer 1 (plane of array)
4d
General inaccuracy temperature probe
Module Temperature Probe 1 - 38.2% Daytime Deviation from Faiman Reference
Temperature probe 1
1d
Tracker malfunction error
Pyranometer 1 tracker-shape mismatch vs satellite POA
Pyranometer 1 (plane of array)
6d
IN PROGRESS 0
Open and assigned
Nothing here
VERIFY ON SITE 3
The AI reports it fixed, still open
General inaccuracy temperature probe
Module Temperature Probe_1 - 33.8% Daytime Deviation from Faiman Reference
Temperature probe 1
5d
Electrical fault voltage
Inverter 2 MPPT 7 - Voltage 682 V vs Ideal 734 V, Alarms on 3/119 Points
Inverter 2 MPPT 7 +1
7d
Electrical fault voltage
Inverter 5 MPPT 5 - Voltage 674 V vs Ideal 734 V, Alarms on 4/119 Points
Inverter 5 MPPT 5 +1
7d
DONE 425
Resolved, most recent first
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
4h
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
8h
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
1d
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
1d
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
2d
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
2d
Portfolio
Maps
Views
AI Brain
Job Cards
Reports
Maintenance
Team Chat
P2Dingo
Learn


# Job card evidence

## Pyranometer POA_1 - 16.8% Daytime Deviation from Satellite Reference

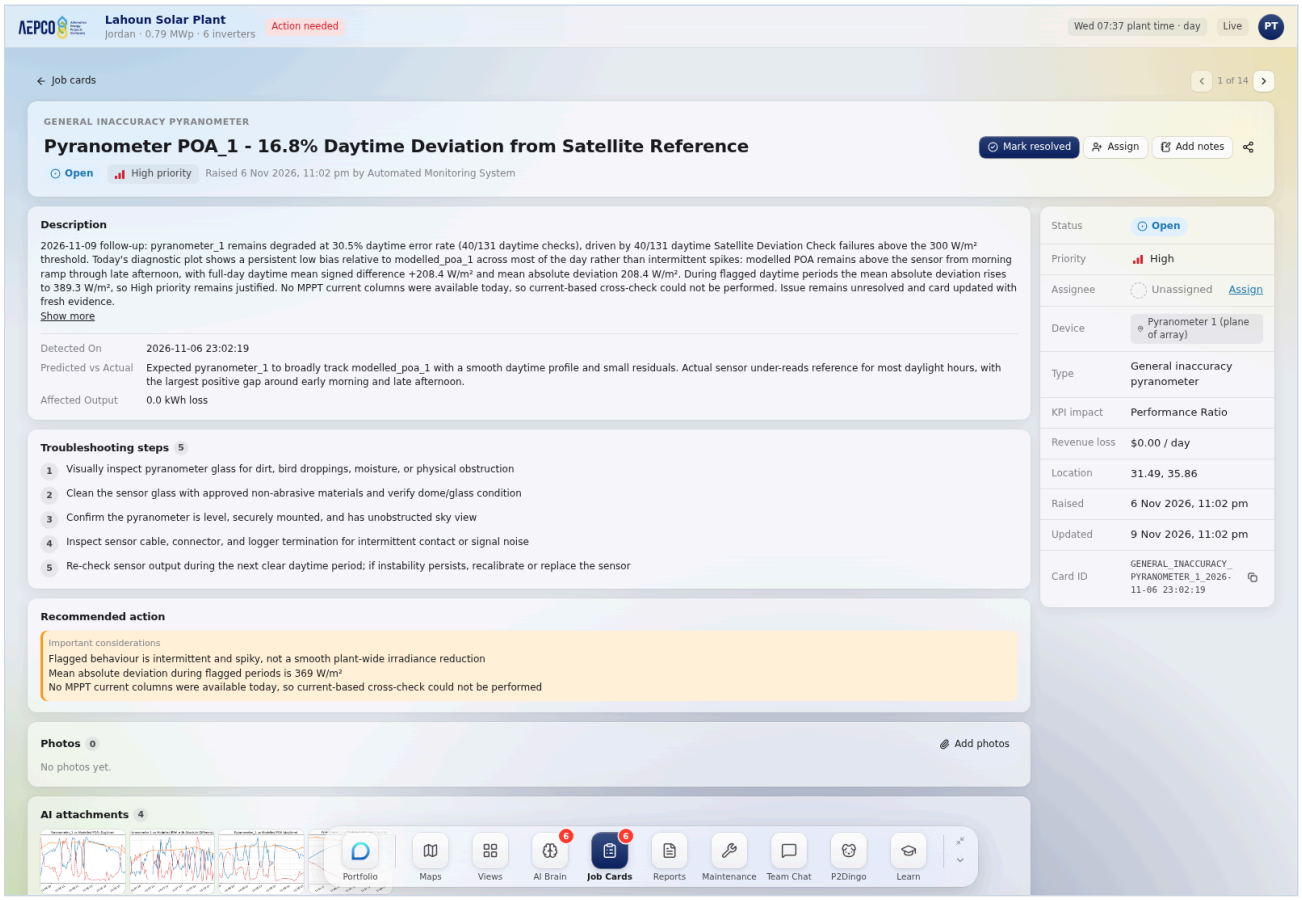


# Job card evidence

## Module Temperature Probe 1 - 38.2% Daytime Deviation from Faiman Reference

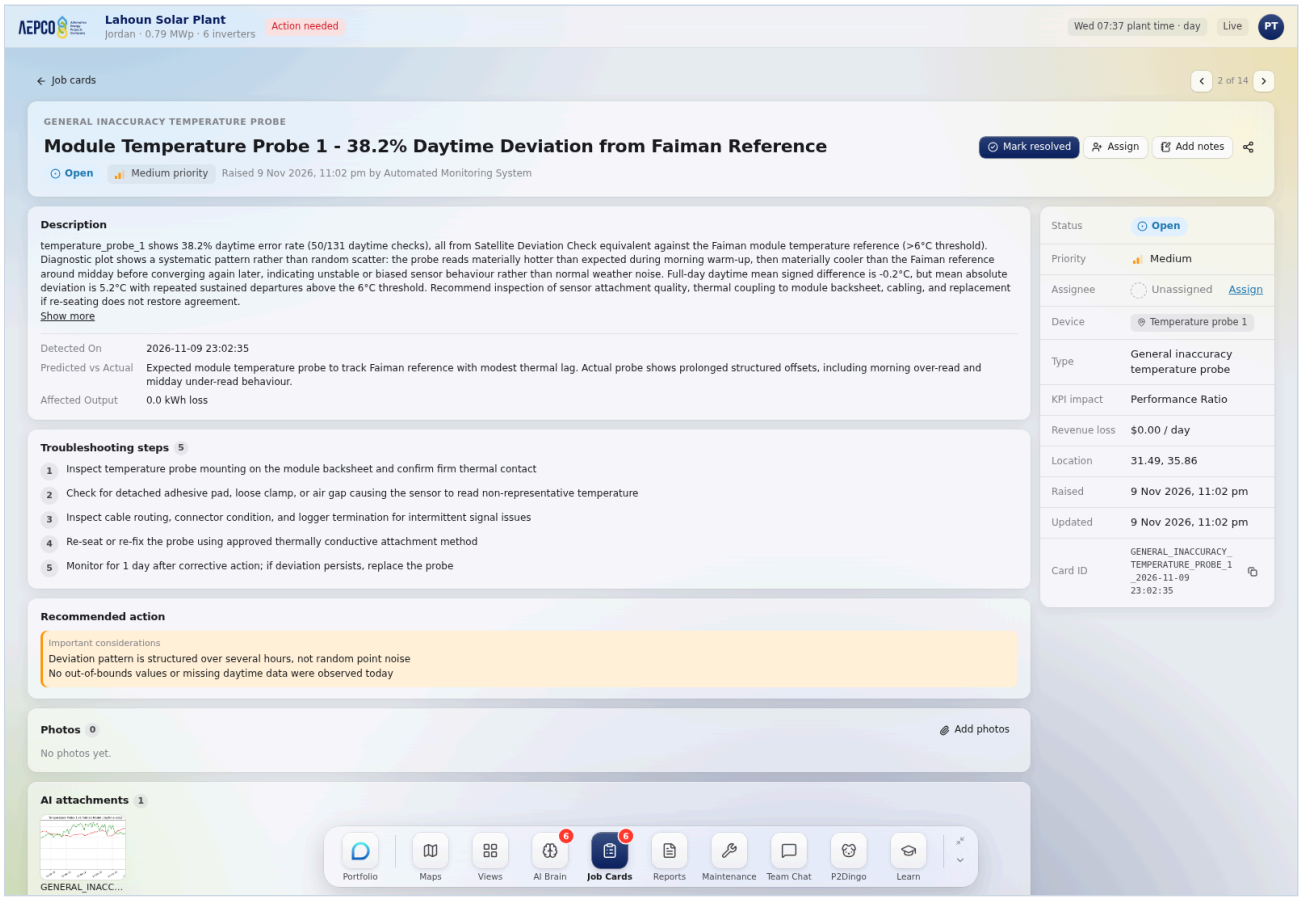


# Job card evidence

## Pyranometer 1 tracker-shape mismatch vs satellite POA

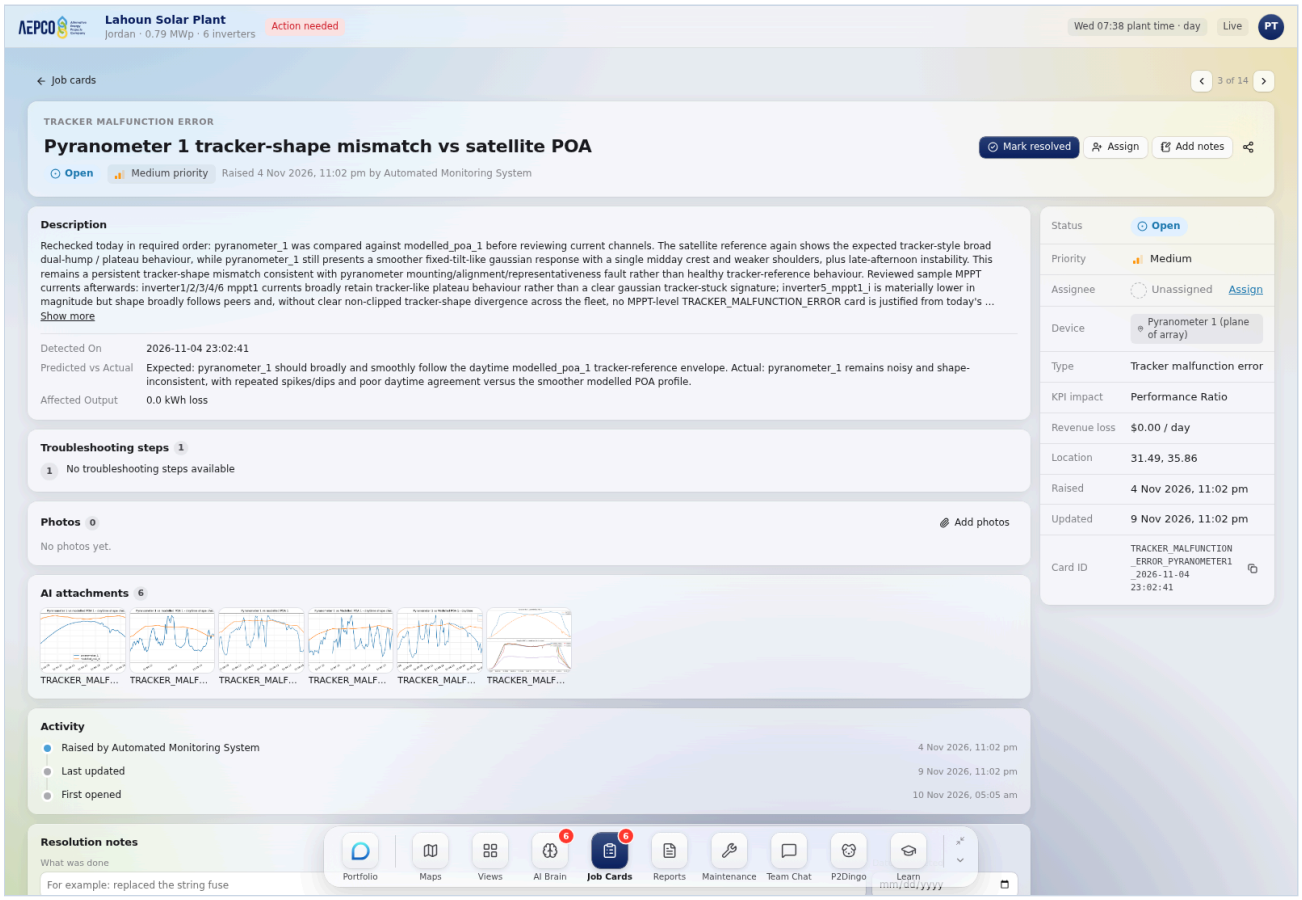


# Job card evidence

## Module Temperature Probe_1 - 33.8% Daytime Deviation from Faiman Reference

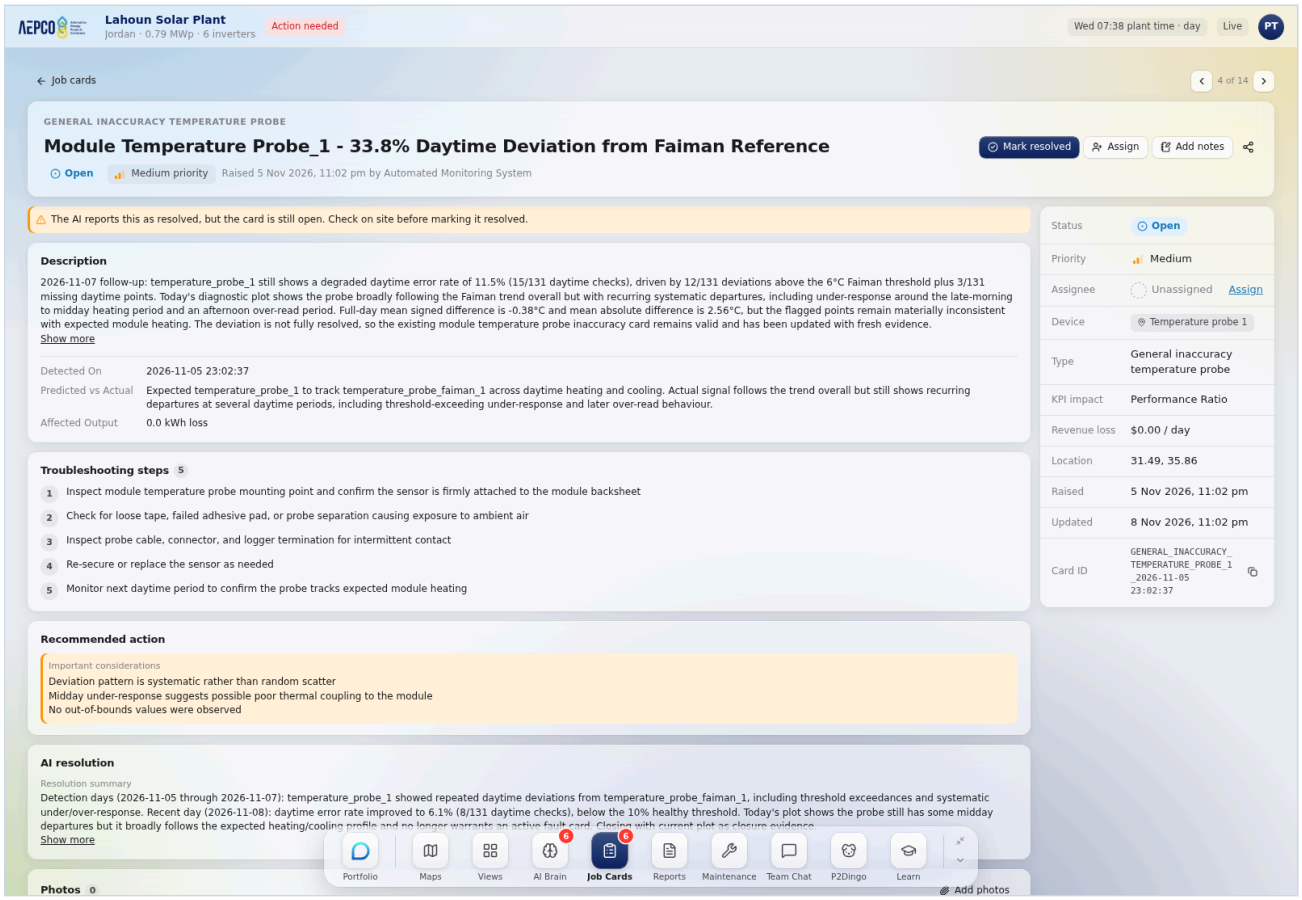


# Job card evidence

## Inverter 2 MPPT 7 - Voltage 682 V vs Ideal 734 V, Alarms on 3/119 Points

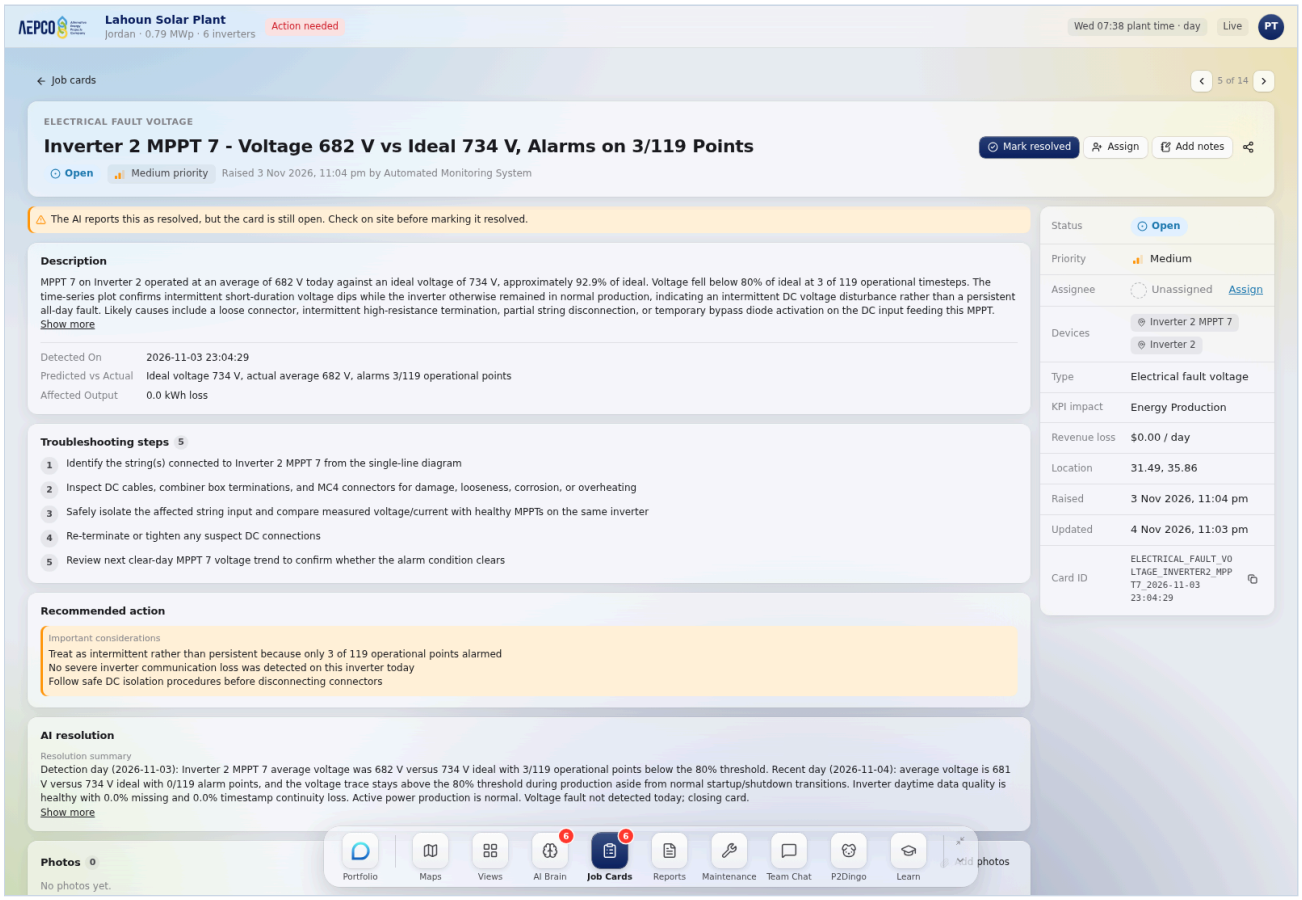


# Job card evidence

## Inverter 5 MPPT 5 - Voltage 674 V vs Ideal 734 V, Alarms on 4/119 Points

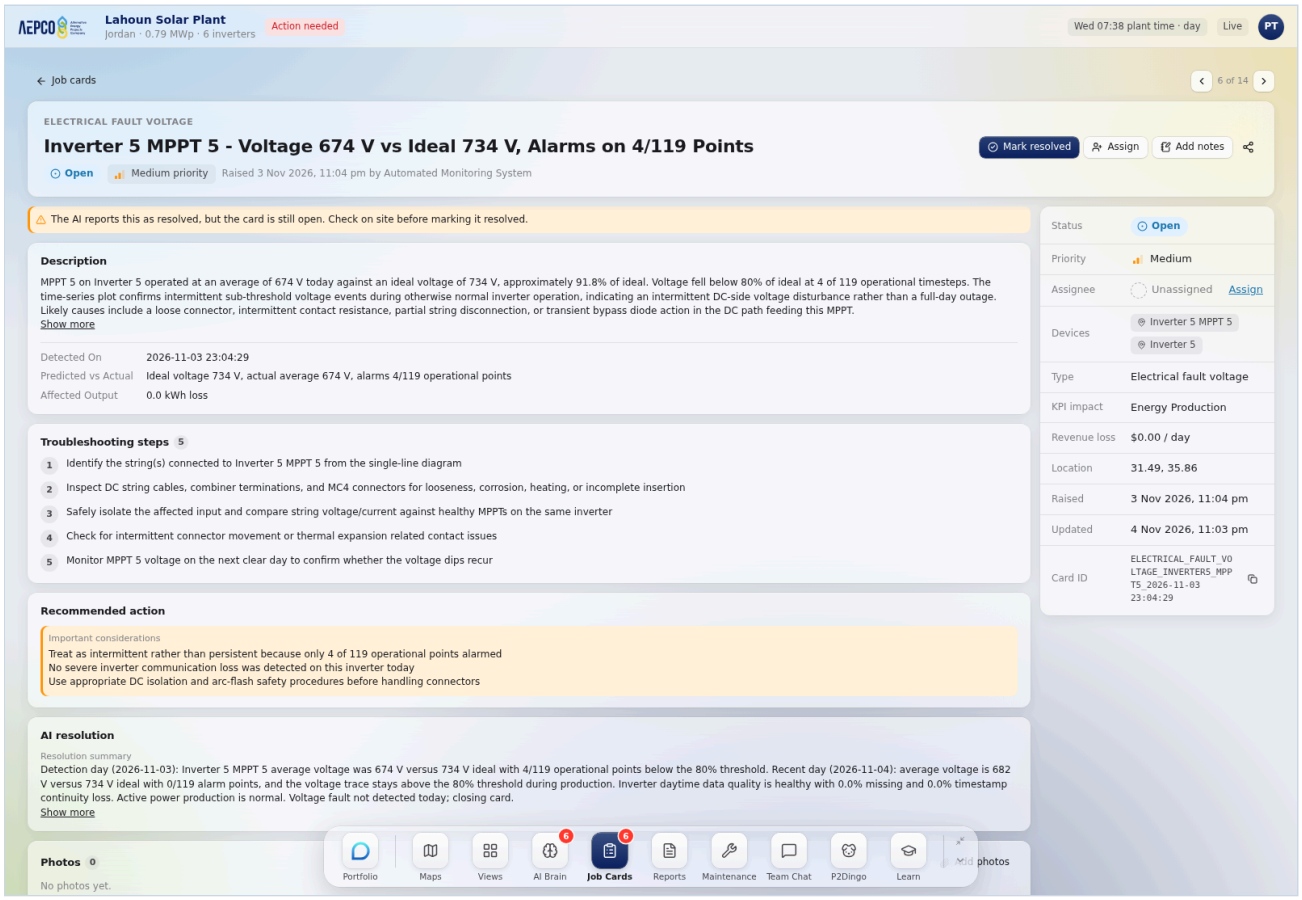

# Teams_UI

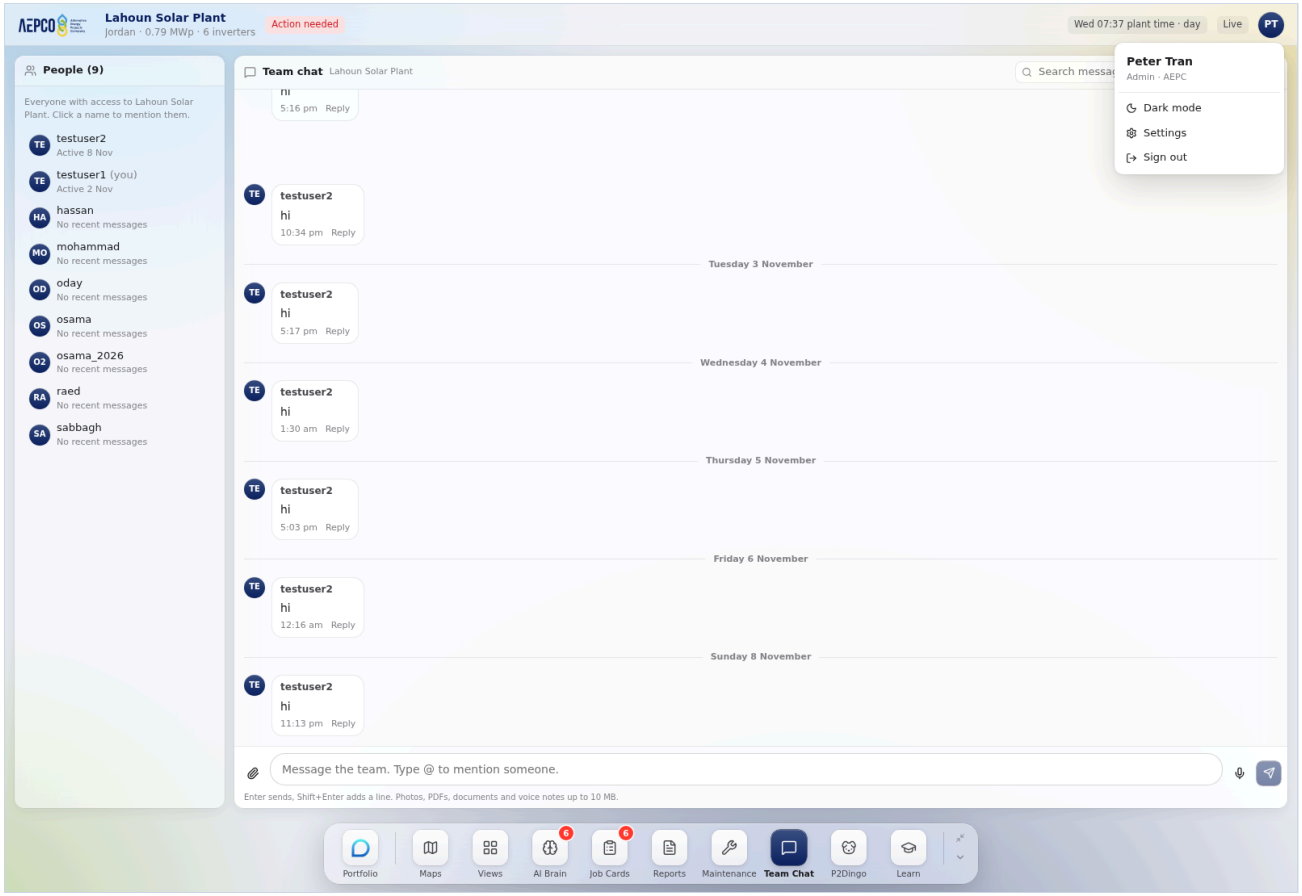
Lahoun Solar Plant
Jordan · 0.79 MWp · 6 inverters
Action needed
Wed 07:37 plant time · day
Live
PT
People (9)
Everyone with access to Lahoun Solar Plant. Click a name to mention them.
testuser2
Active 8 Nov
testuser1 (you)
Active 2 Nov
hassan
No recent messages
mohammad
No recent messages
oday
No recent messages
osama
No recent messages
osama_2026
No recent messages
raed
No recent messages
sabbagh
No recent messages
Team chat
Lahoun Solar Plant
Search messages
Peter Tran
Admin · AEPC
Dark mode
Settings
Sign out
5:16 pm Reply
testuser2
hi
10:34 pm Reply
Tuesday 3 November
testuser2
hi
5:17 pm Reply
Wednesday 4 November
testuser2
hi
1:30 am Reply
Thursday 5 November
testuser2
hi
5:03 pm Reply
Friday 6 November
testuser2
hi
12:16 am Reply
Sunday 8 November
testuser2
hi
11:13 pm Reply
Message the team. Type @ to mention someone.
Enter sends, Shift+Enter adds a line. Photos, PDFs, documents and voice notes up to 10 MB.
Portfolio
Maps
Views
AI Brain
Job Cards
Reports
Maintenance
Team Chat
P2Dingo
Learn

## Scope and limitations

- One-time standalone test; daily schedules and application source unchanged.
- Credentials and browser authentication state are not saved.
- Enabled suite texts and dates preserved; no independent calculation verification.
- A new standalone repeat run; previous evidence files were preserved.
- Functional review used current answers and artifact payloads, not earlier verdicts.
- No alert email, Teams message, GitHub upload, upstream pipeline invocation or S3 write was performed.
- Opening existing job cards may mark them as read; no cards created, resolved or reassigned.
- No independent numerical recalculation, security audit or load test was performed.