Customer readiness test
Lahoun Solar Plant

One-time browser test · 2026-11-10T01:58:25.795506+00:00 UTC
https://main.d3o3iryvy33gj9.amplifyapp.com/portfolio

23/23	16	3	4
Questions attempted	Passed functional checks	Failed checks	Review / blocked

Key findings

- 23/23 enabled questions completed: 16 functional passes, 3 failures, 4 informational/clarification outcomes.
- P1: Q27 July clipping API/tool failed with DNS/name-resolution errors for all six inverters.
- P1: Q18 yesterday-performance answer was partial because the availability tool returned an internal error.
- P2: Q7 memory/context test changed from the original Inverter 2 MPPT plot to Inverter 3.
- Three report links verified as readable PDFs: October 2026 (13 pages), December 2025 (12 pages), September 2026 (13 pages).
- Four adapted customer UI areas checked: AI Brain, Maintenance, Job Cards and Team Chat; all six open job-card details inspected.
- S3 Abdali_Mall_Lahoun.json recorded api_error=false at the check time. This is the update-pipeline flag, not proof that chat analytics tools are healthy.
- Q4 string plot had no data; Q10 BOM timestamp unavailable; Q14 no November cleaning logs; Q15 needs required fields before saving.

> API/tool errors are highest priority, followed by failed application responses. Missing data is reported separately. An answer or HTTP 200 alone is not a functional pass. Numerical results have not been independently recomputed. This test did not change daily schedules or run the upstream pipeline.

Single-plant pipeline snapshot

Abdali_Mall_Lahoun.json · api_error: **false**
S3 last modified: 2026-11-10T01:31:48.000Z
Checked: 2026-11-10T02:00:15.291Z

Question results

ID	Test question	Result	Finding
Q9	I have a COMMUNICATION_FAULT what do I do to my inverters?	**PASSED**	Manual troubleshooting guidance, diagrams and manufacturer PDF reference returned; no hardware actions performed.
Q27	Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026	**FAILED**	P1 API/tool failure: clipping_loss_via_requests reported DNS/name-resolution failure for all six inverters across July chunks.
Q1	Please generate last months report	**PASSED**	October 2026 report URL downloaded successfully; valid 13-page PDF with the expected plant and reporting month.
Q12	Was there any 0 production days in the last 7 days?	**PASSED**	Returned daily energy for all seven completed days and correctly distinguished today's incomplete 0 kWh from a zero-production day.
Q16	Please generate December 2025 performance report	**PASSED**	December 2025 report downloaded successfully; valid 12-page PDF with the expected plant and month.
Q17	How is my data quality for POA and power? How many of them show missing data during daytime or mismatches with satellite prediction?	**PASSED**	Returned daytime missing-data and mismatch counts, thresholds and data cutoff; data-quality findings are not a tool failure.
Q3	Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2	**PASSED**	Inverter 2 MPPT hourly PR chart rendered; returned chart payload contains 12 populated traces.
Q4	Please plot last 3 days hourly performance ratio for my Strings for inverter 2	**REVIEW**	Informational/no-data: string-level request returned 'nothing to plot'. No string chart; answer still says visualization created.
Q5	Please plot the last 4 days hourly performance ratio for all my inverters	**PASSED**	Four-day hourly inverter PR chart rendered; six populated inverter traces.
Q11	Please figure out how much clipping loss was found in the last 6 months broken by inverters, list them down and plot it as well	**PASSED**	Six-month per-inverter clipping totals and six-trace chart returned. Values not independently recalculated.
Q18	How did my plant perform yesterday?	**FAILED**	P1 API/tool failure in a partial answer: energy/PR/weather returned, but plant availability could not be retrieved due to an internal tool error.

ID	Test question	Result	Finding
Q20	Is there shading happening with my plant? Please analyze the pyranometer and check for frequent dips at certain times	**PASSED**	Returned quantified recurring pyranometer dip windows, sample counts, method and moderate-confidence caveats.
Q2	Based on pvsyst report, what is the rated power of this plant and array configuration	**PASSED**	Retrieved two relevant PVsyst sections and two table-image URLs. Rated power/configuration are provided via source sections, not extracted into prose.
Q6	Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3	**PASSED**	Inverter 3 raw 5-minute current/voltage chart rendered; eight populated traces returned.
Q10	When was the last time the BOM data showed up	**REVIEW**	Informational/no matching source: no BOM-labelled rows found; last available record reported, but no last-BOM timestamp verified.
Q19	Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt	**PASSED**	Returned daily POA median, mean and kurtosis, conversion method and missing/partial-day caveats. Values not independently recalculated.
Q14	Pull up the latest cleaning log	**REVIEW**	Informational/no records: no November cleaning logs returned. Does not establish whether older cleaning logs exist.
Q15	Jim cleaned the pyranometer today, can you add it to the cleaning log?	**REVIEW**	Data-entry clarification required: date/action/Jim were prepared, but Fault Cause and Status are missing. No cleaning record was saved or save/retrieval verified.
Q8	How can I shut down my inverters?	**PASSED**	Manufacturer safety guidance and manual PDF reference returned. No inverter shutdown or control action performed.
Q13	Please change to dark mode	**PASSED**	Dark-mode action executed: captured screenshot visibly changes from light to dark theme.
Q21	Please figure out how much clipping loss was found in the last 2 months broken by inverters, list them down and plot it as well	**PASSED**	Two-month per-inverter clipping totals and daily chart returned, with explicit incomplete-end-date caveat; six populated traces.

ID	Test question	Result	Finding
Q7	Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)	**FAILED**	P2 context/memory mismatch: first plotting request was hourly MPPT PR for Inverter 2 (Q3); follow-up instead plotted Inverter 3 at 5-minute granularity (the more recent Q6 context). Dual axes were returned, but original scope was not retained.
Q46	Can you generate report for moth of september 2026	**PASSED**	September 2026 report URL downloaded successfully; valid 13-page PDF with the expected plant and month.

Application UI checks

Area	Result	Finding
AI_brain_UI	passed	Customer AI Brain feed, sensor diagnostics, plant heatmap and open cards rendered; diagnostic/time disclosures expanded. Exact legacy layout/fullscreen controls differ and were not asserted one-for-one.
Maintenance_UI	passed	Tasks, filters and calendar rendered; previous/next month navigation worked. Customer site explicitly disables preventive scheduling for this once-a-year plant; legacy unscheduled/schedule dropdowns are not present.
Job_cards_UI	passed	Board rendered; all six open job-card detail panels were opened and captured. No cards were created, resolved or reassigned.
Teams_UI	passed	Customer equivalent is Team Chat, not a Teams tab. People list, message history and composer rendered; no message or notification sent.

Customer navigation differs from the legacy daily-test site. Unavailable legacy tabs are not counted as passes.

Q9 · passed

I have a COMMUNICATION_FAULT what do I do to my inverters?

Duration: 30.8 seconds · Manual troubleshooting guidance, diagrams and manufacturer PDF reference returned; no hardware actions performed.

Observed answer

Troubleshooting COMMUNICATION_FAULT (Communication Failure) on your inverter, as per the manufacturer manual:

Check the communication cable connections:
Ensure all communication cables are properly attached. Reference the device connection diagram:
Verify connector seating:
Inspect all connectors to confirm they are pushed down and inserted correctly. Use the connector installation diagram as a guide:
Observe operational status indicators:
Check the control/display panel for warnings or notifications (e.g., error LEDs indicating communication issues). Refer to the status display diagrams here:
Restart the inverter:
If the fault persists, switch off the AC miniature circuit breakers and DC load-break switches. Wait 15 minutes before switching them on to restart the inverter. After restarting, check the communication status again.
If the device repeatedly shows communication failure, contact Service. The issue may be with the internal communication processor, requiring qualified personnel to address it.

Safety Precautions:

If the message is frequent, contact Service immediately.
Only qualified professionals should access internal inverter sections or perform advanced troubleshooting due to high voltage risks.

Manual PDF reference: https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

STP_110-60_Manual.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Technical details
Answered by Manual Agent
· 15s


Browser evidence

PT


I have a COMMUNICATION FA...

Troubleshooting COMMUNICATION_FAULT (Communication Failure) on your inverter, as per the manufacturer manual:

1. Check the communication cable connections:
2. Ensure all communication cables are properly attached. Reference the device connection diagram:

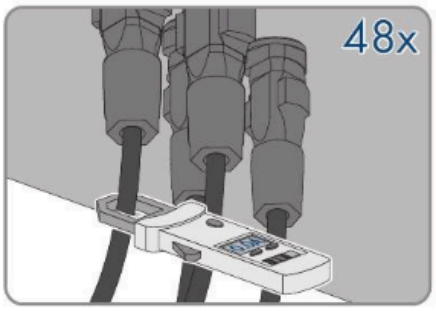

1. Verify connector seating:
2. Inspect all connectors to confirm they are pushed down and inserted correctly. Use the connector installation diagram as a guide:

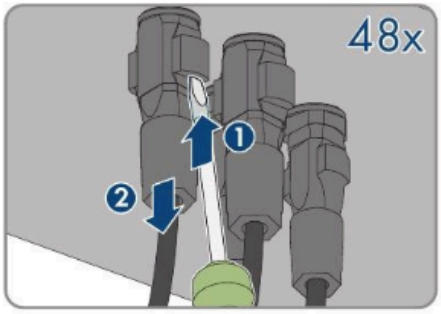

1. Observe operational status indicators:
2. Check the control/display panel for warnings or notifications (e.g., error LEDs indicating communication issues). Refer to the status display diagrams here:
3. 

Ask about Lahoun Solar Plant

Q27 · failed

Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026

Duration: 18.7 seconds · P1 API/tool failure: clipping_loss_via_requests reported DNS/name-resolution failure for all six inverters across July chunks.

Observed answer

I used clipping_loss_via_requests for 2026-07-01 to 2026-07-31, but it did not return clipping values because the external analytics endpoint failed for all six inverters in every July chunk due to a DNS/name-resolution error.

So, I cannot determine from this tool whether there was clipping loss in July 2026.


Result from the requested tool:

Status: Failed
inverter1: request failed for all chunks
inverter2: request failed for all chunks
inverter3: request failed for all chunks
inverter4: request failed for all chunks
inverter5: request failed for all chunks
inverter6: request failed for all chunks

This was a tool connectivity failure, not evidence of zero clipping loss.

How this was worked out
Technical details
Answered by Data Agent
· 8.7s

Browser evidence

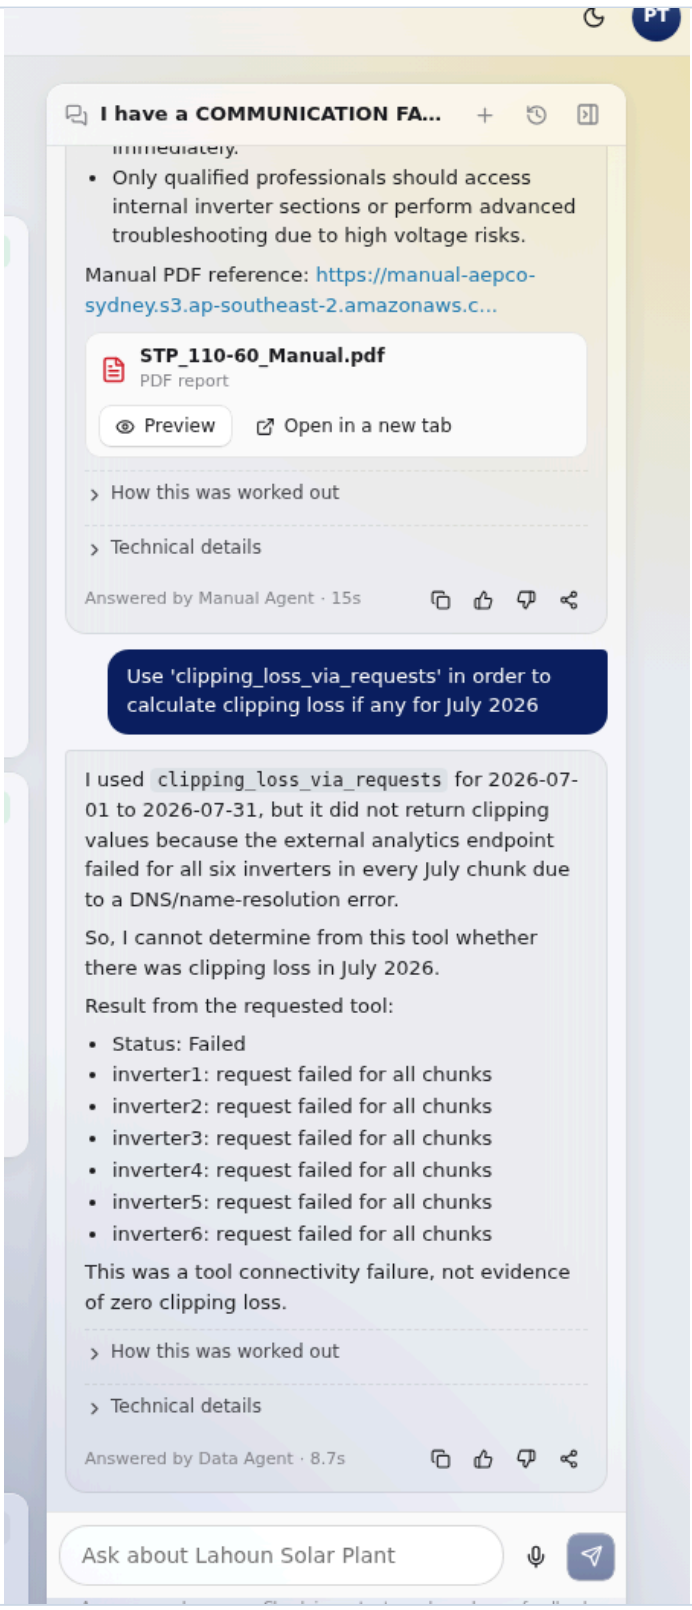
PT
I have a COMMUNICATION FA...
immediately.
Only qualified professionals should access internal inverter sections or perform advanced troubleshooting due to high voltage risks.
Manual PDF reference: https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...
STP_110-60_Manual.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Technical details
Answered by Manual Agent · 15s
Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026
I used clipping_loss_via_requests for 2026-07-01 to 2026-07-31, but it did not return clipping values because the external analytics endpoint failed for all six inverters in every July chunk due to a DNS/name-resolution error.
So, I cannot determine from this tool whether there was clipping loss in July 2026.
Result from the requested tool:
Status: Failed
inverter1: request failed for all chunks
inverter2: request failed for all chunks
inverter3: request failed for all chunks
inverter4: request failed for all chunks
inverter5: request failed for all chunks
inverter6: request failed for all chunks
This was a tool connectivity failure, not evidence of zero clipping loss.
How this was worked out
Technical details
Answered by Data Agent · 8.7s
Ask about Lahoun Solar Plant

Q1 · passed

Please generate last months report


Duration: 91.3 seconds · October 2026 report URL downloaded successfully; valid 13-page PDF with the expected plant and reporting month.

Observed answer

I've generated the plant performance report for October 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_October_2026_external_report.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent
· 81.3s

Browser evidence

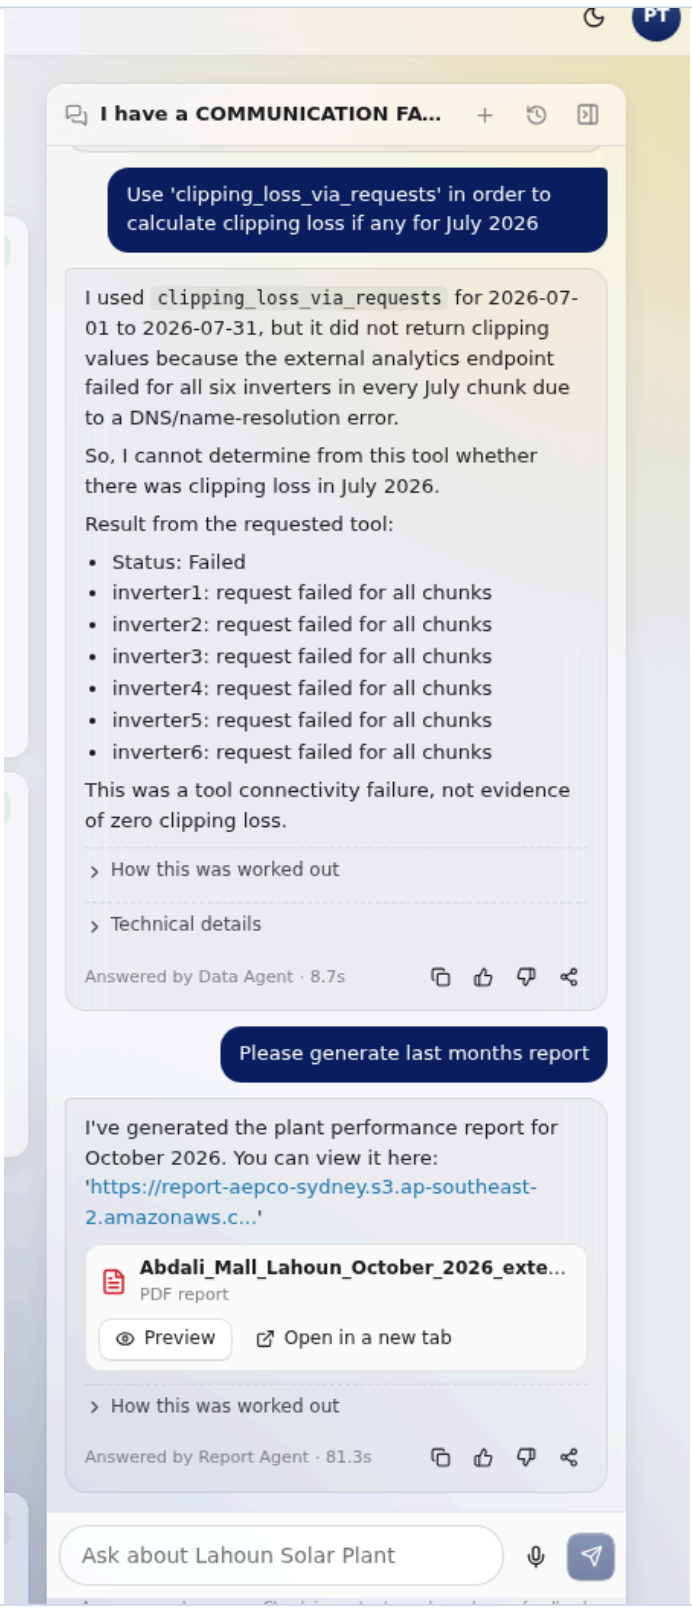
PT
I have a COMMUNICATION FA...
Use 'clipping_loss_via_requests' in order to calculate clipping loss if any for July 2026
I used clipping_loss_via_requests for 2026-07-01 to 2026-07-31, but it did not return clipping values because the external analytics endpoint failed for all six inverters in every July chunk due to a DNS/name-resolution error.
So, I cannot determine from this tool whether there was clipping loss in July 2026.
Result from the requested tool:
Status: Failed
inverter1: request failed for all chunks
inverter2: request failed for all chunks
inverter3: request failed for all chunks
inverter4: request failed for all chunks
inverter5: request failed for all chunks
inverter6: request failed for all chunks
This was a tool connectivity failure, not evidence of zero clipping loss.
How this was worked out
Technical details
Answered by Data Agent · 8.7s
Please generate last months report
I've generated the plant performance report for October 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_October_2026_exte...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 81.3s
Ask about Lahoun Solar Plant

Q12 · passed

Was there any 0 production days in the last 7 days?

Duration: 20.2 seconds · Returned daily energy for all seven completed days and correctly distinguished today's incomplete 0 kWh from a zero-production day.

Observed answer

No. There were no fully completed days with zero production in the last 7 days.


Daily plant energy:

2026-11-03: 3445.15 kWh
2026-11-04: 3994.27 kWh
2026-11-05: 2693.48 kWh
2026-11-06: 3054.89 kWh
2026-11-07: 2424.63 kWh
2026-11-08: 3207.16 kWh
2026-11-09: 4152.37 kWh

2026-11-10 currently shows 0.00 kWh so far, but that day is still in progress and the data only reaches 02:55, so it does not indicate a zero-production day.

How this was worked out
Technical details
Answered by Data Agent
· 10.1s

Browser evidence

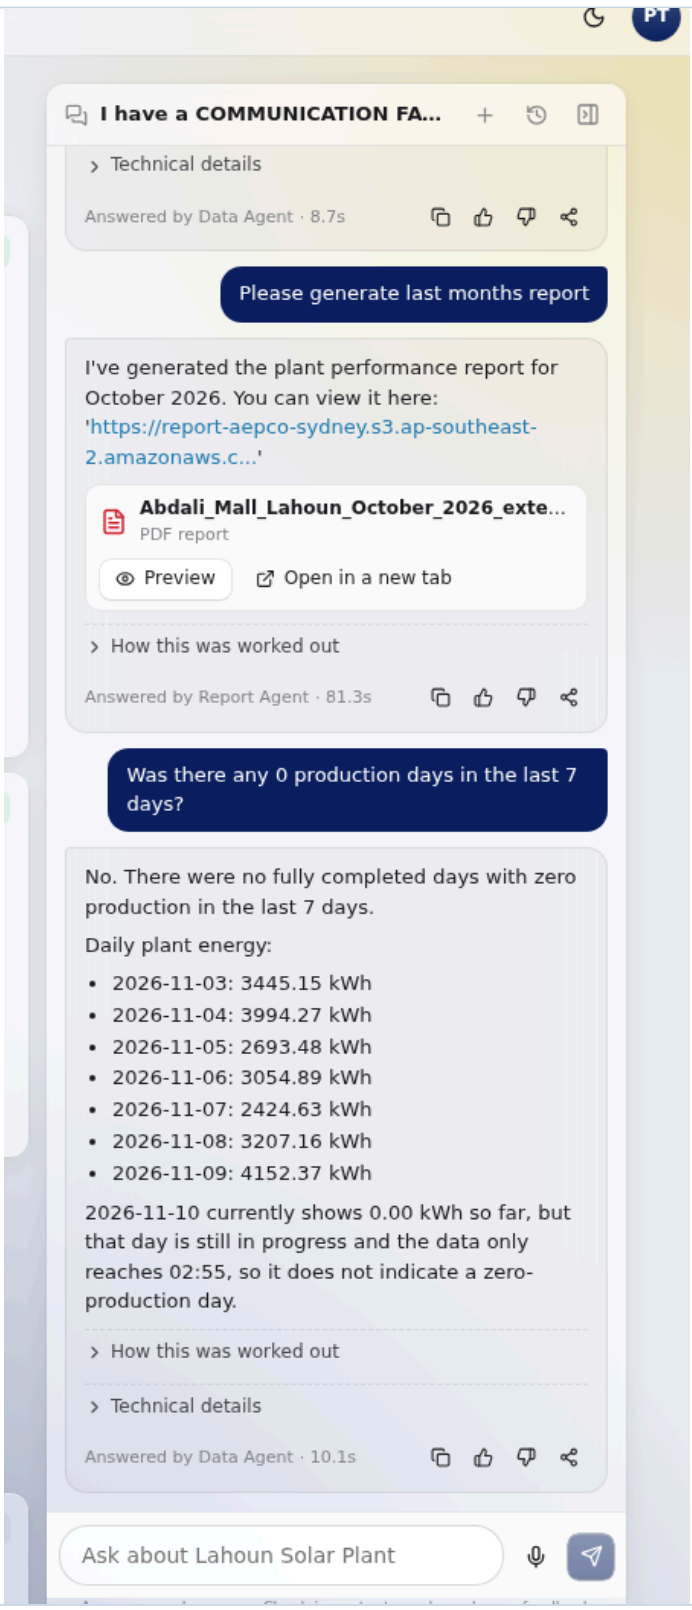
PT
I have a COMMUNICATION FA...
Technical details
Answered by Data Agent · 8.7s
Please generate last months report
I've generated the plant performance report for October 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_October_2026_exte...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 81.3s
Was there any 0 production days in the last 7 days?
No. There were no fully completed days with zero production in the last 7 days.
Daily plant energy:
2026-11-03: 3445.15 kWh
2026-11-04: 3994.27 kWh
2026-11-05: 2693.48 kWh
2026-11-06: 3054.89 kWh
2026-11-07: 2424.63 kWh
2026-11-08: 3207.16 kWh
2026-11-09: 4152.37 kWh
2026-11-10 currently shows 0.00 kWh so far, but that day is still in progress and the data only reaches 02:55, so it does not indicate a zero-production day.
How this was worked out
Technical details
Answered by Data Agent · 10.1s
Ask about Lahoun Solar Plant

Q16 · passed

Please generate December 2025 performance report


Duration: 82.7 seconds · December 2025 report downloaded successfully; valid 12-page PDF with the expected plant and month.

Observed answer

I've generated the December 2025 external performance report. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_December_2025_external_report.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent
· 71.1s

Browser evidence

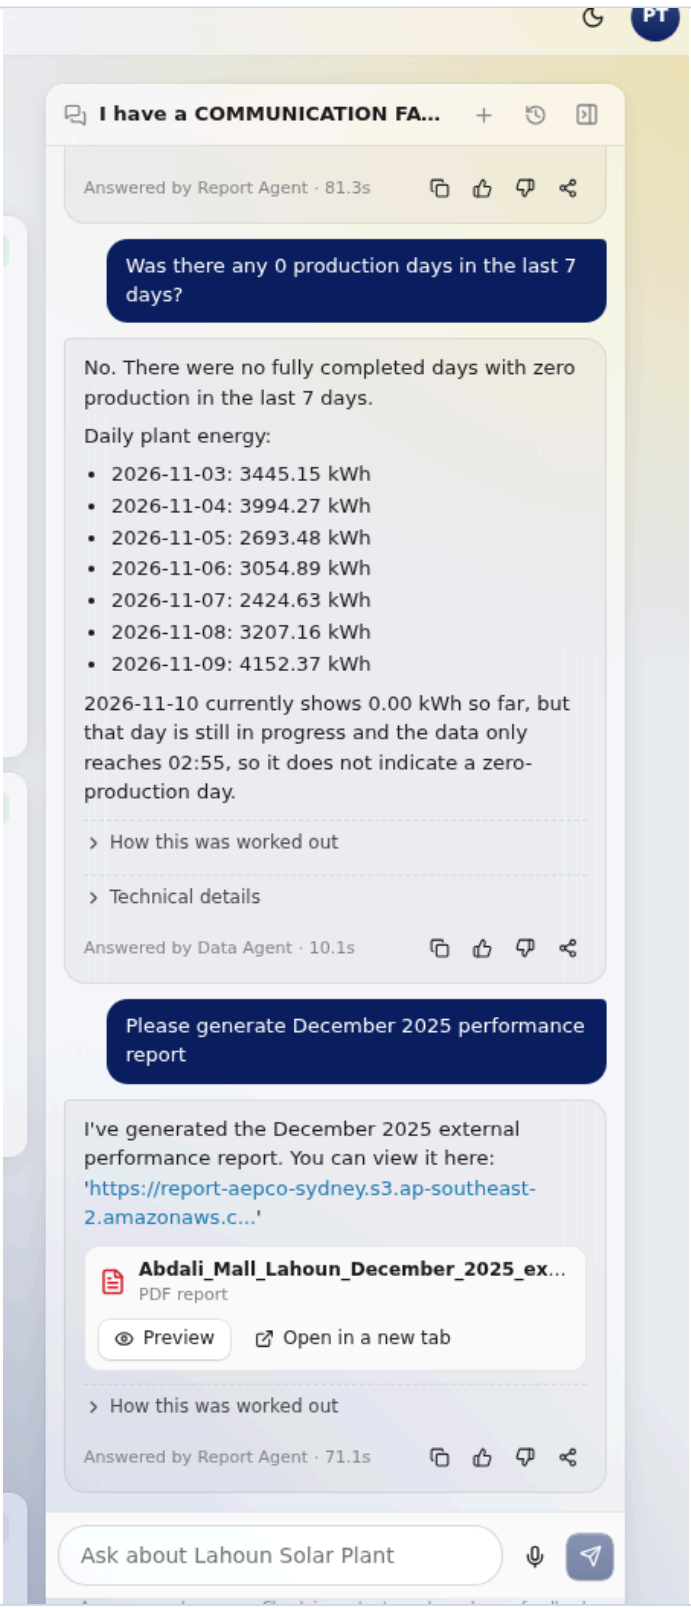
PT
I have a COMMUNICATION FA...
Answered by Report Agent · 81.3s
Was there any 0 production days in the last 7 days?
No. There were no fully completed days with zero production in the last 7 days.
Daily plant energy:
2026-11-03: 3445.15 kWh
2026-11-04: 3994.27 kWh
2026-11-05: 2693.48 kWh
2026-11-06: 3054.89 kWh
2026-11-07: 2424.63 kWh
2026-11-08: 3207.16 kWh
2026-11-09: 4152.37 kWh
2026-11-10 currently shows 0.00 kWh so far, but that day is still in progress and the data only reaches 02:55, so it does not indicate a zero-production day.
How this was worked out
Technical details
Answered by Data Agent · 10.1s
Please generate December 2025 performance report
I've generated the December 2025 external performance report. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_December_2025_ex...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 71.1s
Ask about Lahoun Solar Plant

Q17 · passed

How is my data quality for POA and power? How many of them show missing data during daytime or mismatches with satellite prediction?

Duration: 27.8 seconds · Returned daytime missing-data and mismatch counts, thresholds and data cutoff; data-quality findings are not a tool failure.

Observed answer


Data quality summary for POA and plant power over 2026-11-09 to 2026-11-10 (available data through 2026-11-10 02:55:00):

Daytime points assessed: 324
Missing POA instances during daytime: 0
Missing power instances during daytime: 0
Missing both POA and power during daytime: 0
POA mismatches vs satellite/modelled prediction: 57 instances
Power mismatches vs irradiance-based expectation: 1 instance

Notes:

The data returned does not extend to the full requested end date; it currently ends at 2026-11-10 02:55:00.
Daytime was identified using measured/modelled POA >= 20 W/m².
POA mismatch threshold used: absolute difference > 200 W/m² and relative difference > 30% vs modelled POA.
Power mismatch threshold used: modelled POA >= 200 W/m² and normalized power deviation > 0.35 from irradiance-based expectation.
How this was worked out
Technical details
Answered by Data Agent
· 17.9s

Browser evidence

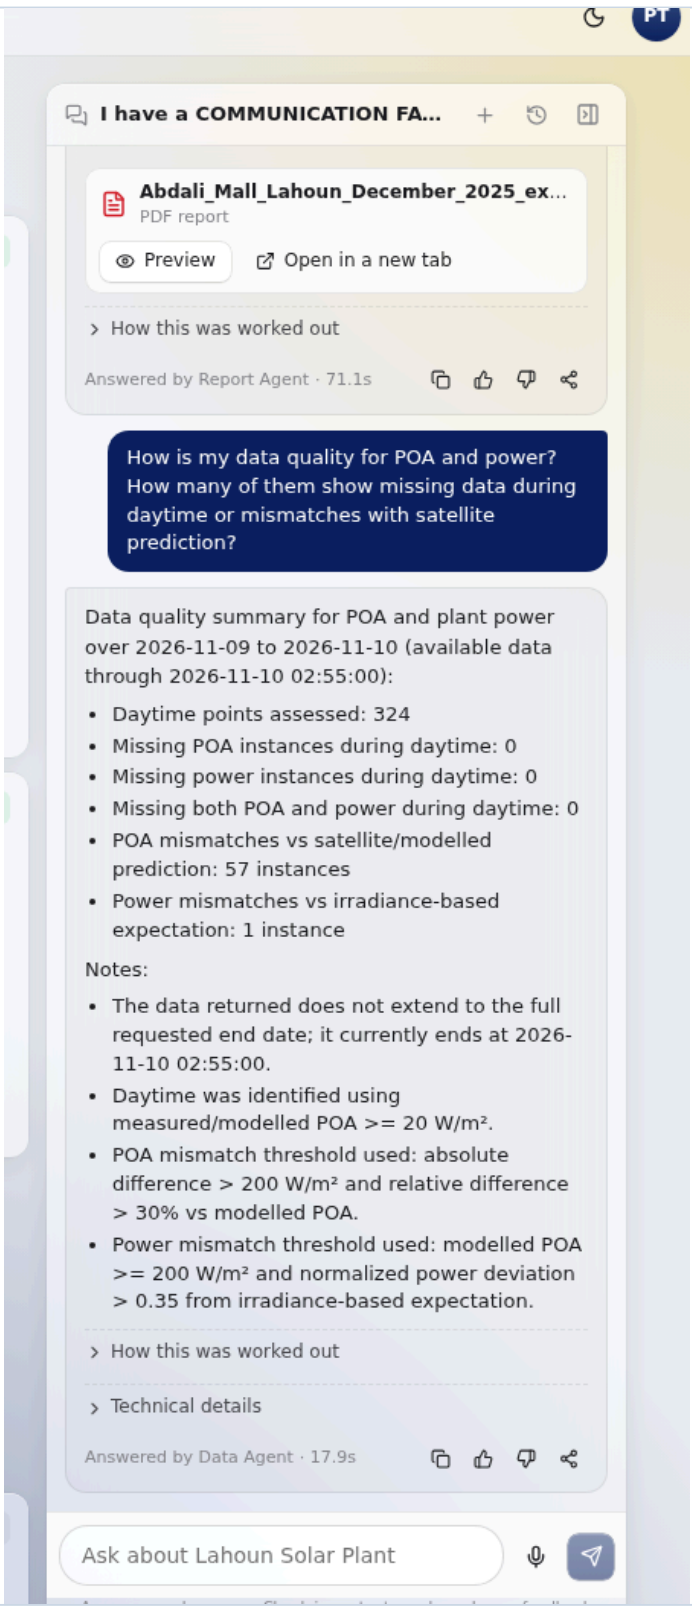
PT
I have a COMMUNICATION FA...
Abdali_Mall_Lahoun_December_2025_ex...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 71.1s
How is my data quality for POA and power? How many of them show missing data during daytime or mismatches with satellite prediction?
Data quality summary for POA and plant power over 2026-11-09 to 2026-11-10 (available data through 2026-11-10 02:55:00):
• Daytime points assessed: 324
• Missing POA instances during daytime: 0
• Missing power instances during daytime: 0
• Missing both POA and power during daytime: 0
• POA mismatches vs satellite/modelled prediction: 57 instances
• Power mismatches vs irradiance-based expectation: 1 instance
Notes:
• The data returned does not extend to the full requested end date; it currently ends at 2026-11-10 02:55:00.
• Daytime was identified using measured/modelled POA >= 20 W/m².
• POA mismatch threshold used: absolute difference > 200 W/m² and relative difference > 30% vs modelled POA.
• Power mismatch threshold used: modelled POA >= 200 W/m² and normalized power deviation > 0.35 from irradiance-based expectation.
How this was worked out
Technical details
Answered by Data Agent · 17.9s
Ask about Lahoun Solar Plant

Q3 · passed

Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2

Duration: 29.3 seconds · Inverter 2 MPPT hourly PR chart rendered; returned chart payload contains 12 populated traces.

Observed answer

I've created the visualization for you.

Hourly Performance Ratio for Each MPPT of Inverter 2 (Last 3 Days)
Pin
How this was worked out
Answered by Graph Agent
· 19.1s

Browser evidence

PT

I have a COMMUNICATION FA...

Notes:

- The data returned does not extend to the full requested end date; it currently ends at 2026-11-10 02:55:00.
- Daytime was identified using measured/modelled POA >= 20 W/m².
- POA mismatch threshold used: absolute difference > 200 W/m² and relative difference > 30% vs modelled POA.
- Power mismatch threshold used: modelled POA >= 200 W/m² and normalized power deviation > 0.35 from irradiance-based expectation.

› How this was worked out


› Technical details

Answered by Data Agent · 17.9s

Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2

I've created the visualization for you.

Hourly Performance Ratio for E... Pin

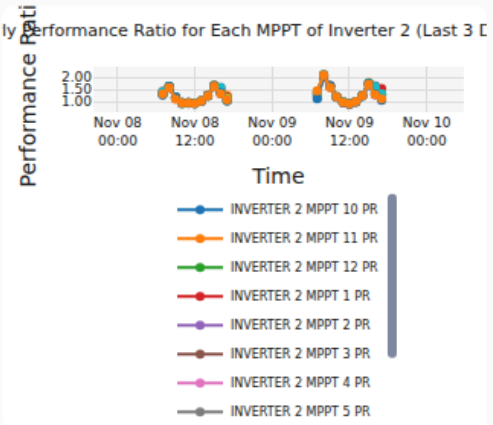

› How this was worked out

Answered by Graph Agent · 19.1s

Ask about Lahoun Solar Plant

Q4 · review

Please plot last 3 days hourly performance ratio for my Strings for inverter 2

Duration: 14.2 seconds · Informational/no-data: string-level request returned 'nothing to plot'. No string chart; answer still says visualization created.

Observed answer

I've created the visualization for you.

There was nothing to plot for this question. Try another date range or measure.

How this was worked out
Answered by Graph Agent
· 4.3s

Browser evidence

I have a COMMUNICATION FA...

> 0.35 from irradiance-based expectation.

› How this was worked out


› Technical details

Answered by Data Agent · 17.9s

Please plot last 3 days hourly performance ratio for my MPPTs for inverter 2

I've created the visualization for you.

Hourly Performance Ratio for E... Pin

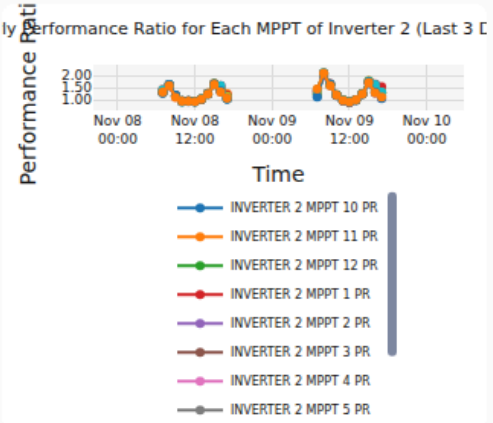

› How this was worked out

Answered by Graph Agent · 19.1s

Please plot last 3 days hourly performance ratio for my Strings for inverter 2

I've created the visualization for you.

There was nothing to plot for this question. Try another date range or measure.

› How this was worked out

Answered by Graph Agent · 4.3s

Ask about Lahoun Solar Plant

Q5 · passed

Please plot the last 4 days hourly performance ratio for all my inverters

Duration: 24.8 seconds · Four-day hourly inverter PR chart rendered; six populated inverter traces.

Observed answer

I've created the visualization for you.

Hourly Performance Ratio for All Inverters - Last 4 Days
Pin
How this was worked out
Answered by Graph Agent
· 13.7s

Browser evidence

PT

I have a COMMUNICATION FA...

INVERTER 2 MPPT 4 PR
INVERTER 2 MPPT 5 PR

› How this was worked out

Answered by Graph Agent · 19.1s

Please plot last 3 days hourly performance ratio for my Strings for inverter 2

I've created the visualization for you.

There was nothing to plot for this question. Try another date range or measure.


› How this was worked out

Answered by Graph Agent · 4.3s

Please plot the last 4 days hourly performance ratio for all my inverters

I've created the visualization for you.

Hourly Performance Ratio for A... Pin

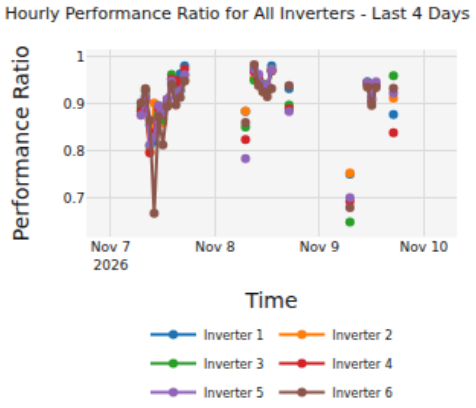

› How this was worked out

Answered by Graph Agent · 13.7s

Ask about Lahoun Solar Plant

Q11 · passed

Please figure out how much clipping loss was found in the last 6 months broken by inverters, list them down and plot it as well

Duration: 47.9 seconds · Six-month per-inverter clipping totals and six-trace chart returned. Values not independently recalculated.

Observed answer

Clipping loss over the last six months (May 10–November 10, 2026), by inverter:

Inverter 1: 30,705.59 kWh
Inverter 2: 17,682.87 kWh
Inverter 3: 29,349.62 kWh
Inverter 4: 21,131.30 kWh
Inverter 5: 18,190.79 kWh
Inverter 6: 11,643.30 kWh

Data status: Good.

A chart showing clipping loss by inverter for the requested period has been created.

Clipping Loss by Inverter - Last 6 Months
Pin
How this was worked out
Technical details
Answered by Data Agent, Graph Agent
· 36.7s

Browser evidence

PT

I have a COMMUNICATION FA...

> How this was worked out

Answered by Graph Agent · 13.7s

Please figure out how much clipping loss was found in the last 6 months broken by inverters, list them down and plot it as well


Clipping loss over the last six months (May 10–November 10, 2026), by inverter:

- Inverter 1: 30,705.59 kWh
- Inverter 2: 17,682.87 kWh
- Inverter 3: 29,349.62 kWh
- Inverter 4: 21,131.30 kWh
- Inverter 5: 18,190.79 kWh
- Inverter 6: 11,643.30 kWh

Data status: Good.

A chart showing clipping loss by inverter for the requested period has been created.

Clipping Loss by Inverter - Last... Pin

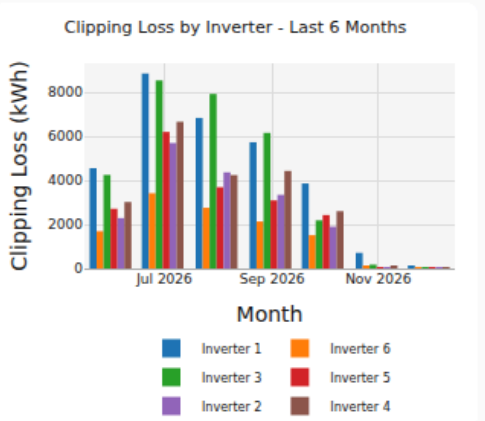

> How this was worked out

> Technical details

Answered by Data Agent, Graph Agent · 36.7s

Ask about Lahoun Solar Plant

Q18 · failed

How did my plant perform yesterday?

Duration: 25.8 seconds · P1 API/tool failure in a partial answer: energy/PR/weather returned, but plant availability could not be retrieved due to an internal tool error.

Observed answer

Yesterday (2026-11-09), your plant’s measured performance was:

Total energy: 4152.37 kWh
Specific yield: 5.283 kWh/kWp
Performance ratio (PR): 0.9212
Reference yield: 4.2806 kWh/kWp

Measured site conditions (daily average):

POA irradiance (pyranometer_1): 178.36 W/m²
Module temperature: 16.46 °C
Ambient temperature: 12.06 °C
Wind speed: 0.48 m/s


Note: plant availability could not be retrieved because the availability tool returned an internal error for this request.

How this was worked out
Technical details
Answered by Data Agent
· 13.6s

Browser evidence

PT

I have a COMMUNICATION FA...

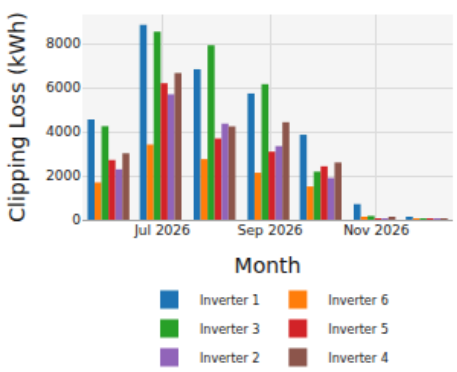

› How this was worked out

› Technical details

Answered by Data Agent, Graph Agent
· 36.7s

How did my plant perform yesterday?

Yesterday (2026-11-09), your plant's measured performance was:

- Total energy: 4152.37 kWh
- Specific yield: 5.283 kWh/kWp
- Performance ratio (PR): 0.9212
- Reference yield: 4.2806 kWh/kWp

Measured site conditions (daily average):

- POA irradiance (pyranometer_1): 178.36 W/m²
- Module temperature: 16.46 °C
- Ambient temperature: 12.06 °C
- Wind speed: 0.48 m/s

Note: plant availability could not be retrieved because the availability tool returned an internal error for this request.

› How this was worked out

› Technical details

Answered by Data Agent · 13.6s

Ask about Lahoun Solar Plant

Q20 · passed

Is there shading happening with my plant? Please analyze the pyranometer and check for frequent dips at certain times

Duration: 95.7 seconds · Returned quantified recurring pyranometer dip windows, sample counts, method and moderate-confidence caveats.

Observed answer

I analyzed the measured pyranometer against modelled POA over 2026-01-01 to 2026-11-10 02:55.

Conclusion: the pyranometer does show recurring dips, and the pattern is broadly consistent with intermittent shading, especially in the afternoon. It does not look like one single sharp, permanent obstruction window; it looks more like a recurring but variable shading influence and/or changing obstruction/cloud interaction.

Key findings:

Data analyzed: 34,960 daylight 5-minute points.
Detected dip points: 1,584, about 4.5% of daylight samples.
Strongest recurring dip window: roughly 13:50–17:30.
Most pronounced individual times were around 16:05–16:40, with the largest low-tail depression at:
16:20
16:10
16:30
16:25
16:15
Around those times, the measured/modelled POA ratio’s low tail sits about 0.25–0.27 below the median for that same clock time, which is a meaningful depression.
There are also weaker recurring dip windows around:
08:00–10:10
11:40–12:00
12:10–12:50
13:00–13:40

Why this is shading-like:

The dips recur at similar clock times across many days, which is a classic shading signature.
The strongest pattern is concentrated in late afternoon, when low sun angles make obstruction shading more likely.
Dip events also cluster in certain solar azimuth ranges rather than being uniformly spread, which also supports a geometry-driven cause.

Why the evidence is not perfectly clean:

A very persistent fixed obstruction usually creates a narrower, cleaner daily window. Here the afternoon window is fairly broad.
Midday weaker dip windows are less typical of a single nearby object and may reflect sensor

cleanliness, occasional cloud enhancement/variability effects, horizon features, or multiple obstructions.
Since this analysis is based on measured pyranometer versus modelled POA, some mismatch can also come from model bias or changing atmospheric conditions.

Assessment:

Yes, there is a recurring dip pattern.
Yes, the afternoon behavior is consistent with shading.
Confidence is moderate, not definitive, because the recurring windows are broad and there are secondary weaker windows outside the main afternoon period.


Most likely shading window to inspect on site:

Primary: 13:50–17:30
Peak concern: 16:05–16:40
Secondary possible window: 08:00–10:10

If you want a stronger confirmation, the next best check would be to compare these pyranometer dip times against plant or inverter power behavior at the same timestamps. That can help distinguish true irradiance shading from sensor-only effects.

How this was worked out
Technical details
Answered by Data Agent
· 36.9s

Browser evidence

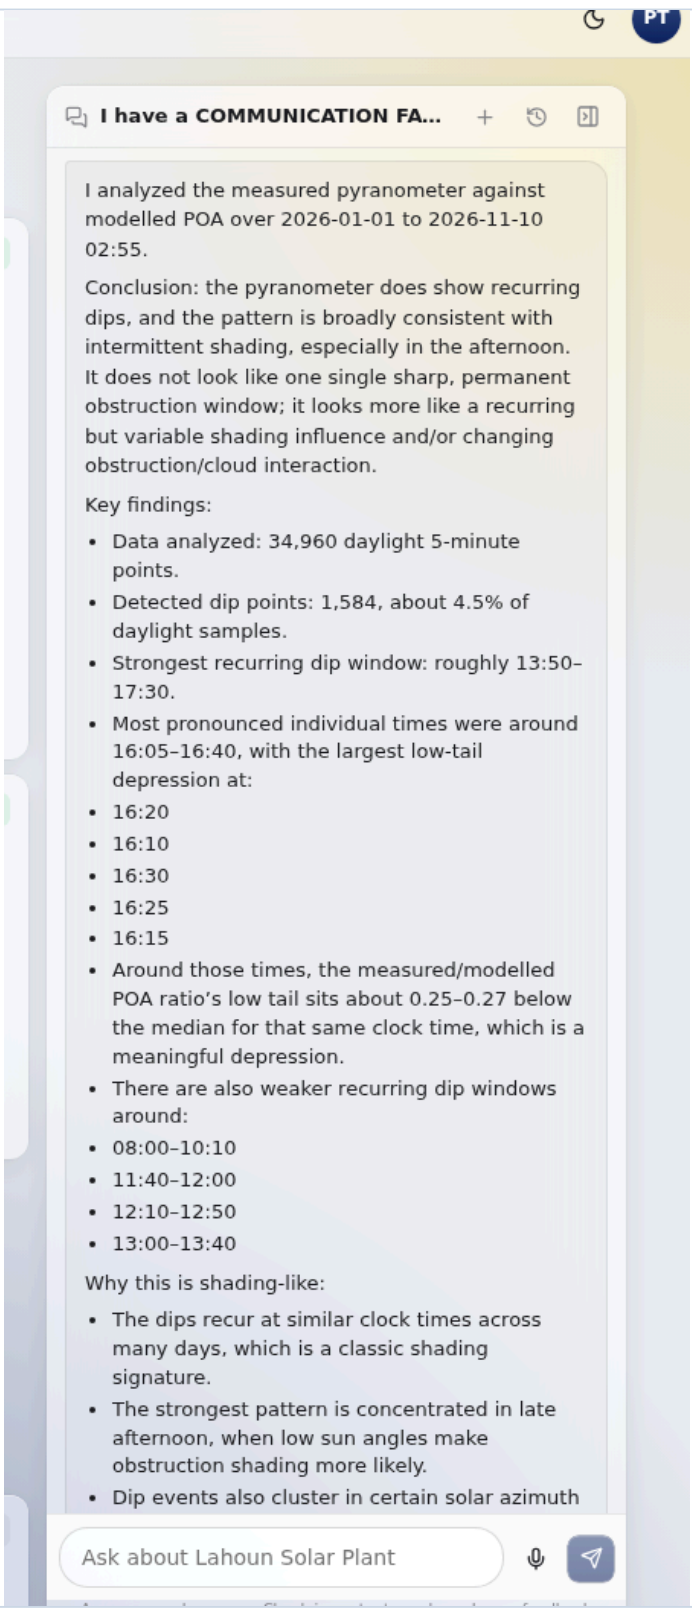
PT
I have a COMMUNICATION FA...
I analyzed the measured pyranometer against modelled POA over 2026-01-01 to 2026-11-10 02:55.
Conclusion: the pyranometer does show recurring dips, and the pattern is broadly consistent with intermittent shading, especially in the afternoon. It does not look like one single sharp, permanent obstruction window; it looks more like a recurring but variable shading influence and/or changing obstruction/cloud interaction.
Key findings:
• Data analyzed: 34,960 daylight 5-minute points.
• Detected dip points: 1,584, about 4.5% of daylight samples.
• Strongest recurring dip window: roughly 13:50–17:30.
• Most pronounced individual times were around 16:05–16:40, with the largest low-tail depression at:
• 16:20
• 16:10
• 16:30
• 16:25
• 16:15
• Around those times, the measured/modelled POA ratio's low tail sits about 0.25–0.27 below the median for that same clock time, which is a meaningful depression.
• There are also weaker recurring dip windows around:
• 08:00–10:10
• 11:40–12:00
• 12:10–12:50
• 13:00–13:40
Why this is shading-like:
• The dips recur at similar clock times across many days, which is a classic shading signature.
• The strongest pattern is concentrated in late afternoon, when low sun angles make obstruction shading more likely.
• Dip events also cluster in certain solar azimuth
Ask about Lahoun Solar Plant

Q2 · passed

Based on pvsyst report, what is the rated power of this plant and array configuration

Duration: 17.3 seconds · Retrieved two relevant PVsyst sections and two table-image URLs. Rated power/configuration are provided via source sections, not extracted into prose.

Observed answer

Found 2 relevant PVsyst report sections:

[Abdali_Mall_Lahoun] System Summary (Page 2, Table 2)
[Abdali_Mall_Lahoun] PV Array Characteristics and array configurations (Page 3, Table 2)
How this was worked out
Technical details
Answered by PVsyst Agent
· 6s

Browser evidence

PT

I have a COMMUNICATION FA...

- Since this analysis is based on measured pyranometer versus modelled POA, some mismatch can also come from model bias or changing atmospheric conditions.

Assessment:

- Yes, there is a recurring dip pattern.
- Yes, the afternoon behavior is consistent with shading.
- Confidence is moderate, not definitive, because the recurring windows are broad and there are secondary weaker windows outside the main afternoon period.

Most likely shading window to inspect on site:

- Primary: 13:50–17:30
- Peak concern: 16:05–16:40
- Secondary possible window: 08:00–10:10

If you want a stronger confirmation, the next best check would be to compare these pyranometer dip times against plant or inverter power behavior at the same timestamps. That can help distinguish true irradiance shading from sensor-only effects.

› How this was worked out

› Technical details


Answered by Data Agent · 36.9s

Based on pvsyst report, what is the rated power of this plant and array configuration

Found 2 relevant PVsyst report sections:

1. [Abdali_Mall_Lahoun] System Summary (Page 2, Table 2)
2. [Abdali_Mall_Lahoun] PV Array Characteristics and array configurations (Page 3, Table 2)





› How this was worked out

Ask about Lahoun Solar Plant

Q6 · passed

Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3

Duration: 26.4 seconds · Inverter 3 raw 5-minute current/voltage chart rendered; eight populated traces returned.

Observed answer

I've created the visualization for you.

Inverter 3 Current and Voltage (Raw 5-minute Data)
Pin
How this was worked out
Answered by Graph Agent
· 15.2s

Browser evidence


PT

I have a COMMUNICATION FA...

Found 2 relevant PVsyst report sections:

1. [Abdali_Mall_Lahoun] System Summary (Page 2, Table 2)
2. [Abdali_Mall_Lahoun] PV Array Characteristics and array configurations (Page 3, Table 2)





› How this was worked out


› Technical details

Answered by PVsyst Agent · 6s

Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3

I've created the visualization for you.

Inverter 3 Current and Voltage ... Pin

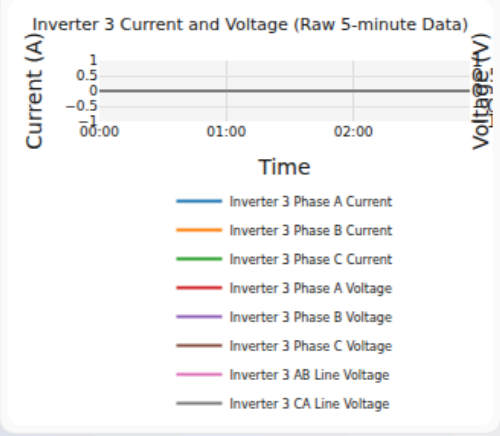

› How this was worked out

Answered by Graph Agent · 15.2s

Ask about Lahoun Solar Plant

Q10 · review

When was the last time the BOM data showed up

Duration: 21.8 seconds · Informational/no matching source: no BOM-labelled rows found; last available record reported, but no last-BOM timestamp verified.

Observed answer

I could not identify any BOM-labelled rows in the available source data.

What I can confirm is:

The latest available record in the queried data is at 2026-11-10 02:55:00.
The extracted source values in this result do not show a BOM label, so I can’t verify a “last BOM timestamp” from this dataset as returned.
How this was worked out
Technical details
Answered by Data Agent
· 10.6s

Browser evidence


PT

I have a COMMUNICATION FA...

Please plot my current and voltage in a dual axes plot on the deepest possible granularity level for inverter3

I've created the visualization for you.

Inverter 3 Current and Voltage ... Pin

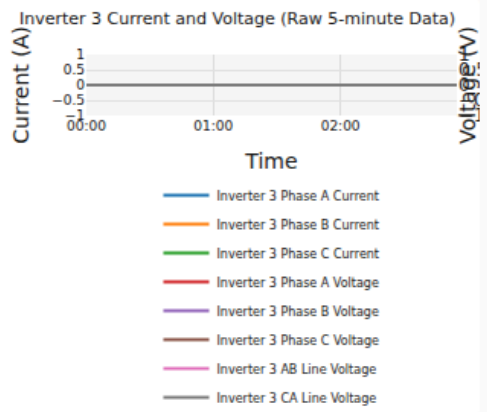

› How this was worked out

Answered by Graph Agent · 15.2s

When was the last time the BOM data showed up

I could not identify any BOM-labelled rows in the available `source` data.

What I can confirm is:

- The latest available record in the queried data is at **2026-11-10 02:55:00**.
- The extracted `source` values in this result do not show a BOM label, so I can't verify a "last BOM timestamp" from this dataset as returned.

› How this was worked out

› Technical details

Answered by Data Agent · 10.6s

Ask about Lahoun Solar Plant

Q19 · passed

Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt

Duration: 21.8 seconds · Returned daily POA median, mean and kurtosis, conversion method and missing/partial-day caveats. Values not independently recalculated.

Observed answer


For the last 12 months, the daily summed POA irradiance from pyranometer_1 is:

Median daily total: 5664.47 Wh/m²
Mean daily total: 5677.98 Wh/m²
Kurtosis: -0.1720

Notes:

I converted 5-minute POA irradiance values in W/m² to Wh/m² using 5/60 h per sample, then summed by day.
The extracted data ends at 2026-11-10 02:55:00, so 2026-11-10 is only a partial day and appears as 0.0 Wh/m² in the daily series.
There are also several days with missing daily totals (null) in the period due to missing source data; the median, mean, and kurtosis were computed on the non-null daily totals only.
How this was worked out
Technical details
Answered by Data Agent
· 11.5s

Browser evidence

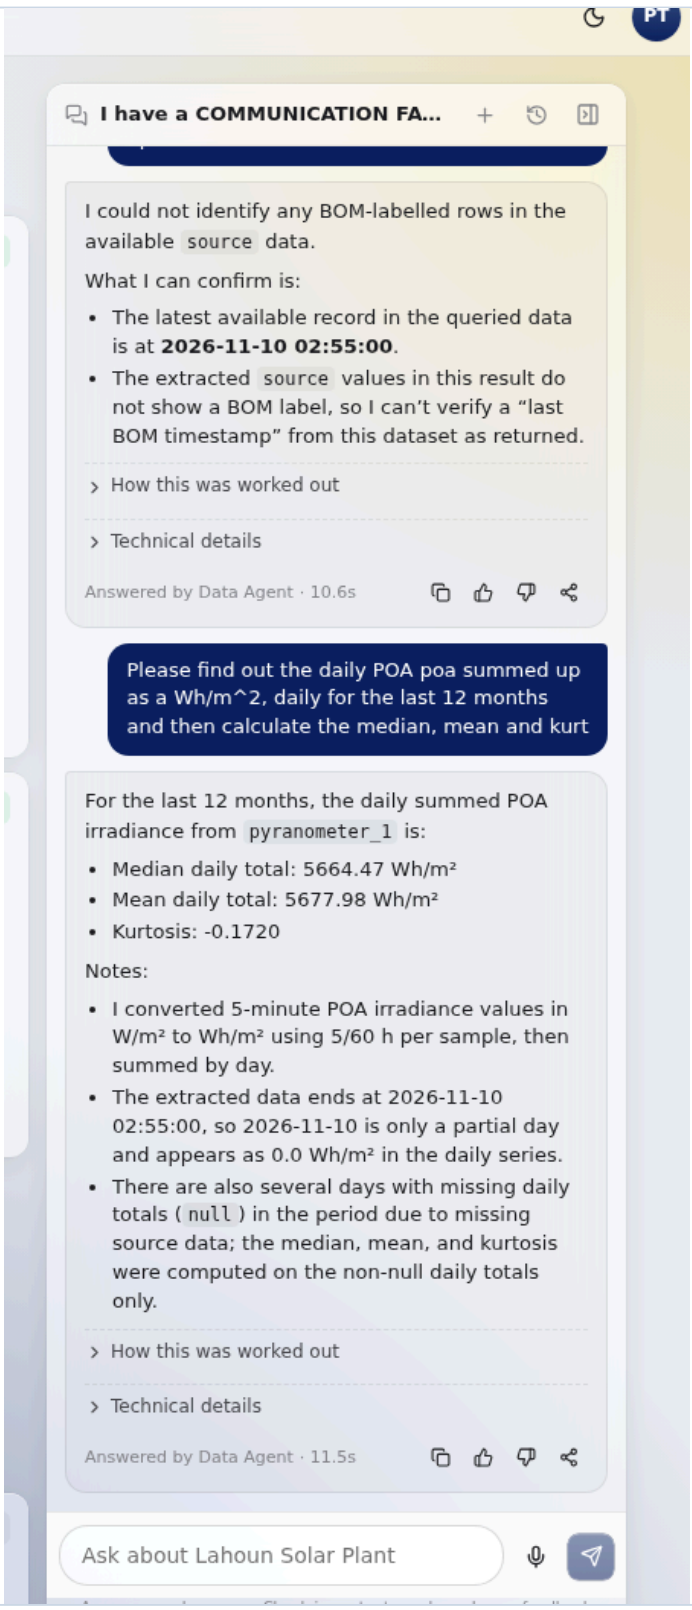
PT
I have a COMMUNICATION FA...
I could not identify any BOM-labelled rows in the available source data.
What I can confirm is:
The latest available record in the queried data is at 2026-11-10 02:55:00.
The extracted source values in this result do not show a BOM label, so I can't verify a "last BOM timestamp" from this dataset as returned.
How this was worked out
Technical details
Answered by Data Agent · 10.6s
Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt
For the last 12 months, the daily summed POA irradiance from pyranometer_1 is:
Median daily total: 5664.47 Wh/m²
Mean daily total: 5677.98 Wh/m²
Kurtosis: -0.1720
Notes:
I converted 5-minute POA irradiance values in W/m² to Wh/m² using 5/60 h per sample, then summed by day.
The extracted data ends at 2026-11-10 02:55:00, so 2026-11-10 is only a partial day and appears as 0.0 Wh/m² in the daily series.
There are also several days with missing daily totals (null) in the period due to missing source data; the median, mean, and kurtosis were computed on the non-null daily totals only.
How this was worked out
Technical details
Answered by Data Agent · 11.5s
Ask about Lahoun Solar Plant

Q14 · review

Pull up the latest cleaning log


Duration: 14.2 seconds · Informational/no records: no November cleaning logs returned. Does not establish whether older cleaning logs exist.

Observed answer

There are no cleaning activity logs recorded for Abdali_Mall_Lahoun in November 2026.

Technical details
Answered by Data Entry Agent
· 3.9s

Browser evidence

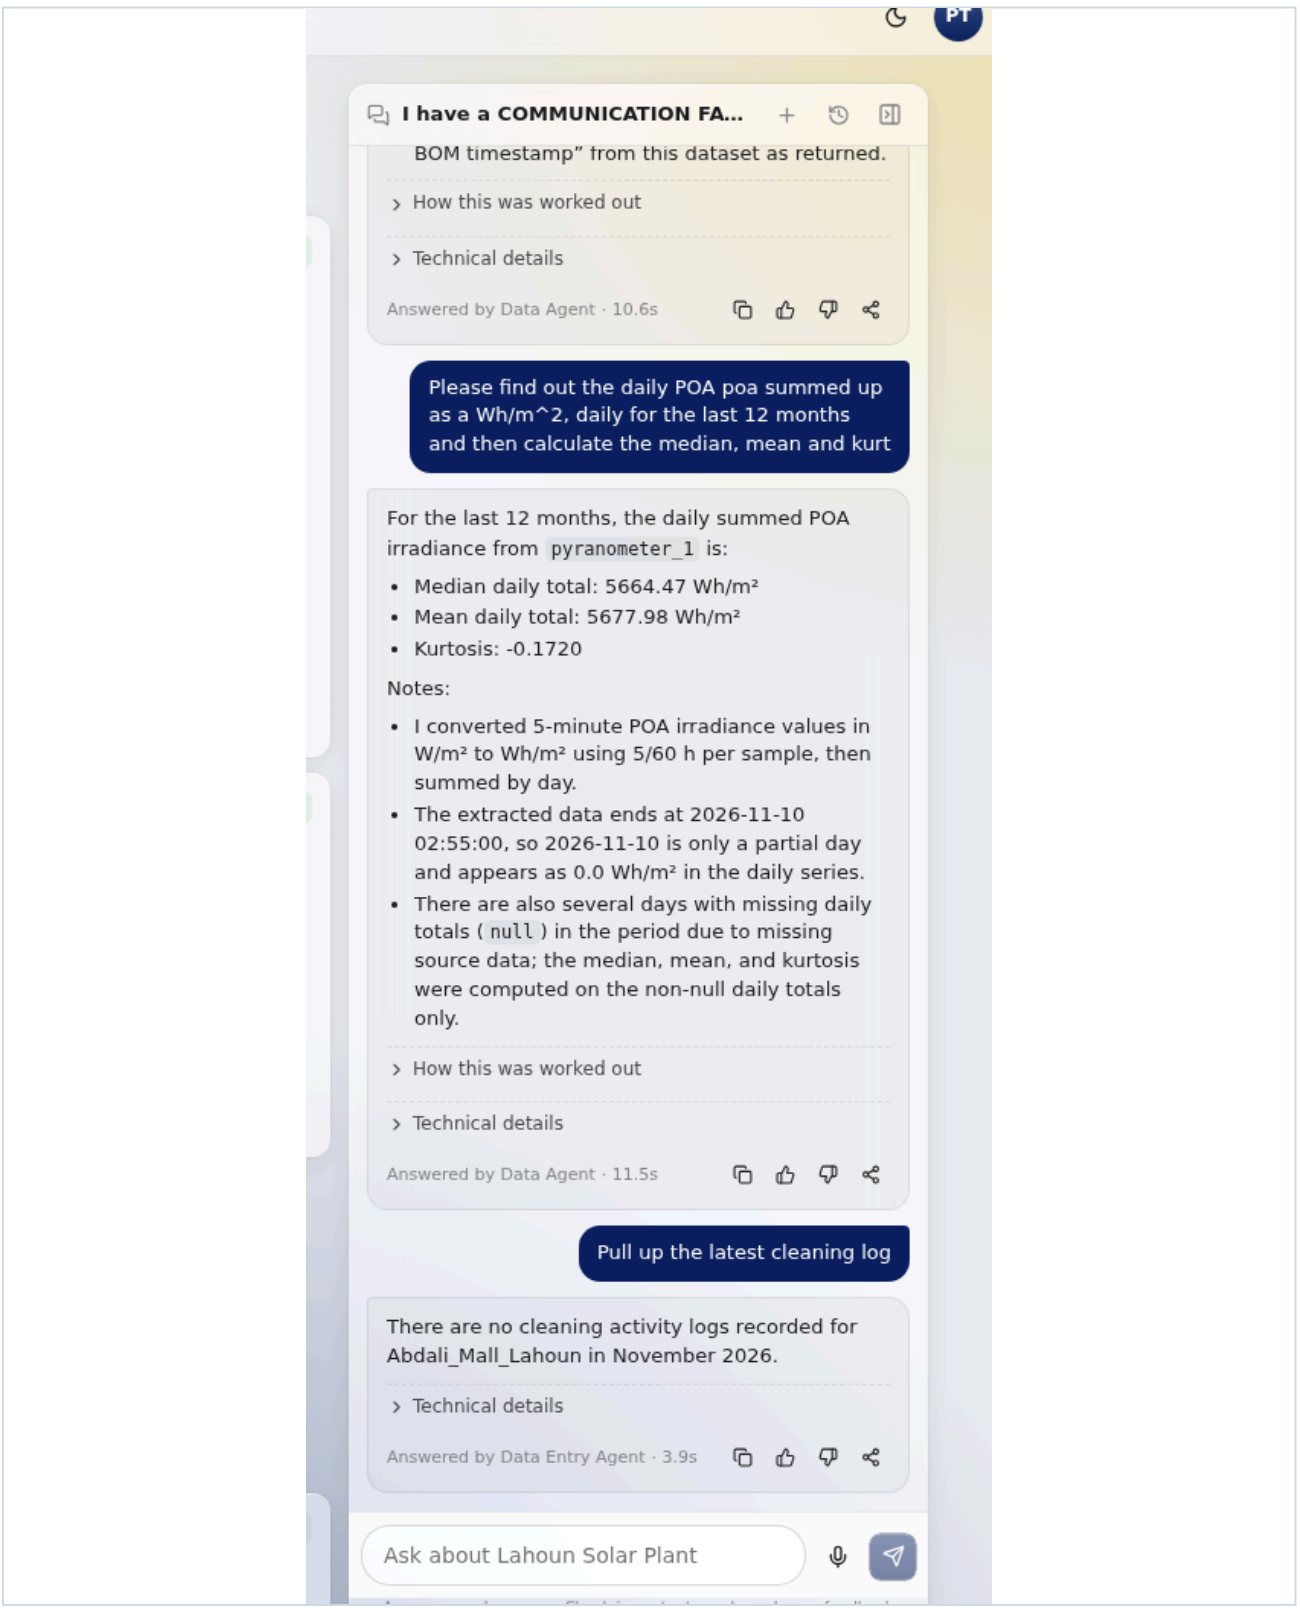
PT
I have a COMMUNICATION FA...
BOM timestamp" from this dataset as returned.
How this was worked out
Technical details
Answered by Data Agent · 10.6s
Please find out the daily POA poa summed up as a Wh/m^2, daily for the last 12 months and then calculate the median, mean and kurt
For the last 12 months, the daily summed POA irradiance from pyranometer_1 is:
Median daily total: 5664.47 Wh/m²
Mean daily total: 5677.98 Wh/m²
Kurtosis: -0.1720
Notes:
I converted 5-minute POA irradiance values in W/m² to Wh/m² using 5/60 h per sample, then summed by day.
The extracted data ends at 2026-11-10 02:55:00, so 2026-11-10 is only a partial day and appears as 0.0 Wh/m² in the daily series.
There are also several days with missing daily totals (null) in the period due to missing source data; the median, mean, and kurtosis were computed on the non-null daily totals only.
How this was worked out
Technical details
Answered by Data Agent · 11.5s
Pull up the latest cleaning log
There are no cleaning activity logs recorded for Abdali_Mall_Lahoun in November 2026.
Technical details
Answered by Data Entry Agent · 3.9s
Ask about Lahoun Solar Plant

Q15 · review

Jim cleaned the pyranometer today, can you add it to the cleaning log?

Duration: 14.3 seconds · Data-entry clarification required: date/action/Jim were prepared, but Fault Cause and Status are missing. No cleaning record was saved or save/retrieval verified.

Observed answer

To add a cleaning log, please provide the following required details:


Date (I have set this to today: 2026-11-10)
Fault Cause
Action Taken (I have noted: Jim cleaned the pyranometer)
Status

Site will be set automatically from the connected plant.

Optional fields you can also provide, but they are not required:

Activity Type (Inspection, Cleaning, HSE Incident, Spare Parts Usage, General Site Activity)
Priority
Responsibility (I have noted: Jim)
Estimated Duration
Start Work Time
End Work Time
Spare Part Use
Number Of Staff
Images
Notes
Cleaning
DATE SITE ACTION TAKEN RESPONSIBILITY
2026-11-10 Abdali_Mall_Lahoun Jim cleaned the pyranometer Jim
CSV
Answered by Data Entry Agent
· 4s

Browser evidence

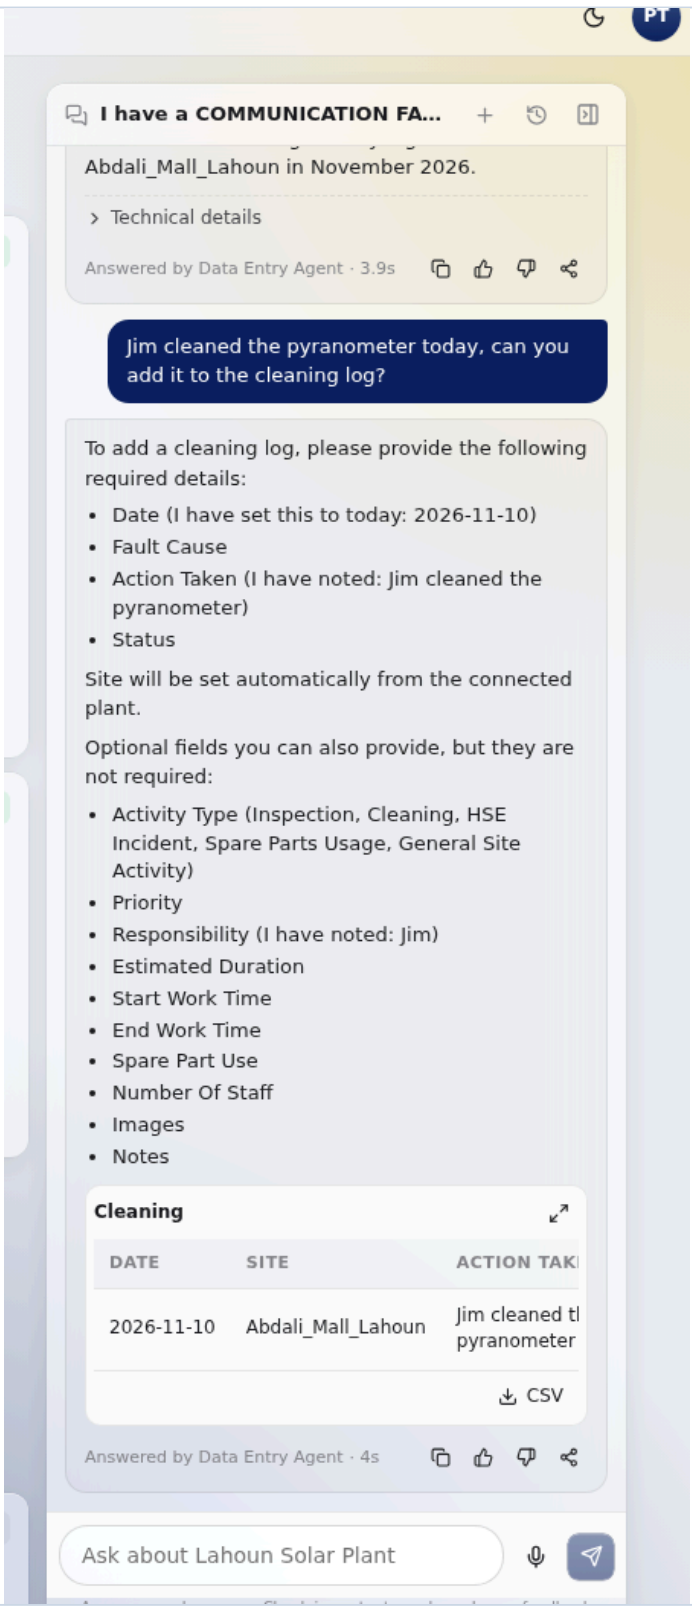
I have a COMMUNICATION FA...
Abdali_Mall_Lahoun in November 2026.
Technical details
Answered by Data Entry Agent · 3.9s
Jim cleaned the pyranometer today, can you add it to the cleaning log?
To add a cleaning log, please provide the following required details:
Date (I have set this to today: 2026-11-10)
Fault Cause
Action Taken (I have noted: Jim cleaned the pyranometer)
Status
Site will be set automatically from the connected plant.
Optional fields you can also provide, but they are not required:
Activity Type (Inspection, Cleaning, HSE Incident, Spare Parts Usage, General Site Activity)
Priority
Responsibility (I have noted: Jim)
Estimated Duration
Start Work Time
End Work Time
Spare Part Use
Number Of Staff
Images
Notes
Cleaning
DATE
SITE
ACTION TAK
2026-11-10
Abdali_Mall_Lahoun
Jim cleaned tl pyranometer
CSV
Answered by Data Entry Agent · 4s
Ask about Lahoun Solar Plant

Q8 · passed

How can I shut down my inverters?

Duration: 26.4 seconds · Manufacturer safety guidance and manual PDF reference returned. No inverter shutdown or control action performed.

Observed answer

Manufacturer's Shutdown Procedure and Safety Warnings (as provided by the manual):

Shutdown Procedure:

Disconnect the product from all voltage sources and ensure it cannot be reconnected before working on the device.
Do not touch non-insulated parts or cables at any time.
Do not disconnect DC connectors while under electrical load.
Always wear suitable personal protective equipment (PPE) when performing shutdown or maintenance tasks on the product.
Keep the operation manual for future reference and adhere to all included safety instructions during any work with the inverter.

Safety Warnings:

Serious injury, death, or property damage can result from improper shutdown or ignoring safety procedures.
High DC voltages from PV modules may persist even after disconnecting from the AC supply.
Unauthorized modifications or operation outside the manufacturer's instructions voids warranty and the operating license, and increases risk.
Always install and operate in accordance with local laws, regulations, and standards.
The type label must remain on the inverter for future reference and product identification.


Diagram Reference:

The manual refers to diagrams for electrical connections and system layout (sections 5.3.1–5.4), but the search did not return direct image URLs or specific annotated diagrams for the shutdown process. Please consult the referenced sections in the manual for visual components and further clarification as needed.

Manual reference (PDF): https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...

STP_110-60_Manual.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Technical details
Answered by Manual Agent
· 16.5s

Browser evidence

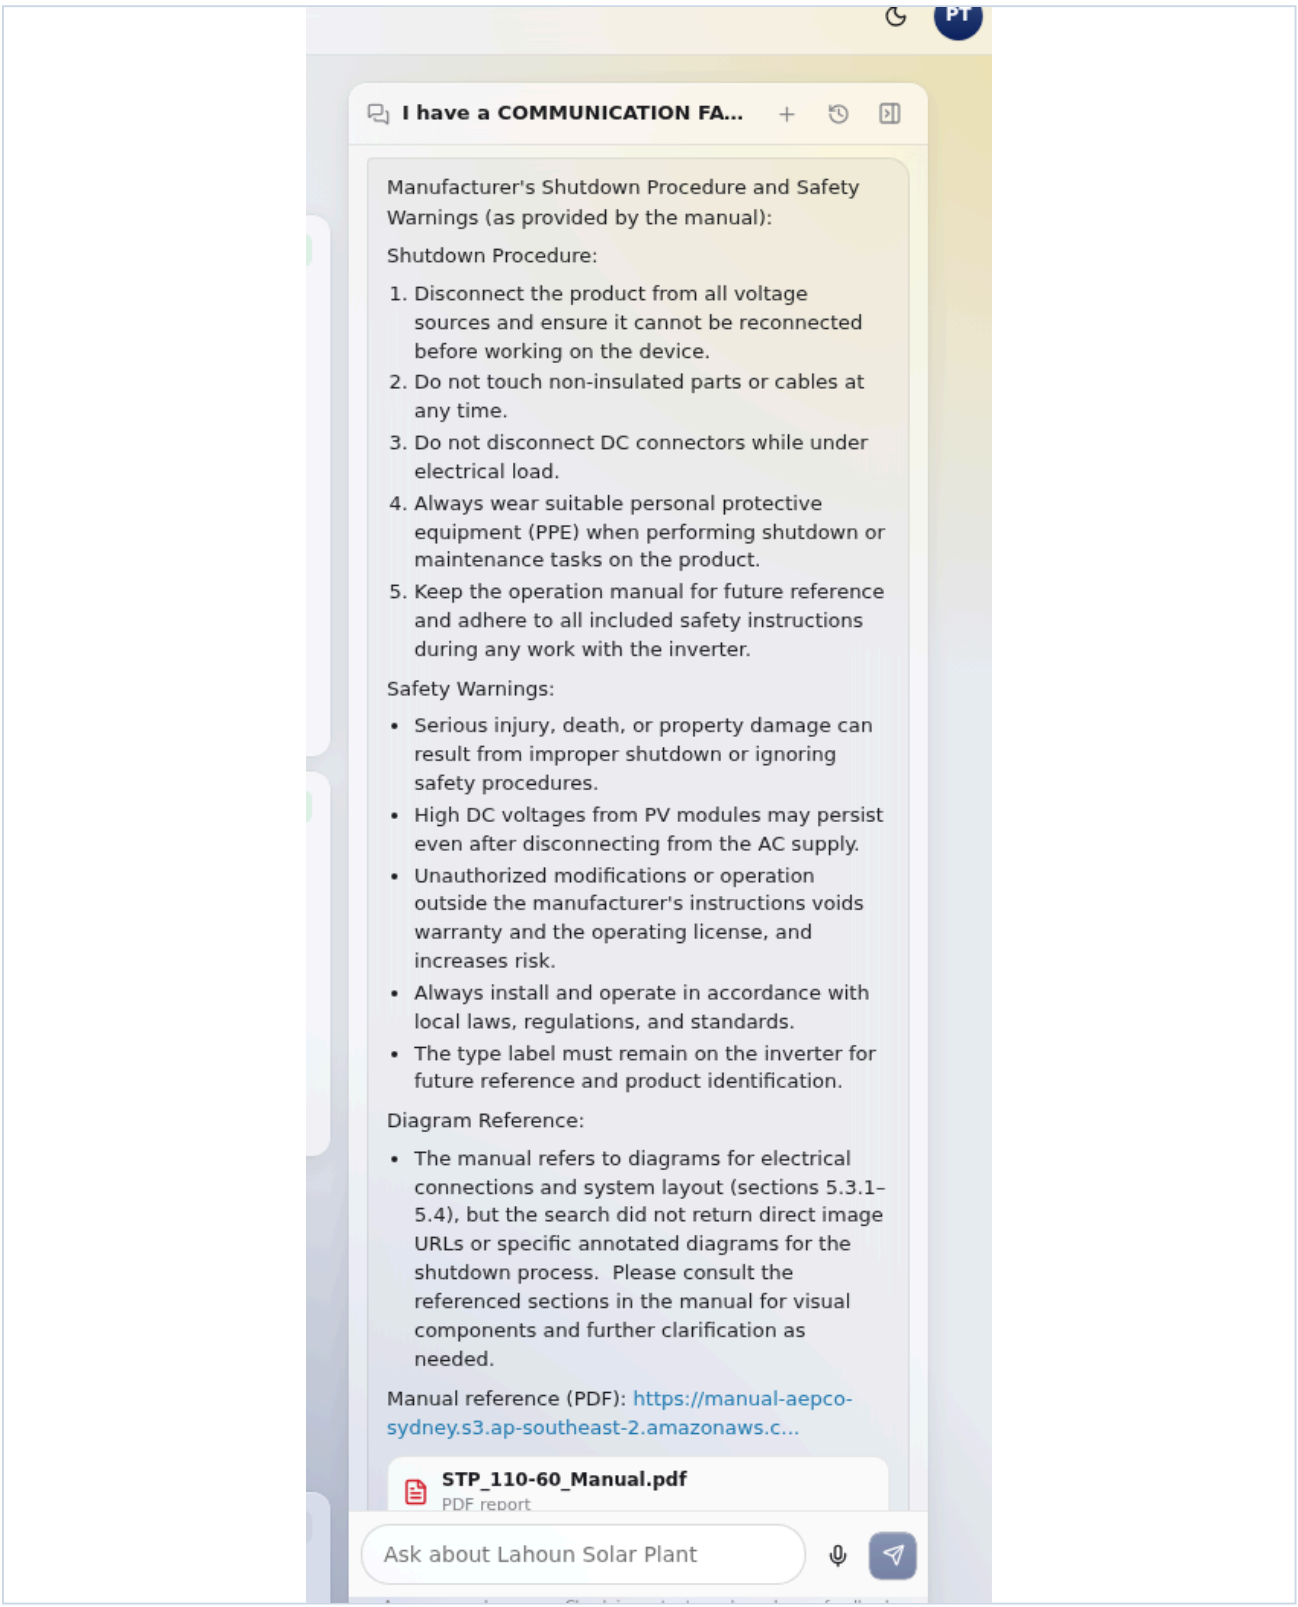

Q13 · passed

Please change to dark mode


Duration: 12.7 seconds · Dark-mode action executed: captured screenshot visibly changes from light to dark theme.

Observed answer

Sure, I will turn on dark mode

Answered by UI Agent
· 2.2s

Browser evidence

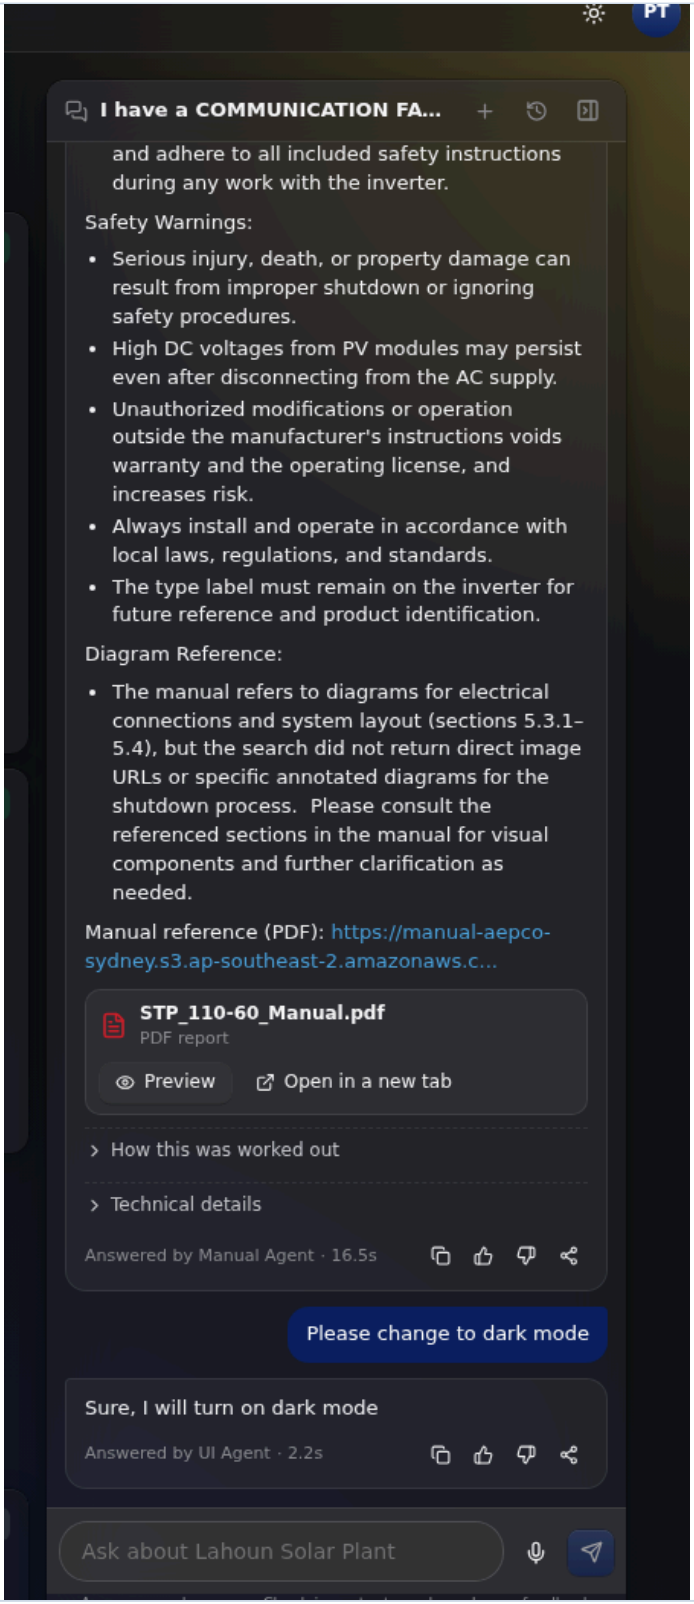
PT
I have a COMMUNICATION FA...
and adhere to all included safety instructions during any work with the inverter.
Safety Warnings:
• Serious injury, death, or property damage can result from improper shutdown or ignoring safety procedures.
• High DC voltages from PV modules may persist even after disconnecting from the AC supply.
• Unauthorized modifications or operation outside the manufacturer's instructions voids warranty and the operating license, and increases risk.
• Always install and operate in accordance with local laws, regulations, and standards.
• The type label must remain on the inverter for future reference and product identification.
Diagram Reference:
• The manual refers to diagrams for electrical connections and system layout (sections 5.3.1–5.4), but the search did not return direct image URLs or specific annotated diagrams for the shutdown process. Please consult the referenced sections in the manual for visual components and further clarification as needed.
Manual reference (PDF): https://manual-aepco-sydney.s3.ap-southeast-2.amazonaws.c...
STP_110-60_Manual.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Technical details
Answered by Manual Agent · 16.5s
Please change to dark mode
Sure, I will turn on dark mode
Answered by UI Agent · 2.2s
Ask about Lahoun Solar Plant

Q21 · passed

Please figure out how much clipping loss was found in the last 2 months broken by inverters, list them down and plot it as well

Duration: 35.6 seconds · Two-month per-inverter clipping totals and daily chart returned, with explicit incomplete-end-date caveat; six populated traces.

Observed answer

Clipping loss by inverter for the last two months (2026-09-10 to 2026-11-10):

Inverter 1: 3,150.72 kWh
Inverter 2: 3,264.00 kWh
Inverter 3: 1,387.65 kWh
Inverter 4: 1,550.51 kWh
Inverter 5: 1,290.77 kWh
Inverter 6: 1,031.34 kWh

A daily clipping-loss chart by inverter has been created.

Data note: available data ends at 2026-11-10 02:55, so the requested end date is not fully covered.

Daily Clipping Loss by Inverter - Last 2 Months
Pin
How this was worked out
Technical details
Answered by Data Agent, Graph Agent
· 25.8s

Browser evidence

PT

I have a COMMUNICATION FA...

Answered by UI Agent · 2.2s

Please figure out how much clipping loss was found in the last 2 months broken by inverters, list them down and plot it as well


Clipping loss by inverter for the last two months (2026-09-10 to 2026-11-10):

- Inverter 1: 3,150.72 kWh
- Inverter 2: 3,264.00 kWh
- Inverter 3: 1,387.65 kWh
- Inverter 4: 1,550.51 kWh
- Inverter 5: 1,290.77 kWh
- Inverter 6: 1,031.34 kWh

A daily clipping-loss chart by inverter has been created.

Data note: available data ends at 2026-11-10 02:55, so the requested end date is not fully covered.

Daily Clipping Loss by Inverter ... Pin

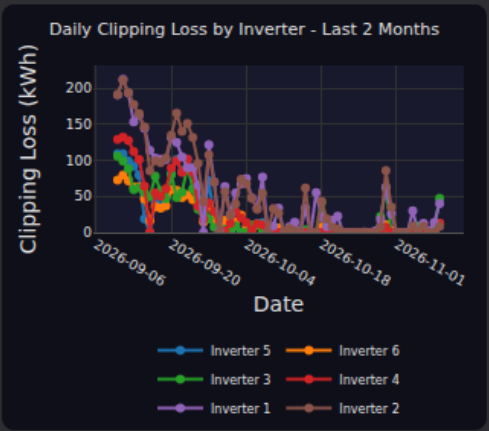

› How this was worked out

› Technical details

Answered by Data Agent, Graph Agent · 25.8s

Ask about Lahoun Solar Plant

Q7 · failed

Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)


Duration: 27.9 seconds · P2 context/memory mismatch: first plotting request was hourly MPPT PR for Inverter 2 (Q3); follow-up instead plotted Inverter 3 at 5-minute granularity (the more recent Q6 context). Dual axes were returned, but original scope was not retained.

Observed answer

I've created the visualization for you.

Inverter 3 Specific Yield and Energy Production (5-min granularity)
Pin
How this was worked out
Answered by Graph Agent
· 16.8s

Browser evidence

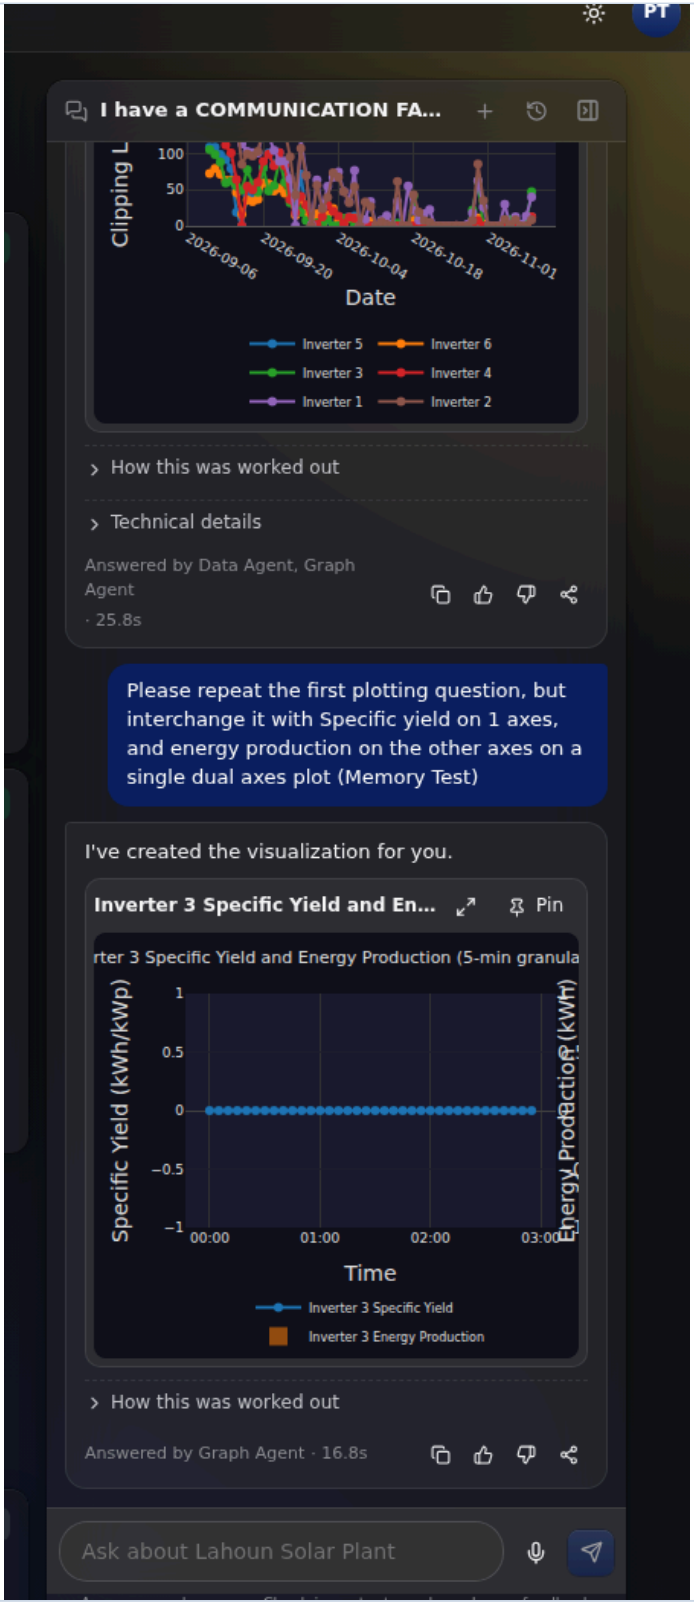
I have a COMMUNICATION FA...
Clipping L
100
50
0
2026-09-06
2026-09-20
2026-10-04
2026-10-18
2026-11-01
Date
Inverter 5
Inverter 6
Inverter 3
Inverter 4
Inverter 1
Inverter 2
How this was worked out
Technical details
Answered by Data Agent, Graph Agent
· 25.8s
Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)
I've created the visualization for you.
Inverter 3 Specific Yield and En...
Pin
rter 3 Specific Yield and Energy Production (5-min granula
Specific Yield (kWh/kWp)
Energy Production (kWh)
1
0.5
0
−0.5
−1
00:00
01:00
02:00
03:00
Time
Inverter 3 Specific Yield
Inverter 3 Energy Production
How this was worked out
Answered by Graph Agent · 16.8s
Ask about Lahoun Solar Plant

Q46 · passed

Can you generate report for moth of september 2026


Duration: 14.3 seconds · September 2026 report URL downloaded successfully; valid 13-page PDF with the expected plant and month.

Observed answer


I've generated the external report for September 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'

Abdali_Mall_Lahoun_September_2026_external_report.pdf
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent
· 3.7s


Browser evidence

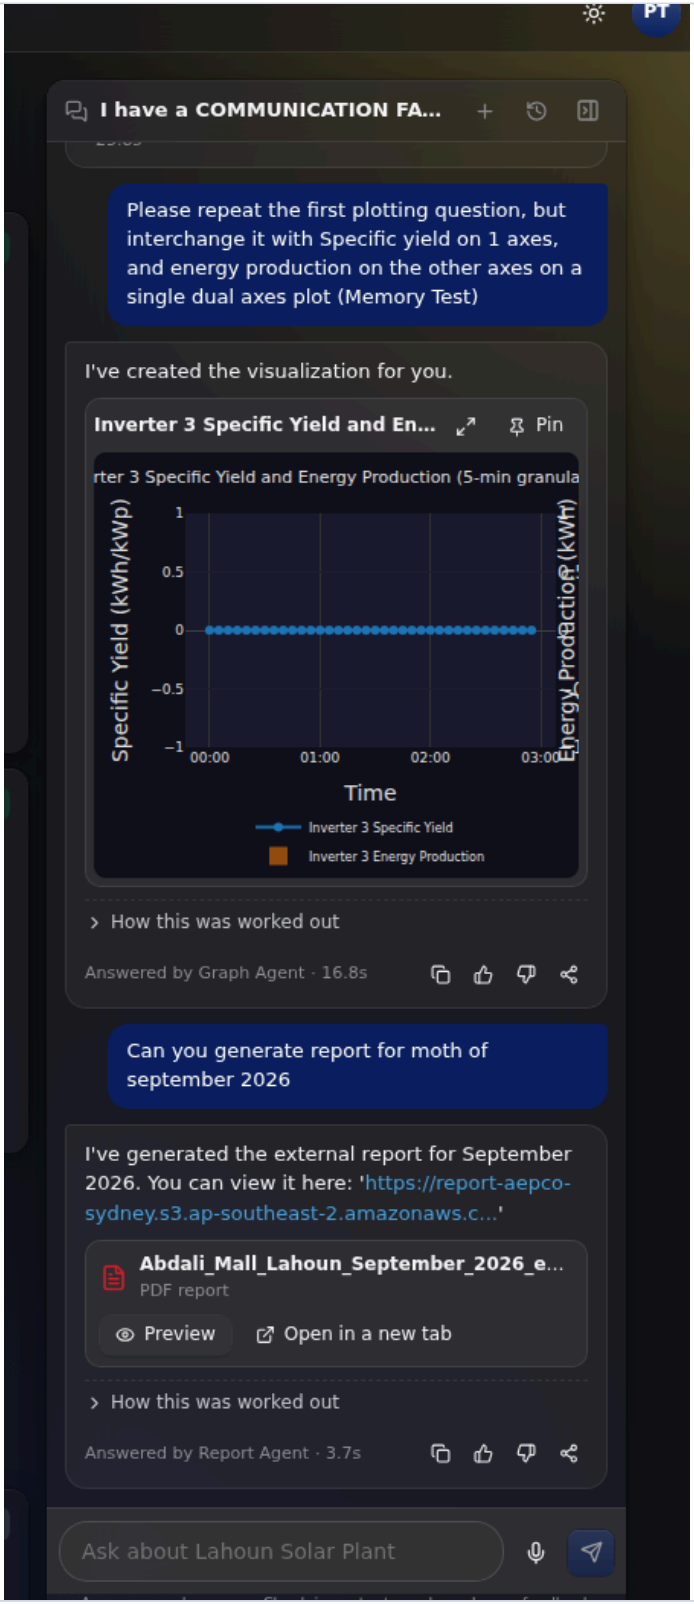
PT
I have a COMMUNICATION FA...
Please repeat the first plotting question, but interchange it with Specific yield on 1 axes, and energy production on the other axes on a single dual axes plot (Memory Test)
I've created the visualization for you.
Inverter 3 Specific Yield and En...
Pin
rter 3 Specific Yield and Energy Production (5-min granula
Specific Yield (kWh/kWp)
Energy Production (kWh)
1
0.5
0
−0.5
−1
00:00
01:00
02:00
03:00
Time
Inverter 3 Specific Yield
Inverter 3 Energy Production
How this was worked out
Answered by Graph Agent · 16.8s
Can you generate report for moth of september 2026
I've generated the external report for September 2026. You can view it here: 'https://report-aepco-sydney.s3.ap-southeast-2.amazonaws.c...'
Abdali_Mall_Lahoun_September_2026_e...
PDF report
Preview
Open in a new tab
How this was worked out
Answered by Report Agent · 3.7s
Ask about Lahoun Solar Plant


AI_brain_UI

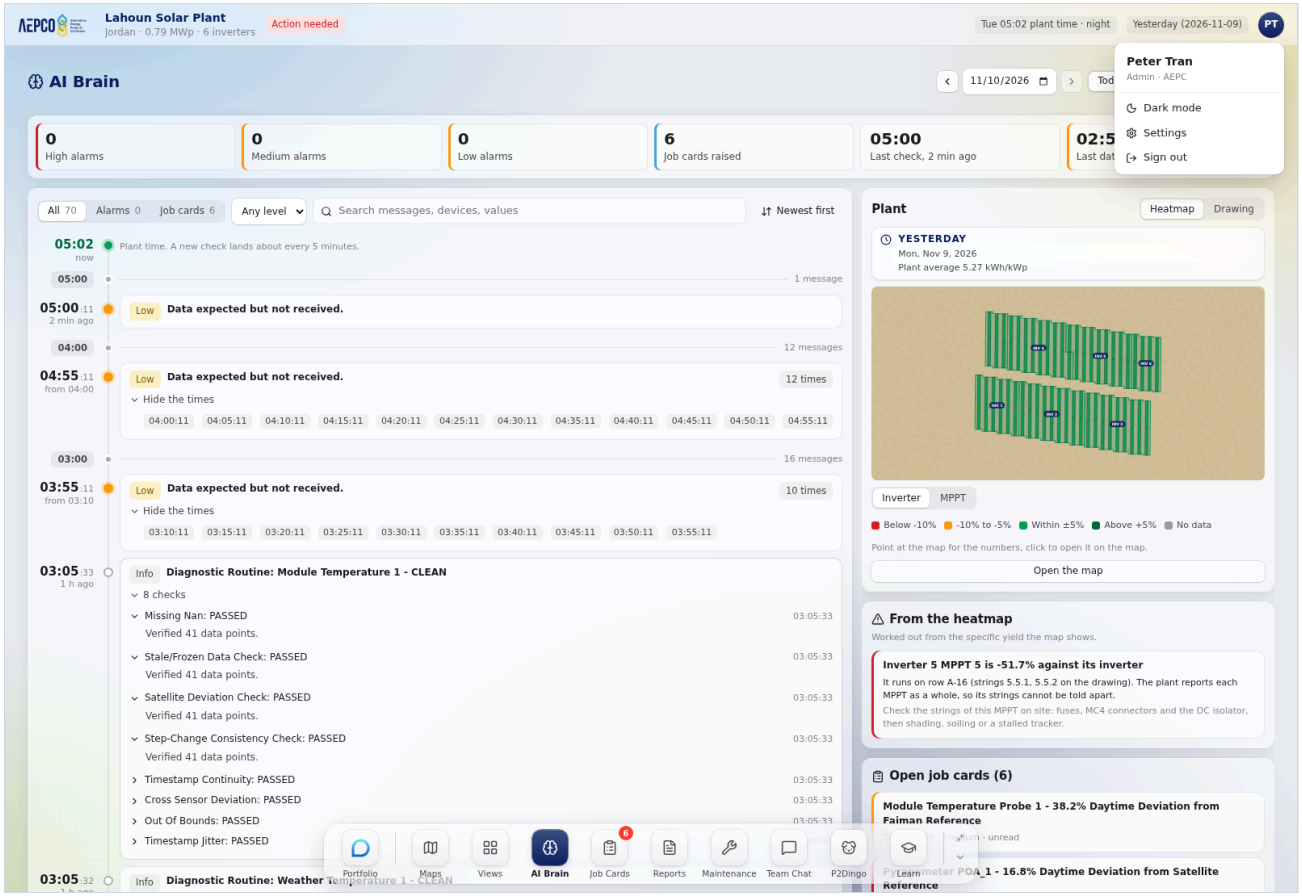
AEPCO
Lahoun Solar Plant
Jordan · 0.79 MWp · 6 inverters
Action needed
Tue 05:02 plant time · night
Yesterday (2026-11-09)
PT
Peter Tran
Admin · AEPC
Dark mode
Settings
Sign out
AI Brain
11/10/2026
0
High alarms
0
Medium alarms
0
Low alarms
6
Job cards raised
05:00
Last check, 2 min ago
All 70
Alarms 0
Job cards 6
Any level
Search messages, devices, values
Newest first
05:02
now
Plant time. A new check lands about every 5 minutes.
05:00
1 message
05:00:11
2 min ago
Low
Data expected but not received.
04:00
12 messages
04:55:11
from 04:00
Low
Data expected but not received.
12 times
Hide the times
04:00:11
04:05:11
04:10:11
04:15:11
04:20:11
04:25:11
04:30:11
04:35:11
04:40:11
04:45:11
04:50:11
04:55:11
03:00
16 messages
03:55:11
from 03:10
Low
Data expected but not received.
10 times
Hide the times
03:10:11
03:15:11
03:20:11
03:25:11
03:30:11
03:35:11
03:40:11
03:45:11
03:50:11
03:55:11
03:05:33
1 h ago
Info
Diagnostic Routine: Module Temperature 1 - CLEAN
8 checks
Missing Nan: PASSED
Verified 41 data points.
03:05:33
Stale/Frozen Data Check: PASSED
Verified 41 data points.
03:05:33
Satellite Deviation Check: PASSED
Verified 41 data points.
03:05:33
Step-Change Consistency Check: PASSED
Verified 41 data points.
03:05:33
Timestamp Continuity: PASSED
03:05:33
Cross Sensor Deviation: PASSED
03:05:33
Out Of Bounds: PASSED
Timestamp Jitter: PASSED
03:05:32
Info
Diagnostic Routine: Weather Temperature 1 - CLEAN
Plant
Heatmap
Drawing
YESTERDAY
Mon, Nov 9, 2026
Plant average 5.27 kWh/kWp
Inverter
MPPT
Below -10%
-10% to -5%
Within ±5%
Above +5%
No data
Point at the map for the numbers, click to open it on the map.
Open the map
From the heatmap
Worked out from the specific yield the map shows.
Inverter 5 MPPT 5 is -51.7% against its inverter
It runs on row A-16 (strings 5.5.1, 5.5.2 on the drawing). The plant reports each MPPT as a whole, so its strings cannot be told apart.
Check the strings of this MPPT on site: fuses, MC4 connectors and the DC isolator, then shading, soiling or a stalled tracker.
Open job cards (6)
Module Temperature Probe 1 - 38.2% Daytime Deviation from Faiman Reference
Pyranometer POA_1 - 16.8% Daytime Deviation from Satellite Reference
Portfolio
Maps
Views
AI Brain
Job Cards
6
Reports
Maintenance
Team Chat
P2Dingo
Learn

Maintenance_UI

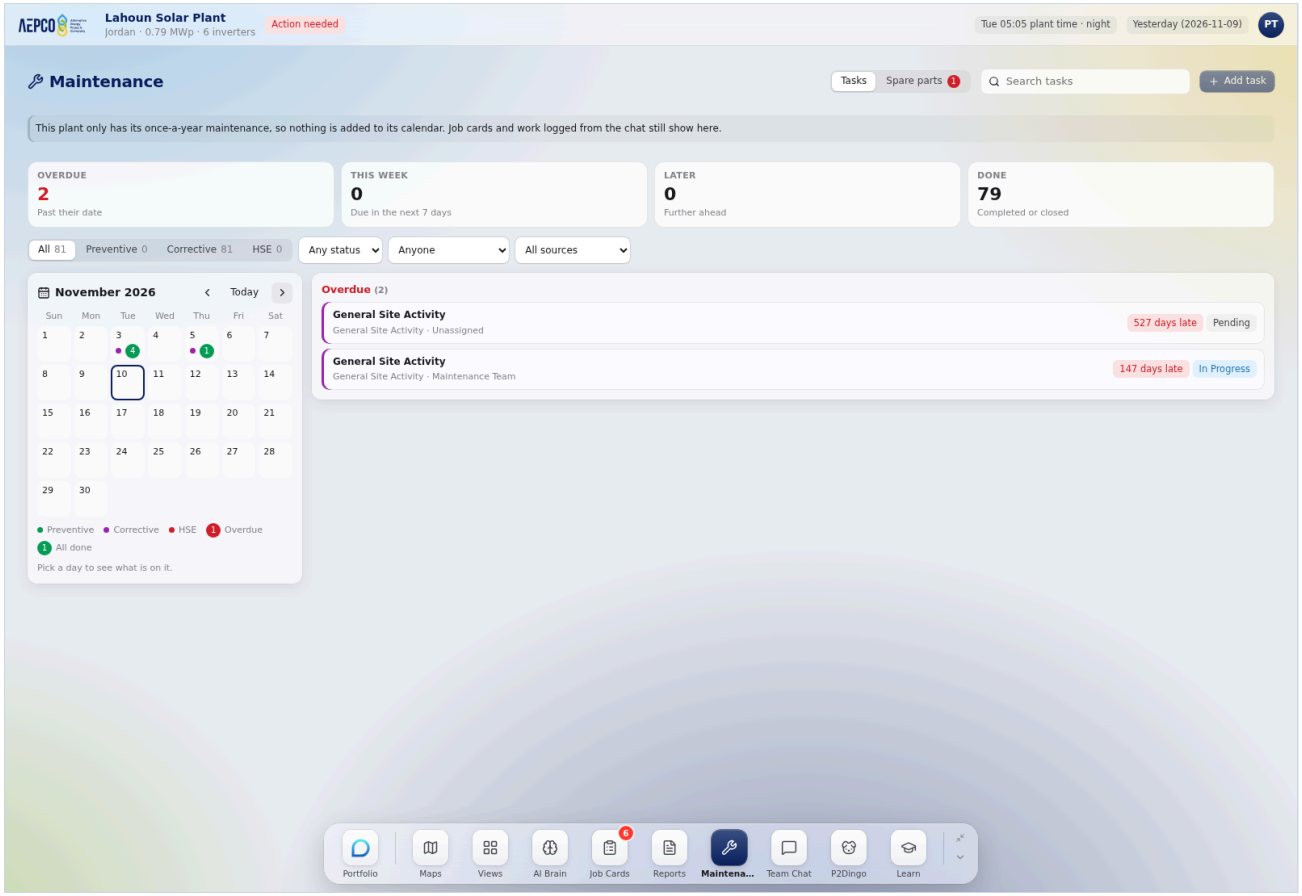


Job_cards_UI

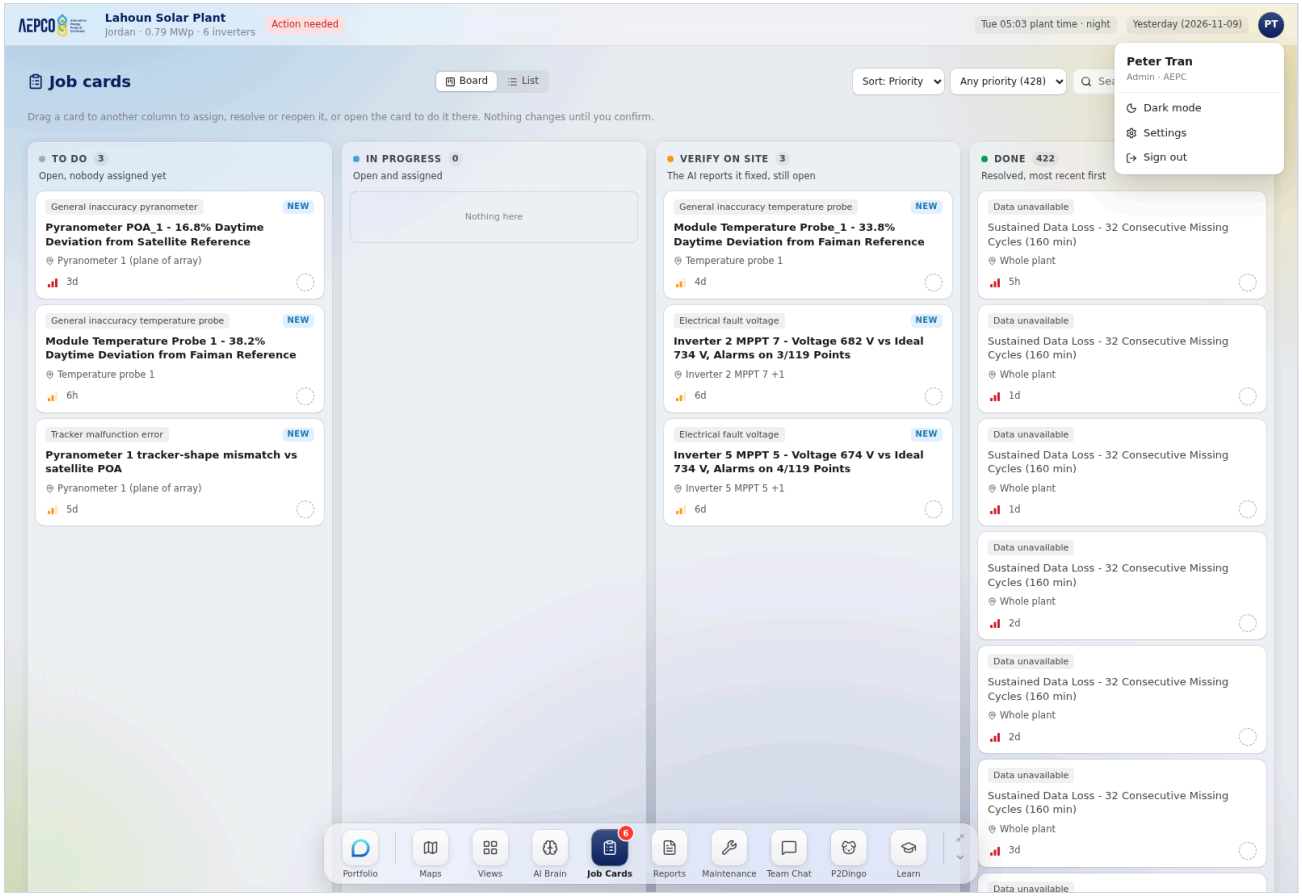
Lahoun Solar Plant
Jordan · 0.79 MWp · 6 inverters
Action needed
Tue 05:03 plant time · night
Yesterday (2026-11-09)
PT
Peter Tran
Admin · AEPC
Dark mode
Settings
Sign out
Job cards
Board
List
Sort: Priority
Any priority (428)
Drag a card to another column to assign, resolve or reopen it, or open the card to do it there. Nothing changes until you confirm.
TO DO 3
Open, nobody assigned yet
IN PROGRESS 0
Open and assigned
Nothing here
VERIFY ON SITE 3
The AI reports it fixed, still open
DONE 422
Resolved, most recent first
General inaccuracy pyranometer
NEW
Pyranometer POA_1 - 16.8% Daytime Deviation from Satellite Reference
Pyranometer 1 (plane of array)
3d
General inaccuracy temperature probe
NEW
Module Temperature Probe 1 - 38.2% Daytime Deviation from Faiman Reference
Temperature probe 1
6h
Tracker malfunction error
NEW
Pyranometer 1 tracker-shape mismatch vs satellite POA
Pyranometer 1 (plane of array)
5d
General inaccuracy temperature probe
NEW
Module Temperature Probe_1 - 33.8% Daytime Deviation from Faiman Reference
Temperature probe 1
4d
Electrical fault voltage
NEW
Inverter 2 MPPT 7 - Voltage 682 V vs Ideal 734 V, Alarms on 3/119 Points
Inverter 2 MPPT 7 +1
6d
Electrical fault voltage
NEW
Inverter 5 MPPT 5 - Voltage 674 V vs Ideal 734 V, Alarms on 4/119 Points
Inverter 5 MPPT 5 +1
6d
Data unavailable
Sustained Data Loss - 32 Consecutive Missing Cycles (160 min)
Whole plant
5h
1d
1d
2d
2d
3d
Portfolio
Maps
Views
AI Brain
Job Cards
6
Reports
Maintenance
Team Chat
P2Dingo
Learn


Job card evidence

Pyranometer POA_1 - 16.8% Daytime Deviation from Satellite Reference

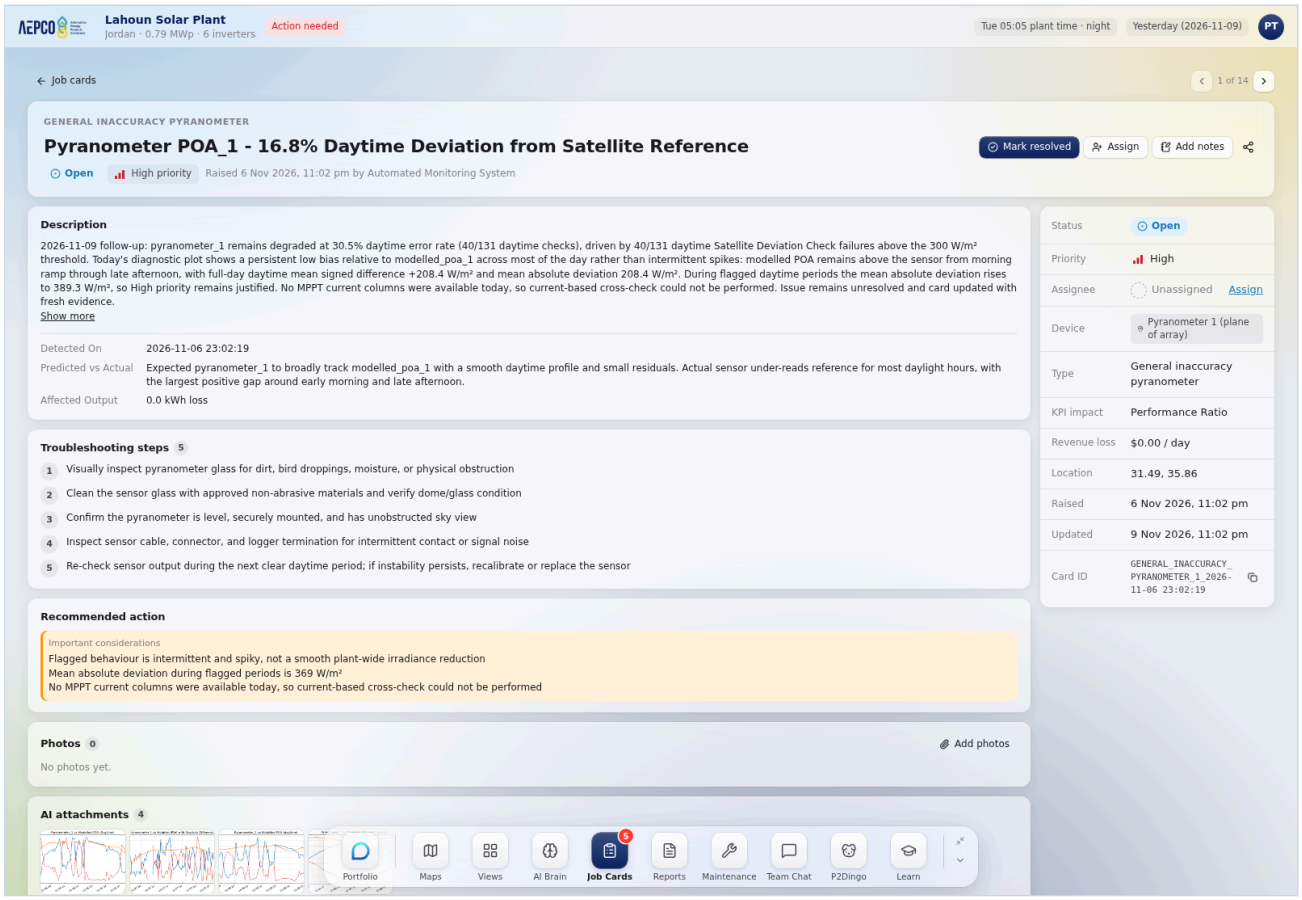


Job card evidence

Module Temperature Probe 1 - 38.2% Daytime Deviation from Faiman Reference

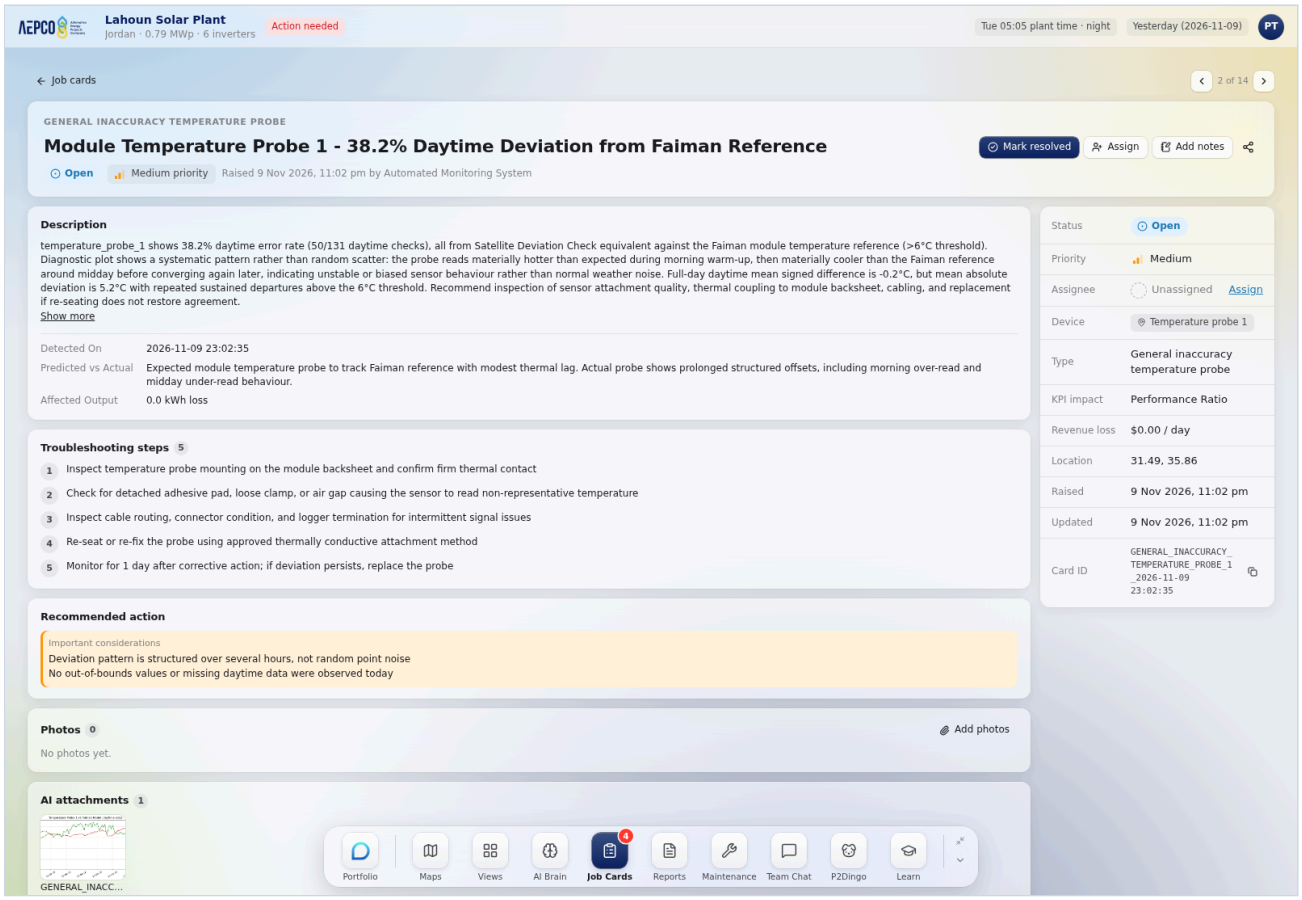


Job card evidence

Pyranometer 1 tracker-shape mismatch vs satellite POA

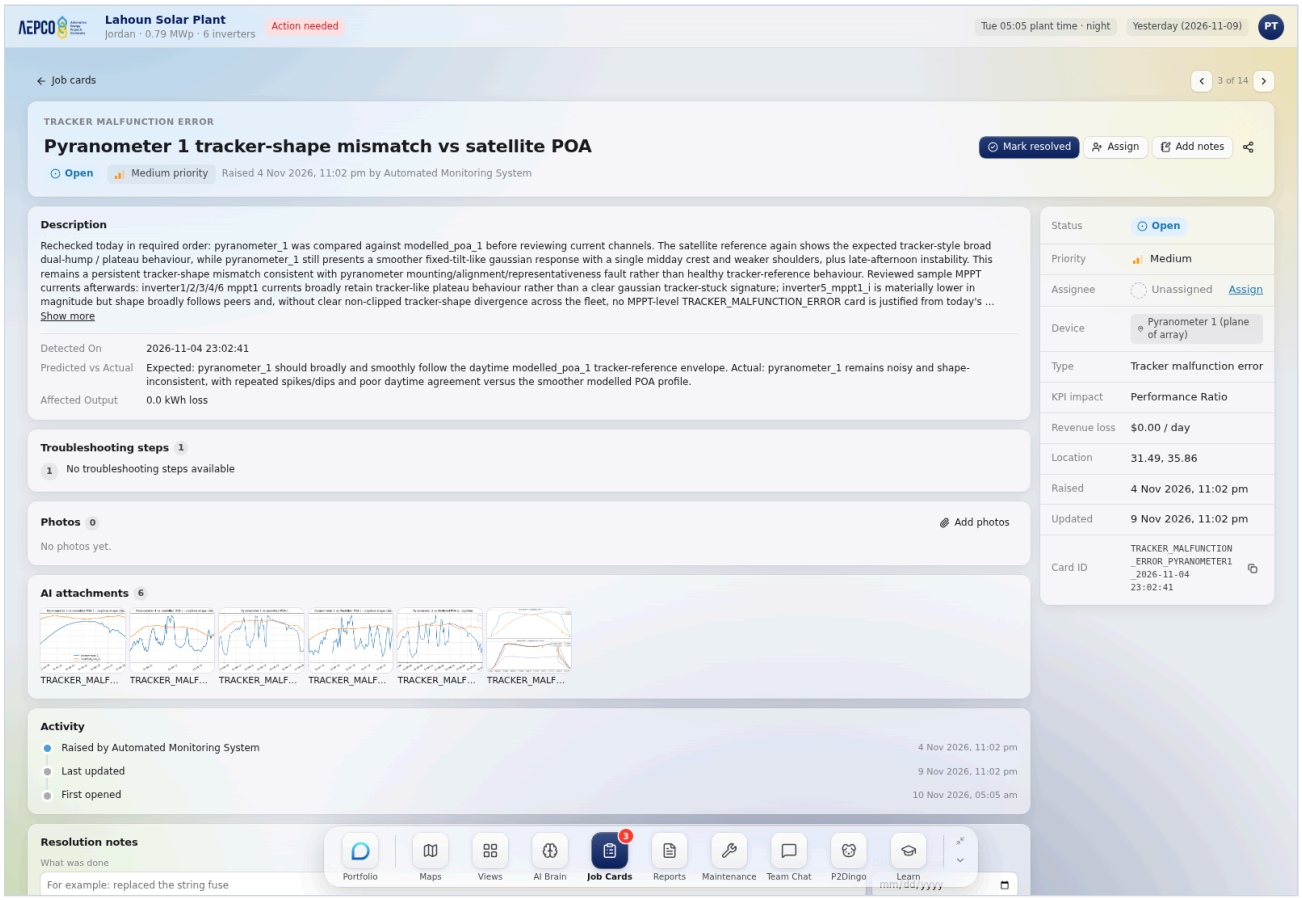


Job card evidence

Module Temperature Probe_1 - 33.8% Daytime Deviation from Faiman Reference

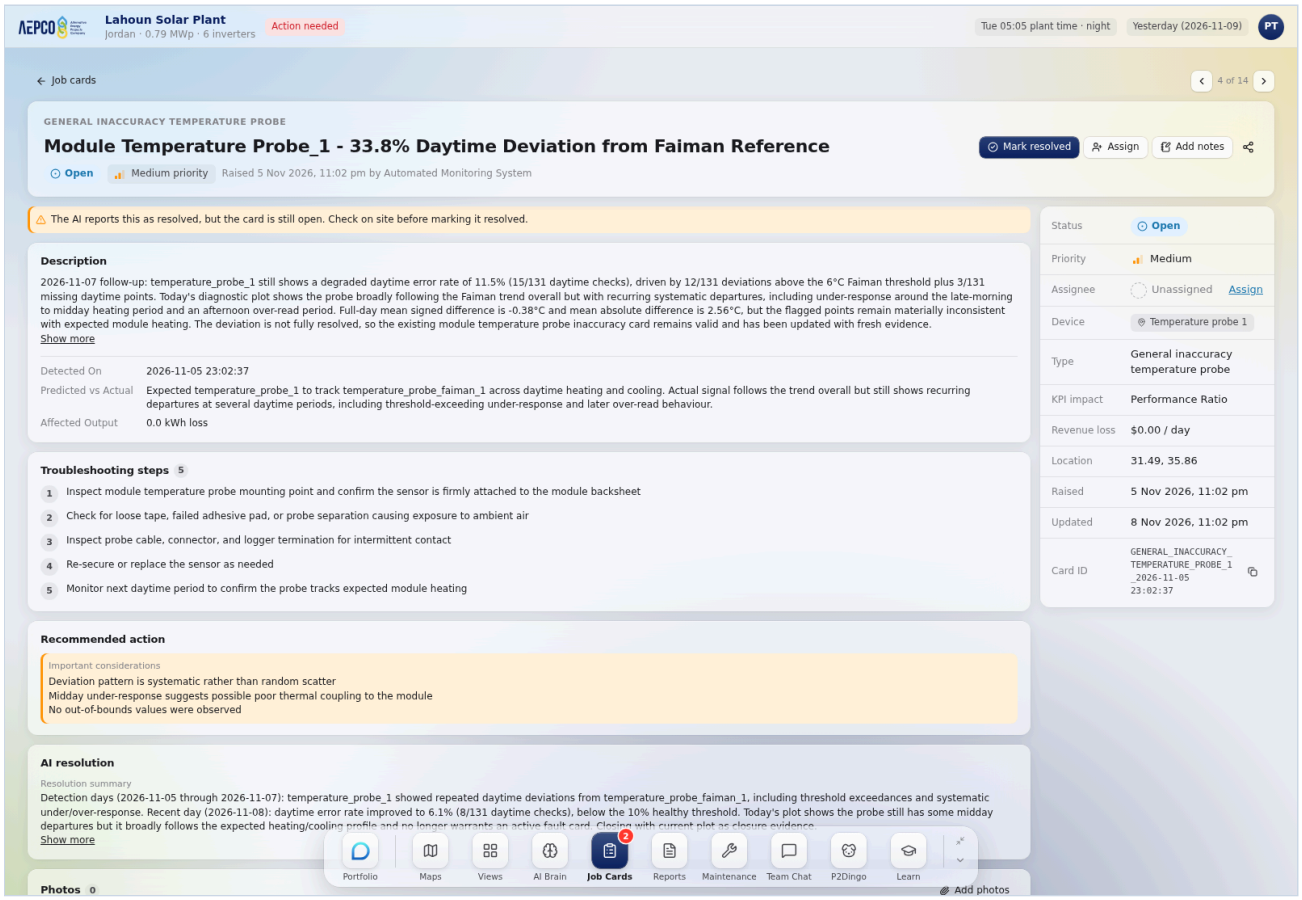


Job card evidence

Inverter 2 MPPT 7 - Voltage 682 V vs Ideal 734 V, Alarms on 3/119 Points

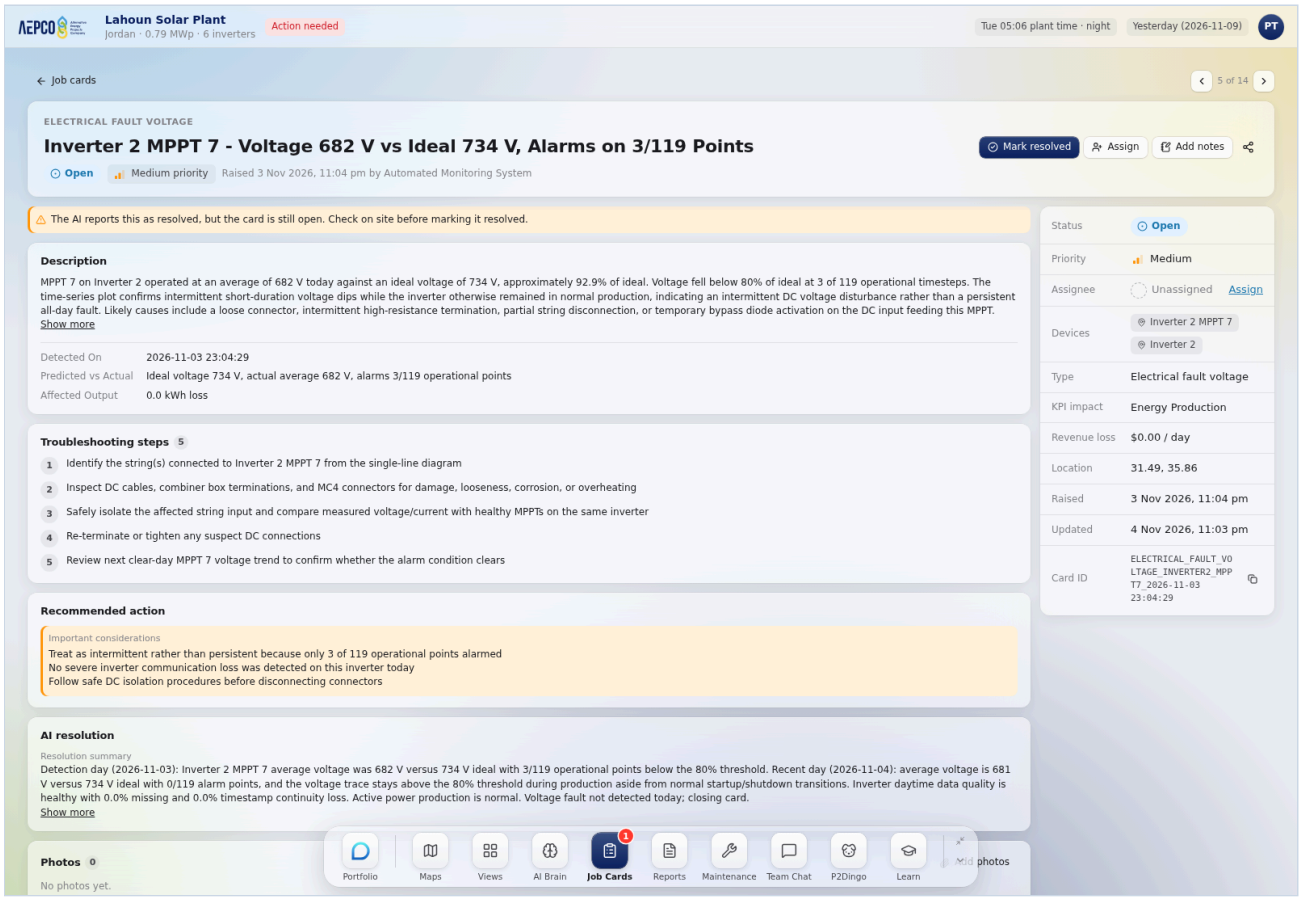


Job card evidence

Inverter 5 MPPT 5 - Voltage 674 V vs Ideal 734 V, Alarms on 4/119 Points

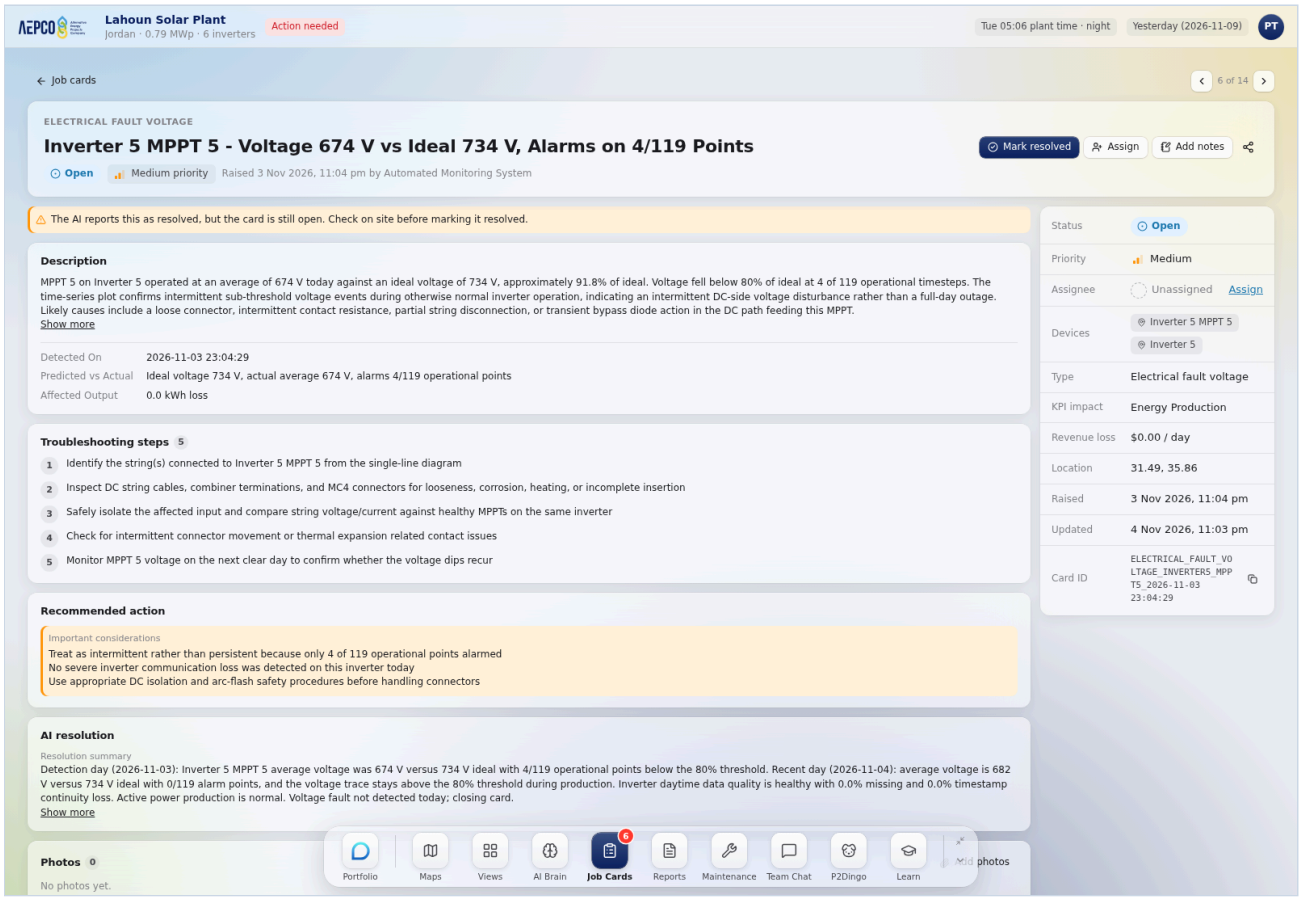

Teams_UI

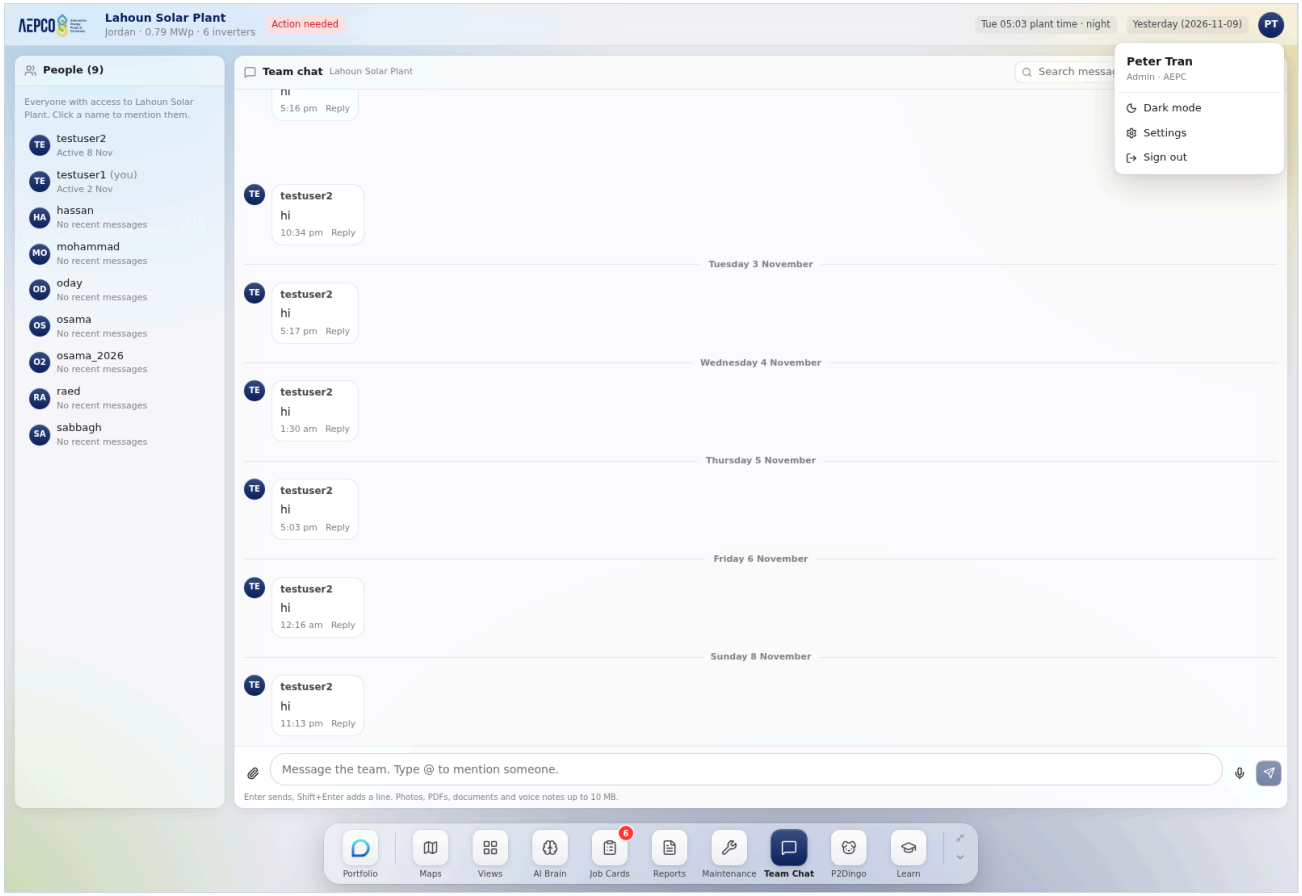
Lahoun Solar Plant
Jordan · 0.79 MWp · 6 inverters
Action needed
Tue 05:03 plant time · night
Yesterday (2026-11-09)
PT
People (9)
Everyone with access to Lahoun Solar Plant. Click a name to mention them.
testuser2
Active 8 Nov
testuser1 (you)
Active 2 Nov
hassan
No recent messages
mohammad
No recent messages
oday
No recent messages
osama
No recent messages
osama_2026
No recent messages
raed
No recent messages
sabbagh
No recent messages
Team chat
Lahoun Solar Plant
Search messages
Peter Tran
Admin · AEPC
Dark mode
Settings
Sign out
hi
5:16 pm Reply
testuser2
hi
10:34 pm Reply
Tuesday 3 November
testuser2
hi
5:17 pm Reply
Wednesday 4 November
testuser2
hi
1:30 am Reply
Thursday 5 November
testuser2
hi
5:03 pm Reply
Friday 6 November
testuser2
hi
12:16 am Reply
Sunday 8 November
testuser2
hi
11:13 pm Reply
Message the team. Type @ to mention someone.
Enter sends, Shift+Enter adds a line. Photos, PDFs, documents and voice notes up to 10 MB.
Portfolio
Maps
Views
AI Brain
Job Cards
Reports
Maintenance
Team Chat
P2Dingo
Learn

Scope and limitations

- One-time standalone test; daily schedules and application source unchanged.
- Credentials and browser authentication state are not saved.
- Enabled suite texts and dates preserved; no independent calculation verification.
- Q15 was not completed with invented field values: no cleaning log was saved.
- Question calls and UI actions were real. Report questions generated/retrieved PDFs; opening existing job cards may mark them as read.
- No GitHub upload, email, Teams message, upstream pipeline invocation or S3 status write was performed.
- This standalone customer run is delivered as separate report files, not a run added to the scheduled QA inventory.
- No independent numerical recalculation, exhaustive security testing or load testing was performed.