Daily 24-Hour Low Voltage (LT) Panels Electrical Report

Date: **14 October 2026** | Generated At: **03:01:39 IST** | Status: MASTER OFFLINE

8	0	0.0 kW	N/A
SUB-PANELS MONITORED	CIRCUITS ENERGIZED	TOTAL LIVE POWER LOAD	AVG GRID FREQUENCY (LIVE)

LT Sub-Panels Electrical Readings (Live values + 24h statistics)

SUB-PANEL	STATE	LIVE POWER	VOLTAGE	CURRENT	FREQUENCY	24H AVG / PEAK POWER
EVM Charger	NO DATA	N/A	N/A	N/A	N/A	N/A peak N/A
Electrical Room 1	STANDBY	**0.00 kW**	0.0 V	0.0 A	26.27 Hz as of 10 Oct 09:43	0.00 kW peak 0.00 kW
UPS Room 1	STANDBY	**0.00 kW**	0.0 V	0.0 A	21.55 Hz as of 10 Oct 09:06	0.00 kW peak 0.00 kW
Transformer 1	NO LIVE DATA	677.99 kW as of 06 Oct 19:17	433.3 V as of 06 Oct 19:17	923.5 A as of 06 Oct 19:17	49.82 Hz as of 06 Oct 19:17	N/A peak N/A
Transformer 2	NO LIVE DATA	485.22 kW as of 06 Oct 19:17	431.9 V as of 06 Oct 19:17	654.7 A as of 06 Oct 19:17	49.82 Hz	N/A peak N/A
Transformer 3	NO LIVE DATA	**0.00 kW**	0.0 V as of 06 Oct 19:17	0.0 A as of 06 Oct 19:17	0.00 Hz as of 06 Oct 18:21	0.00 kW peak 0.00 kW
UPS Panel 2	NO LIVE DATA	21.76 kW as of 27 Sep 00:03	230.8 V as of 27 Sep 00:03	94.3 A as of 27 Sep 00:03	50.04 Hz as of 27 Sep 00:03	N/A peak N/A
Fire Fighting Wall	NO DATA	N/A	N/A	N/A	N/A	N/A peak N/A

Greyed values with an "as of" date were not updated during the report period and are excluded from the totals above.

24-Hour Time Series Trends


EVM Charger (kW · 30-min average)

no data

No valid readings in the report period


Electrical Room 1 (kW · 30-min average)

avg 0 · min 0 · max 0 kW

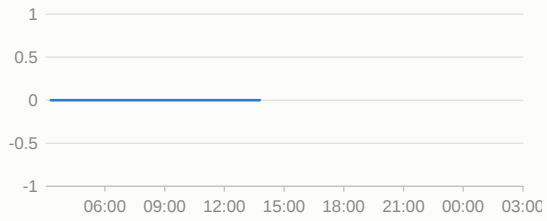

UPS Room 1 (kW · 30-min average)

avg 0 · min 0 · max 0 kW

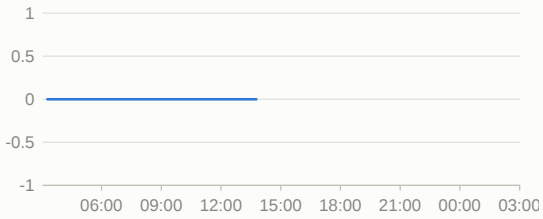

Transformer 1 (kW · 30-min average)

no data

No valid readings in the report period


Transformer 2 (kW · 30-min average)

no data

No valid readings in the report period

Transformer 3 (kW · 30-min average)

avg 0 · min 0 · max 0 kW

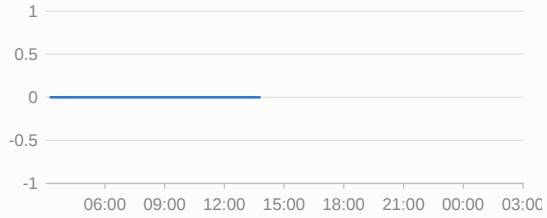

UPS Panel 2 (kW · 30-min average)

no data

No valid readings in the report period

Fire Fighting Wall (kW · 30-min average)

no data

No valid readings in the report period