

PRELIMINARY DESIGN

Veliko Tarnovo

SELECTED ATTACHMENT SOLUTION	VERTICAL CAPACITY CHECK	HORIZONTAL CAPACITY CHECK
OPTION 2	EXCEEDS CAPACITY	APPLICABLE
Walltopia support beams	Required vertical reaction: 12.75 kN	Required horizontal load: 4.00 kN

EXCEEDS CAPACITY	Vertical base reaction exceeds the entered allowable capacity.
------------------	--

SELECTED CONFIGURATION

STRUCTURE TYPE	HEIGHT	ATTACHMENT SCHEME	UNITS
Climbing wall	9 m	2 levels	Metric
COLUMN SPAN A	OVERHANG X	VALUES	STANDARD
8 m	7 m	Characteristic	EN 12572-1

LOADS AT SELECTED FORCE LEVEL

OPTION 2 — LOADS ON BUILDING COLUMNS

ATTACHMENT POINT	R · DL	R · LL	L · DL	L · LL
Base — vertical (Z)	-5.50	-8.00	—	—
Base — horizontal (X)	-0.93	-1.62	—	—
RX1 · 4 m	0.30	2.29	1.80	5.15
RX2 · 8 m	0.35	1.09	2.10	2.45


PRELIMINARY LOADS — NOT FOR CONSTRUCTION.

All values and selected details require verification by the responsible engineer.


CONFIGURATION VISUALS AND SELECTED DETAILS

OPTION 2 · Walltopia support beams | 9 m wall | A = 8 m | X = 7 m | 2 levels | print-ready overview

LOAD APPLICATION - SIDE ELEVATION

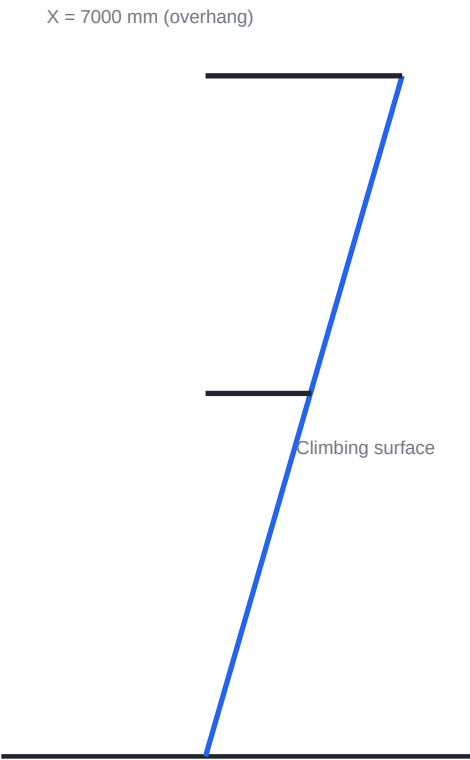

ACS GEOMETRY AND COLUMN LOADS

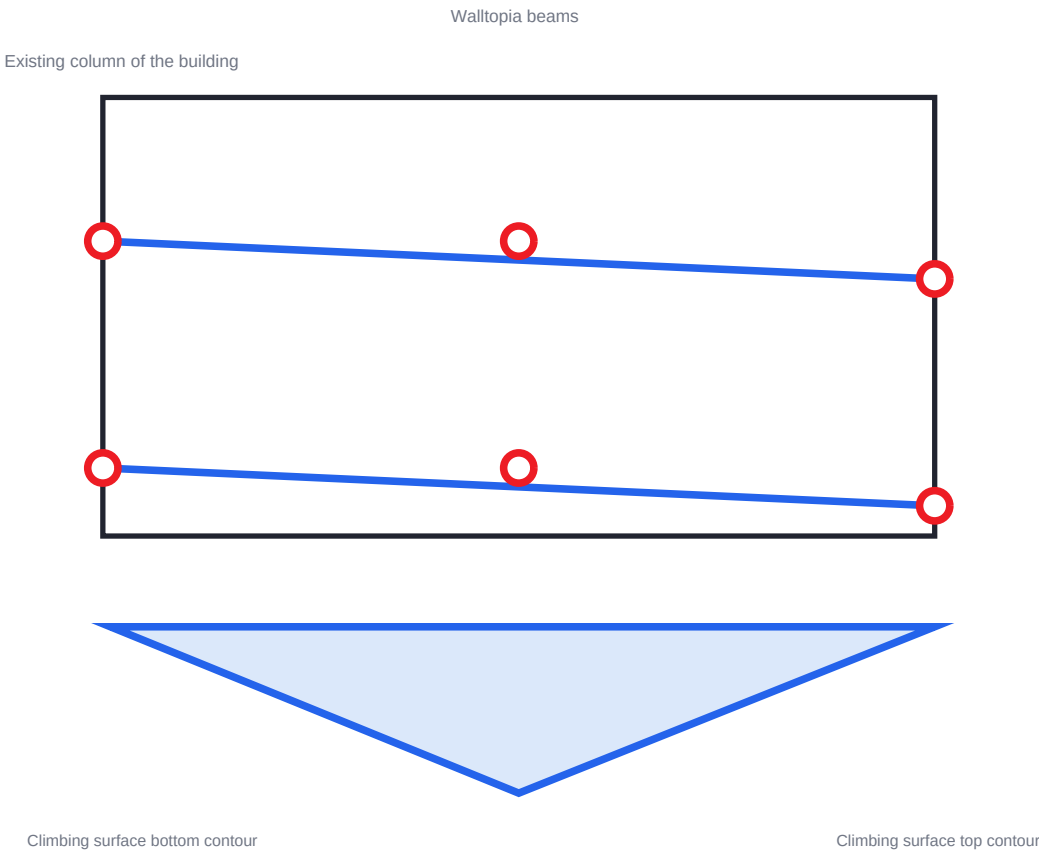

SELECTED ATTACHMENT DETAILS

CF-01

Base connection

Supporting slab: solid concrete slab

CW-02

Attachment levels

Method: solid concrete column