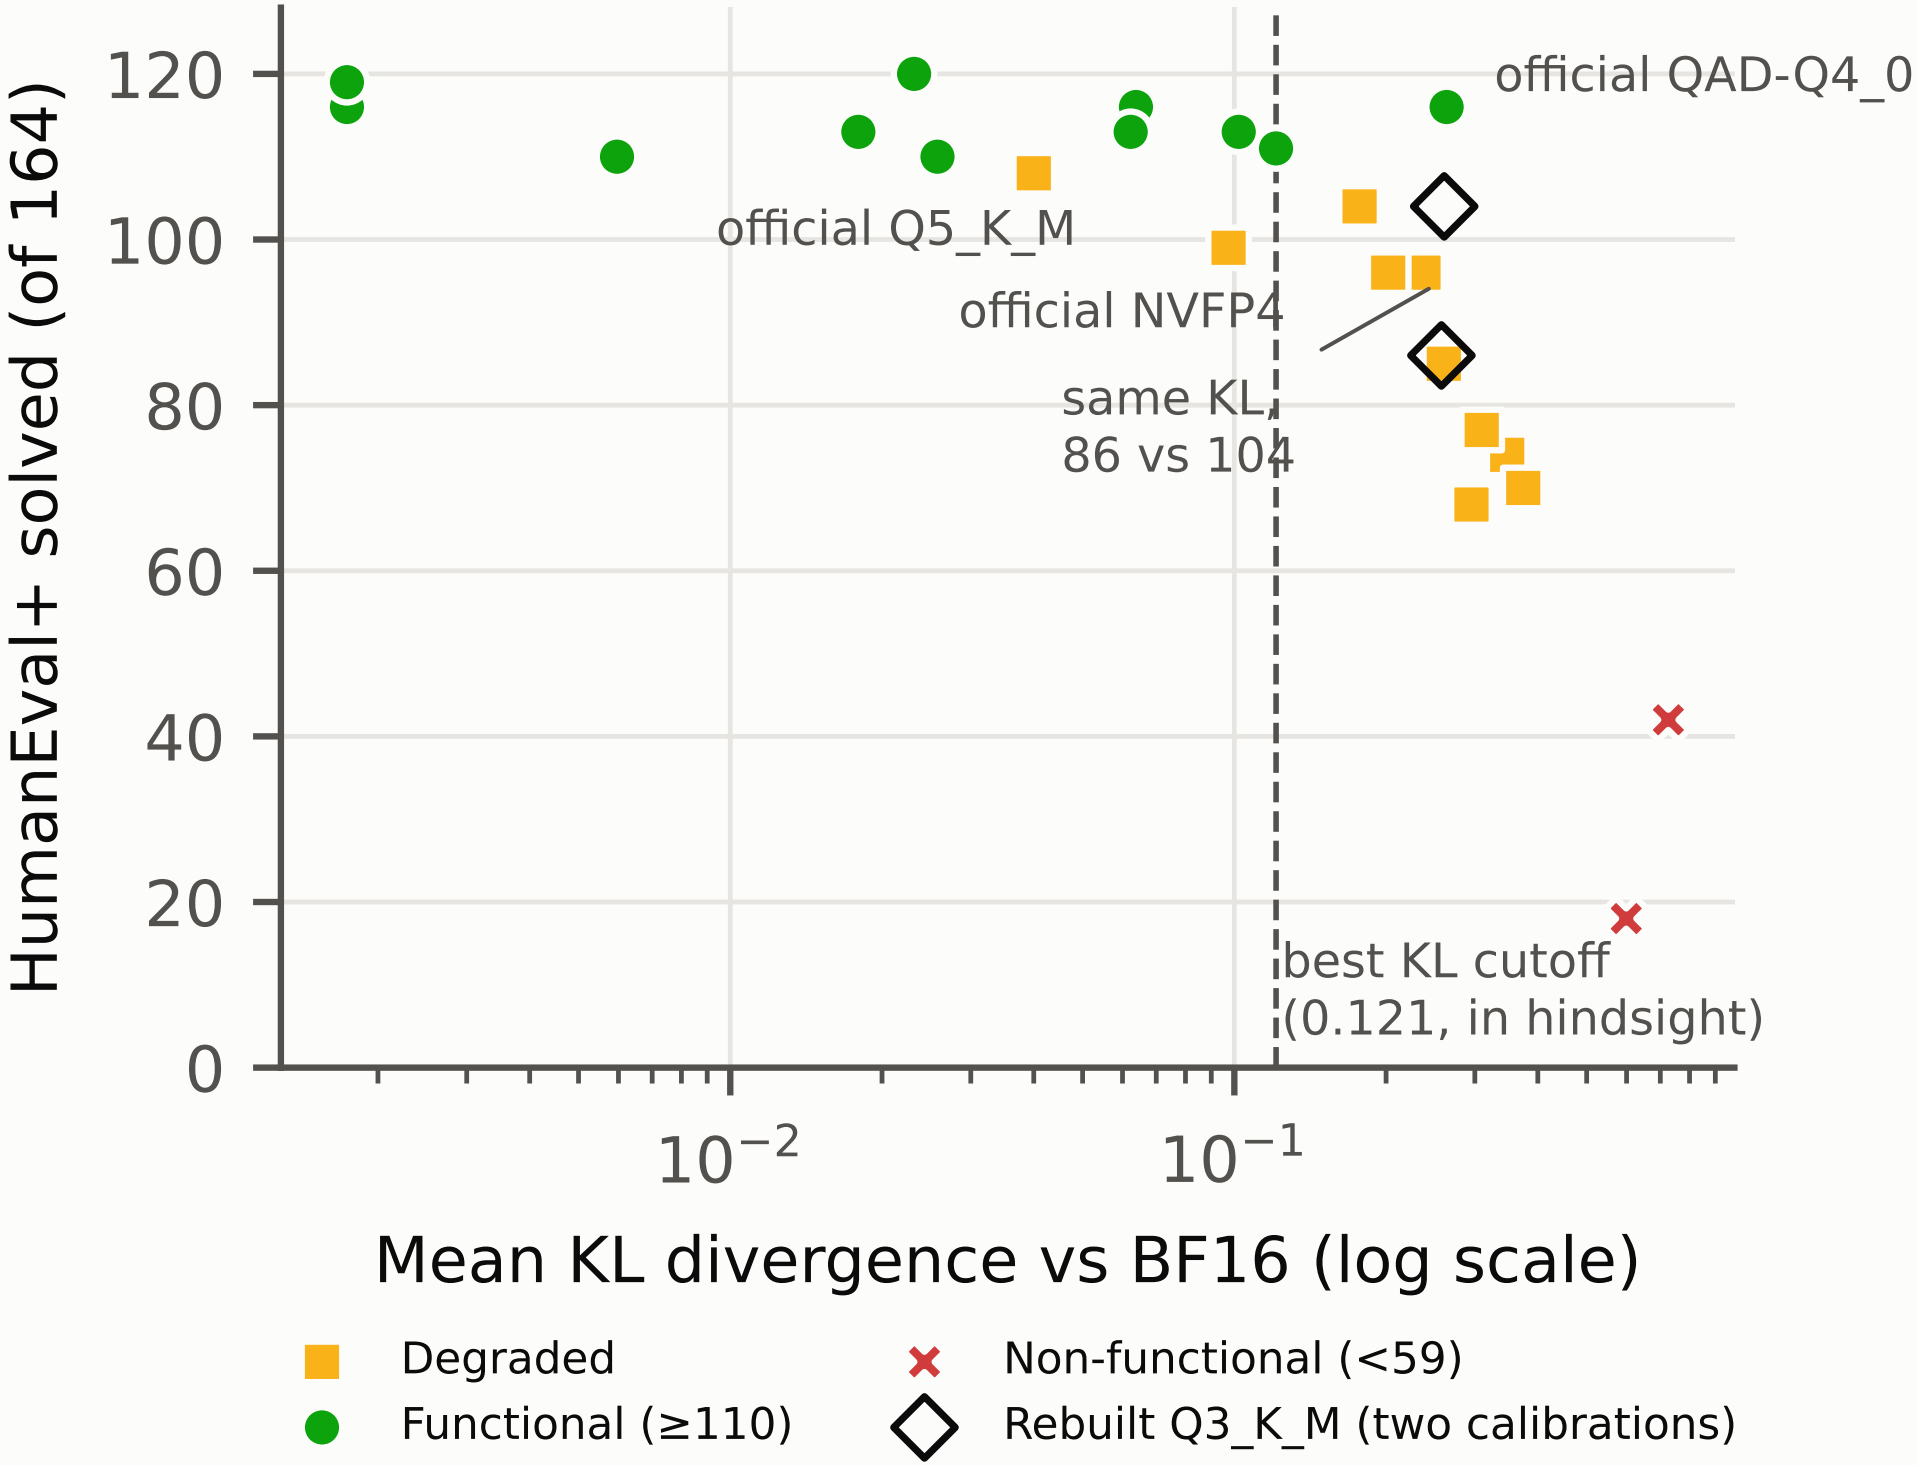
HumanEval+ solved (of 164)
120
100
80
60
40
20
0
official QAD-Q4_0
official Q5_K_M
official NVFP4
same KL,
86 vs 104
best KL cutoff
(0.121, in hindsight)
10^{-2}
10^{-1}
Mean KL divergence vs BF16 (log scale)
Degraded
Functional (≥110)
Non-functional (<59)
Rebuilt Q3_K_M (two calibrations)