

Trench Length

Port - 1

Port - 2



Port - 4

Port - 3

Port - 5

Port - 6

Port - 7

Survey Format : G	<div>OLT</div> OLT	<div></div> Bsnl Exchange	<div>Prepared For</div> <div></div> <div>POWER GRID CORPORATION OF INDIA LIMITED (A Government of India Enterprise)</div> <div>IRIS INFRA SERVICES PRIVATED LTD.</div> <div>Plot No. :30, HIG-A, Dr. A S Rao Nagar, Hyderabad - 62</div>
No. of OLT's : 1 (Sri ramnagar Bsnl Exchange)	<div></div> Tower	<div></div> Gram Panchayat	
No. of Splitters : 10	<div></div> Tapping Point	<div></div> Existing OFC	
Total Length of Existing OFC : 0 m	<div></div> Bsnl Chamber	<div></div> Incremental OFC	
Total Length of Incremental OFC : 86148 m			
No. of Gram Panchayat : 31			

Page 7 of 501

Cable Length

Port - 1

Port - 2

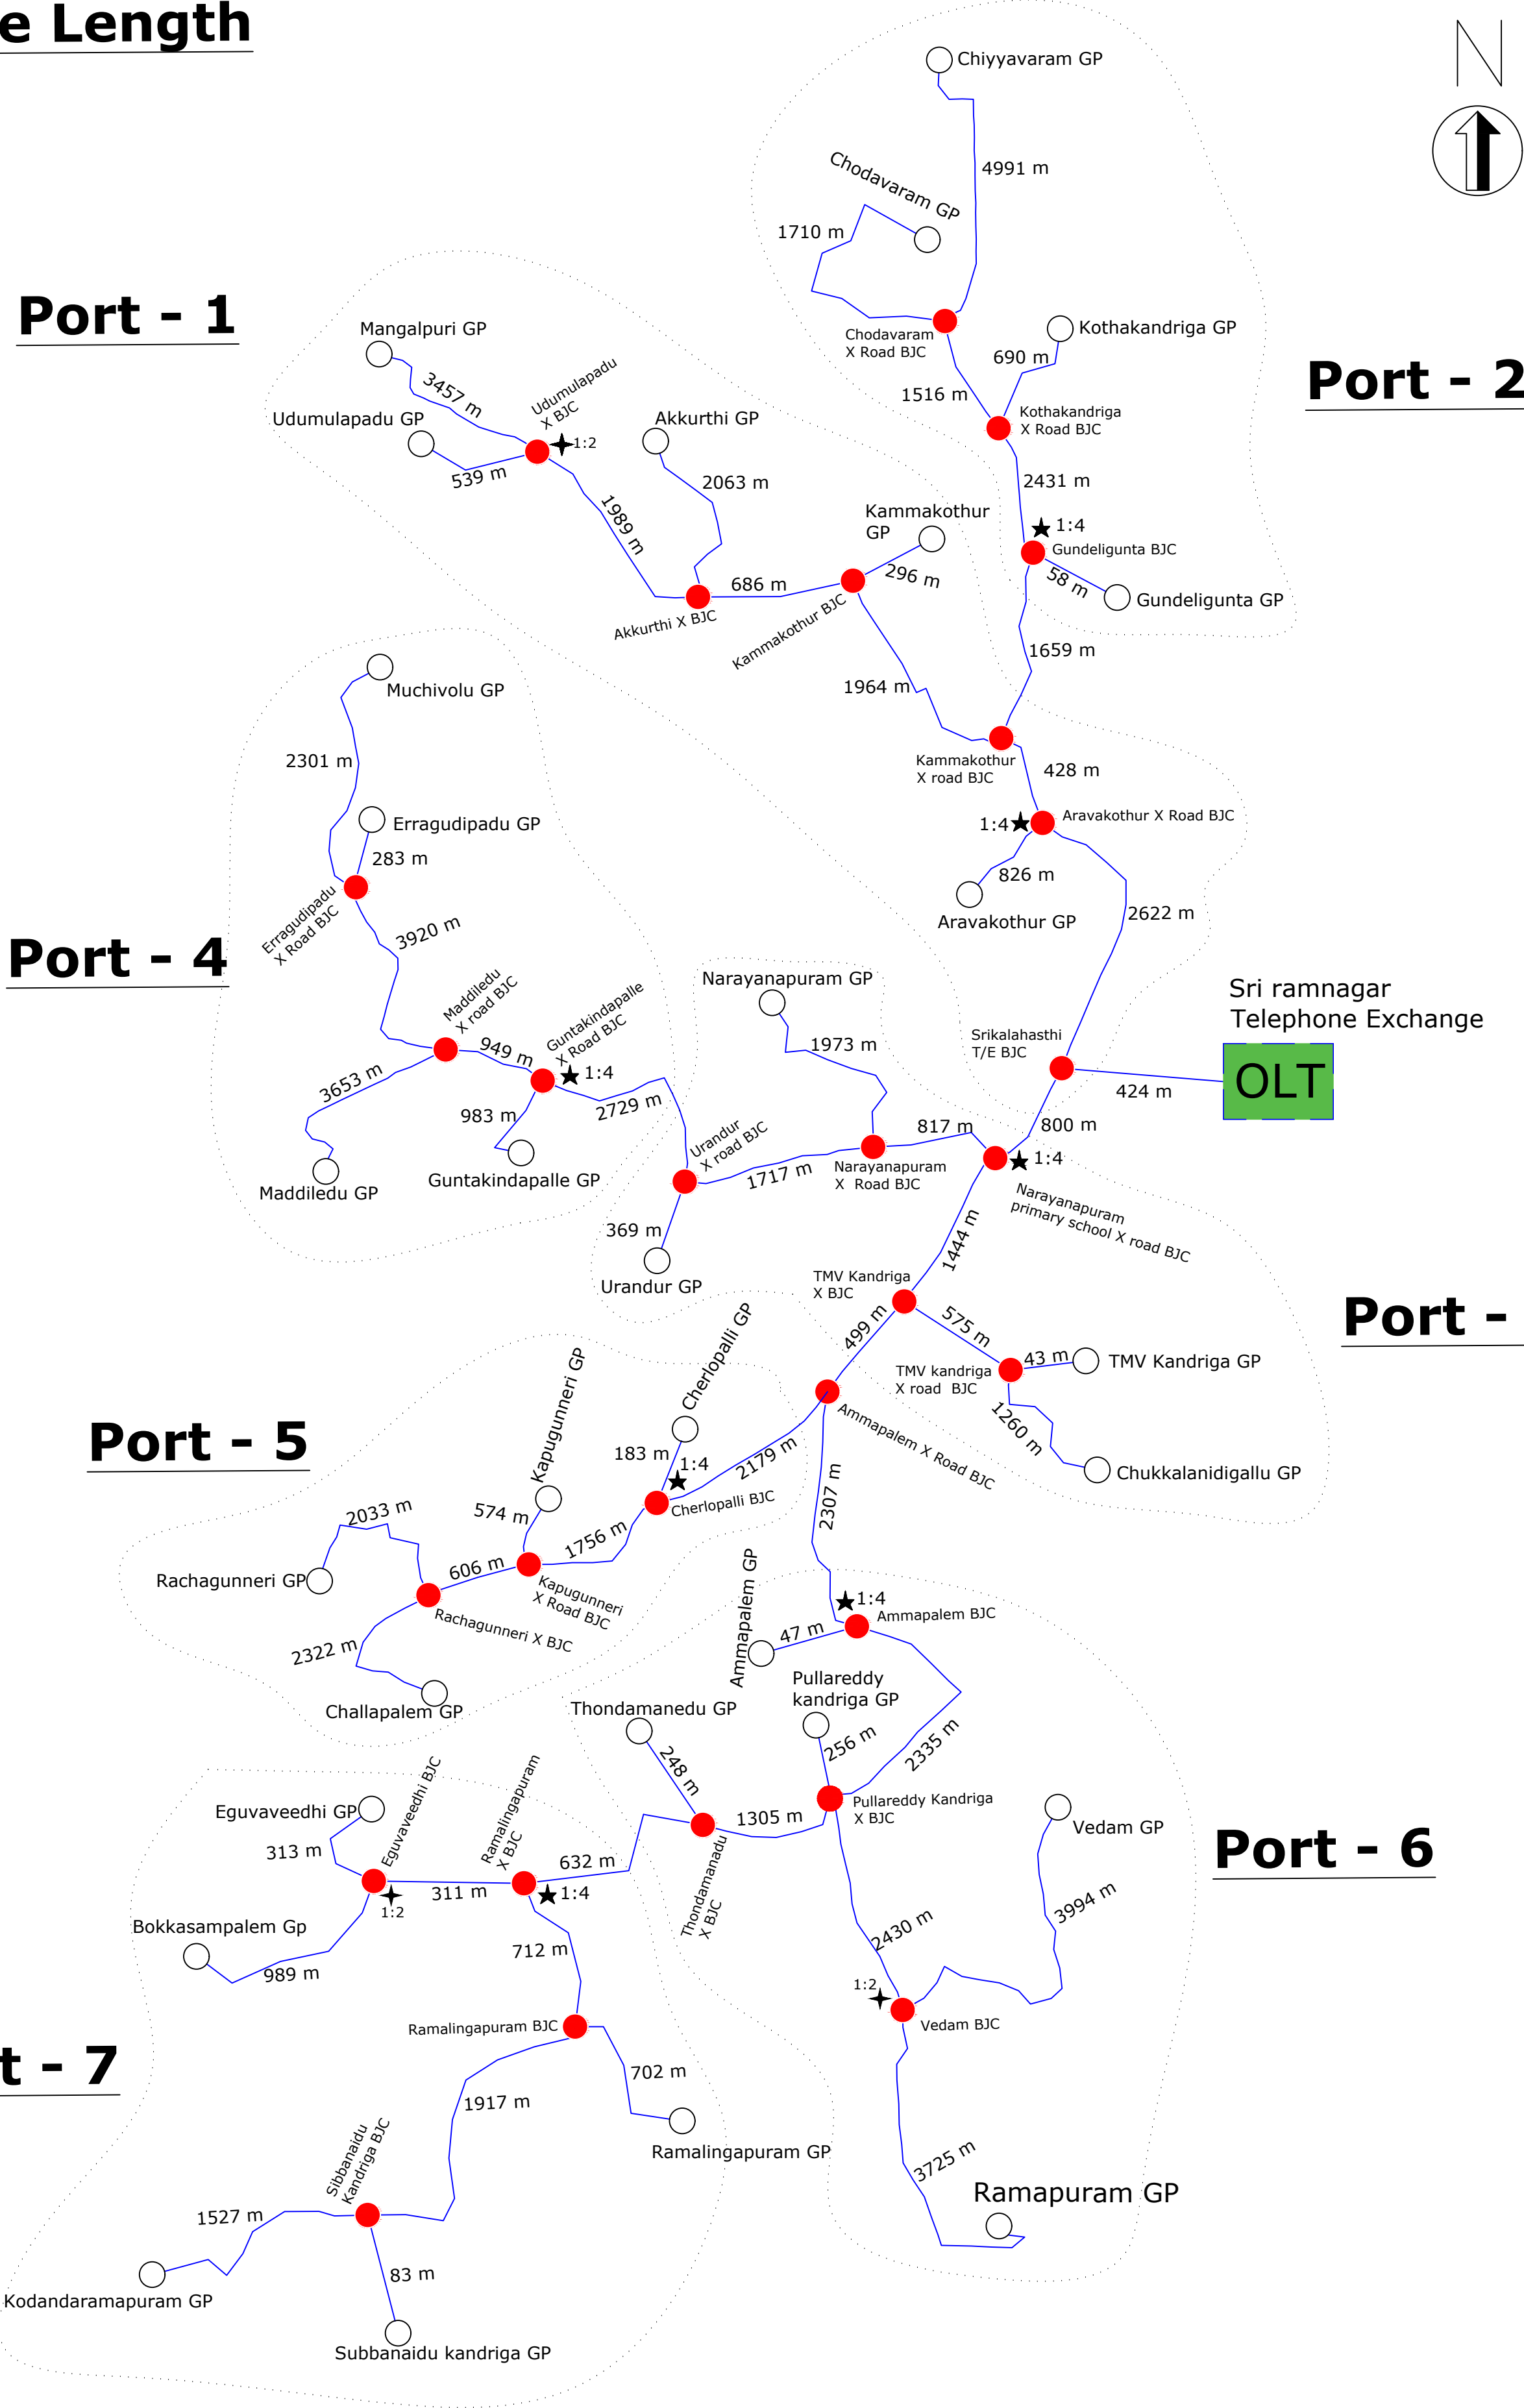
Port - 4



Port - 3

Port - 5

Port - 6

Port - 7



Survey Format : G	<div>OLT</div> OLT	<div></div> Bsnl Exchange	<div>Prepared For<div></div>POWER GRID CORPORATION OF INDIA LIMITED (A Government of India Enterprise)</div> <div>IRIS INFRA SERVICES PRIVATED LTD. Plot No. :30, HIG-A, Dr. A S Rao Nagar, Hyderabad - 62</div>	
No. of OLT's : 1 (Sri ramnagar Bsnl Exchange)	<div>Tower</div>	<div></div> Gram Panchayat		
No. of Splitters : 10	<div><div></div>Tapping Point</div>	<div><div></div>Existing OFC</div>		
Total Length of Existing OFC : 0 m				
Total Length of Incremental OFC : 86148 m	<div><div></div>Bsnl Chamber</div>	<div><div></div>Incremental OFC</div>		
No. of Gram Panchayat : 31	Page 8 of 501			