

中国能建沙特凯西姆 II 燃机联营体项目部
CEEC EPC JV of QASSIM 2 PROJECT-KSA
一般费用报销单 General Expense Claim Form

部门Dept.: 采购管理部

日期Date: 2026 年Year 6 月Month 28 日Day

单位Currency: 人民币CNY ☐ 美元USD ☐ 里亚尔SAR ☒ 其他Others ☐

费用项目Expense Item	发票张数 No. of Invoices	不含税金额 Amount Excluding Tax	费用项目Expense Item	发票张数 No. of Invoices	不含税金额 Amount Excluding Tax
办公费Office Expenses			水电气费Water and Electricity Fee		
通讯费Communication Fee			物业及后勤服务费 Property and Logistics Services		
网络费Network Fee			食堂经费Canteen Expenses		
签证费Visa Fee			其他职工福利费welfare Expenses		
会议费Conference Fee			业务招待费Business Reception Fee		
办证费Certificate Fee			修理费Repair Cost		
租赁费Rental Fee			零星材料Sporadic Materials		
交通费Transportation Expenses			检验试验费Inspection and Test Fee	1	6,000.00
车辆使用费 Vehicle Usage Fee			其他Others		
增值税VAT			6,900.00		
支付方式 Mode of payment			电汇		
合计(小写) Total in Figure			6,900.00		
合计(大写) Total in Words			沙特里亚尔 陆仟玖佰元整		
经办人 Applicant			张楠 2026.6.21		
部门负责人 Dept. Manager			李玲 2026.6.21		
分管业务领导 Deputy Project Director			张建涛		
财务审核 Financial approval			易阳		
财务负责人 Finance Manager					
分管领导 Deputy Project Director(Financial)					
项目经理 Project Director					
结算支付 Cashier					

中国能建沙特凯西姆 II 燃机联营体项目部
CEEC EPC JV OF QASSIM 2 PROJECT-KSA
一般费用报销单General Expense Claim Form

部门
Dept.:

日期Date: 2026 年Year 6 月Month 28 日Day

单位Currency: 人民币CNY☐美元USD☐里亚尔SAR☒其他Others☐

序号	费用名称	发票张数	日期	含税金额	不含税金额	汇率	本位币金额
1	Technical support for 380KV cables at Qassim 2 site issue report Date from 28 Dec To 29 Dec,2025	1	2/16/2026	6900	6000.00		
合计				6900	6000.00		

وإلى

RIYADH CABLES CO.

شركة كابلات الرياض (شركة مساهمة مغلقة)

PAID CAPITAL S.R. 10.00 MILLION - C.R. 146019 - M'SHIP NO.: 84044

QUOTATION # HV5-G001

To: **CHINA ENERGY INTERNATIONAL GROUP COMPANY LIMITED.** -Saudi Arabia

Attn. Mr. ZHAO NAN - Procurement Department

Project: THE QASSIM 2 1980MW CCGT
INDEPENDENT POWER PROJECT-KSA

Subject: Offer for Inspection on 380kV Cables

Ref: Your email dated 23/12/2025

Dear Sir,

Please find below our price for the inspection on your 380kV Cables:

Site visit for technical support: 6000 SAR (Max 2 days)

With VAT +15%: 6900 SAR

Inspection time:

On 28 & 29/12/2025

Payment: 100% after work is done by bank transfer.


Best Regards

Ibrahim Hanoun

DGM Projects

RIYADH CABLES CO.

31/12/2025



(Closed Joint Stock Co.)

HV department

إدارة مشاريع الضغط العالي

P.O. BOX: 26862 – RIYADH: 11496

⑤ 銀行賬號

Company: ARAB NATIONAL BANK CORPORATE BRANCH

Bank: ARAB NATIONAL BANK CORPORATE BRANCH

IBAN Account No: SA27 30400107000020850014

RIYADH CABLES CO.

شركة كابلات الرياض (شركة مساهمة مغلقة)

PAID CAPITAL S.R. 10.00 MILLION - C.R. 146019 - M'SHIP NO.: 84044

Dear Sir,

With reference to the above subject, we hereby submit the **380 kV XLPE Cable Inspection Report (Post Water-Logging Event)** for your review and approval.

As reported earlier, certain sections of the installed 380 kV cable route were subjected to temporary water logging due to site conditions. In order to ensure the integrity and compliance of the cable system, a detailed inspection and testing were carried out in accordance with **SEC Technical Specifications, IEC 62067**, and the cable manufacturer's recommendations.

The scope of inspection included:

- Visual inspection of the cable outer sheath and trench condition
- Verification of cable end sealing and moisture ingress
- Metallic sheath integrity (oversheath) testing

The inspection and test results confirm that the cable system remains **mechanically and electrically sound**, with all measured values found to be **within SEC acceptable limits**. Based on these results, the affected cable sections are considered **fit for continuation of installation, termination, and subsequent pre-commissioning activities**.

The detailed inspection report is attached herewith for your kind review and approval. We kindly request your confirmation to proceed with the next stages of work.

Should you require any further information or clarification, please do not hesitate to contact us.

Thank you for your continued support.

Yours faithfully,


Riyadh Cables Co

Name: Inam Ul Haq

Designation: Cable Supervisor

Contact No.: 0506423268

Email: inamulhaq.niazi@riyadh-cables.com

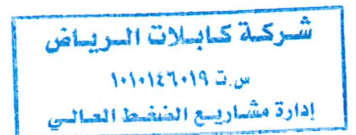

RIYADH CABLES CO.

شركة كابلات الرياض (شركة مساهمة مغلقة)

PAID CAPITAL S.R. 10.00 MILLION - C.R. 146019 - M'SHIP NO.: 84044

1. General Information

Project Name: CCGT Independent Power Project

SEC Project No.: Qassim 2

Substation / Location: Qassim 2

Contractor: CEEC EPC JV OF QASSIM 2 PROJECT - KSA

Consultant:

Client:

Cable Voltage Level: 380 kV

Cable Type: XLPE, Copper Conductor

Cable Size: 2500mm²

Circuit Identification:

Inspection Date: 31/12/2025

2. Reference Standards

SEC Technical Specification for 380 kV XLPE Cable Systems

IEC 62067 – Power Cables with Extruded Insulation (≥ 150 kV)

IEC 60229 – Tests on cable over sheaths

Manufacturer's Installation & Testing Guidelines

3. Description of Water-Logging Incident

Cause: ☒ Heavy rainfall ☐ Drainage blockage ☐ Other: _____

Cable Condition at Time of Event:


☒ Laid in trench (not terminated)

☒ Installed with temporary end caps

☐ On cable drum

4. Inspection Scope

The inspection was carried out to verify the mechanical and electrical integrity of the 380 kV cable system after exposure to water logging and to confirm compliance with SEC and IEC requirements prior to continuation of works.

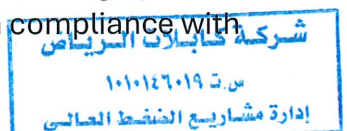

Am

RIYADH CABLES CO.

شركة كابلات الرياض (شركة مساهمة مغلقة)

PAID CAPITAL S.R. 10.00 MILLION - C.R. 146019 - M'SHIP NO.: 84044

5. Inspection and Test Details

5.1 Visual Inspection

- Outer sheath inspected along accessible length
- No visible damage such as cuts, cracks, swelling, or deformation observed
- Trench condition checked for debris, sharp objects, and stagnant water
- Cable ends verified for proper sealing

Result: ☒ **Satisfactory** ☐ Remarks noted below

5.2 Cable End Sealing & Moisture Check

End caps found intact and properly sealed

No evidence of moisture, condensation, or water ingress inside cable core

Silica gel (if provided) found in acceptable condition

Result: ☒ **Acceptable** ☐ Not acceptable (details in remarks)

5.3 Metallic Sheath Integrity Test (Oversheath Test)

Test Method: DC Voltage Test

Applied Voltage: 10 kV DC

Duration: 1 minute

Standard: IEC 60229 / IEC 60840


Acceptance Criteria:

- No breakdown, no sudden increase in leakage current

Result: ☒ **Pass** ☐ Fail

6. Findings

- No mechanical damage observed on cable outer sheath
- Cable end sealing remained effective during water-logging period
- Insulation resistance values are stable and within SEC acceptable limits
- Metallic sheath integrity confirmed by DC sheath test

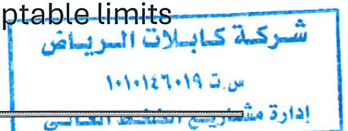

Am

RIYADH CABLES CO.

شركة كابلات الرياض (شركة مساهمة مقفلة)

PAID CAPITAL S.R. 10.00 MILLION - C.R. 146019 - M'SHIP NO.: 84044

7. Corrective and Preventive Measures

- Cable trenches fully dewatered prior to inspection
- Temporary end caps verified and re-secured where necessary
- Improved drainage arrangements implemented to prevent recurrence

8. Conclusion

Based on the inspection and test results, the affected 380 kV XLPE cable section is assessed to be:

- ☒ **Compliant with SEC and IEC requirements**
- ☒ **Suitable for continuation of installation and termination works**
- ☒ **Suitable for pre-commissioning and energization**

9. Recommendations

- Maintain effective sealing of cable ends until final termination
- Avoid prolonged exposure of installed cables to standing water
- Repeat pre-commissioning tests prior to energization as per SEC requirements

10. Signatures :

Name	Designation	Company	Signature	Date
Inam Ul Haq	Site Supervisor	Riyadh Cable Co	 5/1/2026	

شركة كابلات الرياض
س.ت ١٠١٤٦٠١٩
إدارة مشاريع الضغط العالي

