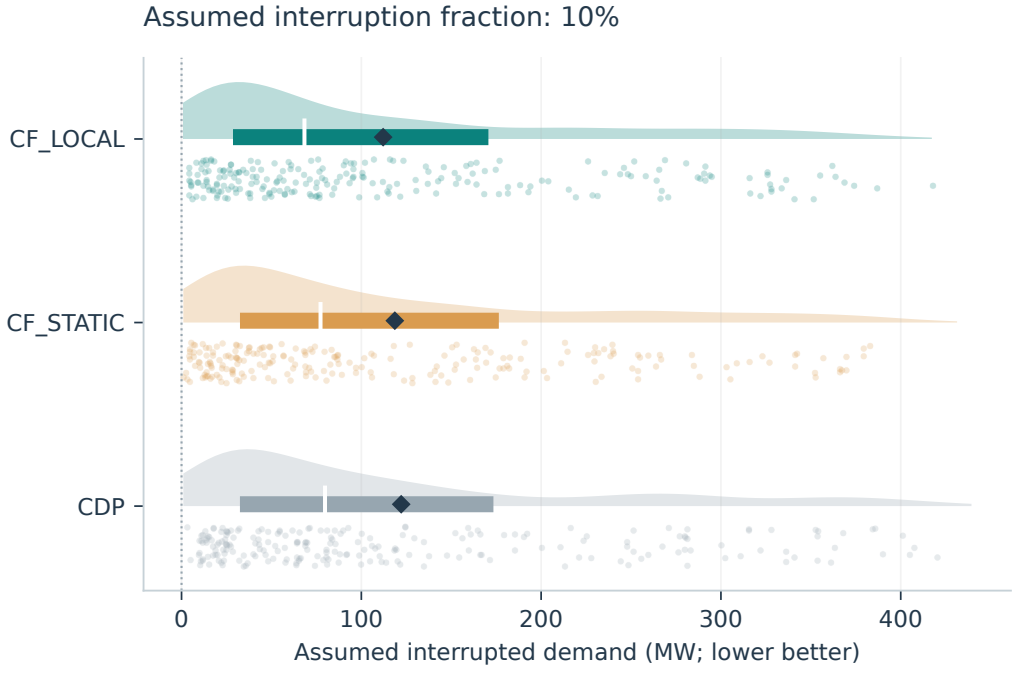
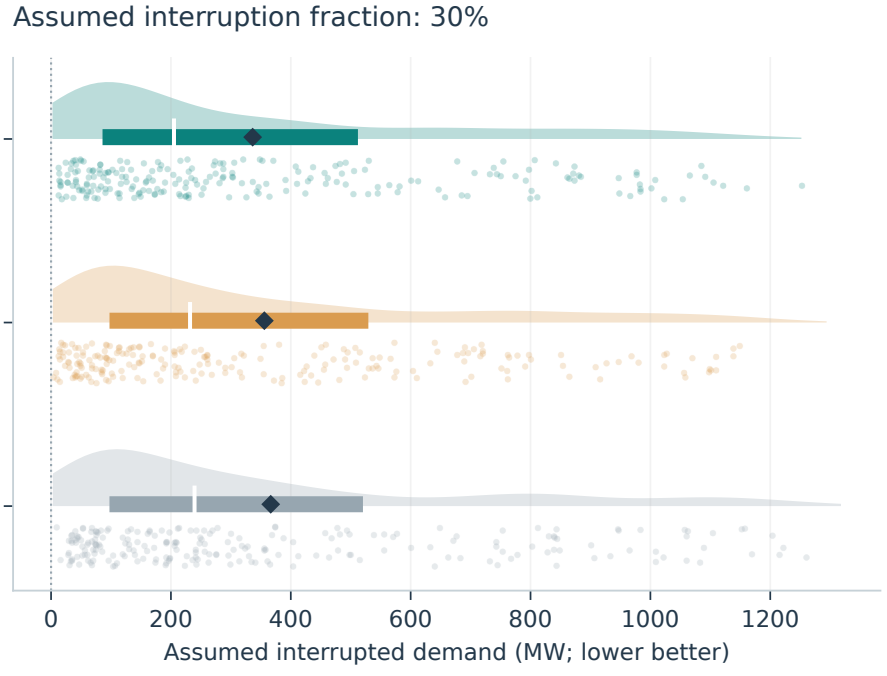

Assumed interruption fraction: 10%
CF_LOCAL
CF_STATIC
CDP
0
100
200
300
400
Assumed interrupted demand (MW; lower better)

(a)


Assumed interruption fraction: 30%
0
200
400
600
800
1000
1200
Assumed interrupted demand (MW; lower better)

(b)