The supplemental materials for paper: A Bio-Inspired Energy Cell Framework for Developing Flexible and Resilient Urban Energy Systems

I. A Comprehensive Comparison Among the EC And Related Concepts.

Table S1. The comparison between the proposed EC framework and exiting architecture.

Architecture	Basic Unit	Covered Sectors	Boundary Characteristic	Operational Mode	Typical Application Scenario
Energy Hub	Energy-coupling devices	Multi-energy system	Single-site, without an explicit inter-unit boundary	Device-level dispatch	Optimal multi-energy dispatch at a single site
Microgrid	Local grid	Mainly power system	Relatively fixed, usually defined by physical connection or islanding capability	Islanded/grid-connected operation	Local energy autonomy and islanded operation
Cellular Grid	Grid cell	Power system	Fixed, partitioned by operational boundaries	Distributed coordination	Voltage and frequency control
Urban Cell	Functionalized urban block	Energy-society system	Fixed, partitioned by urban blocks	Planning-oriented	Urban planning and design
Proposed EC framework	Energy cell	Multi-energy system	Flexible, with dynamic aggregation into EC clusters	Hierarchical coordination across EC-cluster-UES	Economic operation, flexibility utilization, and resilience enhancement

As shown in Table S1, the proposed EC framework differs from several closely related architectures. Compared with the Energy Hub, which mainly focuses on the optimal dispatch of energy-coupling devices at a single site, the EC is not limited to device-level energy conversion, but serves as a distributed multi-energy functional unit embedded in a broader system architecture. Compared with the Microgrid, which mainly emphasizes local autonomy and islanded/grid-connected operation within a relatively fixed boundary, the EC further highlights local multi-energy self-balancing, flexible boundary interaction, and dynamic aggregation with neighboring cells. Compared with the Cellular Grid, which is primarily oriented to distributed coordination in the power sector, the proposed EC extends the cell-based idea to a more general urban multi-energy system context. Compared with the Urban Cell, which is mainly planning- and design-oriented at the spatial scale, the EC framework places stronger emphasis on operational coordination, flexibility utilization, and resilience enhancement.

II. Biological Term Explanations

A. A detailed explanation of Fig.1

In Fig.1, at the component level, representative biological organelles are mapped to key energy-system components: the nucleus corresponds to the energy management center, the vacuole to energy storage, the chloroplast to energy generation, and the mitochondrion to energy utilization. This level emphasizes the functional correspondence between the internal constitution of a biological cell and that of an EC. Specifically,

- Cell chloroplast and EC generation-type units: The compatibility between cell chloroplast and generation-type units in EC is not merely that both are related to energy production, but that both serve as the interface through which external energy is captured and converted into a usable internal energy form. In biological cells, the chloroplast transforms environmental energy into usable biochemical energy; similarly, generation-type units in the EC, especially renewable generation units, convert external primary energy into usable energy.

- Cell vacuole and EC storage-type units: Both cell vacuole and EC storage-type unit have role of buffering, temporary storage, and internal regulation. A vacuole is an internal regulator that helps maintain the stability of the cell. Likewise, storage-type units in the EC are buffering components that shift energy across time, absorb fluctuations, and support local self-balancing.
- Cell mitochondrion and EC consumption-type units: This analogy can be understood from the perspective of functional endpoint of energy utilization. The mitochondrion is where energy substrates (such as the glucose) are processed into ATPs to sustain the activity of the cell; similarly, consumption-type units and local loads in the EC represent the part of the system where energy is ultimately utilized to maintain local services and functions.

At the functional level, the analogy is further extended from component correspondence to system-operating principles.

- The hierarchical organization from cell to organ/tissue to organism-level system is used to motivate the EC-cluster-UES layered structure, highlighting modular aggregation from local units to the whole system.
- The signal interaction among biological cells, such as bioelectrical and synaptic communication, is used to inspire inter-EC information exchange, which may be realized through discrete pulse-like communication rather than continuous global broadcasting.
- The biological regulation and immune-response mechanisms activated under virus invasion or abnormal cells, involving hormones, T-cells, B-cells, are used to analogize the cooperative suppression of uncertainty and disturbances in the EC framework, where neighboring ECs can provide coordinated support through storage and other flexible resources.
- The adaptive metabolic switching of cells under low-oxygen conditions, where ATP production shifts from the mitochondrion-dominated aerobic pathway to glycolysis, is used to analogize adaptive energy substitution in ECs, such as the transition from photovoltaic generation to energy-storage discharge under low solar-radiation conditions.

B. Quick reference index for biological terms & engineering mechanisms.

Table S2. Quick reference index for biological terms & engineering mechanisms.

Biological Item	Biological Meaning	Engineering Mechanism	Functional Similarity
Organismic Cell	The basic functional unit of a living organism, capable of maintaining essential functions through internal regulation	Energy Cell, as the fundamental structural and functional unit of UES, integrating distributed generation, loads, storage, and flexible resources	Both are basic functional units that sustain local operation while contributing to the whole system
Cell Division	The formation of multiple cells from a stem cell	Partitioning the UES into multiple initial ECs based on multi-energy balance and resource allocation	Both create manageable local units from a larger system to support organized operation
Cell Differentiation	Cells specialize into different types according to their roles and characteristics	Functional specialization of ECs according to physical roles, resource endowment, and energy characteristics	Both enable heterogeneous units to perform designated functions within a coordinated system
Cell Nucleus	The control center that regulates cellular behavior and decision-making	Control layer of EC for local energy management and decision-making based on sensed states and interaction signals	Both serve as the decision core of the local unit
Cell Cytoplasm	The internal medium containing functional components that support cellular activity	Physical layer of EC, including energy devices, storage, and aggregated energy facilities	Both contain the physical components that realize the unit's actual functions
Cell Membrane	The interface that separates the cell from its environment and regulates exchanges	Interface layer of EC, supporting standardized information exchange and boundary interaction with neighboring ECs or upper-level operators	Both define boundaries and regulate interaction with the outside environment

Cell-Tissue-System	Multi-level biological organization from local units to larger coordinated structures	EC-cluster-UES hierarchy from local ECs to EC clusters and the whole urban energy system	Both represent hierarchical organization from basic units to system-level coordination
Hormone Regulation	Biological regulation through signaling substances that guide responses across scales	Hierarchical coordination signals used to guide EC scheduling and cross-layer adjustment	Both provide regulation to guide the function adjustment
Reference Hormones	Guidance signals under normal conditions for coordinated regulation	Day-ahead or medium-term reference signals sent from upper levels to guide EC scheduling plans	Both guide local behavior toward a broader coordinated objective under normal conditions
Emergency Hormones	Urgent biological signals released when abnormal conditions are detected	Emergency requests or imbalance signals sent from ECs to neighbors or clusters when local balancing is insufficient	Both trigger additional support only when local regulation is no longer enough
Cell chloroplast	Organelles responsible for energy production	Generation-type flexible resources within EC	Both are associated with energy production capability
Cell Vacuole	Organelles used for storage and regulation of materials	Storage-type flexible resources within EC	Both provide storage and buffering capability for local regulation
Cell Mitochondrion	Organelles responsible for energy consumption and metabolic conversion	Consumption-type flexible demand within EC	Both are associated with energy use and conversion for sustaining local function
Stress Reactivity	Short-term ability to respond and recover from sudden disruptions	Short-term flexibility response capability of resources/ECs/clusters	Both describe fast response to immediate disturbances
Defensive Capability	Mid-term ability to resist risks and take preventive measures	Mid-term capability of ECs/clusters to resist foreseeable operational risks	Both reflect protective capacity against anticipated threats
Immunization	Long-term adaptability and resistance to repeated or evolving threats	Long-term sustainability and adaptability of flexibility planning against future operational changes	Both emphasize enduring protection and adaptation over long horizons
Viral Invasion	External attack that disturbs normal cellular function	Extreme disturbances such as natural disasters	Both represent external disturbance threatening normal system function
Autophagy	Controlled self-reduction of internal activity to maintain survival under stress	Proactive shedding of non-critical loads	Both sacrifice part of local function to preserve the survival of the larger unit
Apoptosis	Programmed removal of damaged cells to protect the organism	Proactive disconnection of an EC from neighboring ECs to isolate fault propagation	Both isolate damaged parts to prevent wider system harm
Paracrine Signaling	Local signaling among nearby cells to coordinate neighboring responses	Parallel coordinated signaling among neighboring EC clusters during post-disaster recovery	Both enable local cooperative recovery through nearby interaction
Synaptic Pulses	Discrete signals transmitted only when bioelectrical thresholds are reached	Event-triggered, encoded discrete communication among ECs under limited bandwidth conditions	Both reduce communication burden by transmitting only significant state changes

III. Modeling Details

A. Guidance on general modeling template of EC-clusters-USE hierarchy

1) What is optimized at each layer:

At the UES layer, the objective is to determine the system-level coordination target for the whole UES, such as the overall operating cost, global energy-accessibility objective, or other system-wide performance indicators. This layer does not optimize detailed local device schedules; instead, it coordinates cluster-level targets from a global perspective. A minimal formulation can be written as:

$$\min_{y_c,z} \sum_{c\in\mathcal{C}} F_c\left(y_c\right) + G\left(z\right)$$
$$\text{s.t.} \begin{cases} \mathcal{A}_c\left(z, y_c\right) = 0, \forall c \in \mathcal{C} \\ \mathcal{B}_c\left(z, y_c\right) \le 0, \forall c \in \mathcal{C} \end{cases} \tag{1}$$

where, y_c denotes the coordination target assigned to cluster c and z is the global decision or coordination variables, $F_c\left(\cdot\right)$ represents the cluster-level operating metrics of cluster c, and $G\left(\cdot\right)$ captures the system-level objective, $\mathcal{A}_c$ and $\mathcal{B}_c$ are the aggregated feasible region coefficients reported by cluster c, $\mathcal{C}$ is the clusters set.

At the EC-cluster layer, the objective is to translate the upper-layer cluster target into regional coordination references for ECs in this cluster. In other words, this layer determines how the cluster-level target should be allocated among neighboring ECs in a coordinated and implementable manner. A minimal formulation can be written as:

$$\min_{r_i,e_c} \sum_{i\in\mathcal{E}_c} f_i\left(r_i\right) + h_i\left(e_i\right)$$
$$\text{s.t.} \begin{cases} B_c\left(r_i, e_i\right) = y_c \\ \mathcal{M}_i\left(r_i, e_i\right) = 0, \forall i \in \mathcal{E}_c \\ \mathcal{N}_i\left(r_i, e_i\right) \le 0, \forall i \in \mathcal{E}_c \end{cases} \tag{2}$$

where e_i is the coordination instruction for each EC, r_i is the reference signal for EC i, $f_i\left(\cdot\right)$ is the local EC-level operating metrics, $h_i\left(\cdot\right)$ is the coordination discipline. $B_c\left(\cdot\right)$ maps the EC reference signal and coordinated decisions to the cluster-level decision y_c, $\mathcal{M}_i$ and $\mathcal{N}_i$ are the aggregated feasible region coefficients reported by the i-th EC.

At the EC layer, each EC optimizes its local multi-energy scheduling decisions, including local generation, storage, conversion devices, and controllable demand response, subject to local physical and operational constraints. A minimal formulation can be written as:

$$\min_{x_i} f_i\left(x_i\right)$$
$$\text{s.t.} \begin{cases} D_i(r_i, e_i) = x_i \\ g_i(x_i) = 0 \\ q_i(x_i) \le 0 \end{cases} \tag{3}$$

where x_i denotes the local dispatch decision of i-th EC, and feasible operating region is consisted of local equality constraints $g_i\left(\cdot\right)$ and inequality constraints $q_i\left(\cdot\right)$, $D_i\left(\cdot\right)$ maps the EC local dispatch into the reference signal obtained from upper cluster.

Therefore, the hierarchy can be understood as follows: the UES layer determines the global coordination target, the cluster layer allocates this target into regional coordination references, and the EC layer computes physically implementable local schedules.

2) What variables are exchanged across layers

From the UES layer to the EC-cluster layer, the exchanged variables are the cluster-level coordination targets y_c, which specify the desired aggregate operating or exchange pattern of each cluster from the system-level perspective.

From the EC-cluster layer to the EC layer, the exchanged variables are the EC-level coordination references r_i. These references indicate how each EC is expected to contribute to the cluster-level target, for example the target boundary exchanges, balancing references, flexibility expectations, or other coordination-oriented signals.

From the EC layer back to the EC-cluster layer and the EC-cluster layer back to UES-layer, the exchanged information is the aggregated feasible region. This information represents the feasible support capability or operational boundary that each EC/cluster can provide after considering its internal physical constraints.

3) How local and inter-layer feasibility are maintained:

In a single EC, its local feasibility is guaranteed through the constraints $g_i(x_i) = 0$ and $q_i(x_i) \le 0$ in (3). These constraints ensure that each EC schedules its local resources within a physically meaningful and operationally admissible region, including multi-energy balance requirements, device limits, conversion relationships, and local network restrictions.

The inter-layer feasibility between EC-layer and cluster-lay is guaranteed by $\mathcal{M}_i\left(r_i, e_i\right) = 0$ and $\mathcal{N}_i\left(r_i, e_i\right) \le 0$ in (2), which ensure that the reference signal and coordination instruction of each EC are endogenously determined by its

local feasible dispatch, rather than being arbitrarily assigned by the cluster. Therefore, the EC can compute a feasible local action that matches the target set by cluster, make sure the constraint $D_i(r_i, e_i) = x_i$ in (3) is always satisfied.

The inter-layer feasibility between EC-layer and cluster-lay is guaranteed by $\mathcal{A}_c(z, y_c) = 0$ and $\mathcal{B}_c(z, y_c) \le 0$ in (2). Under these feasible-region constraints, the target assigned to each cluster can be physically achieved, ensuring that $B_c(r_i, e_i) = y_c$ always holds and that the cluster-level references assigned to individual ECs are collectively consistent with the target determined by the upper UES layer. In this way, the global coordination objective is connected to lower-layer implementation through a structured aggregation mechanism.

It should be noted that, the added formalization is not intended to provide a single fully general model for all possible UES configurations, which would be difficult to achieve within the scope of a perspective article due to the large diversity of physical infrastructures, energy carriers, and operational objectives. Instead, what we provide is a generic but implementable modeling template for the proposed hierarchy. More specific models can then be developed from this template for particular application scenarios.

B. Detailed decomposition approach and solution framework

To illustrate the decomposition process more clearly, we take the EC-cluster layer as a representative example. At this layer, the coordination problem (2) previous aforementioned can be reformulated into a compact form as follows:

$$\left.\begin{array}{l} \min\limits_{r_i, e_c} \sum\limits_{i \in \mathcal{E}_c} f_i(r_i) + h_i(e_i) \\ \text{s.t.} \begin{cases} B_c(r_i, e_i) = y_c \\ \mathcal{M}_i(r_i, e_i) = 0, \forall i \in \mathcal{E}_c \\ \mathcal{N}_i(r_i, e_i) \le 0, \forall i \in \mathcal{E}_c \end{cases} \end{array}\right\} \xrightarrow[\text{Compact Form}]{\text{Linear Assumption}} \begin{cases} \min\limits_{X_i, \hat{X}_i} \sum\limits_{i \in \mathcal{E}_c} f_i(\boldsymbol{X}_i) \\ \text{s.t.} \begin{cases} \mathbb{A}_i \boldsymbol{X}_i - \mathbb{B}_i \hat{\boldsymbol{X}}_i = 0 \\ \forall i \in \mathcal{E} \end{cases} \end{cases} \tag{4}$$

where $\boldsymbol{X}_i$ is the local EC related variables, and $\hat{\boldsymbol{X}}_i$ is the auxiliary variable introduced to represent the coordinated information exchanged within the cluster and the derived variables from the constraints, $\mathbb{A}$ and $\mathbb{B}$ are the related coefficient matrices. Under this reformulation, the original cluster-level coordination problem can be decomposed into multiple local EC subproblems together with a cluster-level auxiliary-variable update. This reformulation is always feasible because the inter-layer consistency constraints $B_c(r_i, e_c) = y_c$ and $D_i(r_i, e_i) = x_i$ ensure the reference signal for each EC can be meet by local EC and this reference signal can meet the upper layer target. And the objective of the cluster layer is naturally consisted of local EC objectives, therefore the decomposition is logically.

Specifically, the decomposed subproblems for each EC can be distributed solved through an iterative procedure, which consists of four main steps (take k-th iteration as an example):

- local decision-variable update, where each EC independently solves its own subproblem for X_i

$$\boldsymbol{X}_i^{k+1} = \arg\min_{x_i^k} f_i(\boldsymbol{X}_i) + \frac{\tau_i^k(\boldsymbol{X}_i)}{2} \left\| \boldsymbol{X}_i^k - \hat{\boldsymbol{X}}_i^k + \frac{\boldsymbol{\lambda}_i^k}{\tau_i^k(\boldsymbol{X}_i)} \right\|_2^2 \tag{5}$$

- auxiliary-variable update, where the cluster-level shared variable $\hat{X}_i$ is updated to enforce coordination consistency

$$\hat{\boldsymbol{X}}_i^{k+1} = \arg\min_{\hat{x}^k} \frac{\tau_i^k(\boldsymbol{X}_i)}{2} \sum_{i \in \mathcal{E}_c} \left\| \boldsymbol{X}_i^{k+1} - \hat{\boldsymbol{X}}_i^k + \frac{\boldsymbol{\lambda}_i^k}{\tau_i^k(\boldsymbol{X}_i)} \right\|_2^2 \tag{6}$$

- dual-variable update, where the Lagrange multiplier λ_i associated with the coupling constraint is updated

$$\boldsymbol{\lambda}_i^{k+1} = \boldsymbol{\lambda}_i^k + \tau_i^k(\boldsymbol{X}_i)\left(\boldsymbol{X}_i^{k+1} - \hat{\boldsymbol{X}}_i^{k+1}\right) \tag{7}$$

- adaptive penalty update, where the penalty parameter τ_i is adaptively adjusted to improve convergence.

$$\tau_i^{k+1}(\boldsymbol{X}_i^{k+1}) = g\left(\tau_i^k(\boldsymbol{X}_i)\right) \tag{8}$$

Repeating these steps, the local EC decisions, exchanged coordination variables, and multiplier information can iteratively update until the primal and dual residuals satisfy the stopping criterion.

B. Detailed Models in the case studies.

The compact form:

$$\begin{aligned} &\min_{\boldsymbol{x},\boldsymbol{y}} \sum_{t=1}^{T} \boldsymbol{c}^{\top}\boldsymbol{x} + \lambda \boldsymbol{y} \\ &\text{s.t.} \mathcal{A}_t \boldsymbol{x} = \mathcal{B}_t, \forall t \in T \\ &\quad \mathbf{A_t}\boldsymbol{x} \le \mathbf{b_t}, \forall t \in T \\ &\quad \boldsymbol{x} \in \mathcal{X} \end{aligned} \tag{9}$$

The objective function:

$$\sum_{t=1}^{T} c_B^{\top} P_t^B + c_*^{\top} P_t^* + \lambda^{\top} P_t^{\mathrm{EC}} \tag{10}$$

where the cost coefficient vectors c_B, c_* correspond to the energy purchase prices and operational costs, λ is the penalty coefficient. The energy purchases P_t^B including power, gas, heat, and hydrogen purchases. The scheduled output vector P_t^* collectively represent the decision variables of all energy devices, and inter-ECs power exchange vector P_t^{EC}.

The energy balance constraints:

$$P_t^B + \sum_{i=1}^{N_{\mathrm{CHP}}} P_{i,t}^{\mathrm{CHP}} + \sum_{i=1}^{N_{\mathrm{WG}}} P_{i,t}^{f} + \sum_{i=1}^{N_{\mathrm{BE}}} P_{i,t}^{\mathrm{BE,D}} + \sum_{i=1}^{N_{\mathrm{FC}}} P_{i,t}^{\mathrm{FC}} = \sum_{i=1}^{N_D} P_{i,t}^{D} + \sum_{i=1}^{N_{\mathrm{EB}}} P_{i,t}^{\mathrm{EB}} + \sum_{i=1}^{N_{\mathrm{BE}}} P_{i,t}^{\mathrm{BE,C}} + \sum_{i=1}^{N_{\mathrm{EL}}} P_{i,t}^{\mathrm{EL}} \tag{11a}$$

$$\sum_{i=1}^{N_{\mathrm{CHP}}} Q_{i,t}^{\mathrm{CHP}} = \sum_{i=1}^{N_D} Q_{i,t}^{D} \tag{11b}$$

$$\sum_{i=1}^{N_{\mathrm{CHP}}} G_{i,t}^{\mathrm{CHP}} + G_t^{D} = G_t^{\mathrm{buy}} \tag{11c}$$

$$\sum_{i=1}^{N_{\mathrm{CHP}}} H_{i,t}^{\mathrm{CHP}} + \sum_{i=1}^{N_{\mathrm{EB}}} H_{i,t}^{\mathrm{EB}} + \sum_{i=1}^{N_{\mathrm{FC}}} H_{i,t}^{\mathrm{FC}} = H_t^{D} \tag{11d}$$

$$M_t^{\mathrm{buy}} + \sum_{i=1}^{N_{\mathrm{EL}}} M_{i,t}^{\mathrm{EL}} + \sum_{i=1}^{N_{\mathrm{HE}}} M_{i,t}^{\mathrm{HE,D}} = \sum_{i=1}^{N_{\mathrm{FC}}} M_{i,t}^{\mathrm{FC}} + \sum_{i=1}^{N_{\mathrm{HE}}} M_{i,t}^{\mathrm{HE,C}} \tag{11f}$$

where Eq. (11a) ensures the active power balance, while Eq. (11b)- Eq. (11e) enforce the balance constraints for reactive power, gas, heat, and hydrogen, respectively. P_t^B the purchased power, $P_{i,t}^{\mathrm{CHP}}$ the power output of CHP, $P_{i,t}^{f}$ the power output of wind generation, $P_{i,t}^{\mathrm{BE,D}}$ the discharging power of energy storage, $P_{i,t}^{\mathrm{FC}}$ the power output of fuel cell (FC), $P_{i,t}^{D}$ the power demand, $P_{i,t}^{\mathrm{EB}}$ the power consumption of electric boiler (EB), $P_{i,t}^{\mathrm{BE,C}}$ the charging power of energy storage, $P_{i,t}^{\mathrm{EL}}$ the power consumption of electrolyzer (EL). $Q_{i,t}^{\mathrm{CHP}}$ the reactive power output of CHP, $Q_{i,t}^{D}$ the reactive power demand, $G_{i,t}^{\mathrm{CHP}}$ the gas consumption of CHP, G_t^{D} the gas demand, G_t^{buy} the purchased gas. $H_{i,t}^{\mathrm{CHP}}$ the heat output of CHP, $H_{i,t}^{\mathrm{EB}}$ the heat output of EB, $H_{i,t}^{\mathrm{FC}}$ the heat output of FC, M_t^{buy} the purchased hydrogen, $M_{i,t}^{\mathrm{EL}}$ the hydrogen output of EL, $M_{i,t}^{\mathrm{HE,D}}$ the discharging flow of hydrogen storage, $M_{i,t}^{\mathrm{FC}}$ the hydrogen consumption of FC, $M_{i,t}^{\mathrm{HE,C}}$ the charging flow of hydrogen storage.

Device constraints of CHP:

$$P_t^{\mathrm{CHP}} = \left(\eta_{\mathrm{CHP}}^{\mathrm{P}} \rho_{\mathrm{G2P}}\right) G_t^{\mathrm{CHP}} \tag{12a}$$

$$H_t^{\mathrm{CHP}} = \left(\eta_{\mathrm{CHP}}^{\mathrm{H}} \rho_{\mathrm{G2P}}\right) G_t^{\mathrm{CHP}} \tag{12b}$$

$$\underline{P}_{\mathrm{CHP}} \le P_t^{\mathrm{CHP}} \le \overline{P}_{\mathrm{CHP}} \tag{12c}$$

$$\underline{Q}_{\mathrm{CHP}} \le Q_t^{\mathrm{CHP}} \le \overline{Q}_{\mathrm{CHP}} \tag{12d}$$

$$-\underline{\Delta P}_{\mathrm{CHP}} \le P_t^{\mathrm{CHP}} - P_{t-1}^{\mathrm{CHP}} \le \overline{\Delta P}_{\mathrm{CHP}} \tag{12e}$$

where Eqs. (12a) and (12b) characterize the conversion of natural gas into electricity and heat based on efficiency parameters η and unit conversion factors ρ. Eq. (12c) imposes ramping constraints to limit abrupt changes in CHP output. Eqs. (12d) and (12e) enforce the operational bounds on active and reactive power outputs, while Eq. (12e) defines the maximum allowable reserve capacities that the CHP unit can offer.

Other devices have the same modeling paradigm, and therefore is omitted here for concise.

Device constraints of BESS:

$$E_t^{\mathrm{BE}} = E_{t-1}^{\mathrm{BE}} + \eta_{\mathrm{BE}}^{\mathrm{C}} P_t^{\mathrm{BE,C}} - P_t^{\mathrm{BE,D}} \big/ \eta_{\mathrm{BE}}^{\mathrm{D}} \tag{13a}$$

$$\underline{E}_{\mathrm{BE}} \le E_t^{\mathrm{BE}} \le \overline{E}_{\mathrm{BE}} \tag{13b}$$

$$\underline{P}_{\mathrm{BE,C}} \le P_t^{\mathrm{BE,C}} \le \overline{P}_{\mathrm{BE,C}} \tag{13c}$$

$$\underline{P}_{\mathrm{BE,D}} \le P_t^{\mathrm{BE,D}} \le \overline{P}_{\mathrm{BE,D}} \tag{13d}$$

Eq. (13a) update the energy level of the BESS. Eqs. (13b) and (13c) impose constraints on the maximum and minimum charging and discharging powers. (No additional constraints are required to prevent simultaneous charging and discharging of BESS, since the objective function in (10) is monotonically increasing with respect to related variables).

Power flow constraints:

$$\mathbf{C} \cdot \mathbf{P}_t^F = \left[\boldsymbol{P}_t^B, \boldsymbol{P}_t^{\mathrm{inj}} \right] \tag{14a}$$

$$\mathbf{C} \cdot \boldsymbol{Q}_t^F = \left[0, \boldsymbol{Q}_t^{\mathrm{inj}} \right] \tag{14b}$$

$$\boldsymbol{P}_t^{\mathrm{inj}} = \mathbf{C}_{\mathrm{CHP}} \boldsymbol{P}_t^{\mathrm{CHP}} + \mathbf{C}_{\mathrm{W}} \widetilde{\boldsymbol{P}}_t^{\mathrm{W}} + \mathbf{C}_{\mathrm{FC}} \boldsymbol{P}_t^{\mathrm{FC}} + \mathbf{C}_{\mathrm{BE}} \boldsymbol{P}_t^{\mathrm{BE,D}} - \mathbf{C}_{\mathrm{D}} \boldsymbol{P}_t^{\mathrm{D}} - \mathbf{C}_{\mathrm{EB}} \boldsymbol{P}_t^{\mathrm{EB}} - \mathbf{C}_{\mathrm{BE}} \boldsymbol{P}_t^{\mathrm{BE,C}} - \mathbf{C}_{\mathrm{EL}} \boldsymbol{P}_t^{\mathrm{EL}} \tag{14c}$$

$$\boldsymbol{Q}_t^{\mathrm{inj}} = \mathbf{C}_{\mathrm{CHP}} \boldsymbol{Q}_t^{\mathrm{CHP}} - \mathbf{C}_{\mathrm{D}} \boldsymbol{Q}_t^{\mathrm{D}} \tag{14d}$$

$$\widehat{\mathbf{C}}^{\top} \boldsymbol{v}_t + v_0 \mathbf{C}_0 = 2\left(\mathbf{R} \boldsymbol{P}_t^{\mathrm{inj}} + \mathbf{X} \boldsymbol{Q}_t^{\mathrm{inj}} \right) \tag{14e}$$

$$\underline{\boldsymbol{v}} \le \boldsymbol{v} \le \overline{\boldsymbol{v}} \tag{14f}$$

Eqs. (14a) and (14b) establish the relationships between branch-level active and reactive power flows and bus-level power injections, which are defined in (14c) and (14d) via the device-to-bus mapping matrix $\mathbf{C}_*$. Eq. (14e) connects the injected powers to bus voltages by relaxing the phase angle constraints. The squared voltage magnitudes are further bounded within specified limits, as expressed in (14f).

C. Settings for case studies.

The detailed model parameters can be found in the attached Excel file.

In economic dispatch under normal operation, the system diagrams for S1-S3 are illustrated as Fig. S1-S3:

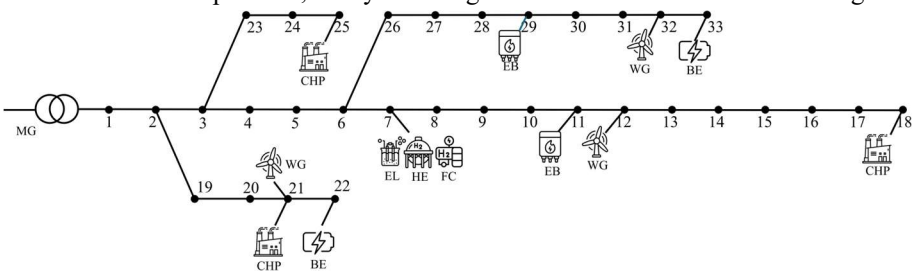

Fig S1. The system diagrams for S1

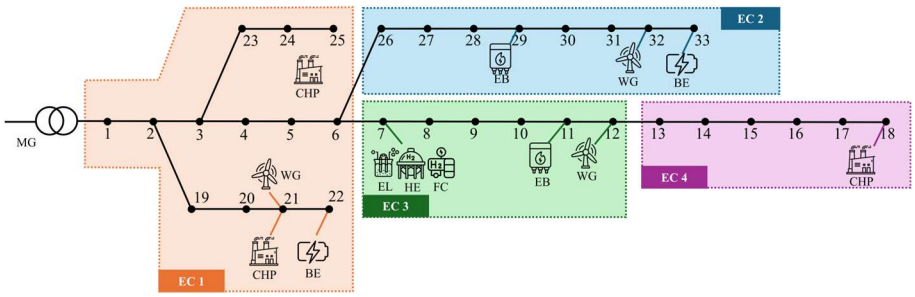

Fig S2. The system diagrams for S2

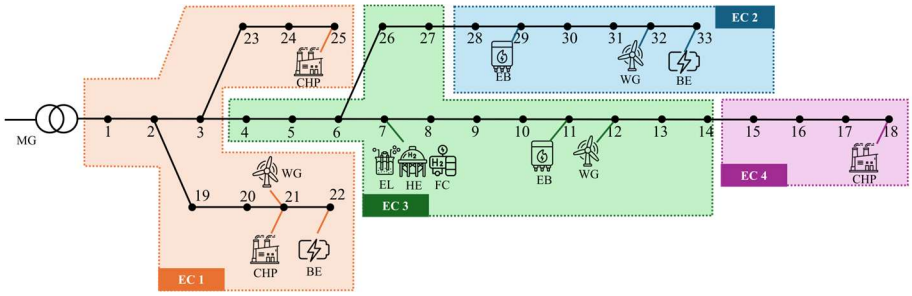

Fig S3. The system diagrams for S3

In resilience enhancement under extreme conditions, the system diagrams without and with flexible boundaries adjustment are illustrated as Fig. S4-S5:

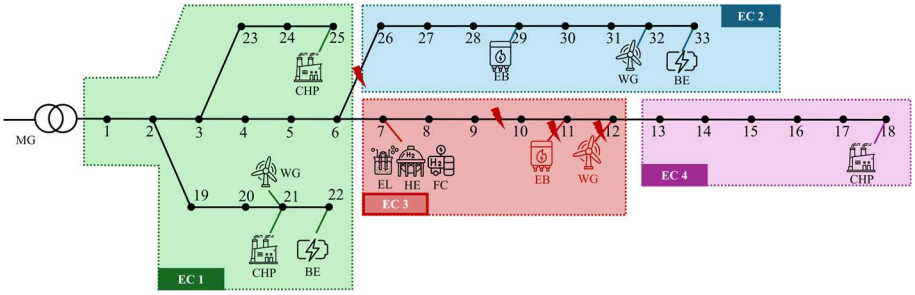

Fig S4. The system diagrams for ECs without boundaries adjustment and clusters

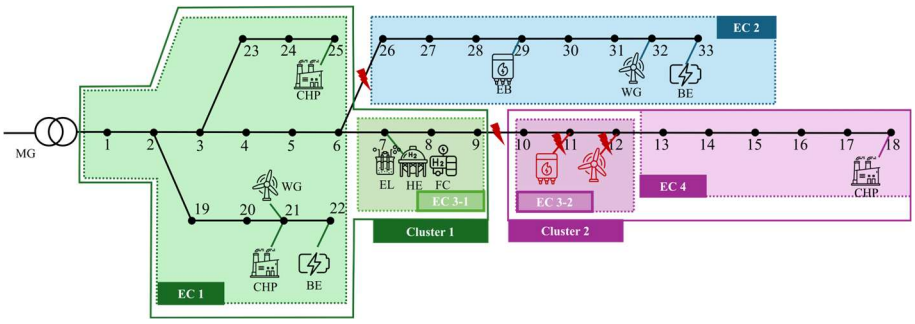

Fig S5. The system diagrams for ECs with boundaries adjustment and clusters

IV. Additional Figures

A. The energy flow diagram in EC

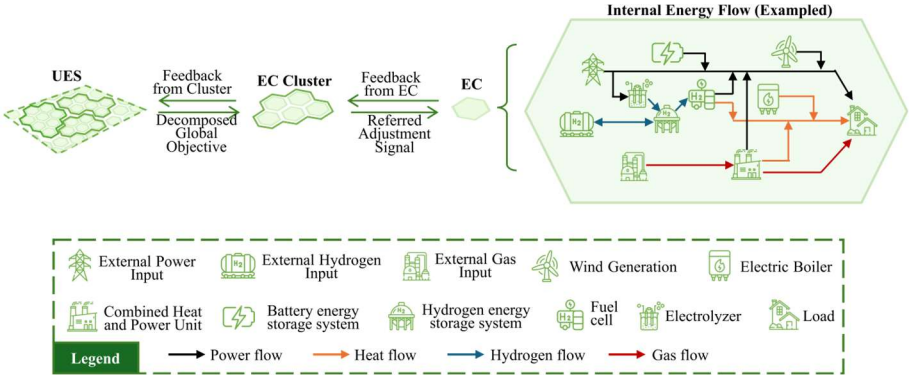

Fig. S6 Energy-flow diagram in an exampled EC and the hierarchy of whole EC framework.