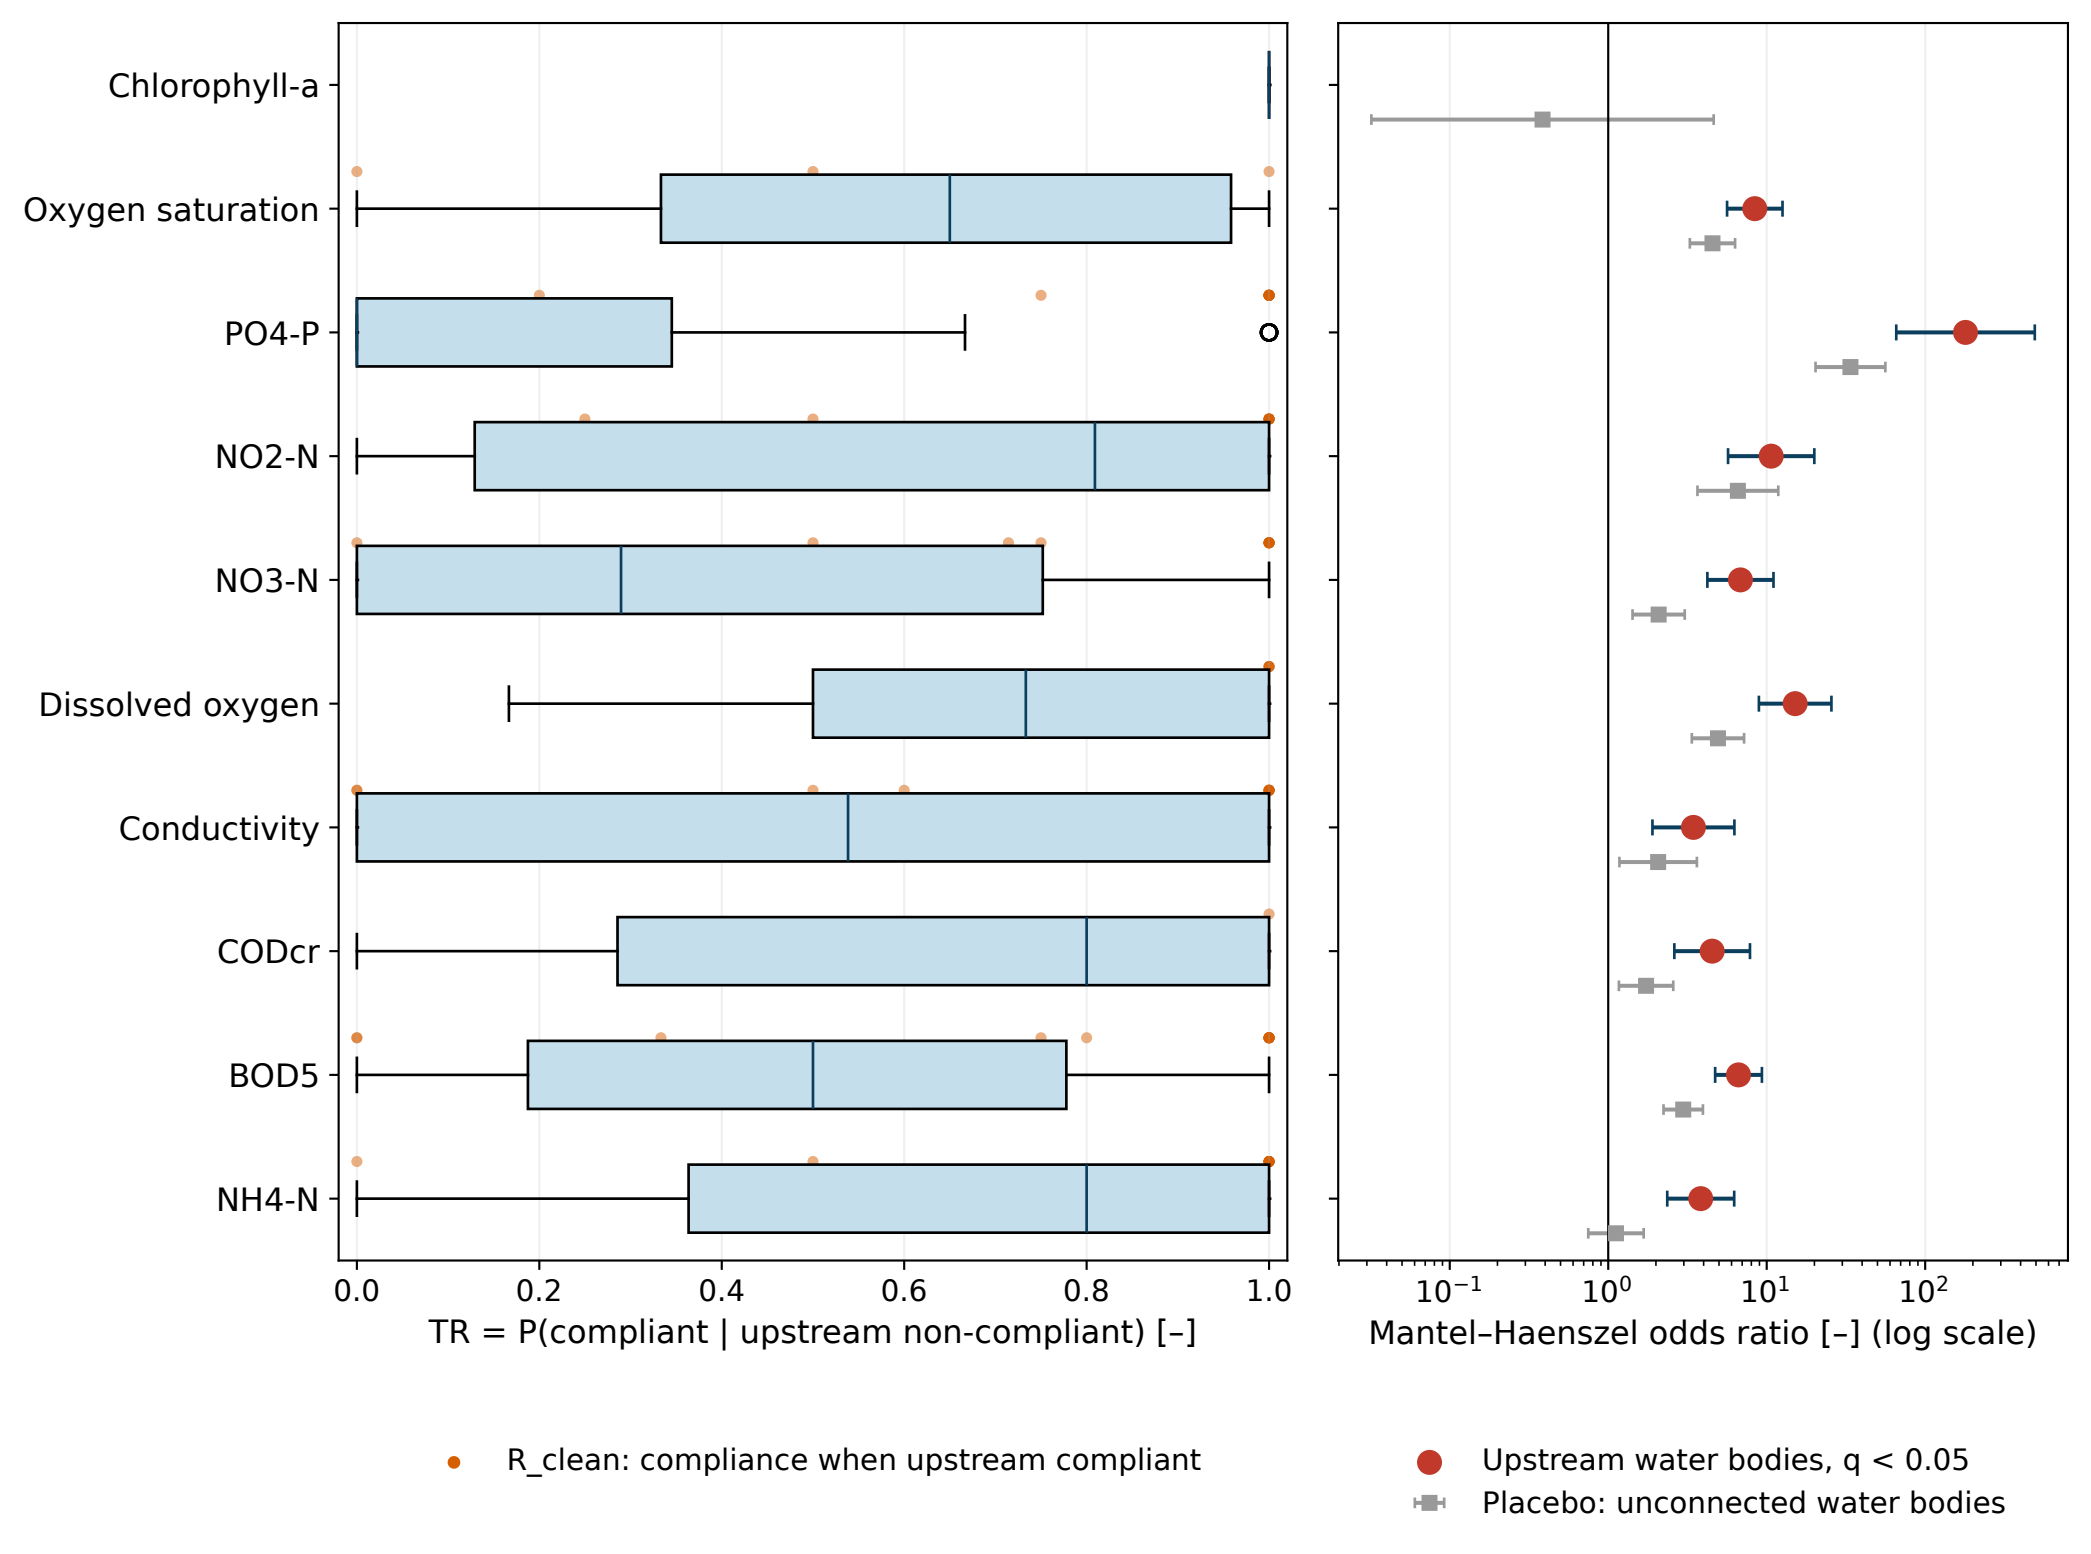
Chlorophyll-a
Oxygen saturation
PO4-P
NO2-N
NO3-N
Dissolved oxygen
Conductivity
CODcr
BOD5
NH4-N
0.0
0.2
0.4
0.6
0.8
1.0
TR = P(compliant | upstream non-compliant) [–]
$10^{-1}$
$10^{0}$
$10^{1}$
$10^{2}$
Mantel–Haenszel odds ratio [–] (log scale)
R_clean: compliance when upstream compliant
Upstream water bodies, q < 0.05
Placebo: unconnected water bodies