NX-CARBON-C754B190-DAY-20261021
Generated 21 Oct 2026, 13:12 UTC

Carbon & ESG Performance report

Nexora Medical Centre | Hospital
2017-12-31 00:00:00 to 2017-12-31 23:00:00 | US/Central

Electricity-linked emissions
2.215
t CO2e | selected period

Electricity consumption
4,027.8
kWh | selected period

Estimated electricity cost
RM 2,013.89
MYR | configured tariff

01 / Executive summary

Nexora Medical Centre has 4,027.8 kWh of estimated electricity use for this period. The configured emission factor produces 2,215.3 kg CO_2e. 3 alert(s) await review and 2 have been settled in the local plan.

Electricity-linked carbon trend

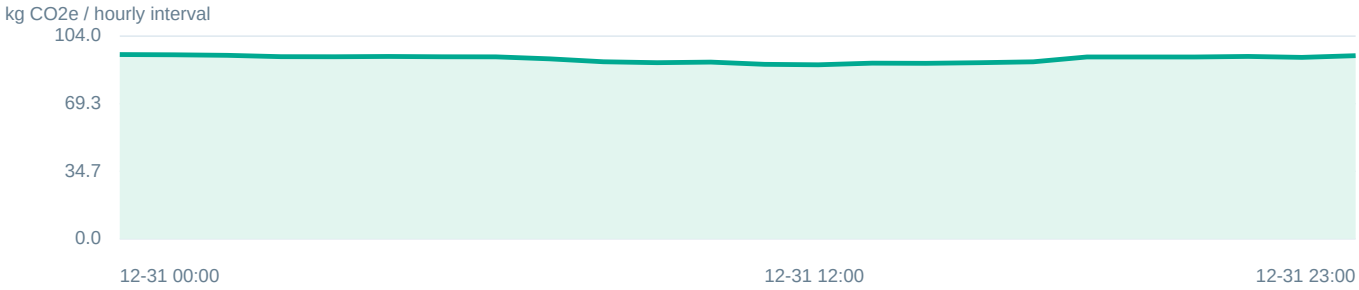

02 / Emissions inventory boundary

Category	t CO2e	Coverage
Scope 1 / direct	Not assessed	Fuel combustion and refrigerant data are unavailable.
Scope 2 / purchased electricity	2.215	Electricity x configured factor; estimate.
Scope 3 / other indirect	Not assessed	Value-chain activity data are unavailable.

The total above covers electricity only. Unassessed categories are excluded, not zero. This is a building performance report, not a verified corporate GHG inventory.

Reduction plan & evidence

Nexora Medical Centre | Decisions, assumptions and reporting coverage

03 / Approved plan - next 24 source-local hours

Forecast window: 01 Jan 2018 00:00 to 01 Jan 2018 23:00 (US/Central).

Projected cost savings
RM 58.84
MYR | approved plan

Grid electricity avoided
117.7
kWh | approved plan

Avoided carbon emissions
64.7
kg CO2e | approved plan

Performance indicator	Baseline forecast	Approved plan
Building electricity / kWh	4,202.6	4,085.0
Grid import / kWh	4,202.6	4,085.0
Peak interval-average demand / kW	194.7	189.3

Savings compare the same next-24-hour forecast and approved simulation. They are projections, separate from the historical period above; approval does not establish a measured saving.

04 / Energy intensity & end-use coverage

Indicator	Selected-period result
Building Energy Index (BEI)	0.167 kWh/m2; selected period only
End-use emissions / HVAC, lighting, plugs, lifts, EV	Not separately metered; electricity total remains unallocated.
Year-on-year change / target progress	Not assessed: comparable baseline and target are not configured.

05 / Methodology & calculation assumptions

Electricity emissions: kWh x 0.5500 kg CO_2e/kWh. **Cost:** kWh x 0.5000 MYR/kWh. Tonnes = kilograms / 1,000. BEI = selected-period kWh / floor area; it is not annualised. No tree equivalent or certified offset is calculated.

Assumption reference: Nexora township v1 illustrative profile; hypothetical tariff, carbon factor and equipment inputs.

Source: Building Data Genome Project 2 v1.0, CC BY 4.0. doi.org/10.5281/zenodo.3887306. Benchmark asset: Hog_lodging_Francisco. Facility results are scaled illustrative estimates derived from this historical benchmark. Floor alerts are illustrative. No corporate-site identity, physical control or verified saving is claimed.