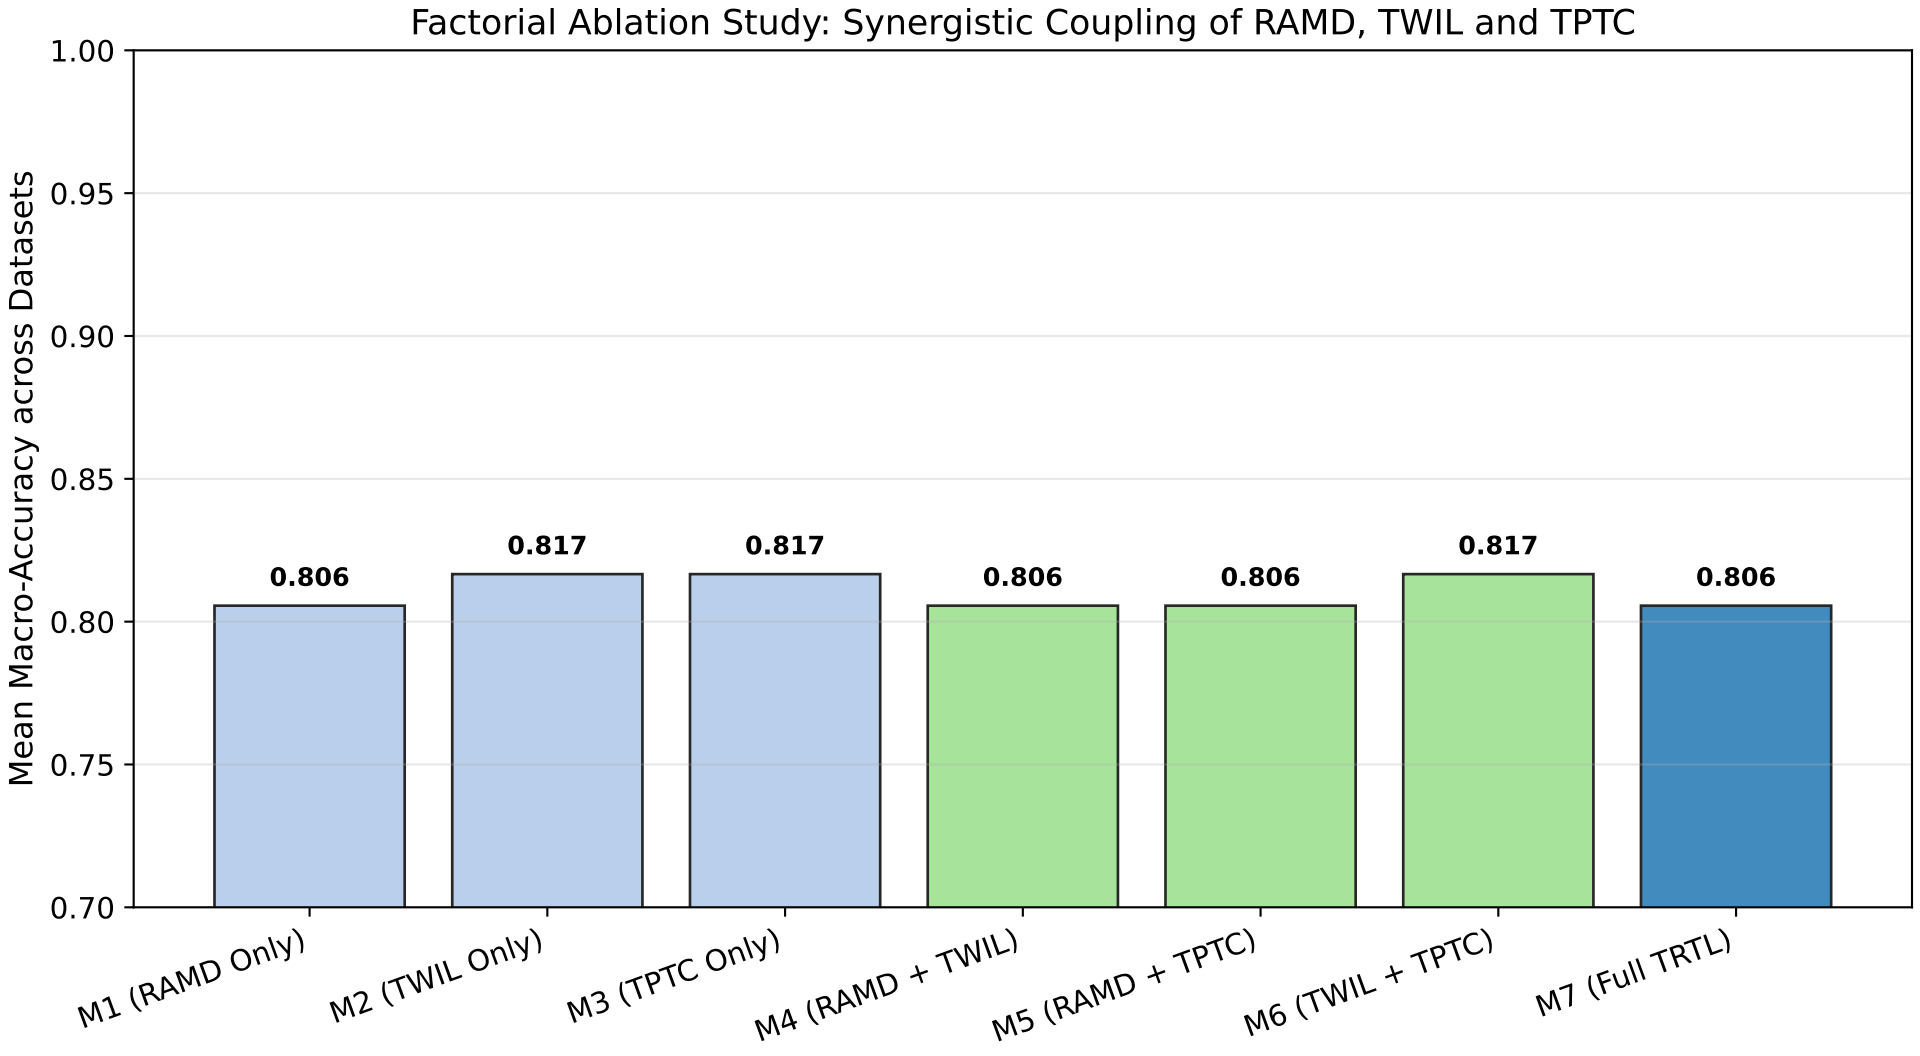
Factorial Ablation Study: Synergistic Coupling of RAMD, TWIL and TPTC
Mean Macro-Accuracy across Datasets
1.00
0.95
0.90
0.85
0.80
0.75
0.70
0.806
0.817
0.817
0.806
0.806
0.817
0.806
M1 (RAMD Only)
M2 (TWIL Only)
M3 (TPTC Only)
M4 (RAMD + TWIL)
M5 (RAMD + TPTC)
M6 (TWIL + TPTC)
M7 (Full TRTL)