

Karlsruhe Institute of Technology

Model- Predictive Control of Heat Pump in Smart Buildings

Master's thesis of

Vivien Geenen

at the Department of Mechanical Engineering
Institute for Automation and Applied Informatics (IAI)

Reviewer: Prof. Dr. Veit Hagenmeyer

Second reviewer: apl. Prof. Dr. Jörg Matthes

Advisor: Moritz Frahm, M.Sc. and Frederik Zahn, M.Sc

Welche Paper
haben die so
veröffentlicht?

June – November 2021

nach
Möglichkeit zielen

Karlsruher Institut für Technologie
Fakultät für Maschinenbau
Postfach 6980
76128 Karlsruhe

I declare that I have developed and written the enclosed thesis completely by myself, and have not used sources or means without declaration in the text.

PLACE, DATE

.....

(Vivien Geenen)

Kurzfassung

Abstract

Contents

Kurzfassung	i
Abstract	iii
1 Introduction	1
1.1 Objective of this work	2
1.2 Related work	2
1.3 Content structuring	3
2 Foundations	5
2.1 Thermal basics	5
2.1.1 Conduction	5
2.1.2 Convection	6
2.1.3 Radiation	6
2.2 Lumped capacitance model	7
2.2.1 Electrical analogy	7
2.3 Model predictive control (MPC)	9
2.3.1 Cost function	10
2.3.2 Current state	10
2.3.3 Dynamics	10
2.3.4 Constraints	11
3 Modelling	13
3.1 The building	13
3.2 The thermal model	14
3.3 Grey-box modelling	15
3.4 Data collection	15

3.5	Validation of the thermal model	15
4	Model predictive control	17
4.1	Optimization	17
4.2	Constrains	17
4.3	Cost function	17
5	Results	19
6	Conclusion	21
7	Outlook <i>heißt das wirklich so?</i>	23
	Bibliography	25
A	Appendix	29
A.1	First Section	29

List of Figures

2.1	Sample RC- network	8
2.2	MPC structure of the control loop	9
3.1	construction plan of the building [27]	14
3.2	structure of the thermal model in RC- analogy	14
A.1	A figure	29

List of Tables

Ich glaube im Englischen
hinter e.g. immer ein
Komma

1. Introduction

Climate change is challenging the entire world. In the Paris Agreement, the United Nations (UN) agrees to keep the rise in global average temperature significant under two degrees Celsius [28]. To achieve this aim every nation must reduce its greenhouse gas emissions.

This calls for changes e.g. in the mobility sector, industry, and energy production. Germany intends to implement this by promoting electromobility, using hydrogen in industry, and energy transition [6]. Especially the energy transition that has already been initiated must be driven forward. That means the expansion of renewable energies and decreasing conventional power plants. The German government is aiming to phase out coal-fired power plants by 2038 [2]. For covering the energy demand, a high increase in photovoltaics and wind power is necessary in a few years.

Since a disadvantage of this renewable energy is that they fluctuate with the weather and do not release energy by demand. In addition, more renewable energies lead to more intense instabilities in the grid. Energy storage and load shifting are to be used to implement the stable grid in the future. Batteries, pumped hydroelectric energy storage, thermal energy storage, and much more could store an excess of power during a sunny or windy day. On the other hand, load shifting is clever adding and removing loads from the grid and results in smoothing the grid. Load shifting is already used industrial. A new approach is to use residential buildings as thermal storage and demand response to contribute to grid stability. Particularly, the idea of controlling the heat pumps of buildings has great potential. As at least 1.25 million heat pumps are already installed in Germany, and the tendency is increasing [16].

The implementation of this approach needs a control strategy during consumer comfort is ensured. Using the weather forecasts and prediction of the grid fluctuations improves the control. Model predictive control (MPC) is one suitable instrument to realize this and the issue of this work.

By conducting a model predictive control the
this provides empirical evidence¹
for addressing the following research question:

Bla bla

have to
in particular
have to
Satz einführen
→ Wodurch
die Lach
in der
Energiever-
sorgung
entsteht

Gibt vorher ein Satz dazu warum Kontrollen notwendig ist
→ z.B. gefährlich weil Überheizung? & c.
Vergewissernsich

1. Introduction

1.1. Objective of this work

This thesis aims to design a control system, which simultaneously serves the grid and comply with the required comfortable internal temperature range, for the heat pump of a building in the so-called "Living Lab" of the Karlsruhe Institute of Technology (KIT) at Campus North. The implementation is to be carried out using the control method Model Predictive Control (MPC). This method enables to predict the future thermal behaviour of the building and to react to the actual and future fluctuations of the weather or the grid for example. In the first step, a thermal model of the building behaviour must be created. For this purpose, the RC analogy is to be used. To reduce the complexity of the thermal behaviour of the building, appropriate assumptions can be made. Furthermore, the resulting model should correspond to a grey-box model, i.e., a middle ground between exact and black-box model description. After validation of the thermal model using measured data from the Living Lab, an optimal control problem shall be created. The aim is to construct an MPC algorithm and to simulate its application. The software used will be Matlab/Simulink.

1.2. Related work

Extant literature investigate in Thessa! ...
Thermal modelling and controlling of buildings are of great research interest. Kramer et al. [20] summarize thermal modelling approaches such as white-box, grey-box, and black-box models and present how researchers apply these approaches. Many authors identify their thermal model parameters with measurements [25], [12], [24], like a grey-box model or use grey-box models [9], [8]. Coakley et al. [4] see the advantages in the short development time for the model, fidelity of predictions, and the interaction of building, system and environmental parameters. One disadvantage is that modellers need a high level of knowledge in physical and statistical modelling. Further, some authors work with such thermal models in their MPC applications for thermal management in buildings [15], [13]. *Versteh ich nicht*

Regardless of the type of model, MPC is utilised for control of heating, ventilation, and air conditioning (HVAC) systems in buildings for a variety of reasons. Researchers are interested in the reduction of energy consumption [13] and saving costs [31] during obtaining thermal comfort. Some papers present how to decrease or shift the peak load of buildings [23]. On the other hand, some articles are interested in the potential of heat pumps for grid services. The report "Wärmepumpen in Bestandsgebäuden" examines, among other things, the load shifting potential of grouped heat pumps. The researchers determine 4 to 14 GWh load

→ Autoren könnten nicht interessiert sein
↳ sowieso zu oft "interested"

wer!

1.3. Content structuring

✓

shifting potential for one million heat pumps [5]. Also [18] analyse the flexibility of heating systems for smart grids, partially of heat pumps.

*Taken
together*

As can be seen from the above issues, many studies focus on thermal grey-box modelling, MPC for HVAC control, and heat pumps and thermal storage possibilities for demand side management. However, the combination of these topics is not yet considered. The research question remains open whether an MPC for controlling a heat pump in smart buildings, including a thermal grey-box model, can stabilize the grid.

1.3. Content structuring

Stukturierung meiner Thesis erläutern

was ist ein grey box model?

2. Foundations

The main foundations on which this work is based are summarized in this chapter. This includes thermal basics, foundations about thermal modelling, and model predictive control (MPC). Note, that in the following all vectors are denoted as bold letters, e.g. \mathbf{x} .

2.1. Thermal basics

There are three mechanisms of heat transfer: Heat conduction, heat convection, and heat radiation[29]. All of these mechanisms are used for the thermal modelling of buildings. For example, conduction is the main part of heat transfer through walls or floors. Convection takes place on the inside and the outside of the building between the walls and the air and radiation is needed for the integration of the impact of the sun, for example.

2.1.1. Conduction

Conduction means that heat energy is directed in a solid or fluid. Molecules within the solid or fluid have higher energy when the temperature is higher. They transfer the energy to neighbouring molecules with smaller energy. Without a heat source, the temperature difference between a hot and a cold location of the molecules decreases.[21]

The equation

$$\dot{\mathbf{q}} = -\lambda \nabla T \quad (2.1)$$

describes the conduction according to Fourier [29]. There is λ the thermal conductivity with the assumption of being constant and $\dot{\mathbf{q}}$ and T represent the specific heat flux and the temperature. The thermal conductivity is dependent on the material, such as concrete, wood or bricks.

To know the heat flux \dot{Q} , it is necessary to expand the above equation with the area A ,

2. Foundations

the thickness of the conductive medium d and a temperature difference ΔT assuming one significant direction of the heat flux \dot{Q} to:

$$\dot{Q} = \frac{A\lambda}{d}\Delta T \quad (2.2)$$

In terms of buildings, the conductive medium could be walls, floors or roofs.

2.1.2. Convection

Macroscopic movements of a fluid lead to the transport of kinetic energy and enthalpy. This mechanism is called convection. These movements are generated by external forces or by internal forces like balancing the pressure or temperature.[29]

Newton's law of cooling describes the convective heat transfer \dot{Q} as

$$\dot{Q} = \alpha A(T_w - T_\infty) \quad (2.3)$$

with the heat transfer coefficient α , especially for building modelling the wall temperature T_w and the environment temperature T_∞ [10]. There are two possibilities to determine the heat transfer coefficient. Both require a temperature difference ΔT and either a temperature gradient $\partial T / \partial x$ or a heat flux \dot{Q} . [29]

2.1.3. Radiation

Every body emits heat radiation to the environment with electromagnetic waves. Especially, heat radiation does not need matter for energy transportation. As shown in the following equation, the temperature T of the body influences highly heat radiation.[29]

$$\dot{q} = \sigma T^4 \quad (2.4)$$

This correlation applies to a black body, where \dot{q} is a heat flux and σ represents the Stefan-Boltzmann coefficient. A black body absorbs all heat radiation with all wavelengths from all directions[10]. The consideration of a black body is idealized. For the illustration of a real body (see Equation 2.5), the emissivity ϵ is used. ϵ is material-dependent and lies between 0 and 1.

$$\dot{q} = \epsilon \sigma T^4 \quad (2.5)$$

2.2. Lumped capacitance model

In general, a body absorbs, transmits, and reflects radiation with the appropriate coefficients a , τ and r . The sum of three coefficients has to be one ($a + \tau + r = 1$) [1]. In particular, the reflection coefficient is needed for describing the influence of radiation from the environment in building modelling.

The best-known source of heat radiation is the sun, which plays an important role in the thermal modelling of buildings. Objectives in the building, such as radiators, also radiate heat. For example, radiators have equal parts convective and radiative energy transport [12].

2.2. Lumped capacitance model

For modelling the thermal behaviour of buildings, the lumped capacitance model is often used. With this approach, using the electrical analogy, building elements are represented by resistors R and capacitors C . [20]

2.2.1. Electrical analogy

Similar to an electrical network, the potential is represented by the temperature at one node and the heat flux corresponds to the current. We can also use Ohm's law, which is formulated in a thermal way as:

$$\dot{Q} = \frac{\Delta T}{R} \quad (2.6)$$

Combining the above equation with Equation 2.2 or Equation 2.3, the thermal resistance R is determined in conductive cases as [21]:

$$R_\lambda = \frac{d}{A\lambda} \quad (2.7)$$

and in convective cases as[10]:

$$R_\alpha = \frac{1}{\alpha A} \quad (2.8)$$

In sum, the thermal resistances R comply with electrical resistors. Further for modelling thermal networks, the thermal capacitance C is needed. It is calculated from the specific heat capacity c multiplied by the mass m ($C = cm$).

For a better explanation of the structure of a thermal network, a simple example is depicted in Figure 2.1. It represents a heated wall of a building. The heat flux \dot{Q} , for example from a radiator, influences the temperature T_{wall} , as well as the capacitance C . And the temperature

2. Foundations

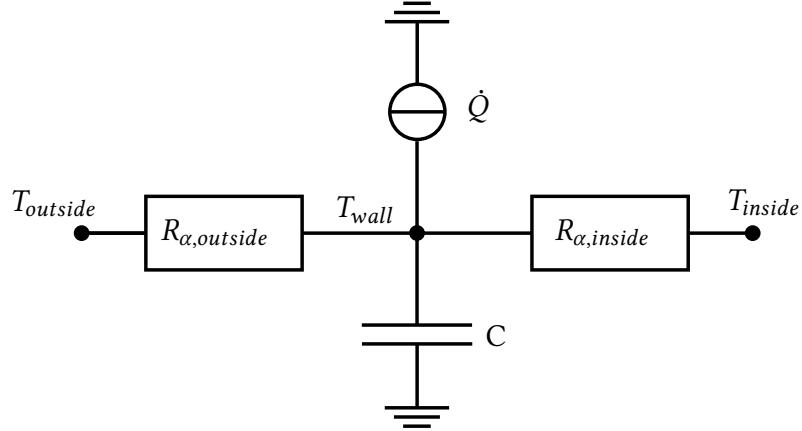


Figure 2.1. Sample RC- network

T_{wall} affects the temperature inside and outside T_{inside} and $T_{outside}$ with their resistances $R_{\alpha,inside}$ and $R_{\alpha,outside}$. The example shows that all connections in the network influence each other. To model the dynamics of the wall in differential equations, Kirchhoff's Current Law is required. It states that the sum of the flowing current to the node is equal to the sum of the flowing current of the node [21]. Because of the thermal analogy of electrical laws, the current is replaced by heat flux. The following differential equation results for the node T_{wall} using Ohm's law ($\dot{Q} = \Delta T / R$) and the relationship $\dot{Q} = C \frac{\partial T}{\partial t}$.

$$C \frac{\partial T_{wall}}{\partial t} = \dot{Q} + \frac{T_{inside} - T_{wall}}{R_{\alpha,inside}} - \frac{T_{wall} - T_{outside}}{R_{\alpha,outside}} \quad (2.9)$$

In Figure 2.1, the thermal resistances are serially connected. According to the electrical network, resistances in series are equal to their sum.

$$R_{sum} = R_{\alpha,inside} + R_{\alpha,outside} \quad (2.10)$$

A parallel circuitry has windows and walls in buildings, for example. Here the resistances are calculated according to the following schema:

$$\frac{1}{R_{sum}} = \frac{1}{R_{wall}} + \frac{1}{R_{window}} \quad (2.11)$$

2.3. Model predictive control (MPC)

In terms of needed more capacitances for describing the thermal model, the summary capacitance is added in a parallel circuitry as:

$$C_{sum} = C_1 + C_2 \quad (2.12)$$

The serial circuitry of capacitances is calculated as follows:

$$\frac{1}{C_{sum}} = \frac{1}{C_1} + \frac{1}{C_2} \quad (2.13)$$

2.3. Model predictive control (MPC)

"The idea of model predictive control [...] is [...] to utilize a model of the process in order to predict and optimize the future system behavior" [11]. Applied to a thermal control of a building with the aim of grid-supporting, a model of the thermal behaviour of the building is required to predict the reaction of the system behaviour in the next N time steps, called the prediction horizon. Every time step k , the current state x_k , the output y_k is measured, and the future system behaviour is obtained computation. The computation of the future system behaviour may include weather forecast, occupancy schedule and the optimization of the control signal u_k over the optimization horizon u_{k+N} . But, only the first calculated control signal is adopted as input for the plant. Then, the calculations are repeated at every time step. Figure 2.2 visualises the MPC control loop.

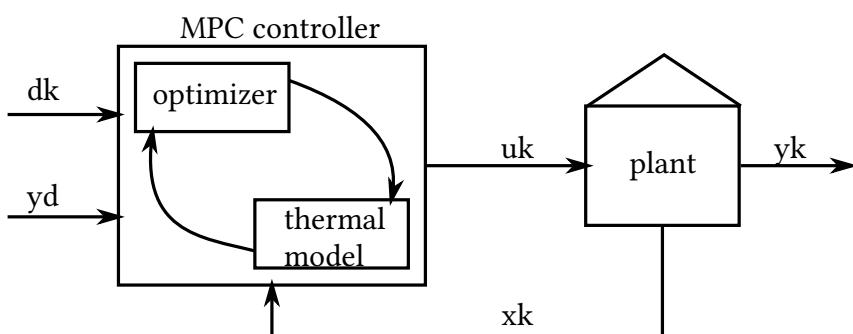


Figure 2.2. MPC structure of the control loop

Concluded, the MPC is "an iterative online optimization over the predictions" [11] compiled

2. Foundations

by the thermal model of the building. Mathematically explained, the optimizer needs to reduce the following equation according to [30] and [22]:

$$\text{Cost function} \quad \underset{k=1}{\text{minimize}} \sum_{k=1}^{N-1} c_k(x_k, u_k, y_k) \quad (2.14)$$

subject to

Current state	$x_0 =$	x
Dynamics	$x_{k+1} =$	$f(x_k, u_k, d_k)$
Constraints	$y_{min} \leq$	$y_k \leq y_{max}$
	$u_{min} \leq$	$u_k \leq u_{max}$

c_k represents the cost function, which is explained in detail in subsection 2.3.1 . In terms of building control, y is the internal temperature.

2.3.1. Cost function

The cost function c_k assigns a cost to the control signal u_k and the current state x_k , which is mathematically described in Equation 2.14 , with:

$$c_k = (x_k^T Q x_k + u_k^T R u_k) \quad (2.15)$$

Here Q and R are matrices over which individual elements of the state vector or control signal vector can be weighted differently. [19]

2.3.2. Current state

The current state \mathbf{x}_k is a vector of measured state variables of a building. Every prediction starts from this initial state [22].

2.3.3. Dynamics

The state-space formulation (SSF) is an alternative representation of a linear differential equation, which models a physical system. In this work, it is used for the formulation of the thermal model, which is required for the MPC. The SSF consists of the state \mathbf{x} , the control

2.3. Model predictive control (MPC)

signal \mathbf{u} , the disturbances \mathbf{d} and the output of the system \mathbf{y} are represented in Equation 2.16. The system matrix is A , B_1 and B_2 are called the input matrices, C is the output matrix, D_1 and D_2 are the pass-through matrices.

$$\begin{aligned}\dot{\mathbf{x}} &= A\mathbf{x} + B_1\mathbf{u} + B_2\mathbf{d} \\ \mathbf{y} &= C\mathbf{x} + D_1\mathbf{u} + D_2\mathbf{d}\end{aligned}\tag{2.16}$$

In a thermal model of a building, some authors ([12], [25],...) use the state as a vector of some temperatures, the control signal as a signal for the heating system, the disturbances can describe the influence by the weather or occupants and the output of the system contains frequently the temperature inside of the building.

2.3.4. Constraints

Dealing with constraints is one of the most important advantages of MPC. Thereby, constraints can be used for the state, the output, and the input. In terms of building control, output constraints and input constraints are reasonable, as mathematically described in the Equation 2.14. That means, the output constraints could be a temperature range, which feels comfortable for occupants. And the constraints for the input are given as minimal ($= 0$) and maximal values of the possible performances. General, logical and physical ranges are constrained. There are different forms of constraints, but linear constraints are frequently used for MPC because they simplify the optimization problem. Constraints can also be time dependant. This is beneficial for embedding diverse temperature ranges during the night and the day or during the working time of occupants when they are not at home. [25]

3. Modelling

After explaining thermal basics and the electrical analogy, the foundations are used in this chapter. How I obtain a thermal model and the resulting thermal model is introduced. Later the model is required for the MPC to predict the thermal reactions of the building.

3.1. The building

Since the thermal model and the MPC are based on a real building, the building is described in more detail below.

The building stands at the "Campus Nord" from the "Karlsruher Institut für Technologie (KIT)" and is part of the "Energy Lab 2.0", "a research infrastructure for renewable energy" [17]. It is equipped with a kitchen, a bathroom, five rooms and a technical room. For a better orientation, you can see in Figure 3.1 a part of the construction plan of the building. It can be noted that the building is designed as a single-family house, but for practical reasons, it is used as an office. The living area is around 100 m^2 . In the building are two options to heat or cool with a ground-source heat pump or an air heat pump. The focus is placed on the air heat pump because the most commonly used heat pumps in Germany are air heat pumps [3]. Further information about the air heat pump you can read in the "Technische Unterlagen Montageanleitung" [14]. In cooperation with the heat pump, there is a water reservoir for saving energy. The volume is 1000 litres (further information in [32]). However, the heating system is not completely installed. So heating or cooling is not possible actual.

One of the main features of the building is the number of sensors. The air temperature is measured in every room, as well as the temperature in the middle of the exterior wall, the screed temperature, the floor plate temperature, and the temperature of the inner wall between room three and room four (see Figure 3.1). Furthermore, the consumption of the actual electrical power is also detected. There are much more sensors, but in this case, are only needed the mentioned sensors.

3. Modelling

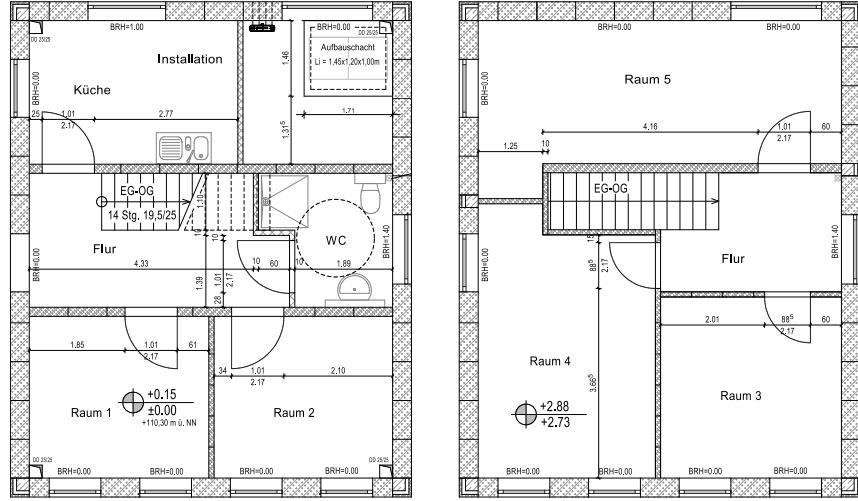


Figure 3.1. construction plan of the building [27]

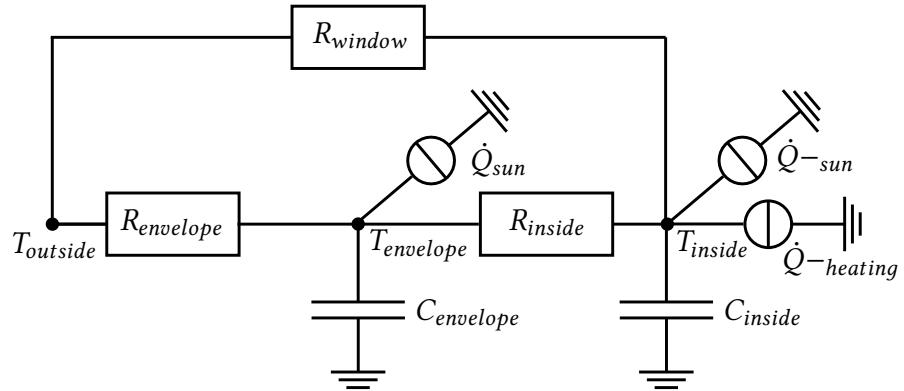


Figure 3.2. structure of the thermal model in RC- analogy

3.2. The thermal model

The focus of this work is on the MPC part, so a simple thermal model is required. Nevertheless, no necessary information must be missing. In this case, the thermal storage possibilities, the temperature inside the building, and the heating system's influence have to be represented in the model. The storage is needed because the objective of the MPC is to heat during the grid has too much power/a too high frequency and to save the energy in the building during grid requires energy. The output of the model needs to be the temperature inside since the MPC aims to be in a pleasant temperature range to ensure customer comfort. Last, the influence of the heating system must be recognisable in the model, as it is the input of the plant.

3.3. Grey-box modelling

$$\begin{aligned}
 C_{inside} * \frac{\partial T_{inside}}{\partial t} &= \dot{Q}_{heating} + \dot{Q}_{sun,inside} - \frac{T_{inside} - T_{envelope}}{R_{inside}} - \frac{T_{inside} - T_{outside}}{R_{window}} \quad (3.1) \\
 C_{envelope} * \frac{\partial T_{envelope}}{\partial t} &= \dot{Q}_{sun,envelope} - \frac{T_{envelope} - T_{outside}}{R_{envelope}} + \frac{T_{inside} - T_{envelope}}{R_{inside}} \\
 \dot{Q}_{WR} &= \dot{Q}_{heating} + \dot{Q}_{HP} - \dot{Q}_{loss} - \dot{Q}_{SW}
 \end{aligned}$$

3.3. Grey-box modelling

Creating a model can be made with three types of models, the so-called white-box models, grey-box models or black-box models. White-box models describe the real system only physically. Black-box models, on the other hand, have no physical description. They are created with data. And grey-box models are in between these two options [26]. All possibilities are used in the thermal modelling of buildings [20].

The chosen approach for the MPC is the grey-box model because it combines the advantages of white-box models and black-box models [7]. The advantages are: [4]

- keeping a physical structure of the model, for
-

3.4. Data collection

3.5. Validation of the thermal model

4. Model predictive control

4.1. Optimization

4.2. Constrains

4.3. Cost function

5. Results

6. Conclusion

7. Outlook

Bibliography

- [1] H. D. Baehr and K. Stephan, eds. *Wärme- und Stoffübertragung*. Berlin, Heidelberg: Springer Berlin Heidelberg, 2016.
- [2] Bundesregierung. *Abschied von der Kohleverstromung: Fragen und Antworten*. Ed. by Presse- und Informationsamt der Bundesregierung. 2021.
- [3] Bundesverband Wärmepumpe e.V. *Positives Signal für den Klimaschutz: 40 Prozent Wachstum bei Wärmepumpen*. 19.01.2021.
- [4] D. Coakley, P. Raftery, and M. Keane. *A review of methods to match building energy simulation models to measured data*. In: *Renewable and Sustainable Energy Reviews*, Vol. 37 (2014), pp. 123–141.
- [5] Danny Günther, Jeannette Wapler, Robert Langner, Sebastian Helmling, Dr.-Ing. Marek Miara, Dr.-Ing. David Fischer, Dirk Zimmermann, Tobias Wolf, Dr.-Ing. Bernhard Wille-Hausmann. *Wärmepumpen in Bestandsgebäuden: Ergebnisse aus dem Forschungsprojekt "WPsmart im Bestand": Abschlussbericht*. Ed. by Fraunhofer Institut für Solare Energiesysteme ISE. Freiburg, 2020.
- [6] Deutschlandfunk, ed. *Auf dem Weg zur Klimaneutralität: Die neuen Klimaziele für Deutschland*. 24.06.2021.
- [7] S. Estrada-Flores, I. Merts, B. DE Ketelaere, and J. Lammertyn. *Development and validation of “grey-box” models for refrigeration applications: A review of key concepts*. In: *International Journal of Refrigeration*, Vol. 29, No. 6 (2006), pp. 931–946.
- [8] Evelyn Sperber. *Grey-Box-Modellierung des thermischen Verhaltens von Typgebäuden*. 11. Internationale Energiewirtschaftstagung. 2019.
- [9] S. Freund and G. Schmitz. *Entwicklung und Validierung von Grey-Box-Modellen zur Modellierung des thermischen Verhaltens von Einzelbüros in einem Niedrigenergie-Bürogebäude*. In: (2020).

Bibliography

- [10] A. Griesinger, ed. *Wärmemanagement in der Elektronik*. Berlin, Heidelberg: Springer Berlin Heidelberg, 2019.
- [11] L. Grüne and J. Pannek. *Nonlinear model predictive control: Theory and algorithms*. Second edition. Communications and control engineering. Cham: Springer, 2017.
- [12] I. Hazyuk, C. Ghiaus, and D. Penhouet. *Optimal temperature control of intermittently heated buildings using Model Predictive Control: Part I – Building modeling*. In: *Building and Environment*, Vol. 51 (2012), pp. 379–387.
- [13] I. Hazyuk, C. Ghiaus, and D. Penhouet. *Optimal temperature control of intermittently heated buildings using Model Predictive Control: Part II – Control algorithm*. In: *Building and Environment*, Vol. 51 (2012), pp. 388–394.
- [14] IDM die Energiefamilie. *Technische Unterlagen Montageanleitung: AERO SLM 3- 11 AERO SLM 6- 17: Zusätzliche Ausstattungsvarianten HGL ohne HGL*. Zusätzliche Ausstattungsvarianten HGL ohne HGL.
- [15] Jiří Cigler, Jaň Sirok, Milan Korda, and Colin N Jones. *On the Selection of the Most Appropriate MPC Problem Formulation for Buildings*. In: (2013).
- [16] Karl-Heinz Backhaus (Vaillant), Dr. Hendrik Ehrhardt (Stiebel Eltron), André Jacob (BWP), Barbara. *Branchenstudie 2021: Marktanalyse - Szenarien - Handlungsempfehlungen: Vorabveröffentlichung zum*. In: (24.11.2020).
- [17] Karlsruher Institut für Technologie. *EnergyLab 2.0*. <https://www.elab2.kit.edu/index.php>, 15.07.2021.
- [18] P. Kohlhepp and V. Hagenmeyer. *Technical Potential of Buildings in Germany as Flexible Power-to-Heat Storage for Smart-Grid Operation*. In: *Energy Technology*, Vol. 5, No. 7 (2017), pp. 1084–1104.
- [19] B. Kouvaritakis and M. Cannon, eds. *Model Predictive Control*. Cham: Springer International Publishing, 2016.
- [20] R. Kramer, J. van Schijndel, and H. Schellen. *Simplified thermal and hygric building models: A literature review*. In: *Frontiers of Architectural Research*, Vol. 1, No. 4 (2012), pp. 318–325.
- [21] H. Kuchling, ed. *Taschenbuch der Physik: Mit zahlreichen Tabellen*. 19., aktualisierte Aufl. München: Fachbuchverl. Leipzig im Carl-Hanser-Verl., 2007.

- [22] F. Oldewurtel, A. Parisio, C. N. Jones, D. Gyalistras, M. Gwerder, V. Stauch, B. Lehmann, and M. Morari. *Use of model predictive control and weather forecasts for energy efficient building climate control*. In: *Energy and Buildings*, Vol. 45, No. 9 (2012), pp. 15–27.
- [23] F. Oldewurtel, A. Ulbig, A. Parisio, G. Andersson, and M. Morari. *Reducing peak electricity demand in building climate control using real-time pricing and model predictive control*. In: (2010), pp. 1927–1932.
- [24] H. Park, M. Ruellan, A. Bouvet, E. Monmasson, and R. Bennacer. *Thermal parameter identification of simplified building model with electric appliance*. In: *11th International Conference on Electrical Power Quality and Utilisation (EPQU), 2011*. Piscataway, NJ: IEEE, 2011, pp. 1–6.
- [25] J. Široký, F. Oldewurtel, J. Cigler, and S. Prívara. *Experimental analysis of model predictive control for an energy efficient building heating system*. In: *Applied Energy*, Vol. 88, No. 9 (2011), pp. 3079–3087.
- [26] Statusseminar. Forschung für Energieoptimiertes Bauen, ed. *Modellbasierte Betriebsanalyse von Gebäuden - Methoden für die Fehlererkennung und Optimierung im Gebäudebetrieb*. 2009.
- [27] Udo Machauer. *Bauplan_Wärmepumpenhaus*. Ed. by Karlsruher Institut für Technologie. 2017.
- [28] United Nations. *Paris Agreement*. 2015.
- [29] *VDI-Wärmeatlas*. Berlin, Heidelberg: Springer Berlin Heidelberg, 2013.
- [30] J. T. Wen and S. Mishra, eds. *Intelligent Building Control Systems: A Survey of Modern Building Control and Sensing Strategies*. Advances in Industrial Control. Cham: Springer, 2018.
- [31] P. Zwickel, A. Engelmann, L. Groll, V. Hagenmeyer, D. Sauer, and T. Faulwasser. *A Comparison of Economic MPC Formulations for Thermal Building Control*. In: *2019 IEEE PES Innovative Smart Grid Technologies Europe (ISGT-Europe)*. IEEE, 29.09.2019 - 02.10.2019, pp. 1–5.
- [32] ratiotherm Smart Energy Systems, ed. *Technische Daten: Oskar°Wärmepumenspeicher WPS*.

A. Appendix

A.1. First Section

Figure A.1. A figure

...