

Fire statement form

Application information	
1. Site address line 1 Site address line 2	The following buildings at Greenwich Millennium Village, Phases 1 & 2 Maurer Court: Units 1 – 4, 101 – 104, 201 – 204, 301 – 304, 401 – 404, 501 – 502, Maurer Court, Renaissance Walk, Greenwich, London SE10 0SR. Units 5 – 8, 105 – 109, 205 – 209, 305 – 309, 405 – 409, 505 – 509, 605 – 608, 705 – 706, Maurer Court, Mudlarks Boulevard, Greenwich, London SE10 0SZ. Units 10 – 11, 110 – 113, 210 – 213, 310 – 313, 410 – 413, 510 – 512, 610 – 611 Maurer Court, Mudlarks Boulevard, Greenwich, London SE10 0SY. Units 14 – 17, 114 – 119, 214 – 219, 314 – 319, 414 – 419, 514 – 519, 614 – 619, 714 – 717, 814 – 817, 914 – 915, Maurer Court, John Harrison Way, Greenwich, London SE10 0SX. Units 20 – 23, 120 – 123, 220 – 223, 320 – 323, 420 – 423, 520 – 523, 620 – 621, Maurer Court, John Harrison Way, Greenwich, London SE10 0SW. Units 24 – 27, 124 – 127, 224 – 227, 324 – 327, 424 – 427, 524 – 526, 624 – 625, Maurer Court, John Harrison Way, Greenwich, London SE10 0SU. Units 28 – 29, 128 – 130, Maurer Court, Teal Street, Greenwich, London SE10 0ST. Units 131 – 136, 232 – 235, 332 – 335, 432 – 434, Maurer Court, Renaissance Walk, Greenwich, London SE10 0SS. Metcalf Court: Units 1 – 5, Metcalfe Court, Renaissance Walk, Greenwich, London SE10 0BU. Units 6 – 26, Metcalfe Court, Teal Street, Greenwich, London SE10 0BX. Units 27 – 69, Metcalfe Court, John Harrison Way, Greenwich, London SE10 0BY. Units 70 – 127, Metcalfe Court, John Harrison Way, Greenwich, London SE10 0BZ. Units 128 – 168, Metcalfe Court, West Parkside, Greenwich, London SE10 0EL. Faraday Lodge: Units 1 – 11, 101 – 110, 201 – 210, 301 – 309, 401 – 407, 501 – 507, 601 – 607, 701 – 706, Faraday Lodge, Renaissance Walk, Greenwich, London SE10 0QL.

Alamaro Lodge:

Units 1 – 7, 101 – 107, 201 – 207, 301 – 307, 401 – 407, 501 – 506, 601 – 605, Alamaro Lodge, Renaissance Walk, Greenwich, London SE10 0QU.

Da Vinci Lodge:

Units 1 – 20, Da Vinci Lodge, West Parkside, Greenwich, London SE10 0BD.

Newton Lodge:

Units 2 – 47, Newton Lodge, West Parkside, Greenwich, London SE10 0BA.

Holly Court:

Units 2 – 4, 101 – 105, 201 – 205, 301 – 305, 401 – 405, 501 – 504, 601 – 603, Holly Court, West Parkside, Greenwich, London SE10 0BS.

Units 5 – 10, 106 – 111, 206 – 214, 306 – 314, 406 – 414, 506 – 512, 606 – 611, 706 – 708, 806 – 808, Holly Court, John Harrison Way, Greenwich, London SE10 0BL.

Units 116 – 120, 216 – 222, 316 – 322, 416 – 422, 516 – 520, 616 – 618, Holly Court, John Harrison Way, Greenwich, London SE10 0BL.

Units 1, 14 – 17, 123 – 133, 223 – 233, 323 – 333, 434 – 427, Holly Court, Greenroof Way, Greenwich, London SE10 0BP.

Units 11 – 13, Holly Court, School Square, Greenwich, London SE10 0BT.

New Becquerel Court:

Units 89 – 118, Becquerel Court, West Parkside, Greenwich, London SE10 0QA

Becquerel Court:

Units 1 – 40, Becquerel Court, West Parkside, Greenwich, London SE10 0QQ

Units 41 – 64, Becquerel Court, Child Lane, Greenwich, London SE10 0QX

Units 65 – 88, Becquerel Court, School Square, Greenwich, London SE10 0QY

Farnsworth Court:

Units 1 – 29, Farnsworth Court, West Parkside, Greenwich, London SE10 0QF


Units 30 – 55, Farnsworth Court, West Parkside, Greenwich, London SE10 0QG

Units 56 – 70, Farnsworth Court, Osier Lane, Greenwich, London SE10 0RG

Units 71 – 120, Farnsworth Court, West Parkside, Greenwich, London SE10 0RU

Site address line 3	
Town	Greenwich
County	London
Site postcode (optional)	SE10
2. Description of proposed development including any change of use (as stated on the application form):	The proposed project is the remediation to the external walls of the ten blocks following a Fire Risk Appraisal of External Walls (FRAEW) in accordance with the latest fire safety guidance in PAS 9980. The principle of the works is to remove the combustible external wall and attachment (balconies, etc.) materials which contribute to an intolerable risk rating and replace them with materials which have a reaction to fire classification of at least Class A2-s1,d0 in accordance with BS EN 13501-1.
3. Name of person completing the fire statement (as section 15.), relevant qualifications and experience. Guide: no more than 200 words	Author: Name: Austin Coyle Role: Associate (Fire Engineer), Ashton Fire, 5 St Johns Lane, London, EC1M 4BH Qualifications: Bachelor of Science (Honours) Fire Safety Engineering (2009) Experience: 12+ years as a fire engineer Membership of Professional Bodies: - Engineers Ireland – Member (MIEI) - Institute of Fire Engineers – Associate (AIFireE) Approved: Name: Adam Taylor Role: Managing Director, Ashton Fire, 5 St Johns Lane, London, EC1M 4BH Qualifications: - Bachelor of Engineering (Honours) Agricultural Engineering - Master of Science Fire and Explosion Engineering Experience: 22+ years in the fire engineering industry Membership of Professional Bodies: - Chartered Engineer with the Engineering Council (CEng) - Member of the Institute of Fire Engineers (MIFireE) - Professional Member of the Society of Fire Protection Engineers (PMSFPE) - Fellow of the Institute of Healthcare Engineers and Estate Managers (IHEEM)

4. State what, if any, consultation has been undertaken on issues relating to the fire safety of the development; and what account has been taken of this. Guide: no more than 200 words	Ashton Fire have reviewed and provided advice on the initial proposed external wall details from a fire safety perspective and against the recommended remedial works identified as required to achieve a tolerable rating in accordance with PAS 9980 for each of the ten buildings. The scheme has not yet been reviewed by the approving authority, nor received comments from the local fire and rescue service at this stage.
5. Site layout plan with block numbering as per building schedule referred to in 6. (consistent with other plans drawings and information submitted in connection with the application)	
Site layout plan is: inserted in the form	

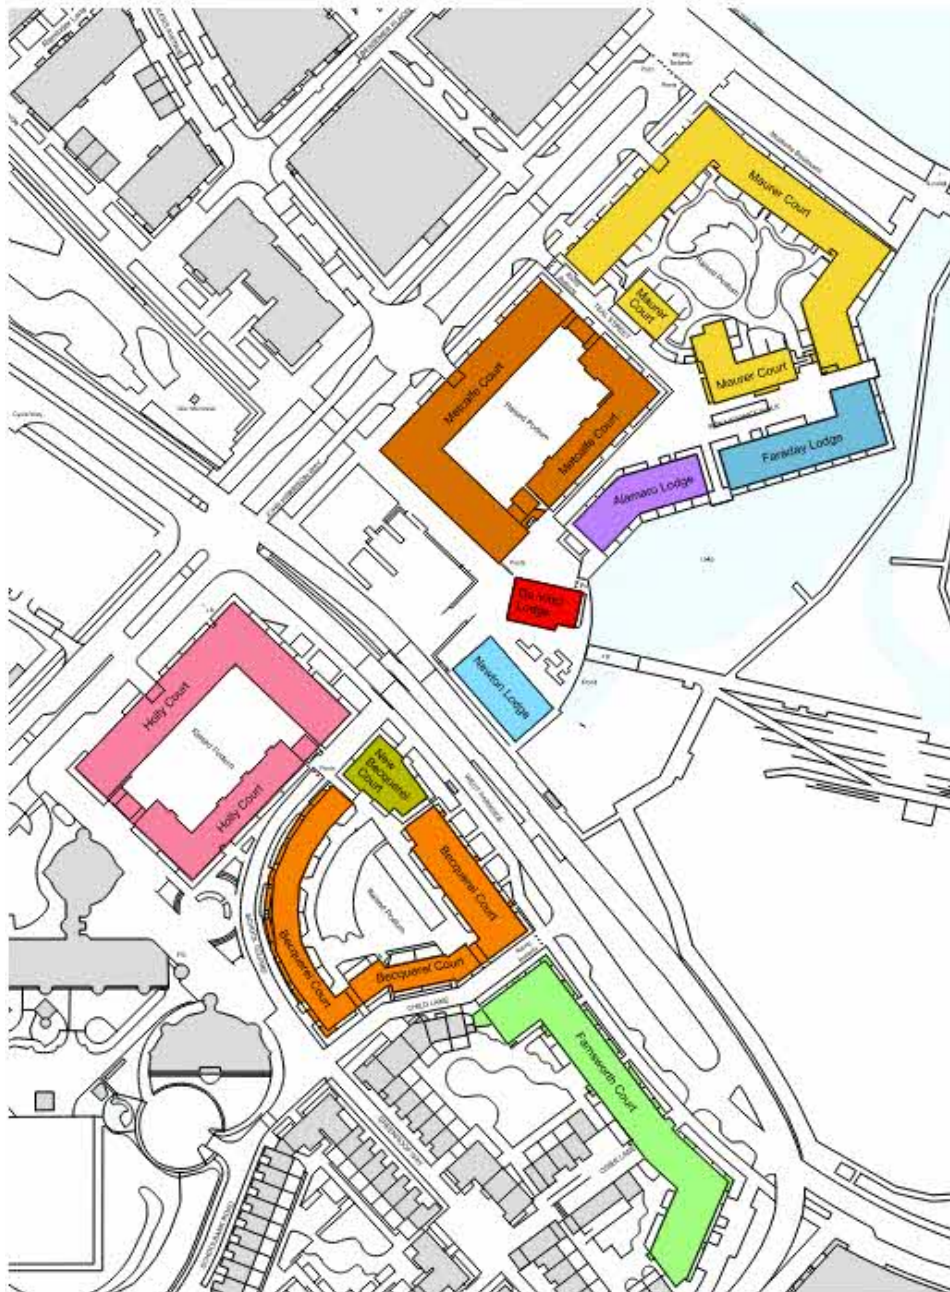

Metcalfe Court

Da Vinci Lodge

Newton Lodge

Alamaro Lodge

Faraday Lodge

Maurer Court

Holly Court

New Becquerel
Court

Becquerel Court

Farnsworth Court

The principles, concepts and approach relating to fire safety that have been applied to the development									
6. Building schedule									
Site information				Building information			Resident safety information		
a) block no. as per site layout plan above	b) block height (m) number of storeys excluding those below ground level number of storeys including those below ground level	c) proposed use (one per line)	d) location of use within block by storey	e) standards relating to fire safety/ approach applied	f) balconies	g) external wall systems	h) approach to evacuation	i) automatic suppression	j) accessible housing provided
Metcalf Court	30.1m 11 storeys ground and above No basement	residential flats, maisonettes, studios	Ground and above	Approved document B vol 1 And PAS 9980:2022	class A2-s1, d0 or better	Existing retained walls will include some materials worse than Class A2- s1,d0. All new materials will be Class A2- s1,d0 or better	stay put	none	Choose an item.
		shop	Ground	Approved document B vol 2	no balconies		simultaneous	none	N/A non resi
		office, research and development	Ground	Approved document B vol 2	no balconies		simultaneous	none	N/A non resi

Da Vinci Lodge	18.5m 7 storeys ground and above No basement	residential flats, maisonettes, studios	Above-ground	Approved document B vol 1 And PAS 9980:2022	class A2-s1, d0 or better	Existing retained walls will include some materials worse than	stay put	none	Choose an item.
		restaurant, cafe, hot food take- away, drinking establishme nt	Ground	Approved document B vol 2	no balconies	Class A2-s1,d0. All new materials will be Class A2-s1,d0 or better	simultaneou s	none	N/A non resi
Newton Lodge	24.3m 9 storeys ground and above No basement	residential flats, maisonettes, studios	Above-ground	Approved document B vol 1 And PAS 9980:2022	class A2-s1, d0 or better	Existing retained walls will include some materials worse than	stay put	none	Choose an item.
		restaurant, cafe, hot food take- away, drinking establishme nt	Ground	Approved document B vol 2	no balconies	Class A2-s1,d0. All new materials will be Class A2-s1,d0 or better	simultaneou s	none	N/A non resi
Alamaro Lodge	22.8m 9 storeys ground, mezzanin e and above	residential flats, maisonettes, studios	All levels	Approved document B vol 1 And PAS 9980:2022	class A2-s1, d0 or better	Existing retained walls will include some materials worse than	stay put	none	Choose an item.

	No basement					Class A2-s1,d0. All new materials will be Class A2-s1,d0 or better			
Faraday Lodge	25.6m 10 storeys ground, mezzanine and above No basement	residential flats, maisonettes, studios	All levels	Approved document B vol 1 And PAS 9980:2022	class A2-s1, d0 or better	Existing retained walls will include some materials worse than Class A2-s1,d0. All new materials will be Class A2-s1,d0 or better	stay put	none	Choose an item.
Maurer Court	25.6m 10 storeys ground and above No basement	residential flats, maisonettes, studios	All levels	Approved document B vol 1 And PAS 9980:2022	class A2-s1, d0 or better	Existing retained walls will include some materials worse than Class A2-s1,d0. All new materials will be Class A2-s1,d0 or better	stay put	none	Choose an item.

Holly Court	25.9m Block A: 9 storeys ground and above Block B: 6 storeys ground and above No basement	residential flats, maisonettes, studios	All levels	Approved document B vol 1 And PAS 9980:2022	class A2-s1, d0 or better	Existing retained walls will include some materials worse than Class A2- s1,d0. All new materials will be Class A2- s1,d0 or better	stay put	none	Choose an item.
New Becquerel Court	20.1m 8 storeys ground and above No basement	residential flats, maisonettes, studios	All levels	Approved document B vol 1 And PAS 9980:2022	class A2-s1, d0 or better	Existing retained walls will include some materials worse than Class A2- s1,d0. All new materials will be Class A2- s1,d0 or better	stay put	none	Choose an item.
Becquerel Court	22.8m 8 storeys ground and above No basement	residential flats, maisonettes, studios	All levels	Approved document B vol 1 And PAS 9980:2022	class A2-s1, d0 or better	Existing retained walls will include some materials worse than	stay put	none	Choose an item.

						Class A2-s1,d0. All new materials will be Class A2-s1,d0 or better			
Farnsworth Court	20.0m 9 storeys ground and above No basement	residential flats, maisonettes, studios	All levels	Approved document B vol 1 And PAS 9980:2022	class A2-s1, d0 or better	Existing retained walls will include some materials worse than Class A2-s1,d0. All new materials will be Class A2-s1,d0 or better	stay put	none	Choose an item.

7. Specific technical complexities

Explain any specific technical complexities in terms of fire safety (for example green walls) and/or departures from information in building schedule above

Guide: no more than 500 words

This project and planning fire statement is for remedial works to the external walls of the buildings that make up the existing, completed Greenwich Millennium Village Phases 1 & 2 development. The remedial works have been recommended following the creation of a Fire Risk Appraisal of External Walls (FRAEW) report for the buildings.

The fire safety guidance document used for this type of assessment is PAS 9980:2022. This risk appraisal serves to establish a risk rating for the building and in particular the external walls. Where deemed to be 'intolerable', the fire engineer recommends the remedial works they consider necessary in order to achieve a rating of 'tolerable'.

We have undertaken this process on all ten buildings that comprise this development and found their rating to be 'Medium – Intolerable'. As such, we have recommended the remedial works we consider necessary in order for the buildings to be considered tolerable in accordance with the guidance set out in PAS 9980.

The remedial works to achieve a tolerable level of safety are not intended to remove all combustible materials from external walls but those required in the opinion of the fire engineer to achieve a tolerable level of safety. Typical remedial works include the removal of combustible cladding materials, insulation and ill-fitting cavity barriers. These are to be replaced with materials achieving a reaction to fire classification of at least Class A2-s1,d0 in accordance with BS EN 13501-1. There are some exceptions (as per Regulation 7 (3), e.g. membranes, which Approved Document B Volume 1 recommends Class B-s3,d0.

8. Issues which might affect the fire safety of the development

Explain how any issues which might affect the fire safety of the development have been addressed.

Guide: no more than 500 words

All ten buildings are existing. Their ongoing management and maintenance is carried out in accordance with the Regulatory Reform (Fire Safety) Order 2005.

Their internal arrangement will not be altered as part of the proposed works to the external walls so the fire strategy will remain unchanged post completion of the works.

Each individual buildings' (or block / core of that building) fire strategy comprises single escape stairs which are accessed from the unit entry doors via protected corridors with a means of smoke ventilation (mechanical or natural). This is as would be expected for these buildings at the time of their construction.

They do not have an automatic fire suppression as they were not a recommendation in the fire safety guidance at the time of construction.

The proposed works to the external walls of the buildings will have a significant positive effect on the likelihood and consequence of external fire spread given the inherent fire resistant properties of the new materials to be used, i.e. Class A2-s1,d0 or better.

Fire service access and facilities outside and inside the buildings will remain unchanged from the existing condition.

9. Local development document policies relating to fire safety

Explain how any policies relating to fire safety in relevant local development documents have been taken into account.

Guide: no more than 500 words

Inclusion of evacuation lifts in accordance with Policy D5 of the London Plan has not been considered a reasonable or viable option as part of the remedial works to the external walls of the building.

In accordance with Policy D12 of the London Plan, an outline fire strategy report will be produced to support the full planning application by qualified engineers with relevant experience of residential buildings.

Emergency road vehicle access and water supplies for firefighting purposes

10. Fire service site plan

Explanation of fire service site plan(s) provided in 14. including what guidance documents have informed the proposed arrangements for fire service access and facilities?

Guide: no more than 200 words

The development and the public and site service roads that serve it are all existing and will remain unchanged by the proposed remedial works to the external walls of the buildings.

A full fire service access and facilities plan will be provided in the outline fire strategy produced for the full planning application fire statement.

11. Emergency road vehicle access

Specify emergency road vehicle access to the site entrances indicated on the site plan

Guide: no more than 200 words

An emergency vehicle site plan will be provided to support the full planning application.

Is the emergency vehicle tracking route within the site to the siting points for appliances clear and unobstructed?

yes

12. Siting of fire appliances

Guide: no more than 200 words

Fire service access will be via the existing public highways and private site access roads. Fire Service Access is provided to each of the residential cores from either the public highways or the private site access roads.

A full fire service access and facilities plan will be provided in the outline fire strategy produced for the full planning application fire statement.

13. Suitability of water supply for the scale of development proposed

Guide: no more than 200 words

All buildings are served by a combination of existing fire hydrants along the public highways and located along the private site access roads, which are accessible by fire service appliances.

Nature of water supply: hydrant- public


Does the proposed development rely on existing hydrants and if so are they currently usable / operable?
yes

14. Fire service site plan

Fire service site plan is:

inserted in the form

Fire statement completed by



15. Signature

16. Date

12/09/2024