

REVISION	DESCRIPTION	BY	DATE
0	ISSUE FOR CONSTRUCTION		09/06/13
1	PRE-BID CLARIFICATION		11/08/13
2	CONTRACTOR QUESTION		10/30/14


#### GENERAL NOTES:

1. SEE DETAILS FOR ADDITIONAL PIPING SPECIALTIES REQUIRED AT EQUIPMENT.


MECHANICAL AND ELECTRICAL ENGINEERING CONSULTANT:




MEP CONSULTANTS  
20251 CENTURY BLVD #125  
GERMANTOWN, MD 20874  
P: 877-871-4229  
F: 301-560-6336  
JFORD@CFRENGINEERING.COM  
PROJECT #12074

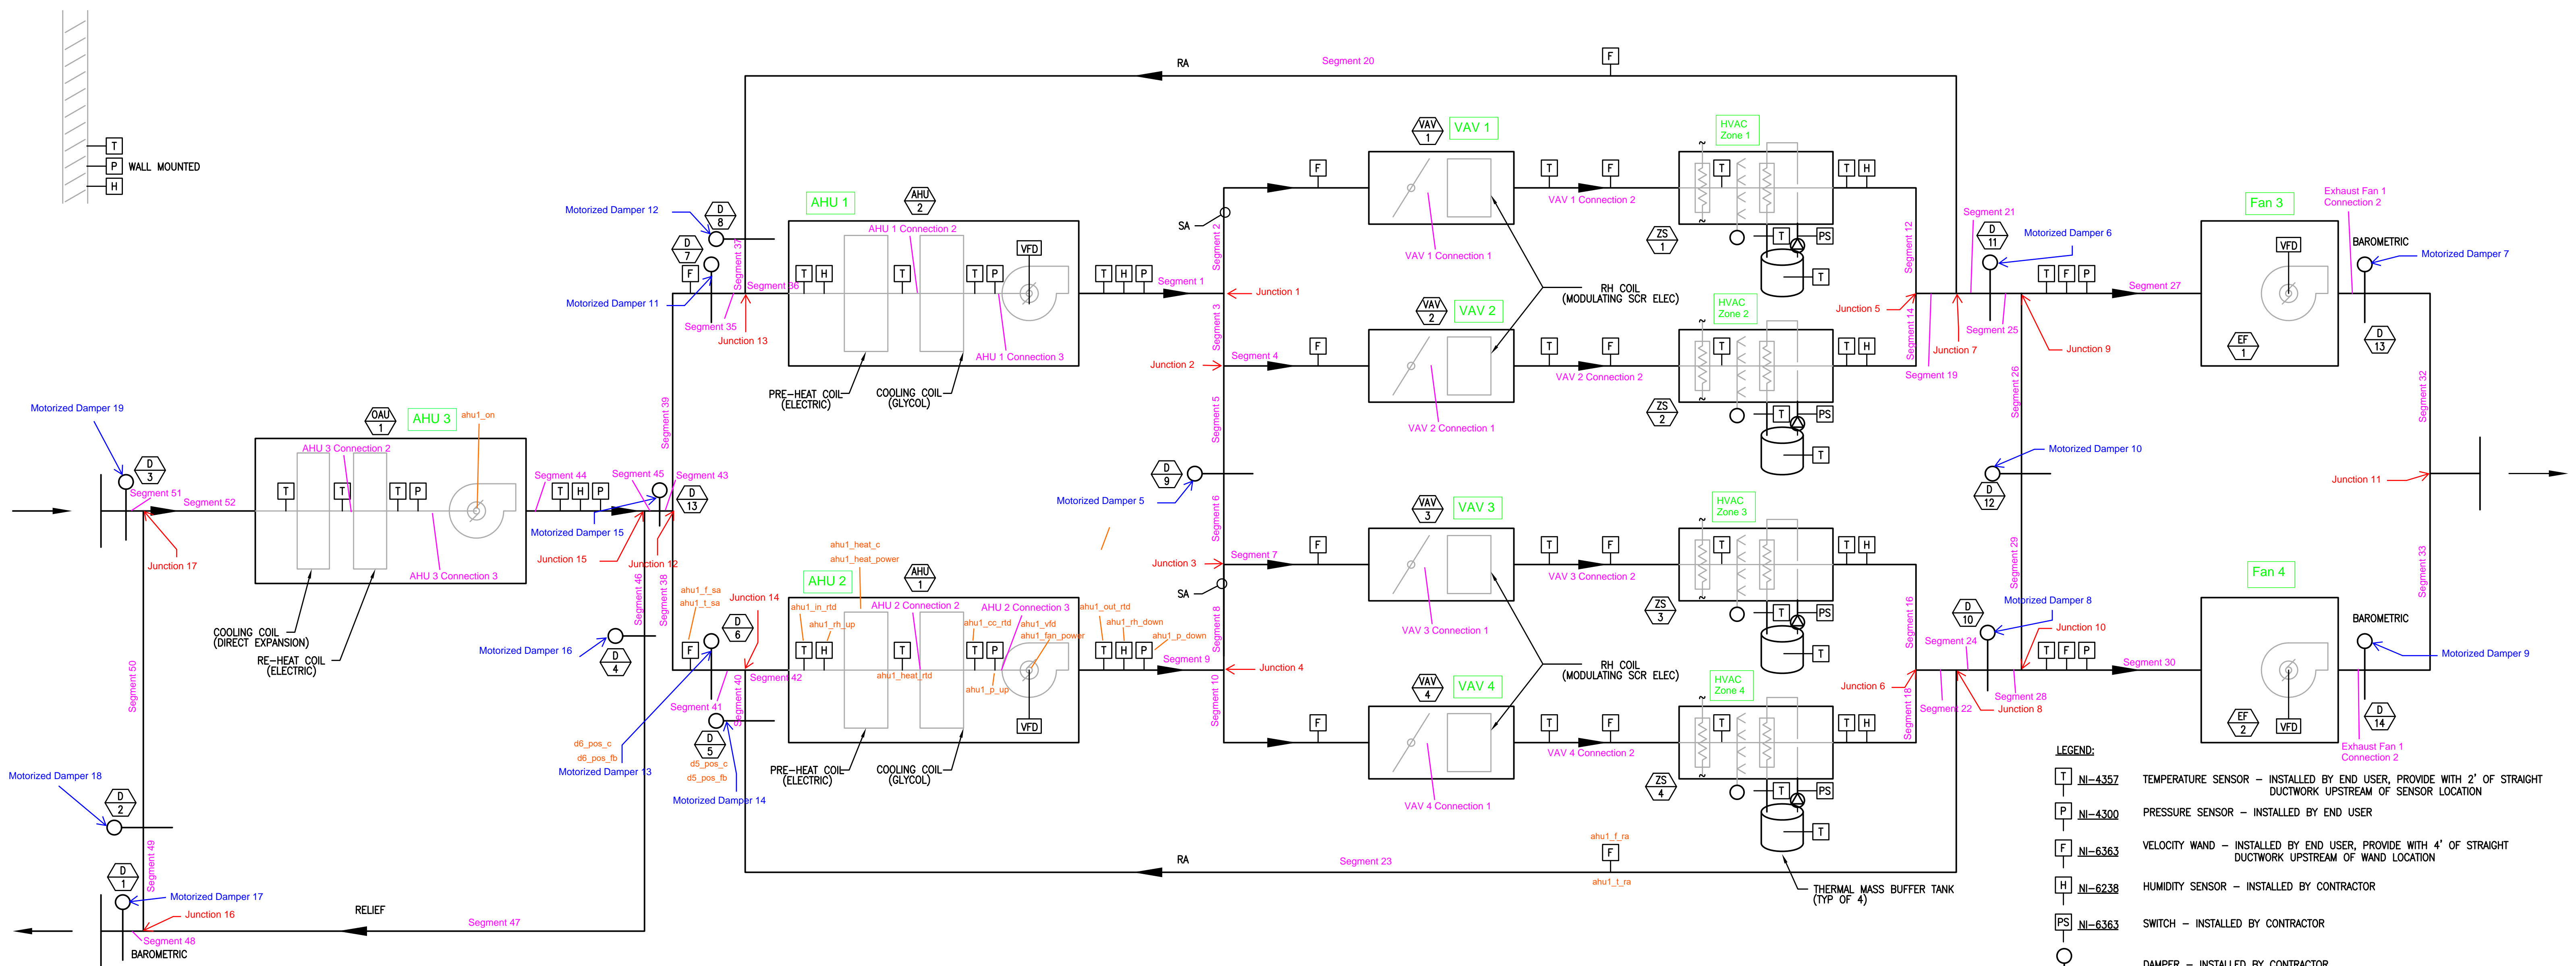

**AIRFLOW DIAGRAM**  
NOT TO SCALE

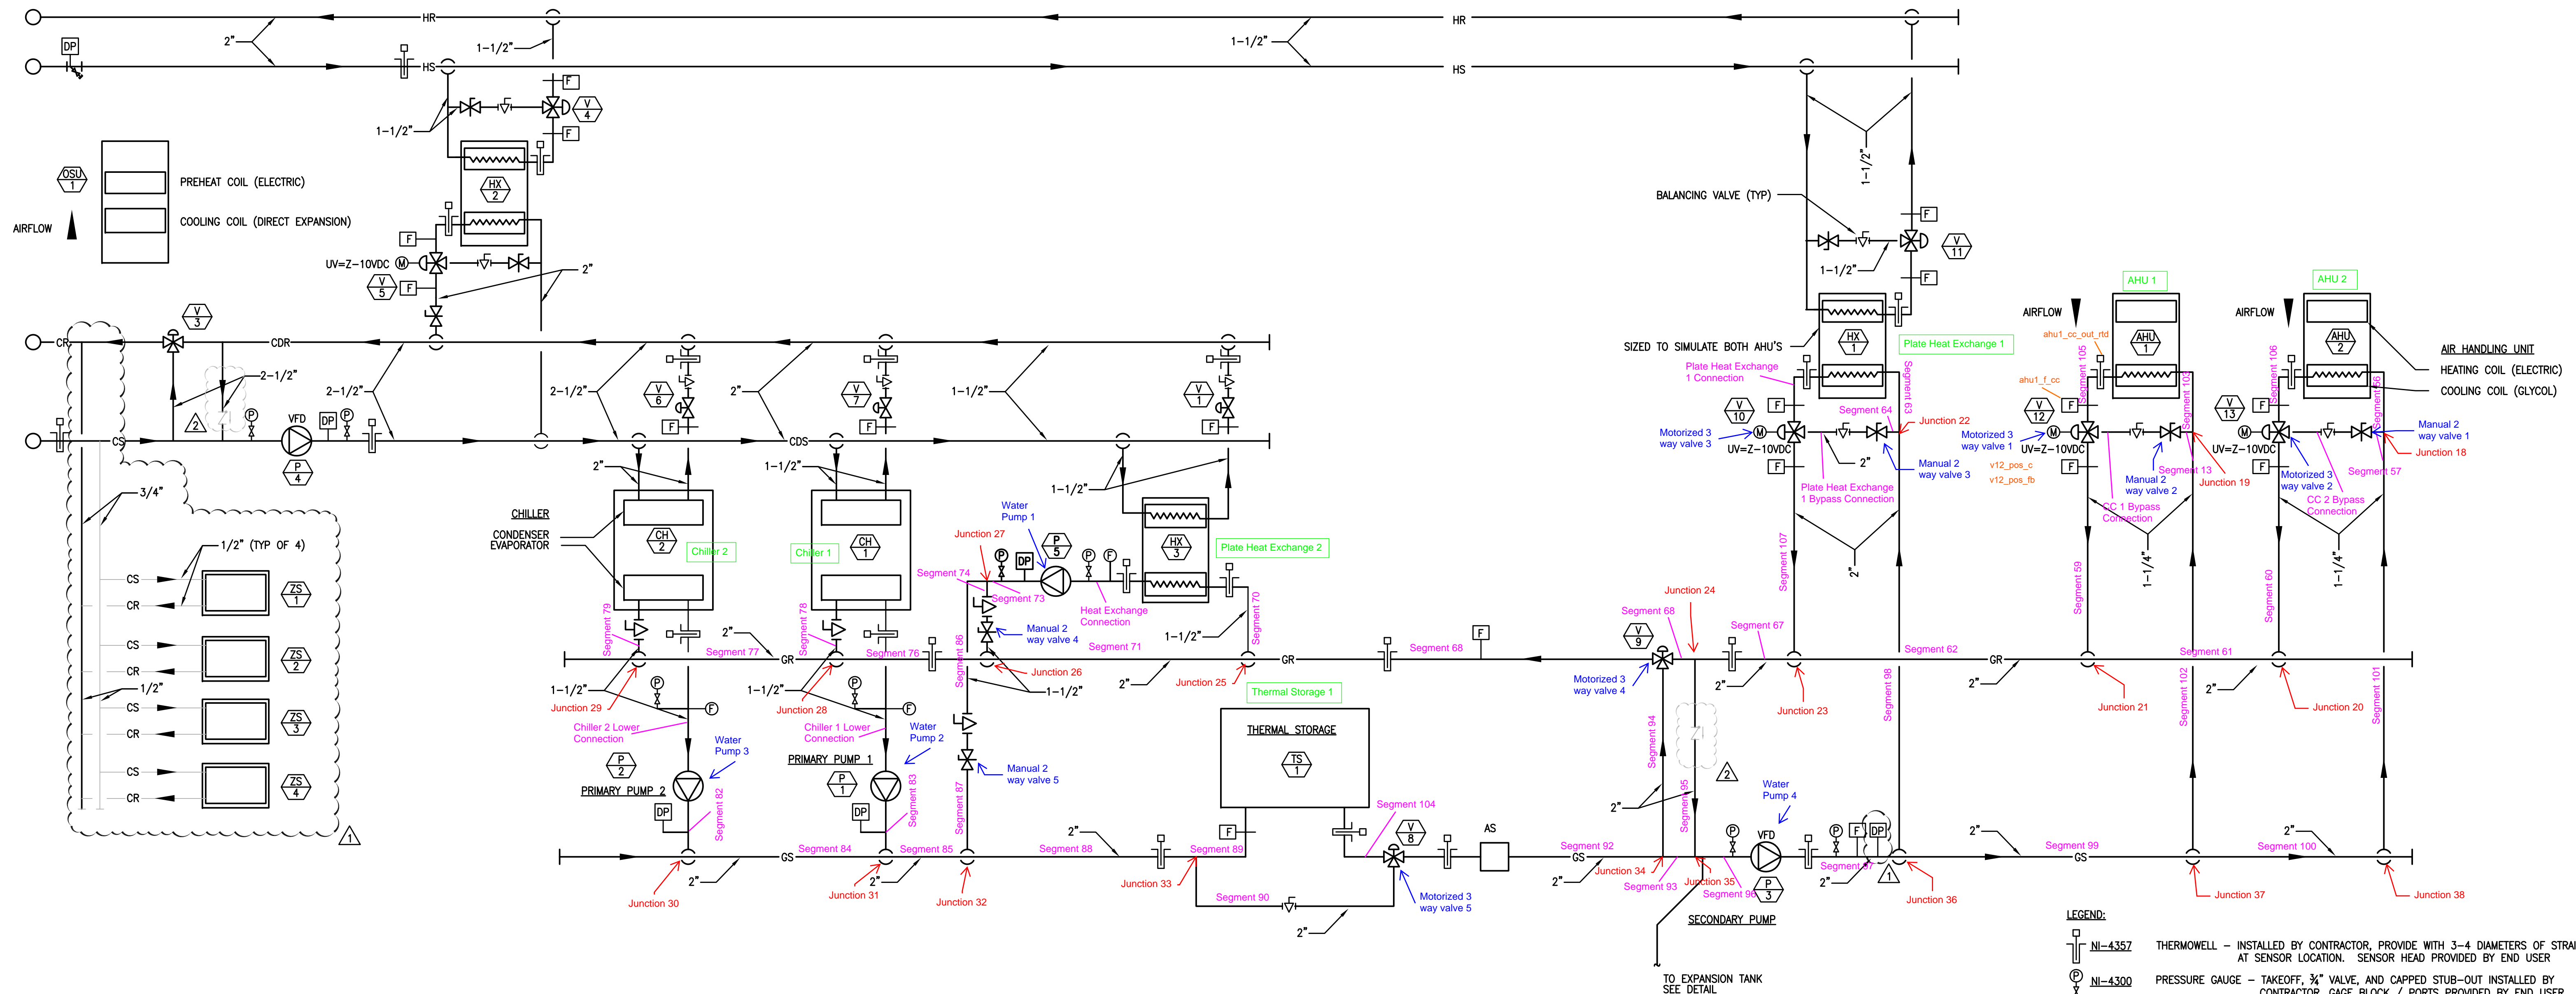

**HYDRONIC DIAGRAM**  
NOT TO SCALE

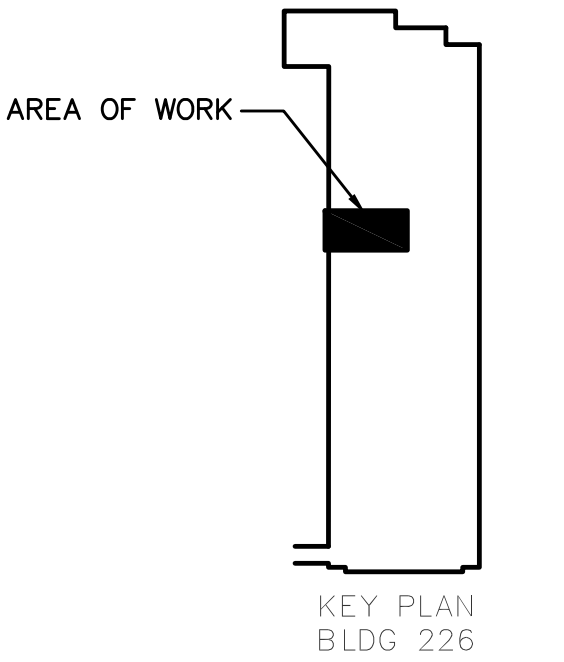

1/4" = 1'-0"



U.S. DEPARTMENT OF COMMERCE  
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY  
PLANT DIVISION

BUILDING 226 - ROOM A122 HVAC TESTING LAB

MECHANICAL SYSTEM DIAGRAMS

SH.NO. 13 OF 16 DWG. 226-372

APPROVED BY	DATE	SPONSOR	DATE	FIRE PROTECTION SYS	DATE	O.H. & S. DIV.	DATE	PLANNING & ENGR. OFF.	DATE	PROJECT ENGR	DATE	JAF	09.06.2013	5597	DP# N/A
												DRN BY	DATE	PROJECT NO.	DESIGN PROJ. #