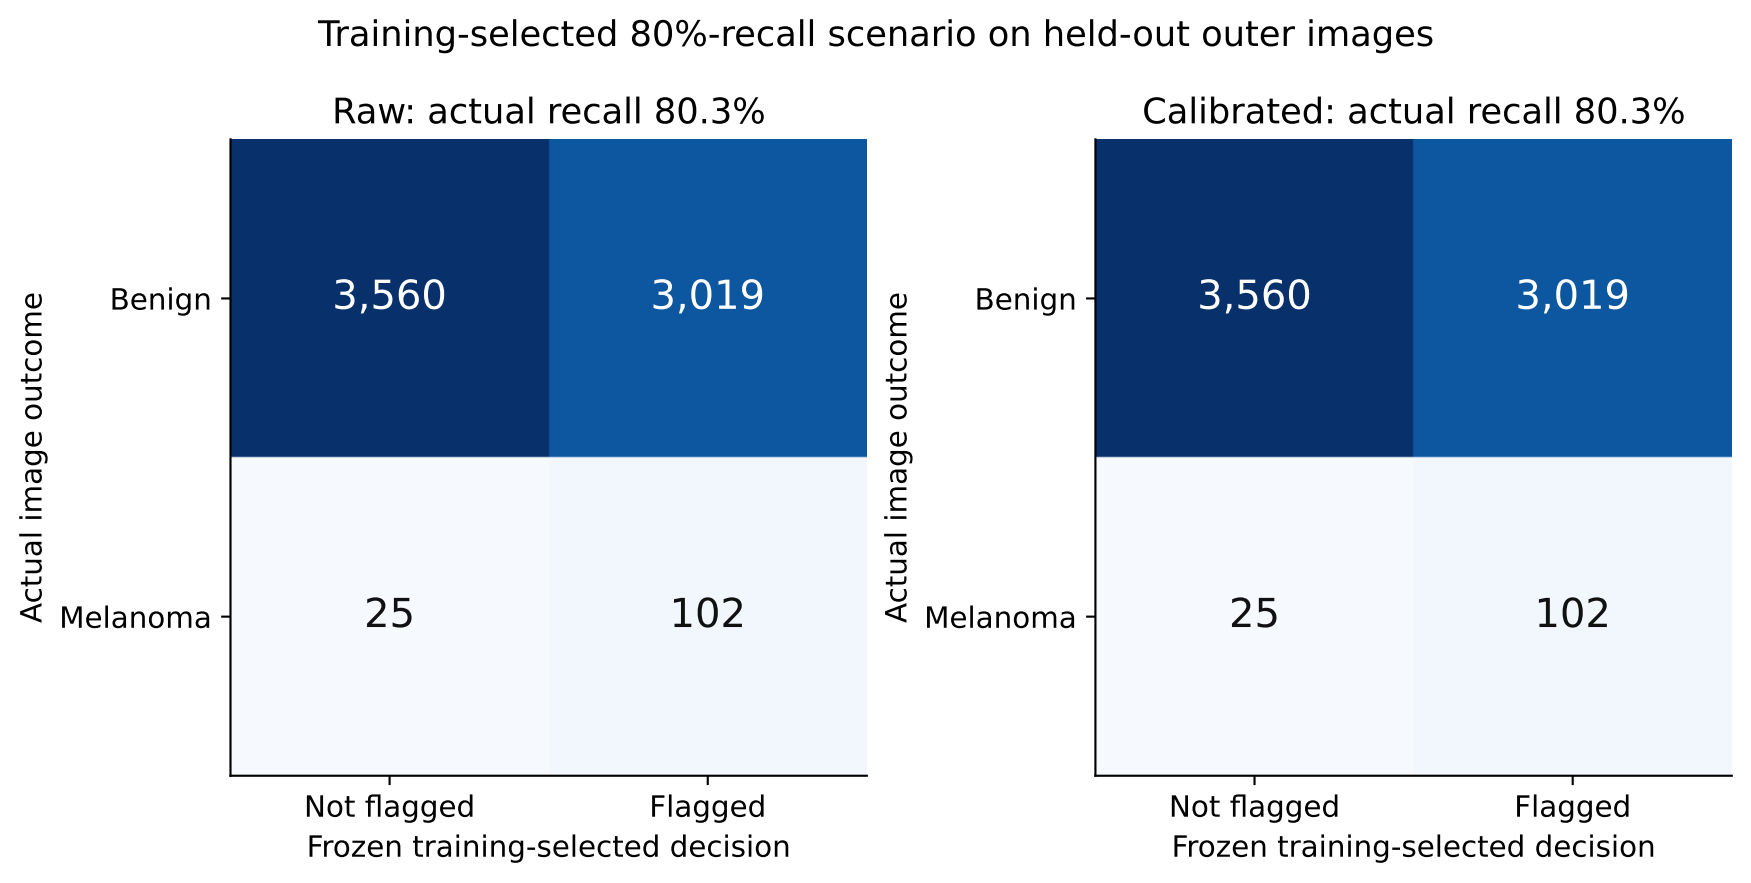
Training-selected 80%-recall scenario on held-out outer images
Raw: actual recall 80.3%
Calibrated: actual recall 80.3%
Actual image outcome
Benign
Melanoma
3,560
3,019
25
102
Not flagged
Flagged
Frozen training-selected decision