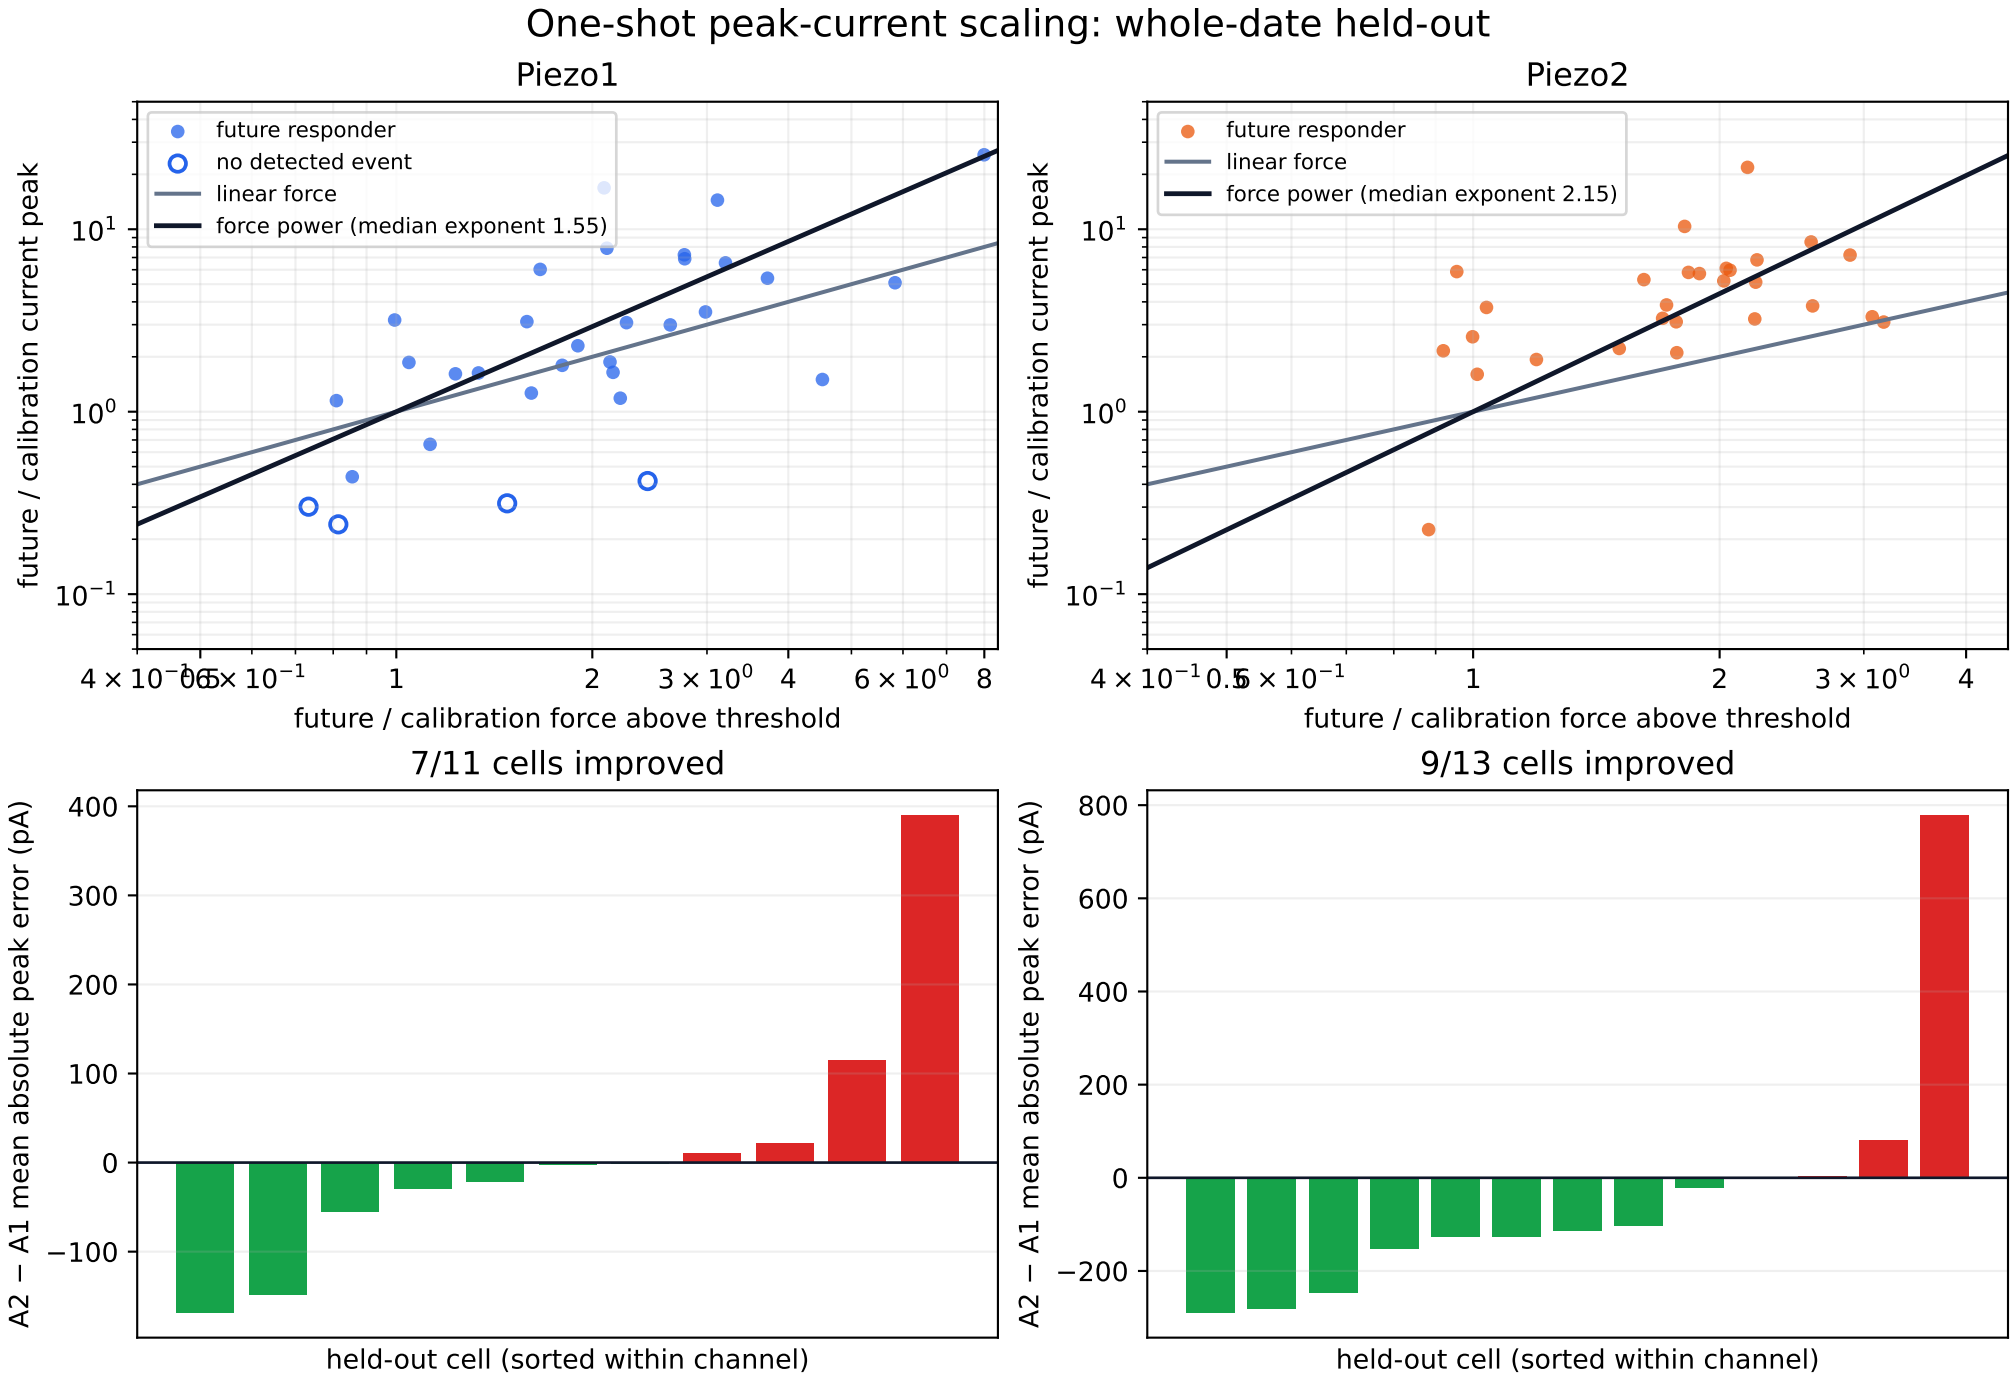
One-shot peak-current scaling: whole-date held-out
Piezo1
Piezo2
future responder
no detected event
linear force
force power (median exponent 1.55)
force power (median exponent 2.15)
future / calibration current peak
future / calibration force above threshold
7/11 cells improved
9/13 cells improved
A2 − A1 mean absolute peak error (pA)
held-out cell (sorted within channel)