



# MDS-UPDRS TREMOR RAPORU (Skor: 0)

## 1. Titreşim Zaman Serisi

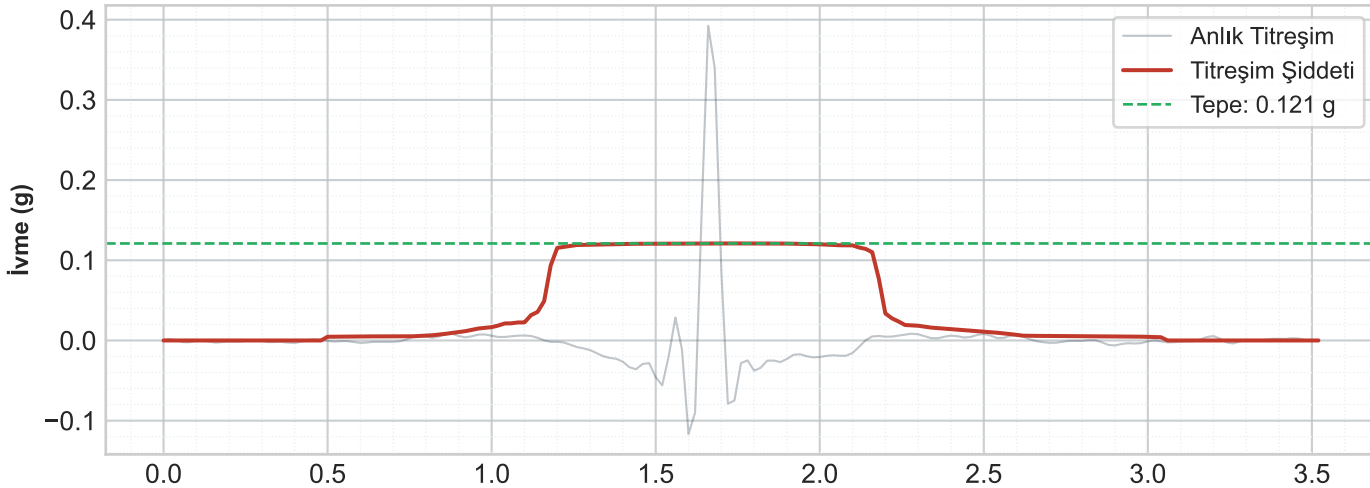

## 2. Frekans Analizi

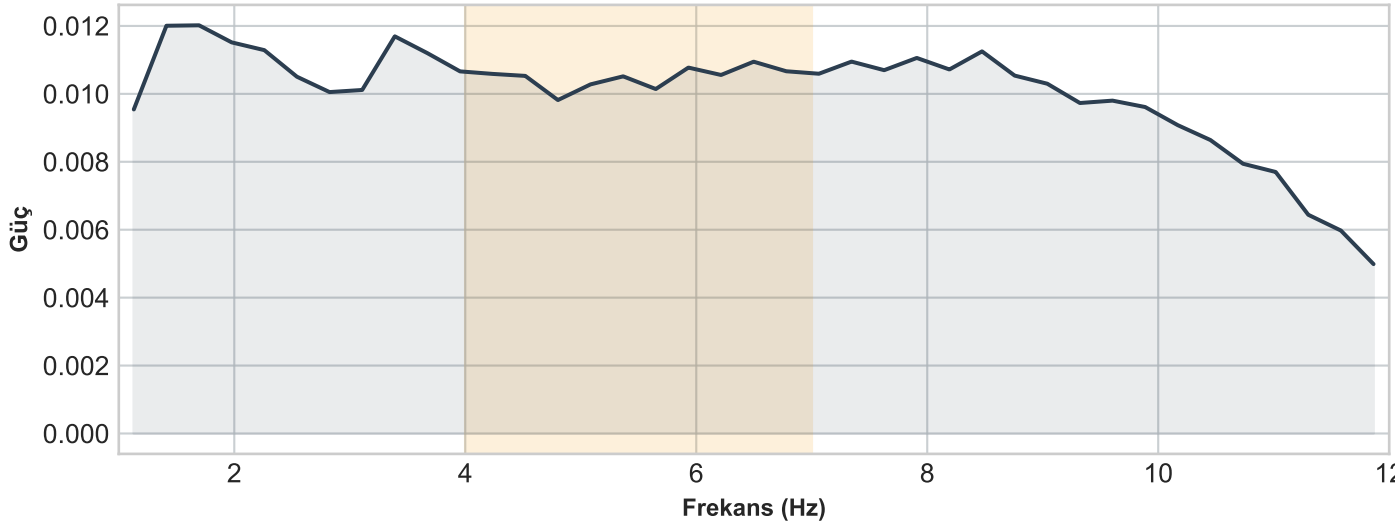

TIBBİ TANI: NORMAL - İstemli Hareket (1.7 Hz)

## PERFORMANS KARNESİ


BASKIN FREKANS: 1.7 Hz

DURGUNLUK



%19

TİTREME ŞİDDETİ



%40