

-  Controller Simulated_IO
-  Controller Fault Handler
-  Power-Up Handler

Tasks

-  MainTask
 -  MainProgram
 -  MainRoutine
-  Unscheduled

Motion Groups

-  Ungrouped Axes

Add-On Instructions

-  CONVEYOR
 - Subscribe
-  Logic

Data Types

-  User-Defined
-  Strings
-  Add-On-Defined
 -  CONVEYOR
 - Subscribe
-  Module-Defined
 -  AB:1756_MODULE:C:0
 -  AB:1756_MODULE_DINT_4Bytes:O:0
 -  AB:1756_MODULE_DINT_8Bytes:I:0

Trends


I/O Configuration

-  1756 Backplane, 1756-A4
 -  [2] Emulate 5570 Simulated_IO
 -  [3] 1756-MODULE Simulat_IO

Name	Value	Data Type	Scope
BELT_CONV		CONVEYOR	Simulated_IO
Subscribe			
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>BELT_CONV - MainProgram/MainRoutine - *0(CONVEYOR)</i>			
BELT_CONV.EnableIn	1	BOOL	
Subscribe Enable Input - System Defined Parameter			
BELT_CONV.EnableOut	0	BOOL	
Subscribe Enable Output - System Defined Parameter			
BELT_CONV.LOC	0	BOOL	
Subscribe			
BELT_CONV.REM	0	BOOL	
Subscribe			
BELT_CONV.STRT	0	BOOL	
Subscribe			
BELT_CONV.STOP	0	BOOL	
Subscribe			
BELT_CONV.ESD	0	BOOL	
Subscribe			
BELT_CONV.JOG	0	BOOL	
Subscribe			
BELT_CONV.RDY	0	BOOL	
Subscribe			
BELT_CONV.RUN	0	BOOL	
Subscribe			
BELT_CONV.FB	0	BOOL	
Subscribe			
BELT_CONV.OL	0	BOOL	
Subscribe			
BELT_CONV.TOL	0	BOOL	
Subscribe			
BELT_CONV.CBK_TRIP	0	BOOL	
Subscribe			
BELT_CONV.FLT	0	BOOL	
Subscribe			
BELT_CONV.RUN_CMD	0	BOOL	
Subscribe			
BELT_CONV.RUN_DLY	0	DINT	
Subscribe			
BELT_CONV.SPD_DLY	0	DINT	
Subscribe			
BELT_CONV.RP_SW	0	BOOL	
Subscribe			
BELT_CONV.DF_SW	0	BOOL	
Subscribe			
BELT_CONV.SPD_SW	0	BOOL	
Subscribe			
BELT_CONV.RST	0	BOOL	
Subscribe			
BELT_CONV.RUN_SEC	0	DINT	
Subscribe			
BELT_CONV.ALM_ROPE	0	BOOL	
Subscribe			
BELT_CONV.ALM_DRIFT	0	BOOL	
Subscribe			
BELT_CONV.ALM_ESD	0	BOOL	
Subscribe			
BELT_CONV.ALM_LOAD	0	BOOL	
Subscribe			
BELT_CONV.FB_LOSS	0	BOOL	
Subscribe			
BELT_CONV.BK_TRIP	0	BOOL	
Subscribe			
BELT_CONV.ALM_THERM	0	BOOL	
Subscribe			
BELT_CONV.ALM_SPEED	0	BOOL	

BELT_CONV (Continued)			
Subscribe			
 DRIFT_SW	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>DRIFT_SW - MainProgram/MainRoutine - 0(CONVEYOR)</i>			
 E_STOP	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>E_STOP - MainProgram/MainRoutine - 0(CONVEYOR)</i>			
 FB_RUN	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>FB_RUN - MainProgram/MainRoutine - *0(CONVEYOR)</i>			
 JOGGING	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>JOGGING - MainProgram/MainRoutine - 0(CONVEYOR)</i>			
 LOCAL	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>LOCAL - MainProgram/MainRoutine - 0(CONVEYOR)</i>			
 Output_En	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>Output_En - MainProgram/MainRoutine - *0(CONVEYOR)</i>			
 OVERLOAD	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>OVERLOAD - MainProgram/MainRoutine - 0(CONVEYOR)</i>			
 REMOTE	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>REMOTE - MainProgram/MainRoutine - 0(CONVEYOR)</i>			
 RESET	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>RESET - MainProgram/MainRoutine - 0(CONVEYOR)</i>			
 ROPE_SW	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>ROPE_SW - MainProgram/MainRoutine - 0(CONVEYOR)</i>			
 SPEED_SW	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>SPEED_SW - MainProgram/MainRoutine - 0(CONVEYOR)</i>			

 START_PB	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>START_PB - MainProgram/MainRoutine - 0(CONVEYOR)</i>			
 STOP_PB	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>STOP_PB - MainProgram/MainRoutine - 0(CONVEYOR)</i>			
 THERM	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>THERM - MainProgram/MainRoutine - 0(CONVEYOR)</i>			
 TRIPPED	0	BOOL	Simulated_IO
Constant	No		
External Access:	Read/Write		
OPC UA Access:	None		
<i>TRIPPED - MainProgram/MainRoutine - 0(CONVEYOR)</i>			

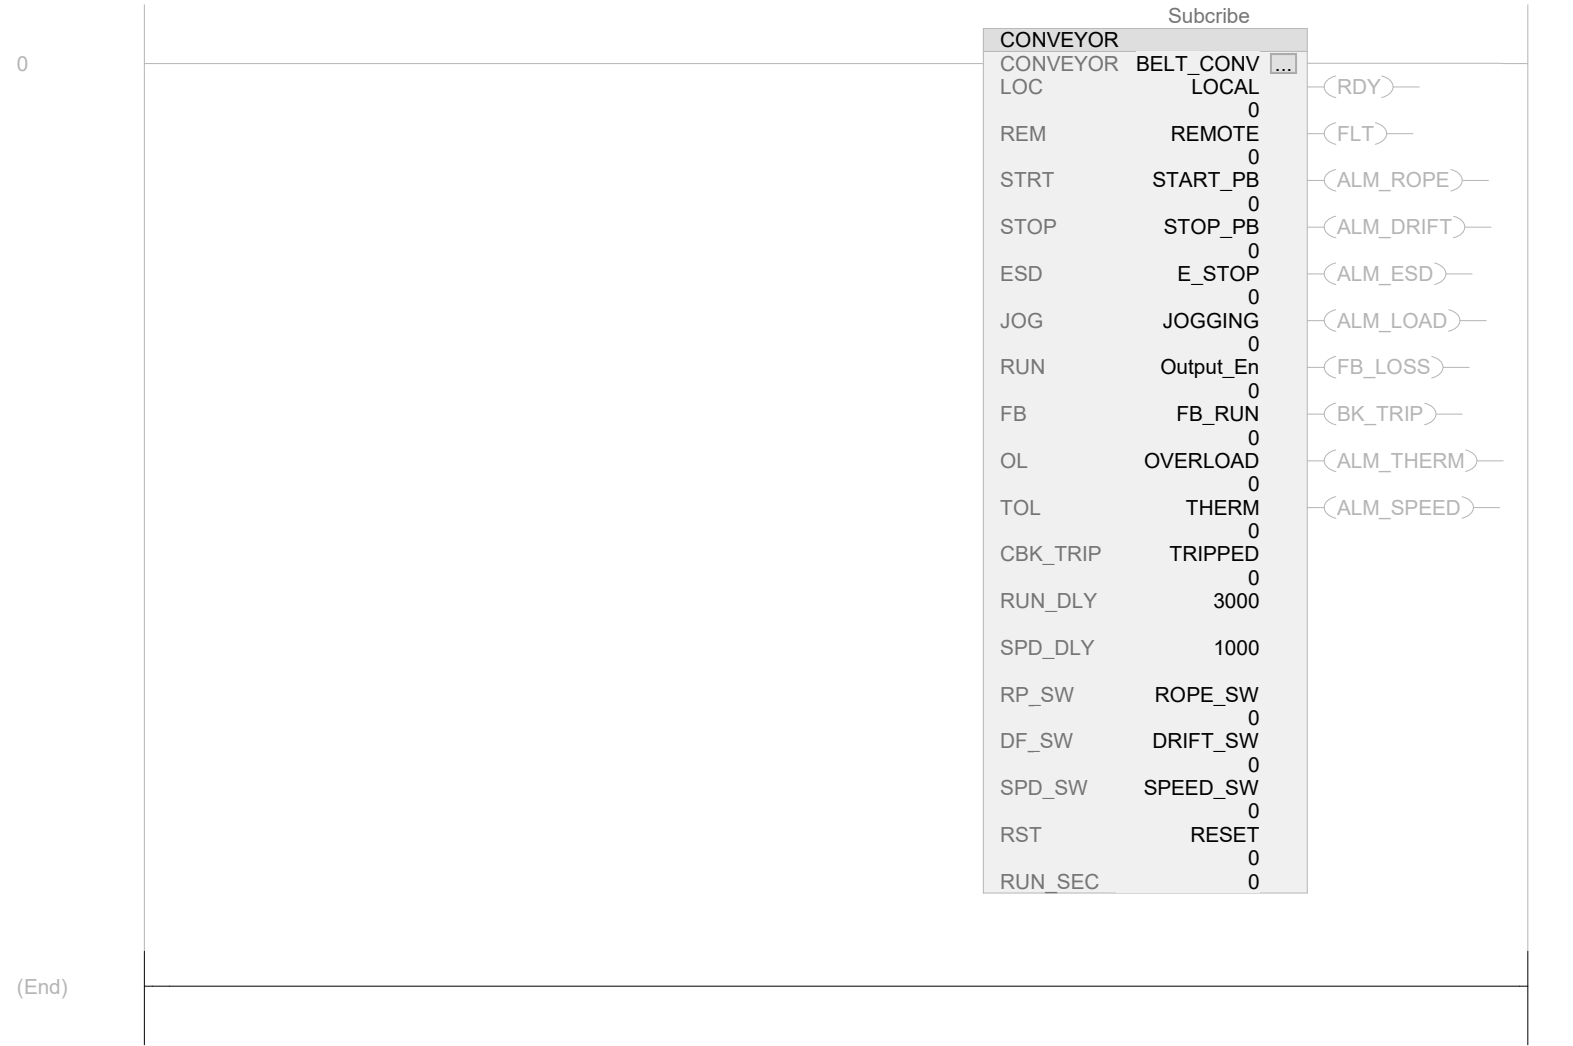

Signature Listing

 CONVEYOR v1.0

2WRTECH

Subscribe

Available Languages

 Relay Ladder

CONVEYOR		
Subscribe		
CONVEYOR	?	...
LOC	?	(RDY)
REM	?	(FLT)
STRT	?	(ALM_ROPE)
STOP	?	(ALM_DRIFT)
ESD	?	(ALM_ESD)
JOG	?	(ALM_LOAD)
RUN	?	(FB_LOSS)
FB	?	(BK_TRIP)
OL	?	(ALM_THERM)
TOL	?	(ALM_SPEED)
CBK_TRIP	?	
RUN_DLY	?	
	??	
SPD_DLY	?	
	??	
RP_SW	?	
DF_SW	?	
SPD_SW	?	
RST	?	
RUN_SEC	?	

 Function Block

CONVEYOR		
Subscribe		
LOC	RDY	
REM	RUN	
STRT	FB	
STOP	FLT	
ESD	ALM_ROPE	
JOG	ALM_DRIFT	
OL	ALM_ESD	
TOL	ALM_LOAD	
CBK_TRIP	FB_LOSS	
RUN_DLY	BK_TRIP	
SPD_DLY	ALM_THERM	
RP_SW	ALM_SPEED	
DF_SW		
SPD_SW		
RST		
RUN_SEC		

 Structured Text

CONVEYOR(LOC, REM, STRT, STOP, ESD, JOG, RUN, FB, OL, TOL, CBK_TRIP, RUN_DLY, SPD_DLY, RP_SW, DF_SW, SPD_SW, RST);

Parameters

Required	Name	Data Type	Usage	Description
X	CONVEYOR	CONVEYOR	InOut	Subscribe

	EnableIn	BOOL	Input
	EnableOut	BOOL	Output
X	LOC	BOOL	Input
X	REM	BOOL	Input
X	STRT	BOOL	Input
X	STOP	BOOL	Input
X	ESD	BOOL	Input
X	JOG	BOOL	Input
	RDY	BOOL	Output
X	RUN	BOOL	Output
X	FB	BOOL	Output
X	OL	BOOL	Input
X	TOL	BOOL	Input
X	CBK_TRIP	BOOL	Input
	FLT	BOOL	Output
	RUN_CMD	BOOL	Output
X	RUN_DLY	DINT	Input
X	SPD_DLY	DINT	Input
X	RP_SW	BOOL	Input
X	DF_SW	BOOL	Input
X	SPD_SW	BOOL	Input
X	RST	BOOL	Input
	RUN_SEC	DINT	Input
	ALM_ROPE	BOOL	Output
	ALM_DRIFT	BOOL	Output
	ALM_ESD	BOOL	Output
	ALM_LOAD	BOOL	Output
	FB_LOSS	BOOL	Output
	BK_TRIP	BOOL	Output
	ALM_THERM	BOOL	Output
	ALM_SPEED	BOOL	Output

Extended Description

Here is the description

Execution

Condition	Description
EnableIn is true	

Revision v1.0 Notes


Name	Default	Data Type	Scope
ALM_DRIFT Usage: Output Parameter Required: No Visible: Yes External Access: Read/Write OPC UA Access: None <i>ALM_DRIFT - CONVEYOR/Logic - *17(OTL), *18(OTU)</i>	0	BOOL	CONVEYOR
ALM_ESD Usage: Output Parameter Required: No Visible: Yes External Access: Read Only OPC UA Access: None <i>ALM_ESD - CONVEYOR/Logic - *13(OTL), *14(OTU)</i>	0	BOOL	CONVEYOR
ALM_LOAD Usage: Output Parameter Required: No Visible: Yes External Access: Read Only OPC UA Access: None <i>ALM_LOAD - CONVEYOR/Logic - *7(OTL), *8(OTU)</i>	0	BOOL	CONVEYOR
ALM_ROPE Usage: Output Parameter Required: No Visible: Yes External Access: Read Only OPC UA Access: None <i>ALM_ROPE - CONVEYOR/Logic - *19(OTL), *20(OTU)</i>	0	BOOL	CONVEYOR
ALM_SPEED Usage: Output Parameter Required: No Visible: Yes External Access: Read/Write OPC UA Access: None <i>ALM_SPEED - CONVEYOR/Logic - *10(OTU), *9(OTL)</i>	0	BOOL	CONVEYOR
ALM_THERM Usage: Output Parameter Required: No Visible: Yes External Access: Read Only OPC UA Access: None <i>ALM_THERM - CONVEYOR/Logic - *15(OTL), *16(OTU)</i>	0	BOOL	CONVEYOR
BK_TRIP Usage: Output Parameter Required: No Visible: Yes External Access: Read Only OPC UA Access: None <i>BK_TRIP - CONVEYOR/Logic - *11(OTL), *12(OTU)</i>	0	BOOL	CONVEYOR
CBK_TRIP Usage: Input Parameter Required: Yes Visible: Yes External Access: Read Only OPC UA Access: None <i>CBK_TRIP - CONVEYOR/Logic - 0(XIO), 11(XIC), 12(XIO)</i>	0	BOOL	CONVEYOR
DF_SW Usage: Input Parameter	0	BOOL	CONVEYOR


DF_SW (Continued)			
Required:	Yes		
Visible:	Yes		
External Access:	Read/Write		
OPC UA Access:	None		
DF_SW - CONVEYOR/Logic - 0(XIO), 17(XIC), 18(XIO)			
ESD	0	BOOL	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read Only		
OPC UA Access:	None		
ESD - CONVEYOR/Logic - 0(XIO), 13(XIC), 14(XIO)			
FB	0	BOOL	CONVEYOR
Usage:	Output Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read Only		
OPC UA Access:	None		
FB - CONVEYOR/Logic - *4(OTE), 5(XIO), 6(XIC)			
FB_LOSS	0	BOOL	CONVEYOR
Usage:	Output Parameter		
Required:	No		
Visible:	Yes		
External Access:	Read Only		
OPC UA Access:	None		
FB_LOSS - CONVEYOR/Logic - *5(OTL), *6(OTU)			
FLT	0	BOOL	CONVEYOR
Usage:	Output Parameter		
Required:	No		
Visible:	Yes		
External Access:	Read Only		
OPC UA Access:	None		
FLT - CONVEYOR/Logic - *11(OTL), *13(OTL), *15(OTL), *17(OTL), *19(OTL), *24(OTU), *7(OTL), *9(OTL), 0(XIO), 1(XIO)			
JOG	0	BOOL	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read Only		
OPC UA Access:	None		
JOG - CONVEYOR/Logic - 1(XIC)			
LOC	0	BOOL	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read Only		
OPC UA Access:	None		
LOC - CONVEYOR/Logic - 1(XIC), 1(XIO)			
OL	0	BOOL	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read Only		
OPC UA Access:	None		
OL - CONVEYOR/Logic - 0(XIO), 7(XIC), 8(XIO)			
RDY	0	BOOL	CONVEYOR
Usage:	Output Parameter		
Required:	No		
Visible:	Yes		

RDY (Continued)			
External Access:	Read/Write		
OPC UA Access:	None		
RDY - CONVEYOR/Logic - *0(OTE), 1(XIC)			
REM	0	BOOL	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read Only		
OPC UA Access:	None		
REM - CONVEYOR/Logic - 1(XIC), 1(XIO)			
RP_SW	0	BOOL	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read/Write		
OPC UA Access:	None		
RP_SW - CONVEYOR/Logic - 0(XIO), 19(XIC), 20(XIO)			
RST	0	BOOL	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read/Write		
OPC UA Access:	None		
RST - CONVEYOR/Logic - 24(XIC)			
RUN	0	BOOL	CONVEYOR
Usage:	Output Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read Only		
OPC UA Access:	None		
RUN - CONVEYOR/Logic - *3(OTE), 22(XIC), 23(XIC), 4(XIC), 5(XIC), 6(XIC)			
RUN_CMD	0	BOOL	CONVEYOR
Usage:	Output Parameter		
Required:	No		
Visible:	No		
External Access:	Read Only		
OPC UA Access:	None		
RUN_CMD - CONVEYOR/Logic - *1(OTE), 1(XIC), 2(XIC)			
RUN_DLY	0	DINT	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read/Write		
OPC UA Access:	None		
RUN_DLY - CONVEYOR/Logic - 21(MOVE)			
RUN_SEC	0	DINT	CONVEYOR
Usage:	Input Parameter		
Required:	No		
Visible:	Yes		
External Access:	Read/Write		
OPC UA Access:	None		
RUN_SEC - CONVEYOR/Logic - *23(ADD), 23(ADD)			
SPD_DLY	0	DINT	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read/Write		
OPC UA Access:	None		

SPD_DLY (Continued)			
SPD_DLY - CONVEYOR/Logic - 21(MOVE)			
SPD_SW	0	BOOL	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read/Write		
OPC UA Access:	None		
SPD_SW - CONVEYOR/Logic - 10(XIO), 9(XIC)			
STOP	0	BOOL	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read Only		
OPC UA Access:	None		
STOP - CONVEYOR/Logic - 0(XIO)			
STRT	0	BOOL	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read Only		
OPC UA Access:	None		
STRT - CONVEYOR/Logic - 1(XIC)			
TOL	0	BOOL	CONVEYOR
Usage:	Input Parameter		
Required:	Yes		
Visible:	Yes		
External Access:	Read Only		
OPC UA Access:	None		
TOL - CONVEYOR/Logic - 0(XIO), 15(XIC), 16(XIO)			

Name	Default	Data Type	Scope
OLD_SEC	0	DINT	CONVEYOR
Usage:	Local Tag		
External Access:	None		
OPC UA Access:	None		
<i>OLD_SEC - CONVEYOR/Logic - *23(MOVE), 23(NE)</i>			
PLC_DATE_TIME		DINT[7]	CONVEYOR
Usage:	Local Tag		
External Access:	Read/Write		
OPC UA Access:	None		
PLC_DATE_TIME[0]	0	DINT	
YEAR			
<i>PLC_DATE_TIME[0] - CONVEYOR/Logic - *22(GSV)</i>			
PLC_DATE_TIME[1]	0	DINT	
MONTH			
PLC_DATE_TIME[2]	0	DINT	
DAY			
PLC_DATE_TIME[3]	0	DINT	
HOURS			
PLC_DATE_TIME[4]	0	DINT	
MINUTE			
PLC_DATE_TIME[5]	0	DINT	
<i>PLC_DATE_TIME[5] - CONVEYOR/Logic - 23(MOVE), 23(NE)</i>			
PLC_DATE_TIME[6]	0	DINT	
MILLISECONDE			
SPEED_SW_DLY		TIMER	CONVEYOR
Usage:	Local Tag		
External Access:	None		
OPC UA Access:	None		
<i>SPEED_SW_DLY - CONVEYOR/Logic - *24(RES), *4(TON)</i>			
SPEED_SW_DLY.PRE	2000	DINT	
<i>SPEED_SW_DLY.PRE - CONVEYOR/Logic - *21(MOVE)</i>			
SPEED_SW_DLY.DN	0	BOOL	
<i>SPEED_SW_DLY.DN - CONVEYOR/Logic - 10(XIC), 9(XIC)</i>			
STRT_DLY		TIMER	CONVEYOR
Usage:	Local Tag		
External Access:	None		
OPC UA Access:	None		
<i>STRT_DLY - CONVEYOR/Logic - *2(TON), *24(RES)</i>			
STRT_DLY.PRE	6000	DINT	
<i>STRT_DLY.PRE - CONVEYOR/Logic - *21(MOVE)</i>			
STRT_DLY.DN	0	BOOL	
<i>STRT_DLY.DN - CONVEYOR/Logic - 3(XIC)</i>			

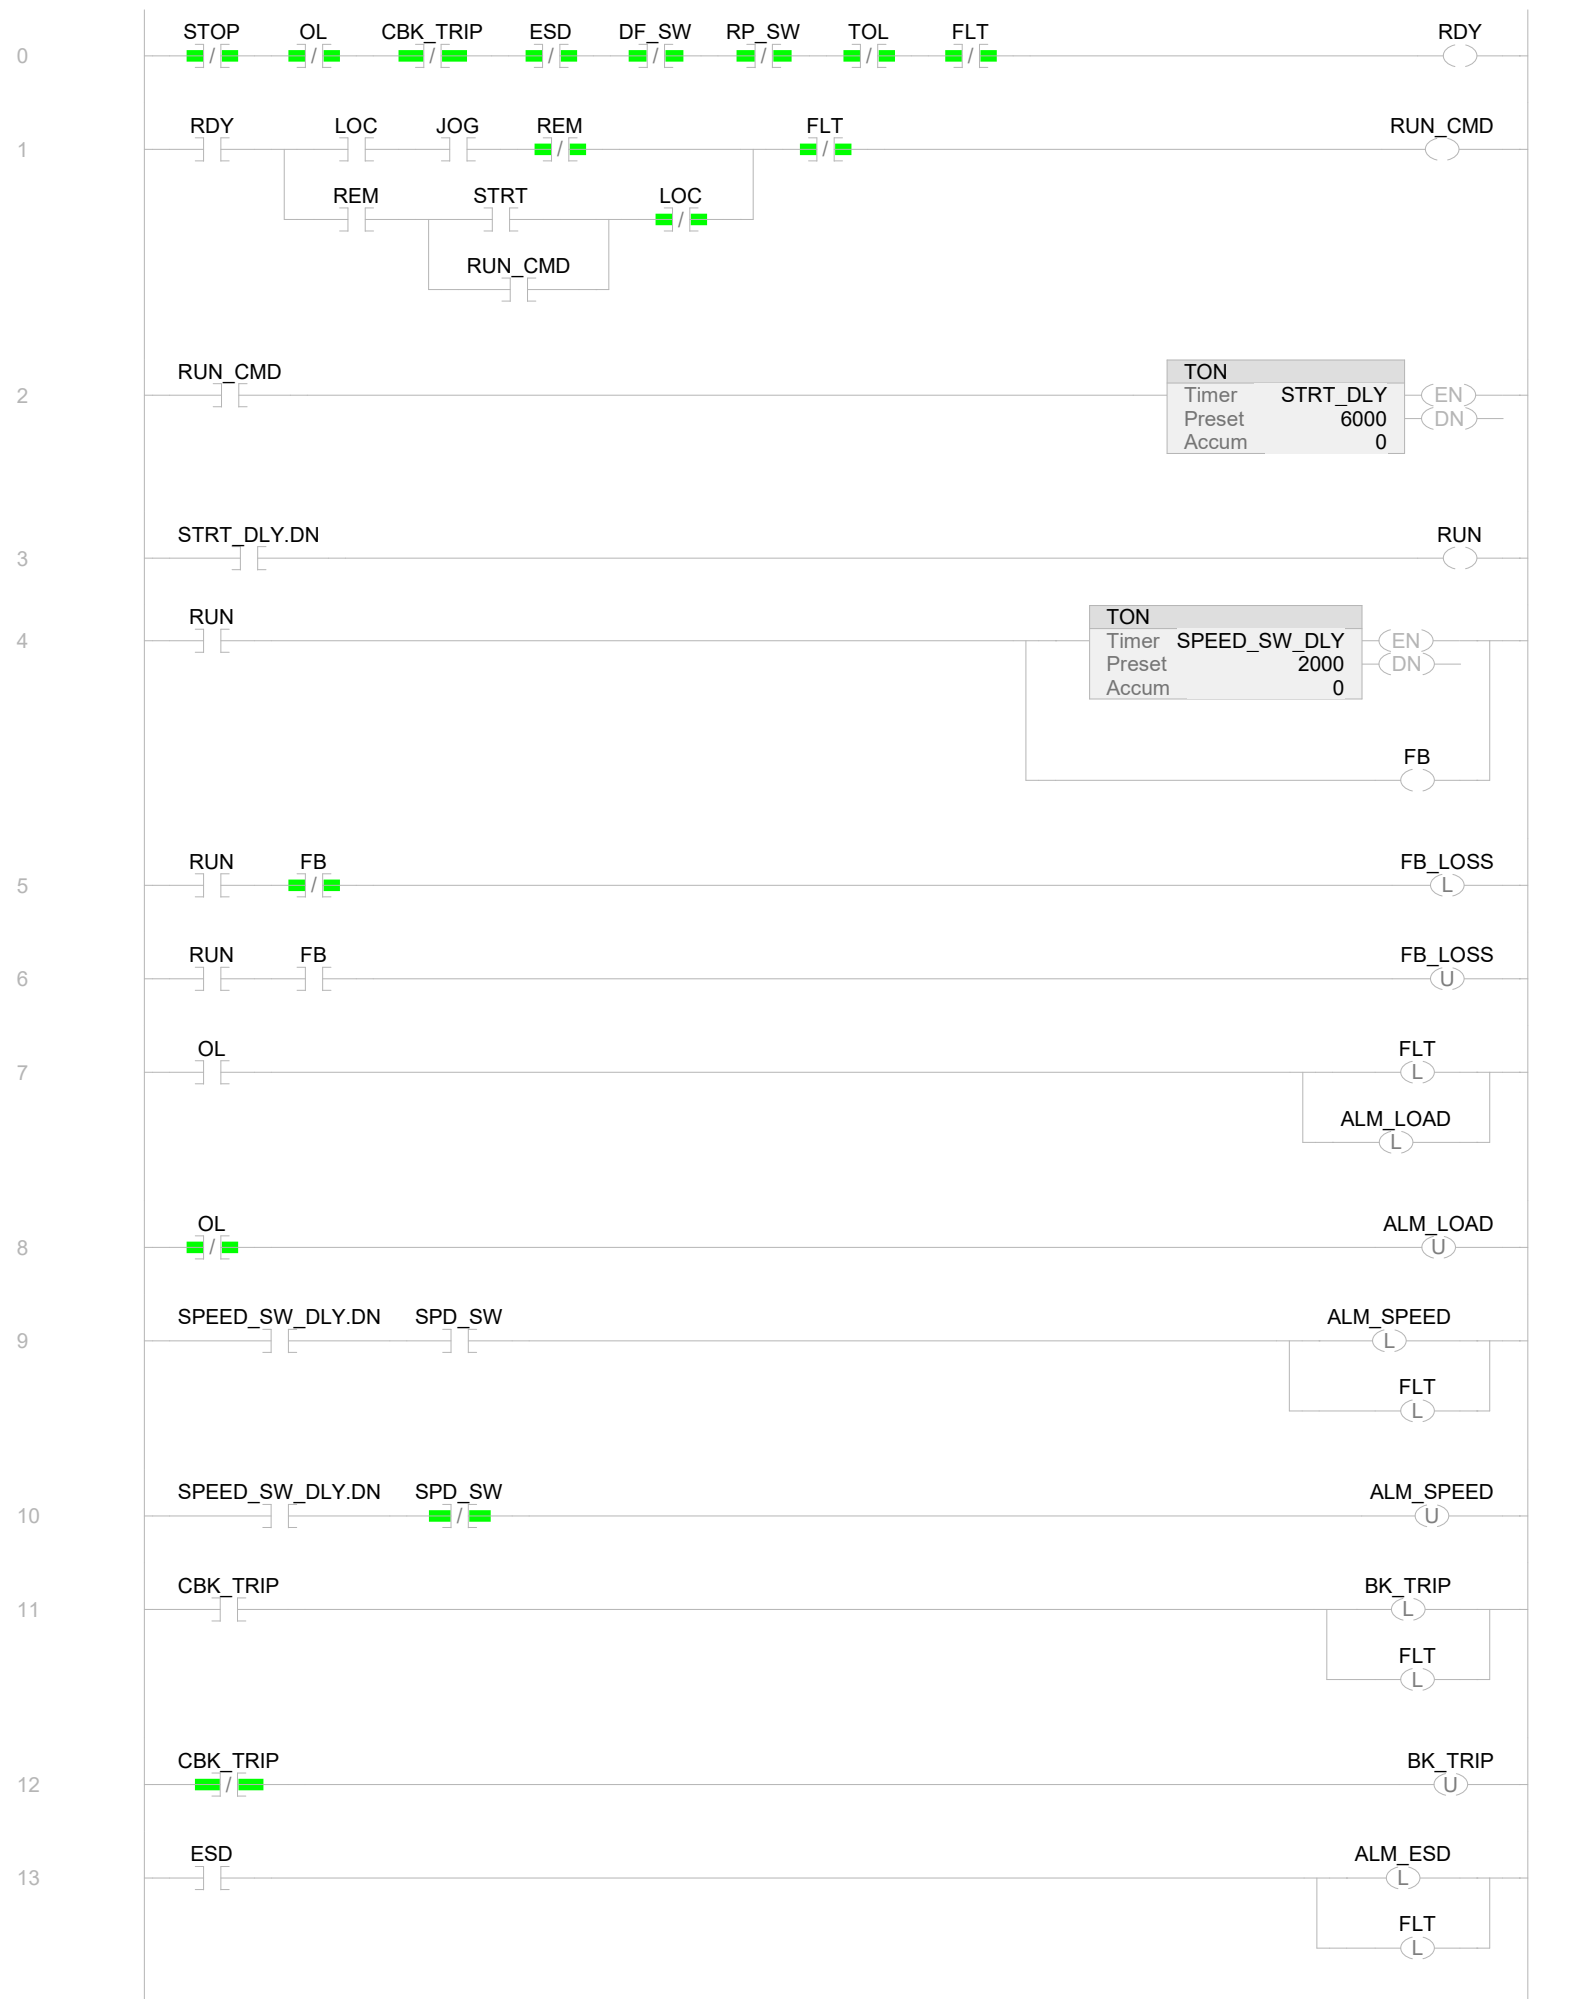

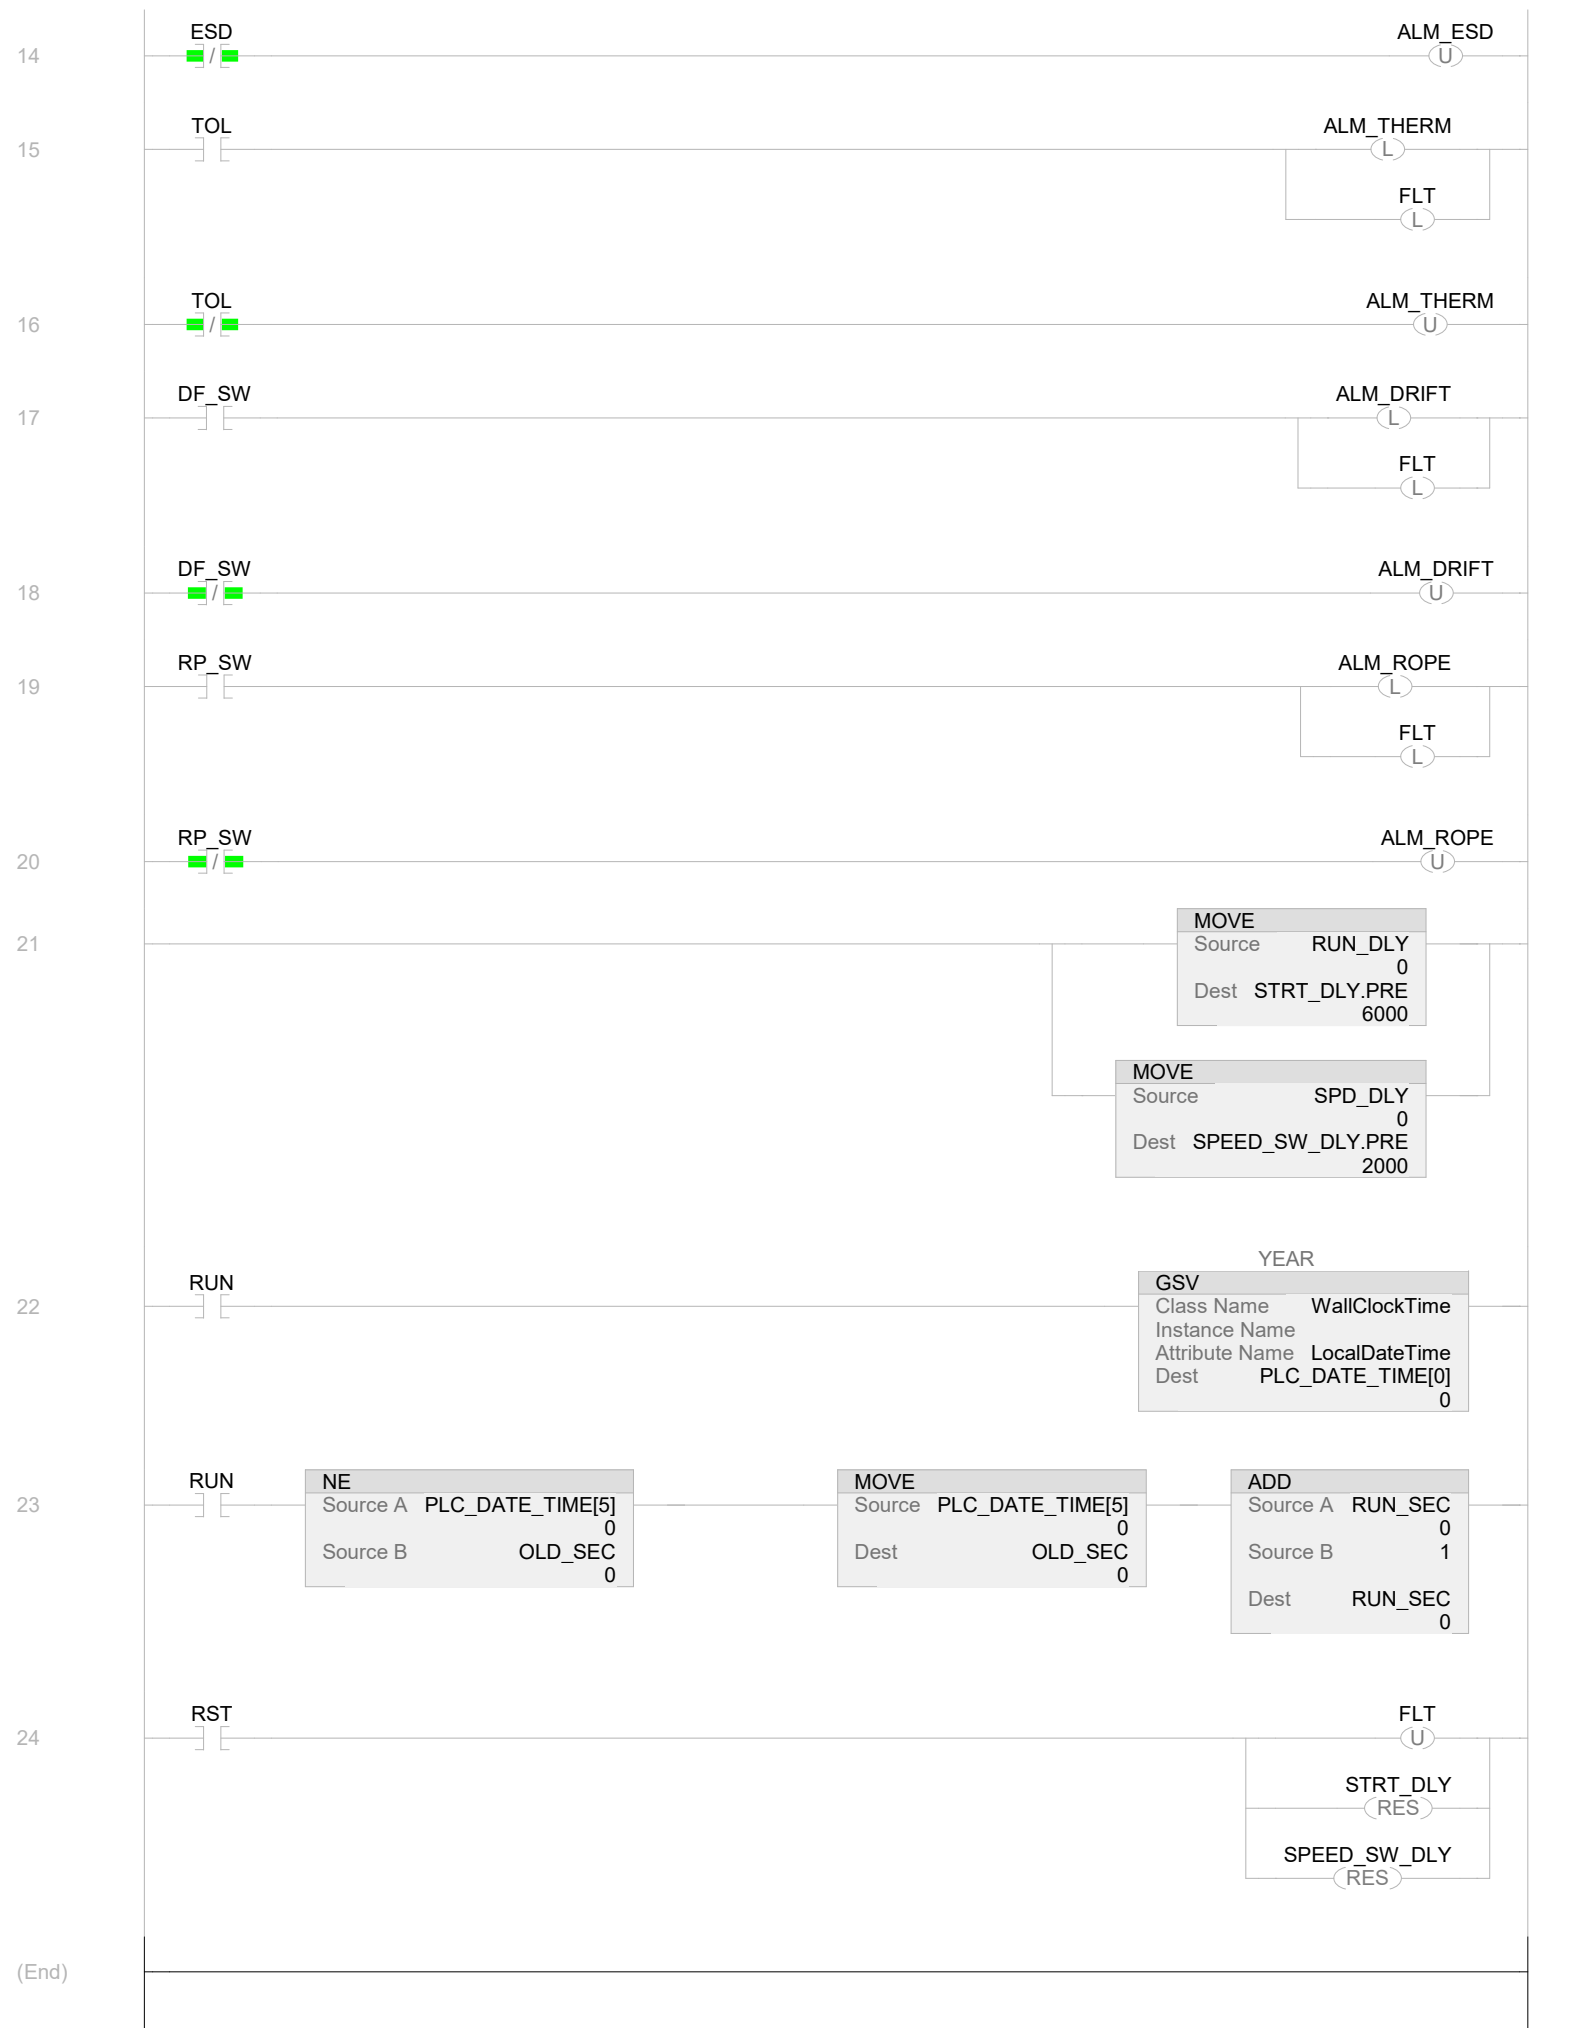

Data type Name: STRING

Description:

Size: 88 byte(s)

Name	Value	Data Type	Style
LEN		DINT	Decimal
External Access:	Read/Write		
DATA		SINT[82]	ASCII
External Access:	Read/Write		

Data type Name: STRING_16

Description:

Size: 20 byte(s)

Name	Value	Data Type	Style
LEN		DINT	Decimal
External Access:	Read/Write		
DATA		SINT[16]	ASCII
External Access:	Read/Write		

Data type Name: STRING_32

Description:

Size: 36 byte(s)

Name	Value	Data Type	Style
LEN		DINT	Decimal
External Access:	Read/Write		
DATA		SINT[32]	ASCII
External Access:	Read/Write		

Data type Name: CONVEYOR

Description:
Subscribe

Size: 76 byte(s)

Name	Value	Data Type	Style
EnableIn		BOOL	Decimal
Enable Input - System Defined Parameter			
External Access:	Read Only		
EnableOut		BOOL	Decimal
Enable Output - System Defined Parameter			
External Access:	Read Only		
LOC		BOOL	Decimal
External Access:	Read Only		
REM		BOOL	Decimal
External Access:	Read Only		
STRT		BOOL	Decimal
External Access:	Read Only		
STOP		BOOL	Decimal
External Access:	Read Only		
ESD		BOOL	Decimal
External Access:	Read Only		
JOG		BOOL	Decimal
External Access:	Read Only		
RDY		BOOL	Decimal
External Access:	Read/Write		
RUN		BOOL	Decimal
External Access:	Read Only		
FB		BOOL	Decimal
External Access:	Read Only		
OL		BOOL	Decimal
External Access:	Read Only		
TOL		BOOL	Decimal
External Access:	Read Only		
CBK_TRIP		BOOL	Decimal
External Access:	Read Only		
FLT		BOOL	Decimal
External Access:	Read Only		
RUN_CMD		BOOL	Decimal
External Access:	Read Only		
RUN_DLY		DINT	Decimal
External Access:	Read/Write		
SPD_DLY		DINT	Decimal
External Access:	Read/Write		
RP_SW		BOOL	Decimal
External Access:	Read/Write		
DF_SW		BOOL	Decimal

External Access:	Read/Write		
SPD_SW		BOOL	Decimal
External Access:	Read/Write		
RST		BOOL	Decimal
External Access:	Read/Write		
RUN_SEC		DINT	Decimal
External Access:	Read/Write		
ALM_ROPE		BOOL	Decimal
External Access:	Read Only		
ALM_DRIFT		BOOL	Decimal
External Access:	Read/Write		
ALM_ESD		BOOL	Decimal
External Access:	Read Only		
ALM_LOAD		BOOL	Decimal
External Access:	Read Only		
FB_LOSS		BOOL	Decimal
External Access:	Read Only		
BK_TRIP		BOOL	Decimal
External Access:	Read Only		
ALM_THERM		BOOL	Decimal
External Access:	Read Only		
ALM_SPEED		BOOL	Decimal
External Access:	Read/Write		

1756 Backplane, 1756-A4 : Local Modules

Local: [2] Emulate 5570 Simulated_IO

Type:	Emulate 5570 Studio 5000® Logix Emulate™ Controller	Parent:	Local
Vendor:	Rockwell Automation/Allen-Bradley	Vendor ID:	1
Slot:	2	Electronic Keying:	Exact Match
Revision:	36.11	Status:	Standby
Module Fault:	Offline	Inhibit Flag	Off

Local: [3] 1756-MODULE Simulat_IO

Type:	1756-MODULE Generic 1756 Module	Parent:	Local
Vendor:	Rockwell Automation/Allen-Bradley	Vendor ID:	1
Slot:	3	Electronic Keying:	Disabled
Revision:	1.1	Status:	Standby
Module Fault:	Offline	Inhibit Flag	Off
Use Unicast:	Yes		

Module Defined Configuration Tag	Value	Data Type
Local:3:C .Data	AB:1756_MODULE:C:0	SINT[400]

Simulated_IO

Label does not exist1

Tag Listing.....2

MainTask
MainProgram
MainRoutine

Ladder Diagram5

Add-On Instruction Signature Listing
Add-On Instructions

Instruction Definition7

CONVEYOR

Parameter Listing9

Local Tag Listing.....13

Logic Routine14

Data Types

Strings16

Add-On-Defined Data Type.....19

Module Properties

1756 Backplane, 1756-A4 : Local Modules21