



ELECTRICAL DOCUMENTATION

CUSTOMER : FARM FRESH
 PLANT DESIGNATION : ASSY,ELECT,BA625,480V
 ORDER NUMBER :

PANEL NO. : 6250096482_D
 DOCUMENT NO : 6250096482_D
 MACHINE NO. : BA625/24

EUROPEAN STANDARD :
 ENCLOSURE PROTECTION DEGREE : NEMA 4X
 DISTRIBUTION SYSTEM :

MANUFACTURING YEAR : 2018
 PLOT DATE : 9/28/2018
 RESPONSIBLE FOR PROJECT : Ryan O
 EDITOR : RyanO
 NUMBER OF PAGES : 7

RATED OPERATIONAL VOLTAGE : 480V
 RATED CURRENT : 5A
 MAX.SHORT CIRCUIT CURRENT ICP : 20kA
 CONTROL CIRCUIT VOLTAGE : 24VDC

*) The machine must be connected to the mains in accordance with the local electricity supply regulations as regards neutral conductor and grounding according to IEC/EN 60204-1.

*) Prior to connection, compare the mains voltage indicated on the rating plate.

BAADER LINCO, INC. 2955 Fairfax Trafficway Kansas City, KS Tel +1 913 621 3366, www.Baader.com

Prev.page:

Next page:
=CONTROL+MOTOR/3



Proj.start 9/11/2014	Mach. no. BA625/24
by RyanO	Panel no. 6250096482_D
Page rev. 1/23/2018	Doc. no. 6250096482_D
by RyanO	Plot date 9/28/2018
Path\\file C:\Users\Public\EPLAN\Data\Projects\Linco\6250096482_D.elk	

FARM FRESH

ASSY,ELECT,BA625,480V

Cover Page


= INFO

+

P/N


Page


2

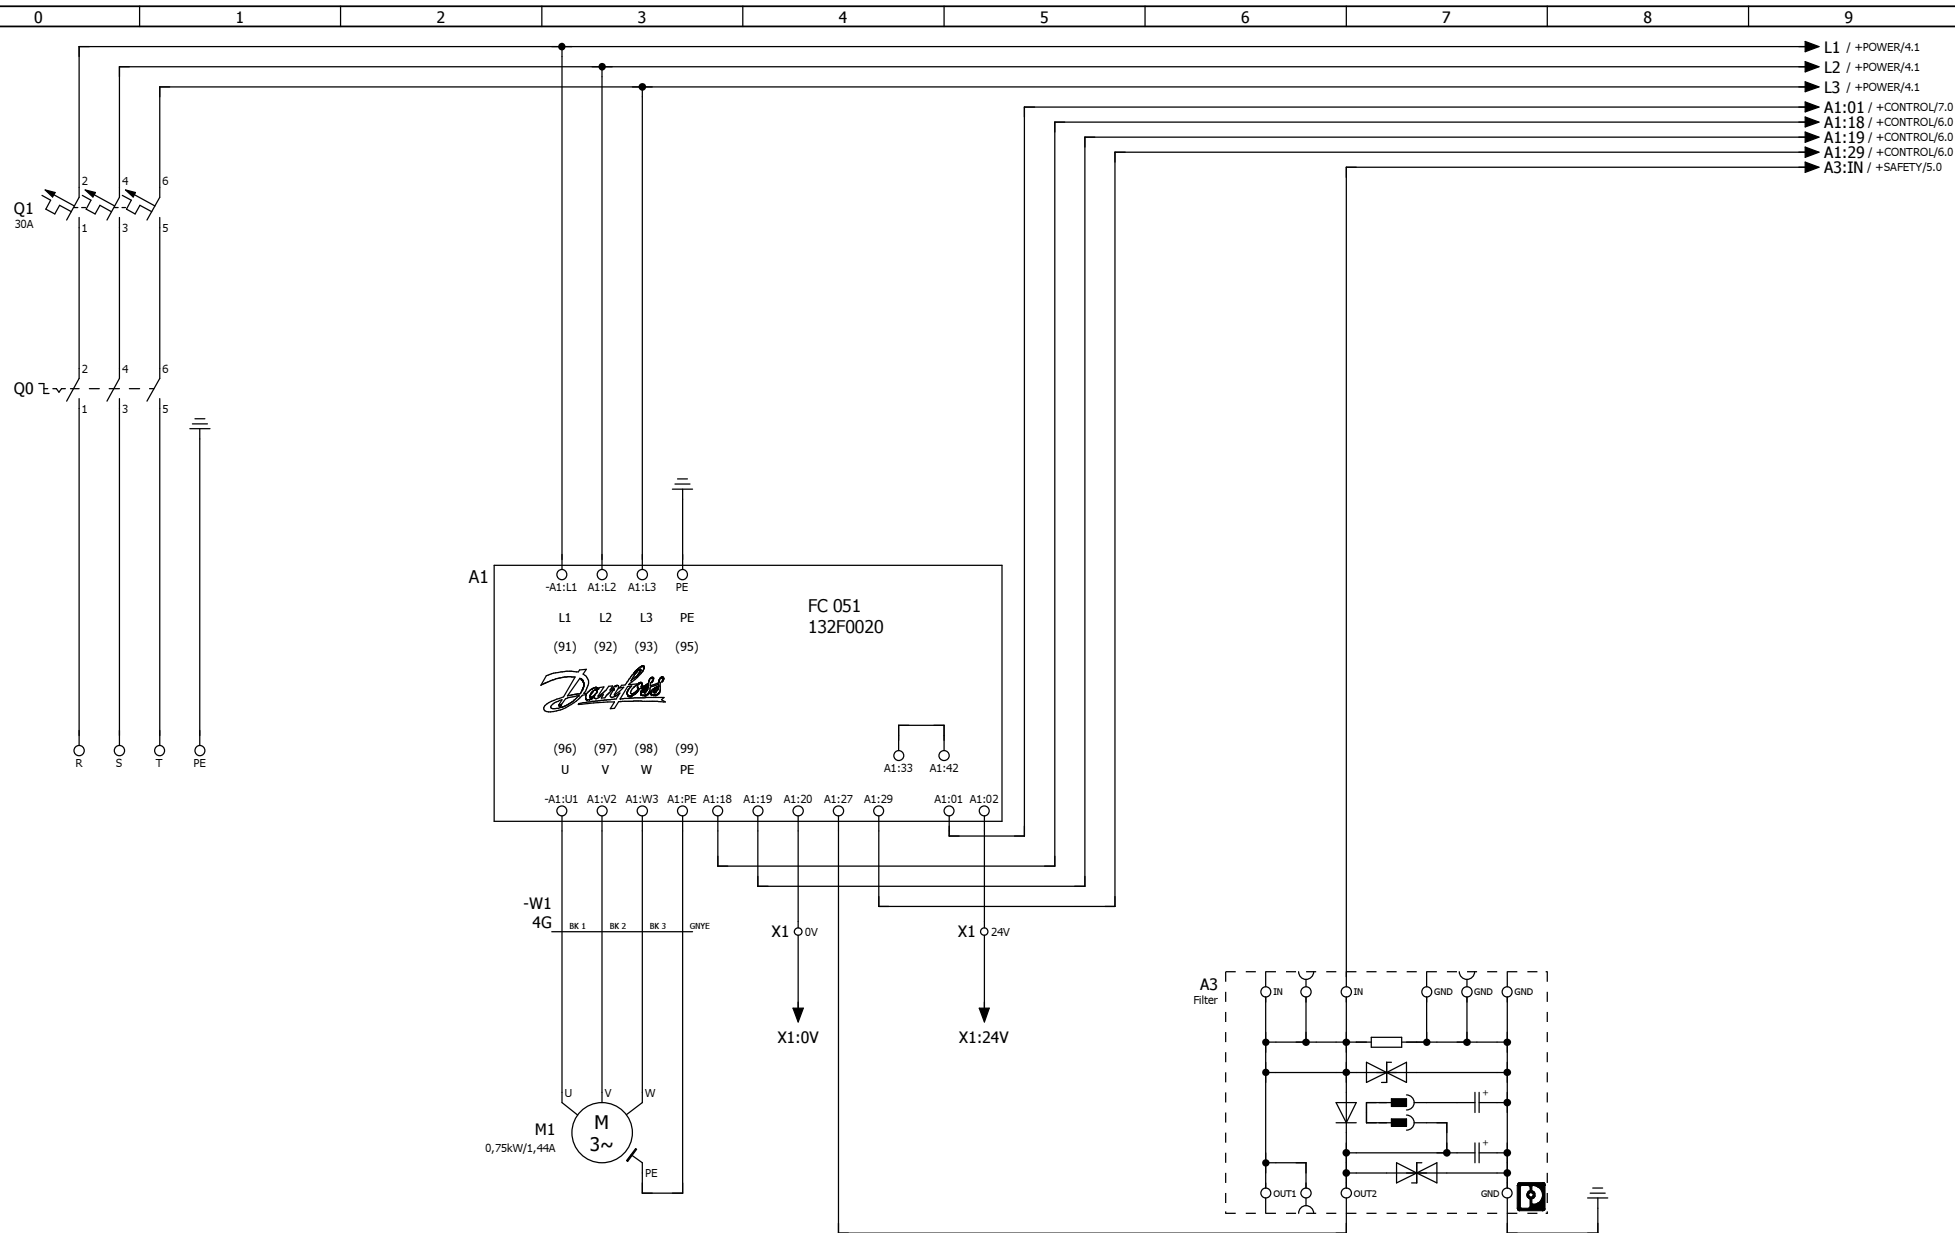

Prev. page:
=INFO+/2


Next page:
3_PARAMETERS

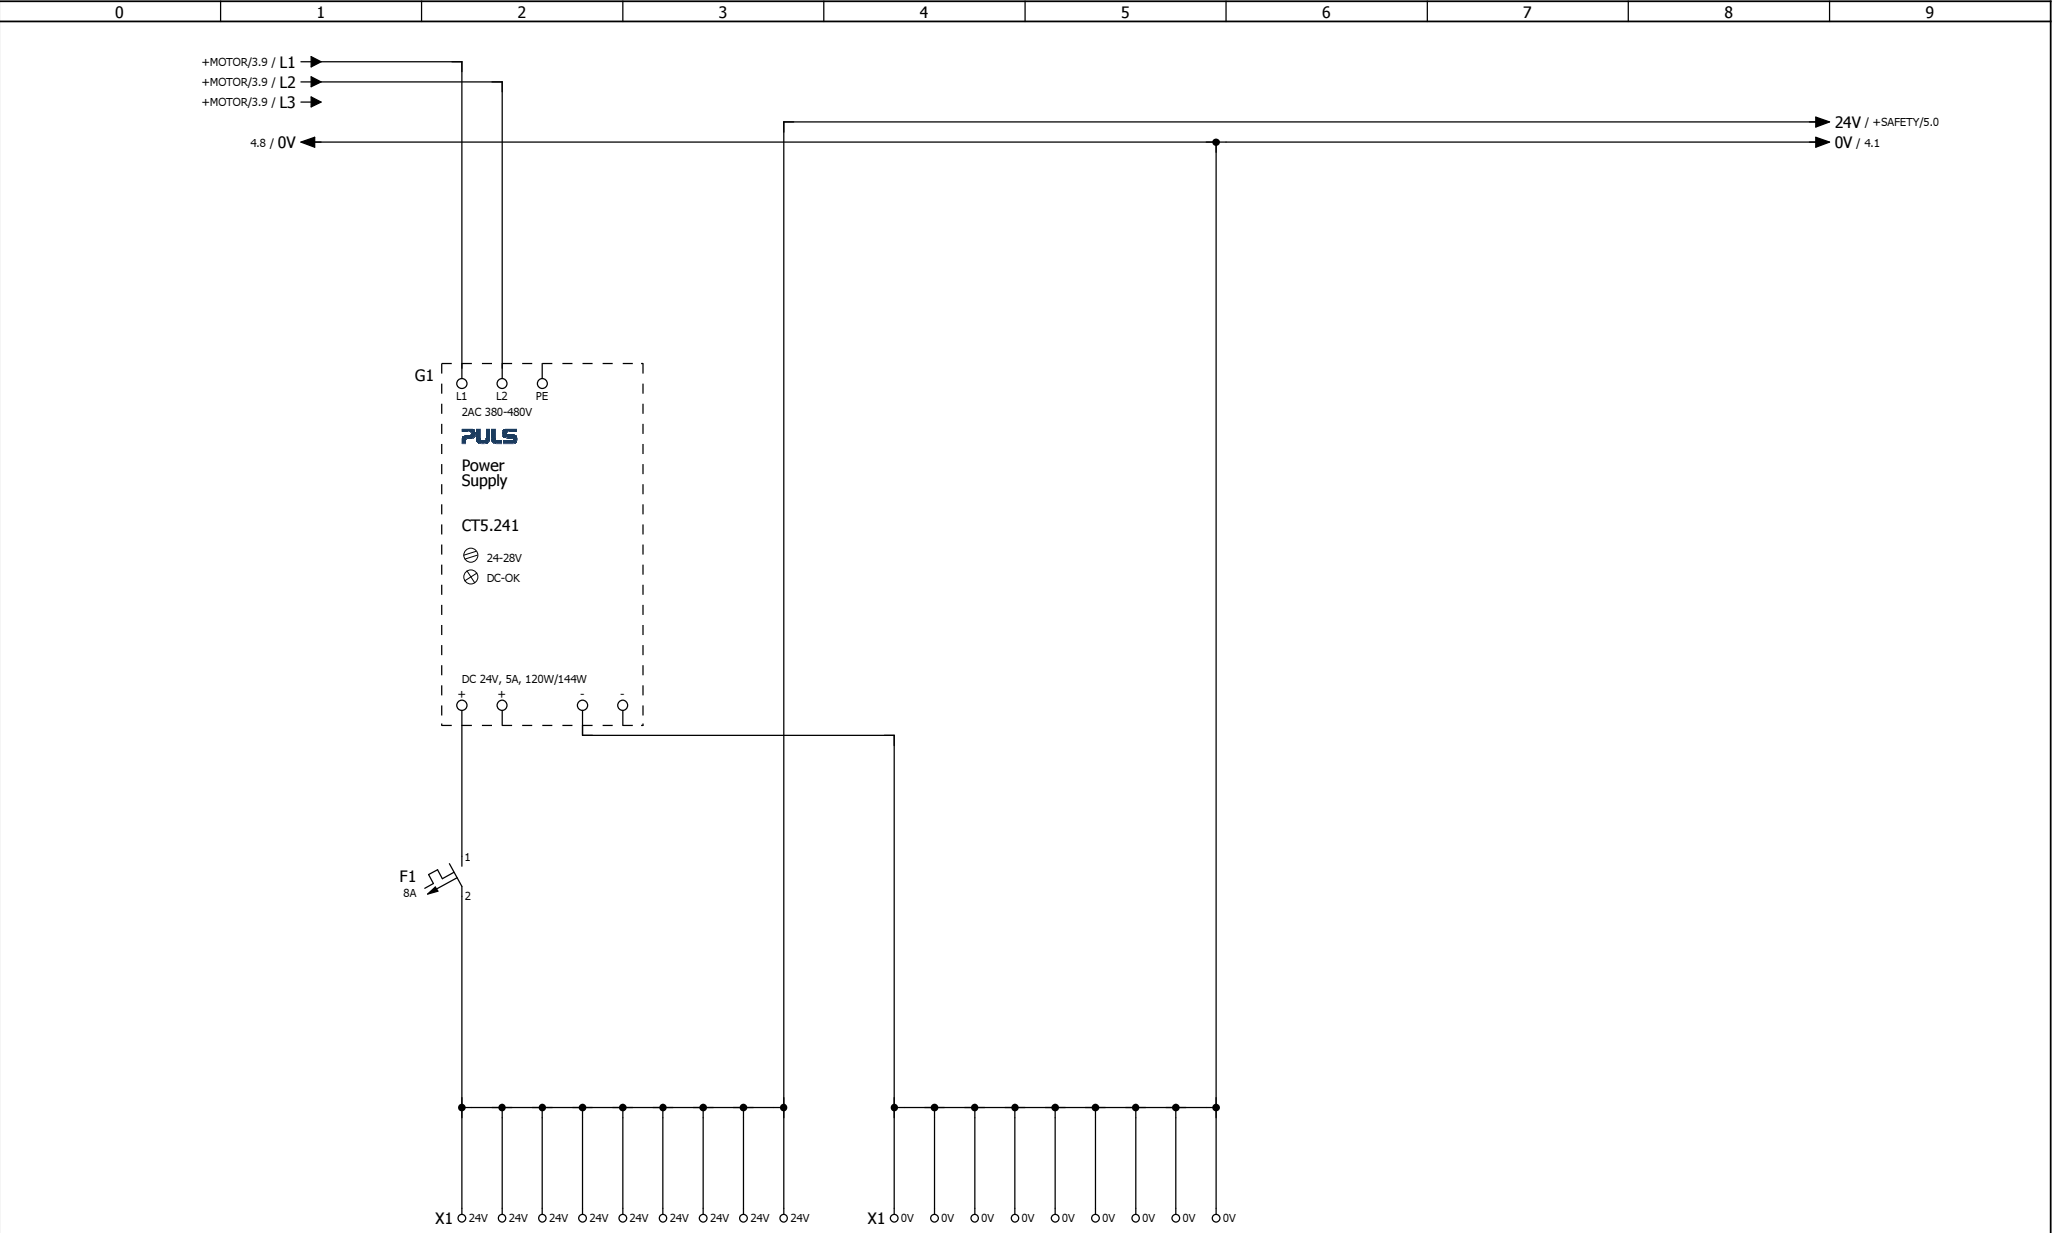

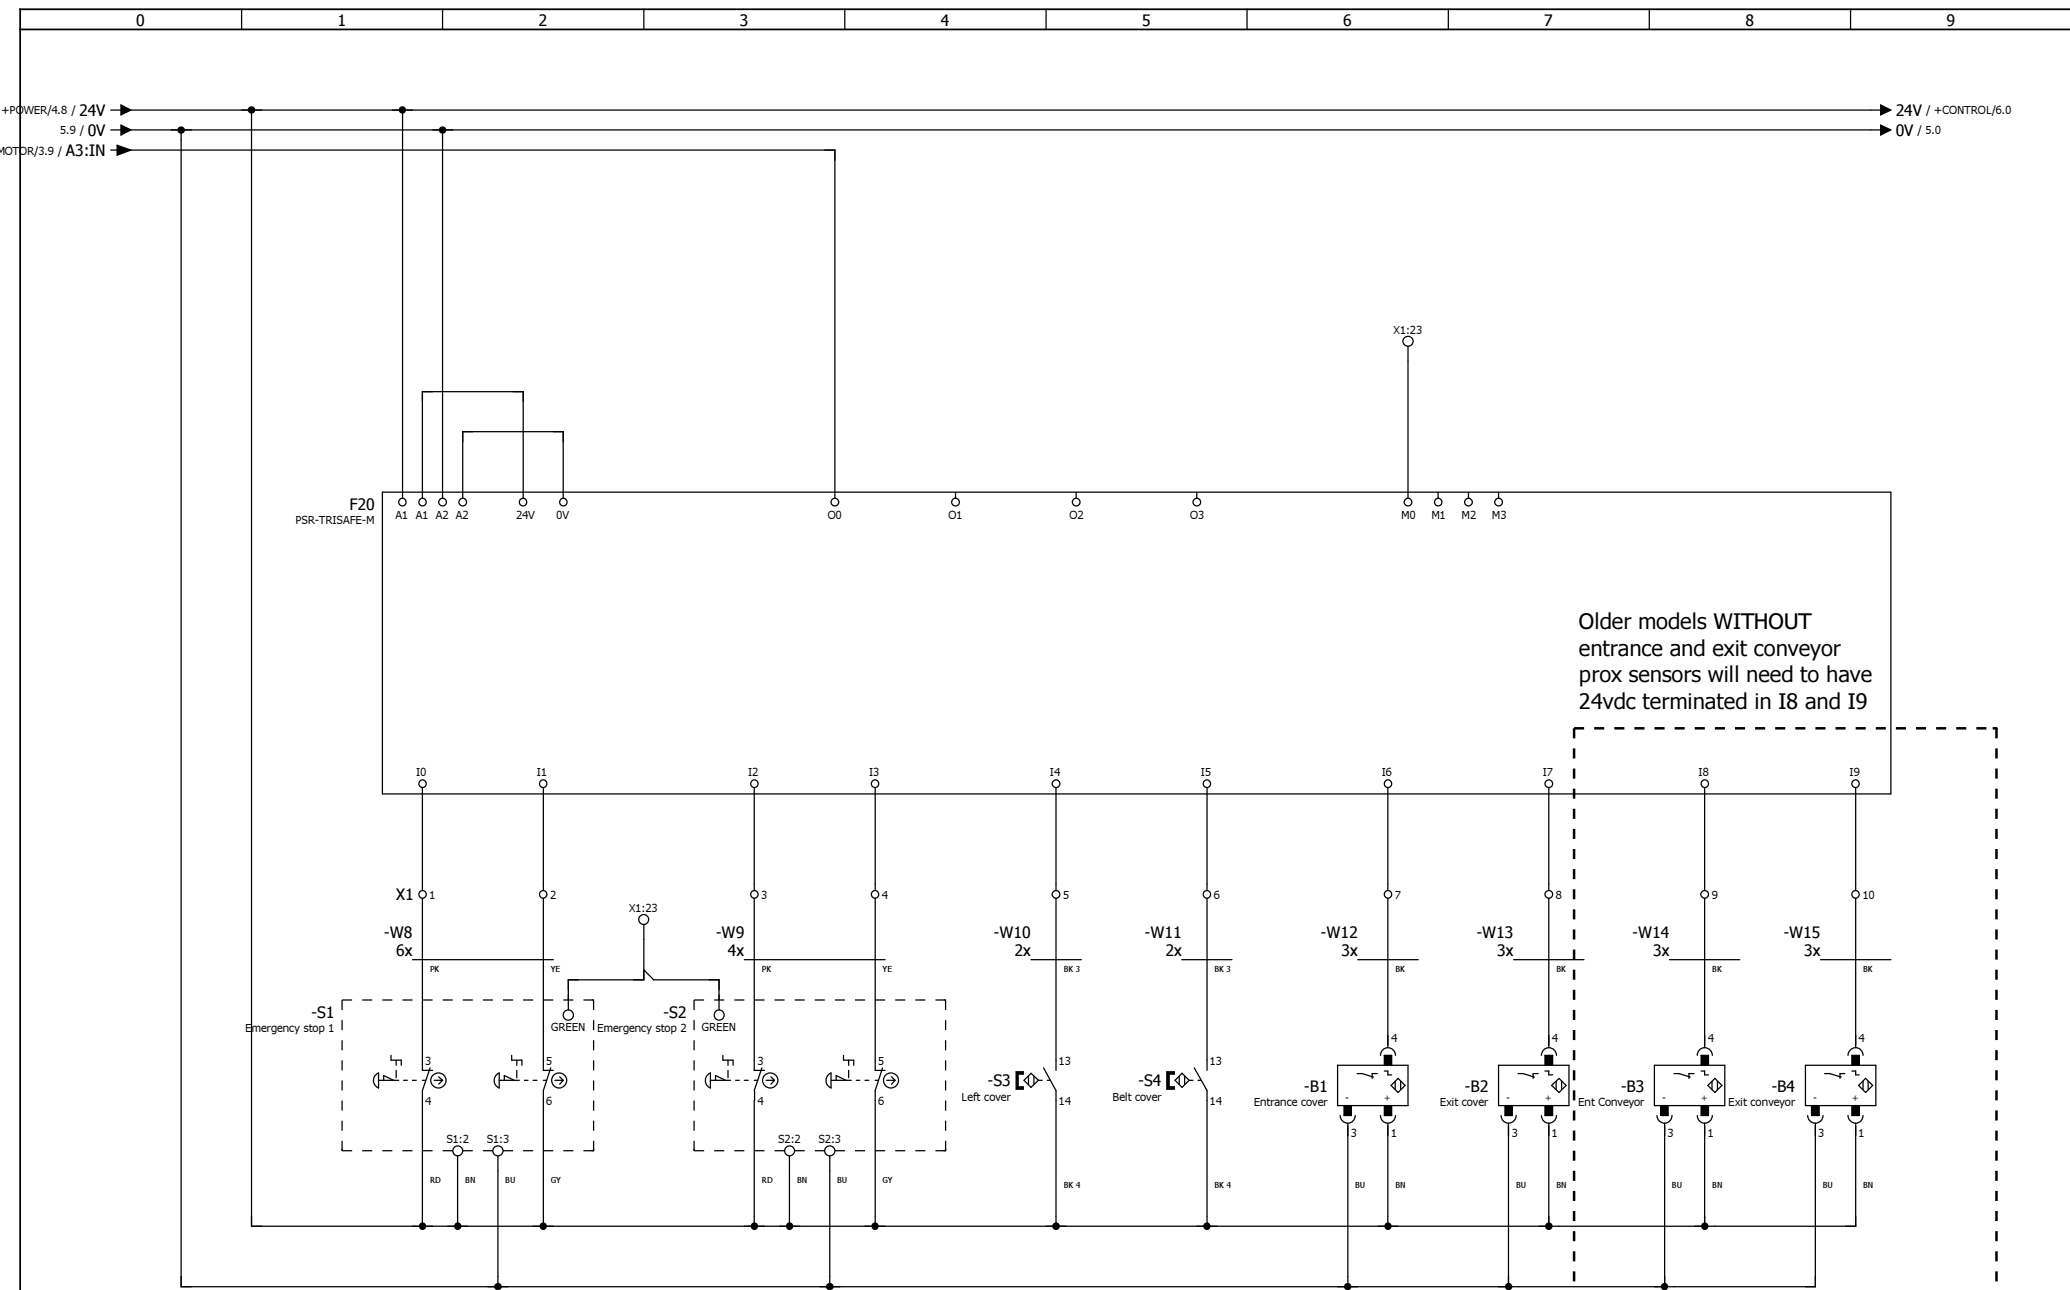

Prev. page:
+POWER/4

Next page:
+CONTROL/6

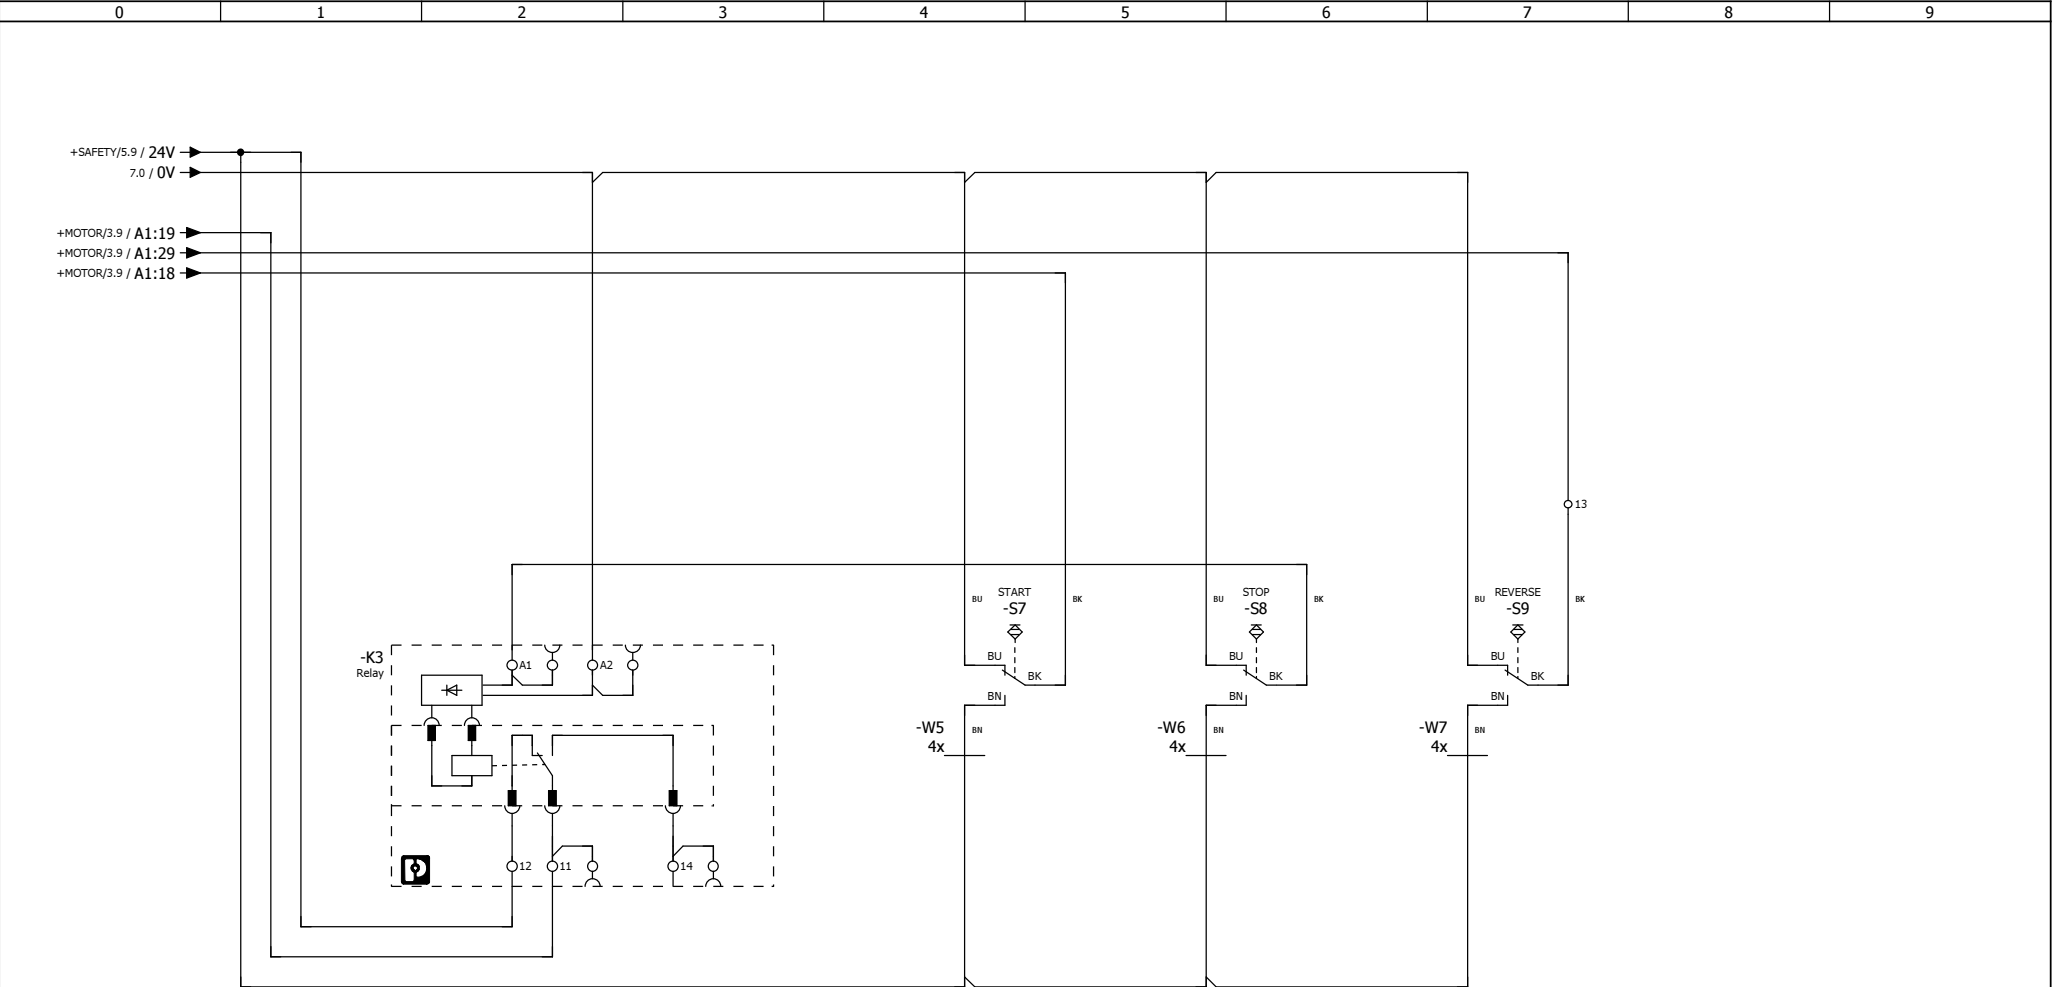

Prev.page:
+SAFETY/5

Next page:
7

