



EVAPCO, Inc.
P.O. Box 1300
Westminster, MD 21158
410-756-2600

February 02, 2024

Republic Refrigeration, Inc.
2810 Gray Fox Rd.
Monroe, 28110

Project: Wayne Farms - Union Springs, AL - Cond's. (Condenser)
Purchase Order(s): JS-CR2308G 35829
Unit (Serial No): (1) PMC-1038E (24p147639)
Duplicate 16-778700

Enclosed is the record submittal data for the order referenced above.

This order is being manufactured at our Madera factory using the highest quality materials and will be assembled in accordance with EVAPCO's strict quality control guidelines. All EVAPCO products undergo a mechanical test prior to shipment to ensure proper field performance.

This order is in our production schedule for shipment on or before 02/28/2024. If you experience any delays in the project that would affect your shipment requirements, please contact your local EVAPCO representative, MidAtlantic Refrigeration, as soon as possible.

Thank you for selecting EVAPCO as your supplier. We appreciate your business and look forward to working with you in the future.

Sincerely,

EVAPCO, Inc.

Joseph Mandato
Joseph Mandato

ENCLOSURE(S)

Cc: MidAtlantic Refrigeration - Mike Hawkins
Southern Equipment Sales Co. - Chris Dreher



EVAPCO, Inc.
 P.O. Box 1300
 Westminster, MD 21158
 410-756-2600

Customer: Republic Refrigeration, Inc.

Project: Wayne Farms - Union Springs, AL - Cond's. (Condenser)

Engineer: Republic Refrigeration

Purchase Order(s): JS-CR2308G 35829

Unit (Serial No): (1) PMC-1038E (24p147639)
 Duplicate 16-778700

Revision	Date	Description
Original	February 02, 2024	Original Submittal
1	February 02, 2024	A Modify Release/Un-Release A Modify Factory

Released For Production



EVAPCO, Inc.
P.O. Box 1300
Westminster, MD 21158
410-756-2600

Customer: Republic Refrigeration, Inc.

Project: Wayne Farms - Union Springs, AL - Cond's. (Condenser)

Engineer: Republic Refrigeration

Unit (Serial No): (1) PMC-1038E (24p147639)
Duplicate 16-778700

Submittal Information		
Document	Drawing No.	Page No.
(1) PMC-1038E [Condenser] (24p147639) Duplicate 16-778700 1 Right Hand		
Equipment Summary		3
Technical Data Sheet		4
Mechanical Specifications		5 - 7
Unit Certified Drawing	CEWTM2412-DRE-001	8
Steel Support Configuration	SLAPTM24-DE	9
Heater Location	HLCETMEI-DC	10
Heater Wiring Diagram	B2AU0000-DC	11
Fan Motor Space Heaters	MHAU0000-DB	12
Sound Data		13 - 14
Additional Documents		
Heater Specification		15 - 16
Basin Heater Control Panel Specifications		17 - 18
Express Warranty Open Cooling Towers, Evaporative Closed Circuit Coolers And Evaporative Condensers		19
Certificate of Compliance		20
Performance Guarantee		21

The intent of the submittal document is to provide applicable project specific performance data, specifications, wiring diagrams, and certified drawings for the equipment being supplied by EVAPCO, Inc..

Visit www.evapco.com to review equipment layout guidelines, rigging and installation instructions, operation and maintenance manuals and any other supporting literature relating to the supplied equipment.



EVAPCO, Inc.
 P.O. Box 1300
 Westminster, MD 21158
 410-756-2600

Customer: Republic Refrigeration, Inc.

Project: Wayne Farms - Union Springs, AL - Cond's. (Condenser)

Engineer: Republic Refrigeration

Unit (Serial No): (1) PMC-1038E (24p147639)
Duplicate 16-778700

Equipment Summary
G-235 Hot-Dip Galvanized Steel Construction
High Efficiency PVC Drift Eliminators
Mechanical Float Valve Assembly
304 Stainless Steel Strainer(s)
Premium Efficient, Inverter Capable Fan Motor(s)
Extended Bearing Lubrication Lines
Non-Corrosive PVC Water Distribution System ZMII® Spray Nozzles
Thermal-Pak® II Coil
Pump Motor EISA Compliant
V-Belt Type Fan Drive
Removable Fan Screens
High Efficiency, Aluminum Axial Fans Arranged in a Two-Stage System
El. Heaters Sized to Maintain +40° F Water at 0 °F Ambient (2) 8 kW, 460/3/60 copper Heater Elements
NEMA 4x Heater Control Package with Contactor, Transformer, and Disconnect
Fan Motor Space Heaters
Oversized Access Doors
IBC Standard Structural Design
Nitrogen Charged Coil(s)
1.0 Importance Factor Specified



EVAPCO, Inc.
P.O. Box 1300
Westminster, MD 21158
410-756-2600

(1) PMC-1038E

24p147639

Product Description

Forced draft, axial fan models can reduce power requirements by up to 50% over centrifugal fan models of similar capacity. The PMC-E Condenser has more capacity than any other forced draft condenser on the market and provides more choices due to its greater number of plan areas.


Selection Criteria

Refrigerant: NH3
Condensing Temp: 95.0 F
Condensing Pressure: 181.2 psi
Entering Wet Bulb: 80.0 F

Required Capacity

9,360.74 MBH NH3

Entering Dry Bulb Switchover: -19.16 F

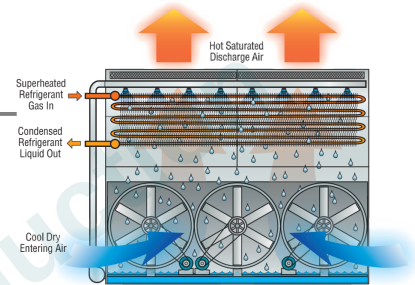

Unit Selected

One(1) EVAPCO PMC-1038E at 100% capacity (9,360.74 MBH)

Physical Data Per Unit

Overall Dimensions (WxLxH): 9'-9 3/4" x 24'-7/8" x 15'-8 7/8"
Operating Weight: 48,590 lbs
Shipping Weight: 37,430 lbs
Heaviest Section: 14,170 lbs
*weights and dimensions could vary depending on options selected

IBC Design Capability

IBC Standard Structural Design
1.0 Importance Factor Specified
Seismic(SDs): up to 0.67 g, z/h = 0
Wind Load(P): up to 288 psf

Fan Motor Data Per Unit

Number of Fans: 4
of Fan Motors: 4
Nameplate Power (460/3/60): 15.00 HP Per Motor
Total Connected Nameplate Power: 60.00 HP
Typical Nameplate FLA: 18 Amps Per Motor
*Nameplate FLA could vary

Pump Motor Data per Unit

No.of Pumps: 2
Nameplate Power (460/3/60): 5 HP per pump motor
Total Connected Nameplate Power: 10 HP
Design Amps: 6.49 Amps Per Motor
*Design amps could vary

Additional Details Per Unit

Air Flow: 169,600 CFM
Coil Volume: 130.9 cu ft per unit
Est. Refrigerant Charge: 961.0 lbs per unit
Coil Design Pressure: 300 psi

Hydraulic Data

Spray Water Flow: 1,370 GPM
Evaporated Water Rate: 15.28 GPM

Accessories

- | | | |
|--|--|---|
| (1) IBC Standard Structural Design | (1) 1.0 Importance Factor Specified | (1) Nitrogen Charged Coil(s) |
| (1) Oversized Access Door(s) | (1) El. Heaters (0F / -18C ambient) (2) 8 kW; 460/3/60 | (1) Contactor w/Transformer and Disconnect for Heater Package |
| (4) Fan Motor: Inverter Capable, Premium Efficient | (4) Fan Motor: Space Heaters | |



EVAPCO, Inc.
P.O. Box 1300
Westminster, MD 21158
410-756-2600

Customer: Republic Refrigeration, Inc.

Project: Wayne Farms - Union Springs, AL - Cond's. (Condenser)

Engineer: Republic Refrigeration

Unit (Serial No): (1) PMC-1038E (24p147639)
Duplicate 16-778700

EVAPCO Model PMC-1038E
EVAPORATIVE CONDENSERS

PART 1 - GENERAL

PART 2 - PRODUCTS

2.1 IBC COMPLIANCE

- A. The structure of this product is designed, analyzed, and constructed in accordance with the wind and seismic load requirements of the following: 2015 IBC, ASCE/SEI 7-16, NFPA 5000. For Importance Factor (I_p) = 1.0, S_{DS} = 0.67 (@ z/h = 0) and P = 288 psf.

2.2 COMPONENTS

A. Materials of Construction

1. All cold water basin components (including vertical supports, air inlet louver frames, and panels up to rigging seam) and upper casing, channels and angle supports are constructed of heavy gauge mill hot-dip galvanized steel. All galvanized steel is coated with a minimum of 2.35 ounces of zinc per square foot of area (G-235 Hot-Dip Galvanized Steel designation). During fabrication, all panel edges are coated with a 95% pure zinc-rich compound.
All evaporative cooling equipment utilizing galvanized construction require initial passivation to maximize the service life of the equipment. The site's water treatment vendor should be contacted several weeks prior to adding any water to the system to provide a passivation plan along with associated passivation plan costs.
2. All panels including the fan snouts, housings and supports are constructed of heavy gauge mill hot-dip galvanized steel. All galvanized steel is coated with a minimum of 2.35 ounces of zinc per square foot of area (G-235 Hot-Dip Galvanized Steel designation). During fabrication, all galvanized steel panel edges are coated with a 95% pure zinc-rich compound.

B. Fan(s):

1. Fans are vane-axial type constructed of cast aluminum alloy blades. They are arranged in a two-stage system installed in a closely fitted cowl with a venturi air inlet and air stabilizing vanes.

C. Drift Eliminators

1. Drift eliminators are constructed entirely of Polyvinyl Chloride (PVC) in easily handled sections. Design incorporates three changes in air direction and limit the water carryover to a maximum of 0.001% of the recirculating water rate. Drift eliminators are self-extinguishing, have a flame spread of less than 25 under ASTM E84, and are resistant to rot, decay and biological attack.

D. Water Distribution System

1. Spray nozzles are zero-maintenance precision molded ABS with large 1-1/4" diameter orifice and internal sludge ring to eliminate clogging. Spray header, branches, and riser are Schedule 40 Polyvinyl Chloride (PVC) for corrosion resistance.

E. Heat Transfer Media

1. Heat transfer coil has elliptical tubes of prime surface steel, encased in steel framework with entire assembly hot-dip galvanized after fabrication. The coil assembly is designed with sloping tubes for liquid drainage. Coil shall have design pressure of 300 psi and shall be in compliance with ASME/ANSI B31.5, Refrigeration Piping and Heat Transfer Components. The coil assembly shall be strength tested in accordance with ASME/ANSI B31.5 and subsequently leak tested using air under water. All evaporative cooling equipment utilizing galvanized construction require initial passivation to maximize the service life of the equipment. The site's water treatment vendor should be contacted several weeks prior to adding any water to the system to provide a passivation plan along with associated passivation plan costs.
2. The heat transfer coil is evacuated and charged with low pressure nitrogen prior to shipment.

F. Pump

1. Unit has EISA close-coupled centrifugal pump with mechanical seal. The pump is installed in a vertical position so that water will drain from the pump when the cold water basin is emptied. Pump motor is totally enclosed with protective canopy for outdoor operation.

G. Bleed-off

1. Unit has a waste water bleed line with a manual adjustable valve provided.

H. Make up Float Valve Assembly

1. Make up float assembly is a mechanical brass valve with an adjustable plastic float.

I. Pan Strainer

1. Pan Strainer(s) are all Type 304 Stainless Steel construction with large area removable perforated screens.

J. Pipe Connection Type

1. Any connections provided with a Groove (GVD) or Beveled for Welding/Grooved (BFW/GVD) conforms to standard groove specification (SGS).

2.3 MOTORS AND DRIVES

A. Fan Motor

1. Fan motor(s) are totally enclosed, ball bearing type electric motor(s) suitable for moist air service. Motor(s) are Premium Efficient, Class F insulated, 1.15 service factor design. Inverter rated per NEMA MG1 Part 31.4.4.2 and suitable for variable torque applications and constant torque speed range with properly sized and adjusted variable frequency drives.
2. Fan motor(s) include strip-type space heaters with separate leads brought to the motor conduit box.

B. Fan Drive

1. The fan drive is V-belt type with QD tapered bushings designed for 150% of the motor nameplate power. The belt material is neoprene reinforced with polyester cord and specifically designed for evaporative equipment service. Belt adjustment is accomplished from the exterior of the unit.

C. Fan Shaft

1. Fan shaft is solid, ground and polished steel. Exposed surface is coated with rust preventative.

D. Fan Shaft Bearings

1. Fan Shaft Bearings are heavy-duty, self-aligning ball type bearings with extended lubrication lines to grease fittings located on access door frame. Bearings are designed for a minimum L-10 life of 100,000 hours.

2.4 MAINTENANCE ACCESS

A. Fan Section

1. Fan screens are removable for fan motor and drive access at grade.

B. Basin Section

1. Oversized access doors are located above the basin to allow for easy access to pan interior.

2.5 ACCESSORIES


A. Basin Heater Package

1. Cold water basin is fitted with copper element, electric immersion heater (s) with a separate thermostat and low water protection device. Heaters maintain +40° F pan water at 0 °F ambient temperature.
2. Electric immersion heater package includes a factory-supplied NEMA 4x enclosure containing a magnetic contactor with 120 VAC control circuit, transformer, and main power disconnect. Control package wired by others.


UNIT EVAPORATIVE CONDENSER			DWG. # CEWTM2412-DRE-001	REV. -
MODEL # PMC-1038E	SCALE N.T.S.		SERIAL # 24p147639	DATE 2/2/2024

- NOTES:
1. (M)- FAN MOTOR LOCATION
 2. HEAVIEST SECTION IS UPPER SECTION
 3. MPT DENOTES MALE PIPE THREAD
FPT DENOTES FEMALE PIPE THREAD
BFW DENOTES BEVELED FOR WELDING
PE DENOTES PLAIN END WITH PLUG
CLOSURE FOR NITROGEN CHARGE
 4. +UNIT WEIGHT DOES NOT INCLUDE
ACCESSORIES (SEE ACCESSORY DRAWINGS)
 5. 3/4" DIA. MOUNTING HOLES. REFER TO
RECOMMENDED STEEL SUPPORT DRAWING.
 6. MAKE-UP WATER PRESSURE
20 psi MIN [137 kPa], 50 psi MAX [344 kPa]
 7. *-APPROXIMATE DIMENSIONS DO NOT USE
FOR PRE-FABRICATION OF CONNECTING
PIPING
 8. DIMENSIONS LISTED AS FOLLOWS: ENGLISH FT-IN
METRIC [mm]


FACE B
PLAN VIEW

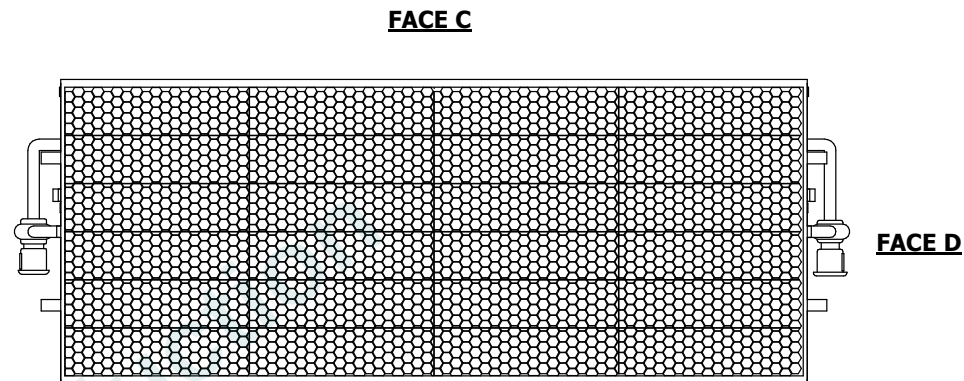

FACE A

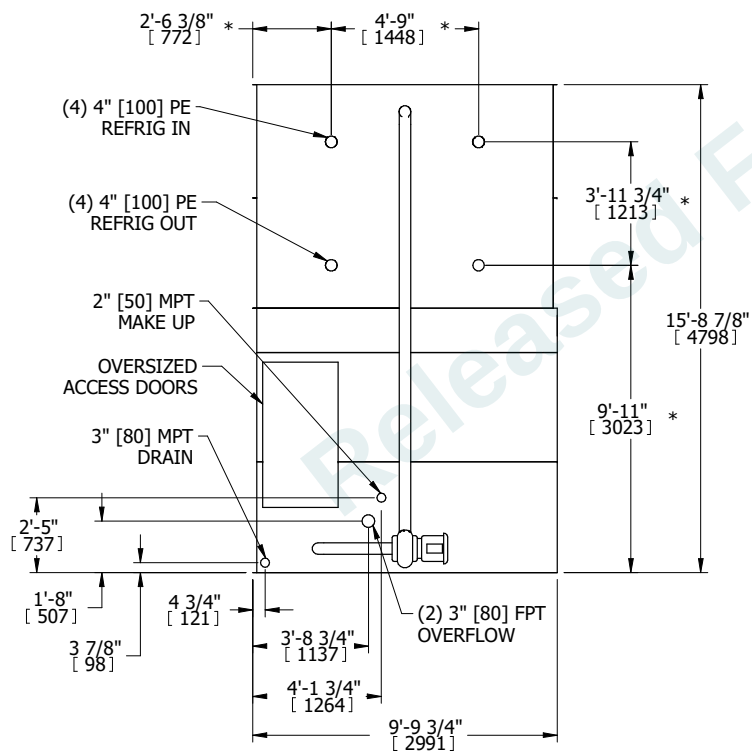




FACE B

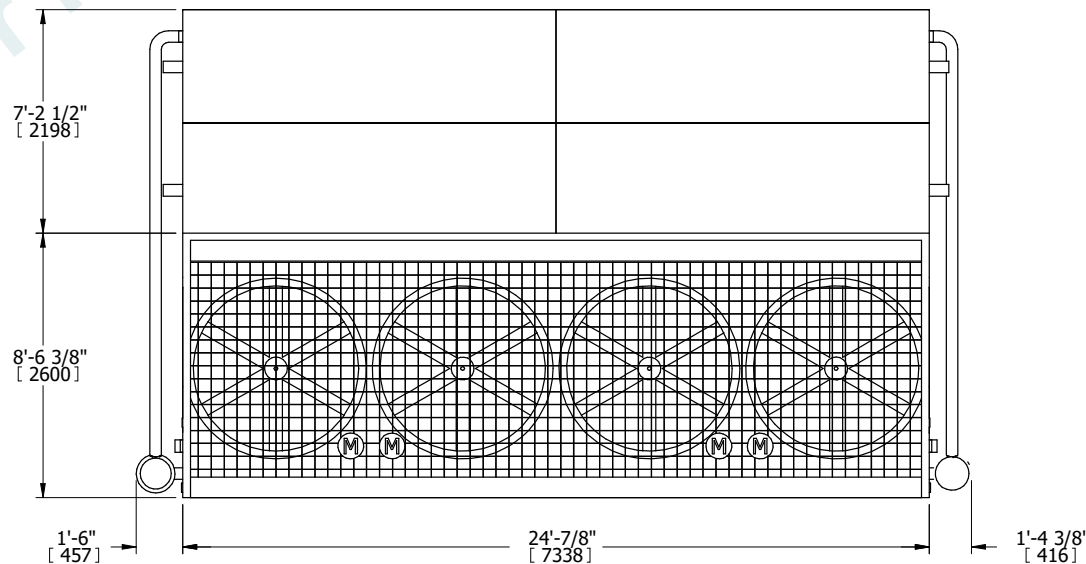

FACE A

SHIPPING WEIGHT 37430 Lb+ [16978] Kg+	OPERATING WEIGHT 48590 Lb+ [22040] Kg+	HEAVIEST SECTION WEIGHT 14170 Lb+ [6427] Kg+	NO. OF SHIPPING SECTIONS 3	DRAWN BY: JTG
--	---	---	-------------------------------	------------------


UNIT	PMC-1038E	EVAPCO, INC. 	DWG. #	SLAPTM24-DE	
TITLE	STEEL SUPPORT CONFIGURATION		SCALE	N.T.S.	DRAWN BY

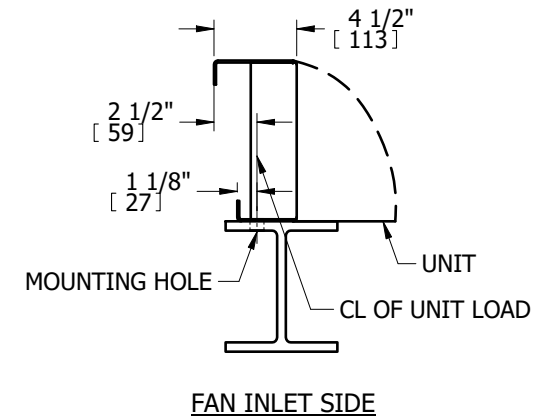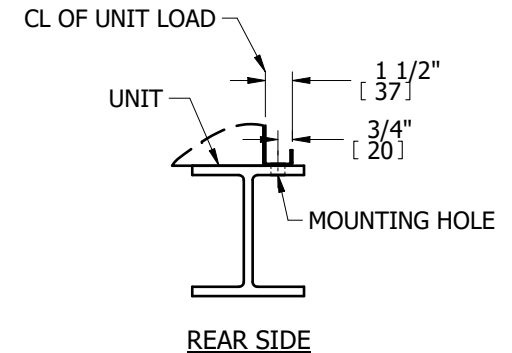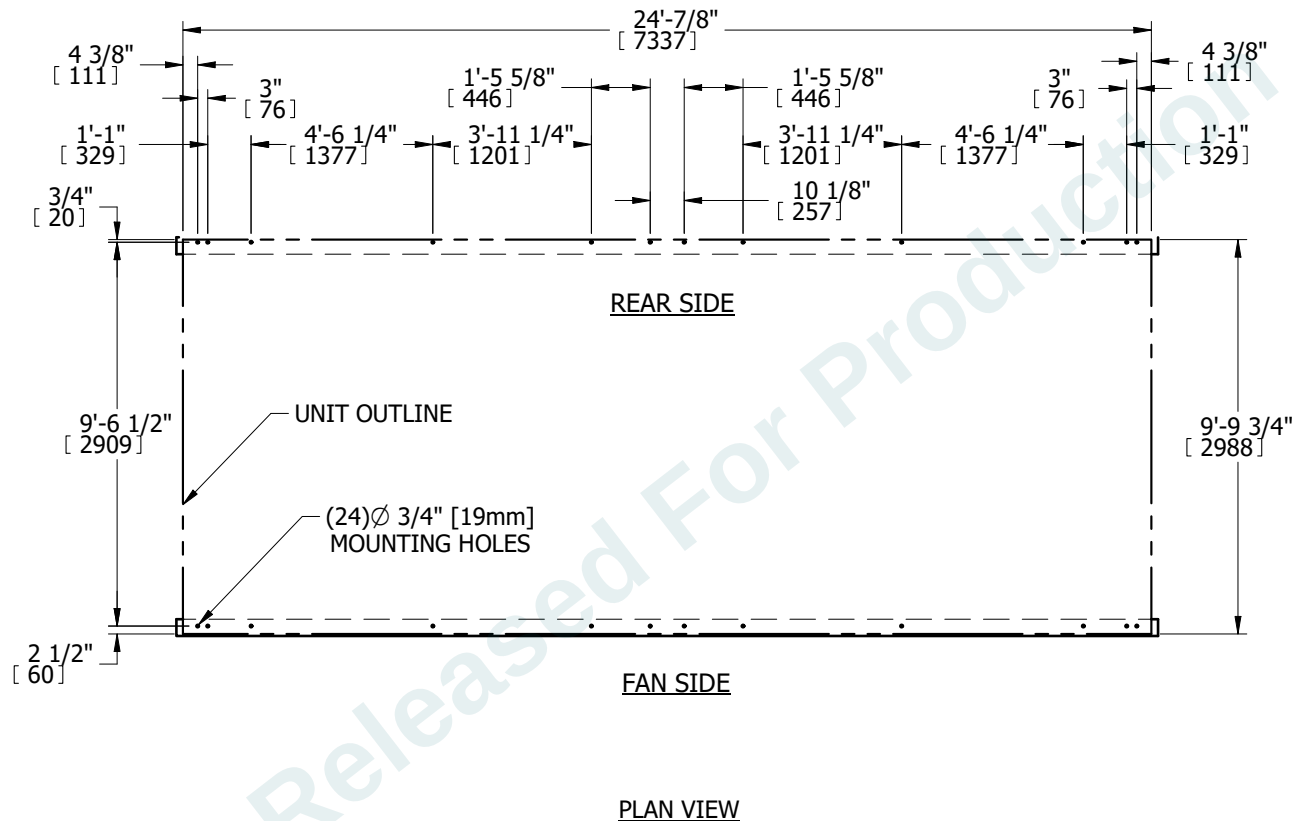

NOTES:

- [illegible]

UNIT	PMC-1038E	EVAPCO, INC. 	DWG. #	HLCETMEI-DC	
TITLE	HEATER LOCATION		SCALE	N.T.S.	DRAWN BY JLG

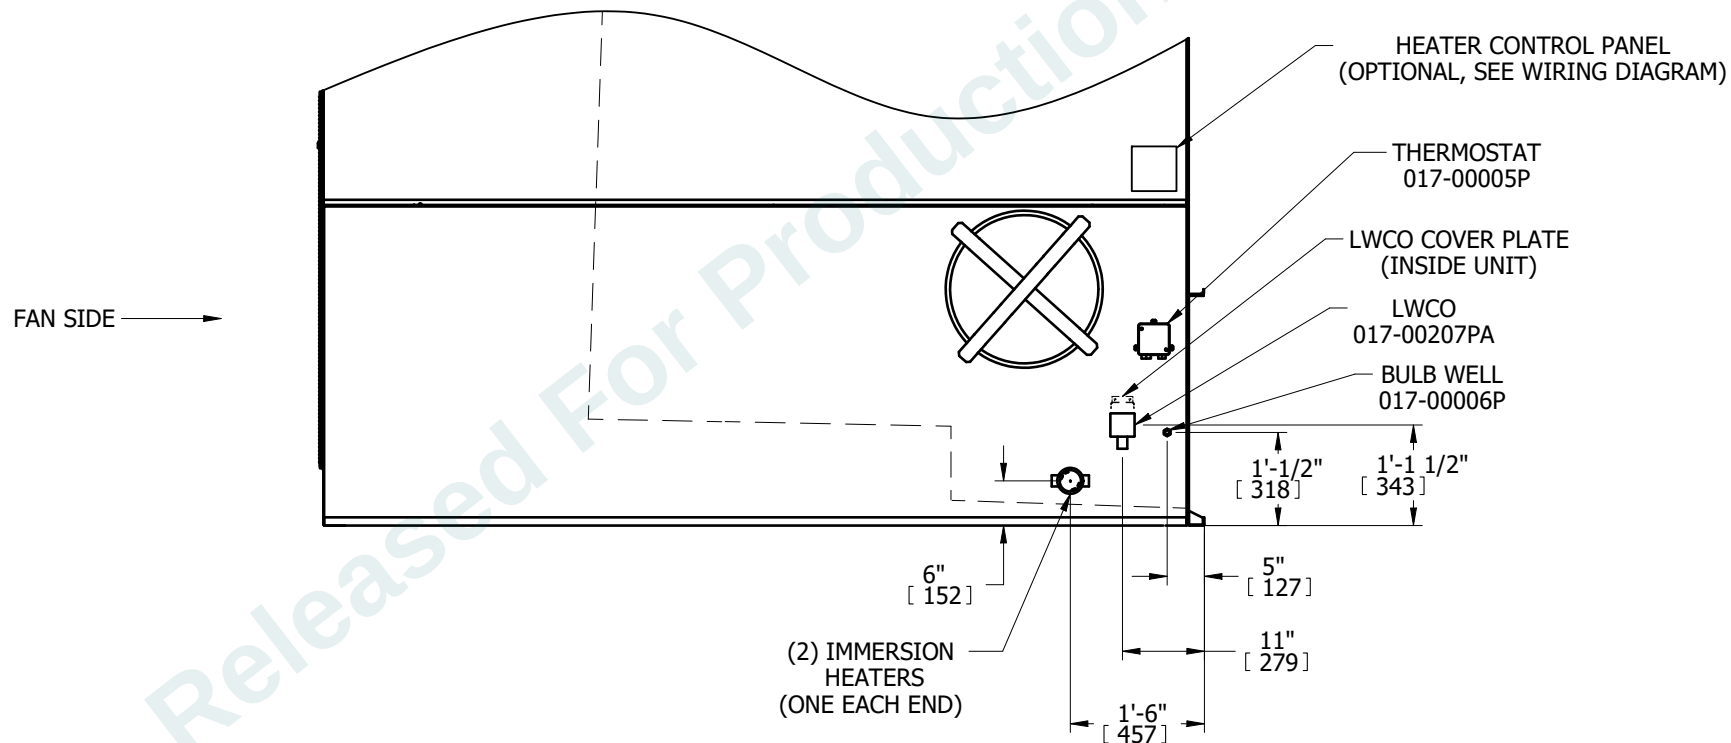

FACE D

NOTES:


1. PLEASE REFER TO THE EVAPCO EQUIPMENT LAYOUT MANUAL FOR CLEARANCE REQUIREMENTS.
2. ALL NIPPLES ON UNIT ARE NOT SHOWN IN ORDER TO CLARIFY HEATER COMPONENT LOCATIONS.
3. ALL HEATER COMPONENTS BY EVAPCO ARE FACTORY MOUNTED WHEN POSSIBLE.
4. DIMENSIONS LISTED AS FOLLOWS: ENGLISH FT- IN [METRIC] [mm]

UNIT	PMC-1038E	EVAPCO, INC. 	DWG. #	B2AU0000-DC	
TITLE	3Ø HEATER WIRING DIAGRAM 2 HEATERS		SCALE	N.T.S.	DRAWN BY SLR

LINE VOLTAGE: 460/3/60

RECOMMENDED POWER AND CONTROL WIRING

- ALL HEATERS AND CONTROLS NOT PROVIDED BY EVAPCO TO BE INSTALLED AND WIRED BY OTHERS
- ALL POWER WIRING BY OTHERS
- ALL FIELD WIRING BY OTHERS

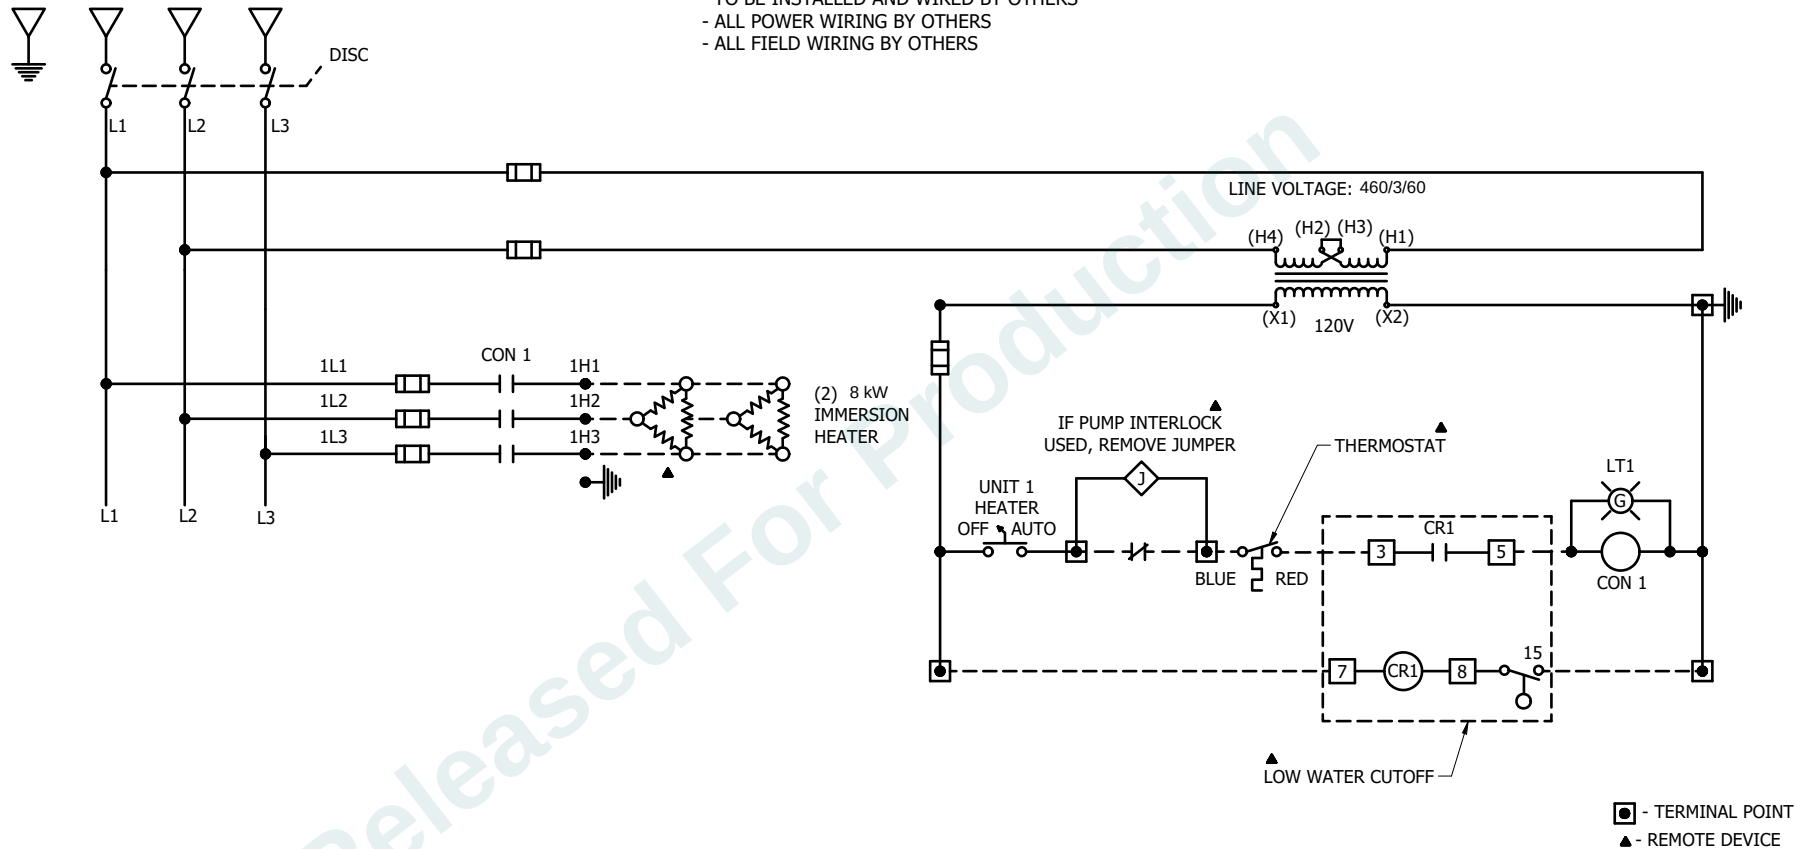**NOTES:**

1. DASHED LINES INDICATE FIELD WIRING.
2. THE HEATERS HAVE BEEN SIZED TO MAINTAIN 40° F PAN WATER AT AN AMBIENT TEMPERATURE OF 0° F
3. ALL COMPONENTS BY EVAPCO HAVE TYPE 4 ENCLOSURES.
4. AUXILIARY N.C. CONTACT INTERLOCKS IMMERSION HEATERS WITH SPRAY WATER CIRCULATING PUMP TO DE-ENERGIZE HEATERS WHEN SPRAY PUMP IS RUNNING.
5. (1) CONTACTOR IS SUPPLIED FOR EVERY (2) HEATERS
 - CONTACTOR SHOULD BE WIRED WITH SEPARATE SUPPLY TERMINALS FOR EACH HEATER.
6. (1) CONTACTOR IS SUPPLIED PER CELL OF A MULTICELL UNIT
 - PROVIDES FOR INDIVIDUAL CELL OPERATION.

IMMERSION HEATER BY:

EVAPCO

LOW WATER CUTOFF/THERMOSTAT CONTROL BY:

EVAPCO

AUXILIARY N.C. PUMP INTERLOCK BY:

OTHERS

HEATER CONTROL PANEL BY:

EVAPCO

TRANSFORMER BY:

EVAPCO


HEATER CONTACTOR BY:

EVAPCO

FUSED DISCONNECT BY:

EVAPCO

UNIT	PMC-1038E	EVAPCO, INC. 	DWG. #	MHAU0000-DB	
TITLE	FAN MOTOR SPACE HEATERS		SCALE	N.T.S.	DRAWN BY BLL

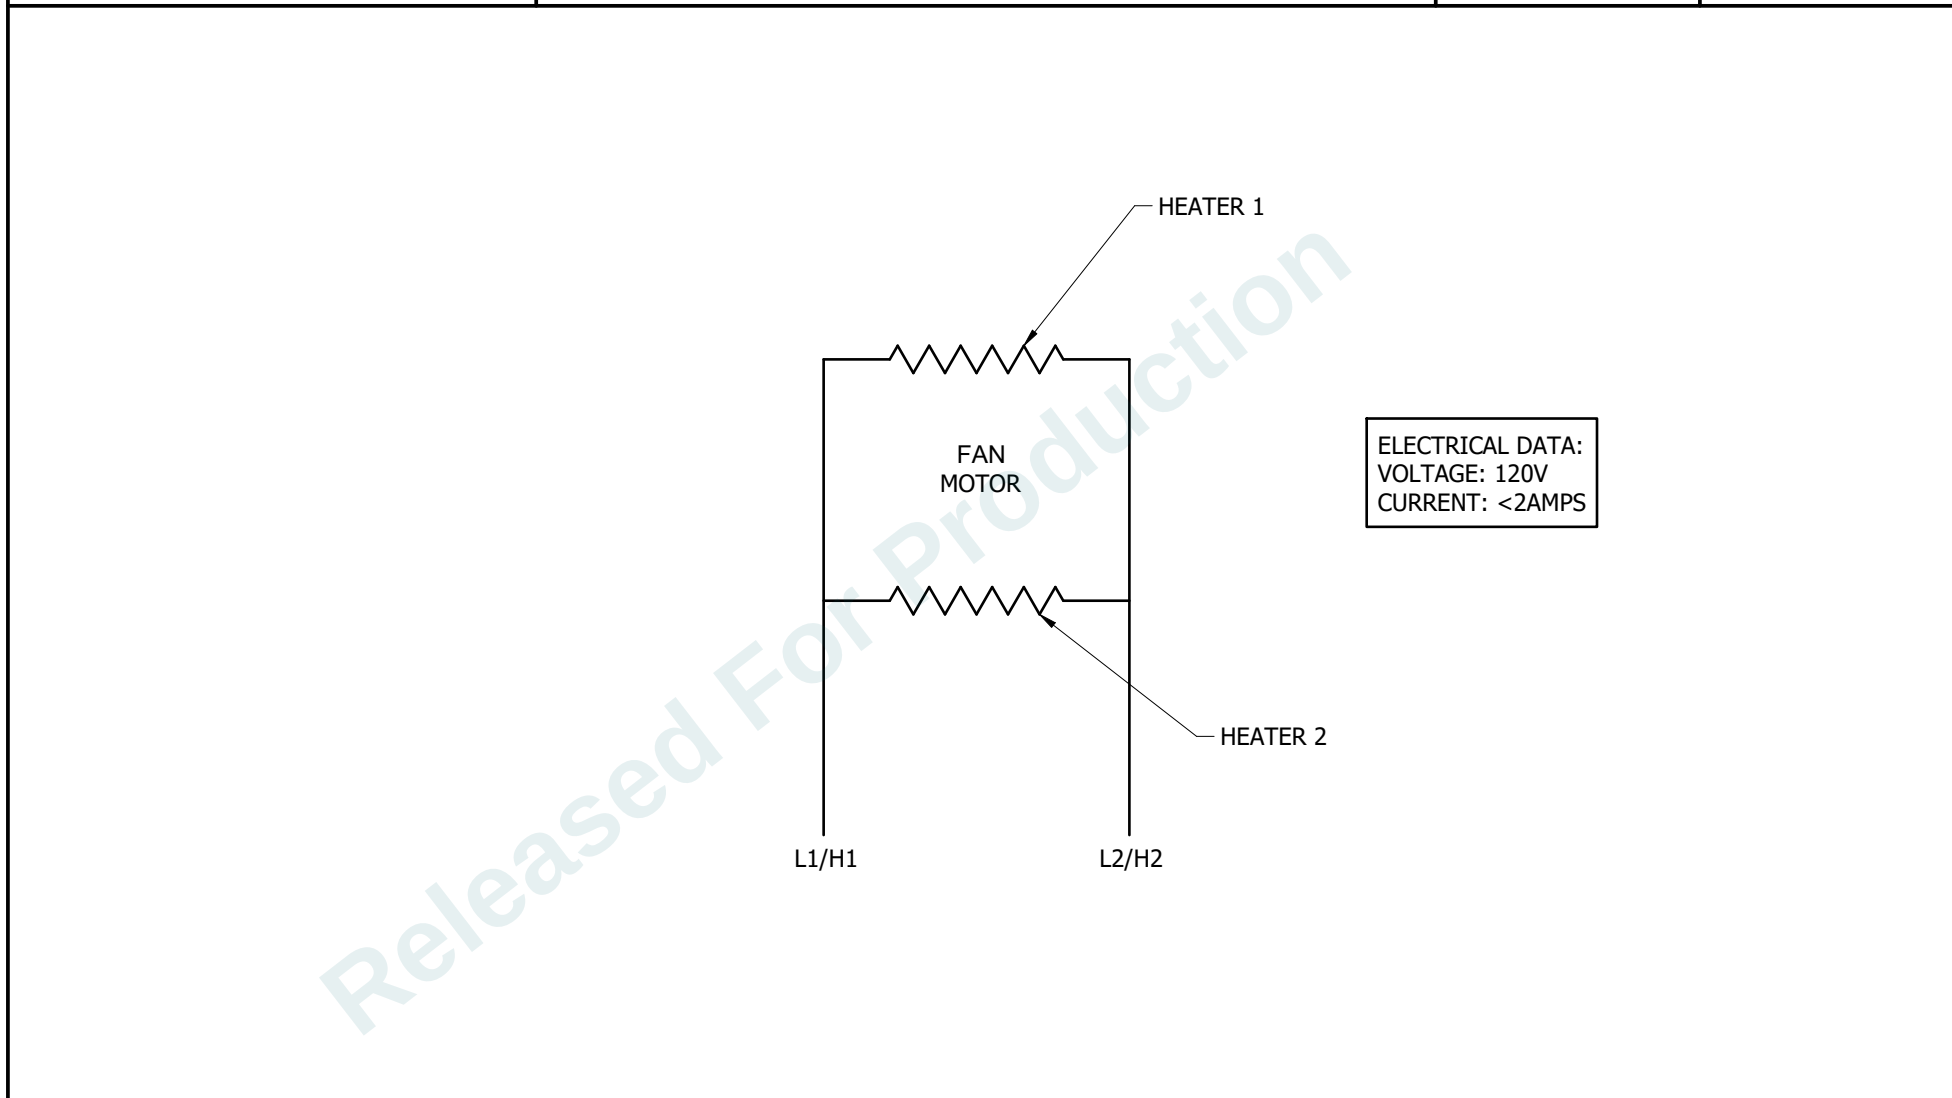

NOTE:

1. FAN MOTOR SPACE HEATERS SHOULD BE ENERGIZED WHEN MOTOR IS OFF TO PREVENT CONDENSATION IN THE MOTOR
2. FAN MOTOR SPACE HEATERS MUST BE SWITCHED OFF WHEN MOTOR IS RUNNING



EVAPCO, Inc.
P.O. Box 1300
Westminster, MD 21158
410-756-2600

Full Speed Complete Sound Data

Sound Pressure Levels (SPL) in dB RE 0.0002 Microbar
Sound Power Levels (PWL) in dB RE 10-12 Watt

Model (1) PMC-1038E (24p147639)
Duplicate 16-778700
Motor 15.00 HP
Motors 4
Speed Full Speed

2 Cell Data

	Sound Pressure Level (dB)											Sound Power Level (db)
	End		Motor Side		Opp End		Opp Mtr. Side		Top			
	5.0 ft (1.5m)	50.0 ft (15.2m)	5.0 ft (1.5m)	50.0 ft (15.2m)	5.0 ft (1.5m)	50.0 ft (15.2m)	5.0 ft (1.5m)	50.0 ft (15.2m)	5.0 ft (1.5m)	50.0 ft (15.2m)		
Band												
63 HZ	88	77	92	83	88	77	84	75	87	75		110
125 HZ	80	70	90	79	79	69	81	68	86	73		106
250 HZ	81	68	98	83	80	67	78	65	89	74		108
500 HZ	77	67	98	84	76	66	72	67	88	74		109
1 KHZ	72	62	96	82	71	61	71	60	84	71		107
2 KHZ	67	57	89	73	66	56	65	56	79	65		99
4 KHZ	63	48	84	70	63	48	56	50	73	57		95
8 KHZ	56	42	80	65	56	42	52	41	72	53		90
Calc dBA	78	68	100	85	78	67	76	67	89	75		111

Sound option(s) selected: None

Remarks:

1. Sound Pressure Levels are according to CTI Standard ATC-128 and verified by an independent CTI-licensed sound test agency
2. Sound Power Levels are calculated according to the Small Units Section 8
3. Sound from free-field conditions over a reflecting plane with +/-2 db(A) tolerance
4. Noise levels can increase with variable frequency drives depending on the drive manufacturer and the drive configuration
5. Complete unit sound data with all fans operating



CERTIFICATE OF COMPLIANCE

Independent Sound Validation

All EVAPCO Cooling Towers, Closed Circuit Coolers and Condensers have been tested in accordance with CTI ATC-128, Test Code for Measurement of Sound from Water-Cooling Towers, by a CTI-licensed independent test agency

As outlined in CTI ATC-128, sound testing was conducted on various EVAPCO cooling towers, closed circuit coolers and condenser models by an independent CTI-licensed sound test agency. Sound pressure levels were recorded in the acoustic near-field and far-field locations. Using certified and calibrated precision sound test instruments per test standards, the sound test agency conducted and verified the analysis.

Applicable Codes:
CTI ATC 128





Heater Package Specifications

Basin heaters in a cooling tower, closed circuit cooler, or evaporative condenser prevent the recirculated water from freezing in the basin when the unit is idle during low ambient conditions. The basin heaters are designed to maintain 40°F (5°C) basin water temperature at 0°F (-18°C) ambient temperature, with options available for -20°F (-29°C) or -40°F (-40°C) ambient temperatures. The heaters are only energized when the recirculating water pumps are off and no water is flowing over the tower/cooler/condenser, and the basin water temperature drops below 40°F (5°C).

EVAPCO Basin Heater Package Includes:

- Copper or Optional Stainless Steel Element Electric Immersion Heater(s)
- Low Water Cutoff (LWCO) Switch
- Thermostat (T-Stat) with Remote Bulb & Well

Location Drawing and Wiring Diagram for Basin Heater Package are included in submittals.

This document shows standard Basin Heater Package components. Please refer to the equipment summary in the submittals for actual components provided.

Electric Immersion Heater(s)

- Heater ratings anywhere from 2 kW – 20 kW. Heater size and quantity is selected based on desired ambient temperature.
- Voltage/phase varies and is selected on order.
- Heater enclosure is an E4 Enclosure with two NPT conduct openings and removable threaded end cap.

1. Nameplate with Volts, Watts, Phase, Catalog Number, Date Code, and EVAPCO Part Number.
2. NPT Screwplug
3. Removable Threaded End Cap
4. NPT conduit opening with Cap Plug
5. NPT conduit opening with Pipe Plug




Figure 3: Heater Enclosure Sketch


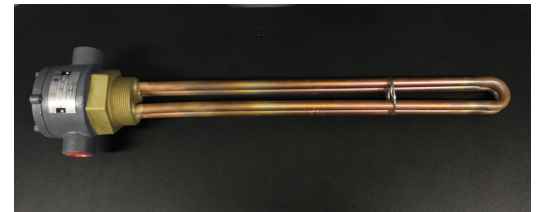


Figure 1: Copper Basin Heater



Figure 2: SST Basin Heater

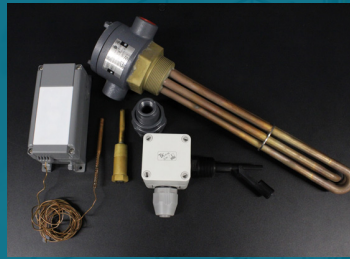

Heater Package Specifications

Low Water Cutoff (LWCO) Switch

If the immersion heater is energized while not submerged in the basin water, the heater element will burnout and fail. The low water cutoff (LWCO) switch prevents heaters from energizing when there is insufficient water depth in the basin.

Specifications

Material of Construction Float/Stem: Polypropylene

Float/Stem Pressure: 50 PSIG (max)

Contact Rating: 10A at 30VDC-240VDC,
1/3HP 120VAC-240VAC

Environmental Rating: NEMA 4X



Figure 4: LWCO with the Cover Removed

Thermostat with Remote Bulb & Well

- Adjustable Thermostat (T-Stat) Control and Remote Bulb is designed to measure basin water temperature. Bulb Well and fitting is provided and located strategically on the basin.
- Watertight gasketed thermoplastic enclosure with concealed temperature setpoint factory set to 40°F (5°C).

Specifications

Temperature Range: 0 to 150°F (-18 to 66°C)

Differential: 5 +/- 2°F (2.82 +/- 1.11°C)

Max Ambient Temperature: 140°F (60°C)

Electrical Rating: 120V/16A

Bulb and Capillary: 3/10 x 2-1/2 in.; 10 ft. Capillary

Environmental Rating: NEMA 4X



Figure 5: T-Stat with Remote Bulb, Bulb Well, & Fitting. T-Stat Cover is Removed Showing the Temperature Setpoint



Basin Heater Control Panel Specifications

EVAPCO Basin Heater Control Panels offer dependable control of basin heaters. EVAPCO offers the Basin Heater Control Panel in various configurations to best suit the customer's need.

Basin Heater Control Panel Options:

1. Contactor
 - When energized, the heavy duty electromechanical relay completes the circuit to allow power to reach the heater(s)
 - Typically, (1) contactor is supplied per basin
 - Disconnect and transformer provided and wired by others
2. Contactor with Disconnect
 - Includes contactor above
 - Disconnect option provides a local, rotary "padlockable" handle which will isolate the contactor(s) from incoming power
 - Transformer provided and wired by others
3. Contactor with Transformer
 - Includes contactor above
 - Transformer generates the required control voltage within the panel
 - Primary and secondary circuit breakers provide overcurrent protection to the transformer and control circuitry
 - Disconnect provided and wired by others
4. Contactor with transformer and disconnect
 - Provides all components shown above

Front View Key

1. Disconnect handle
2. Green status LED pilot light(s)
3. ON/OFF selector switch(es)



Figure 1: Front view of Contactor with Transformer and Disconnect Panel (three contactor example)

Location drawing and wiring diagram for Basin Heater Package are included in submittals. Please refer to the equipment summary in the submittals for actual components provided.



Basin Heater Control Panel Specifications

Specifications

Base Contactor Package

- NEMA 4X outdoor rated fiberglass enclosure
- UL 508A listed for US and Canada
- 575V, 480V, 230V, or 208V 50/60Hz
- Hinged door with screw fasteners
- 120 VAC 50/60 Hz control circuit
- 5,000-amp short circuit current rating (SCCR)

With Disconnect

- Main disconnect with provisions for lock out / tag out padlocks
- Appropriately sized fuse holder and fuses
- Green status LED pilot light per heater circuit
- ON/OFF selector switch per heater circuit

With Transformer

- Class 2 heavy duty transformer
- Primary and secondary circuit breakers to provide overcurrent protection to the transformer and control circuitry
- Green status LED pilot light per heater circuit
- ON/OFF selector switch per heater circuit

Inside View Key

1. Transformer
2. Disconnect
3. Contactor
4. Fuses

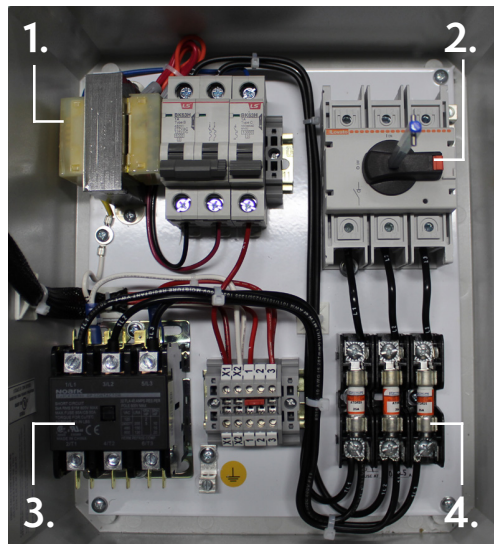


Figure 2: Inside view of Contactor with Transformer and Disconnect Panel



EVAPCO, Inc.
P.O. Box 1300
Westminster, MD 21158
410-756-2600

Customer: Republic Refrigeration, Inc.

Project: Wayne Farms - Union Springs, AL - Cond's. (Condenser)

EXPRESS WARRANTY

Open Cooling Towers, Evaporative Closed Circuit Coolers and Evaporative Condensers

MANUFACTURER'S EXPRESS WARRANTY

EVAPCO warrants the unit(s) identified above against failure caused by defects in materials and workmanship for a period of twelve (12) months from the date of installation, not to exceed eighteen (18) months from the date of shipment from EVAPCO when installation is completed in accordance with good practices. This twelve (12) month product warranty covers the entire unit including electrical components. Labor costs associated with any repair work performed under the terms of the warranty are NOT included within the warranty. Damage caused by misuse of the product, including without limitation failure to properly install or maintain the product, is NOT covered by the warranty.

In addition to the warranty provided above, EVAPCO warrants the mechanical equipment components of the subject unit(s) against failure caused by defects in materials and workmanship for a period of five (5) years from the date of shipment from EVAPCO. Mechanical equipment components include fans, fan motors, bearings, pulleys, shafts, belts, gear reducers, drive shafts, drive couplings, and mechanical equipment supports.

In addition to the warranty provided above, if the unit is provided with stainless cold water basin construction, or all stainless construction, EVAPCO warrants the non-mechanical components of the subject unit(s) against failure caused by defects in materials and workmanship for a period of five (5) years from the date of shipment from EVAPCO. Such non-mechanical components include panels, drift eliminators and drift eliminator supports, air inlet louvers and air inlet louver supports, spray header and spray header supports, fill and fill supports (if applicable), coil supports (if applicable), fan deck, fan cylinder, fan screen and fan screen supports.

In addition to the warranty provided above, if the unit is provided with stainless steel (Titan-Pak®) coils, EVAPCO warrants the coil against failure caused by defects in materials and workmanship for a period of five (5) years from the date of shipment from EVAPCO. If the unit is not provided with a stainless steel coil, the coil is covered only by the 12-month product warranty in the first paragraph.

In addition to the unit warranty above, EVAPCO warrants the thermal performance of the unit as shown on the certified drawings delivered to the customer for a period of one-year from the date installation is completed in accordance with good engineering practices, but in no event shall such warranty period exceed eighteen (18) months from the date the unit is shipped by EVAPCO. If, after installation and start-up, there is any question regarding thermal performance of the equipment, at the owner's request EVAPCO will send its engineers to the jobsite to conduct a performance test. This test may be observed by the owner and the consulting engineer or by their authorized representatives. If the results of the evaluation show the equipment to be deficient, EVAPCO will make the necessary repairs or alterations to correct the deficiency subject to the limitations set forth below. If the equipment is found to be performing in accordance with its certified capacity, the owner will reimburse EVAPCO for all direct expenses incurred in connection with such performance test.

These warranties are predicated on EVAPCO receiving payment in full on the covered products and on unit operation and maintenance in accordance with EVAPCO's recommended operation and maintenance procedures. Ordinary wear is NOT covered by the warranties. Moreover, the erosion, corrosion, and/or deterioration of the products are not covered by any warranty. Any changes to warranty terms must be approved in writing by an EVAPCO officer.

LIMITATION OF LIABILITY

THE SOLE REMEDY FOR BREACH OF THE EXPRESS WARRANTIES DESCRIBED HEREIN SHALL BE REPAIR OR REPLACEMENT OF THE EQUIPMENT BY EVAPCO, OR REFUNDING THE PURCHASE PRICE SET FORTH ON THE PURCHASE ORDER. IT SHALL BE IN EVAPCO'S SOLE DISCRETION AS TO WHETHER REPAIR, REPLACEMENT OR REFUND IS THE OFFERED REMEDY. IF EVAPCO DECIDES TO MAKE REPAIRS, EVAPCO HAS THE OPTION OF COMPLETING ALL NECESSARY REPAIRS ITSELF, OR AUTHORIZING A THIRD PARTY TO PERFORM SUCH REPAIRS AT EVAPCO'S EXPENSE. EVAPCO IS NOT RESPONSIBLE FOR ANY REPAIR WORK PERFORMED BY A THIRD PARTY THAT EVAPCO DID NOT PRE-APPROVE IN WRITING. EVAPCO IS ONLY RESPONSIBLE FOR COSTS THAT PERTAIN TO REPAIR OR REPLACEMENT OF EQUIPMENT SUPPLIED BY EVAPCO (i.e., EVAPCO IS NOT RESPONSIBLE FOR REPLACEMENT OR MODIFICATION OF PIPING, SUPPORTING STEEL, ELECTRICAL WIRING, MOTOR STARTERS OR IN AND OUT COSTS SUCH AS THIRD PARTY LABOR, CRANE OR OTHER EQUIPMENT FEES).

NOTWITHSTANDING ANYTHING ELSE IN THIS DOCUMENT, EVAPCO'S LIABILITY OF ANY KIND WHATSOEVER SHALL NOT EXCEED THE PURCHASE PRICE SET FORTH ON THE PURCHASE ORDER. UNDER NO CIRCUMSTANCES SHALL EVAPCO BE LIABLE FOR LOST PROFITS, LOST SAVINGS, PERSONAL INJURIES, INCIDENTAL DAMAGES, ECONOMIC LOSS, PROPERTY DAMAGE, OR ANY OTHER CONSEQUENTIAL, INDIRECT, INCIDENTAL, OR PUNITIVE DAMAGES, EVEN IF EVAPCO HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES. IN ADDITION, EVAPCO SHALL NOT BE RESPONSIBLE FOR ANY INJURIES OR DAMAGES OF ANY KIND WHATSOEVER UNDER ANY THEORY OF TORT TO THE EXTENT THE INJURIES OR DAMAGE ARE CAUSED BY THE MISUSE OF THE PRODUCT BY BUYER OR ANY THIRD PARTY.

DISCLAIMER OF IMPLIED WARRANTIES

OTHER THAN THE EXPRESS MANUFACTURER'S WARRANTY DESCRIBED HEREIN, THE UNIT IS SOLD "AS IS" AND THERE ARE NO OTHER WARRANTIES. EVAPCO HEREBY DISCLAIMS AND EXCLUDES ALL IMPLIED WARRANTIES OF ANY KIND WHATSOEVER, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY, THAT THE UNIT IS FIT FOR A PARTICULAR USE OR PURPOSE, THAT THE UNIT IS FIT FOR A PARTICULAR APPLICATION OR ENVIRONMENT, AND ANY WARRANTIES THAT MIGHT OTHERWISE ARISE OUT OF A COURSE OF DEALING BETWEEN THE PARTIES OR USAGE OF TRADE. IN THE INTEREST OF PRODUCT IMPROVEMENT, EVAPCO RESERVES THE RIGHT TO CHANGE SPECIFICATIONS AND PRODUCT DESIGN WITHOUT INCURRING ANY LIABILITY THEREFOR.



CERTIFICATE OF COMPLIANCE

PMCE Condensers
are certified to meet or exceed the Seismic and Wind Load Provisions
set forth in the applicable building codes for this project.

These products have been manufactured following all applicable quality assurance programs.

Applicable Codes:

2015 IBC
ASCE/SEI 7-16
NFPA 5000

Importance Factor:

1.0





Guarantee of Thermal Performance

EVAPCO unequivocally guarantees the thermal performance of its equipment as shown on the certified drawings, when the equipment is installed in accordance with good engineering practice. If after installation and start-up there is any question regarding thermal performance of the equipment, at the owner's request EVAPCO will send its engineers to the jobsite to conduct a performance test. This test may be observed by the owner and the consulting engineer or by their authorized representatives. If the results of the evaluation show the equipment to be deficient, EVAPCO will make the necessary repairs or alterations to correct the deficiency at no cost to the owner. If the equipment is found to be performing in accordance with its certified drawing, the owner is expected to reimburse the company for its costs associated with this performance test. This guarantee is subject to all conditions and limitations set forth in the express warranty that applies to the equipment.

