



EVAPCO, Inc.  
P.O. Box 1300  
Westminster, MD 21158  
410-756-2600

April 18, 2022

REPUBLIC REFRIGERATION  
2810 Gray Fox Rd  
Monroe, North Carolina 28110-8422

Project: Wayne Farms - Union Springs, AL (Wayne Farms 007CD)  
Purchase Order(s): MQ-CR2112E 30247  
Unit (Serial No): (8) SSTWE 4-37S44E0075F1LA-RH (21p116307 - 14 )  
*Debone Room*

Enclosed is the record submittal data for the order referenced above.

This order is being manufactured at our Taneytown factory using the highest quality materials and will be assembled in accordance with EVAPCO's strict quality control guidelines. All EVAPCO products undergo a mechanical test prior to shipment to ensure proper field performance.

This order is in our production schedule for shipment on or before 05/20/2022. If you experience any delays in the project that would affect your shipment requirements, please contact your local EVAPCO representative, Southern Equipment Sales Co., as soon as possible.

Thank you for selecting EVAPCO as your supplier. We appreciate your business and look forward to working with you in the future.

Sincerely,

EVAPCO, Inc.

***Brett Alexander***

Brett Alexander

Sr. Marketing Engineer

ENCLOSURE(S)

Cc: Southern Equipment Sales Co. - Chris Dreher



EVAPCO, Inc.  
 P.O. Box 1300  
 Westminster, MD 21158  
 410-756-2600

Customer: REPUBLIC REFRIGERATION

Project: Wayne Farms - Union Springs, AL (Wayne Farms 007CD)

Engineer: Wayne Farms

Purchase Order(s): MQ-CR2112E 30247

Unit (Serial No): (8) SSTWE 4-37S44E0075F1LA-RH (21p116307 - 14 )  
*Debone Room*

| Revision | Date              | Description                                                                                                                                                                                                                                                                                                                                              |
|----------|-------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Original | December 20, 2021 | Original Submittal                                                                                                                                                                                                                                                                                                                                       |
| 1        | April 18, 2022    | Å Add Customization Accessory Location<br>Å Added Unit Certified Drawing (Custom Unit Certified)<br>Å Modify Release/Un-Release<br>Å Modify Release/Un-Release<br>Å Modify Release/Un-Release<br>Å Modify Release/Un-Release<br>Å Modify Release/Un-Release<br>Å Modify Release/Un-Release<br>Å Modify Release/Un-Release<br>Å Modify Release/Un-Release |
| 2        | April 18, 2022    | Å Add Customization Other                                                                                                                                                                                                                                                                                                                                |



EVAPCO, Inc.  
P.O. Box 1300  
Westminster, MD 21158  
410-756-2600

Customer: REPUBLIC REFRIGERATION



Project: Wayne Farms - Union Springs, AL (Wayne Farms 007CD)

Engineer: Wayne Farms

Unit (Serial No): (8) SSTWE 4-37S44E0075F1LA-RH (21p116307 - 14 )  
Debone Room

| Submittal Information                                                                        |                   |          |
|----------------------------------------------------------------------------------------------|-------------------|----------|
| Document                                                                                     | Drawing No.       | Page No. |
| (8) SSTWE 4-37S44E0075F1LA-RH [Evaporators] (21p116307 - 14 )<br>Debone Room<br>8 Right Hand |                   |          |
| Unit Certified Drawing ()                                                                    | 21P116307-14_Rev1 | 3 - 4    |
| Additional Documents                                                                         |                   |          |
| Evaporator Express Warranty                                                                  |                   | 5        |
| Performance Guarantee                                                                        |                   | 6        |



**UNIT IS OUTSIDE OF THE SCOPE OF AHRI UNIT COOLERS  
CERTIFICATION PROGRAM, BUT IS RATED IN ACCORDANCE  
WITH AHRI STANDARD 420.**

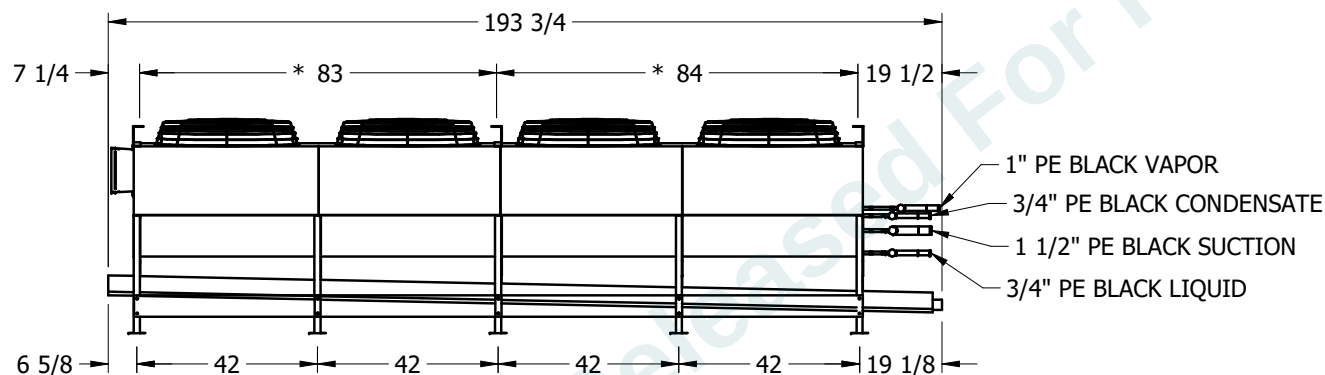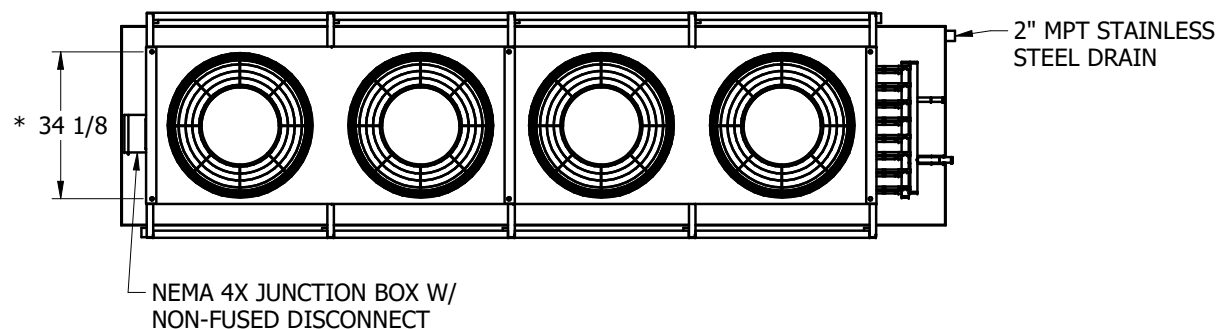


**NOTES:**

- (1) ALL HANGER HOLES ARE 13/16Ø; ALL LEGS ARE REMOVABLE.
- (2) THE EVAPORATOR CONNECTION SIZES (SHOWN) DO NOT NECESSARILY CORRESPOND TO THE APPROPRIATE SYSTEM PIPE SIZES.
- (3) DO NOT SCALE DRAWING. CONNECTION LOCATIONS ARE APPROXIMATE; DO NOT USE FOR FABRICATION OF PIPING.
- (4) 5.0 PSI LIQUID FEED PRESSURE REQUIRED ABOVE COIL SATURATED SUCTION PRESSURE.

**\*HANGER HOLE LOCATIONS**

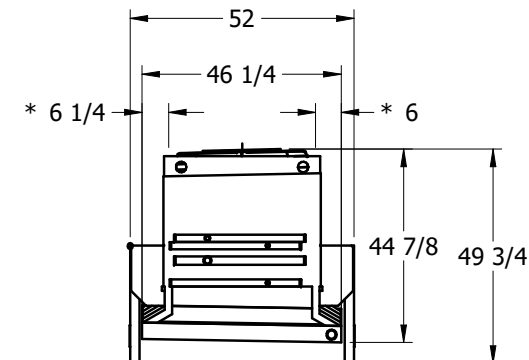

|                                                                                                                                                                                                                                                                                                                                                                                                        |   |       |                          |                                 |              |                                    |                        |         |                                                                                                                                                                                                        |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---|-------|--------------------------|---------------------------------|--------------|------------------------------------|------------------------|---------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| QTY.                                                                                                                                                                                                                                                                                                                                                                                                   | 8 | MODEL | SSTWE4-37S44E0075F1LA-RH | SERIAL NUMBER                   | 21P116307-14 | CERTIFIED FOR                      | REPUBLIC REFRIGERATION | PROJECT | WAYNE FARMS - UNION SPRINGS, AL                                                                                                                                                                        |
| APPLICATION RATING:                                                                                                                                                                                                                                                                                                                                                                                    |   |       |                          | [X] WET [ ] DRY                 |              | FAN/MOTOR DATA:                    |                        |         | PHYSICAL DATA:                                                                                                                                                                                         |
| 13.65 TONS ( 163,762 BTUH) @ 13.5°F TD                                                                                                                                                                                                                                                                                                                                                                 |   |       |                          | 20,922 CFM @ 0" ESP             |              | *** ESTIMATED REFRIGERANT CHARGE   |                        |         | ROOM                                                                                                                                                                                                   |
| 50°F ROOM TEMP. 36.5°F SST 47.3°F WB                                                                                                                                                                                                                                                                                                                                                                   |   |       |                          | 560 FPM FACE VELOCITY           |              | 37.3 SQ. FT. FACE AREA             |                        |         | REFERENCE                                                                                                                                                                                              |
| R-717 REFRIGERANT BOTTOM FEED                                                                                                                                                                                                                                                                                                                                                                          |   |       |                          | ( 4 ) 0.75 HP TEAO FAN MOTOR(S) |              | ** CU. FT. COIL VOLUME             |                        |         | APP. VERSION                                                                                                                                                                                           |
| 36.5°F LIQ. FEED TEMP. 1.2:1 RECIRC. RATE                                                                                                                                                                                                                                                                                                                                                              |   |       |                          | 1160 RPM 460/3/60 SERVICE       |              | ** ROWS DEEP 4.3 FPI               |                        |         | 6.1.3                                                                                                                                                                                                  |
| 86 dBA @ 6 FT PER UNIT, FREE FIELD                                                                                                                                                                                                                                                                                                                                                                     |   |       |                          | 1.7 DESIGN MOTOR AMPS           |              | 2,116 LBS. NORMAL OPERATING WEIGHT |                        |         | <div><p>P.O. Box 1300<br/>Westminster, Maryland 21158 USA<br/>Phone (410)756-2600<br/>Fax (410)756-6450</p></div> |
|                                                                                                                                                                                                                                                                                                                                                                                                        |   |       |                          | 30" FAN DIAMETER                |              | 1,918 LBS. SHIPPING WEIGHT         |                        |         |                                                                                                                                                                                                        |
| REMARKS: STAINLESS STEEL EMBOSSED TUBE, ENHANCED ALUMINUM FIN COIL, STAINLESS STEEL CASING, PAN AND PAN COVER, STAINLESS STEEL FAN SCREENS, AIR DEFROST, PREMIUM EFFICIENCY INVERTER READY WASH DOWN DUTY MOTORS, EXTENDED WIDTH PAN, END DRAIN, NON-FUSED DISCONNECT, **4 ROWS COOLING @ 1.8 CU. FT., 2 ROWS REHEAT @ 0.9 CU. FT., ***ESTIMATED REFRIGERANT CHARGE 10.05 LBS COOLING, 5.26 LBS REHEAT |   |       |                          |                                 |              |                                    |                        |         | REV: 1) 2/9/22 AMS DATE: 1/15/22 MRN                                                                                                                                                                   |

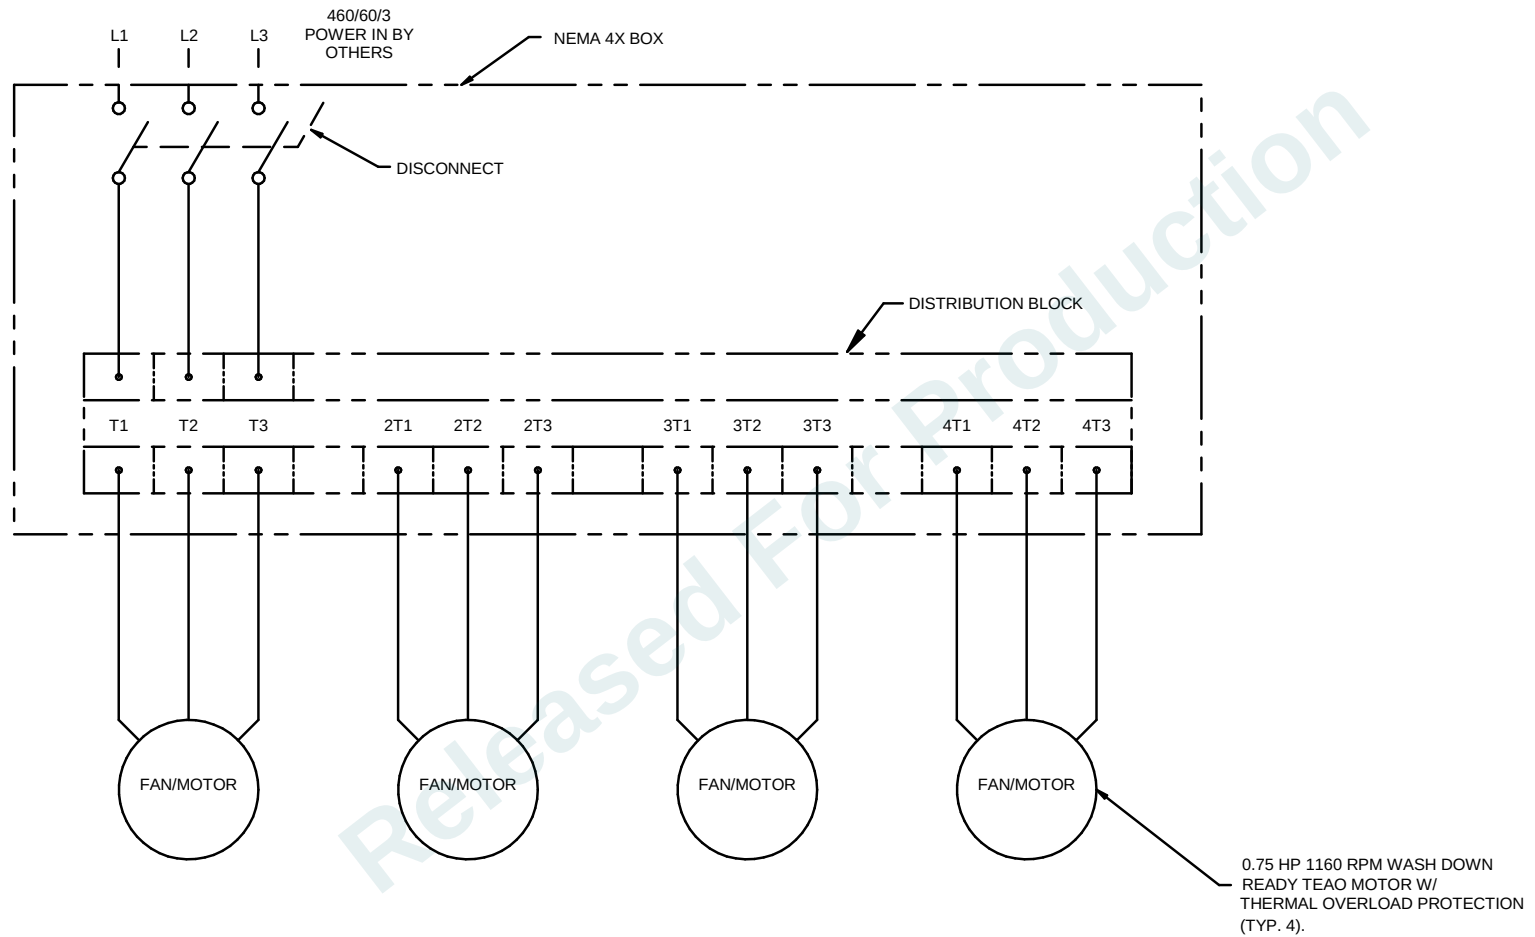

|                                                                                                                                                            |   |       |                          |        |        |              |           |                      |                        |                                                          |                                 |              |
|------------------------------------------------------------------------------------------------------------------------------------------------------------|---|-------|--------------------------|--------|--------|--------------|-----------|----------------------|------------------------|----------------------------------------------------------|---------------------------------|--------------|
| QTY.                                                                                                                                                       | 8 | MODEL | SSTWE4-37S44E0075F1LA-RH | SERIAL | NUMBER | 21P116307-14 | CERTIFIED | FOR                  | REPUBLIC REFRIGERATION | PROJECT                                                  | WAYNE FARMS - UNION SPRINGS, AL |              |
| <div>CONFIDENTIAL</div> <div>This document is the property of Evapco, Inc. It should not be copied or disclosed without prior written authorization.</div> |   |       |                          |        |        |              | TITLE     | ELECTRICAL SCHEMATIC |                        | <div>DRAWN BY</div> <div>MRN</div> <div>CHECKED BY</div> |                                 | EVAPCO, INC. |



EVAPCO, Inc.  
P.O. Box 1300  
Westminster, MD 21158  
410-756-2600

Customer: REPUBLIC REFRIGERATION

Project: Wayne Farms - Union Springs, AL (Wayne Farms 007CD)

Engineer: Wayne Farms

Unit (Serial No): (8) SSTWE 4-37S44E0075F1LA-RH (21p116307 - 14 )  
*Debone Room*

## EVAPORATOR EXPRESS WARRANTY

### MANUFACTURER'S EXPRESS WARRANTY

EVAPCO warrants the unit identified above against failure caused by defects in materials and workmanship for one (1) year from the date of installation according to good engineering practices, but not to exceed eighteen (18) months from the date of shipment by EVAPCO. This warranty includes all structural components, coil, hot gas coil and pan (if supplied by EVAPCO), electric motors, shafts, bearings, pulleys, mechanical equipment supports, fan belts, fans, fan screens and their supports, and electrical components. Labor costs associated with any repair work performed under the terms of the warranty are NOT included within the warranty. Damage caused by misuse of the product, including without limitation failure to properly install or maintain the product, is NOT covered by the warranty.

In addition to the unit warranty above, EVAPCO warrants the thermal performance of the unit as shown on the certified drawings delivered to the customer for a period of one (1) year from the date installation is completed in accordance with good engineering practices, but in no event shall such thermal performance warranty period exceed eighteen (18) months from the date the unit is shipped by EVAPCO. If after installation and start-up there is any question regarding thermal performance of the equipment, and the warranty period has not lapsed, at the owner's request EVAPCO will send its engineers to the jobsite to conduct a performance test. This test may be observed by the owner and the consulting engineer or by their authorized representatives. If the results of the evaluation show the equipment to be deficient, EVAPCO will make the necessary repairs or alterations to correct the deficiency subject to the limitations set forth below. If the equipment is found to be performing in accordance with its certified capacity, the owner will reimburse EVAPCO for all direct expenses incurred in connection with such performance test.

### LIMITATION OF LIABILITY

THE SOLE REMEDY FOR BREACH OF THE EXPRESS WARRANTIES DESCRIBED HEREIN SHALL BE REPAIR OR REPLACEMENT OF THE EQUIPMENT BY EVAPCO, OR REFUNDING THE PURCHASE PRICE SET FORTH ON THE PURCHASE ORDER OR ORDER ACKNOWLEDGEMENT. IT SHALL BE IN EVAPCO'S SOLE DISCRETION AS TO WHETHER REPAIR, REPLACEMENT OR REFUND IS THE OFFERED REMEDY. IF EVAPCO DECIDES TO MAKE REPAIRS, EVAPCO HAS THE OPTION OF COMPLETING ALL NECESSARY REPAIRS ITSELF, OR AUTHORIZING A THIRD PARTY TO PERFORM SUCH REPAIRS AT EVAPCO'S EXPENSE. EVAPCO IS NOT RESPONSIBLE FOR ANY REPAIR WORK PERFORMED BY A THIRD PARTY THAT EVAPCO DID NOT PREAPPROVE IN WRITING. EVAPCO IS ONLY RESPONSIBLE FOR COSTS THAT PERTAIN TO REPAIR OR REPLACEMENT OF EQUIPMENT SUPPLIED BY EVAPCO (i.e., EVAPCO IS NOT RESPONSIBLE FOR REPLACEMENT OR MODIFICATION OF PIPING, SUPPORTING STEEL, ONSITE ELECTRICAL WIRING, MOTOR STARTERS OR IN AND OUT COSTS SUCH AS THIRD PARTY LABOR, CRANE OR OTHER EQUIPMENT FEES).

NOTWITHSTANDING ANYTHING ELSE IN THIS DOCUMENT, EVAPCO'S LIABILITY OF ANY KIND WHATSOEVER SHALL NOT EXCEED THE PURCHASE PRICE SET FORTH ON THE PURCHASE ORDER OR ORDER ACKNOWLEDGEMENT. UNDER NO CIRCUMSTANCES SHALL EVAPCO BE LIABLE FOR LOST PROFITS, LOST SAVINGS, PERSONAL INJURIES, INCIDENTAL DAMAGES, ECONOMIC LOSS, REFRIGERANT LOSS, PRODUCT LOSS, PROPERTY DAMAGE, OR ANY OTHER CONSEQUENTIAL, INDIRECT, INCIDENTAL, OR PUNITIVE DAMAGES, EVEN IF EVAPCO HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES. In addition, EVAPCO shall not be responsible for any injuries or damages of any kind whatsoever under any theory of tort to the extent the injuries or damage are caused by misuse of the product by buyer or any third party.

### DISCLAIMER OF IMPLIED WARRANTIES

OTHER THAN THE EXPRESS MANUFACTURER'S WARRANTY DESCRIBED HEREIN, THE UNIT IS SOLD AS IS AND THERE ARE NO OTHER WARRANTIES. EVAPCO HEREBY DISCLAIMS AND EXCLUDES ALL IMPLIED WARRANTIES OF ANY KIND WHATSOEVER, INCLUDING WITHOUT LIMITATION WARRANTIES OF MERCHANTABILITY, THAT THE UNIT IS FIT FOR A PARTICULAR USE OR PURPOSE, THAT THE UNIT IS FIT FOR A PARTICULAR APPLICATION OR ENVIRONMENT, AND ANY WARRANTIES THAT MIGHT OTHERWISE ARISE OUT OF A COURSE OF DEALING BETWEEN THE PARTIES OR USAGE OF TRADE.



# Guarantee of Thermal Performance

EVAPCO unequivocally guarantees the thermal performance of its equipment as shown on the certified drawings, when the equipment is installed in accordance with good engineering practice. If after installation and start-up there is any question regarding thermal performance of the equipment, at the owner's request EVAPCO will send its engineers to the jobsite to conduct a performance test. This test may be observed by the owner and the consulting engineer or by their authorized representatives. If the results of the evaluation show the equipment to be deficient, EVAPCO will make the necessary repairs or alterations to correct the deficiency at no cost to the owner. If the equipment is found to be performing in accordance with its certified drawing, the owner is expected to reimburse the company for its costs associated with this performance test. This guarantee is subject to all conditions and limitations set forth in the express warranty that applies to the equipment.

