


WIRE TO CUSTOMER SUPPLIED
LISTED FUSED DISCONNECT OR BREAKER FOR
BRANCH CIRCUIT PROTECTION SUPPLYING
460VAC, 3 PHASE, 60HZ

CB SIZE	MAX AMPS	MIN. WIRE SIZE
30A	24A	#10AWG
60A	48A	#6AWG
100A	80A	#3AWG

*FIELD WIRING TO FOLLOW NEC OR LOCAL
ELECTRICAL CODES

FACTORY 3PH MOTOR STARTER WIRING
#12AWG (BLACK) FOR UP TO 16FLA
#10AWG (BLACK) FOR 17 TO 25FLA
#8AWG (BLACK) FOR 26 TO 50FLA

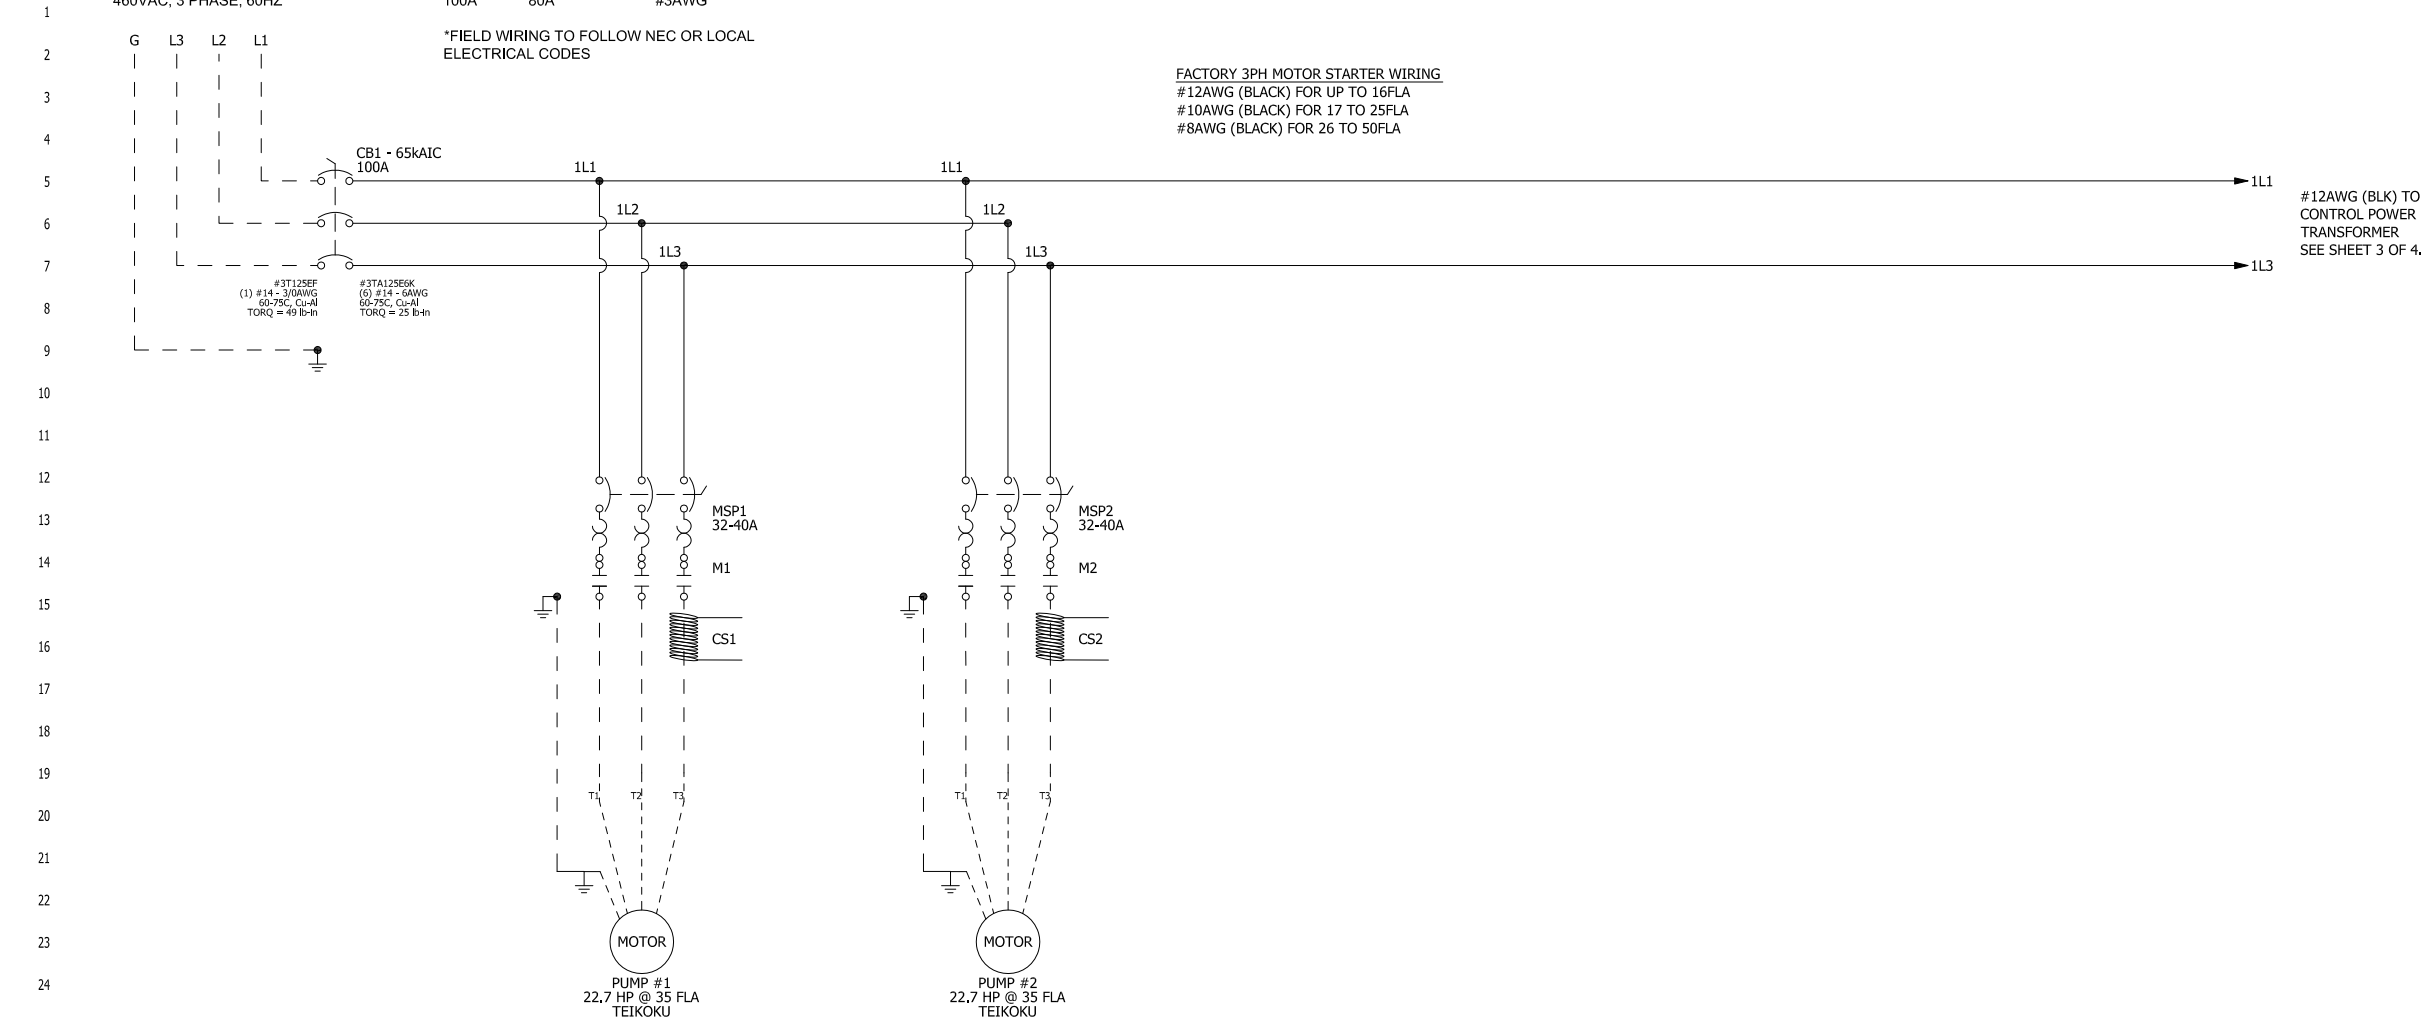

● CONTROL FIELD TERMINAL
○ IO BOARD TERMINAL
◇ VFD TERMINAL

--- FIELD WIRING
- - - RVS WIRING
_____ PANEL FACTORY WIRING

(R) RED WIRE - 120VAC HOT
(W) WHITE WIRE - 120VAC NEUTRAL
(G) GREEN GROUND WIRE
(Y) YELLOW WIRE - POWER FROM REMOTE SOURCE, USE CAUTION.
(BLU) BLUE WIRE - +24VDC OR POSITIVE VOLTAGE
(BLK) BLACK WIRE - VDC COMMON VOLTAGE

○ DIGITAL OUTPUT
○ DIGITAL INPUT

CERTIFIED

RVS PROJECT No.: 333821		EVAPCO S/N: 19-864101	
CONFIDENTIAL			
THIS DOCUMENT CONTAINS PROPRIETARY ENGINEERING DESIGNS WHICH ARE THE PROPERTY OF REFRIGERATION VALVES & SYSTEMS CORPORATION. IT SHOULD NOT BE DISCLOSED OR USED TO REPLICATE THE PRODUCT WITHOUT PRIOR WRITTEN AUTHORIZATION.			
CUSTOMER		P.O.	
UNI-TEMP REFRIGERATION, INC.		0026267	
REVISIONS			
Rev.	DATE	BY	DESCRIPTION
0	2-12-19	JYG	CERTIFIED & SENT TO CUSTOMER
1	3-21-19	JYG	REVISED PER ENGINEERING
TITLE			
MATRIX II - CHARLIE TYPE 4, SINGLE IO BOARD WIRING DIAGRAM			
DRAWN		CHK'D	
BY: JYG 2-12-19		BY: KB 2-12-19	
APR'D		SCALE: N/A	
BY: KB 2-12-19		S/N: N/A	
DWG No.		REV.	
333821E2		1	